

CITY STANDARD ACCESSORY DWELLING UNIT

ADU: 1,199 L-SHAPE

CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

Release Date: 03/22/2024

Release #: A

DEVELOPMENT STANDARDS

EXISTING LOT COVERAGE: _____

*PROPOSED LOT COVERAGE: _____

MAX. LOT COVERAGE: _____

EXISTING FLOOR AREA RATIO: _____

*PROPOSED FLOOR AREA RATIO: _____

MAX. FLOOR AREA RATIO: _____

PROPOSED BUILDING HEIGHT: _____

NO. OF STORIES: _____

DETACHED MAX SIZE: 1,200 SF

HEIGHT LIMIT: 16'-0"

*ADU SETBACKS: 4'

*ADU TO PDU MIN. DISTANCE: 10'

ADDITIONAL PARKING REQUIREMENT ☐ YES ☐ NO

PER CVMC 19.58.022(C)(7):

THE DISTANCE OF THE PROPOSED DETACHED ADU FROM THE TOP AND BOTTOM OF THE SLOPE SHALL MEET CRC SECTION R403.1.7 (SEE SITE PLAN NOTES ON SHEET G101).

1 SEE CALCULATIONS ON SHEET A011.

2 ADU'S LOCATED BETWEEN 3 FEET AND 5 FEET OF THE PROPERTY LINES SHALL REQUIRE FIRE RATED EAVES AND WALLS PER DETAILS LOCATED IN THIS SET.

3 EXISTING PRIMARY DWELLING UNIT (PDU).

UTILITY DATA

EXISTING MAIN SERVICE PANEL BREAKER SIZE: _____

EXISTING MAIN SERVICE PANEL BUS RATING: _____

PROPOSED SUB PANEL ON ADU BREAKER SIZE: 150A

PROPOSED SUB PANEL ON ADU BUS RATING: 150A BUS RATING

CIRCUIT BREAKER ON MAIN SERVICE PANEL FEEDING THE ADU: 150A

EXISTING WATER METER SIZE: _____

EXISTING WATER METER LATERAL SIZE: _____

WATER METER UPGRADE REQUIRED: _____

* CONTACT LOCAL UTILITY COMPANIES REGARDING GAS AND ELECTRIC SERVICES TO THIS DETACHED ADU.

** SEE ELECTRICAL SERVICE SELECTION REQUIREMENTS ON SHEET G102.

ZONING SETBACKS

ZONING: _____

FRONT YARD: _____

SIDE YARDS: _____

SIDE STREET YARDS: _____

REAR YARD: _____

BETWEEN BUILDINGS: _____

DESIGN TEAM

OWNER

CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER

SnapADU
CONTACT: LUIS CALDERON
LICENSE: 1075582
YUCCA ROAD
OCEANSIDE, CA 92054
PHONE: 760.259.2476
EMAIL: PERMITS@SNAPADU.COM

STRUCTURAL ENGINEER

CONTACT: PAUL CHRISTENSON
LICENSE: C-057182
PHONE: 760.207.1885
EMAIL: PAUL.PCSD@GMAIL.COM

TITLE 24 CONSULTANT

SOCAL TITLE-24
CONTACT: KEN PONCE
PHONE: 909.294.5822
EMAIL: KEN@SOCALTITLE24.COM

LEGAL

EXISTING ADDRESS: _____

ADU ADDRESS: _____

ASSESSOR'S PARCEL NUMBER: _____

JURISDICTION: CITY OF CHULA VISTA

LEGAL DESCRIPTION: _____

LOT AREA (ACRES): _____

LOT AREA (SQ. FT.): _____

BUILDING DATA

BUILDING OCCUPANCY GROUP: R-3

CONSTRUCTION TYPE: TYPE V-B

FIRE ZONING (CHECK ONE): _____(N/A) _____(VHFSZ)

EXISTING BUILDING USE: SINGLE FAMILY DWELLING

EXISTING BUILDING AREA: SQ. FT.

EXISTING GARAGE AREA: SQ. FT.

EXISTING BUILDING YEAR BUILT: _____

EXISTING BUILDING SPRINKLERED (YES/NO): _____

PROPOSED BUILDING USE: DETACHED ADU

PROPOSED BUILDING AREA: 1,199 SF


PROPOSED BUILDING HEIGHT: 12'-4 1/2"

PROPOSED BUILDING SPRINKLERED (YES/NO): _____

NUMBER OF STORIES: 1

* WHEN LOCATED IN THE VHFSZ, VHFSZ NOTES ON SHEET G102 AND DETAILS 1, THROUGH 3, ON SHEET A500; 1, THROUGH 6, AND 12, ON SHEET A510; 1, THROUGH 6, AND 12, ON SHEET A520; 1, THROUGH 6, AND 12, ON SHEET A530 ARE APPLICABLE TO THIS PROJECT.

VICINITY MAP



SHEET INDEX

ARCHITECTURE

REV.	SHEET #	DRAWING TITLE
A	G100	TITLE SHEET
A	G101	GENERAL NOTES
A	G102	CHECKLIST
A	G200	CODE COMPLIANCE NOTES
A	G201	CODE COMPLIANCE NOTES
A	G300	CAL-GREEN REQUIREMENTS
A	G301	CAL-GREEN REQUIREMENTS
A	G400	TITLE 24 - 3-BEDROOM SOG - CZ10
A	G401	TITLE 24 - 3-BEDROOM SOG - CZ10
A	G402	TITLE 24 - 3-BEDROOM SOG - CZ7
A	G403	TITLE 24 - 3-BEDROOM SOG - CZ7
A	G410	TITLE 24 - 3-BEDROOM RF - CZ10
A	G411	TITLE 24 - 3-BEDROOM RF - CZ10
A	G412	TITLE 24 - 3-BEDROOM RF - CZ7
A	G413	TITLE 24 - 3-BEDROOM RF - CZ7
A	G420	TITLE 24 - 2-BEDROOM SOG - CZ10
A	G421	TITLE 24 - 2-BEDROOM SOG - CZ10
A	G422	TITLE 24 - 2-BEDROOM SOG - CZ7
A	G423	TITLE 24 - 2-BEDROOM SOG - CZ7
A	G430	TITLE 24 - 2-BEDROOM RF - CZ10
A	G431	TITLE 24 - 2-BEDROOM RF - CZ10
A	G432	TITLE 24 - 2-BEDROOM RF - CZ7
A	G433	TITLE 24 - 2-BEDROOM RF - CZ7
A	G440	SPR MANDATORY MEASURES
A	C100	BMP SITE PLAN
A	A010	EXISTING SITE PLAN
A	A011	PROPOSED SITE PLAN
A	A100	FLOOR PLAN - 3-BEDROOM
A	A101	FLOOR PLAN - 2-BEDROOM
A	A102	FLOOR PLAN - OPTIONS
A	A110	REFLECTED CEILING PLAN - 3-BEDROOM
A	A111	REFLECTED CEILING PLAN - 2-BEDROOM
A	A112	REFLECTED CEILING PLAN - OPTIONS
A	A120	ROOF PLAN - 3-BEDROOM
A	A121	ROOF PLAN - 2-BEDROOM
A	A122	ROOF PLAN - OPTIONS
A	A201	ELEVATIONS A - STUCCO
A	A202	ELEVATIONS A - STUCCO - OPTIONS
A	A211	ELEVATIONS B - LAP SIDING
A	A212	ELEVATIONS B - LAP SIDING - OPTIONS
A	A221	ELEVATIONS C - BOARD & BATTEN
A	A222	ELEVATIONS C - BOARD & BATTEN - OPTIONS
A	A300	BUILDING SECTIONS
A	A500	GENERIC ROOF & MISC. DETAILS
A	A501	GENERIC DOOR, WINDOW & MISC. DETAILS
A	A510	STUCCO DETAILS
A	A520	LAP SIDING DETAILS
A	A530	BOARD & BATTEN DETAILS
A	E100	ELECTRICAL PLAN - 3-BEDROOM
A	E101	ELECTRICAL PLAN - 2-BEDROOM
A	E102	ELECTRICAL PLAN - OPTIONS
A	E103	ELECTRIC PANEL SCHEDULE

PLUMBING FIXTURE SCHEDULE

FIXTURES	EXISTING QTY	NEW QTY	TOTAL FIXTURES	MAX WATER CONSUMPTION (CPC TABLE M102.1)	UNIT WSFU (CPC 610.3)	WSFU
BATH/TUB OR COMBINATION BATH/SHOWER	0	0	0	5.5	4.0	0
CLOTHES WASHER	0	1	1	3.5	4.0	4
DISHWASHER, DOMESTIC	0	1	1	1.3	1.5	1.5
HOSE BIB (USE HIGHEST GPM OF INDOOR WATER FIXTURE)	0	1	1	3.5	2.5	2.5
HOSE BIB, EACH ADDITIONAL	0	0	0		1.0	0
LAVATORY 1.2 GPM (CPC 407.2.2)	0	2	2	1.5	1.0	2
SHOWER, PER HEAD 1.8 GPM (CPC 408.2.1)	0	2	2	1.8	2.0	4
SINKS (KITCHEN) 1.8 GPM (CPC 420.2.1)	0	1	1	2.2	1.5	1.5
WATER CLOSET, 1.28 GPF (CPC 411.2.1)	0	2	2	3	2.5	5
TOTAL WSFU						20.5

GENERAL NOTES

1. COMPLIANCE WITH THE DOCUMENTATION REQUIREMENTS OF THE 2022 ENERGY EFFICIENCY STANDARDS IS NECESSARY FOR THIS PROJECT. REGISTERED, SIGNED, AND DATED COPIES OF THE APPROPRIATE CF1R, CF2R, AND CF3R FORMS SHALL BE MADE AVAILABLE AT NECESSARY INTERVALS FOR BUILDING INSPECTOR REVIEW. FINAL COMPLETED FORMS WILL BE AVAILABLE FOR THE BUILDING OWNER.

2. PRIOR TO FINAL INSPECTION THE LICENSED CONTRACTOR, ARCHITECT OR ENGINEER IN RESPONSIBLE CHARGE OF THE OVERALL CONSTRUCTION MUST PROVIDE TO THE BUILDING DEPARTMENT OFFICIAL WRITTEN VERIFICATION THAT ALL APPLICABLE PROVISIONS FROM THE GREEN BUILDING STANDARDS CODE HAVE BEEN IMPLEMENTED AS PART OF THE CONSTRUCTION. CGC 102.3.

3. REFER TO PLUMBING SPEC SHEETS FOR ADDITIONAL INFORMATION.

4. REFER TO CABINET DRAWINGS AND APPLIANCES PACKAGES.



ADU: 1,199 L-SHAPE

DESIGNER:
LUIS CALDERON
SnapADU


SIGNATURE

[illegible]

TITLE SHEET

G100

22040

1. SDGE HAS SPECIFIC REQUIREMENTS ABOUT THE NUMBER OF MAIN ELECTRICAL SERVICE PANELS (HOW MANY ELECTRICAL DROPS) ALLOWED ON THE SAME LOT, WHICH IS DIFFERENT FROM THE REQUIREMENTS OF THE CITY OF CHULA VISTA AND CALIFORNIA ELECTRICAL CODE.
2. SDGE MAY REQUIRE ALL NEW ADU(S)/JADU(S) TO BE PLACED ON A SEPARATE ELECTRIC METER.
3. IT IS THE RESPONSIBILITY OF THE PROJECT DESIGNER TO CONTACT SDGE FOR THE REQUIREMENTS FOR SETTING UP THE NEW ELECTRICAL UTILITIES TO ALL NEW ADU(S)/JADU(S).
4. REFER TO THE CURRENT SDGE SERVICE STANDARDS AND GUIDE TO ENSURE THAT PROJECT COMPLIES WITH THEIR REQUIREMENTS.

1. THE PLACEMENT OF BUILDINGS AND STRUCTURES ON OR ADJACENT TO SLOPES STEEPER THAN 1 UNIT VERTICAL IN 3 UNITS HORIZONTAL (33.3-PERCENT SLOPE) SHALL CONFORM TO SECTIONS R403.1.7.1 THROUGH R403.1.7.4.



1. DURING CONSTRUCTION, AT LEAST ONE EXTINGUISHER SHALL BE PROVIDED ON EACH FLOOR LEVEL AT EACH STAIRWAY, IN ALL STORAGE CONSTRUCTION SHEDS IN LOCATIONS WHERE FLAMMABLE OR COMBUSTIBLE LIQUIDS ARE STORED OR USED, AND OTHER SPECIAL HAZARDS ARE PRESENT PER CFC 3315.1
2. DUMPSTERS AND TRASH CONTAINERS EXCEEDING 1.5 CUBIC YARDS SHALL NOT BE STORED IN BUILDINGS OR PLACED WITHIN 5 FEET OF COMBUSTIBLE WALLS, OPENINGS OR COMBUSTIBLE ROOF EAVE LINES UNLESS PROTECTED BY AN APPROVED SPRINKLER SYSTEM. DUMPSTERS IN TYPE I OR IIIA STRUCTURE SEPARATED BY 10 FEET FROM OTHER STRUCTURES.
3. CONTAINERS LARGER THAN 1 CUBIC YARD SHALL BE OF NON-OR LIMITED-COMBUSTIBLE MATERIALS OR SIMILARLY PROTECTED OR SEPARATED.
4. OPEN FLAMES, FIRE, AND BURNING ON ALL PREMISES IS PROHIBITED EXCEPT AS SPECIFICALLY PERMITTED BY THE CITY OF DENVER.
5. NEWLY CONSTRUCTED DWELLING UNITS INCLUDING DETACHED ADUs ARE REQUIRED TO COMPLY WITH AGING-IN-PLACE REQUIREMENTS IN ACCORDANCE WITH CRC R327.1 ADDRESS THE FOLLOWING:
 - A. AT LEAST ONE BATHROOM ON THE ENTRY LEVEL SHALL BE PROVIDED WITH REINFORCEMENT INSTALLED IN ACCORDANCE WITH THIS SECTION.
 1. SPECIFY THE REINFORCEMENT TO BE SOLID LUMBER AND NOT LESS THAN 2X8.
 2. DIMENSION THE REINFORCEMENT SHALL BE LOCATED BETWEEN 32 - 39 1/4 INCHES ABOVE THE FINISHED FLOOR.
 3. SPECIFY THE WATER CLOSET REINFORCEMENT TO BE INSTALLED ON BOTH SIDE WALLS OF THE TOILET ROOM WALL AND THE BACK WALL (IT WHERE THE WATER CLOSET IS NOT LOCATED ADJACENT TO THE SIDE WALL, GRAB BAR REINFORCEMENT FOR A GROUND-MOUNTED INSTALLATION IS ACCEPTABLE.
 4. SPECIFY THE SHOWER REINFORCEMENT SHALL BE CONTINUOUS WHERE WALL FRAMING IS PROVIDED.
 5. BATHTUB AND COMBINATION BATHTUB/SHOWER REINFORCEMENT SHALL BE CONTINUOUS ON EACH END OF THE BATHTUB AND THE BACK WALL. ADDITIONALLY, BACK WALL REINFORCEMENT FOR A LOWER GRAB BAR SHALL BE PROVIDED WITH THE BOTTOM EDGE LOCATED NO MORE THAN 6 INCHES ABOVE THE BATHTUB RIM.
 - B. ELECTRICAL RECEPTACLE OUTLETS, SWITCHES AND CONTROLS INTENDED TO BE USED BY OCCUPANTS SHALL BE LOCATED NO MORE THAN 48 INCHES MEASURED FROM THE TOP OF THE OUTLET BOX AND NOT LESS THAN 15 INCHES MEASURED FROM THE BOTTOM OF THE OUTLET BOX ABOVE THE FINISHED FLOOR.
 - C. SPECIFY DOORBELL CONTROLS TO BE NOT EXCEED 48 INCHES ABOVE EXTERIOR FLOOR, MEASURED FROM THE TOP OF THE DOORBELL BUTTON ASSEMBLY.

ALL NEW RESIDENTIAL UNITS ARE REQUIRED TO BE ENERGY STORAGE SYSTEM (ESS) READY. PROVIDE THE FOLLOWING ON THE PLANS PER CEC 150.0(S):

1. AT LEAST ONE OF THE FOLLOWING SHALL BE PROVIDED:
 - A. ESS READY INTERCONNECTION EQUIPMENT WITH A MINIMUM BACKUPPED-UP CAPACITY OF 60 AMPS AND A MINIMUM OF FOUR ESS-SUPPLIED BRANCH CIRCUITS.
2. A DEDICATED RACEWAY FROM THE MAIN SERVICE TO A PANELBOARD (SUBPANEL) THAT SUPPLIES THE BRANCH CIRCUITS IN SECTION 150.0(S)(2). ALL BRANCH CIRCUITS ARE PERMITTED TO BE SUPPLIED BY THE MAIN SERVICE PANEL PRIOR TO THE INSTALLATION OF AN ESS. THE TRADE SIZE OF THE RACEWAY SHALL BE DETERMINED BY THE PANELBOARD THAT IT SUPPLIES THE BRANCH CIRCUITS (SUBPANEL) MUST BE LABELED "SUBPANEL SHALL INCLUDE ALL BACKUP UP LOAD CIRCUITS."
3. A MINIMUM OF FOUR BRANCH CIRCUITS SHALL BE IDENTIFIED AND HAVE THEIR SOURCE OF SUPPLY IDENTIFIED ON THE MAIN PANELBOARD SUITABLE TO BE SUPPLIED BY THE ESS. AT LEAST ONE CIRCUIT SHALL SUPPLY THE REFRIGERATOR. ONE LIGHTING CIRCUIT SHALL BE LOCATED NEAR THE PRIMARY EGRESS AND AT LEAST ONE CIRCUIT SHALL SUPPLY A SLEEPING ROOM RECEPTACLE OUTLET.
4. THE MAIN PANELBOARD SHALL HAVE A MINIMUM BUSBAR RATING OF 225 AMPS.
5. SYSTEM SPACE SHALL BE RESERVED TO ALLOW FUTURE INSTALLATION OF A FUTURE ISOLATION EQUIPMENT/TRANSFER SWITCH WITHIN 3 FEET OF THE MAIN SERVICE RACEWAY. THIS SPACE SHALL BE IDENTIFIED ON THE PANELBOARD AND THE SYSTEM ISOLATION EQUIPMENT/TRANSFER SWITCH LOCATION TO ALLOW THE CONNECTION OF BACKUP POWER SOURCE.

1. A PLUMBING FIXTURE CERTIFICATION MUST BE COMPLETED AND SIGNED BY EITHER A LICENSED GENERAL CONTRACTOR, A PLUMBING CONTRACTOR, OR THE BUILDING OWNER CERTIFYING THE FLOW RATE OF THE FIXTURES INSTALLED. A COPY OF THE CERTIFICATION CAN BE OBTAINED FROM THE DEVELOPMENT SERVICES DEPARTMENT.
2. ALL PLUMBING FIXTURES AND FITTINGS WILL BE WATER CONSERVING.
3. PERMANENT VACUUM BREAKERS SHALL BE INCLUDED WITH ALL NEW HOSE BIBS.
4. PER CPC 402.5, 30" CLEAR WIDTH REQUIRED FOR THE WATER CLOSET COMPARTMENT AND MINIMUM 24" CLEARANCE REQUIRED IN FRONT OF THE WATER CLOSET.
5. PLUMBING FIXTURES (WATER CLOSURES AND URINALS) AND FITTINGS (FAUCETS AND SHOWERHEADS) SHALL BE INSTALLED IN ACCORDANCE WITH THE PLUMBING CODE.
6. ALL NEW RESIDENTIAL BUILDINGS (SINGLE FAMILY, DUPLEXES, OR TOWNHOMES) SHALL BE CONSTRUCTED TO INCLUDE WASTE PIPING TO DISCHARGE GRAY WATER FROM CLOTHES WASHERS TO A PLACE WHERE IT MAY BE USED FOR OUTDOOR IRRIGATION, IN COMPLIANCE WITH SECTION 1602 OF THE CALIFORNIA PLUMBING CODE.
7. OUTDOOR SHOWER DRAINS AND SINKS ARE NOT PERMITTED TO CONNECT TO THE PUBLIC SEWER SYSTEM UNLESS EQUIPPED WITH AN APPROVED COVER, HOT AND COLD WATER CONNECTIONS ALLOWED.
8. THE CONTROL VALVES IN SHOWERS, TUB/SHOWERS, BATHTUBS, AND BIDETS MUST BE PRESSURE BALANCED OR THERMOSTATIC MIXING VALVES. CPC 408, 409, 410.
9. MECHANICAL EXHAUST FANS WHICH EXHAUST DIRECTLY FROM BATHROOMS SHALL COMPLY WITH THE FOLLOWING:
 - A. FANS SHALL BE ENERGY STAR COMPLIANT AND BE DUCTED TO TERMINATE OUTSIDE OF THE BUILDING.
 - B. UNLESS FUNCTIONING AS A COMPONENT OF A WHOLE HOUSE VENTILATION SYSTEM, FANS MUST BE CONTROLLED BY A HUMIDISTAT WHICH SHALL BE READILY ACCESSIBLE. HUMIDISTAT CONTROLS SHALL BE CAPABLE OF ADJUSTMENT BETWEEN A RELATIVE HUMIDITY RANGE OF 50 TO 80 PERCENT.
10. FOR WATER HEATER, ADDRESS THE FOLLOWING:
 - A. PROVIDE T & P RELIEF VALVE AND SHOW TERMINATION POINT.
 - B. PROVIDE PLATFORM FOR THE WATER HEATER.
 - C. PROVIDE SEISMIC STRAPPING FOR THE WATER HEATER PER CPC 507.2.
 - a. STRAPPING SHALL BE INSTALLED WITHIN THE UPPER ONE THIRD AND LOWER ONE-THIRD OF THE WATER HEATER.
 - b. AT THE LOWER POINT, A MINIMUM DISTANCE OF FOUR INCHES SHALL BE MAINTAINED ABOVE THE CONTROLS WITH THE STRAPPING.
11. HEAT PUMP WATER HEATER SHALL BE INSTALLED PER MANUFACTURER'S RECOMMENDATIONS.
12. HEAT PUMP WATER HEATER AND WATER LINES SHALL BE PROTECTED FROM FREEZING TEMPERATURES AND NOT INSTALLED IN OUTDOOR UNPROTECTED AREAS.
13. VERIFY WATER HEATER IS RATED FOR EXTERIOR INSTALLATION.
14. GAS WATER HEATER USING GAS OR PROPANE WATER HEATER TO SERVE INDIVIDUAL DWELLING UNITS SHALL INCLUDE THE FOLLOWING:
 - A. A DEDICATED 240 VOLT BRANCH CIRCUIT WIRING SHALL BE INSTALLED WITHIN 3 FEET FROM THE WATER HEATER AND ACCESSIBLE TO THE WATER WITH NO OBSTRUCTIONS. THE BRANCH CIRCUIT CONDUCTORS SHALL BE RATED AT 30 AMPS MINIMUM. THE BLANK COVER SHALL BE IDENTIFIED AS "240V READY." ALL ELECTRICAL COMPONENTS SHALL BE INSTALLED IN ACCORDANCE WITH THE CALIFORNIA ELECTRICAL CODE.
 - B. THE MAIN ELECTRICAL SERVICE PANEL SHALL HAVE A RESERVED SPACE TO ALLOW FOR THE INSTALLATION OF A DOUBLE POLE CIRCUIT BREAKER FOR A FUTURE WATER HEATER INSTALLATION. THE RESERVED SPACE SHALL BE PERMANENTLY MARKED AS "FOR FUTURE 240V USE."
15. 150.0(V) ELECTRIC COOKTOP RATED, SYSTEMS USING GAS OR PROPANE COOKTOP TO SERVE INDIVIDUAL DWELLING UNITS SHALL INCLUDE THE FOLLOWING:
 - A. A DEDICATED 240 VOLT BRANCH CIRCUIT WIRING SHALL BE INSTALLED WITHIN 3 FEET FROM THE COOKTOP AND ACCESSIBLE TO THE COOKTOP WITH NO OBSTRUCTIONS. THE BRANCH CIRCUIT CONDUCTORS SHALL BE RATED AT 50 AMPS MINIMUM. THE BLANK COVER SHALL BE IDENTIFIED AS "240V READY."
 - B. THE MAIN ELECTRICAL SERVICE PANEL SHALL HAVE A RESERVED SPACE TO ALLOW FOR THE INSTALLATION OF A DOUBLE POLE CIRCUIT BREAKER FOR A FUTURE ELECTRIC COOKTOP INSTALLATION. THE RESERVED SPACE SHALL BE PERMANENTLY MARKED AS "FOR FUTURE 240V USE."
16. 150.0(V) ELECTRIC CLOTHES DRYER RATED, CLOTHES DRYER LOCATIONS WITHIN INDIVIDUAL DWELLING UNITS SERVING INDIVIDUAL DWELLING UNITS SHALL INCLUDE THE FOLLOWING:
 - A. A DEDICATED 240 VOLT BRANCH CIRCUIT WIRING SHALL BE INSTALLED WITHIN 3 FEET FROM THE CLOTHES DRYER LOCATION AND ACCESSIBLE TO THE CLOTHES DRYER LOCATION WITH NO OBSTRUCTIONS. THE BRANCH CIRCUIT CONDUCTORS SHALL BE RATED AT 30 AMPS MINIMUM. THE BLANK COVER SHALL BE IDENTIFIED AS "240V READY."
 - B. THE MAIN ELECTRICAL SERVICE PANEL SHALL HAVE A RESERVED SPACE TO ALLOW FOR THE INSTALLATION OF A DOUBLE POLE CIRCUIT BREAKER FOR A FUTURE ELECTRIC CLOTHES DRYER INSTALLATION. THE RESERVED SPACE SHALL BE PERMANENTLY MARKED AS "FOR FUTURE 240V USE."
17. 150.0(T) SYSTEMS USING GAS OR PROPANE FURNACE TO SERVE INDIVIDUAL DWELLING UNITS SHALL INCLUDE THE FOLLOWING:
 - A. A DEDICATED 240 VOLT BRANCH CIRCUIT WIRING SHALL BE INSTALLED WITHIN 3 FEET FROM THE FURNACE AND ACCESSIBLE TO THE FURNACE WITH NO OBSTRUCTIONS. THE BRANCH CIRCUIT CONDUCTORS SHALL BE RATED AT 30 AMPS MINIMUM. THE BLANK COVER SHALL BE IDENTIFIED AS "240V READY." ALL ELECTRICAL COMPONENTS SHALL BE INSTALLED IN ACCORDANCE WITH THE CALIFORNIA ELECTRICAL CODE.
 - B. THE MAIN ELECTRICAL SERVICE PANEL SHALL HAVE A RESERVED SPACE TO ALLOW FOR THE INSTALLATION OF A DOUBLE POLE CIRCUIT BREAKER FOR A FUTURE HEAT PUMP SPACE HEATER INSTALLATION. THE RESERVED SPACE SHALL BE PERMANENTLY MARKED AS "FOR FUTURE 240V USE."

AC	AIR CONDITIONING	LAV	LAVATORY
AFF	AIR CURTAIN	L	LOUVER
ALUM	ABOVE FINISHED FLOOR		
ARCH	ALUMINUM ARCHITECTURAL	MAX	MAXIMUM
		MECH	MECHANICAL
B	BOLLARD	MTL	METAL
BLDG	BUILDING	MFR	MANUFACTURER
BLKG	BLOCKING	MIN	MINIMUM
BTW	BETWEEN	MWO	MICROWAVE OVEN
CAB	CABINET	N/A	NOT APPLICABLE
CA	COMPRESSED AIR	(N)	NEW
CL	CENTER LINE	NIC	NOT IN CONTRACT
CLG	CEILING	NTS	NOT TO SCALE
CLO.	CLOSET		
CLR	CLEAR	oc	ON CENTER
CMU	CONCRETE MASONRY UNIT		
CO	CLEAN OUT (PLUMBING)	P.LAM	PLASTIC LAMINATE
CONC	CONCRETE	PLYWD	PLYWOOD
CONST.	CONSTRUCTION	PTW	PRESSURE TREATED WOOD
CONT.	CONTINUOUS	Ꞥ	PROPERTY LINE
CONTR	CONTRACTOR		
CORR	CORRIDOR	REFR.	REFRIGERATOR
		REQ'D	REQUIRED
D	DRYER	RD	ROOF DRAIN
DS	DOWNSPOUT	RDO	ROOF DRAIN OVERFLOW
DSN	DOWNSPOUT NOZZLE	RE	REFER TO
DV	DRYER VENT	RO	ROUGH OPENING
DW	DISHWASHER		
		S/A	SUPPLY AIR
(E)	EXISTING	SIM	SIMILAR
EP	ELECTRICAL PANEL DRAWINGS	SLD	SLOT DRAIN
EQ	EQUAL	SOD	SCUPPER OVERFLOW DRAIN
EQUIP	EQUIPMENT	SRD	SCUPPER ROOF DRAIN
		SUSP	SUSPENDED
FIN	FINISHED	STL	STEEL
FO	FINISHED OPENING		
FOC	FACE OF CONCRETE	T	THERMOSTAT
FOF	FACE OF FINISH	TD	TRENCH DRAIN
FOM	FACE OF MASONRY	TEL	TELEPHONE
FOS	FACE OF STUD	TYP	TYPICAL
FURR	FURRED, FURRING	T.O.	TOP OF...
		T.O.D	TOP OF DRAIN
GA	GAUGE		
GB	GRAB BAR	UNO	UNLESS NOTED OTHERWISE
GWB	GYPSUM WALL BOARD		
GYP.BD.	GYPSUM BOARD	VIF	VERIFY IN FIELD
GALV.	GALVANIZED		
		W	WASHER
HB	HOSE BIB	W/	WITH
HDWR	HARDWARE	W/O	WITHOUT
HM	HOLLOW METAL	WD	WOOD
HPW	HOT WATER - SEE PLUMBING	WH	WATER HEATER
DWGS			
HVAC	HEATING, VENTILATING, & AIR CONDITIONING		

SEE DISCIPLINE SHEETS FOR DISCIPLINE SPECIFIC SYMBOLS.

A100

SHEET NUMBER

Sheet No. Sequence

Type Discipline

PLAN NORTH

TRUE NORTH

NORTH ARROW

ROOM TAG

NAME

Room Name

SF

Area

DOOR TAG

D1

Door number

WINDOW TAG

W1

Window type

ADDITIONAL NOTES

R000

FLOW ARROW

EXTERIOR ELEVATION

1

Elevation No.

A201

Sheet No.

BUILDING SECTION

1

Section No.

A101

Sheet No.

DETAIL - CALLOUT

1

Detail No.

A1001

Sheet No.

DETAIL - SECTION

1

Detail No.

A1001

Sheet No.

SPOT ELEVATION MARKER

FLOOR LEVEL MARKER

LEVEL

Level Name

ELEVATION

Floor Elevation


REVISION TAG

1


Revision Number

Revision Cloud

STAIR TAG w/ number of Risers & Riser Height

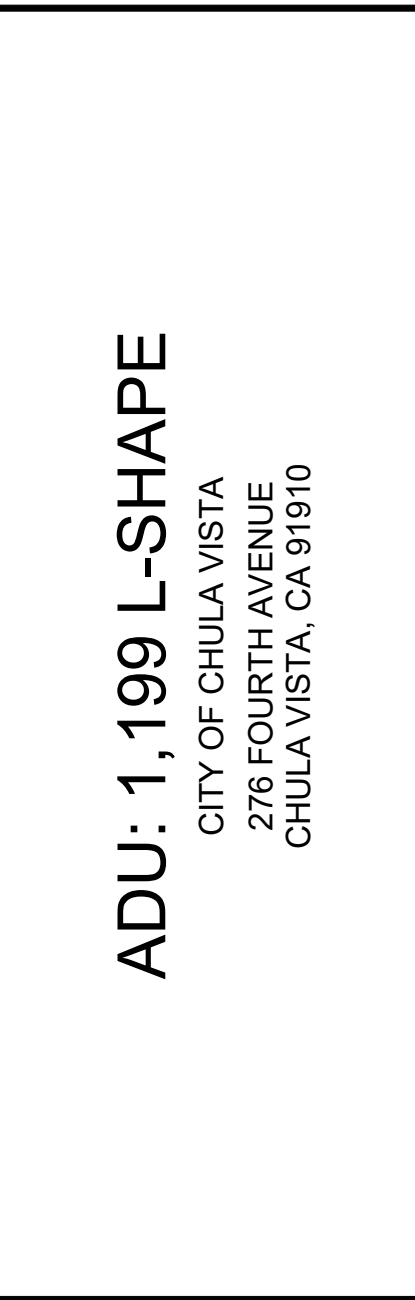

DESIGNER:
LUIS CALDERON
SnapADU


SIGNATURE

[illegible]

G101

22040

WASTE WATER:

✓SELECTION

SEWER

SEPTIC*

SEPTIC OPTION NOTES:

1. PROVIDE PLAN SHEETS ADDRESSING SEPTIC OPTION INFORMATION.
2. IN ADDITION TO APPROVAL FROM BUILDING & SAFETY, APPROVAL IS REQUIRED FROM THE SAN DEIGO COUNTY HEALTH DEPARTMENT. PROVIDE DOCUMENTATION SHOWING SEPTIC SYSTEM WAS REVIEWED AND APPROVED BY THE COUNTY HEALTH DEPARTMENT.
3. DESIGN AND LOCATION OF PROPOSED SEPTIC SYSTEM SHALL BE PROVIDED ON SITE PLAN IN ACCORDANCE WITH CPC APPENDIX H. ALL ELEMENTS INCLUDING DISPOSAL FIELD SIZING BASED ON PERCOLATION RATE SHALL BE SHOWN.
 1. ON THE SITE PLAN, DIMENSION THE SEPTIC TANK AND DISPOSAL FIELD/SEEPAGE PIT FROM THE BUILDINGS, LOT LINES, TREES, ETC. ENSURE THE LOCATION OF THE SEWAGE DISPOSAL SYSTEM IS IN COMPLIANCE WITH CPC TABLE H 101.8.
 2. PROVIDE THE CAPACITY OF THE SEPTIC TANK PER CPC H 201.0.
 3. PROVIDE THE DESIGN FOR THE DISPOSAL FIELD AND SEEPAGE PITS PER CPC H 301.0.

METHANE AREA:

✓SELECTION

PROPOSED ACCESSORY DWELLING UNIT IN METHANE AREA

YES

NO

PHOTOVOLTAIC (PV) SOLAR SYSTEM SIZE REQUIREMENT:

✓SELECTION (PER T24 CALCULATIONS PG. 2)

NUMBER OF BEDROOMS:	FOUNDATION TYPE:	CLIMATE ZONE 7	CLIMATE ZONE 10
3	SLAB-ON-GRADE	<div><div></div>2.35 kWDC</div>	<div><div></div>2.36 kWDC</div>
3	RAISED FLOOR	<div><div></div>2.47 kWDC</div>	<div><div></div>2.50 kWDC</div>
2	SLAB-ON-GRADE	<div><div></div>2.05 kWDC</div>	<div><div></div>2.11 kWDC</div>
2	RAISED FLOOR	<div><div></div>2.17 kWDC</div>	<div><div></div>2.25 kWDC</div>

SOILS REQUIREMENT:

✓SELECTION

SOILS REPORT IS PROVIDED.

SOIL REPORT WAIVER IS REQUESTED; IF CHECKED THEN A LETTER FROM A LICENSESD PROFESSIONAL ENGINEER MUST BE PROVIDED TO CERTIFY THAT THERE IS NO FILL. SUCH LETTER TO BE IMPRINTED ON THE PLANS.

WILDLAND-URBAN INTERFACE (WUI):

✓SELECTION

YES

NO

1. EAVES SHALL BE ENCLOSED PER THE CRITERIA LISTED IN CRC R337.7.5. SHOW ON APPLICABLE DETAILS.
2. EXTERIOR WALLS SHALL BE IGNITION RESISTANT OR NON-COMBUSTIBLE. PROVIDE DETAILS AND INFORMATION FOR THE SIDING TO DEMONSTRATE COMPLIANCE. CRC R337.7.3
3. THE SCREENS COVERING VENTS SHALL HAVE A MAXIMUM MESH OF 1/8" AND SHALL BE OF CORROSION-RESISTANT METAL. CRC R337.6.2
4. VENTS SHALL NOT BE INSTALLED ON THE UNDERSIDE OF EAVES. CRC R337.6.3
5. PROVIDE ONE LAYER OF ROOF UNDERLAYMENT OF MINIMUM 72-POUND MINERAL-SURFACED NON-PERFORATED CAP SHEET COMPLYING WITH ASTM D 3909. CRC 337.5.2
6. ROOF GUTTERS SHALL BE SCREENED TO PREVENT THE ACCUMULATION OF LEAVES AND DEBRIS. CRC R337.5.4.

DEFENSIBLE SPACE ZONES

ZONE 0 - EMBER-RESISTANT ZONE

EXTENDS 5 FEET FROM BUILDINGS, STRUCTURES, DECKS, ETC.

THE EMBER-RESISTANT ZONE IS CURRENTLY NOT REQUIRED BY LAW, BUT SCIENCE HAS PROVEN IT TO BE THE MOST IMPORTANT OF ALL THE DEFENSIBLE SPACE ZONES. THIS ZONE INCLUDES THE AREA UNDER AND AROUND ALL ATTACHED DECKS, AND REQUIRES THE MOST STRINGENT WILDFIRE FUEL REDUCTION. THE EMBER-RESISTANT ZONE IN DESIGNED TO KEEP FIRE OR EMBERS FROM IGNITING MATERIALS THAT CAN SPREAD THE FIRE TO YOUR HOME. THE FOLLOWING PROVIDES GUIDANCE FOR THIS ZONE, WICH MAY CHANGE BASED ON THE REGULATION DEVELOPED BY THE BOARD OF FORESTRY AND FIRE PROTECTION.

• USE HARDSCAPE LIKE GRAVEL, PAVERS, CONCRETE AND OTHER NONCOMBUSTIBLE MULCH MATERIALS. NO COMBUSTIBLE BARK OR MULCH.

• REMOVE ALL DEAD AND DYING WEEDS, GRASS, PLANTS SHRUBS, TREES, BRANCHES AND VEGETATIVE DEBRIS (LEAVES, NEEDLES, CONES, BARK, ETC.); CHECK YOUR ROOFS, GUTTERS, DECKS, PORCHES, STAIRWAYS, ETC.

• REMOVE ALL BRANCHES WITHIN 10 FEET OF ANY CHIMNEY OR STOVEPIPE OUTLET.

• LIMIT PLANTS IN THIS AREA TO LOW GROWING, NONWOODY, PROPERLY WATERED AND MAINTAINED PLANTS.

• LIMIT COMBUSTIBLE ITEMS (OUTDOOR FURNITURE, PLANTERS, ETC.) ON TOP OF DECKS.

• RELOCATE FIREWOOD AND LUMBER TO ZONE 2.

• REPLACE COMBUSTIBLE FENCING, GATES, AND ARBORS ATTACH TO THE HOME WITH NONCOMBUSTIBLE ALTERNATIVES.

• CONSIDER RELOCATING GARBAGE AND RECYCLING CONTAINERS OUTSIDE THIS ZONE.

• CONSIDER RELOCATING BOATS, RV'S, VEHICLES AND OTHER COMBUSTIBLE ITEMS OUTSIDE THIS ZONE.

ZONE 1 - LEAN, CLEAN AND GREEN ZONE

EXTENDS 30 FEET FROM BUILDINGS, STRUCTURES, DECKS, ETC. OR TO YOUR PROPERTY LINE, WHICHEVER IS CLOSER.

• REMOVE ALL DEAD PLANTS, GRASS AND WEEDS (VEGETATION).

• REMOVE DEAD OR DRY LEAVES AND PINE NEEDLES FROM YOUR YARD, ROOF AND RAIN GUTTERS.

• REMOVE BRANCHES THAT HANG OVER YOUR ROOF AND KEEP DEAD BRANCHES 10 FEET AWAY FROM YOUR CHIMNEY.

• TRIM TREES REGULARLY TO KEEP BRANCHES A MINIMUM OF 10 FEET FROM OTHER TREES.

• RELOCATE WOOD PILES TO ZONE 2.

• REMOVE OR PRUNE FLAMMABLE PLANTS AND SHRUBS NEAR WINDOWS.

• REMOVE VEGETATION AND ITEMS THAT COULD CATCH FIRE FROM AROUND AND UNDER DECKS, BALCONIES AND STAIRS.

• CREATE A SEPARATION BETWEEN TREES, SHRUBS AND ITEMS THAT COULD CATCH FIRE, SUCH AS PATIO FURNITURE, WOOD PILES, SWING SETS, ETC.

ZONE 2 - REDUCE FUEL ZONE

EXTENDS FROM 30 FEET TO 100 FEET OUT FROM BUILDINGS, STRUCTURES, DECKS, ETC. OR TO YOUR PROPERTY LINE, WHICHEVER IS CLOSER.

• CUT OR MOW ANNUAL GRASS DOWN TO A MAXIMUM HEIGHT OF 4 INCHES.

• CREATE HORIZONTAL SPACE BETWEEN SHRUBS AND TREES. (SEE DIAGRAM)

• CREATE VERTICAL SPACE BETWEEN GRASS, SHRUBS AND TREES. (SEE DIAGRAM)

• REMOVE FALLEN LEAVES, NEEDLES, TWIGS, BARK, CONES, AND SMALL BRANCHES. HOWEVER, THEY MAY BE PERMITTED TO A DEPTH OF 3 INCHES.

• ALL EXPOSED WOOD PILES MUST HAVE A MINIMUM OF 10 FEET OF CLEARANCE, DOWN TO BARE MINERAL SOIL, IN ALL DIRECTIONS.

FIRE SPRINKLERS:

✓SELECTION

EXISTING PRIMARY DWELLING UNIT

YES

NO

REQUIRED AT PROPOSED ACCESSORY DWELLING UNIT

YES

NO

VERY HIGH FIRE SEVERITY ZONE:

✓SELECTION

*YES

NO

1. ALL EXTERIOR GLAZED DOOR ASSEMBLIES SHALL BE MULTI-PANE WITH A MINIMUM OF ONE TEMPERED PANE AND COMPLY WITH SECTION CRC R337.8.2.1
2. ALL EXTERIOR DOORS SHALL BE 20-MINUTES FIRE RATED AND COMPLY WITH SECTION CRC R337.8.3
3. ALL EXTERIOR WINDOW ASSEMBLIES SHALL COMPLY WITH SECTION CRC R337.8.2.1
4. ROOF GUTTERS SHALL BE PROVIDED WITH THE MEANS TO PREVENT THE ACCUMULATION OF LEAVES AND DEBRIS IN THE GUTTER. ALL ROOF GUTTERS AND DOWNSPOUTS SHALL BE CONSTRUCTED OF NON-COMBUSTIBLE MATERIALS PER CRC R337.5.4; SDMC 149.0327(E) (1).
5. DRIP EDGE FLASHING USED AT THE FREE EDGES OF ROOFING MATERIALS SHALL BE NON-COMBUSTIBLE PER SDMC 149.0327(E) (2).
6. VALLEY FLASHINGS SHALL BE NOT LESS THAN 0.019-INCH (NO. 26 GALVANIZED SHEET GAGE) CORROSION-RESISTANT METAL INSTALLED OVER A MINIMUM 36-INCH-WIDE UNDERLAYMENT CONSISTING OF ONE LAYER OF NO. 72 ASTM CAP SHEET RUNNING THE FULL LENGTH OF THE VALLEY PER CRC R337.5.3.
7. CHIMNEYS, FLUES OR STOVEPIPES ATTACHED TO ANY FIREPLACE, STOVE, BARBEQUE OR OTHER SOLID OR LIQUID FUEL BURNING EQUIPMENT OR DEVICE SHALL BE EQUIPPED WITH AN APPROVES SPARK ARRESTOR PER SDMC 149.0327(H).
8. TURBINE ATTIC VENTS SHALL BE EQUIPPED TO ALLOW ONE-WAY DIRECTION ROTATION ONLY AND SHALL NOT FREE SPIN IN BOTH DIRECTIONS PER SDMC 145.0706(D).
9. ATTIC VENTS SHOULD BE PROTECTED BY NONCOMBUSTIBLE, CORROSION RESISTANT MESH AND MEETS ALL THE FOLLOWING REQUIREMENTS (PER CRC R337.6.2; SDMC 149.0327(F).1):
 A. INDIVIDUAL VENT OPENINGS SHALL NOT EXCEED 144 SQUARE INCHES.
 B. THE DIMENSIONS OF THE OPENINGS SHALL BE A MINIMUM OF 1/16-INCH AND SHALL NOT EXCEED 1/8-INCH.

*SEE DETAILS:
1/A500, 2/A500, 3/A500;
1/A510, 2/A510, 3/A510, 4/A510, 5/A510, 6/A510, 12/A510.
1/A520, 2/A520, 3/A520, 4/A520, 5/A520, 6/A520, 12/A520.
1/A530, 2/A530, 3/A530, 4/A530, 5/A530, 6/A530, 12/A530.

WATER METER:

✓SELECTION

UPGRADE METER

EXISTING METER TO REMAIN

NEW METER

ELECTRICAL SERVICE:

✓SELECTION

UPGRADE SERVICE

EXISTING SERVICE TO REMAIN

NEW SERVICE

*IF THE EXISTING MSP IS NOT 200A WITH 225A BUS RATING, A NEW SERVICE PANEL FOR THE EXISTING SFR OR THE PROPOSED ADU SHALL BE PROVIDED TO COMPLY WITH ESS READY REQUIREMENT.

CLIMATE ZONE:

✓SELECTION

CLIMATE ZONE 7 (ZIP CODES: 91910, 91911, 91913, 91915)

CLIMATE ZONE 10 (ZIP CODE: 91914)

ADU FLOOR PLAN:

✓SELECTION

STANDARD 3-BEDROOM PLAN

2-BEDROOM OPTION

MISC. AVAILABLE OPTIONS:

✓SELECTION(S)

8' PENINSULA (SEE 1/A102)

OR

L-KITCHEN WITH 5' ISLAND (SEE 2/A102)

6'-0" x 6'-8" SLIDING GLASS DOOR (SEE 4/A102)

ENLARGED BEDROOM & BATH DOOR WITH 2 BEDROOM (SEE 6/A102)

SIDE BY SIDE LAUNDRY (SEE 3/A102)

ENLARGED BEDROOM & BATH DOOR WITH 3 BEDROOMS(SEE 5/A102)

SKYLIGHTS (SEE 1/A122)

FOUNDATION TYPE:

✓SELECTION

STANDARD SOIL, SLAB ON GRADE (SEE S1 / S2)

STANDARD SOIL, RAISED FLOOR FOUNDATION* (SEE S1 / S2)

* PROVIDE 18" X 24" MIN. UNDERFLOOR ACCESS, CLEARANCE, AND VENTILATION. UNDER-FLOOR VENTILATION SHALL BE NOT LESS THAN 1/150 OF UNDER FLOOR AREA. (1209.1, R408.2, R408.4). REFER TO DETAIL 9 AND 10/ SHEET A500.




SNAPADU
DESIGN / HOUSE

YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 1,199 L-SHAPE
CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:
LUIS CALDERON
SnapADU


SIGNATURE

[illegible]

CHECKLIST
G102
22040

CODE COMPLIANCE NOTES

EXCERPTS FROM THE 2022 CALIFORNIA RESIDENTIAL CODE

CHAPTER 3 - BUILDING PLANNING

R302 FIRE-RESISTANT CONSTRUCTION

R302.1 EXTERIOR WALLS
CONSTRUCTION, PROJECTIONS, OPENINGS AND PENETRATIONS OF EXTERIOR WALLS OF DWELLINGS AND ACCESSORY BUILDINGS SHALL COMPLY WITH TABLE R302.1(1) FOR DWELLINGS AND ACCESSORY BUILDINGS EQUIPPED THROUGHOUT WITH AN AUTOMATIC SPRINKLER SYSTEM INSTALLED IN ACCORDANCE WITH SECTION R313 SHALL COMPLY WITH TABLE R302.1(2).

R302.2 DWELLING-GARAGE OPENING AND PENETRATION PROTECTION
OPENINGS AND PENETRATIONS THROUGH THE WALLS OR CEILINGS SEPARATING THE DWELLING FROM THE GARAGE SHALL BE IN ACCORDANCE WITH SECTIONS R302.5.1 THROUGH R302.5.3.

R302.6 DWELLING/GARAGE AND/OR CARPORT FIRE SEPARATION
THE GARAGE AND/OR CARPORT SHALL BE SEPARATED AS REQUIRED BY TABLE R302.6. OPENINGS IN GARAGE WALLS SHALL COMPLY WITH SECTION R302.5. ATTACHMENT OF GYPSUM BOARD SHALL COMPLY WITH TABLE R702.3.5. THE WALL SEPARATION PROVISIONS OF TABLE R302.6 SHALL NOT APPLY TO GARAGE WALLS THAT ARE PERPENDICULAR TO THE ADJACENT DWELLING UNIT WALL. A SEPARATION IS NOT REQUIRED BETWEEN THE DWELLING UNIT AND A CARPORT, PROVIDED THE CARPORT IS ENTIRELY OPEN ON TWO OR MORE SIDES AND THERE ARE NOT ENCLOSED AREAS ABOVE.

R302.7 UNDER-STAIR PROTECTION
ENCLOSED SPACE UNDER STAIRS THAT IS ACCESSED BY A DOOR OR ACCESS PANEL SHALL HAVE WALLS, UNDER-STAIR SURFACE AND ANY SOFFITS PROTECTED ON THE ENCLOSED SIDE WITH 1/2-INCH (12.7 MM) GYPSUM BOARD.

R302.11 FIREBLOCKING
IN COMBUSTIBLE CONSTRUCTION, FIREBLOCKING SHALL BE PROVIDED TO CUT OFF BOTH VERTICAL AND HORIZONTAL CONCEALED DRAFT OPENINGS AND TO FORM AN EFFECTIVE FIRE BARRIER BETWEEN STORIES, AND BETWEEN A TOP STORY AND THE ROOF SPACE.

FIREBLOCKING SHALL BE PROVIDED IN WOOD-FRAMED CONSTRUCTION IN THE FOLLOWING LOCATIONS:

- IN CONCEALED SPACES OF STUD WALLS AND PARTITIONS, INCLUDING FURRED SPACES AND PARALLEL ROWS OF STUDS OR STAGGERED STUDS, AS FOLLOWS:
 - VERTICALLY AT THE CEILING AND FLOOR LEVELS.
 - HORIZONTALLY AT INTERVALS NOT EXCEEDING 10 FEET (3048 MM).
- AT INTERCONNECTIONS BETWEEN CONCEALED VERTICAL AND HORIZONTAL SPACES SUCH AS OCCUR AT SOFFITS, DROPPED CEILINGS AND COVE CEILINGS.
- IN CONCEALED SPACES BETWEEN STAIR STRINGERS AT THE TOP AND BOTTOM OF THE RUN. ENCLOSED SPACES UNDER STAIRS SHALL COMPLY WITH SECTION R302.7.
- AT OPENINGS AROUND VENTS, PIPES, DUCTS, CABLES AND WIRES AT CEILING AND FLOOR LEVEL, WITH AN APPROVED MATERIAL, TO RESIST THE FREE PASSAGE OF FLAME AND PRODUCTS OF COMBUSTION. THE MATERIAL FILLING THIS ANNULAR SPACE SHALL NOT BE REQUIRED TO MEET THE ASTM E136 REQUIREMENTS.
- FOR THE FIREBLOCKING OF CHIMNEYS AND FIREPLACES, SEE SECTION R1003.19.
- FIREBLOCKING OF CORNICES OF A TWO-FAMILY DWELLING IS REQUIRED AT THE LINE OF DWELLING UNIT SEPARATION.

R303 LIGHT, VENTILATION AND HEATING

R303.1 HABITABLE ROOMS
HABITABLE ROOMS SHALL HAVE AN AGGREGATE GLAZING AREA OF NOT LESS THAN 8 PERCENT OF THE FLOOR AREA OF SUCH ROOMS. NATURAL VENTILATION SHALL BE THROUGH WINDOWS, SKYLIGHTS, DOORS, LOUVERS OR OTHER APPROVED OPENINGS TO THE OUTDOOR AIR. SUCH OPENINGS SHALL BE PROVIDED WITH READY ACCESS OR SHALL OTHERWISE BE READILY CONTROLLABLE BY THE BUILDING OCCUPANTS. THE OPENABLE AREA TO THE OUTDOORS SHALL BE NOT LESS THAN 4 PERCENT OF THE FLOOR AREA BEING VENTILATED.

R303.2 ADJOINING ROOMS
FOR THE PURPOSE OF DETERMINING LIGHT AND VENTILATION REQUIREMENTS, ROOMS SHALL BE CONSIDERED TO BE A PORTION OF AN ADJOINING ROOM WHERE NOT LESS THAN ONE-HALF OF THE AREA OF THE COMMON WALL IS OPEN AND UNOBSTRUCTED AND PROVIDES AN OPENING OF NOT LESS THAN ONE-TENTH OF THE FLOOR AREA OF THE INTERIOR ROOM AND NOT LESS THAN 25 SQUARE FEET (2.3 M2).

R307 BATHTUB AND SHOWER SPACES

R307.2 BATHTUB AND SHOWER SPACES
BATHTUB AND SHOWER FLOORS AND WALLS ABOVE BATHTUBS WITH INSTALLED SHOWER HEADS AND IN SHOWER COMPARTMENTS SHALL BE FINISHED WITH A NONABSORBENT SURFACE. SUCH WALL SURFACES SHALL EXTEND TO A HEIGHT OF NOT LESS THAN 6 FEET (1829 MM) ABOVE THE FLOOR.

R308 GLAZING

R308.1 IDENTIFICATION
EXCEPT AS INDICATED IN SECTION R308.1.1, EACH PANE OF GLAZING INSTALLED IN HAZARDOUS LOCATIONS AS DEFINED IN SECTION R308.4 SHALL BE PROVIDED WITH A MANUFACTURER'S DESIGNATION SPECIFYING WHO APPLIED THE DESIGNATION. THE TYPE OF GLAZING AND THE SAFETY OF GLAZING STANDARD WITH WHICH IT COMPLIES, AND THAT IS VISIBLE IN THE FINAL INSTALLATION, THE DESIGNATION SHALL BE A CODE ETCHED, SANDBLASTED, CERAMIC-FIRED, LASER ETCHED, EMBOSSED, OR BE OF A TYPE THAT ONCE APPLIED CANNOT BE REMOVED WITHOUT BEING DESTROYED. A LABEL SHALL BE PERMITTED IN LIEU OF THE MANUFACTURER'S DESIGNATION.

R308.4 HAZARDOUS LOCATIONS

THE LOCATIONS SPECIFIED IN SECTIONS R308.4.1 THROUGH R308.4.7 SHALL BE CONSIDERED TO BE SPECIFIC HAZARDOUS LOCATIONS FOR THE PURPOSES OF GLAZING.

R310 EMERGENCY ESCAPE AND RESCUE OPENINGS

R310.2.1 MINIMUM SIZE
EMERGENCY ESCAPE AND RESCUE OPENINGS SHALL HAVE A NET CLEAR OPENING OF NOT LESS THAN 5.7 SQUARE FEET (0.530 M2).

R310.2.2 MINIMUM DIMENSIONS

THE MINIMUM NET CLEAR OPENING HEIGHT DIMENSION SHALL BE 24 INCHES (610 MM). THE MINIMUM NET CLEAR OPENING WIDTH DIMENSION SHALL BE 20 INCHES (508 MM). THE NET CLEAR OPENING DIMENSIONS SHALL BE THE RESULT OF NORMAL OPERATION OF THE OPENING.

R310.2.3 WINDOW SILL HEIGHT

WHERE A WINDOW IS PROVIDED AS THE EMERGENCY ESCAPE AND RESCUE OPENING, IT SHALL HAVE THE BOTTOM OF THE CLEAR OPENING NOT GREATER THAN 44 INCHES (1118 MM) MEASURED FROM THE FLOOR.

R310.4 AREA WELLS

AN EMERGENCY ESCAPE AND RESCUE OPENING WHERE THE BOTTOM OF THE CLEAR OPENING IS BELOW THE ADJACENT GRADE SHALL BE PROVIDED WITH AN AREA WELL IN ACCORDANCE WITH SECTIONS R310.4.1 THROUGH R310.4.4.

R311 MEANS OF EGRESS

R311.3 FLOORS AND LANDINGS AT EXTERIOR DOORS

THERE SHALL BE A LANDING OR FLOOR ON EACH SIDE OF EACH EXTERIOR DOOR. THE WIDTH OF EACH LANDING SHALL BE NOT LESS THAN THE DOOR SWEPT. LANDINGS SHALL HAVE A DIMENSION OF NOT LESS THAN 36 INCHES (914 MM) MEASURED IN THE DIRECTION OF TRAVEL. THE SLOPE AT EXTERIOR LANDINGS SHALL NOT EXCEED 1/4 INCH VERTICAL, IN 12 UNITS HORIZONTAL (2 PERCENT).

R311.3.1 FLOOR ELEVATIONS AT THE REQUIRED EGRESS DOORS

LANDINGS OR FINISHED FLOORS AT THE REQUIRED EGRESS DOOR SHALL BE NOT MORE THAN 1 1/2 INCHES (38 MM) LOWER THAN THE TOP OF THE THRESHOLD.

EXCEPTION: THE LANDINGS OR FLOOR ON THE EXTERIOR SIDE SHALL BE NOT MORE THAN 7 3/4 INCHES (196 MM) BELOW THE TOP OF THE THRESHOLD PROVIDED THAT THE DOOR DOES NOT SWING OVER THE LANDING OR FLOOR.

WHERE EXTERIOR LANDINGS OR FLOORS SERVING THE REQUIRED EGRESS DOOR ARE NOT AT GRADE, THEY SHALL BE PROVIDED WITH ACCESS TO GRADE BY MEANS OF A RAMP IN ACCORDANCE WITH SECTION R311.8 OR A STAIRWAY IN ACCORDANCE WITH SECTION R311.7.

CHAPTER 3 - BUILDING PLANNING (CONT')

R314 SMOKE ALARMS

- R314.3 LOCATION
SMOKE ALARMS SHALL BE INSTALLED IN THE FOLLOWING LOCATIONS:
- IN EACH SLEEPING ROOM.
 - OUTSIDE EACH SEPARATE SLEEPING AREA IN THE IMMEDIATE VICINITY OF THE BEDROOMS.
 - ON EACH ADDITIONAL STORY OF THE DWELLING, INCLUDING BASEMENTS AND HABITABLE ATTICS AND NOT INCLUDING CRAWL SPACES AND UNINHABITABLE ATTICS. IN DWELLINGS OR DWELLING UNITS WITH SPLIT LEVELS AND WITHOUT AN INTERVENING DOOR BETWEEN THE ADJACENT LEVELS, A SMOKE ALARM INSTALLED ON THE UPPER LEVEL SHALL SUFFICE FOR THE ADJACENT LOWER LEVEL PROVIDED THAT THE LOWER LEVEL IS LESS THAN ONE FULL STORY BELOW THE UPPER LEVEL.
 - SMOKE ALARMS SHALL BE INSTALLED NOT LESS THAN 3 FEET (914 MM) HORIZONTALLY FROM THE DOOR OR OPENING OF A BATHROOM THAT CONTAINS A BATHTUB OR SHOWER UNLESS THIS WOULD PREVENT PLACEMENT OF A SMOKE ALARM REQUIRED BY THIS SECTION.
 - IN THE HALLWAY AND IN THE ROOM OPEN TO THE HALLWAY IN DWELLING UNITS WHERE THE CEILING HEIGHT OF A ROOM OPEN TO A HALLWAY SERVING BEDROOMS EXCEEDS THAT OF THE HALLWAY BY 24 INCHES (610 MM) OR MORE.

R316 CARBON MONOXIDE ALARMS

- R316.3 LOCATION
CARBON MONOXIDE ALARMS IN DWELLING UNITS SHALL BE INSTALLED AND MAINTAINED IN ACCORDANCE WITH THE MANUFACTURER'S PUBLISHED INSTRUCTIONS IN THE FOLLOWING LOCATIONS:
- OUTSIDE OF EACH SEPARATE SLEEPING AREA IN THE IMMEDIATE VICINITY OF THE BEDROOMS.
 - ON EVERY OCCUPABLE LEVEL OF A DWELLING UNIT, INCLUDING BASEMENTS, WHERE A FUEL-BURNING APPLIANCE IS LOCATED WITHIN A BEDROOM OR ITS ATTACHED BATHROOM. A CARBON MONOXIDE ALARM SHALL BE INSTALLED WITHIN THE BEDROOM.

R318 FOAM PLASTIC

R318.4 THERMAL BARRIER
UNLESS OTHERWISE ALLOWED IN SECTION R318.5, FOAM PLASTIC SHALL BE SEPARATED FROM THE INTERIOR OF A BUILDING BY AN APPROVED THERMAL BARRIER OF NOT LESS THAN 1/2-INCH (12.7 MM) GYPSUM WALLBOARD, 23/32-INCH (18.2 MM) WOOD STRUCTURAL PLY, OR A MATERIAL THAT IS TESTED IN ACCORDANCE WITH AND MEETS THE ACCEPTANCE CRITERIA OF BOTH THE TEMPERATURE TRANSMISSION FIRE TEST AND THE INTEGRITY FIRE TEST OF NFPA 275.

R318 PROTECTION AGAINST SUBTERRANEAN TERMITES

R318.4 FOAM PLASTIC PROTECTION
IN AREAS WHERE THE PROBABILITY OF TERMITE INFESTATION IS "VERY HEAVY" AS INDICATED IN FIGURE D318.4, EXTRUDED AND EXPANDED POLYSTYRENE, POLYISOCYANURATE AND OTHER FOAM PLASTICS SHALL NOT BE INSTALLED ON THE EXTERIOR FACE OR UNDER INTERIOR OR EXTERIOR FOUNDATION WALLS OR SLAB FOUNDATIONS LOCATED BELOW GRADE. THE CLEARANCE BETWEEN FOAM PLASTICS INSTALLED ABOVE GRADE AND EXPOSED EARTH SHALL BE NOT LESS THAN 6 INCHES (152 MM).
EXCEPTIONS: BUILDINGS WHERE THE STRUCTURAL MEMBERS OF WALLS, FLOORS, CEILINGS AND ROOFS ARE ENTIRELY OF NONCOMBUSTIBLE MATERIALS OR PRESSURE-PRESERVATIVE-TREATED WOOD.
WHERE IN ADDITION TO THE REQUIREMENTS OF SECTION R318.1, AN APPROVED METHOD OF PROTECTING THE FOAM PLASTIC AND STRUCTURE FROM SUBTERRANEAN TERMITE DAMAGE IS USED.
ON THE INTERIOR SIDE OF BASEMENT WALLS.

CHAPTER 4 - FOUNDATIONS

R401 GENERAL

R401.3 DRAINAGE
SURFACE DRAINAGE SHALL BE DIVERTED TO A STORM SEWER CONVEYANCE OR OTHER APPROVED POINT OF COLLECTION THAT DOES NOT CREATE A HAZARD. LOTS SHALL BE GRADED TO DRAIN SURFACE WATER AWAY FROM FOUNDATION WALLS. THE GRADE SHALL FALL NOT FEWER THAN 6 INCHES (152 MM) WITHIN THE FIRST 10 FEET.

* SURFACE WATER MUST BE MOVING AWAY FROM THE BUILDING AND ADJACENT PROPERTIES AND TOWARDS THE PUBLIC WAY.

EXCEPTION: WHERE LOT LINES, WALLS, SLOPES OR OTHER PHYSICAL BARRIERS PROHIBIT 6 INCHES (152 MM) OF FALL WITHIN 10 FEET (3048 MM), DRAINS OR SWALES SHALL BE CONSTRUCTED TO ENSURE DRAINAGE AWAY FROM THE BUILDING. IMPERVIOUS SURFACES WITHIN 10 FEET (3048 MM) OF THE BUILDING FOUNDATION SHALL BE SLOPED NOT LESS THAN 2 PERCENT AWAY FROM THE BUILDING.

CHAPTER 7 - WALL COVERING

R702 INTERIOR COVERING

R702.3.7 WATER-RESISTANT GYPSUM BACKING BOARD
GYPSUM BOARD USED AS THE BASE OR BACKER FOR ADHESIVE APPLICATION OF CERAMIC TILE OR OTHER REQUIRED NONABSORBENT FINISH MATERIAL SHALL CONFORM TO ASTM C1178, C1278 OR C1396. USE OF WATER-RESISTANT GYPSUM BACKING BOARD SHALL BE PERMITTED ON CEILINGS. WATER-RESISTANT GYPSUM BOARD SHALL NOT BE INSTALLED OVER A CLASS I OR I VAPOR RETARDER IN A SHOWER OR TUB COMPARTMENT, CUT OR EXPOSED EDGES, INCLUDING THOSE AT WALL INTERSECTIONS, SHALL BE SEALED AS RECOMMENDED BY THE MANUFACTURER.

R702.42 BACKER BOARDS

MATERIALS USED AS BACKERS FOR WALL TILE IN TUB AND SHOWER AREAS AND WALL PANELS IN SHOWER AREAS SHALL BE OF MATERIALS LISTED IN TABLE R702.4.2, AND INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS.

R703 EXTERIOR COVERING

R703.4 FLASHING
APPROVED CORROSION-RESISTANT FLASHING SHALL BE APPLIED SHINGLE-FASHION IN A MANNER TO PREVENT ENTRY OF WATER INTO THE WALL CAVITY OR PENETRATION OF WATER TO THE BUILDING STRUCTURAL FRAMING COMPONENTS. SELF-ADHERED MEMBRANES USED AS FLASHING SHALL COMPLY WITH AAMA 711. FLUID-APPLIED MEMBRANES USED AS FLASHING IN EXTERIOR WALLS SHALL COMPLY WITH AAMA 714. THE FLASHING SHALL EXTEND TO THE SURFACE OF THE EXTERIOR WALL FINISH. APPROVED CORROSION-RESISTANT FLASHINGS SHALL BE INSTALLED AT THE FOLLOWING LOCATIONS:

- EXTERIOR WINDOW AND DOOR OPENINGS. FLASHING AT EXTERIOR WINDOW AND DOOR OPENINGS SHALL EXTEND TO THE SURFACE OF THE EXTERIOR WALL FINISH OR TO THE WATER-RESISTIVE BARRIER COMPLYING WITH SECTION 703.2 FOR SUBSEQUENT DRAINAGE. MECHANICALLY ATTACHED FLEXIBLE FLASHINGS SHALL COMPLY WITH AAMA 712. FLASHING AT EXTERIOR WINDOW AND DOOR OPENINGS SHALL BE INSTALLED IN ACCORDANCE WITH ONE OR MORE OF THE FOLLOWING:
 - THE PENETRATION MANUFACTURER'S INSTALLATION AND FLASHING INSTRUCTIONS, OR FOR APPLICATIONS NOT ADDRESSED IN THE PENETRATION MANUFACTURER'S INSTRUCTIONS, IN ACCORDANCE WITH THE FLASHING MANUFACTURER'S INSTRUCTIONS, WHERE FLASHING INSTRUCTIONS OR DETAILS ARE NOT PROVIDED, PAN FLASHING SHALL BE INSTALLED AT THE SILL OF EXTERIOR WINDOW AND DOOR OPENINGS. PAN FLASHING SHALL BE SEALED OR SLOPED IN SUCH A MANNER AS TO DIRECT WATER TO THE SURFACE OF THE EXTERIOR WALL FINISH OR TO THE WATER-RESISTIVE BARRIER FOR SUBSEQUENT DRAINAGE. OPENINGS USING PAN FLASHING SHALL INCORPORATE FLASHING OR PROTECTION AT THE HEAD AND SIDES.
 - IN ACCORDANCE WITH THE FLASHING DESIGN OR METHOD OF A REGISTERED DESIGN PROFESSIONAL.
 - IN ACCORDANCE WITH OTHER APPROVED METHODS.
- AT THE INTERSECTION OF CHIMNEYS OR OTHER MASONRY CONSTRUCTION WITH FRAME OR STUCCO WALLS, WITH PROJECTING LIPS ON BOTH SIDES UNDER STUCCO COPINGS.
- UNDER AND AT THE ENDS OF MASONRY, WOOD OR METAL COPINGS AND SILLS.
- CONTINUOUSLY ABOVE ALL PROJECTING WOOD TRIM.
- WHERE EXTERIOR PORCHES, DECKS OR PORCHES ATTACH TO A WALL OR FLOOR ASSEMBLY OF WOOD-FRAME CONSTRUCTION.
- AT WALL AND ROOF INTERSECTIONS.
- AT BUILT-IN GUTTERS.

R704 R703.7.2 1/2 WEEP SCREEDS

A MINIMUM 0.019-INCH (0.5 MM), NO. 26 GALVANIZED SHEET GAGE), CORROSION-RESISTANT WEEP SCREED OR PLASTIC WEEP SCREED, WITH A MINIMUM VERTICAL ATTACHMENT FLANGE OF 3/12 INCHES (89 MM), SHALL BE PROVIDED AT OR BELOW THE FOUNDATION PLATE LINE ON EXTERIOR STUD WALLS IN ACCORDANCE WITH ASTM C626. THE WEEP SCREED SHALL BE PLACED NOT LESS THAN 4 INCHES (102 MM) ABOVE THE EARTH OR 2 INCHES (51 MM) ABOVE PAVED AREAS AND SHALL BE OF A TYPE THAT WILL ALLOW TRAPPED WATER TO DRAIN TO THE EXTERIOR OF THE BUILDING. THE WEATHER RESISTANT BARRIER SHALL LAP THE ATTACHMENT FLANGE. THE EXTERIOR LATH SHALL COVER AND TERMINATE ON THE ATTACHMENT FLANGE OF THE WEEP SCREED.

CHAPTER 7 - WALL COVERING (CONT')

R705 R703.10.1 PANEL SIDING

FIBER-CEMENT PANELS SHALL COMPLY WITH THE REQUIREMENTS OF ASTM C1186, TYPE A, MINIMUM GRADE II OR ISO 8336, CATEGORY A. MINIMUM CLASS 2. PANELS SHALL BE INSTALLED WITH THE LONG DIMENSION EITHER PARALLEL OR PERPENDICULAR TO FRAMING. VERTICAL AND HORIZONTAL JOINTS SHALL OCCUR OVER FRAMING MEMBERS AND SHALL BE PROTECTED WITH CAULKING, OR WITH BATTENS OR FLASHING, OR BE VERTICAL OR HORIZONTAL SHIP-LAP, OR OTHERWISE DESIGNED TO COMPLY WITH SECTION R703.1. PANEL SIDING SHALL BE INSTALLED WITH FASTENERS IN ACCORDANCE WITH TABLE R703.3(1) OR THE APPROVED MANUFACTURER'S INSTRUCTIONS.

R706 R703.10.2 LAP SIDING

FIBER-CEMENT LAP SIDING HAVING A MAXIMUM WIDTH OF 12 INCHES (305 MM) SHALL COMPLY WITH THE REQUIREMENTS OF ASTM C1186, TYPE A, MINIMUM GRADE II OR ISO 8336, CATEGORY A, MINIMUM CLASS 2. LAP SIDING SHALL BE LAPPED A MINIMUM OF 1 1/4 INCHES (32 MM) AND LAP SIDING NOT HAVING TONGUE-AND-GROOVE END JOINTS SHALL HAVE THE ENDS PROTECTED WITH CAULKING, COVERED WITH AN IN-SECTION JOINT COVER, LOCATED OVER A STRIP OF FLASHING, OR SHALL BE DESIGNED TO COMPLY WITH SECTION R703.1. LAP SIDING COURSES SHALL BE INSTALLED WITH THE FASTENERS EDGES EXPOSED OR CONCEALED. IN ACCORDANCE WITH TABLE R703.3(1) OR APPROVED MANUFACTURER'S INSTRUCTIONS.

CHAPTER 8 - ROOF-CEILING CONSTRUCTION

R806 ROOF VENTILATION

R806.2 MINIMUM VENT AREA
THE MINIMUM NET FREE VENTILATING AREA SHALL BE 1/150 OF THE AREA OF THE VENTED SPACE.

EXCEPTION: THE MINIMUM NET FREE VENTILATING AREA SHALL BE 1/300 OF THE VENTED SPACE PROVIDED BOTH OF THE FOLLOWING CONDITIONS ARE MET:

- IN CLIMATE ZONES 6, 7 AND 8, A CLASS I OR I VAPOR RETARDER IS INSTALLED ON THE WARM-IN-WINTER SIDE OF THE CEILING.
- NOT LESS THAN 40 PERCENT AND NOT MORE THAN 50 PERCENT OF THE REQUIRED VENTILATING AREA IS PROVIDED BY VENTILATORS LOCATED IN THE UPPER PORTION OF THE ATTIC OR RAFTER SPACE. UPPER VENTILATORS SHALL BE LOCATED NOT MORE THAN 3 FEET (914 MM) BELOW THE RIDGE OR HIGHEST POINT OF THE SPACE, MEASURED VERTICALLY. THE BALANCE OF THE REQUIRED VENTILATION PROVIDED SHALL BE LOCATED IN THE BOTTOM ONE-THIRD OF THE ATTIC SPACE WHERE THE LOCATION OF WALL OR ROOF FRAMING MEMBERS CONFLICTS WITH THE INSTALLATION OF UPPER VENTILATORS. INSTALLATION MORE THAN 3 FEET (914 MM) BELOW THE RIDGE OR HIGHEST POINT OF THE SPACE SHALL BE PERMITTED.

R807.1 ATTIC ACCESS
BUILDINGS WITH COMBUSTIBLE CEILING OR ROOF CONSTRUCTION SHALL HAVE AN ATTIC ACCESS OPENING TO ATTIC AREAS THAT HAVE A VERTICAL HEIGHT OF 30 INCHES (762 MM) OR GREATER OVER AN AREA OF NOT LESS THAN 30 SQUARE FEET (2.8 M2). THE VERTICAL HEIGHT SHALL BE MEASURED FROM THE TOP OF THE CEILING FRAMING MEMBERS TO THE UNDERSIDE OF THE ROOF FRAMING MEMBERS.

THE ROUGH-FRAMED OPENING SHALL BE NOT LESS THAN 22 INCHES BY 30 INCHES (559 MM BY 762 MM) AND SHALL BE LOCATED IN A HALLWAY OR OTHER LOCATION WITH READY ACCESS. WHERE LOCATED IN A WALL, THE OPENING SHALL BE NOT LESS THAN 22 INCHES WIDE BY 30 INCHES HIGH (559 MM WIDE BY 762 MM HIGH). WHERE THE ACCESS IS LOCATED IN A CEILING, MINIMUM UNOBSTRUCTED HEADROOM IN THE ATTIC SPACE SHALL BE 30 INCHES (762 MM) AT SOME POINT ABOVE THE ACCESS MEASURED VERTICALLY FROM THE BOTTOM OF CEILING FRAMING MEMBERS. SEE THE CALIFORNIA MECHANICAL CODE FOR ACCESS REQUIREMENTS WHERE MECHANICAL EQUIPMENT IS LOCATED IN ATTICS.

EXCERPTS FROM THE 2022 CALIFORNIA MECHANICAL CODE

CHAPTER 3 - GENERAL REGULATIONS

M304.4 ACCESSIBILITY FOR SERVICE

M304.4.1 APPLIANCE AND TUB SHOWER-FLOOR SPACE
AN ATTIC OR UNDER-FLOOR SPACE IN WHICH AN APPLIANCE IS INSTALLED SHALL BE ACCESSIBLE THROUGH AN OPENING AND PASSAGEWAY NOT LESS THAN THE LARGEST COMPONENT OF THE APPLIANCE, AND NOT LESS THAN 22 INCHES BY 30 INCHES (559 MM BY 762 MM).

M304.4.1 LENGTH OF PASSAGEWAY
WHERE THE HEIGHT OF THE PASSAGEWAY IS LESS THAN 6 FEET (1829 MM), THE DISTANCE FROM THE PASSAGEWAY ACCESS TO THE APPLIANCE SHALL NOT EXCEED 20 FEET (6096 MM) MEASURED ALONG THE CENTERLINE OF THE PASSAGEWAY. (NFPA 54.9.5.1.2)

M304.4.2 WIDTH OF PASSAGEWAY
THE PASSAGEWAY SHALL BE UNOBSTRUCTED AND SHALL HAVE SOLID FLOORING NOT LESS THAN 24 INCHES (610 MM) WIDE FROM THE ENTRANCE OPENING TO THE APPLIANCE. (NFPA 54.9.5.1.2)

M304.4.3 WORK PLATFORM
A LEVEL WORKING PLATFORM NOT LESS THAN 30 INCHES BY 30 INCHES (762 MM BY 762 MM) SHALL BE PROVIDED IN FRONT OF THE SERVICE SIDE OF THE APPLIANCE. (NFPA 54.9.5.2)

EXCEPTION: A WORKING PLATFORM NEED NOT BE PROVIDED WHERE THE FURNACE IS CAPABLE OF BEING SERVICED FROM THE REQUIRED ACCESS OPENING. THE FURNACE SERVICE SIDE SHALL NOT EXCEED 12 INCHES (305 MM) FROM THE ACCESS OPENING.

M304.4.1 LIGHTING AND CONVENIENCE OUTLET
A PERMANENT 120V RECEPTACLE OUTLET AND A LIGHTING FIXTURE SHALL BE INSTALLED NEAR THE APPLIANCE. THE SWITCH CONTROLLING THE LIGHTING FIXTURE SHALL BE LOCATED AT THE ENTRANCE TO THE PASSAGEWAY. (NFPA 54.9.5.3)

CHAPTER 5 - EXHAUST SYSTEMS

M501.0 ENVIRONMENTAL AIR DUCTS

M501.0.1 CLOTHES DRYERS
A CLOTHES DRYER EXHAUST DUCT SHALL NOT BE CONNECTED TO A VENT CONNECTOR, GAS VENT, CHIMNEY, AND SHALL NOT TERMINATE INTO A CRAWL SPACE, ATTIC, OR OTHER CONCEALED SPACE. EXHAUST DUCTS SHALL NOT BE ASSEMBLED WITH SCREWS OR OTHER FASTENING MEANS THAT EXTEND INTO THE DUCT AND THAT ARE CAPABLE OF CATCHING LINT, AND THAT REDUCE THE EFFICIENCY OF THE EXHAUST SYSTEM. EXHAUST DUCTS SHALL BE CONSTRUCTED OF RIGID METALLIC MATERIAL. TRANSITION DUCTS USED TO CONNECT THE DRYER TO THE EXHAUST DUCT SHALL BE LISTED AND LABELED IN ACCORDANCE WITH UL 2158A, OR INSTALLED IN ACCORDANCE WITH THE CLOTHES DRYER MANUFACTURER'S INSTALLATION INSTRUCTIONS. CLOTHES DRYER EXHAUST DUCTS SHALL TERMINATE OUTSIDE OF THE BUILDING IN ACCORDANCE WITH SECTION 502.2.1 AND SHALL BE EQUIPPED WITH A BACKDRAFT DAMPER. SCREENS SHALL NOT BE INSTALLED AT THE DUCT TERMINATION DEVICES, SUCH AS FIRE OR SMOKE DAMPERS THAT WILL OBSTRUCT THE FLOW OF THE EXHAUST SHALL NOT BE USED. WHERE JOINING OF DUCTS, THE MALE END SHALL BE INSERTED IN THE DIRECTION OF FLOW.

M504.4.1 PROVISIONS FOR MAKEUP AIR
MAKEUP AIR SHALL BE PROVIDED IN ACCORDANCE WITH THE FOLLOWING:

- MAKEUP AIR SHALL BE PROVIDED FOR TYPE 1 CLOTHES DRYERS IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS. (NFPA 54.10.4.3.1) WHERE A CLOSET IS DESIGNED FOR THE INSTALLATION OF A CLOTHES DRYER, AN OPENING OF NOT LESS THAN 100 SQUARE INCHES (0.005 M2) FOR MAKEUP AIR SHALL BE PROVIDED IN THE DOOR OR BY OTHER APPROVED MEANS.
- PROVISION FOR MAKEUP AIR SHALL BE PROVIDED FOR TYPE 2 CLOTHES DRYERS, WITH A FREE AREA OF NOT LESS THAN 1 SQUARE INCH (0.0006 M2) FOR EACH 1000 BRITISH THERMAL UNITS PER HOUR (BTUH) (0.293 KW) TOTAL INPUT RATING OF THE DRYER(S) INSTALLED. (NFPA 54.10.4.3.2)

M504.4.2 DOMESTIC CLOTHES DRYERS
WHERE A COMPARTMENT OR SPACE FOR A TYPE 1 CLOTHES DRYER IS PROVIDED, NOT LESS THAN A 4 INCH DIAMETER (102 MM) EXHAUST DUCT APPROVED MATERIAL SHALL BE INSTALLED IN ACCORDANCE WITH SECTION 504.0.

TYPE 1 CLOTHES DRYER EXHAUST DUCTS SHALL BE OF RIGID METAL AND SHALL HAVE SMOOTH INTERIOR SURFACES. THE DIAMETER SHALL BE NOT LESS THAN 4 INCHES NOMINAL (100 MM), AND THE THICKNESS SHALL BE NOT LESS THAN 0.016 OF AN INCH (0.406 MM).

CHAPTER 5 - EXHAUST SYSTEMS (CONT')

M504.0.2 LENGTH LIMITATION

UNLESS OTHERWISE PERMITTED OR REQUIRED BY THE DRYER MANUFACTURER'S INSTRUCTIONS AND APPROVED BY THE AUTHORITY HAVING JURISDICTION, DOMESTIC DRYER MOISTURE EXHAUST DUCTS SHALL NOT EXCEED A TOTAL COMBINED HORIZONTAL AND VERTICAL LENGTH OF 14 FEET (4287 MM), INCLUDING TWO 90 DEGREE (1.57 RAD) ELBOWS. A LENGTH OF 2 FEET (610 MM) SHALL BE DEDUCTED FOR EACH 90 DEGREE (1.57 RAD) ELBOW IN EXCESS OF TWO.

EXCEPTION: WHERE AN EXHAUST DUCT POWER VENTILATOR, IN ACCORDANCE WITH SECTION 504.4.2.3, IS USED, THE MAXIMUM LENGTH OF THE DRYER EXHAUST DUCT SHALL BE PERMITTED TO EXCEED THE MAXIMUM LENGTH OF THE DRYER DUCT POWER VENTILATOR MANUFACTURER'S INSTALLATION INSTRUCTIONS.

CHAPTER 11 - REFRIGERATION

M1105.0 GENERAL REQUIREMENTS

M1105.2 SUPPORTS AND ANCHORAGE
SUPPORTS AND ANCHORAGE FOR REFRIGERATION EQUIPMENT AND PIPING SHALL BE PROVIDED IN ACCORDANCE WITH THE BUILDING CODE AS OCCUPANCY CATEGORY H (HAZARDOUS FACILITIES). SUPPORTS SHALL BE MADE OF NONCOMBUSTIBLE MATERIALS.

EXCEPTIONS:
EQUIPMENT CONTAINING GROUP A1 REFRIGERANTS SHALL BE PERMITTED TO BE SUPPORTED BY THE SAME MATERIALS PERMITTED FOR THE BUILDING TYPE. THE USE OF APPROVED VIBRATION ISOLATORS SPECIFICALLY DESIGNED FOR THE NORMAL, WIND, AND SEISMIC LOADS ENCOUNTERED, SHALL BE PERMITTED.

A COMPRESSOR OR PORTION OF A CONDENSING UNIT SUPPORTED FROM THE GROUND SHALL REST ON A CONCRETE OR OTHER APPROVED BASE EXTENDING NOT LESS THAN 3 INCHES (76 MM) ABOVE THE ADJOINING GROUND LEVEL.

M1102.1 M1105.11 REFRIGERANT PORT PROTECTION

AIR CONDITIONING REFRIGERANT CIRCUIT ACCESS PORTS LOCATED OUTDOORS SHALL BE PROTECTED FROM UNAUTHORIZED ACCESS WITH AN EXISTING TYPE TAMPER-RESISTANT CAPS OR IN A MANNER APPROVED BY THE AUTHORITY HAVING JURISDICTION.

EXCEPTION: REFRIGERANT PORTS IN SECURE LOCATIONS PROTECTED BY WALLS OR FENCING AND REQUIRING KEY ACCESS.

EXCERPTS FROM THE 2022 CALIFORNIA PLUMBING CODE

CHAPTER 4 - PLUMBING FIXTURES AND FIXTURE FITTINGS

P401.2 RESIDENTIAL LAVATORY FAUCETS

P401.2.1 MAXIMUM FLOW RATE OF RESIDENTIAL LAVATORY FAUCETS SHALL NOT EXCEED 1.2 GALLONS (4.54 L) PER MINUTE AT 60 PSI. THE MINIMUM FLOW RATE OF RESIDENTIAL LAVATORY FAUCETS SHALL NOT BE LESS THAN 0.8 GALLONS (3.03 L) PER MINUTE AT 20 PSI.

P402.0 SHOWERS

P402.2 WATER CONSUMPTION
SHOWERHEADS SHALL HAVE A MAXIMUM FLOW RATE OF NOT MORE THAN 1.8 GPM AT 80 PSI (8.1 L/M AT 552 KPA). [HCD 1] RESIDENTIAL SHOWERHEADS SHALL COMPLY WITH STANDARD 4.3 OF THE CALIFORNIA GREEN BUILDING STANDARDS CODE (CALGREEN).

P402.2.1 SINGLE SHOWERHEAD

[BSC-CG, DSA-SS & DSA-SS(C)] SHOWERHEADS SHALL HAVE A MAXIMUM FLOW RATE OF NOT MORE THAN 1.8 GALLONS (8.1 L) PER MINUTE AT 80 PSI. SHOWERHEADS SHALL BE CERTIFIED TO THE PERFORMANCE CRITERIA OF THE U.S. EPA WATERSENSE SPECIFICATION FOR SHOWERHEADS IN COMPLIANCE WITH CHAPTER 5, DIVISION 5.3, OF THE CALIFORNIA GREEN BUILDING STANDARDS CODE (CAL GREEN).

P402.3 INDIVIDUAL SHOWER AND TUB-SHOWER COMBINATION CONTROL VALVES
SHOWER AND TUB-SHOWER COMBINATION VALVES SHALL BE PROVIDED WITH INDIVIDUAL CONTROL VALVES OF THE PRESSURE-BALANCE, THERMOSTATIC, OR COMBINATION PRESSURE-BALANCE/THERMOSTATIC MIXING VALVE TYPE THAT PROVIDE SCALD AND THERMAL SHOCK PROTECTION FOR THE RATED FLOW RATE OF THE INSTALLED SHOWERHEAD. THESE VALVES SHALL BE INSTALLED AT THE POINT OF USE AND COMPLY WITH ASSE 1016/ASSE A112 1016/CSA B125.16 OR ASME A112.16.1/CSA B125.1.

GANG SHOWERS, WHERE SUPPLIED WITH A SINGLE TEMPERATURE-CONTROLLED WATER SUPPLY PIPE, SHALL BE CONTROLLED BY A MIXING VALVE THAT COMPLIES WITH ASSE 1069. HANDLE POSITION STOPS SHALL BE PROVIDED ON SUCH VALVES AND SHALL BE ADJUSTED PER THE MANUFACTURER'S INSTRUCTIONS TO DELIVER MAXIMUM MIXED WATER SETTING OF 120°F (49°C). WATER HEATER THERMOSTATS SHALL NOT BE CONSIDERED A SUITABLE CONTROL FOR MEETING THIS PROVISION.

P402.6 SHOWER COMPARTMENTS
SHOWER COMPARTMENTS, REGARDLESS OF SHAPE, SHALL HAVE A MINIMUM FINISHED INTERIOR OF 1024 SQUARE INCHES (66.2 CM) AND SHALL ALSO BE CAPABLE OF ENCOMPASSING A 30 INCH (762 MM) CIRCLE. THE MINIMUM REQUIRED AREA AND DIMENSIONS SHALL BE MEASURED AT A HEIGHT EQUAL TO THE TOP OF THE THRESHOLD AND A POINT TANGENT TO ITS CENTERLINE. THE AREA AND DIMENSIONS SHALL BE MAINTAINED TO A POINT OF NOT LESS THAN 70 INCHES (1778 MM) ABOVE THE SHOWER DRAIN OR TUB SHOWER DRAIN OUTLET WITH NO PROTRUSIONS OTHER THAN A VALVE OR VALVES, SHOWERHEADS, SOAP DISHES, SHELVES, AND SAFETY GRAB BARS, OR RAILS. FOLD-DOWN SEATS IN ACCESSIBLE SHOWER STALLS SHALL BE PERMITTED TO PROTRUDE INTO THE 30 INCH (762 MM) CIRCLE.

EXCEPTIONS:
SHOWERS THAT ARE DESIGNED TO BE IN ACCORDANCE WITH CHAPTER 11A OF THE CALIFORNIA BUILDING CODE.
THE MINIMUM REQUIRED AREA AND DIMENSION SHALL NOT APPLY FOR A SHOWER RECEPTOR HAVING OVERALL DIMENSIONS OF NOT LESS THAN 30 INCHES (762 MM) IN WIDTH AND 60 INCHES (1524 MM) IN LENGTH.

P411.0 WATER CLOSETS

P411.2 WATER CONSUMPTION
THE EFFECTIVE FLUSH VOLUME OF ALL WATER CLOSETS SHALL NOT EXCEED 1.28 GALLONS (4.8 L) PER FLUSH WHEN TESTED IN ACCORDANCE WITH ASME A112.19.2/CSA B45.1.

P420.0 SINKS

P420.2.1 KITCHEN FAUCETS
[BSC-CG, DSA-SS & DSA-SS(C)] KITCHEN FAUCETS SHALL HAVE A MAXIMUM FLOW RATE OF NOT MORE THAN 1.2 GALLONS (8.1 L) PER MINUTE AT 60 PSI. KITCHEN FAUCETS MAY TEMPORARILY INCREASE THE FLOW ABOVE THE MAXIMUM RATE, BUT NOT TO EXCEED 2.2 GALLONS (8.3 L) PER MINUTE AT 60 PSI, AND MUST DEFAULT TO A MAXIMUM FLOW RATE OF 1.8 GALLONS (8.1 L) PER MINUTE AT 60 PSI IN COMPLIANCE WITH CHAPTER 5, DIVISION 5.3 OF THE CALIFORNIA GREEN BUILDING STANDARDS CODE (CALGREEN).

CODE COMPLIANCE NOTES

TABLE R302.1(1) EXTERIOR WALLS, DWELLINGS AND ACCESSORY BUILDINGS WITHOUT AUTO RESIDENTIAL FIRE SPRINKLER PROTECTION				TABLE 610.4 FIXTURE UNIT TABLE FOR DETERMINING WATER PIPE AND METER SIZES																TABLE 703.2 MAXIMUM UNIT LOADING AND MAXIMUM LENGTH OF DRAINAGE AND VENT PIPING											
EXTERIOR WALL ELEMENT		MINIMUM FIRE-RESISTANCE RATING	MINIMUM FIRE SEPARATION DISTANCE	METER AND STREET SERVICE (inches)	BUILDING SUPPLY AND BRANCHES (inches)	MAXIMUM ALLOWABLE LENGTH (feet)														SIZE OF PIPE (inches)	1 ¹ / ₄	1 ¹ / ₂	2	3	4	5	6	8	10	12	
WALLS	FIRE-RESISTANCE RATED	1 HOUR-TESTED IN ACCORDANCE WITH ASTM E119, UL 263 OR SECTION 703.3 OF THE CALIFORNIA BUILDING CODE WITH EXPOSURE FROM BOTH SIDES	0 FEET			40	60	80	100	150	200	250	300	400	500	600	700	800	900	1000	Maximum Units										
	NOT FIRE-RESISTANCE RATED	0 HOURS	≥ 5 FEET	PRESSURE RANGE - 30 to 45 psi ¹																Drainage Piping ¹	1	2 ²	16 ³	48 ⁴	256	600	1380	3600	5600	8400	
PROJECTIONS	NOT ALLOWED	NA	< 2 FEET	3/4	1/2 ²	6	5	4	3	2	1	1	1	0	0	0	0	0	0	Maximum Length											
	FIRE-RESISTANCE RATED	1 HOUR ON THE UNDERSIDE, OR HEAVY TIMBER, OR FIRE-RETARDANT-TREATED WOOD ^{A,B}	≥ 2 FEET < 5 FEET	3/4	3/4	16	16	14	12	9	6	5	5	4	4	3	2	2	2	Drainage Piping											
	NOT FIRE-RESISTANCE RATED	0 HOURS	≥ 5 FEET	3/4	1	29	25	23	21	17	15	13	12	10	8	6	6	6	6	Vertical, (feet)	45	65	85	212	300	390	510	750	—	—	
OPENINGS IN WALLS	NOT ALLOWED	NA	< 3 FEET	1	1	36	31	27	25	20	17	15	13	12	10	8	6	6	6	Horizontal (unlimited)											
	25% MAXIMUM OF WALL AREA	0 HOURS	3 FEET	3/4	1 ¹ / ₄	36	33	31	28	24	23	21	19	17	16	13	12	12	11	Vent Piping											
	UNLIMITED	0 HOURS	5 FEET	1	1 ¹ / ₄	54	47	42	38	32	28	25	23	19	17	14	12	12	11	Horizontal and Vertical ⁶											
PENETRATIONS	ALL	COMPLY WITH SECTION R302.4	< 3 FEET	1 ¹ / ₂	1 ¹ / ₄	78	68	57	48	38	32	28	25	21	18	15	12	12	11	11	Maximum Units	1	8 ³	24	84	256	600	1380	3600	—	—
		NONE REQUIRED	3 FEET	1	1 ¹ / ₂	85	84	79	65	56	48	43	38	32	28	26	22	21	20	20	Maximum Lengths, (feet)	45	60	120	212	300	390	510	750		
FOR SI: 1 FOOT = 304.8 MM. NA = NOT APPLICABLE. A. THE FIRE-RESISTANCE RATING SHALL BE PERMITTED TO BE REDUCED TO 0 HOURS ON THE UNDERSIDE OF THE EAVE OVERHANG IF FIREBLOCKING IS PROVIDED FROM THE WALL TOP PLATE TO THE UNDERSIDE OF THE ROOF SHEATHING. B. THE FIRE-RESISTANCE RATING SHALL BE PERMITTED TO BE REDUCED TO 0 HOURS ON THE UNDERSIDE OF THE RAKE OVERHANG WHERE GABLE VENT OPENINGS ARE NOT INSTALLED.				1 ¹ / ₂	1 ¹ / ₂	150	124	105	91	70	57	49	45	36	31	26	23	21	20	20	FOR SI UNITS: 1 INCH = 25 MM, 1 FOOT = 304.8 MM NOTES: 1. EXCLUDING TRAP ARM. 2. EXCEPT FOR SINKS, URINALS, AND DISHWASHERS - EXCEEDING 1 FIXTURE UNIT. 3. EXCEPT FOR SIX-UNIT TRAPS OR WATER CLOSETS. 4. NOT TO EXCEED FIVE WATER CLOSETS OR FIVE SIX-UNIT TRAPS. 5. BASED ON 1/4 INCH PER FOOT (20.8 MM/M) SLOPE. FOR 1/8 OF AN INCH PER FOOT (10.4 MM/M) SLOPE, MULTIPLY HORIZONTAL FIXTURE UNITS BY A FACTOR OF 0.8. 6. THE DIAMETER OF AN INDIVIDUAL VENT SHALL BE NOT LESS THAN 1 1/4 INCHES (32 MM) NOR LESS THAN ONE-HALF THE DIAMETER OF THE DRAIN TO WHICH IT IS CONNECTED. FIXTURE UNIT LOAD VALUES FOR DRAINAGE AND VENT PIPING SHALL BE COMPUTED FROM TABLE 702.1 AND TABLE 702.2. NOT TO EXCEED ONE-THIRD OF THE TOTAL PERMITTED LENGTH OF A VENT SHALL BE PERMITTED TO BE INSTALLED IN A HORIZONTAL POSITION. WHERE VENTS ARE INCREASED ONE PIPE SIZE FOR THEIR ENTIRE LENGTH, THE MAXIMUM LENGTH LIMITATIONS SPECIFIED IN THIS TABLE DO NOT APPLY. THIS TABLE IS IN ACCORDANCE WITH THE REQUIREMENTS OF SECTION 901.3. 7. UP TO 8 PUBLIC LAVATORIES ARE PERMITTED TO BE INSTALLED ON A 1 1/2 INCH (40 MM) VERTICAL BRANCH OR HORIZONTAL SANITARY BRANCH SLOPED AT 1/4 INCH PER FOOT (20.8 MM/M).										
				2	1 ¹ / ₂	151	129	129	110	80	64	53	46	38	32	27	23	21	20	20											
				1	2	85	85	85	85	85	85	82	80	66	61	57	52	49	46	43											
				1 ¹ / ₂	2	220	205	190	176	155	138	127	120	104	85	70	61	57	54	51											
				2	2	370	327	292	265	217	185	164	147	124	96	70	61	57	54	51											
				2	2 ¹ / ₂	445	418	390	370	330	300	280	265	240	220	198	175	158	143	133											
				PRESSURE RANGE - 46 to 60 psi ¹																											
				3/4	1/2 ²	7	7	6	5	4	3	2	2	1	1	1	0	0	0	0											
				3/4	3/4	20	20	19	17	14	11	9	8	6	5	4	4	3	3	3											
				3/4	1	39	39	36	33	28	23	21	19	17	14	12	10	9	8	8											
				1	1	39	39	39	36	30	25	23	20	18	15	12	10	9	8	8											
				3/4	1 ¹ / ₄	39	39	39	39	39	39	34	32	27	25	22	19	19	17	16											
				1	1 ¹ / ₄	78	78	76	67	52	44	39	36	30	27	24	20	19	17	16											
				1 ¹ / ₂	1 ¹ / ₄	78	78	78	78	66	52	44	39	33	29	24	20	19	17	16											
				1	1 ¹ / ₂	85	85	85	85	85	85	80	67	55	49	41	37	34	32	30											
				1 ¹ / ₂	1 ¹ / ₂	151	151	151	151	128	105	90	78	62	52	42	38	35	32	30											
				2	1 ¹ / ₂	151	151	151	151	150	117	98	84	67	55	42	38	35	32	30											
				1	2	85	85	85	85	85	85	85	85	85	85	85	85	85	83	80											
				1 ¹ / ₂	2	370	370	340	318	272	240	220	198	170	150	135	123	110	102	94											
				2	2	370	370	370	370	368	318	280	250	205	165	142	123	110	102	94											
				2	2 ¹ / ₂	654	640	610	580	535	500	470	440	400	365	335	315	285	267	250											
				PRESSURE RANGE - Over 60 psi ¹																											
				3/4	1/2 ²	7	7	7	6	5	4	3	3	2	1	1	1	1	1	0											
				3/4	3/4	20	20	20	20	17	13	11	10	8	7	6	6	5	4	4											
				3/4	1	39	39	39	39	35	30	27	24	21	17	14	13	12	12	11											
				1	1	39	39	39	39	38	32	29	26	22	18	14	13	12	12	11											
				3/4	1 ¹ / ₄	39	39	39	39	39	39	39	39	34	28	26	25	23	22	21											
				1	1 ¹ / ₄	78	78	78	78	74	62	53	47	39	31	26	25	23	22	21											
				1 ¹ / ₂	1 ¹ / ₄	78	78	78	78	78•	74	65	54	43	34	26	25	23	22	21											
				1	1 ¹ / ₂	85	85	85	85	85	85	85	85	81	64	51	48	46	43	40											
				1 ¹ / ₂	1 ¹ / ₂	151	151	151	151	151	151	130	113	88	73	51	51	46	43	40											
				2	1 ¹ / ₂	151	151	151	151	151	151	142	122	98	82	64	51	46	43	40											
1	2	85	85	85	85	85	85	85	85	85	85	85	85	85	85	85															
1 ¹ / ₂	2	370	370	370	370	360	335	305	282	244	212	187	172	153	141	129															
2	2	370	370	370	370	370	370	370	340	288	245	204	172	153	141	129															
2	2 ¹ / ₂	654	654	654	654	654	650	610	570	510	460	430	404	380	356	329															



California

2022 CALIFORNIA GREEN BUILDING STANDARDS CODE

RESIDENTIAL MANDATORY MEASURES, SHEET 1 (January 2023)

Y N/A RESPON. PARTY
* YES
* NOT APPLICABLE
RESPONSIBLE PARTY (i.e. ARCHITECT, ENGINEER, OWNER, CONTRACTOR, INSPECTOR ETC.)

CHAPTER 3 GREEN BUILDING SECTION 301 GENERAL

301.1 SCOPE. Buildings shall be designed to include the green building measures specified as mandatory in the application checklists contained in this code. Voluntary green building measures are also included in the application checklists and may be included in the design and construction of structures covered by this code, but are not required unless adopted by a city, county, or city and county as specified in Section 101.7.

301.1.1 Additions and alterations. [HCD] The mandatory provisions of Chapter 4 shall be applied to additions or alterations of existing residential buildings where the addition or alteration increases the building's conditioned area, volume, or size. The requirements shall apply only to and/or within the specific area of the addition or alteration.

The mandatory provision of Section 4.106.4.2 may apply to additions or alterations of existing parking facilities or the addition of new parking facilities serving existing multifamily buildings. See Section 4.106.4.3 for application.

Note: Repairs including, but not limited to, resurfacing, restriping and repairing or maintaining existing lighting fixtures are not considered alterations for the purpose of this section.

Note: On and after January 1, 2014, residential buildings undergoing permitted alterations, additions, or improvements shall replace noncompliant plumbing fixtures with water-conserving plumbing fixtures. Plumbing fixture replacement is required prior to issuance of a certificate of final completion, certificate of occupancy or final permit approval by the local building department. See Civil Code Section 1101.1, et seq., for the definition of a noncompliant plumbing fixture, types of residential buildings affected and other important enactment dates.

301.2 LOW-RISE AND HIGH-RISE RESIDENTIAL BUILDINGS. [HCD] The provisions of individual sections of CALGreen may apply to either low-rise residential buildings, high-rise residential buildings, or both. Individual sections will be designated by banners to indicate where the section applies specifically to low-rise only (LR) or high-rise only (HR). When the section applies to both low-rise and high-rise buildings, no banner will be used.

SECTION 302 MIXED OCCUPANCY BUILDINGS

302.1 MIXED OCCUPANCY BUILDINGS. In mixed occupancy buildings, each portion of a building shall comply with the specific green building measures applicable to each specific occupancy.

- Exceptions:
- [HCD] Accessory structures and accessory occupancies serving residential buildings shall comply with Chapter 4 and Appendix A4, as applicable.
 - [HCD] For purposes of CALGreen, live/work units, complying with Section 419 of the *California Building Code*, shall not be considered mixed occupancies. Live/Work units shall comply with Chapter 4 and Appendix A4, as applicable.

DIVISION 4.1 PLANNING AND DESIGN

ABBREVIATION DEFINITIONS:

HCD Department of Housing and Community Development
BSC California Building Standards Commission
DSA-SS Division of the State Architect, Structural Safety
OSHPD Office of Statewide Health Planning and Development
LR Low Rise
HR High Rise
AA Additions and Alterations
N New

CHAPTER 4 RESIDENTIAL MANDATORY MEASURES

SECTION 4.102 DEFINITIONS

4.102.1 DEFINITIONS
The following terms are defined in Chapter 2 (*and are included here for reference*)

FRENCH DRAIN. A trench, hole or other depressed area loosely filled with rock, gravel, fragments of brick or similar pervious material used to collect or channel drainage or runoff water.

WATTLES. Wattles are used to reduce sediment in runoff. Wattles are often constructed of natural plant materials such as hay, straw or similar material shaped in the form of tubes and placed on a downflow slope. Wattles are also used for perimeter and inlet controls.

4.106 SITE DEVELOPMENT

4.106.1 GENERAL. Preservation and use of available natural resources shall be accomplished through evaluation and careful planning to minimize negative effects on the site and adjacent areas. Preservation of slopes, management of storm water drainage and erosion controls shall comply with this section.

4.106.2 STORM WATER DRAINAGE AND RETENTION DURING CONSTRUCTION. Projects which disturb less than one acre of soil and are not part of a larger common plan of development which in total disturbs one acre or more, shall manage storm water drainage during construction. In order to manage storm water drainage during construction, one or more of the following measures shall be implemented to prevent flooding of adjacent property, prevent erosion and retain soil runoff on the site.

- Retention basins of sufficient size shall be utilized to retain storm water on the site.
- Where storm water is conveyed to a public drainage system, collection point, gutter or similar disposal method, water shall be filtered by use of a barrier system, wattle or other method approved by the enforcing agency.
- Compliance with a lawfully enacted storm water management ordinance.

Note: Refer to the State Water Resources Control Board for projects which disturb one acre or more of soil, or are part of a larger common plan of development which in total disturbs one acre or more of soil.

(Website: https://www.waterboards.ca.gov/water_issues/programs/stormwater/construction.html)

4.106.3 GRADING AND PAVING. Construction plans shall indicate how the site grading or drainage system will manage all surface water flows to keep water from entering buildings. Examples of methods to manage surface water include, but are not limited to, the following:

- Swales
- Water collection and disposal systems
- French drains
- Water retention gardens
- Other water measures which keep surface water away from buildings and aid in groundwater recharge.

Exception: Additions and alterations not altering the drainage path.

4.106.4 Electric vehicle (EV) charging for new construction. New construction shall comply with Sections 4.106.4.1 and 4.106.4.2 to facilitate future installation and use of EV chargers. Electric vehicle supply equipment (EVSE) shall be installed in accordance with the *California Electrical Code*, Article 625.

- Exceptions:
- On a case-by-case basis, where the local enforcing agency has determined EV charging and infrastructure are not feasible based upon one or more of the following conditions:
 - Where there is no local utility power supply or the local utility is unable to supply adequate power.
 - Where there is evidence suitable to the local enforcing agency substantiating that additional local utility infrastructure design requirements, directly related to the implementation of Section 4.106.4, may adversely impact the construction cost of the project.
 - Accessory Dwelling Units (ADU) and Junior Accessory Dwelling Units (JADU) without additional parking facilities.

4.106.4.1 New one- and two-family dwellings and townhouses with attached private garages. For each dwelling unit, installed a listed raceway to accommodate a dedicated 208/240-volt branch circuit. The raceway shall not be less than trade size 1 (nominal 1-inch inside diameter). The raceway shall originate at the main service or subpanel and shall terminate into a listed cabinet, box or other enclosure in close proximity to the proposed location of an EV charger. Raceways are required to be continuous at enclosed, inaccessible or concealed areas and spaces. The service panel and/or subpanel shall provide capacity to install a 40-ampere 208/240-volt minimum dedicated branch circuit and space(s) reserved to permit installation of a branch circuit overcurrent protective device.

Exception: A raceway is not required if a minimum 40-ampere 208/240-volt dedicated EV branch circuit is installed in close proximity to the proposed location of an EV charger at the time of original construction in accordance with the *California Electrical Code*.

4.106.4.1.1 Identification. The service panel or subpanel circuit directory shall identify the overcurrent protective device space(s) reserved for future EV charging as "EV CAPABLE". The raceway termination location shall be permanently and visibly marked as "EV CAPABLE".

4.106.4.2 New multifamily dwellings, hotels and motels and new residential parking facilities. When parking is provided, parking spaces for new multifamily dwellings, hotels and motels shall meet the requirements of Sections 4.106.4.2.1 and 4.106.4.2.2. Calculations for spaces shall be rounded up to the nearest whole number. A parking space served by electric vehicle supply equipment or designed as a future EV charging space shall count as at least one standard automobile parking space only for the purpose of complying with any applicable minimum parking space requirements established by a local jurisdiction. See Vehicle Code Section 22511.2 for further details.

4.106.4.2.1 Multifamily development projects with less than 20 dwelling units; and hotels and motels with less than 20 sleeping facilities or guest rooms. The number of dwelling units, sleeping units or guest rooms shall be based on all buildings on a project site subject to this section.

1. EV Capable. Ten (10) percent of the total number of parking spaces on a building site, provided for all types of parking facilities, shall be electric vehicle charging spaces (EV spaces) capable of supporting future Level 2 EVSE. Electrical load calculations shall demonstrate that the electrical panel service capacity and electrical system, including any on-site distribution transformer(s), have sufficient capacity to simultaneously charge all EVs at all required EV spaces at a minimum of 40 amperes.

The service panel or subpanel circuit directory shall identify the overcurrent protective device space(s) reserved for future EV charging purposes as "EV CAPABLE" in accordance with the *California Electrical Code*.

Exceptions:

- When EV chargers (Level 2 EVSE) are installed in a number equal to or greater than the required number of EV capable spaces.
- When EV chargers (Level 2 EVSE) are installed in a number less than the required number of EV capable spaces, the number of EV capable spaces required may be reduced by a number equal to the number of EV chargers installed.

Notes:

a. Construction documents are intended to demonstrate the project's capability and capacity for facilitating future EV charging.

b. There is no requirement for EV spaces to be constructed or available until receptacles for EV charging or EV chargers are installed for use.

2. EV Ready. Twenty-five (25) percent of the total number of parking spaces shall be equipped with low power Level 2 EV charging receptacles. For multifamily parking facilities, no more than one receptacle is required per dwelling unit when more than one parking space is provided for use by a single dwelling unit.

Exception: Areas of parking facilities served by parking lifts.

4.106.4.2.2 Multifamily development projects with 20 or more dwelling units, hotels and motels with 20 or more sleeping units or guest rooms. The number of dwelling units, sleeping units or guest rooms shall be based on all buildings on a project site subject to this section.

1. EV Capable. Ten (10) percent of the total number of parking spaces on a building site, provided for all types of parking facilities, shall be electric vehicle charging spaces (EV spaces) capable of supporting future Level 2 EVSE. Electrical load calculations shall demonstrate that the electrical panel service capacity and electrical system, including any on-site distribution transformer(s), have sufficient capacity to simultaneously charge all EVs at all required EV spaces at a minimum of 40 amperes.

The service panel or subpanel circuit directory shall identify the overcurrent protective device space(s) reserved for future EV charging purposes as "EV CAPABLE" in accordance with the *California Electrical Code*.

Exception: When EV chargers (Level 2 EVSE) are installed in a number greater than five (5) percent of parking spaces required by Section 4.106.4.2.2, Item 3, the number of EV capable spaces required may be reduced by a number equal to the number of EV chargers installed over the five (5) percent required.

Notes:

a. Construction documents shall show locations of future EV spaces.

b. There is no requirement for EV spaces to be constructed or available until receptacles for EV charging or EV chargers are installed for use.

2. EV Ready. Twenty-five (25) percent of the total number of parking spaces shall be equipped with low power Level 2 EV charging receptacles. For multifamily parking facilities, no more than one receptacle is required per dwelling unit when more than one parking space is provided for use by a single dwelling unit.

Exception: Areas of parking facilities served by parking lifts.

3. EV Chargers. Five (5) percent of the total number of parking spaces shall be equipped with Level 2 EVSE. Where common use parking is provided, at least one EV charger shall be located in the common use parking area and shall be available for use by all residents or guests.

When low power Level 2 EV charging receptacles or Level 2 EVSE are installed beyond the minimum required, an automatic load management system (ALMS) may be used to reduce the maximum required electrical capacity to each space served by the ALMS. The electrical system and any on-site distribution transformers shall have sufficient capacity to deliver at least 3.3 kW simultaneously to each EV charging station (EVCS) served by the ALMS. The branch circuit shall have a minimum capacity of 40 amperes, and installed EVSE shall have a capacity of not less than 30 amperes. ALMS shall not be used to reduce the minimum required electrical capacity to the required EV capable spaces.

4.106.4.2.2.1 Electric vehicle charging stations (EVCS). Electric vehicle charging stations required by Section 4.106.4.2.2, Item 3, shall comply with Section 4.106.4.2.2.1.

Exception: Electric vehicle charging stations serving public accommodations, public housing, motels and hotels shall not be required to comply with this section. See California Building Code, Chapter 11B, for applicable requirements.

4.106.4.2.2.1.1 Location. EVCS shall comply with at least one of the following options:

- The charging space shall be located adjacent to an accessible parking space meeting the requirements of the California Building Code, Chapter 11A, to allow use of the EV charger from the accessible parking space, Chapter 2, to the building.
- The charging space shall be located on an accessible route, as defined in the California Building Code, Chapter 2, to the building.

Exception: Electric vehicle charging stations designed and constructed in compliance with the California Building Code, Chapter 11B, are not required to comply with Section 4.106.4.2.2.1.1 and Section 4.106.4.2.2.1.2, Item 3.

4.106.4.2.2.1.2 Electric vehicle charging stations (EVCS) dimensions. The charging spaces shall be designed to comply with the following:

- The minimum length of each EV space shall be 18 feet (5486 mm).
- The minimum width of each EV space shall be 9 feet (2743 mm).
- One in every 25 charging spaces, but not less than one, shall also have an 8-foot (2438 mm) wide minimum aisle. A 5-foot (1524 mm) wide minimum aisle shall be permitted provided the minimum width of the EV space is 12 feet (3658 mm).

a. Surface slope for this EV space and the aisle shall not exceed 1 unit vertical in 48 units horizontal (2.083 percent slope) in any direction.

4.106.4.2.2.1.3 Accessible EV spaces. In addition to the requirements in Sections 4.106.4.2.2.1.1 and 4.106.4.2.2.1.2, all EVSE, when installed, shall comply with the accessibility provisions for EV chargers in the California Building Code, Chapter 11B. EV ready spaces and EVCS in multifamily developments shall comply with California Building Code, Chapter 11A, Section 1109A.

4.106.4.2.3 EV space requirements.

1. Single EV space required. Install a listed raceway capable of accommodating a 208/240-volt dedicated branch circuit. The raceway shall not be less than trade size 1 (nominal 1-inch inside diameter). The raceway shall originate at the main service or subpanel and shall terminate into a listed cabinet, box or enclosure in close proximity to the location or the proposed location of the EV space. Construction documents shall identify the raceway termination point, receptacle or charger location, as applicable. The service panel and/or subpanel shall have a 40-ampere minimum dedicated branch circuit, including branch circuit overcurrent protective device installed, or space(s) reserved to permit installation of a branch circuit overcurrent protective device.

Exception: A raceway is not required if a minimum 40-ampere 208/240-volt dedicated EV branch circuit is installed in close proximity to the location or the proposed location of the EV space, at the time of original construction in accordance with the *California Electrical Code*.

2. Multiple EV spaces required. Construction documents shall indicate the raceway termination point and the location of installed or future EV spaces, receptacles or EV chargers. Construction documents shall also provide information on ampacity of installed or future receptacles or EVSE, raceway methods(s), wiring schematics and electrical load calculations. Plan design shall be based upon a 40-ampere minimum branch circuit. Required raceways and related components that are planned to be installed underground, enclosed, inaccessible or in concealed areas and spaces shall be installed at the time of original construction.

Exception: A raceway is not required if a minimum 40-ampere 208/240-volt dedicated EV branch circuit is installed in close proximity to the location or the proposed location of the EV space at the time of original construction in accordance with the *California Electrical Code*.

4.106.4.2.4 Identification. The service panel or subpanel circuit directory shall identify the overcurrent protective device space(s) reserved for future EV charging purposes as "EV CAPABLE" in accordance with the *California Electrical Code*.

4.106.4.2.5 Electric Vehicle Ready Space Signage. Electric vehicle ready spaces shall be identified by signage or pavement markings, in compliance with Caltrans Traffic Operations Policy Directive 13-01 (Zero Emission Vehicle Signs and Pavement Markings) or its successor(s).

4.106.4.3 Electric vehicle charging for additions and alterations of parking facilities serving existing multifamily buildings. When new parking facilities are added, or electrical systems or lighting of existing parking facilities are added or altered and the work requires a building permit, ten (10) percent of the total number of parking spaces added or altered shall be electric vehicle charging spaces (EV spaces) capable of supporting future Level 2 EVSE.

Notes:

1. Construction documents are intended to demonstrate the project's capability and capacity for facilitating future EV charging.

2. There is no requirement for EV spaces to be constructed or available until EV chargers are installed for use.

DIVISION 4.2 ENERGY EFFICIENCY

4.201 GENERAL

4.201.1 SCOPE. For the purposes of mandatory energy efficiency standards in this code, the California Energy Commission will continue to adopt mandatory standards.

DIVISION 4.3 WATER EFFICIENCY AND CONSERVATION

4.303 INDOOR WATER USE

4.303.1 WATER CONSERVING PLUMBING FIXTURES AND FITTINGS. Plumbing fixtures (water closets and urinals) and fittings (faucets and showerheads) shall comply with the sections 4.303.1.1, 4.303.1.2, 4.303.1.3, and 4.303.1.4.

Note: All noncompliant plumbing fixtures in any residential real property shall be replaced with water-conserving plumbing fixtures. Plumbing fixture replacement is required prior to issuance of a certificate of final completion, certificate of occupancy, or final permit approval by the local building department. See Civil Code Section 1101.1, et seq., for the definition of a noncompliant plumbing fixture, types of residential buildings affected and other important enactment dates.

4.303.1.1 Water Closets. The effective flush volume of all water closets shall not exceed 1.28 gallons per flush. Tank-type water closets shall be certified to the performance criteria of the U.S. EPA WaterSense Specification for Tank-type Toilets.

Note: The effective flush volume of dual flush toilets is defined as the composite, average flush volume of two reduced flushes and one full flush.

4.303.1.2 Urinals. The effective flush volume of wall mounted urinals shall not exceed 0.125 gallons per flush. The effective flush volume of all other urinals shall not exceed 0.5 gallons per flush.

4.303.1.3 Showerheads.

4.303.1.3.1 Single Showerhead. Showerheads shall have a maximum flow rate of not more than 1.8 gallons per minute at 80 psi. Showerheads shall be certified to the performance criteria of the U.S. EPA WaterSense Specification for Showerheads.

4.303.1.3.2 Multiple showerheads serving one shower. When a shower is served by more than one showerhead, the combined flow rate of all the showerheads and/or other shower outlets controlled by a single valve shall not exceed 1.8 gallons per minute at 80 psi, or the shower shall be designed to only allow one shower outlet to be in operation at a time.

Note: A hand-held shower shall be considered a showerhead.

4.303.1.4 Faucets.

4.303.1.4.1 Residential Lavatory Faucets. The maximum flow rate of residential lavatory faucets shall not exceed 1.2 gallons per minute at 60 psi. The minimum flow rate of residential lavatory faucets shall not be less than 0.8 gallons per minute at 20 psi.

4.303.1.4.2 Lavatory Faucets in Common and Public Use Areas. The maximum flow rate of lavatory faucets installed in common and public use areas (outside of dwellings or sleeping units) in residential buildings shall not exceed 0.5 gallons per minute at 60 psi.

4.303.1.4.3 Metering Faucets. Metering faucets when installed in residential buildings shall not deliver more than 0.2 gallons per cycle.

4.303.1.4.4 Kitchen Faucets. The maximum flow rate of kitchen faucets shall not exceed 1.8 gallons per minute at 60 psi. Kitchen faucets may temporarily increase the flow above the maximum rate, but not to exceed 2.2 gallons per minute at 60 psi, and must default to a maximum flow rate of 1.8 gallons per minute at 60 psi.

Note: Where complying faucets are unavailable, aerators or other means may be used to achieve reduction.

4.303.1.4.5 Pre-rinse spray valves. When installed, shall meet the requirements in the *California Code of Regulations*, Title 20 (Appliance Efficiency Regulations), Sections 1605.1 (h)(4) Table H-2, Section 1605.3 (h)(4)(A), and Section 1607 (d)(7) and shall be equipped with an integral automatic shutoff.

FOR REFERENCE ONLY: The following table and code section have been reprinted from the *California Code of Regulations*, Title 20 (Appliance Efficiency Regulations), Section 1605.1 (h)(4) and Section 1605.3 (h)(4)(A).

TABLE H-2	
STANDARDS FOR COMMERCIAL PRE-RINSE SPRAY VALVES MANUFACTURED ON OR AFTER JANUARY 28, 2019	
PRODUCT CLASS [spray force in ounce force (ozf)]	MAXIMUM FLOW RATE (gpm)
Product Class 1 (≤ 5.0 ozf)	1.00
Product Class 2 (> 5.0 ozf and ≤ 8.0 ozf)	1.20
Product Class 3 (> 8.0 ozf)	1.28

Title 20 Section 1605.3 (h)(4)(A): Commercial pre-rinse spray valves manufactured on or after January 1, 2006, shall have a minimum spray force of not less than 4.0 ounces-force (ozf)[113 grams-force(gf)]

4.303.2 Submeters for multifamily buildings and dwelling units in mixed-used residential/commercial buildings. Submeters shall be installed to measure water usage of individual residential dwelling units in accordance with the *California Plumbing Code*.

4.303.3 Standards for plumbing fixtures and fittings. Plumbing fixtures and fittings shall be installed in accordance with the *California Plumbing Code*, and shall meet the applicable standards referenced in Table T701.1 of the *California Plumbing Code*.

NOTE: THIS TABLE COMPILES THE DATA IN SECTION 4.303.1, AND IS INCLUDED AS A CONVENIENCE FOR THE USER.

TABLE - MAXIMUM FIXTURE WATER USE	
FIXTURE TYPE	FLOW RATE
SHOWER HEADS (RESIDENTIAL)	1.8 GMP @ 80 PSI
LAVATORY FAUCETS (RESIDENTIAL)	MAX. 1.2 GPM @ 60 PSI MIN. 0.8 GPM @ 20 PSI
LAVATORY FAUCETS IN COMMON & PUBLIC USE AREAS	0.5 GPM @ 60 PSI
KITCHEN FAUCETS	1.8 GPM @ 60 PSI
METERING FAUCETS	0.2 GAL/CYCLE
WATER CLOSET	1.28 GAL/FLUSH
URINALS	0.125 GAL/FLUSH

4.304 OUTDOOR WATER USE

4.304.1 OUTDOOR POTABLE WATER USE IN LANDSCAPE AREAS. Residential developments shall comply with a local water efficient landscape ordinance or the current California Department of Water Resources' Model Water Efficient Landscape Ordinance (MWELO), whichever is more stringent.

NOTES:

- The Model Water Efficient Landscape Ordinance (MWELO) is located in the *California Code Regulations*, Title 23, Chapter 2.7, Division 2. MWEL0 and supporting documents, including water budget calculator, are available at: <https://www.water.ca.gov/>

DIVISION 4.4 MATERIAL CONSERVATION AND RESOURCE EFFICIENCY

4.406 ENHANCED DURABILITY AND REDUCED MAINTENANCE

4.406.1 RODENT PROOFING. Annular spaces around pipes, electric cables, conduits or other openings in sole/bottom plates at exterior walls shall be protected against the passage of rodents by closing such openings with cement mortar, concrete masonry or a similar method acceptable to the enforcing agency.

4.408 CONSTRUCTION WASTE REDUCTION, DISPOSAL AND RECYCLING
4.408.1 CONSTRUCTION WASTE MANAGEMENT. Recycle and/or salvage for reuse a minimum of 65 percent of the non-hazardous construction and demolition waste in accordance with either Section 4.408.2, 4.408.3 or 4.408.4, or meet a more stringent local construction and demolition waste management ordinance.

Exceptions:

- Excavated soil and land-clearing debris.
- Alternate waste reduction methods developed by working with local agencies if diversion or recycle facilities capable of compliance with this item do not exist or are not located reasonably close to the jobsite.
- The enforcing agency may make exceptions to the requirements of this section when isolated jobsites are located in areas beyond the haul boundaries of the diversion facility.

4.408.2 CONSTRUCTION WASTE MANAGEMENT PLAN. Submit a construction waste management plan in conformance with Items 1 through 5. The construction waste management plan shall be updated as necessary and shall be available during construction for examination by the enforcing agency.

- Identify the construction and demolition waste materials to be diverted from disposal by recycling, reuse on the project or salvage for future use or sale.
- Specify if construction and demolition waste materials will be sorted on-site (source separated) or bulk mixed (single stream).
- Identify diversion facilities where the construction and demolition waste material collected will be taken.
- Identify construction methods employed to reduce the amount of construction and demolition waste generated.
- Specify that the amount of construction and demolition waste materials diverted shall be calculated by weight or volume, but not by both.

4.408.3 WASTE MANAGEMENT COMPANY. Utilize a waste management company, approved by the enforcing agency, which can provide verifiable documentation that the percentage of construction and demolition waste material diverted from the landfill complies with Section 4.408.1.

Note: The owner or contractor may make the determination if the construction and demolition waste materials will be diverted by a waste management company.

4.408.4 WASTE STREAM REDUCTION ALTERNATIVE [LR]. Projects that generate a total combined weight of construction and demolition waste disposed of in landfills, which do not exceed 3.4 lbs./sq.ft. of the building area shall meet the minimum 65% construction waste reduction requirement in Section 4.408.1

4.408.4.1 WASTE STREAM REDUCTION ALTERNATIVE. Projects that generate a total combined weight of construction and demolition waste disposed of in landfills, which do not exceed 2 pounds per square foot of the building area, shall meet the minimum 65% construction waste reduction requirement in Section 4.408.1

4.408.5 DOCUMENTATION. Documentation shall be provided to the enforcing agency which demonstrates compliance with Section 4.408.2, Items 1 through 5, Section 4.408.3 or Section 4.408.4.

NOTES:

- Sample forms found in "A Guide to the California Green Building Standards Code (Residential)" located at www.hcd.ca.gov/CALGreen.html may be used to assist in documenting compliance with this section.
- Mixed construction and demolition debris (C & D) processors can be located at the California Department of Resources Recycling and Recovery (CalRecycle).

4.410 BUILDING MAINTENANCE AND OPERATION

4.410.1 OPERATION AND MAINTENANCE MANUAL. At the time of final inspection, a manual, compact disc, web-based reference or other media acceptable to the enforcing agency which includes all of the following shall be placed in the building:

- Directions to the owner or occupant that the manual shall remain with the building throughout the life cycle of the structure.
- Operation and maintenance instructions for the following:
 - Equipment and appliances, including water-saving devices and systems, HVAC systems, photovoltaic systems, electric vehicle chargers, water-heating systems and other major appliances and equipment.
 - Roof and yard drainage, including gutters and downspouts.
 - Space conditioning systems, including condensers and air filters.
 - Landscape irrigation systems.
 - Water reuse systems.
- Information from local utility, water and waste recovery providers on methods to further reduce resource consumption, including recycle programs and locations.
- Public transportation and/or carpool options available in the area.
- Educational material on the positive impacts of an interior relative humidity between 30-60 percent and what methods an occupant may use to maintain the relative humidity level in that range.
- Information about water-conserving landscape and irrigation design and controllers which conserve water.
- Instructions for maintaining gutters and downspouts and the importance of diverting water at least 5 feet away from the foundation.
- Information on required routine maintenance measures, including, but not limited to, caulking, painting, grading around the building, etc.
- Information about state solar energy and incentive programs available.
- A copy of all special inspections verifications required by the enforcing agency or this code.
- Information from the Department of Forestry and Fire Protection on maintenance of defensible space around residential structures.
- Information and/or drawings identifying the location of grab bar reinforcements.

4.410.2 RECYCLING BY OCCUPANTS. Where 5 or more multifamily dwelling units are constructed on a building site, provide readily accessible area(s) that serves all buildings on the site and are identified for the depositing, storage and collection of non-hazardous materials for recycling, including (at a minimum) paper, corrugated cardboard, glass, plastics, organic waste, and metals, or meet a lawfully enacted local recycling ordinance, if more restrictive.

Exception: Rural jurisdictions that meet and apply for the exemption in Public Resources Code Section 42549.82 (a)(2)(A) et seq. are note required to comply with the organic waste portion of this section.

DIVISION 4.5 ENVIRONMENTAL QUALITY

SECTION 4.501 GENERAL

4.501.



Y = YES
N/A = NOT APPLICABLE
RESPON. PARTY = RESPONSIBLE PARTY (ie: ARCHITECT, ENGINEER, OWNER, CONTRACTOR, INSPECTOR ETC.)

DISCLAIMER: THIS DOCUMENT IS PROVIDED AND INTENDED TO BE USED AS A MEANS TO INDICATE AREAS OF COMPLIANCE WITH THE CALIFORNIA GREEN BUILDING STANDARDS (CALGREEN) CODE. DUE TO THE VARIABLES BETWEEN BUILDING DEPARTMENT JURISDICTIONS, THIS CHECKLIST IS TO BE USED ON AN INDIVIDUAL PROJECT BASIS AND MAY BE MODIFIED BY THE END USER TO MEET THOSE INDIVIDUAL NEEDS. THE END USER ASSUMES ALL RESPONSIBILITY ASSOCIATED WITH THE USE OF THIS DOCUMENT, INCLUDING VERIFICATION WITH THE FULL CODE.



YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 1,199 L-SHAPE

DESIGNER:
LUIS CALDERON
SnapADU


SIGNATURE

[illegible]

CAL-GREEN REQUIREMENTS

G301

22040

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: 2306-22-0336 Chula-Vista ADU -- 1199 L-Shape -- Standard 3BR SOG

Calculation Description: Title 24 Analysis

CF1R-PF-01E

Calculation Date/Time: 2023-06-25T12:05:17:00Z

Input File Name: 2306-22-0336 Chula-Vista ADU -- 1199 L-Shape -- Standard 3BR SOG.rbd22x

(Page 1 of 11)

GENERAL INFORMATION									
01	Project Name2306-22-0336 Chula-Vista ADU -- 1199 L-Shape -- Standard 3BR SOG								
02	Run TitleTitle 24 Analysis								
03	Project Location276 4th Avenue								
04	CityChula Vista				05	Standards Version2022			
06	Zip code91910				07	Software VersionEnergyPro 9.1			
08	Climate Zone10				09	Front Orientation (deg/ Cardinal)All orientations			
10	Building TypeSingle family				11	Number of Dwelling Units1			
12	Project ScopeNewly Constructed				13	Number of Bedrooms3			
14	Addition Cond. Floor Area (ft²)0				15	Number of Stories1			
16	Existing Cond. Floor Area (ft²)n/a				17	Fenestration Average U-factor0.3			
18	Total Cond. Floor Area (ft²)1199				19	Glazing Percentage (%)8.38%			
20	ADU Bedroom Countn/a								

COMPLIANCE RESULTS

01	Building Complies with Computer Performance
02	This building incorporates features that require field testing and/or verification by a certified HERS rater under the supervision of a CEC-approved HERS provider.
03	This building incorporates one or more Special Features shown below

Registration Number: 423-P01011173A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 06/27/2023 16:27
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CHEERS
Report Generated: 2023-06-25 12:06:04

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD													
Project Name: 2306-22-0336 Chula-Vista ADU -- 1199 L-Shape -- Standard 3BR SOG													
Calculation Description: Title 24 Analysis													
ENERGY USE SUMMARY													
Energy Use	Standard Design Source Energy (EDR1) (kBtu/ft ² -yr)	Standard Design TDV Energy (EDR2) (kTDV/ft ² -yr)	Proposed Design Source Energy (EDR1) (kBtu/ft ² -yr)	Proposed Design TDV Energy (EDR2) (kTDV/ft ² -yr)	Compliance Margin (EDR1)	Compliance Margin (EDR2)							
Space Heating	0.89	3.98	1.09	7.92	-0.2	-3.94							
Space Cooling	1.14	23.56	0.84	19.85	0.3	3.71							
IAQ Ventilation	0.42	4.43	0.42	4.43	0	0							
Water Heating	2	20.35	1.34	14.68	0.66	5.67							
Self Utilization/Flexibility Credit				0		0							
South Facing Efficiency Compliance Total	4.45	52.32	3.69	46.88	0.76	5.44							
Space Heating	0.89	3.98	1.27	9.25	-0.38	-5.27							
Space Cooling	1.14	23.56	1	23.51	0.14	0.05							
IAQ Ventilation	0.42	4.43	0.42	4.43	0	0							
Water Heating	2	20.35	1.35	14.67	0.65	5.68							
Self Utilization/Flexibility Credit				0		0							
West Facing Efficiency Compliance Total	4.45	52.32	4.04	51.86	0.41	0.46							

Registration Number: 423-P01011173A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 06/27/2023 16:27
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CHEERS
Report Generated: 2023-06-25 12:06:04

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: 2306-22-0336 Chula-Vista ADU -- 1199 L-Shape -- Standard 3BR SOG

Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-06-25T12:05:17-07:00

Input File Name: 2306-22-0336 Chula-Vista ADU -- 1199 L-Shape -- Standard 3BR SOG.rbd22x

CF19-PRF-01E

(Page 7 of 11)

OPAQUE SURFACES

01	02	03	04	05	06	07	08
Name	Zone	Construction	Azimuth	Orientation	Gross Area (ft²)	Window and Door Area (ft2)	Tilt (deg)
New Front Wall	New ADU	R-21 w/R-5 Wall	0	Front	397	83	90
New Left Wall	New ADU	R-21 w/R-5 Wall	90	Left	259	3	90
New Back Wall	New ADU	R-21 w/R-5 Wall	180	Back	394	34.5	90
New Right Wall	New ADU	R-21 w/R-5 Wall	270	Right	248	0	90
New Roof Attic	New ADU	R-38 w/R-19 B.R.D.	n/a	n/a	1199	n/a	n/a

ATTIC

01	02	03	04	05	06	07	08
Name	Construction	Type	Roof Rise (x in 12)	Roof Reflectance	Roof Emittance	Radiant Barrier	Cool Roof
Attic New ADU	Attic RoofNew ADU	Ventilated	4.5	0.1	0.85	No	No

FENESTRATION / GLAZING

01	02	03	04	05	06	07	08	09	10	11	12	13	14
Name	Type	Surface	Orientation	Azimuth	Width (ft)	Height (ft)	Mult.	Area (ft²)	U-factor	U-factor Source	SHGC	SHGC Source	Exterior Shading
Window W4	Window	New Front Wall	Front	0			1	24	0.3	NFRC	0.23	NFRC	Bug Screen
Window W3	Window	New Front Wall	Front	0			1	3	0.3	NFRC	0.23	NFRC	Bug Screen
Window W2	Window	New Front Wall	Front	0			1	12	0.3	NFRC	0.23	NFRC	Bug Screen
Window W1	Window	New Front Wall	Front	0			1	24	0.3	NFRC	0.23	NFRC	Bug Screen
Window W7	Window	New Left Wall	Left	90			1	3	0.3	NFRC	0.23	NFRC	Bug Screen
Window W6	Window	New Back Wall	Back	180			1	10.5	0.3	NFRC	0.23	NFRC	Bug Screen
Window W5	Window	New Back Wall	Back	180			1	24	0.3	NFRC	0.23	NFRC	Bug Screen

Registration Number: 423-P01011173A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 06/27/2023 16:27
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CHEERS
Report Generated: 2023-06-25 12:06:04

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD						
Project Name: 2306-22-0336 Chula-Vista ADU -- 1199 L-Shape -- Standard 3BR SOG						
Calculation Description: Title 24 Analysis						
ENERGY DESIGN RATINGS						
Standard Design	Energy Design Ratings			Compliance Margins		
	Source Energy (EDR1)	Efficiency ¹ EDR (EDR2efficiency)	Total ² EDR (EDR2total)	Source Energy (EDR1)	Efficiency ¹ EDR (EDR2efficiency)	Total ² EDR (EDR2total)
	37.2	39.2	29.5			
Proposed Design						
North Facing	35.4	35.6	27.6	1.8	3.6	1.9
East Facing	35.9	38.1	28.9	1.3	1.1	0.6
South Facing	34.9	35.2	27.4	2.3	4	2.1
West Facing	36	38.9	29.3	1.2	0.3	0.2
RESULT ³ : PASS						
¹ Efficiency EDR includes improvements like a better building envelope and more efficient equipment. ² Total EDR includes efficiency and demand response measures such as photovoltaic (PV) system and batteries ³ Building complies when source energy, efficiency and total compliance margins are greater than or equal to zero and unmet load hour limits are not exceeded						
• Standard Design PV Capacity: 2.36 kWdc • Proposed PV Capacity Scaling: North (2.36 kWdc) East (2.36 kWdc) South (2.36 kWdc) West (2.36 kWdc)						

Registration Number: 423-P01011173A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 06/27/2023 16:27
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CHEERS
Report Generated: 2023-06-25 12:06:04

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

CF1R-PRF-01E

Project Name: 2306-22-0336 Chula-Vista ADU -- 1199 L-Shape -- Standard 3BR SOG

Calculation Date/Time: 2023-06-25T12:05:17-07:00

(Page 5 of 11)

Calculation Description: Title 24 Analysis

Input File Name: 2306-22-0336 Chula-Vista ADU -- 1199 L-Shape -- Standard 3BR SOG.rbd22x

ENERGY USE INTENSITY				
	Standard Design (kBtu/ft ² - yr)	Proposed Design (kBtu/ft ² - yr)	Compliance Margin (kBtu/ft ² - yr)	Margin Percentage
North Facing				
Gross EU1 ¹	18.66	17.52	1.14	6.11
Net EU1 ²	7.21	6.07	1.14	15.81
East Facing				
Gross EU1 ¹	18.66	17.9	0.76	4.07
Net EU1 ²	7.21	6.45	0.76	10.54
South Facing				
Gross EU1 ¹	18.66	17.44	1.22	6.54
Net EU1 ²	7.21	5.99	1.22	16.92
West Facing				
Gross EU1 ¹	18.66	17.91	0.75	4.02
Net EU1 ²	7.21	6.46	0.75	10.4

Notes

1. Gross EU1 is Energy Use Total (not including PV) / Total Building Area.

2. Net EU1 is Energy Use Total (including PV) / Total Building Area.

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

CF1R-PRF-01E

Project Name: 2306-22-0336 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR SOG

Calculation Date/Time: 2023-06-25T12:36:17-07:00

Input File Name: 2306-22-0336 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR SOG.rbd22zx

Calculation Description: Title 24 Analysis

Page 1 of 12

GENERAL INFORMATION													
01	Project Name 2306-22-0336 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR SOG												
02	Run Title Title 24 Analysis												
03	Project Location 276 4th Avenue												
04	City	Chula Vista	05	Standards Version 2022									
06	Zip code	91910	07	Software Version EnergyPro 9.1									
08	Climate Zone	10	09	Front Orientation (deg/ Cardinal) All orientations									
10	Building Type	Single family	11	Number of Dwelling Units 1									
12	Project Scope	Newly Constructed	13	Number of Bedrooms 2									
14	Addition Cond. Floor Area (ft²)	0	15	Number of Stories 1									
16	Existing Cond. Floor Area (ft²)	n/a	17	Fenestration Average U-factor 0.3									
18	Total Cond. Floor Area (ft²)	1199	19	Glazing Percentage (%) 11.38%									
20	ADU Bedroom Count n/a												
COMPLIANCE RESULTS													
01	Building Complies with Computer Performance												
02	This building incorporates features that require field testing and/or verification by a certified HERS rater under the supervision of a CEC-approved HERS provider.												
03	This building incorporates one or more Special Features shown below												

Registration Number: 423-P01011176A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 06/27/2023 16:28
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CHEERS
Report Generated: 2023-06-25 12:37:04

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

CF1R-PRF-01E

Project Name: 2306-22-0336 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR SOG

Calculation Date/Time: 2023-06-25T12:36:17-07:00

Input File Name: 2306-22-0336 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR SOG.rbd22zx

Calculation Description: Title 24 Analysis

Page 4 of 12

ENERGY USE SUMMARY							
Energy Use	Standard Design Source Energy (EDR1) (kBtu/ft² - yr)	Standard Design TDV Energy (EDR2) (kTDV/ft² - yr)	Proposed Design Source Energy (EDR1) (kBtu/ft² - yr)	Proposed Design TDV Energy (EDR2) (kTDV/ft² - yr)	Compliance Margin (EDR1)	Compliance Margin (EDR2)	
Space Heating	0.99	4.39	1.09	7.89	-0.1	-3.5	
Space Cooling	1.09	23.45	0.8	19.82	0.29	3.63	
IAQ Ventilation	0.37	3.92	0.37	3.92	0	0	
Water Heating	1.81	18.39	1.18	13.25	0.63	5.14	
Self Utilization/Flexibility Credit				0		0	
South Facing Efficiency Compliance Total	4.26	50.15	3.44	44.88	0.82	5.27	
Space Heating	0.99	4.39	1.35	9.8	-0.36	-5.41	
Space Cooling	1.09	23.45	0.93	22.88	0.16	0.57	
IAQ Ventilation	0.37	3.92	0.37	3.92	0	0	
Water Heating	1.81	18.39	1.19	13.26	0.62	5.13	
Self Utilization/Flexibility Credit				0		0	
West Facing Efficiency Compliance Total	4.26	50.15	3.84	49.86	0.42	0.29	

Registration Number: 423-P01011176A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 06/27/2023 16:28
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CHEERS
Report Generated: 2023-06-25 12:37:04

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

CF1R-PRF-01E

Project Name: 2306-22-0336 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR SOG

Calculation Date/Time: 2023-06-25T12:36:17-07:00

Input File Name: 2306-22-0336 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR SOG.rbd22zx

Calculation Description: Title 24 Analysis

Page 7 of 12

OPAQUE SURFACES													
01	02	03	04	05	06	07	08						
Name	Zone	Construction	Azimuth	Orientation	Gross Area (ft²)	Window and Door Area (ft2)	Tilt (deg)						
New Front Wall	New ADU	R-21 w/R-5 Wall	0	Front	397	95	90						
New Left Wall	New ADU	R-21 w/R-5 Wall	90	Left	261	24	90						
New Back Wall	New ADU	R-21 w/R-5 Wall	180	Back	394	37.5	90						
New Right Wall	New ADU	R-21 w/R-5 Wall	270	Right	248	0	90						
New Roof Attic	New ADU	R-38 w/R-19 B.R.D.	n/a	n/a	1199	n/a	n/a						
ATTIC													
01	02	03	04	05	06	07	08						
Name	Construction	Type	Roof Rise [x in 12]	Roof Reflectance	Roof Emittance	Radiant Barrier	Cool Roof						
Attic New ADU	Attic RoofNew ADU	Ventilated	4.5	0.1	0.85	No	No						
FENESTRATION / GLAZING													
01	02	03	04	05	06	07	08	09	10	11	12	13	14
Name	Type	Surface	Orientation	Azimuth	Width (ft)	Height (ft)	Mult.	Area (ft²)	U-factor	U-factor Source	SHGC	SHGC Source	Exterior Shading
Window W4	Window	New Front Wall	Front	0			1	24	0.3	NFRC	0.23	NFRC	Bug Screen
Window W3	Window	New Front Wall	Front	0			1	3	0.3	NFRC	0.23	NFRC	Bug Screen
Window W1	Window	New Front Wall	Front	0			1	24	0.3	NFRC	0.23	NFRC	Bug Screen
Window W9	Window	New Front Wall	Front	0			1	24	0.3	NFRC	0.23	NFRC	Bug Screen
Window W8	Window	New Left Wall	Left	90			1	12	0.3	NFRC	0.23	NFRC	Bug Screen
Window W2	Window	New Left Wall	Left	90			1	12	0.3	NFRC	0.23	NFRC	Bug Screen
Window W6	Window	New Back Wall	Back	180			1	10.5	0.3	NFRC	0.23	NFRC	Bug Screen

Registration Number: 423-P01011176A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 06/27/2023 16:28
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CHEERS
Report Generated: 2023-06-25 12:37:04

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

CF1R-PRF-01E

Project Name: 2306-22-0336 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR SOG

Calculation Date/Time: 2023-06-25T12:36:17-07:00

Input File Name: 2306-22-0336 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR SOG.rbd22zx

Calculation Description: Title 24 Analysis

Page 2 of 12

ENERGY DESIGN RATINGS						
	Energy Design Ratings			Compliance Margins		
	Source Energy (EDR1)	Efficiency ¹ EDR (EDR2efficiency)	Total ² EDR (EDR2total)	Source Energy (EDR1)	Efficiency ¹ EDR (EDR2efficiency)	Total ² EDR (EDR2total)
Standard Design	35.7	38.2	28			
Proposed Design						
North Facing	33.7	34.4	26.1	2	3.8	1.9
East Facing	33.9	36.6	27.2	1.8	1.6	0.8
South Facing	33.1	34.2	26	2.6	4	2
West Facing	34.3	38	27.9	1.4	0.2	0.1
RESULT ³ : PASS						
¹ Efficiency EDR includes improvements like a better building envelope and more efficient equipment. ² Total EDR includes efficiency and demand response measures such as photovoltaic (PV) system and batteries ³ Building complies when source energy, efficiency and total compliance margins are greater than or equal to zero and unmet load hour limits are not exceeded						
• Standard Design PV Capacity: 2.11 kWdc • Proposed PV Capacity Scaling: North (2.11 kWdc) East (2.11 kWdc) South (2.11 kWdc) West (2.11 kWdc)						

Registration Number: 423-P01011176A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 06/27/2023 16:28
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CHEERS
Report Generated: 2023-06-25 12:37:04

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

CF1R-PRF-01E

Project Name: 2306-22-0336 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR SOG

Calculation Date/Time: 2023-06-25T12:36:17-07:00

Input File Name: 2306-22-0336 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR SOG.rbd22zx

Calculation Description: Title 24 Analysis

Page 5 of 12

ENERGY USE INTENSITY				
	Standard Design (kBtu/ft² - yr)	Proposed Design (kBtu/ft² - yr)	Compliance Margin (kBtu/ft² - yr)	Margin Percentage
North Facing				
Gross EU1 ¹	17	15.81	1.19	7
Net EU1 ²	6.75	5.57	1.18	17.48
East Facing				
Gross EU1 ¹	17	16.13	0.87	5.12
Net EU1 ²	6.75	5.88	0.87	12.89
South Facing				
Gross EU1 ¹	17	15.71	1.29	7.59
Net EU1 ²	6.75	5.47	1.28	18.96
West Facing				
Gross EU1 ¹	17	16.19	0.81	4.76
Net EU1 ²	6.75	5.95	0.8	11.85
Notes 1. Gross EU1 is Energy Use Total (not including PV) / Total Building Area. 2. Net EU1 is Energy Use Total (including PV) / Total Building Area.				

Registration Number: 423-P01011176A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 06/27/2023 16:28
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CHEERS
Report Generated: 2023-06-25 12:37:04

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

CF1R-PRF-01E

Project Name: 2306-22-0336 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR SOG

Calculation Date/Time: 2023-06-25T12:36:17-07:00

Input File Name: 2306-22-0336 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR SOG.rbd22zx

Calculation Description: Title 24 Analysis

Page 8 of 12

FENESTRATION / GLAZING													
01	02	03	04	05	06	07	08	09	10	11	12	13	14
Name	Type	Surface	Orientation	Azimuth	Width (ft)	Height (ft)	Mult.	Area (ft²)	U-factor	U-factor Source	SHGC	SHGC Source	Exterior Shading
Window W7	Window	New Back Wall	Back	180			1	3	0.3	NFRC	0.23	NFRC	Bug Screen
Window W5	Window	New Back Wall	Back	180			1	24	0.3	NFRC	0.23	NFRC	Bug Screen
OPAQUE DOORS													
01	02	03	04										
Name	Side of Building	Area (ft²)	U-factor										
Front Door D1	New Front Wall	20	0.2										
SLAB FLOORS													
01	02	03	04	05	06	07	08						
Name	Zone	Area (ft²)	Perimeter (ft)	Edge Insul. R-value and Depth	Edge Insul. R-value and Depth	Carpeted Fraction	Heated						
New Slab-on-Grade	New ADU	1199	0.1	none	0	80%	No						
OPAQUE SURFACE CONSTRUCTIONS													
01	02	03	04	05	06	07	08						
Construction Name	Surface Type	Construction Type	Framing	Total Cavity R-value	Interior / Exterior Continuous R-value	U-factor	Assembly Layers						
R-21 w/R-5 Wall	Exterior Walls	Wood Framed Wall	2x6 @ 16 in. O. C.	R-21	None / 5	0.048	Inside Finish: Gypsum Board Cavity / Frame: R-21 / 2x6 Sheathing / Insulation: R-5 Sheathing Exterior Finish: 3 Coat Stucco						

Registration Number: 423-P01011176A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 06/27/2023 16:28
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CHEERS
Report Generated: 2023-06-25 12:37:04

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

CF1R-PRF-01E

Project Name: 2306-22-0336 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR SOG

Calculation Date/Time: 2023-06-25T12:36:17-07:00

Input File Name: 2306-22-0336 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR SOG.rbd22zx

Calculation Description: Title 24 Analysis

Page 3 of 12

ENERGY USE SUMMARY							
Energy Use	Standard Design Source Energy (EDR1) (kBtu/ft² - yr)	Standard Design TDV Energy (EDR2) (kTDV/ft² - yr)	Proposed Design Source Energy (EDR1) (kBtu/ft² - yr)	Proposed Design TDV Energy (EDR2) (kTDV/ft² - yr)	Compliance Margin (EDR1)	Compliance Margin (EDR2)	
Space Heating	0.99	4.39	1.33	9.55	-0.34	-5.16	
Space Cooling	1.09	23.45	0.75	18.45	0.34	5	
IAQ Ventilation	0.37	3.92	0.37	3.92	0	0	
Water Heating	1.81	18.39	1.19	13.3	0.62	5.09	
Self Utilization/Flexibility Credit				0		0	
North Facing Efficiency Compliance Total	4.26	50.15	3.64	45.22	0.62	4.93	
Space Heating	0.99	4.39	1.24	8.77	-0.25	-4.38	
Space Cooling	1.09	23.45	0.91	22.2	0.18	1.25	
IAQ Ventilation	0.37	3.92	0.37	3.92	0	0	
Water Heating	1.81	18.39	1.18	13.22	0.63	5.17	
Self Utilization/Flexibility Credit				0		0	
East Facing Efficiency Compliance Total	4.26	50.15	3.7	48.11	0.56	2.04	

Registration Number: 423-P01011176A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 06/27/2023 16:28
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CHEERS
Report Generated: 2023-06-25 12:37:04

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

CF1R-PRF-01E

Project Name: 2306-22-0336 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR SOG

Calculation Date/Time: 2023-06-25T12:36:17-07:00

Input File Name: 2306-22-0336 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR SOG.rbd22zx

Calculation Description: Title 24 Analysis

Page 6 of 12

REQUIRED PV SYSTEMS												
01	02	03	04	05	06	07	08	09	10	11	12	
DC System Size (kWdc)	Exception	Module Type	Array Type	Power Electronics	CFI	Azimuth (deg)	Tilt Input	Array Angle (deg)	Tilt: [x in 12]	Inverter Eff. (%)	Annual Solar Access (%)	
2.11	NA	Standard (14-17%)	Fixed	none	true	150-270	n/a	n/a	<=7:12	96	98	
REQUIRED SPECIAL FEATURES												
The following are features that must be installed as condition for meeting the modeled energy performance for this computer analysis. • Insulation below roof deck • Northwest Energy Efficiency Alliance (NEEA) rated heat pump water heater; specific brand/model, or equivalent, must be installed												
HERS FEATURE SUMMARY												
The following is a summary of the features that must be field-verified by a certified HERS Rater as a condition for meeting the modeled energy performance for this computer analysis. Additional detail is provided in the building tables below. Registered CF2Rs and CF3Rs are required to be completed in the HERS Registry • Quality insulation installation (QII) • Indoor air quality ventilation • Kitchen range hood • Verified heat pump rated heating capacity												
BUILDING - FEATURES INFORMATION												
01	02	03	04	05	06	07						
Project Name	Conditioned Floor Area (ft²)	Number of Dwelling Units	Number of Bedrooms	Number of Zones	Number of Ventilation Cooling Systems	Number of Water Heating Systems						
2306-22-0336 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR SOG	1199	1	2	1	0	1						
ZONE INFORMATION												
01	02	03	04	05	06	07						
Zone Name	Zone Type	HVAC System Name	Zone Floor Area (ft²)	Avg. Ceiling Height	Water Heating System 1	Status						
New ADU	Conditioned	New HVAC1	1199	8	DHW Sys 1	New						
Registration Number: 423-P01011176A-000-000-0000000-0000 NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document. CA Building Energy Efficiency Standards - 2022 Residential Compliance												
Registration Date/Time: 06/27/2023 16:28 Report Version: 2022.0.000 Schema Version: rev 20220901												
HERS Provider: CHEERS Report Generated: 2023-06-25 12:37:04												

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

CF1R-PRF-01E

Project Name: 2306-22-0336 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR RF

Calculation Date/Time: 2023-06-25T12:20:40-07:00

Input File Name: 2306-22-0336 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR RF.rbd22zx

Calculation Description: Title 24 Analysis

Page 9 of 12

OPAQUE SURFACE CONSTRUCTIONS								
01	02	03	04	05	06	07	08	
Construction Name	Surface Type	Construction Type	Framing	Total Cavity R-value	Interior / Exterior Continuous R-value	U-factor	Assembly Layers	
R-38 w/R-19 B.R.D.	Ceilings (below attic)	Wood Framed Ceiling	2x4 @ 24 in. O. C.	R-38	None / None	0.025	Over Ceiling Joists: R-38.9 Insul. Cavity / Frame: R-9.1 / 2x4 Inside Finish: Gypsum Board	
BUILDING ENVELOPE - HERS VERIFICATION								
01	02	03	04	05				
Quality Insulation Installation (QII)	High R-value Spray Foam Insulation	Building Envelope Air Leakage	CFM50	CFM50				
Required	Not Required	N/A	n/a	n/a				
WATER HEATING SYSTEMS								
01	02	03	04	05	06	07	08	09
Name	System Type	Distribution Type	Water Heater Name	Number of Units	Solar Heating System	Compact Distribution	HERS Verification	Water Heater Name (#)
DHW Sys 1	Domestic Hot Water (DHW)	Standard	DHW Heater 1	1	n/a	None	n/a	DHW Heater 1 (1)
WATER HEATERS - NEEA HEAT PUMP								
01	02	03	04	05	06	07	08	
Name	# of Units	Tank Vol. (gal)	NEEA Heat Pump Brand	NEEA Heat Pump Model	Tank Location	Duct Inlet Air Source	Duct Outlet Air Source	
DHW Heater 1	1	50	AOSmith	AOSmithHPTU50	Outside	New ADU	New ADU	

Autodesk Docs://22040_City of Chula Vista/22040_City of Chula Vista_1199 L-Shape_V2_CD_RVT22.rvt 3/23/2024 12:45:28 PM

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: 2310-22-0616 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR SOG

Calculation Description: Title 24 Analysis

CF1R-PRF-01E

(Page 1 of 12)

Calculation Date/Time: 2023-11-01T16:34:49-07:00

Input File Name: 2310-22-0616 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR SOG.rbd22x

GENERAL INFORMATION											
01	Project Name		2310-22-0616 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR SOG								
02	Run Title		Title 24 Analysis								
03	Project Location		276 4th Avenue								
04	City		Chula Vista		05	Standards Version		2022			
06	Zip code		91910		07	Software Version		EnergyPro 9.2			
08	Climate Zone		7		09	Front Orientation (deg/ Cardinal)		All orientations			
10	Building Type		Single family		11	Number of Dwelling Units		1			
12	Project Scope		Newly Constructed		13	Number of Bedrooms		2			
14	Addition Cond. Floor Area (ft²)		0		15	Number of Stories		1			
16	Existing Cond. Floor Area (ft²)		n/a		17	Fenestration Average U-factor		0.3			
18	Total Cond. Floor Area (ft²)		1199		19	Glazing Percentage (%)		11.38%			
20	ADU Bedroom Count		n/a		21	ADU Conditioned Floor Area		n/a			
22	Fuel Type		Natural gas		23	No Dwelling Unit:		No			

COMPLIANCE RESULTS

01

Building Complies with Computer Performance

02

This building incorporates features that require field testing and/or verification by a certified HERS rater under the supervision of a CEC-approved HERS provider.

03

This building incorporates one or more Special Features shown below

Registration Number: 423-P010199029A-000-000-0000000-0000 Registration Date/Time: 11/01/2023 17:00 HERS Provider: CHEERS
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance Report Version: 2022.0.000 Schema Version: rev 20220901 Report Generated: 2023-11-01 16:35:37

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD											
Project Name: 2310-22-0616 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR SOG											
Calculation Description: Title 24 Analysis											
Input File Name: 2310-22-0616 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR SOG.rbd22x											
CF1R-PRF-01E (Page 4 of 12)											
ENERGY USE SUMMARY											
Energy Use	Standard Design Source Energy (EDR1) (kBtu/ft² · yr)	Standard Design TDV Energy (EDR2) (kTOV/ft² · yr)	Proposed Design Source Energy (EDR1) (kBtu/ft² · yr)	Proposed Design TDV Energy (EDR2) (kTOV/ft² · yr)	Compliance Margin (EDR1)	Compliance Margin (EDR2)					
Space Heating	0.21	0.96	0.37	2.73	-0.16	-1.77					
Space Cooling	0.41	9.3	0.09	3.05	0.32	6.25					
IAQ Ventilation	0.37	4	0.37	4	0	0					
Water Heating	1.59	17.89	1.23	14.23	0.36	3.66					
Self Utilization/Flexibility Credit				0		0					
South Facing Efficiency Compliance Total	2.58	32.15	2.06	24.01	0.52	8.14					
Space Heating	0.21	0.96	0.55	4.09	-0.34	-3.13					
Space Cooling	0.41	9.3	0.18	4.46	0.23	4.84					
IAQ Ventilation	0.37	4	0.37	4	0	0					
Water Heating	1.59	17.89	1.23	14.23	0.36	3.66					
Self Utilization/Flexibility Credit				0		0					
West Facing Efficiency Compliance Total	2.58	32.15	2.33	26.78	0.25	5.37					

Registration Number: 423-P010199029A-000-000-0000000-0000 Registration Date/Time: 11/01/2023 17:00 HERS Provider: CHEERS
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance Report Version: 2022.0.000 Schema Version: rev 20220901 Report Generated: 2023-11-01 16:35:37

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD												CF1R-PRF-01E			
Project Name: 2310-22-0616 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR SOG												Calculation Date/Time: 2023-11-01T16:34:49-07:00		(Page 7 of 12)	
Calculation Description: Title 24 Analysis												Input File Name: 2310-22-0616 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR SOG.rbd22x			
OPAQUE SURFACES															
01	02	03	04	05	06	07	08								
Name	Zone	Construction	Azimuth	Orientation	Gross Area (ft²)	Window and Door Area (ft2)	Tilt (deg)								
New Front Wall	New ADU	R-21 Wall	0	Front	397	95	90								
New Left Wall	New ADU	R-21 Wall	90	Left	261	24	90								
New Back Wall	New ADU	R-21 Wall	180	Back	394	37.5	90								
New Right Wall	New ADU	R-21 Wall	270	Right	248	0	90								
New Roof Attic	New ADU	R-30 Roof Attic	n/a	n/a	1199	n/a	n/a								
ATTIC															
01	02	03	04	05	06	07	08								
Name	Construction	Type	Roof Rise (x in 12)	Roof Reflectance	Roof Emittance	Radiant Barrier	Cool Roof								
Attic New ADU	Attic RoofNew ADU	Ventilated	4.5	0.1	0.85	Yes	No								
FENESTRATION / GLAZING															
01	02	03	04	05	06	07	08	09	10	11	12	13	14		
Name	Type	Surface	Orientation	Azimuth	Width (ft)	Height (ft)	Mult.	Area (ft²)	U-factor	U-factor Source	SHGC	SHGC Source	Exterior Shading		
Window W4	Window	New Front Wall	Front	0			1	24	0.3	NFRC	0.23	NFRC	Bug Screen		
Window W3	Window	New Front Wall	Front	0			1	3	0.3	NFRC	0.23	NFRC	Bug Screen		
Window W1	Window	New Front Wall	Front	0			1	24	0.3	NFRC	0.23	NFRC	Bug Screen		
Window W9	Window	New Front Wall	Front	0			1	24	0.3	NFRC	0.23	NFRC	Bug Screen		
Window W8	Window	New Left Wall	Left	90			1	12	0.3	NFRC	0.23	NFRC	Bug Screen		
Window W2	Window	New Left Wall	Left	90			1	12	0.3	NFRC	0.23	NFRC	Bug Screen		
Window W6	Window	New Back Wall	Back	180			1	10.5	0.3	NFRC	0.23	NFRC	Bug Screen		
Registration Number: 423-P010199029A-000-000-0000000-0000															
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS). Usage information submitted by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.															
CA Building Energy Efficiency Standards - 2022 Residential Compliance															
Registration Date/Time: 11/01/2023 17:00															
Schema Version: 2022.0.0001															
Report Generated: 2023-11-01 16:35:37															

Registration Number: 423-P010199029A-000-000-0000000-0000 Registration Date/Time: 11/01/2023 17:00 HERS Provider: CHEERS
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance Report Version: 2022.0.000 Schema Version: rev 20220901 Report Generated: 2023-11-01 16:35:37

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: 2310-22-0616 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR SOG

Calculation Description: Title 24 Analysis

Input File Name: 2310-22-0616 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR SOG.rbd22x

CF1R-PRF-01E (Page 2 of 12)

ENERGY DESIGN RATINGS

	Energy Design Ratings			Compliance Margins		
	Source Energy (EDR1)	Efficiency ¹ EDR (EDR2efficiency)	Total ² EDR (EDR2total)	Source Energy (EDR1)	Efficiency ¹ EDR (EDR2efficiency)	Total ² EDR (EDR2total)
Standard Design	36.3	46.2	32.4			
Proposed Design						
North Facing	34.7	35.1	28.4	1.6	11.1	4
East Facing	34.9	37.3	29.2	1.4	8.9	3.2
South Facing	34.3	34.5	28.2	2	11.7	4.2
West Facing	35.3	38.5	29.6	1	7.7	2.8
RESULT ³ : PASS						

¹Efficiency EDR includes improvements like a better building envelope and more efficient equipment

²Total EDR includes efficiency and demand response measures such as photovoltaic (PV) system and batteries

³Building complies when source energy, efficiency and total compliance margins are greater than or equal to zero and unmet load hour limits are not exceeded

• Standard Design PV Capacity: 2.05 kWdc

• Proposed PV Capacity Scaling: North (2.05 kWdc) East (2.05 kWdc) South (2.05 kWdc) West (2.05 kWdc)

Registration Number: 423-P010199029A-000-000-0000000-0000 Registration Date/Time: 11/01/2023 17:00 HERS Provider: CHEERS
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance Report Version: 2022.0.000 Schema Version: rev 20220901 Report Generated: 2023-11-01 16:35:37

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: 2310-22-0616 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR SOG

Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-11-01T16:34:49-07:00

Input File Name: 2310-22-0616 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR SOG.rbd22x

CF1R-PRF-01E
(Page 5 of 12)

ENERGY USE INTENSITY				
	Standard Design (kBtu/ft² · yr)	Proposed Design (kBtu/ft² · yr)	Compliance Margin (kBtu/ft² · yr)	Margin Percentage
North Facing				
Gross EU1 ¹	14.96	14.14	0.82	5.48
Net EU1 ²	5.78	4.95	0.83	14.36
East Facing				
Gross EU1 ¹	14.96	14.23	0.73	4.88
Net EU1 ²	5.78	5.04	0.74	12.8
South Facing				
Gross EU1 ¹	14.96	14.06	0.9	6.02
Net EU1 ²	5.78	4.87	0.91	15.74
West Facing				
Gross EU1 ¹	14.96	14.32	0.64	4.28
Net EU1 ²	5.78	5.13	0.65	11.25

Notes

1. Gross EU1 is Energy Use Total (not including PV) / Total Building Area.

2. Net EU1 is Energy Use Total (including PV) / Total Building Area.

Registration Number: 423-P010199029A-000-000-00000000-0000 Registration Date/Time: 11/01/2023 17:00 HERS Provider: CHEERS
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance Report Version: 2022.0.000 Report Generated: 2023-11-01 16:35:37
Schema Version: rev 20220901

Registration Number: 423-P010199029A-000-000-00000000-0000
 Registration Date/Time: 11/01/2023 17:00
 HERS Provider: CHEERS
 NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
 CA Building Energy Efficiency Standards - 2022 Residential Compliance
 Report Version: 2022.0.000
 Schema Version: rev 20220901
 Report Generated: 2023-11-01 16:35:37

Digitally signed by California Home Energy Efficiency Rating Services (CHEERS). This digital signature is provided in order to secure the content of this registered document and in no way implies Registration Provider responsibility for the accuracy of the information.

Registration Number: 425-0010199029A-000-000-00000000-0000	Registration Date/Time: 11/01/2023 17:00	HERS Provider: CHEERS
Notice: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information supplied by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and does not warrant, the accuracy or completeness of this document.	Report Version: 2022.0.000	
CA Building Energy Efficiency Standards - 2022 Residential Compliance	Schema Version: rev 20220901	Report Generated: 2023-11-01 16:35:37

ADU: 1,199 L-SHAPE
CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

[illegible]

TITLE 24 - 2-BEDROOM SOG - CZ7
G423
22040

3/23/2024 12:46:35 PM
Autodesk Docs://22040_City of Chula Vista/22040_City of Chula Vista_1199 L-Shape_V2_CD_RVT22.rvt

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD										CF1R-PRF-01E
Project Name: 2310-22-0616 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR RF					Calculation Date/Time: 2023-11-01T16:40:01-07:00					(Page 1 of 11)
Calculation Description: Title 24 Analysis					Input File Name: 2310-22-0616 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR RF.rbd22x					
GENERAL INFORMATION										
01	Project Name		2310-22-0616 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR RF							
02	Run Title		Title 24 Analysis							
03	Project Location		276 4th Avenue							
04	City		Chula Vista		05	Standards Version		2022		
06	Zip code		91910		07	Software Version		EnergyPro 9.2		
08	Climate Zone		7		09	Front Orientation (deg/ Cardinal)		All orientations		
10	Building Type		Single family		11	Number of Dwelling Units		1		
12	Project Scope		Newly Constructed		13	Number of Bedrooms		2		
14	Addition Cond. Floor Area (ft²)		0		15	Number of Stories		1		
16	Existing Cond. Floor Area (ft²)		n/a		17	Fenestration Average U-factor		0.3		
18	Total Cond. Floor Area (ft²)		1199		19	Glazing Percentage (%)		11.38%		
20	ADU Bedroom Count		n/a		21	ADU Conditioned Floor Area		n/a		
22	Fuel Type		Natural gas		23	No Dwelling Unit:		No		
COMPLIANCE RESULTS										
01	Building Complies with Computer Performance									
02	This building incorporates features that require field testing and/or verification by a certified HERS rater under the supervision of a CEC-approved HERS provider.									
03	This building incorporates one or more Special Features shown below									

Registration Number: 423-P010199030A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 11/01/2023 17:00
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CHEERS
Report Generated: 2023-11-01 16:40:47

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD										CF1R-PRF-01E
Project Name: 2310-22-0616 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR RF					Calculation Date/Time: 2023-11-01T16:40:01-07:00					(Page 4 of 11)
Calculation Description: Title 24 Analysis					Input File Name: 2310-22-0616 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR RF.rbd22x					
ENERGY USE SUMMARY										
Energy Use	Standard Design Source Energy (EDR1) (kBtu/ft²·yr)	Standard Design TDV Energy (EDR2) (kTDV/ft²·yr)	Proposed Design Source Energy (EDR1) (kBtu/ft²·yr)	Proposed Design TDV Energy (EDR2) (kTDV/ft²·yr)	Compliance Margin (EDR1)	Compliance Margin (EDR2)				
Space Heating	0.24	1.1	0.31	2.31	-0.07	-1.21				
Space Cooling	0.75	14.99	0.36	8.43	0.39	6.56				
IAQ Ventilation	0.37	4	0.37	4	0	0				
Water Heating	1.59	17.73	1.22	14.11	0.37	3.62				
Self Utilization/Flexibility Credit				0		0				
South Facing Efficiency Compliance Total	2.95	37.82	2.26	28.85	0.69	8.97				
Space Heating	0.24	1.1	0.45	3.45	-0.21	-2.35				
Space Cooling	0.75	14.99	0.45	9.53	0.3	5.46				
IAQ Ventilation	0.37	4	0.37	4	0	0				
Water Heating	1.59	17.73	1.22	14.12	0.37	3.61				
Self Utilization/Flexibility Credit				0		0				
West Facing Efficiency Compliance Total	2.95	37.82	2.49	31.1	0.46	6.72				

Registration Number: 423-P010199030A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 11/01/2023 17:00
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CHEERS
Report Generated: 2023-11-01 16:40:47

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD										CF1R-PRF-01E
Project Name: 2310-22-0616 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR RF					Calculation Date/Time: 2023-11-01T16:40:01-07:00					(Page 7 of 11)
Calculation Description: Title 24 Analysis					Input File Name: 2310-22-0616 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR RF.rbd22x					
OPAQUE SURFACES										
01	02	03	04	05	06	07	08			
Name	Zone	Construction	Azimuth	Orientation	Gross Area (ft²)	Window and Door Area (ft2)	Tilt (deg)			
New Front Wall	New ADU	R-21 Wall	0	Front	397	95	90			
New Left Wall	New ADU	R-21 Wall	90	Left	261	24	90			
New Back Wall	New ADU	R-21 Wall	180	Back	394	37.5	90			
New Right Wall	New ADU	R-21 Wall	270	Right	248	0	90			
New Roof Attic	New ADU	R-30 Roof Attic	n/a	n/a	1199	n/a	n/a			
New Raised Floor	New ADU	R-19 Floor Crawlspace	n/a	n/a	1199	n/a	n/a			
ATTIC										
01	02	03	04	05	06	07	08			
Name	Construction	Type	Roof Rise (x in 12)	Roof Reflectance	Roof Emittance	Radiant Barrier	Cool Roof			
Attic New ADU	Attic RoofNew ADU	Ventilated	4.5	0.1	0.85	Yes	No			

FENESTRATION / GLAZING													
01	02	03	04	05	06	07	08	09	10	11	12	13	14
Name	Type	Surface	Orientation	Azimuth	Width (ft)	Height (ft)	Mult.	Area (ft²)	U-factor	U-factor Source	SHGC	SHGC Source	Exterior Shading
Window W4	Window	New Front Wall	Front	0			1	24	0.3	NFRC	0.23	NFRC	Bug Screen
Window W3	Window	New Front Wall	Front	0			1	3	0.3	NFRC	0.23	NFRC	Bug Screen
Window W1	Window	New Front Wall	Front	0			1	24	0.3	NFRC	0.23	NFRC	Bug Screen
Window W9	Window	New Front Wall	Front	0			1	24	0.3	NFRC	0.23	NFRC	Bug Screen
Window W8	Window	New Left Wall	Left	90			1	12	0.3	NFRC	0.23	NFRC	Bug Screen
Window W2	Window	New Left Wall	Left	90			1	12	0.3	NFRC	0.23	NFRC	Bug Screen
Window W6	Window	New Back Wall	Back	180			1	10.5	0.3	NFRC	0.23	NFRC	Bug Screen

Registration Number: 423-P010199030A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 11/01/2023 17:00
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CHEERS
Report Generated: 2023-11-01 16:40:47

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

CF1R-PRF-01E

Project Name: 2310-22-0616 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR RF

Calculation Date/Time: 2023-11-01T16:40:01-07:00

(Page 2 of 11)

Calculation Description: Title 24 Analysis

Input File Name: 2310-22-0616 Chula-Vista ADU -- 1199 L-Shape -- Standard 2BR RF.rbd22x

ENERGY DESIGN RATINGS

	Energy Design Ratings			Compliance Margins		
	Source Energy (EDR1)	Efficiency ¹ EDR (EDR2efficiency)	Total ² EDR (EDR2total)	Source Energy (EDR1)	Efficiency ¹ EDR (EDR2efficiency)	Total ² EDR (EDR2total)
Standard Design	36.9	49.2	32.6			
Proposed Design						
North Facing	34.5	37.6	28.3	2.4	11.6	4.3
East Facing	34.8	39.9	29.1	2.1	9.3	3.5
South Facing	34.3	37.6	28.3	2.6	11.6	4.3
West Facing	35.1	40.5	29.3	1.8	8.7	3.3

RESULT²: PASS

¹Efficiency EDR includes improvements like a better building envelope and more efficient equipment

²Total EDR includes efficiency and demand response measures such as photovoltaic (PV) system and batteries

³Building complies when source energy, efficiency and total compliance margins are greater than or equal to zero and unmet load limits are not exceeded

- Standard Design PV Capacity: 2.17 kWdc
- Proposed PV Capacity Scaling: North (2.17 kWdc) East (2.17 kWdc) South (2.17 kWdc) West (2.17 kWdc)



2022 Single-Family Residential Mandatory Requirements Summary

\$ (150.00)	<p>Energy Storage System (ESS) Read: At single-family residences must meet all of the following: Either ESS-ESD interconnection equipment with backed up capacity of 60 amps or more and four or more ESS supplied branch circuits, or a dedicated neutral from the service panel to a subpanel that supplies at least two ESS branch circuits. If the ESS is connected to a subpanel, the subpanel's source collected at a single paneled busbar to be supplied by the ESS, with one circuit supplying the refrigerator, one lighting circuit for general room lighting, and one for other loads. The subpanel shall have a minimum rating of 100A and 125V. If the ESS is connected to a main panel, the main panel shall have a minimum rating of 125A and 125V; sufficient space must be reserved below the installation of a system isolation/transfer switch within 3' of the paneled busbar with branches installed between the paneled bus and the switch location to allow the connection of backup power source.</p>
\$ (150.00)	<p>Emergency Standby Power Source (ESS) Read: A dedicated neutral from the service panel to a subpanel that supplies at least two ESS-ESD unswitched 240V branch circuit wiring installed within 3' of the furnace with circuit conductors rated at least 30 amps with the blank cover identified as "240V ready"; and a reserved main electrical service panel space to allow for the installation of a double pole circuit breaker permanently marked as "For ESS".</p>
\$ (150.00)	<p>Electric Cooktop Ready: Systems using gas or propane cooking to serve individual dwelling units must include: A dedicated unswitched 240V branch circuit wiring installed within 3' of the cooktop with circuit conductors rated at least 30 amps with the blank cover identified as "240V ready"; and a reserved main electrical service panel space to allow for the installation of a double pole circuit breaker permanently marked as "For Electric Cooktop".</p>
\$ (150.00)	<p>Clothes Dryer Ready: Either dryers requiring a gas or propane plumbing to serve individual dwelling units must include: A dedicated unswitched 240V branch circuit wiring installed within 3' of the dryer location with circuit conductors rated at least 30 amps with the blank cover identified as "240V ready"; and a reserved main electrical service panel space to allow for the installation of a double pole circuit breaker permanently marked as "For Clothes Dryer".</p>

\$ (50.00)	<p>Energy Storage System (ESS) Read: At single-family residences must meet all of the following: Either ESS-ESD interconnection equipment with backed up capacity of 60 amps or more and four or more ESS supplied branch circuits, or a dedicated runover from the service panel to a subpanel that supplies at least two branch circuits, or a dedicated runover from the main service panel to a subpanel located at a single paneled busbar to be supplied by the ESS, with one circuit supplying the refrigerator, one lighting circuit for general dry prep area, and one for general living area. The subpanel shall have a minimum rating of 100A and 225 amps, sufficient space must be reserved to allow future installation of a system solution/transfeer switch within 3' of the paneled, with branches installed between the paneled and the switch location to allow the connection of backup power source.</p>
\$ (50.00)	<p>Emergency Standby Power (ESP) Read: At single-family residences must meet all of the following: A dedicated runover from the service panel to a subpanel located at a single paneled busbar to be supplied by the ESP, with one circuit supplying the refrigerator, one lighting circuit for general dry prep area, and one for general living area. The subpanel shall have a minimum rating of 100A and 225 amps, sufficient space must be reserved to allow future installation of a system solution/transfeer switch within 3' of the paneled, with branches installed between the paneled and the switch location to allow the connection of backup power source.</p>
\$ (50.00)	<p>Electric Cooktop Ready: Systems using gas or propane cooking to serve individual dwelling units must include: A dedicated unswitched 240V branch circuit wiring installed within 3' of the furnace with circuit conductors rated at least 30 amps with the blank cover identified as "240V ready," and a reserved main electrical service panel space to allow for the installation of a double pole circuit breaker permanently marked as "For Future 240V."</p>
\$ (50.00)	<p>Electric Clothes Dryer Ready: Whether dryers with gas or propane planning to serve individual dwelling units must include: A dedicated unswitched 240V branch circuit wiring installed within 3' of the dryer location with circuit conductors rated at least 30 amps with the blank cover identified as "240V ready," and a reserved main electrical service panel space to allow for the installation of a double pole circuit breaker permanently marked as "For Future 240V."</p>

5/6/2

5/6/2


5/6/2

3-BEDROOM DOOR SCHEDULE						
MARK	WIDTH	HEIGHT	R.O. WIDTH	R.O. HEIGHT	TYPE	COMMENTS
D1	3' - 0"	6' - 8"	38"	82 1/2"	EXTERIOR DOOR	
D2	2' - 6"	6' - 8"	32"	82"	INTERIOR SINGLE PANEL DOOR	
D3	3' - 0"	6' - 8"	38"	82"	INTERIOR SINGLE PANEL DOOR	
D4	3' - 0"	6' - 8"	38"	82"	INTERIOR SINGLE PANEL DOOR	
D5	3' - 0"	6' - 8"	38"	82"	INTERIOR SINGLE PANEL DOOR	
D6	3' - 0"	6' - 8"	38"	82"	INTERIOR SINGLE PANEL DOOR	
D7	2' - 6"	6' - 8"	32"	82"	INTERIOR SINGLE PANEL DOOR	
D8	4' - 0"	6' - 8"	50 1/2"	82"	INTERIOR DOUBLE PANEL DOOR	
D9	4' - 0"	6' - 8"	50 1/2"	82"	INTERIOR DOUBLE PANEL DOOR	100 SQ.IN. MIN. AIR TRANSFER GRILLE ABOVE DOOR
D10	4' - 0"	6' - 8"			INTERIOR BYPASS SLIDING DOOR	
D11	4' - 0"	6' - 8"			INTERIOR BYPASS SLIDING DOOR	
D12	2' - 6"	6' - 8"	32"	82"	INTERIOR SINGLE PANEL DOOR	
D13	2' - 6"	6' - 8"	32"	82"	INTERIOR SINGLE PANEL DOOR	
D14	2' - 6"	6' - 8"	32"	82"	INTERIOR SINGLE PANEL DOOR	



3-BEDROOM WINDOW SCHEDULE							
MARK	WIDTH	HEIGHT	R.O. WIDTH	R.O. HEIGHT	SILL HEIGHT	HEADER HEIGHT	TYPE
W1	6' - 0"	4' - 0"	6' - 0 1/2"	4' - 0 1/2"	3' - 0"	7' - 0"	SLIDING WINDOW
W2	3' - 0"	5' - 0"	3' - 0 1/2"	5' - 0 1/2"	2' - 0"	7' - 0"	SINGLE HUNG
W3	3' - 0"	1' - 0"	3' - 0 1/2"	1' - 0 1/2"	6' - 9"	7' - 9"	SLIDING WINDOW
W4	6' - 0"	4' - 0"	6' - 0 1/2"	4' - 0 1/2"	3' - 0"	7' - 0"	SLIDING WINDOW
W5	6' - 0"	4' - 0"	6' - 0 1/2"	4' - 0 1/2"	3' - 0"	7' - 0"	SLIDING WINDOW
W6	3' - 0"	3' - 6"	3' - 0 1/2"	3' - 6 1/2"	3' - 6"	7' - 0"	SLIDING WINDOW
W7	3' - 0"	1' - 0"	3' - 0 1/2"	1' - 0 1/2"	6' - 9"	7' - 9"	SLIDING WINDOW

DOOR & WINDOW NOTES

- FIELD VERIFY ALL DIMENSIONS PRIOR TO ORDERING.
- DOOR SWING DIRECTION PER PLAN.
- DIMENSIONS DO NOT INCLUDE DOOR FRAME, U.N.O.
- PROVIDE SUITABLE ISOLATOR BETWEEN DIS-SIMILAR METALS (I.E. ALUMINUM & STEEL).
- ALL GLAZING IN DOORS SHALL BE TEMPERED.
- ALL WINDOWS (U.N.O.) SHALL BE GLAZED PER TITLE 24 REQUIREMENTS.
- ALL MANUFACTURED WINDOWS SHALL HAVE A LABEL ATTACHED CERTIFIED BY THE NATIONAL FENESTRATION RATING COUNCIL (NFR) AND SHOWING COMPLIANCE WITH THE TITLE 24 ENERGY REPORT.
- ALL WINDOWS SHOULD HAVE A MAX U-FACTOR OF .30, A MAXIMUM SHGC OF .23.
- PROVIDE TEMPERED GLASS ("TEMP") AT WINDOWS WITHIN A 24-INCH ARCH OF A DOOR JAMB (CRC 308.4.2), AND AT GLAZING UNITS ABOVE THE SHOWER OR BATHTUB, IN SAUNAS OR STEAM ROOMS WHERE THE SILL IS WITHIN 60 INCHES MEASURED VERTICALLY FROM THE WET STANDING SURFACE.
- TEMPERED GLASS AT THE FOLLOWING LOCATIONS REQUIRING SAFETY GLAZING:
 - GLAZING IN SWINGING, SLIDING, AND BI-FOLD DOORS (CRC R308.4.1).
 - GLAZING WITHIN 60 INCHES - VERTICALLY AND HORIZONTALLY - OF SHOWERS, BATHTUBS, HOT TUBS, SWIMMING POOLS, AND SAUNAS (CRC R308.4.5).
- PER CBC SECTION 708A.2, EXTERIOR WINDOWS, EXTERIOR GLAZED SHALL COMPLY WITH THE FOLLOWING:
 - MULTI-PANE GLAZING WITH A MINIMUM OF ONE TEMPERED PANE MEETING THE REQUIREMENTS OF SECTION 2406 SAFETY GLAZING, AND WHERE ANY GLAZING FRAMES MADE OF VINYL MATERIALS SHALL HAVE WELDED CORNERS, METAL REINFORCEMENT IN INTERLOCK AREA, AND BE CERTIFIED TO AAMA/WDMA/CSA 1011I.S.2/4440.
- PER CBC SECTION 708A.3, EXTERIOR DOORS SHALL BE CONSTRUCTED WITH A NON-COMBUSTIBLE CLADDING MATERIAL OR BE CONSTRUCTED WITH A SOLID CORE, STILES/RAILS NO LESS THAN 1-3/8" THICK, AND PANELS NO LESS THAN 1-1/4" THICK, EXCEPT FOR THE XTERIOR PERIMETER OF THE PANEL THAT SHALL BE PERMITTED TO TAPER TO THE TONGUE NO LESS THAT 3/8" THICK.
- PER CBC SECTION 708A.2, GLAZED DOORS TO BE CONSTRUCTED WITH MULTIPANE GLAZING WITH A MINIMUM OF ONE TEMPERED PANE CONFORMING TO SECTION 2406.

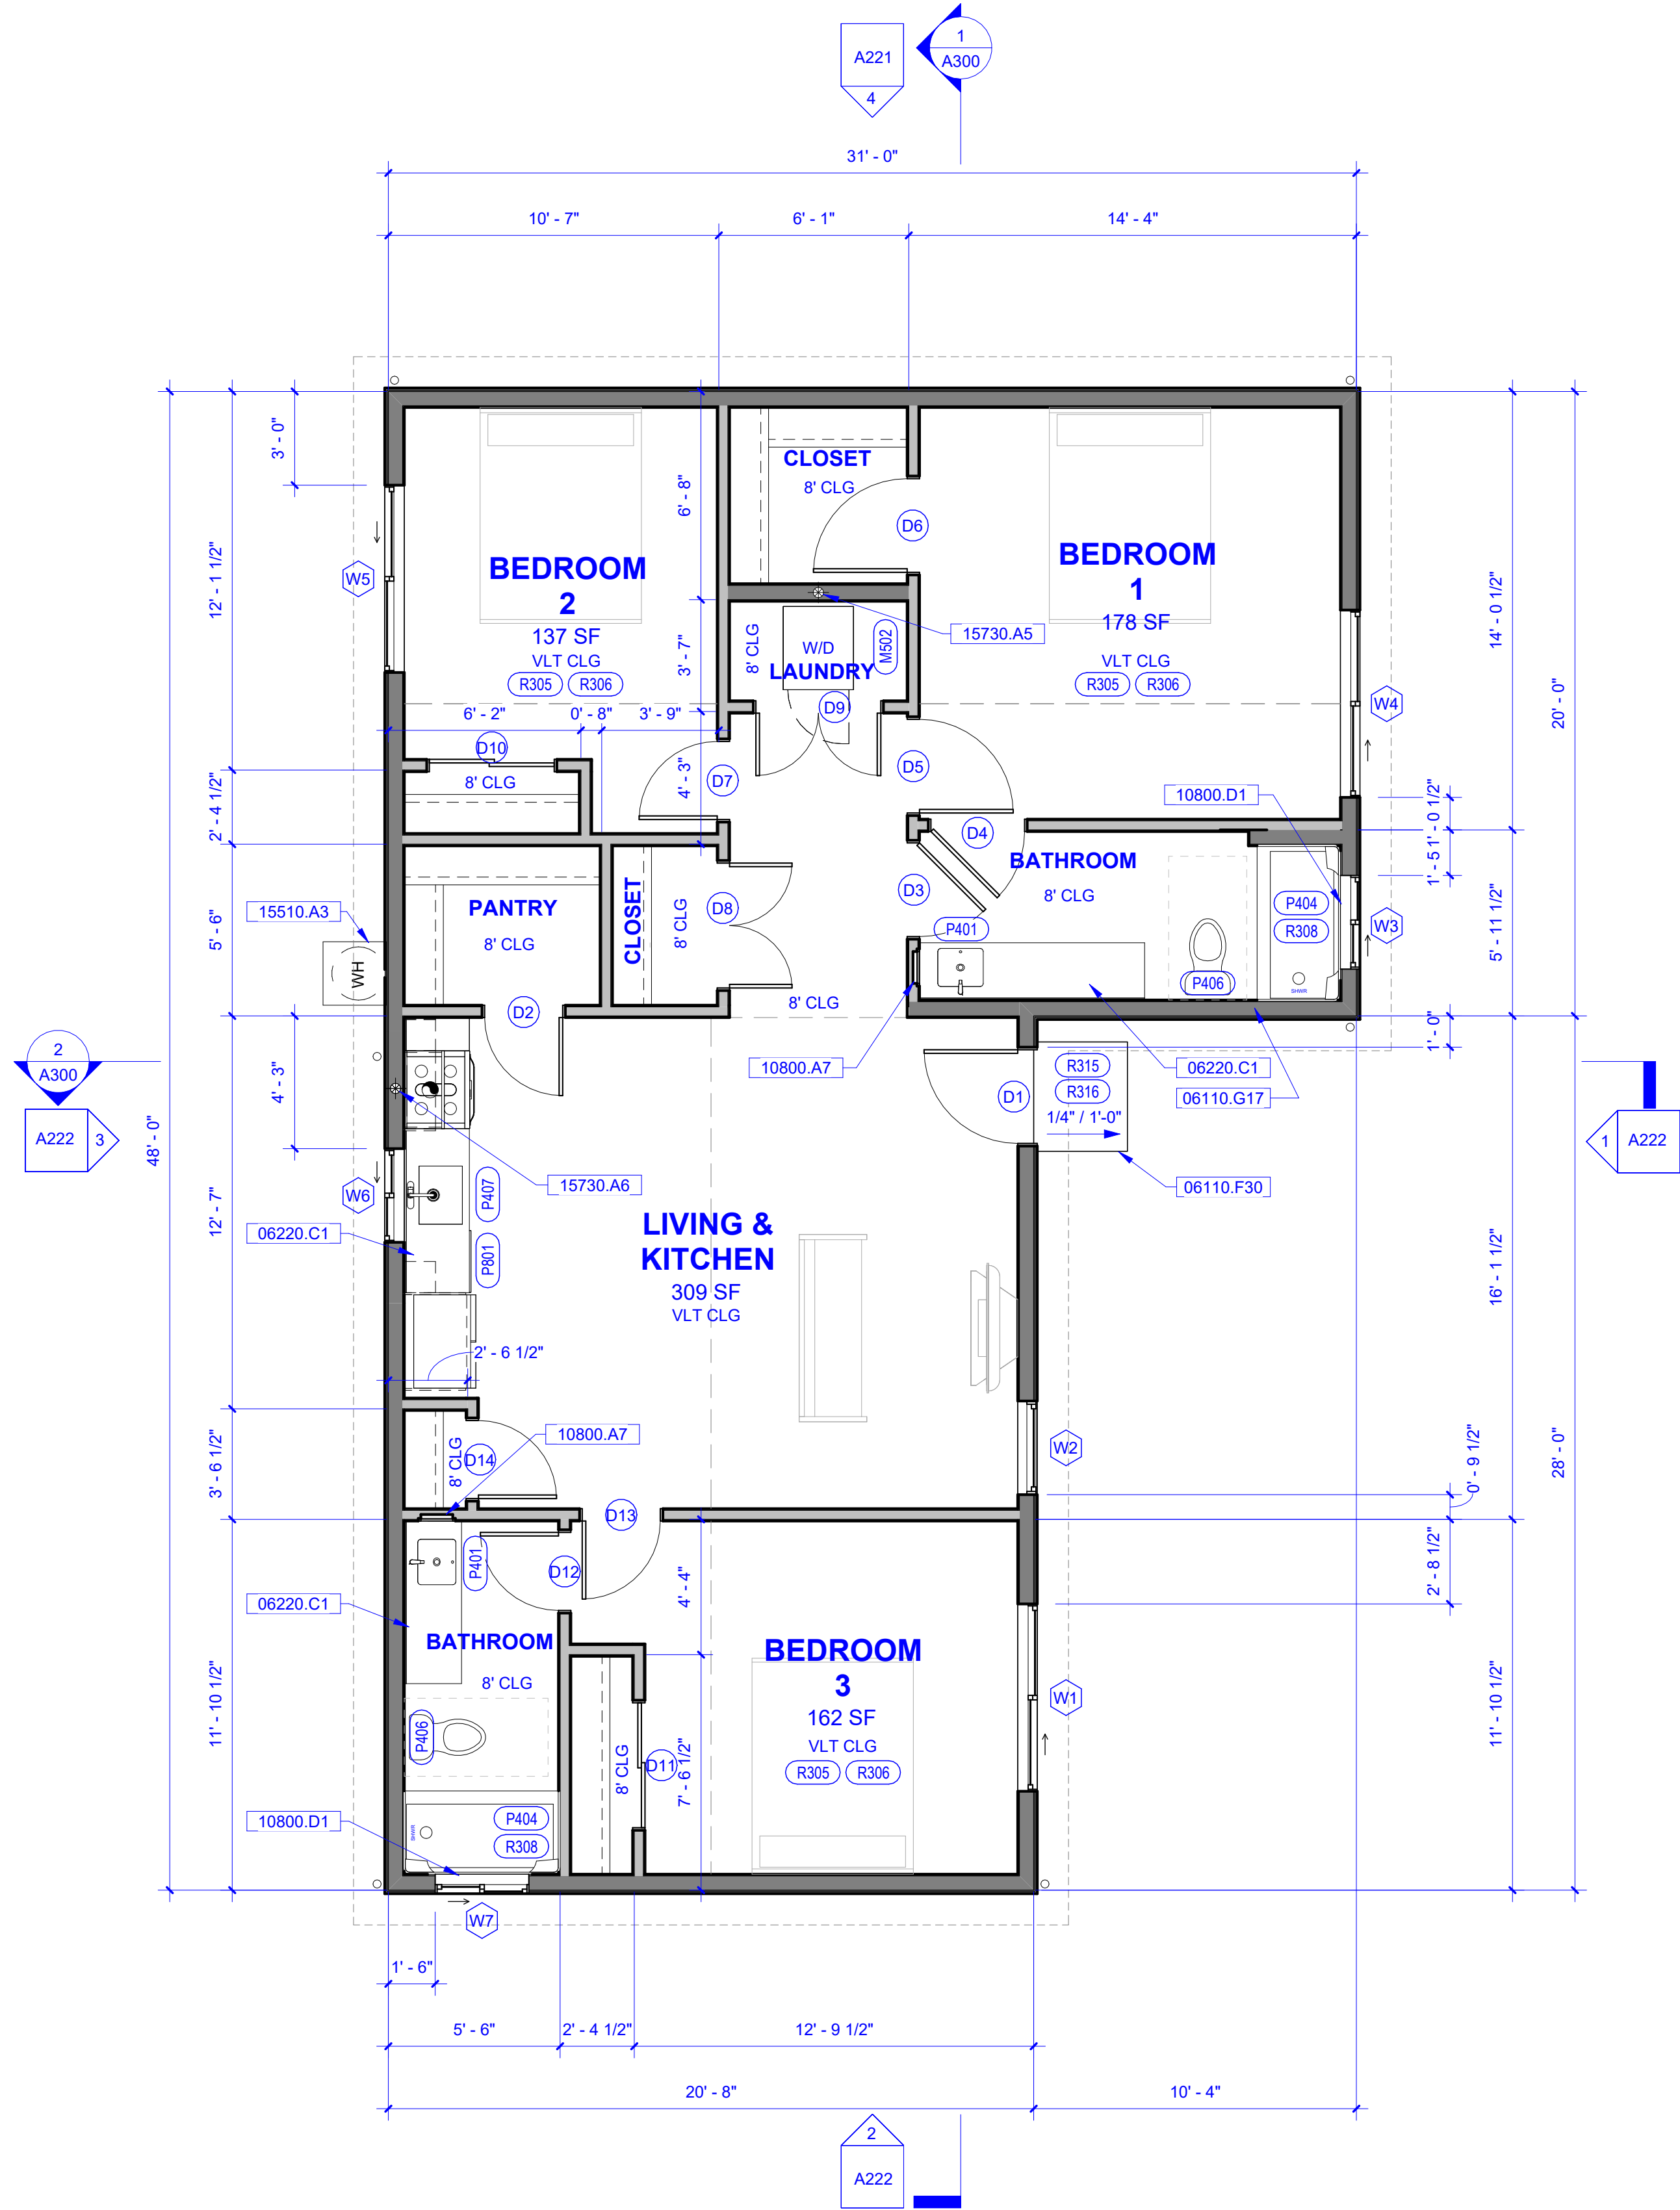

1 STANDARD 3-BEDROOM FLOOR PLAN
SCALE: 1/4" = 1'-0"

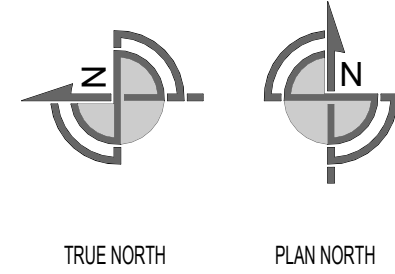

KEYNOTES:

KEYNOTE	DESCRIPTION
06110.F30	WOOD STOOP EXTERIOR DOOR LANDING
06110.G17	2X8 MIN. SOLID REINFORCEMENT LOCATED BETWEEN 32" AND 39 1/4" AFF. SEE SHEETS G101 AND A501 FOR MORE INFORMATION ABOUT AGING-IN-PLACE DESIGN
06220.C1	MILLWORK SHOWN FOR REFERENCE ONLY. SEE SHOP DRAWINGS
10800.A7	PROVIDE 14 1/4" x 25 1/4" R.O. FRAMING FOR MEDICINE CABINET. NO ELECTRICAL WIRING WITHIN FRAMING FOR MEDICINE CABINET PERMITTED
10800.D1	PROVIDE FRAMING FOR 16"x12" NICHE. BOTTOM OF NICHE TO BE 60" ABOVE SLAB AND CENTERED ALONG WALL
15510.A3	APPLICANT/OWNER TO PROVIDE CUT SHEET FOR WATER HEATER TO MEET MINIMUM REQUIREMENTS OF TITLE 24 CALCULATIONS
15730.A5	4" DRYER VENT, SEE SHEET C200 CODE EXCERPTS CHAPTER 5: EXHAUST SYSTEMS FOR MORE INFORMATION
15730.A6	HOOD EXHAUST FAN ABOVE ELECTRIC RANGE 110 CFM OR 50% CE MIN. (GAS RANGE 250 CFM OR 80% CE MIN.); 2022 BEES TABLE 150.0-G

FLOOR PLAN LEGEND:

	EXTERIOR 2X6 WOOD STUDS @ 16" O.C.
	INTERIOR 2X6 WOOD STUDS @ 16" O.C.
	INTERIOR 2X4 WOOD STUDS @ 16" O.C.
	OVERHEAD LINES
	VAULTED CEILING
	8' CLG
	8' FLAT CEILING
	VLT CLG
	VAULTED CEILING

WALL OPENING SCHEDULE:

	WALL AREA (SF)	DOOR OPENING AREA (SF)	WINDOW OPENING AREA (SF)	TOTAL OPENING AREA (SF)	% OPENING AREA
NORTH	250.58	-	-	-	0%
SOUTH	250.58	-	3.00	3.00	1.20%
EAST	388.00	20.00	66.00	86.00	22.16%
WEST	388.00	-	34.50	13.50	6.95%

*NOTE: BUILDING ORIENTATION PER PROJECT NORTH

SNAPADU
DESIGN HOUSE

YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 1,199 L-SHAPE

CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:

LUIS CALDERON
SnapADU

SIGNATURE

RELEASE	DATE	BY	APP.	RELEASED FOR...
A	03/22/2024	LAG	BY	APP.

FLOOR PLAN -
3-BEDROOM


A100

22040

MARK	WIDTH	HEIGHT	R.O. WIDTH	R.O. HEIGHT	TYPE	COMMENTS
D1	3' - 0"	6' - 8"	38"	82 1/2"	EXTERIOR DOOR	
D2	2' - 6"	6' - 8"	32"	82"	INTERIOR SINGLE PANEL DOOR	
D3	2' - 6"	6' - 8"	32"	82"	INTERIOR SINGLE PANEL DOOR	
D4	3' - 0"	6' - 8"	38"	82"	INTERIOR SINGLE PANEL DOOR	
D5	3' - 0"	6' - 8"	38"	82"	INTERIOR SINGLE PANEL DOOR	
D6	3' - 0"	6' - 8"	38"	82"	INTERIOR SINGLE PANEL DOOR	
D7	2' - 6"	6' - 8"	32"	82"	INTERIOR SINGLE PANEL DOOR	
D8	4' - 0"	6' - 8"	50 1/2"	82"	INTERIOR DOUBLE PANEL DOOR	
D9	4' - 0"	6' - 8"	50 1/2"	82"	INTERIOR DOUBLE PANEL DOOR	100 SQ.IN. MIN. AIR TRANSFER GRILLE ABOVE DOOR
D10	4' - 0"	6' - 8"			INTERIOR BYPASS SLIDING DOOR	

MARK	WIDTH	HEIGHT	R.O. WIDTH	R.O. HEIGHT	SILL HEIGHT	HEADER HEIGHT	TYPE	COMMENTS
W1	6'-0"	4'-0"	6'-0 1/2"	4'-0 1/2"	3'-0"	7'-0"	SLIDING WINDOW	
W2	3'-0"	4'-0"	3'-0 1/2"	4'-0 1/2"	3'-0"	7'-0"	SINGLE HUNG	
W3	4'-0"	1'-0"	3'-0 1/2"	1'-0 1/2"	6'-9"	7'-9"	SLIDING WINDOW	
W4	6'-0"	4'-0"	6'-0 1/2"	4'-0 1/2"	3'-0"	7'-0"	SLIDING WINDOW	
W5	6'-0"	4'-0"	6'-0 1/2"	4'-0 1/2"	3'-0"	7'-0"	SLIDING WINDOW	
W6	3'-0"	3'-6"	3'-0 1/2"	3'-6 1/2"	3'-6"	7'-0"	SLIDING WINDOW	
W7	3'-0"	1'-0"	3'-0 1/2"	1'-0 1/2"	6'-9"	7'-9"	SLIDING WINDOW	
W8	3'-0"	4'-0"	3'-0 1/2"	4'-0 1/2"	3'-0"	7'-0"	SINGLE HUNG	
W9	6'-0"	4'-0"	6'-0 1/2"	4'-0 1/2"	3'-0"	7'-0"	SLIDING WINDOW	

1. FIELD VERIFY ALL DIMENSIONS PRIOR TO ORDERING.
2. DOOR SWING DIRECTION PER PLAN.
3. DIMENSIONS DO NOT INCLUDE DOOR FRAME. (U.N.O.)
4. PROVIDE SUITABLE ISOLATOR BETWEEN DIS-SIMILAR METALS (I.E. ALUMINUM & STEEL).
5. ALL GLAZING IN DOORS SHALL BE TEMPERED.
6. ALL GLAZINGS (U.N.O.) SHALL BE GLAZED PER TITLE 24 REQUIREMENTS.
7. ALL GLAZING (U.N.O.) SHALL BE GLAZED WITH THE LABEL ATTACHED CERTIFIED BY THE NATIONAL PENETRATION RATING COUNCIL (NPRC) AND SHOWING COMPLIANCE WITH THE TITLE 24 ENERGY RATING.
8. ALL WINDOWS SHOULD HAVE A MAX U-FACTOR OF .30, A MAXIMUM SHGC OF .23.
9. PROVIDE TEMPERED GLASS ("TEMP") AT WINDOWS WITH A 24-INCH ARCH OF 24 INCHES OR MORE (CIRCULAR), AND A 24-INCH HORIZONTAL AND HORIZONTALLY-OF SAUNAS OR BATHTUB, IN SAUNAS OR STEAM ROOMS WHERE THE SILL IS LESS THAN 60 INCHES MEASURED VERTICALLY FROM THE WET STANDING SURFACE.
10. TEMPERED GLASS AT THE FOLLOWING LOCATIONS REQUIRING SAFETY GLAZING:
 - A. GLAZING IN SWINGING, SLIDING, AND BI-FOLD DOORS (CRC R308.4.1).
 - B. GLAZING WITHIN 60 INCHES - IN SAUNAS, HOT TUBS, AND HORIZONTALLY-OF SAUNAS, BATHTUBS, HOT TUBS, SWIMMING POOLS, AND SAUNAS (CRC R308.4.5).
11. PER CBC SECTION 704.2, EXTERIOR WINDOWS, EXTERIOR GLAZING SHALL COMPLY WITH THE FOLLOWING:
 - A. EXTERIOR GLAZING WITH A MINIMUM OF ONE TEMPERED PANE MEETING THE REQUIREMENTS OF SECTION 2406 SAFETY GLAZING, AND WHERE ANY GLAZING FRAMES MADE OF VINYL MATERIALS SHALL HAVE WELDED CORNERS, METAL REINFORCEMENT IN INTERLOCK AREA, AND BE CERTIFIED TO AAMA/WDMA/CSA 1011.S.2/4440.
 - B. PER CBC SECTION 704.3, EXTERIOR DOORS SHALL BE CONSTRUCTED WITH A NON-COMBUSTIBLE CLADDING MATERIAL OR BE CONSTRUCTED WITH A SOLID CORE, STILES/RAILS NO LESS THAN 1-3/8" THICK, AND PANELS NO LESS THAN 1-1/4" THICK, EXCEPT FOR THE EXTERIOR PERIMETER OF THE PANEL THAT SHALL BE PERMITTED TO BE THINER TO A TONGUE NO LESS THAN 1/2" THICK.
12. PER CBC SECTION 704.4, EXTERIOR DOORS TO BE CONSTRUCTED WITH MULTIPANE GLAZING WITH A MINIMUM OF ONE TEMPERED PANE CONFORMING TO SECTION 2406.



KEYNOTE	DESCRIPTION
06110.F30	WOOD STOOP EXTERIOR DOOR LANDING
06110.G17	2X8 MIN. SOLID REINFORCEMENT LOCATED BETWEEN 32" AND 39 1/4" AFF. SEE SHEETS G101 AND A501 FOR MORE INFORMATION ABOUT AGING-IN-PLACE DESIGN
06220.C1	PROVIDE 14" DEEP REINFORCEMENT ONLY. SEE SHOP DRAWINGS
010800.A7	PROVIDE 14" x 25 1/4" R.O. FRAMING FOR MEDICINE CABINET. NO ELECTRICAL WIRING WITHIN FRAMING FOR MEDICINE CABINET PERMITTED
0800.D1	PROVIDE FRAMING FOR 16"x12" NICHE. BOTTOM OF NICHE TO BE 60" ABOVE SLAB AND CENTERED ALONG WALL
15510.A3	APPLICANT/OWNER TO PROVIDE CUT SHEET FOR WATER HEATER TO MEET MINIMUM REQUIREMENTS OF TITLE 24 CALCULATIONS
15730.A5	4" DRYER VENT. SEE SHEET 6200 CODE EXCERPTS CHAPTER 5: EXHAUSTS FOR MORE INFORMATION
15730.A6	HOOD EXHAUST FAN ABOVE ELECTRIC RANGE 110 CFM OR 50% CE MIN. (GAS RANGE 250 CFM OR 80% CE MIN.). 2022 BEES TABLE 150.0-G

EXTERIOR 2X6 WOOD STUDS @ 16" O.C.

INTERIOR 2X6 WOOD STUDS @ 16" O.C.

INTERIOR 2X4 WOOD STUDS @ 16" O.C.

	WALL AREA (SF)	DOOR OPENING AREA (SF)	WINDOW OPENING AREA (SF)	TOTAL OPENING AREA (SF)	% OPENING AREA
NORTH	250.58	-	-	-	0%
SOUTH	250.58	-	24.00	24.00	9.58%
EAST	388.00	20.00	75.00	95.00	24.48%
WEST	388.00	-	37.50	37.50	9.66%



YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 1,199 L-SHAPE
CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:
LUIS CALDERON
SnapADU

SIGNATURE

[illegible]

FLOOR PLAN -
2-BEDROOM

A101

22040

FLOOR PLAN OPTIONS - DOOR SCHEDULE						
MARK	WIDTH	HEIGHT	R.O. WIDTH	R.O. HEIGHT	TYPE	COMMENTS
D15	5' - 6"	6' - 8"	68 1/2"	82"	INTERIOR DOUBLE PANEL DOOR	100 SQ.IN. MIN. AIR TRANSFER GRILLE ABOVE DOOR
D16	6' - 0"	6' - 8"	74"	82"	EXTERIOR SLIDING GLASS DOOR	TEMPERED
D17	3' - 0"	6' - 8"	38"	82"	INTERIOR SINGLE PANEL DOOR	
D18	3' - 0"	6' - 8"	38"	82"	INTERIOR SINGLE PANEL DOOR	
D19	3' - 0"	6' - 8"	38"	82"	INTERIOR SINGLE PANEL DOOR	
D20	3' - 0"	6' - 8"	38"	82"	INTERIOR SINGLE PANEL DOOR	

FLOOR PLAN OPTIONS - WINDOW SCHEDULE							
MARK	WIDTH	HEIGHT	R.O. WIDTH	R.O. HEIGHT	SILL HEIGHT	HEADER HEIGHT	COMMENTS


DOOR & WINDOW NOTES

1. FIELD VERIFY ALL DIMENSIONS PRIOR TO ORDERING.
2. DOOR SWING DIRECTION PER PLAN.
3. DIMENSIONS DO NOT INCLUDE DOOR FRAME, U.N.O.
4. PROVIDE SUITABLE ISOLATOR BETWEEN DIS-SIMILAR METALS (I.E. ALUMINUM & STEEL).
5. ALL GLAZING IN DOORS SHALL BE TEMPERED.
6. ALL WINDOWS (U.N.O.) SHALL BE GLAZED PER TITLE 24 REQUIREMENTS.
7. ALL MANUFACTURED WINDOWS SHALL HAVE A LABEL ATTACHED CERTIFIED BY THE NATIONAL FENESTRATION RATING COUNCIL (NFR)C) AND SHOWING COMPLIANCE WITH THE TITLE 24 ENERGY REPORT.
8. ALL WINDOWS SHOULD HAVE A MAX U-FACTOR OF .30, A MAXIMUM SHGC OF .23.
9. PROVIDE TEMPERED GLASS ("TEMP") AT WINDOWS WITHIN A 24-INCH ARCH OF A DOOR JAMB (CRC 308.4.2), AND AT GLAZING UNITS ABOVE THE SHOWER OR BATHTUB, IN SAUNAS OR STEAM ROOMS WHERE THE SILL IS WITHIN 60 INCHES MEASURED VERTICALLY FROM THE WET STANDING SURFACE.
10. TEMPERED GLASS AT THE FOLLOWING LOCATIONS REQUIRING SAFETY GLAZING:


A. GLAZING IN SWINGING, SLIDING, AND BI-FOLD DOORS (CRC R308.4.1).

B. GLAZING WITHIN 60 INCHES - VERTICALLY AND HORIZONTALLY - OF SHOWERS, BATHTUBS, HOT TUBS, SWIMMING POOLS, AND SAUNAS (CRC R308.4.5).
11. PER CBC SECTION 708A.2, EXTERIOR WINDOWS, EXTERIOR GLAZED SHALL COMPLY WITH THE FOLLOWING:


A. MULTIPANE GLAZING WITH A MINIMUM OF ONE TEMPERED PANE MEETING THE REQUIREMENTS OF SECTION 2406 SAFETY GLAZING, AND WHERE ANY GLAZING FRAMES MADE OF VINYL MATERIALS SHALL HAVE WELDED CORNERS, METAL REINFORCEMENT IN INTERLOCK AREA, AND BE CERTIFIED TO AAMA/WDMA/CSA 1011I.S.2/4440.
12. PER CBC SECTION 708A.3, EXTERIOR DOORS SHALL BE CONSTRUCTED WITH A NON-COMBUSTIBLE CLADDING MATERIAL OR BE CONSTRUCTED WITH A SOLID CORE, STILES/RAILS NO LESS THAN 1-3/8" THICK, AND PANELS NO LESS THAN 1-1/4" THICK, EXCEPT FOR THE XTERIOR PERIMETER OF THE PANEL THAT SHALL BE PERMITTED TO TAPER TO THE TONGUE NO LESS THAT 3/8" THICK.
13. PER CBC SECTION 708A.2, GLAZED DOORS TO BE CONSTRUCTED WITH MULTIPANE GLAZING WITH A MINIMUM OF ONE TEMPERED PANE CONFORMING TO SECTION 2406.

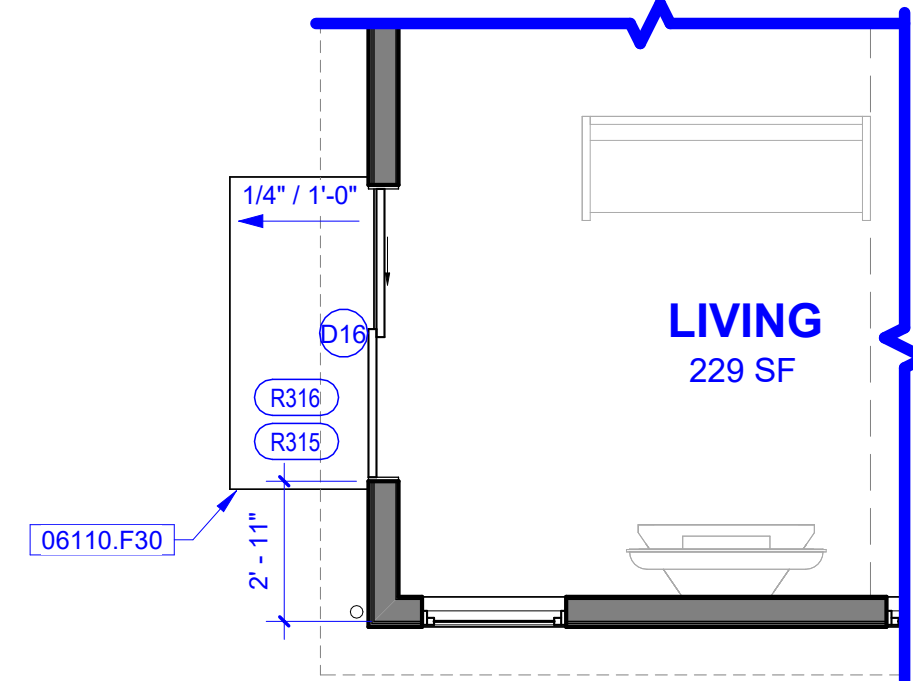


6'-0" x 6'-8" SLIDING GLASS DOOR OPTION AT 2-BEDROOM PLAN

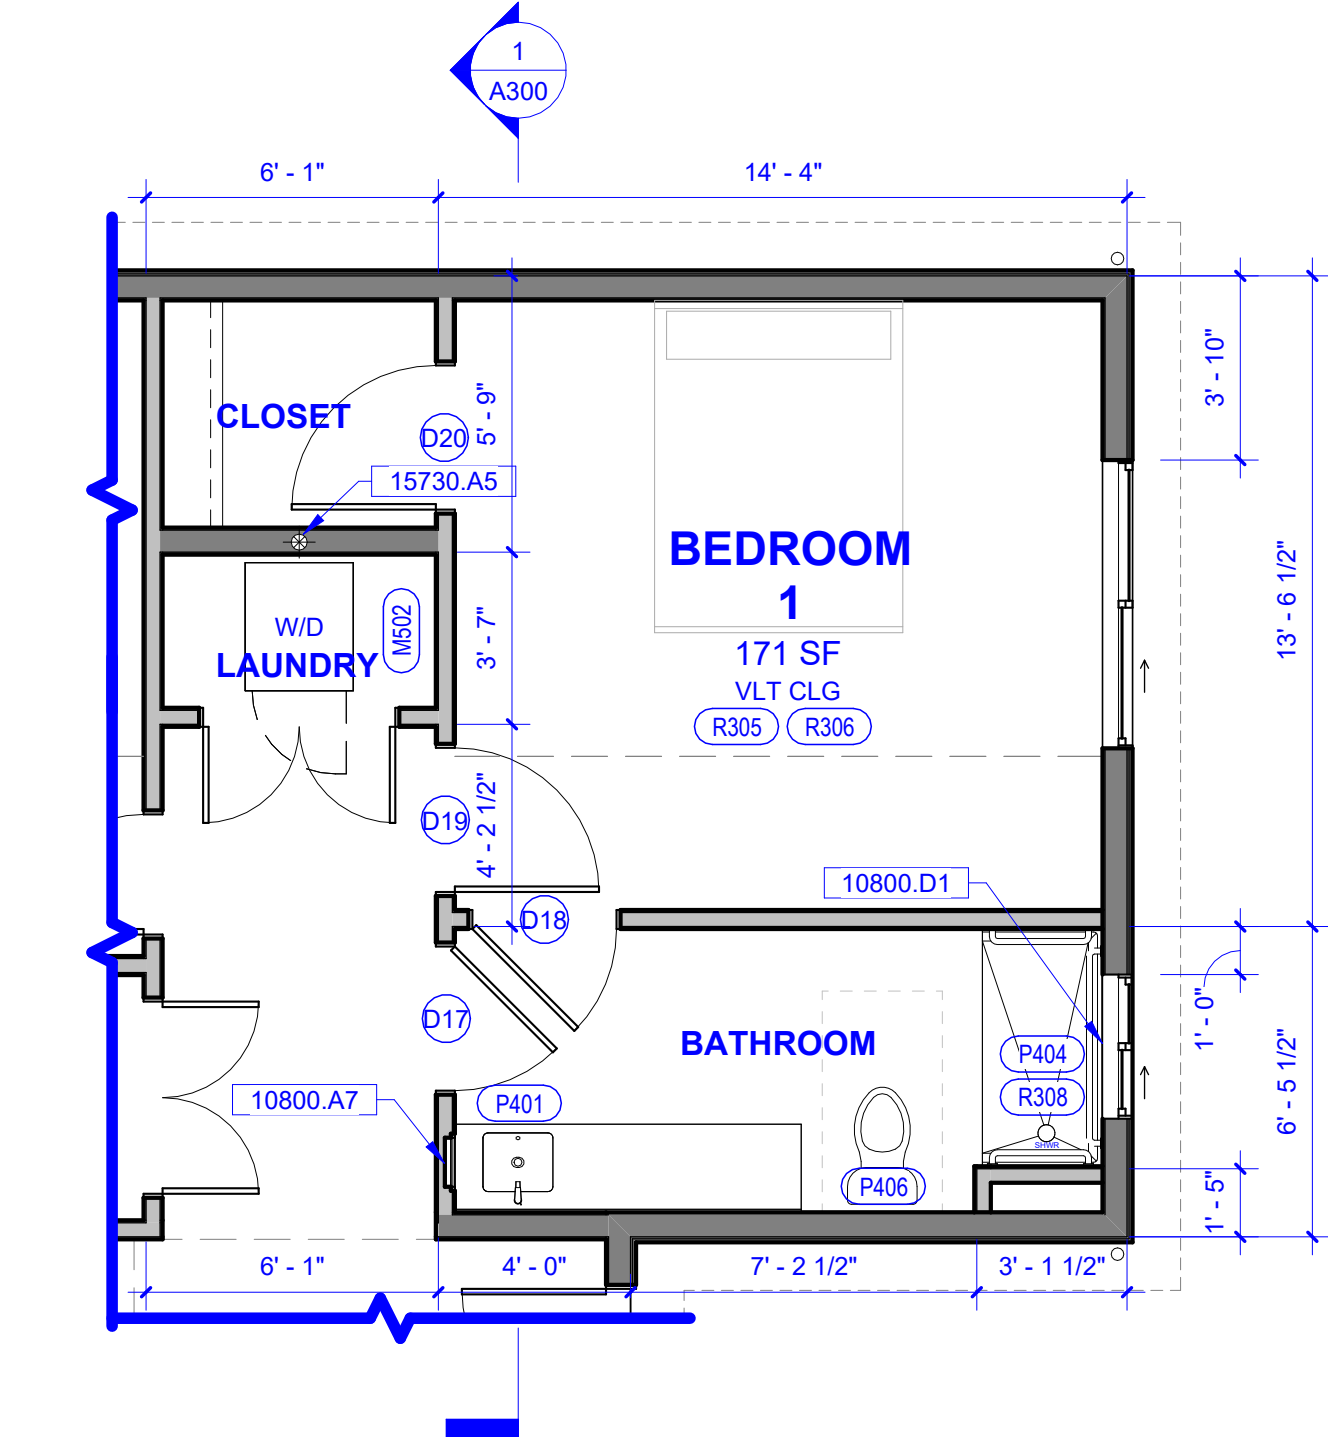


ENLARGED BEDROOM & BATH DOOR AT 3-BEDROOM OPTION PLAN

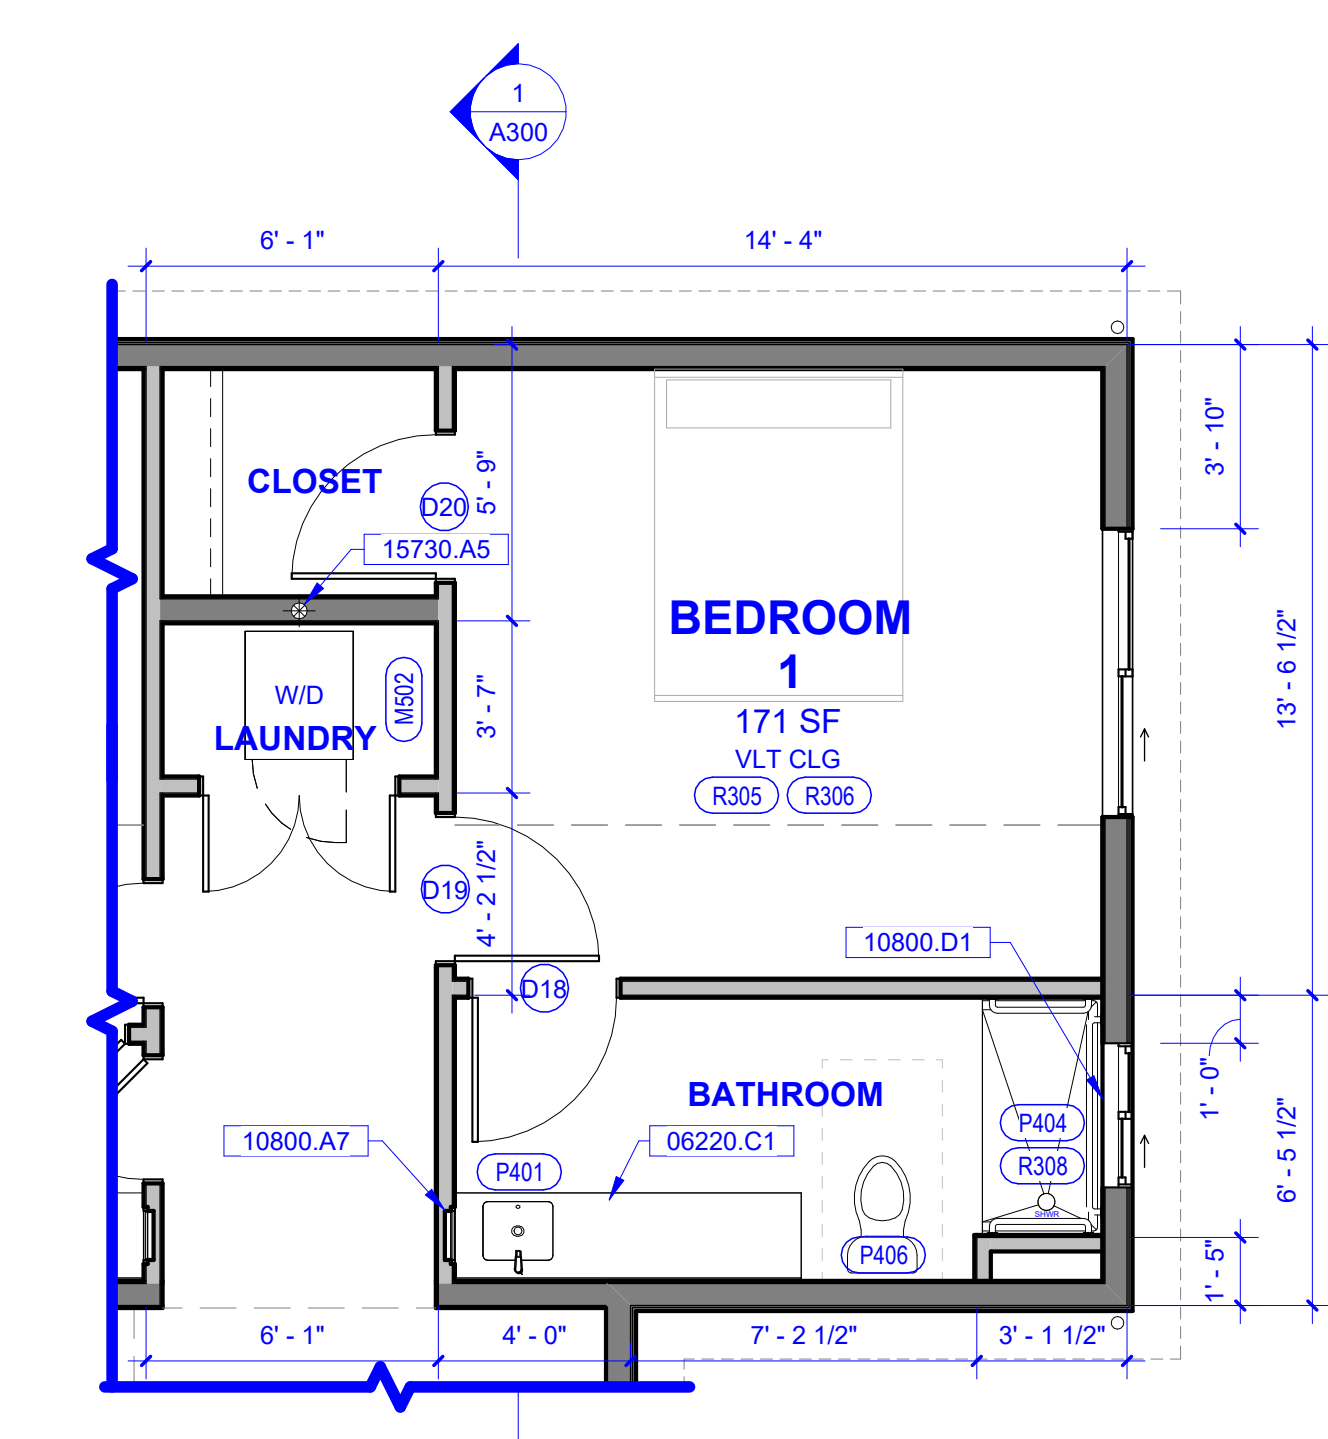


ENLARGED BEDROOM & BATH DOOR AT 2-BEDROOM OPTION PLAN

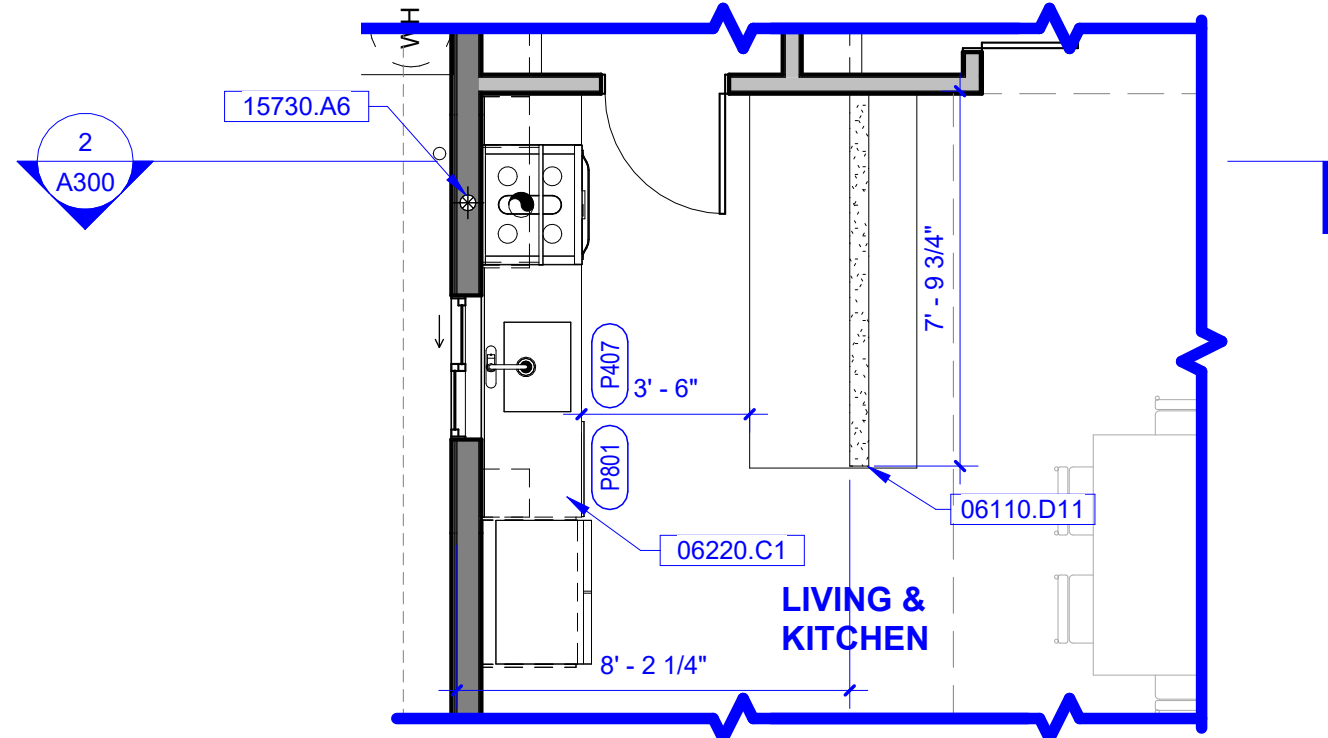

8' PENINSULA OPTION

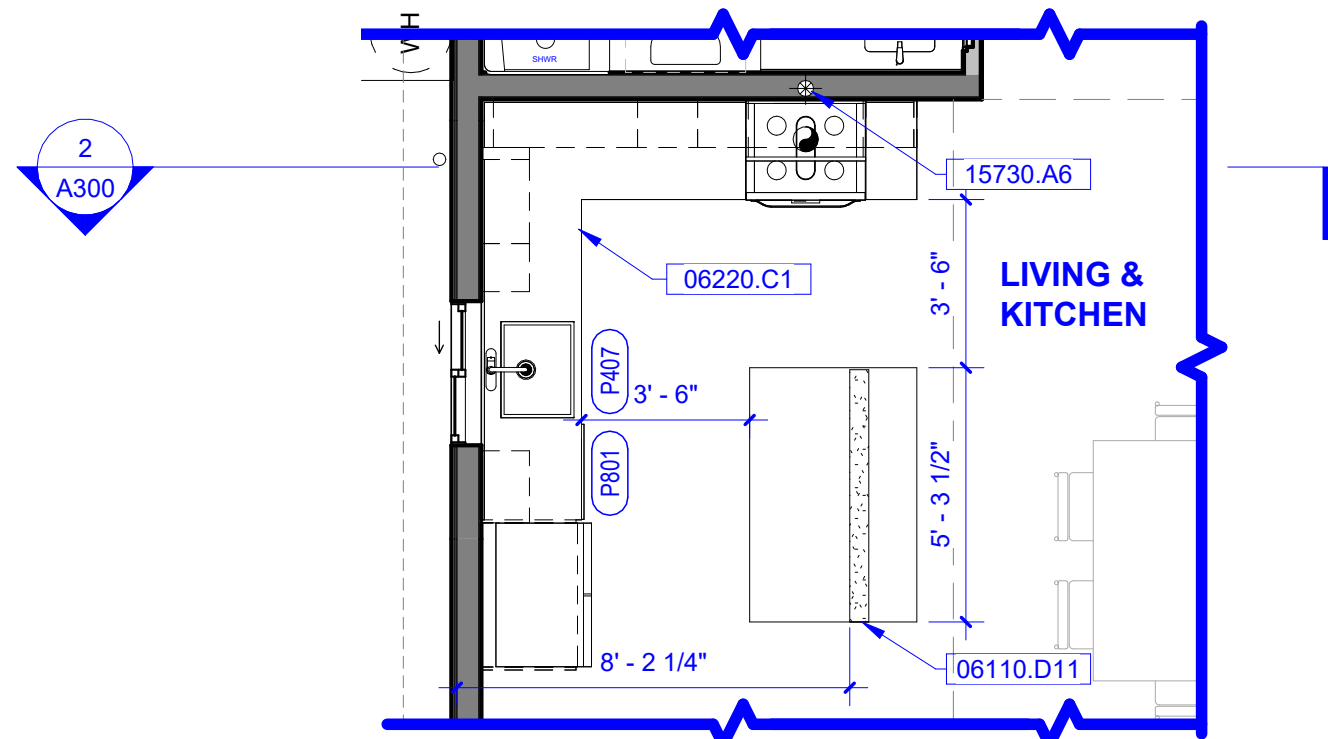

L-KITCHEN W/ 5' ISLAND AT 2-BEDROOM OPTION PLAN

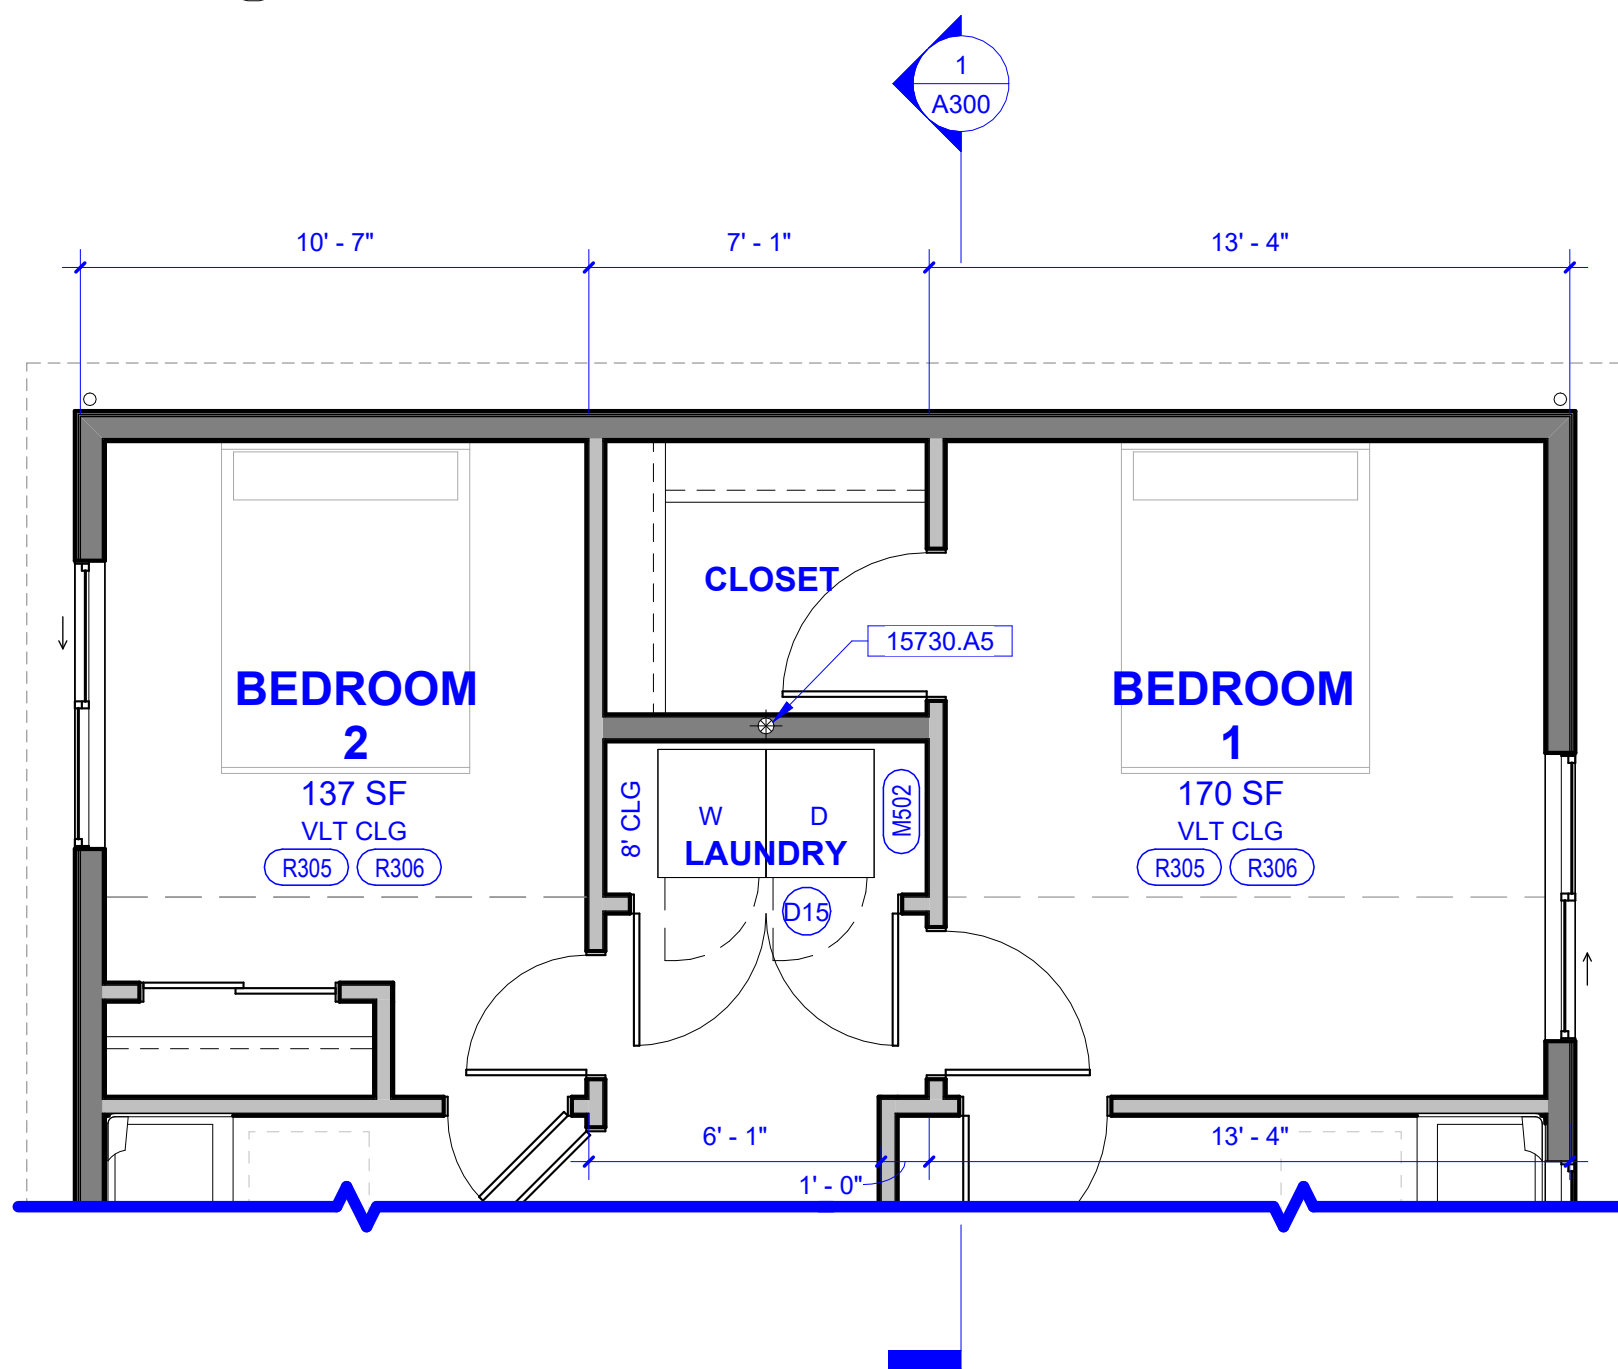

SIDE BY SIDE LAUNDRY OPTION

KEYNOTES:

KEYNOTE	DESCRIPTION
06110.D11	34" TALL 2X4 PONY WALL
06110.F30	WOOD STOOP EXTERIOR DOOR LANDING
06220.C1	MILLWORK SHOWN FOR REFERENCE ONLY. SEE SHOP DRAWINGS
10800.A7	PROVIDE 14 1/4" x 25 1/4" R.O. FRAMING FOR MEDICINE CABINET. NO ELECTRICAL WIRING WITHIN FRAMING FOR MEDICINE CABINET PERMITTED
10800.D1	PROVIDE FRAMING FOR 16"x12" NICHE. BOTTOM OF NICHE TO BE 60" ABOVE SLAB AND CENTERED ALONG WALL
15730.A5	4" DRYER VENT. SEE SHEET G200 CODE EXCERPTS CHAPTER 5. EXHAUST SYSTEMS FOR MORE INFORMATION
15730.A6	HOOD EXHAUST FAN ABOVE ELECTRIC RANGE 110 CFM OR 50% CE MIN. (GAS RANGE 250 CFM OR 80% CE MIN.); 2022 BEES TABLE 150.0-G

FLOOR PLAN LEGEND:

- EXTERIOR 2X6 WOOD STUDS @ 16" O.C.
- INTERIOR 2X6 WOOD STUDS @ 16" O.C.
- INTERIOR 2X4 WOOD STUDS @ 16" O.C.
- OVERHEAD LINES
- VAULTED CEILING
- 8" CLG

8" FLAT CEILING
- VLT CLG

VAULTED CEILING

WALL OPENING SCHEDULE:

	WALL AREA (SF)	DOOR OPENING AREA (SF)	WINDOW OPENING AREA (SF)	TOTAL OPENING AREA (SF)	% OPENING AREA
NORTH	250.58	-	-	-	0%
SOUTH	250.58	-	24.00	24.00	9.58%
EAST	388.00	20.00	75.00	95.00	24.48%
WEST	388.00	40.00	37.50	77.50	19.97%

*OPENING AREA PER 6' - 0" X 6' - 8" SLIDING GLASS DOOR OPTION

S

SNAPADU
DESIGN HOUSE

YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 1,199 L-SHAPE
CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:
LUIS CALDERON
SnapADU


SIGNATURE

RELEASE	DATE	BY	APP.	RELEASED FOR...
A	03/22/2024	LAG		



FLOOR PLAN -
OPTIONS

A102

22040

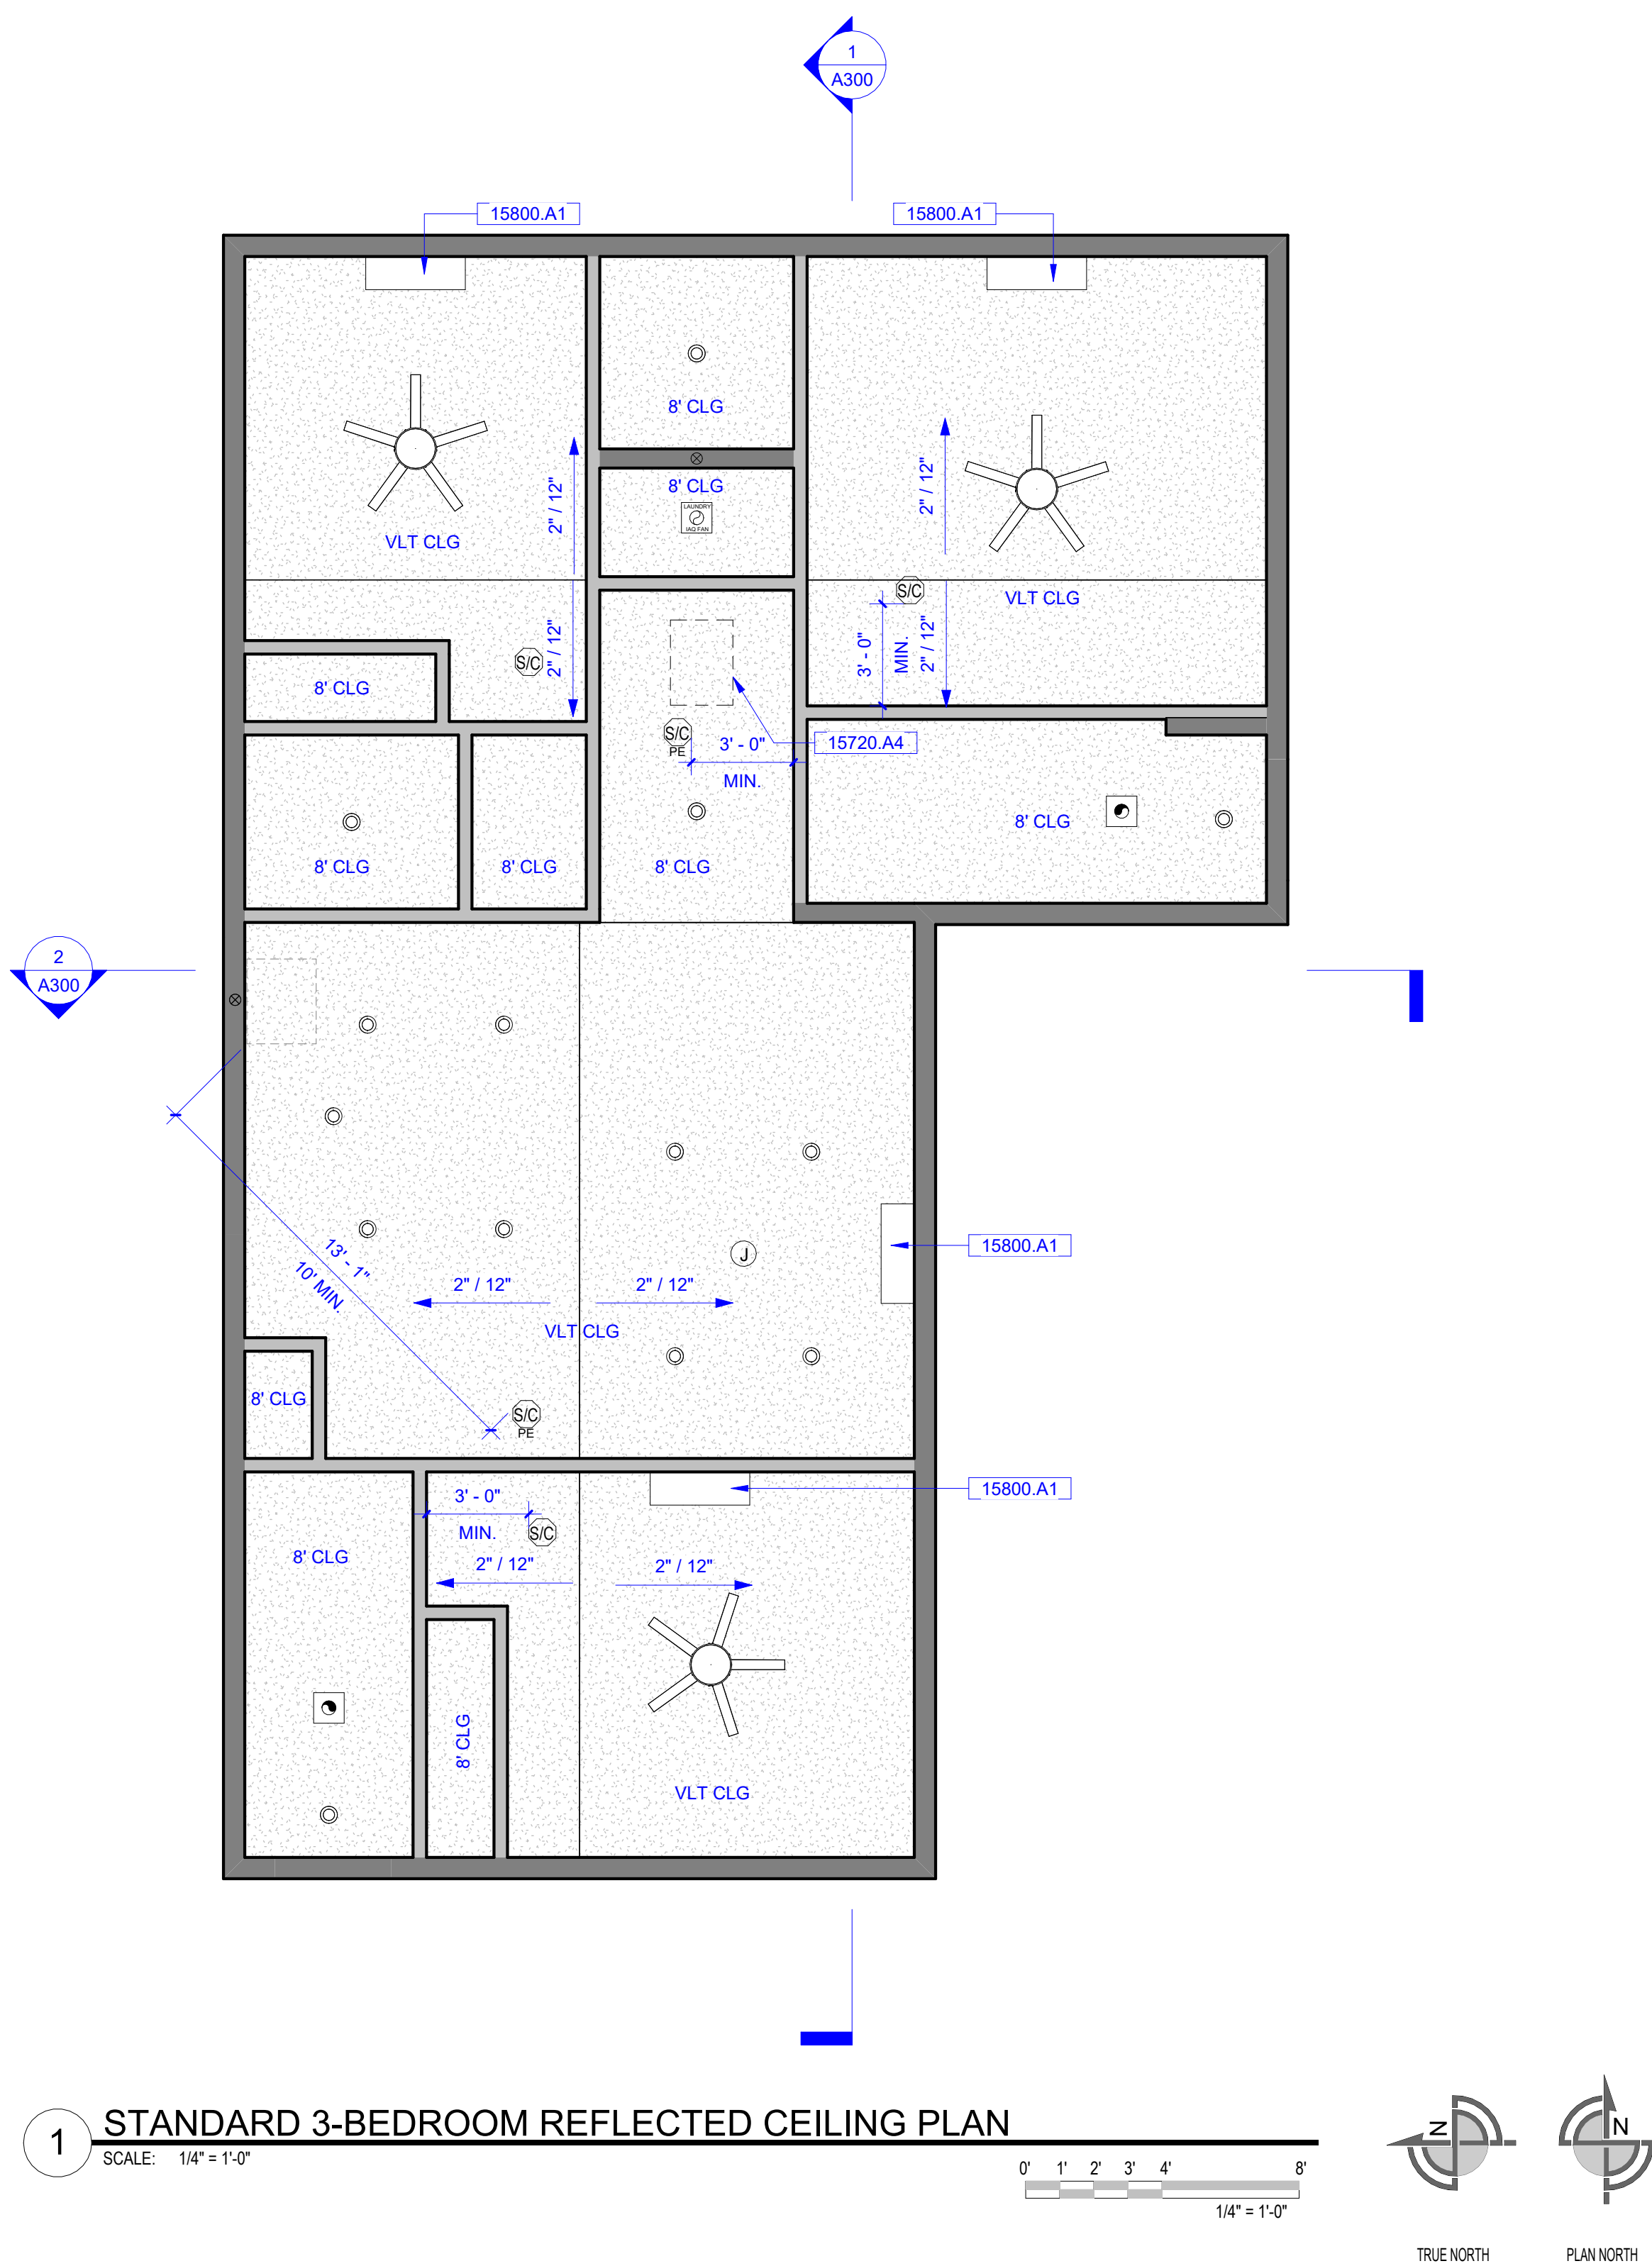

1 STANDARD 3-BEDROOM REFLECTED CEILING PLAN
SCALE: 1/4" = 1'-0"

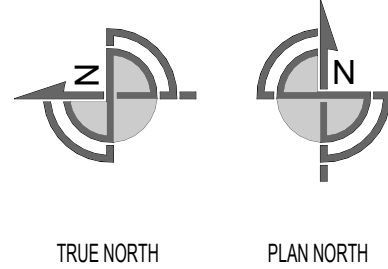

KEYNOTES:

KEYNOTE	DESCRIPTION
15720.A4	22"x30" ATTIC ACCESS
15800.A1	MINI SPLIT SYSTEM; APPLICANT/OWNER TO PROVIDE CUT SHEET TO MEET MINIMUM REQUIREMENTS OF TITLE 24 CALCULATIONS

REFLECTED CEILING PLAN LEGEND

	DRYWALL CEILING
	JUNCTION BOX
	SMOKE / CARBON MONOXIDE DETECTOR HARDWIRED W/ BATTERY BACKUP
	PHOTOELECTRIC SMOKE / CARBON MONOXIDE DETECTOR HARDWIRED W/ BATTERY BACKUP
	RECESSED LIGHT
	MICROWAVE-HOOD EXHAUST FAN COMBO 110 CFM MIN (IF GAS RANGE 250 CFM MIN. TO BE PROVIDED)
	EXHAUST VENT FAN - INTERMITTENT 50 CFM MIN / CONTINUOUS 20 CFM MIN
	EXHAUST VENT FAN SHALL BE USED TO MEET THE REQUIREMENTS FOR INDOOR AIR QUALITY (IAQ) PER T24 REPORT
	LAUNDRY EXHAUST VENT FAN SHALL BE USED TO MEET THE REQUIREMENTS FOR INDOOR AIR QUALITY (IAQ) PER T24 REPORT
	CEILING FAN WITH LIGHT
	DIRECTION OF CEILING SLOPE
	8' FLAT CEILING
	VAULTED CEILING

REFLECTED CEILING NOTES:

1. SMOKE ALARMS LOCATED BETWEEN 10 TO 20 FT FROM COOKING APPLIANCE SHALL BE IONIZED SMOKE ALARMS WITH ALARM SILENCING SWITCH, OR PHOTOELECTRIC SMOKE ALARM IN ACCORDANCE CRC R314.3.3 (4) EXCEPTION



SNAPADU
DESIGN HOUSE

YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 1,199 L-SHAPE
CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:
LUIS CALDERON
SnapADU

SIGNATURE

RELEASE	DATE	BY	APP.	LAG	RELEASED FOR...
A	03/22/2024				

REFLECTED
CEILING PLAN -
3-BEDROOM

A110

22040



SNAPADU
DESIGN HOUSE

YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 1,199 L-SHAPE
CITY OF CHILL A VISTA

276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:

LUIS CALDERON
SnapADU


SIGNATURE

[illegible]

REFLECTED
CEILING PLAN -
2-BEDROOM












A111

2040

KEYNOTES:


KEYNOTE	DESCRIPTION
15720.A4	22"X30" ATTIC ACCESS
15800.A1	MINI SPLIT SYSTEM; APPLICANT/OWNER TO PROVIDE CUT SHEET TO MEET MINIMUM REQUIREMENTS OF TITLE 24 CALCULATIONS


REFLECTED CEILING PLAN LEGEND

	DRYWALL CEILING
	JUNCTION BOX
	SMOKE / CARBON MONOXIDE DETECTOR HARDWIRED W/ BATTERY BACKUP
	PHOTOELECTRIC SMOKE / CARBON MONOXIDE DETECTOR HARDWIRED W/ BATTERY BACKUP
	RECESSED LIGHT
	MICROWAVE-HOOD EXHAUST FAN COMBO 110 CFM MIN (IF GAS RANGE 250 CFM MIN. TO BE PROVIDED)
	EXHAUST VENT FAN - INTERMITTENT 50 CFM MIN / CONTINUOUS 20 CFM MIN
	EXHAUST VENT FAN SHALL BE USED TO MEET THE REQUIREMENTS FOR INDOOR AIR QUALITY (IAQ) PER T24 REPORT
	LAUNDRY EXHAUST VENT FAN SHALL BE USED TO MEET THE REQUIREMENTS FOR INDOOR AIR QUALITY (IAQ) PER T24 REPORT
	CEILING FAN WITH LIGHT
	DIRECTION OF CEILING SLOPE
8' CLG	8' FLAT CEILING
VLT CLG	VAULTED CEILING


REFLECTED CEILING NOTES:

1. SMOKE ALARMS LOCATED BETWEEN 10 TO 20 FT FROM COOKING APPLIANCE SHALL BE IONIZED SMOKE ALARMS WITH ALARM SILENCING SWITCH, OR PHOTOELECTRIC SMOKE ALARM IN ACCORDANCE CRC R314.3.3 (4) EXCEPTION

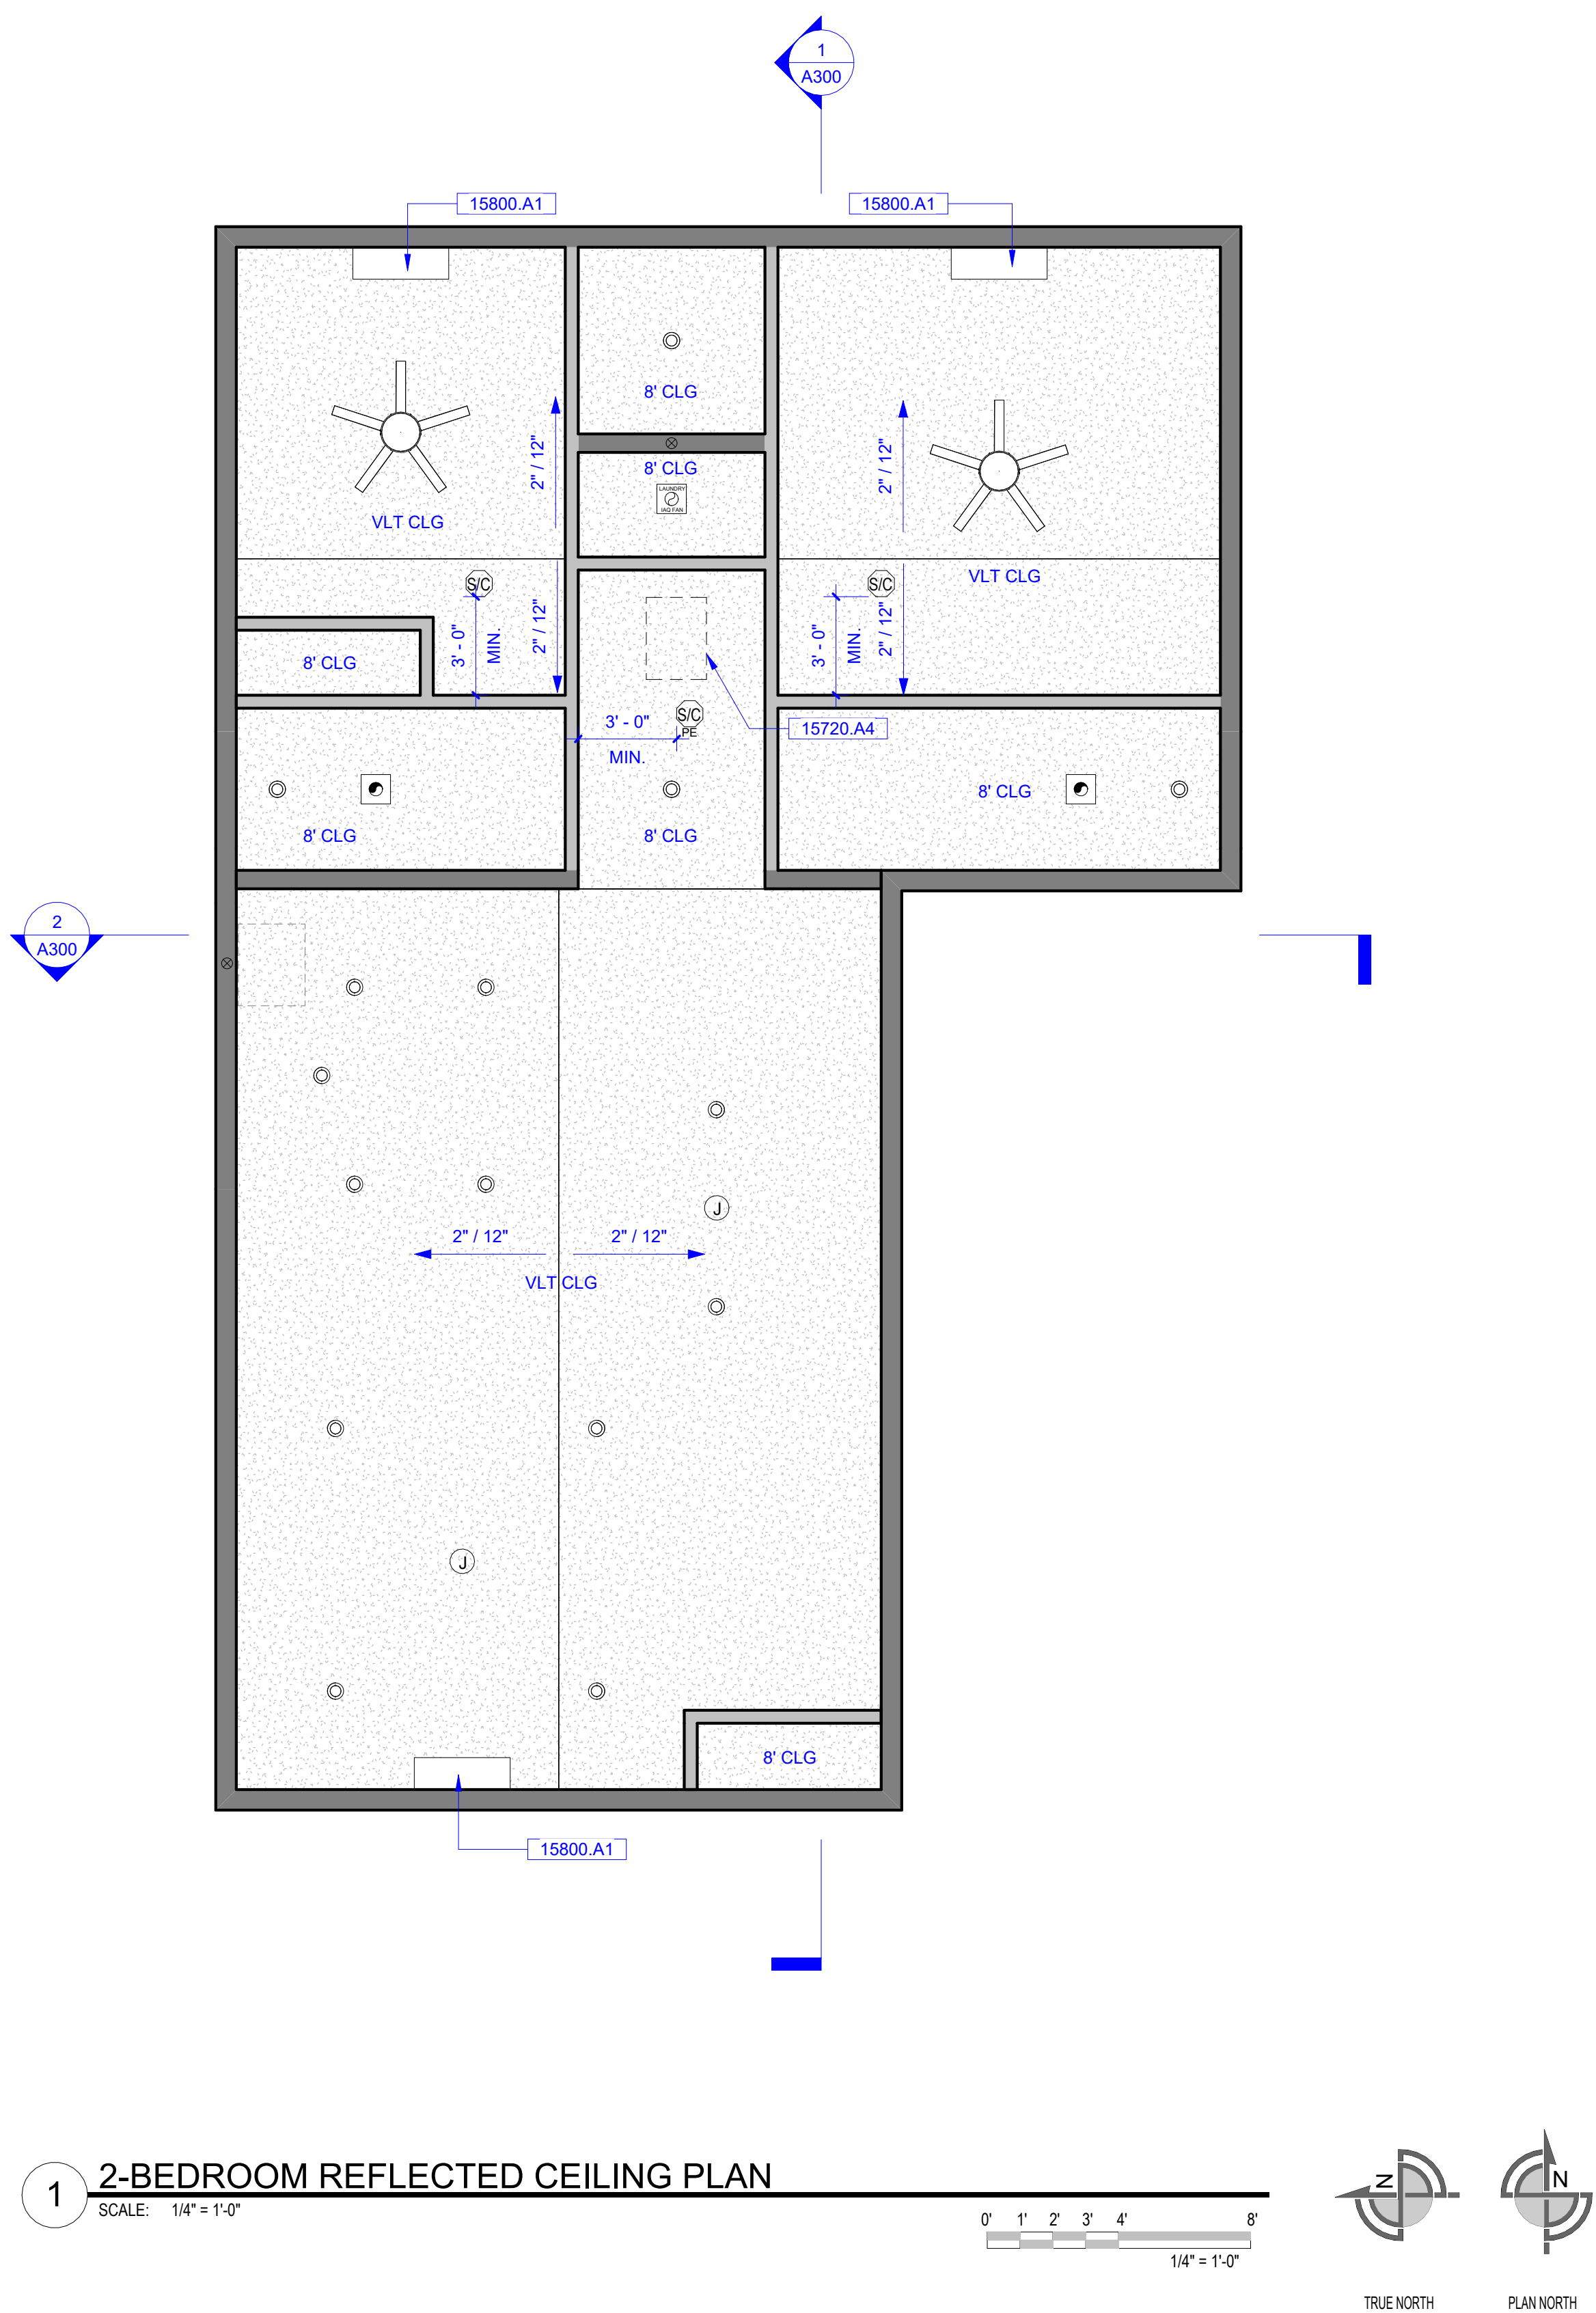


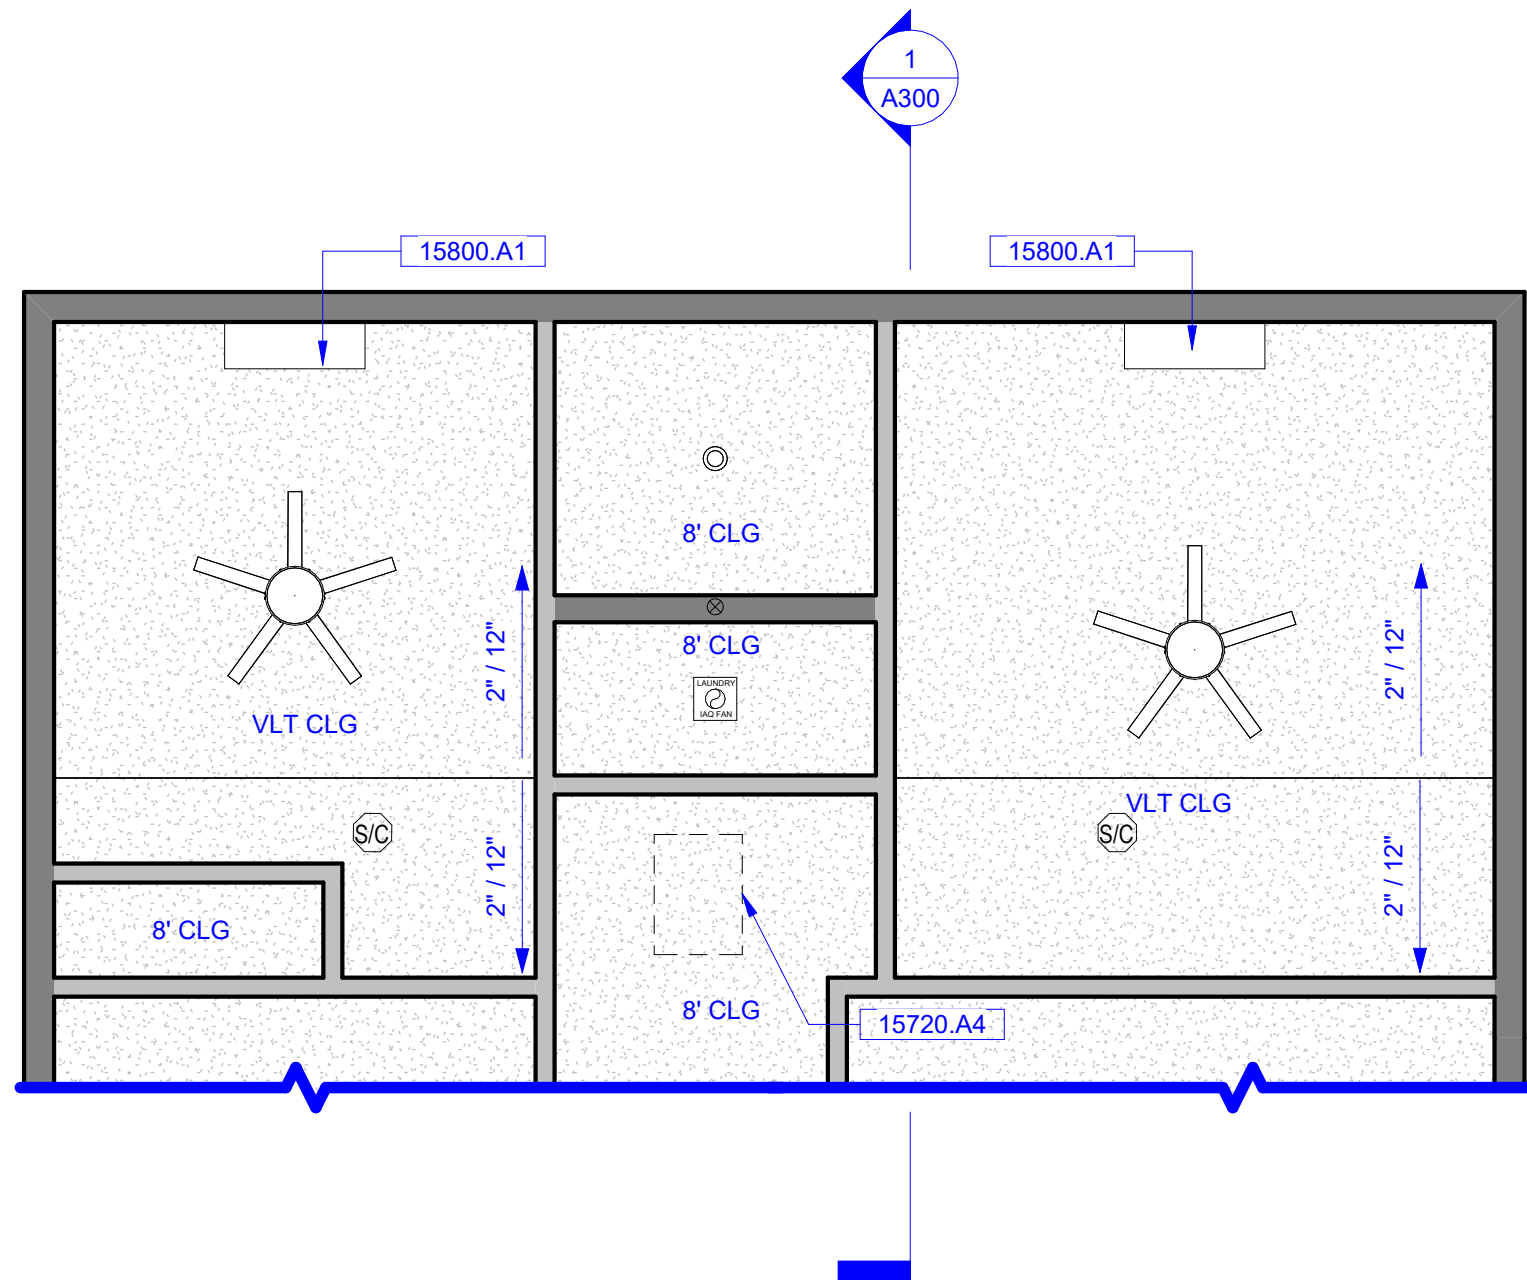

1 SIDE BY SIDE LAUNDRY OPTION REFLECTED CEILING PLAN
SCALE: 1/4" = 1'-0"

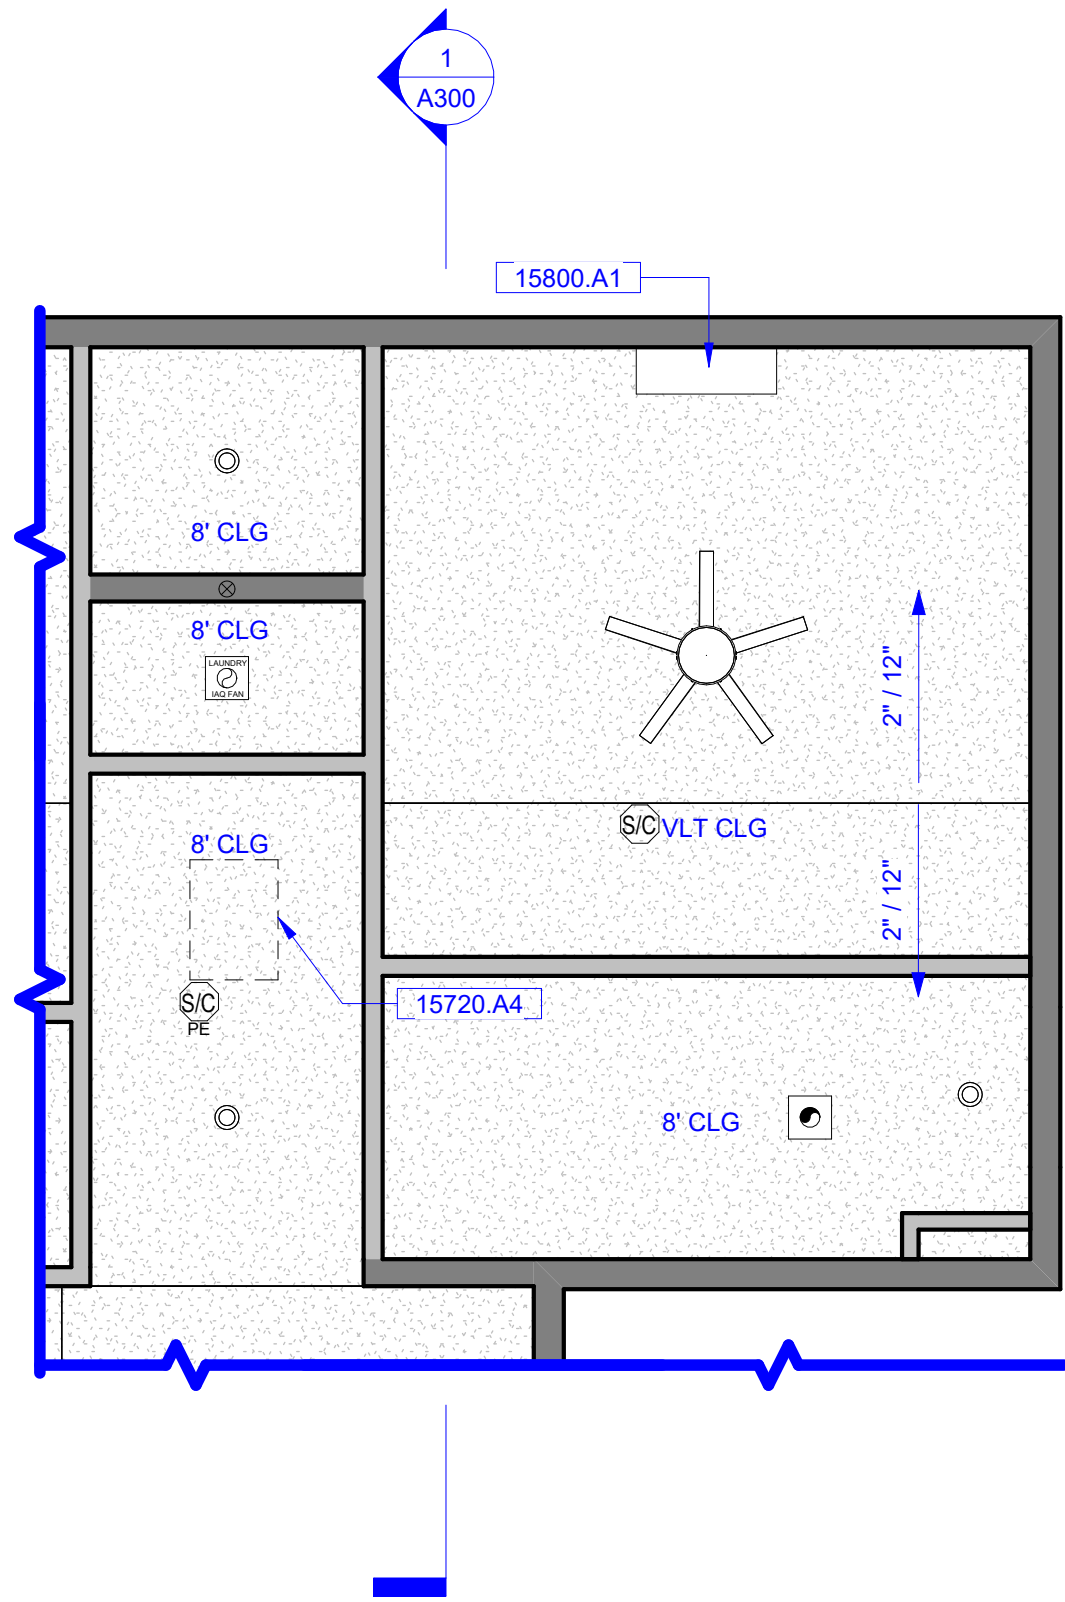

2 ENLARGED BEDROOM & BATH DOOR OPTION AT STANDARD 3-BEDROOM REFLECTED CEILING PLAN
SCALE: 1/4" = 1'-0"

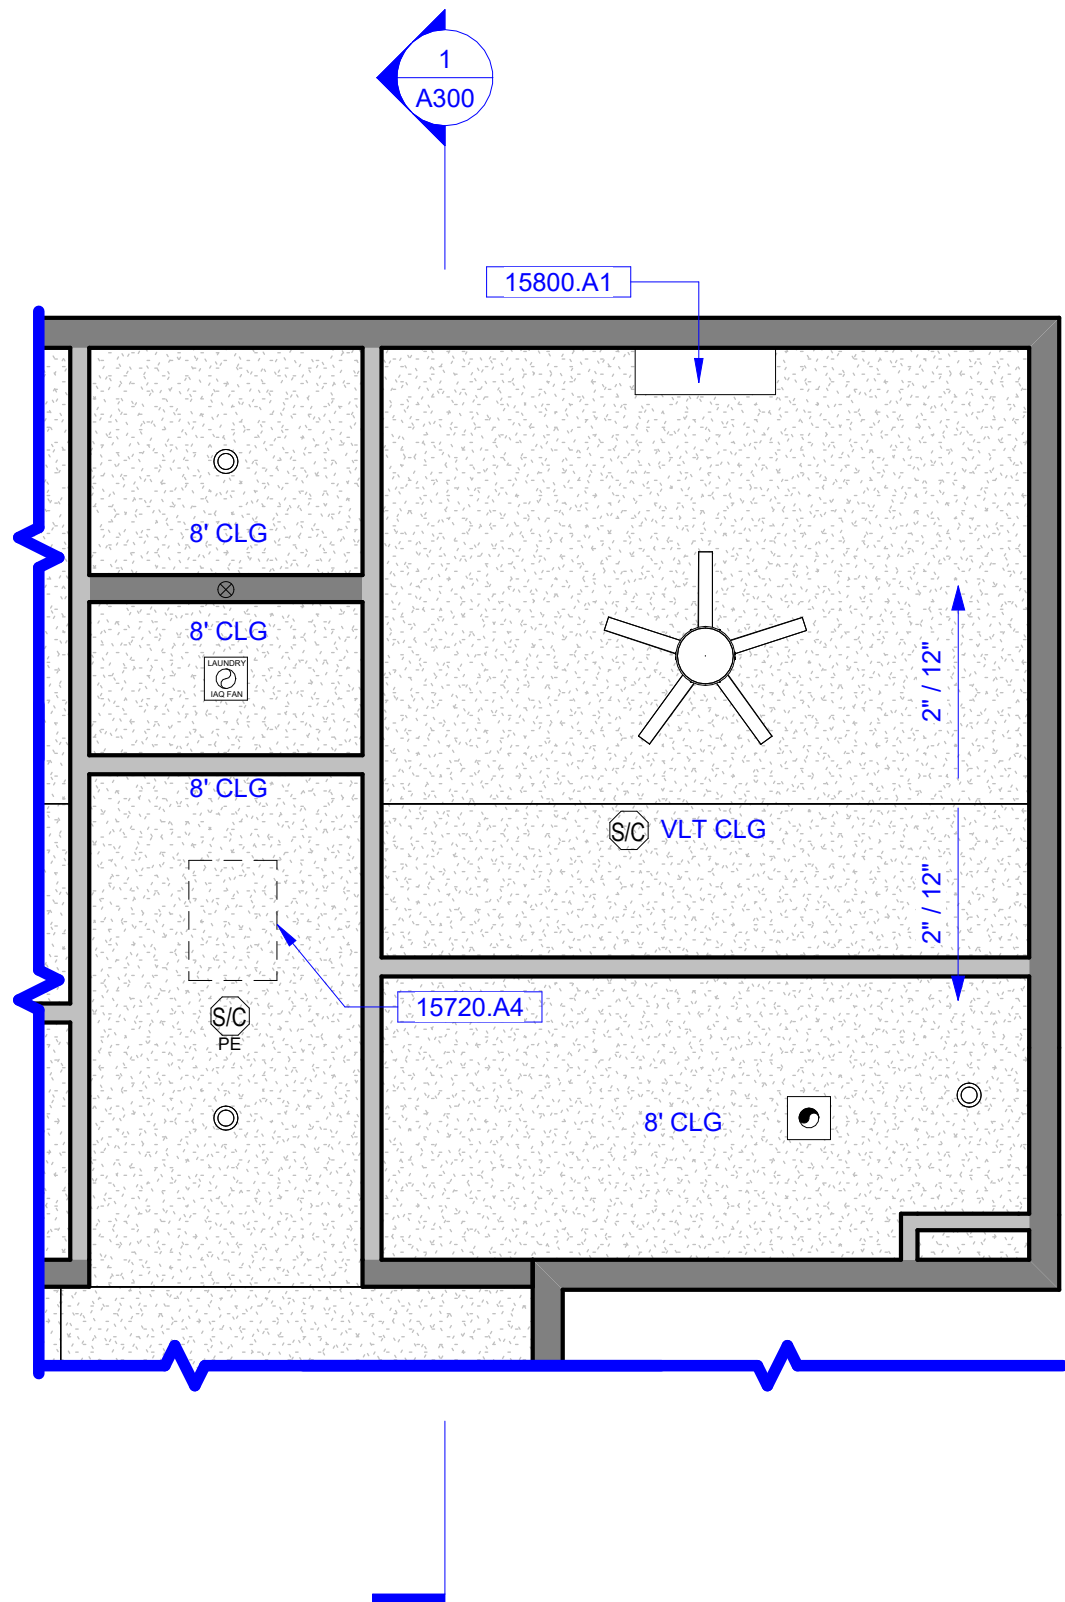

3 ENLARGED BEDROOM & BATH DOOR OPTION AT 2-BEDROOM REFLECTED CEILING PLAN
SCALE: 1/4" = 1'-0"

KEYNOTES:

KEYNOTE	DESCRIPTION
15720.A4	22"X30" ATTIC ACCESS
15800.A1	MINI SPLIT SYSTEM; APPLICANT/OWNER TO PROVIDE CUT SHEET TO MEET MINIMUM REQUIREMENTS OF TITLE 24 CALCULATIONS

REFLECTED CEILING PLAN LEGEND

	DRYWALL CEILING
	JUNCTION BOX
	SMOKE / CARBON MONOXIDE DETECTOR HARDWIRED W/ BATTERY BACKUP
	PHOTOELECTRIC SMOKE / CARBON MONOXIDE DETECTOR HARDWIRED W/ BATTERY BACKUP
	RECESSED LIGHT
	MICROWAVE-HOOD EXHAUST FAN COMBO 110 CFM MIN (IF GAS RANGE 250 CFM MIN. TO BE PROVIDED)
	EXHAUST VENT FAN - INTERMITTENT 50 CFM MIN / CONTINUOUS 20 CFM MIN
	EXHAUST VENT FAN SHALL BE USED TO MEET THE REQUIREMENTS FOR INDOOR AIR QUALITY (IAQ) PER T24 REPORT
	LAUNDRY EXHAUST VENT FAN SHALL BE USED TO MEET THE REQUIREMENTS FOR INDOOR AIR QUALITY (IAQ) PER T24 REPORT
	CEILING FAN WITH LIGHT
	DIRECTION OF CEILING SLOPE
	8' FLAT CEILING
	VAULTED CEILING

REFLECTED CEILING NOTES:

1. SMOKE ALARMS LOCATED BETWEEN 10 TO 20 FT FROM COOKING APPLIANCE SHALL BE IONIZED SMOKE ALARMS WITH ALARM SILENCING SWITCH, OR PHOTOELECTRIC SMOKE ALARM IN ACCORDANCE CRC R314.3.3 (4) EXCEPTION



SNAPADU
DESIGN HOUSE

YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 1,199 L-SHAPE
CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:
LUIS CALDERON
SnapADU



SIGNATURE

RELEASE	DATE	BY	APP.	LAG	RELEASED FOR...
A	03/22/2024				

REFLECTED
CEILING PLAN -
OPTIONS



A112

22040

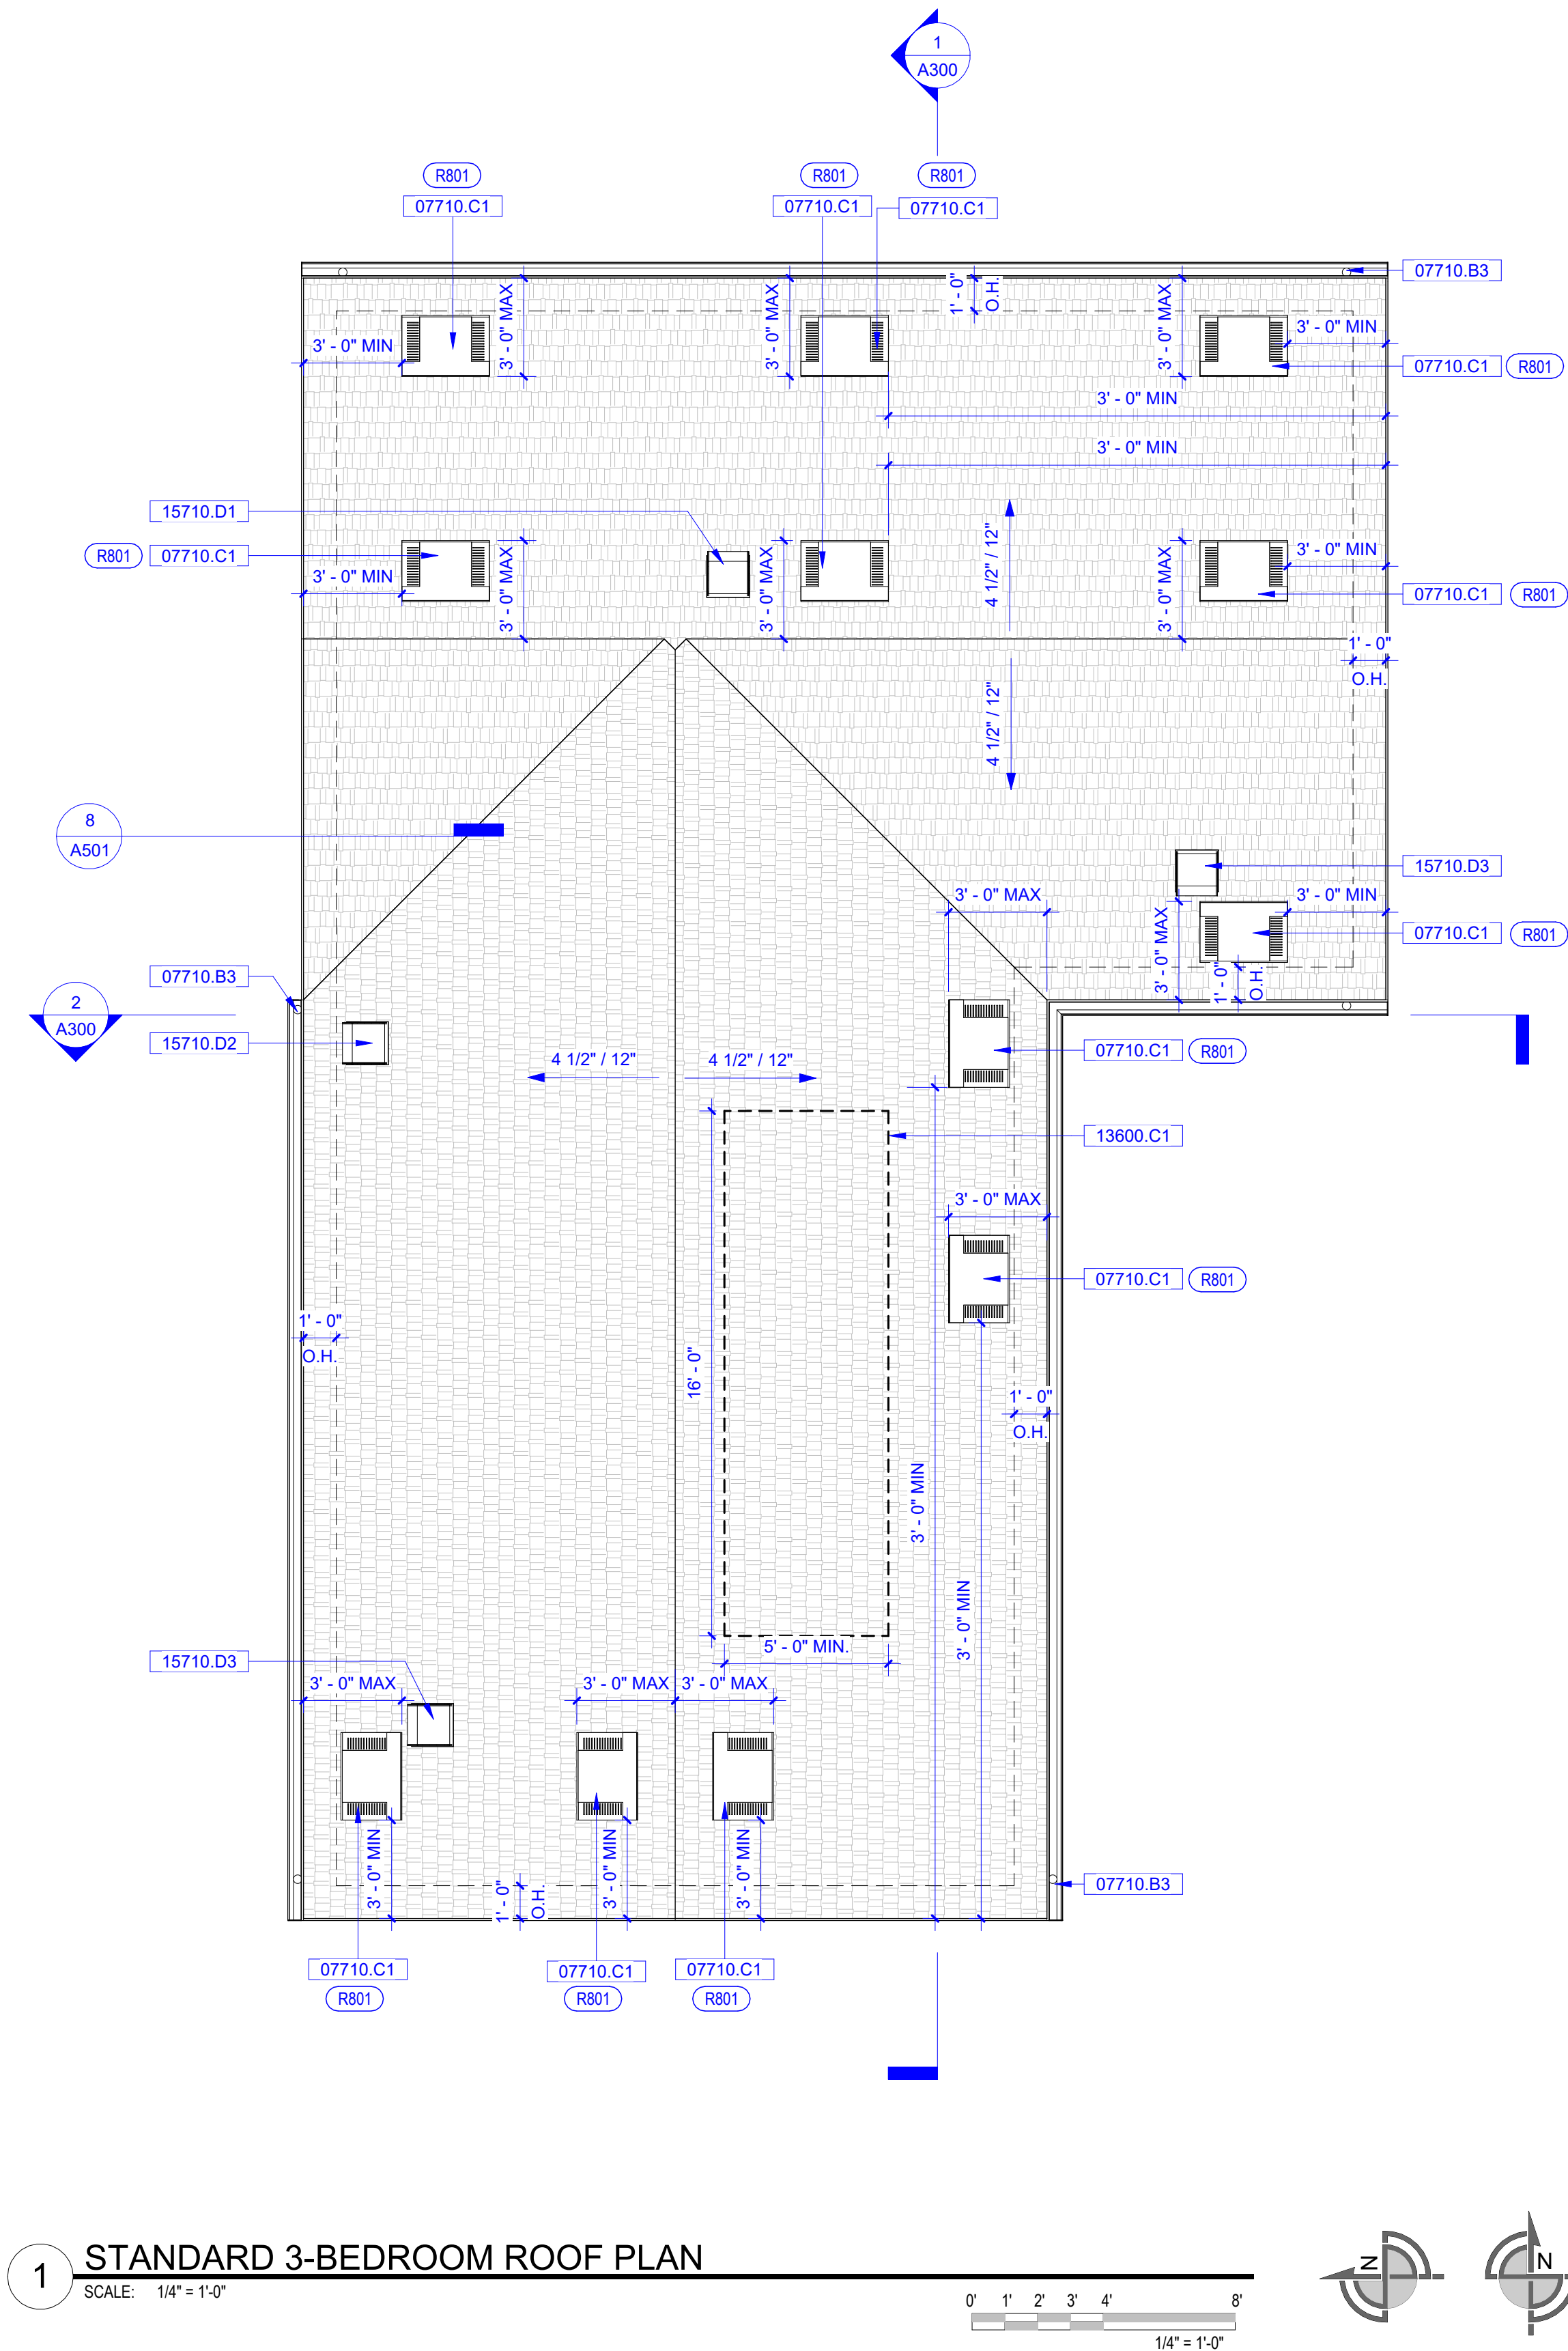

1 STANDARD 3-BEDROOM ROOF PLAN

SCALE: 1/4" = 1'-0"

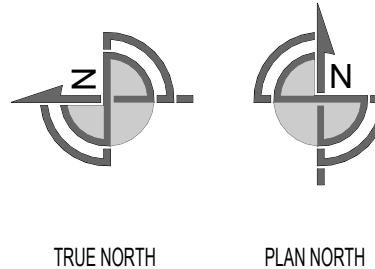

KEYNOTES:

KEYNOTE	DESCRIPTION
07710.B3	DOWNSPOUT
07710.C1	O'HAGIN STANDARD LOW PROFILE ATTIC VENTS, 0.68 SF NFVA
13600.C1	SOLAR ZONE FOR PV SYSTEM (SEE G102 CHECKLIST FOR SIZING PER T24 CALCULATIONS). SOLAR ZONE LOCATION MIGHT VARY PER SITE CONDITIONS
15710.D1	DRYER EXHAUST ROOF EXHAUST VENT
15710.D2	RANGE HOOD ROOF EXHAUST VENT
15710.D3	BATH EXHAUST FAN ROOF VENT

ROOF PLAN LEGEND

	ROOFING PER CHECKLIST SELECTION ON SHEET G102
	SOLAR ZONE OUTLINE. CEC 110.10(B)1
	WALL LINE BELOW
	DIRECTION OF DRAINAGE
	ROOF VENT
	EXHAUST ROOF JACK VENT
	SOLAR PV PANEL

ROOF NOTES:

- ROOF MATERIAL PER CHECKLIST SELECTION ON SHEET G102.
 - ROOF TYPE 1 - 242 HIGHLANDER NEX AR ASPHALT SHINGLE, MANUFACTURED BY MALARKY ROOFING PRODUCTS; ICC APPROVAL: ESR-3150, UL RATING 2218; OR EQUAL APPROVED.
 - SEE DETAILS 1/A500, 4/A500, 1/A510, 4/A510, 1/A520, 4/A520, 1/A530, 4/A530.
 - ROOF TYPE 2 - LOW PROFILE 'BEL AIR' CONCRETE ROOF TILE BY EAGLE ROOFING; IAPMO ER-1900; OR EQUAL APPROVED.
 - SEE DETAILS 2/A500, 5/A500, 2/A510, 5/A510, 2/A520, 5/A520, 2/A530, 5/A530.
 - ROOF TYPE 3 - HIGH PROFILE 'CAPISTRANO' CONCRETE S-TILE ROOF BY EAGLE ROOFING; IAPMO ER-1900; OR EQUAL APPROVED.
 - SEE DETAILS 3/A500, 6/A500, 3/A510, 6/A510, 3/A520, 6/A520, 3/A530, 6/A530.
 - OTHER ROOF TYPE MODEL:
 - MAKE:
 - MODEL:
 - ICC ESR NUMBER:
- ROOF UNDERLAYMENT SHALL BE DOUBLE NEX POLYMER MODIFIED FIBERGLASS UNDERLAYMENT ON ROOF SLOPES EQUAL OR LESS TO 4:12 PER P905.1.1(2); ICC APPROVAL: ESR-1561; OR EQUAL APPROVED
- ROOF GUTTERS SHALL BE PROVIDED WITH THE MEANS TO PREVENT THE ACCUMULATION OF LEAVES AND DEBRIS IN THE GUTTER. (CBC 92.1.705A.4)
- ALL VENTS (ROOF, FOUNDATION, COMBUSTION-AIR, ETC.) SHALL RESIST THE INTRUSION OF FLAMES AND EMBERS. (CBC 92.1.706A.1)
- VENTILATION OPENING FOR ENCLOSED ATTICS, EAVE SOFFIT SPACES, ENCLOSED RAFTER SPACES FORMED WHERE CEILINGS ARE APPLIED DIRECTLY TO THE UNDERSIDE OF ROOF RAFTERS, UNDERFLOOR VENTILATION OPENINGS, AND VENT OPENINGS IN EXTERIOR WALLS AND EXTERIOR DOORS SHALL BE LISTED TO ASTM E 2886 AND COMPLY WITH ALL OF THE FOLLOWING: (CBC 92.1.706A.2, CBC 92.1.707A5)
 - THERE SHALL BE NO FLAMING IGNITION OF THE COTTON MATERIAL DURING THE EMBER ENTRUSION TEST.
 - THERE SHALL BE NO FLAMING IGNITION DURING THE INTEGRITY TEST PORTION OF THE FLAME INTRUSION TEST.
 - THE MAXIMUM TEMPERATURE OF THE UNEXPOSED SIDE OF THE VENT SHALL NOT EXCEED 662 DEGREES FAHRENHEIT (350 DEGREES CELSIUS)
- EXHAUST DUCT TERMINATION IS AS FOLLOWS PER CMC 502.2:
 - 3 FEET FROM A PROPERTY LINE.
 - 10 FEET FROM A FORCED AIR INLET, AND
 - 3 FEET FROM OPENINGS INTO THE BUILDING.
- EXHAUST DUCT SHALL NOT DISCHARGE ONTO A PUBLIC WAY. CMC 502.2
- UNLESS OTHERWISE PERMITTED OR REQUIRED BY THE DRYER MANUFACTURER'S INSTALLATION INSTRUCTIONS AND APPROVED BY THE CITY, DOMESTIC DRYER MOISTURE EXHAUST DUCTS SHALL NOT EXCEED A TOTAL COMBINED HORIZONTAL AND VERTICAL LENGTH OF FOURTEEN FEET, INCLUDING TWO 90-DEGREE ELBOWS. TWO FEET SHALL BE DEDUCTED FOR EACH 90 DEGREE ELBOW IN EXCESS OF TWO. CMC 504.4.2.

ROOF VENT CALCULATION

CLASS-1 VAPOR BARREIR PROVIDED ON WINTER-WARM-SIDE; NO
TOTAL ROOF VENT AREA REQUIRED: ROOF AREA / 150 SF

CALCULATIONS:

DESCRIPTION	AREA	REQ. ROOF VENT
ATTIC AREA	1199 SF	8.00 SF

TOTAL NET FREE VENTILATION AREA (NFVA) PROVIDE:

O'HAGIN CONC.TILE LOW PROF.VENT NFVA = 98.75 SQ.IN.=0.68 SF./V.
8.00 SF. / 0.68 SF./VENT = 11.76 12 VENTS WILL BE PROVIDED AS FOLLOWS:

5 EXHAUST VENTS WITHIN 3 FT. BELOW THE RIDGE HIGHEST POINT
& 7 INTAKE VENTS AT THE BOTTOM THIRD OF THE ATTIC SPACE

TOTAL VENT AREA = 12 VENTS X 0.68 SF./VENT = 8.16 SF.
TOTAL PROVIDE = 8.16 SF > 8.00 SF REQ. ROOF VENT.



SNAPADU
DESIGN HOUSE
YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 1,199 L-SHAPE
CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:

LUIS CALDERON
SnapADU


SIGNATURE

RELEASE	DATE	BY	APP.	RELEASED FOR...
A	03/22/2024		LAG	



ROOF PLAN -
3-BEDROOM

A120

22040

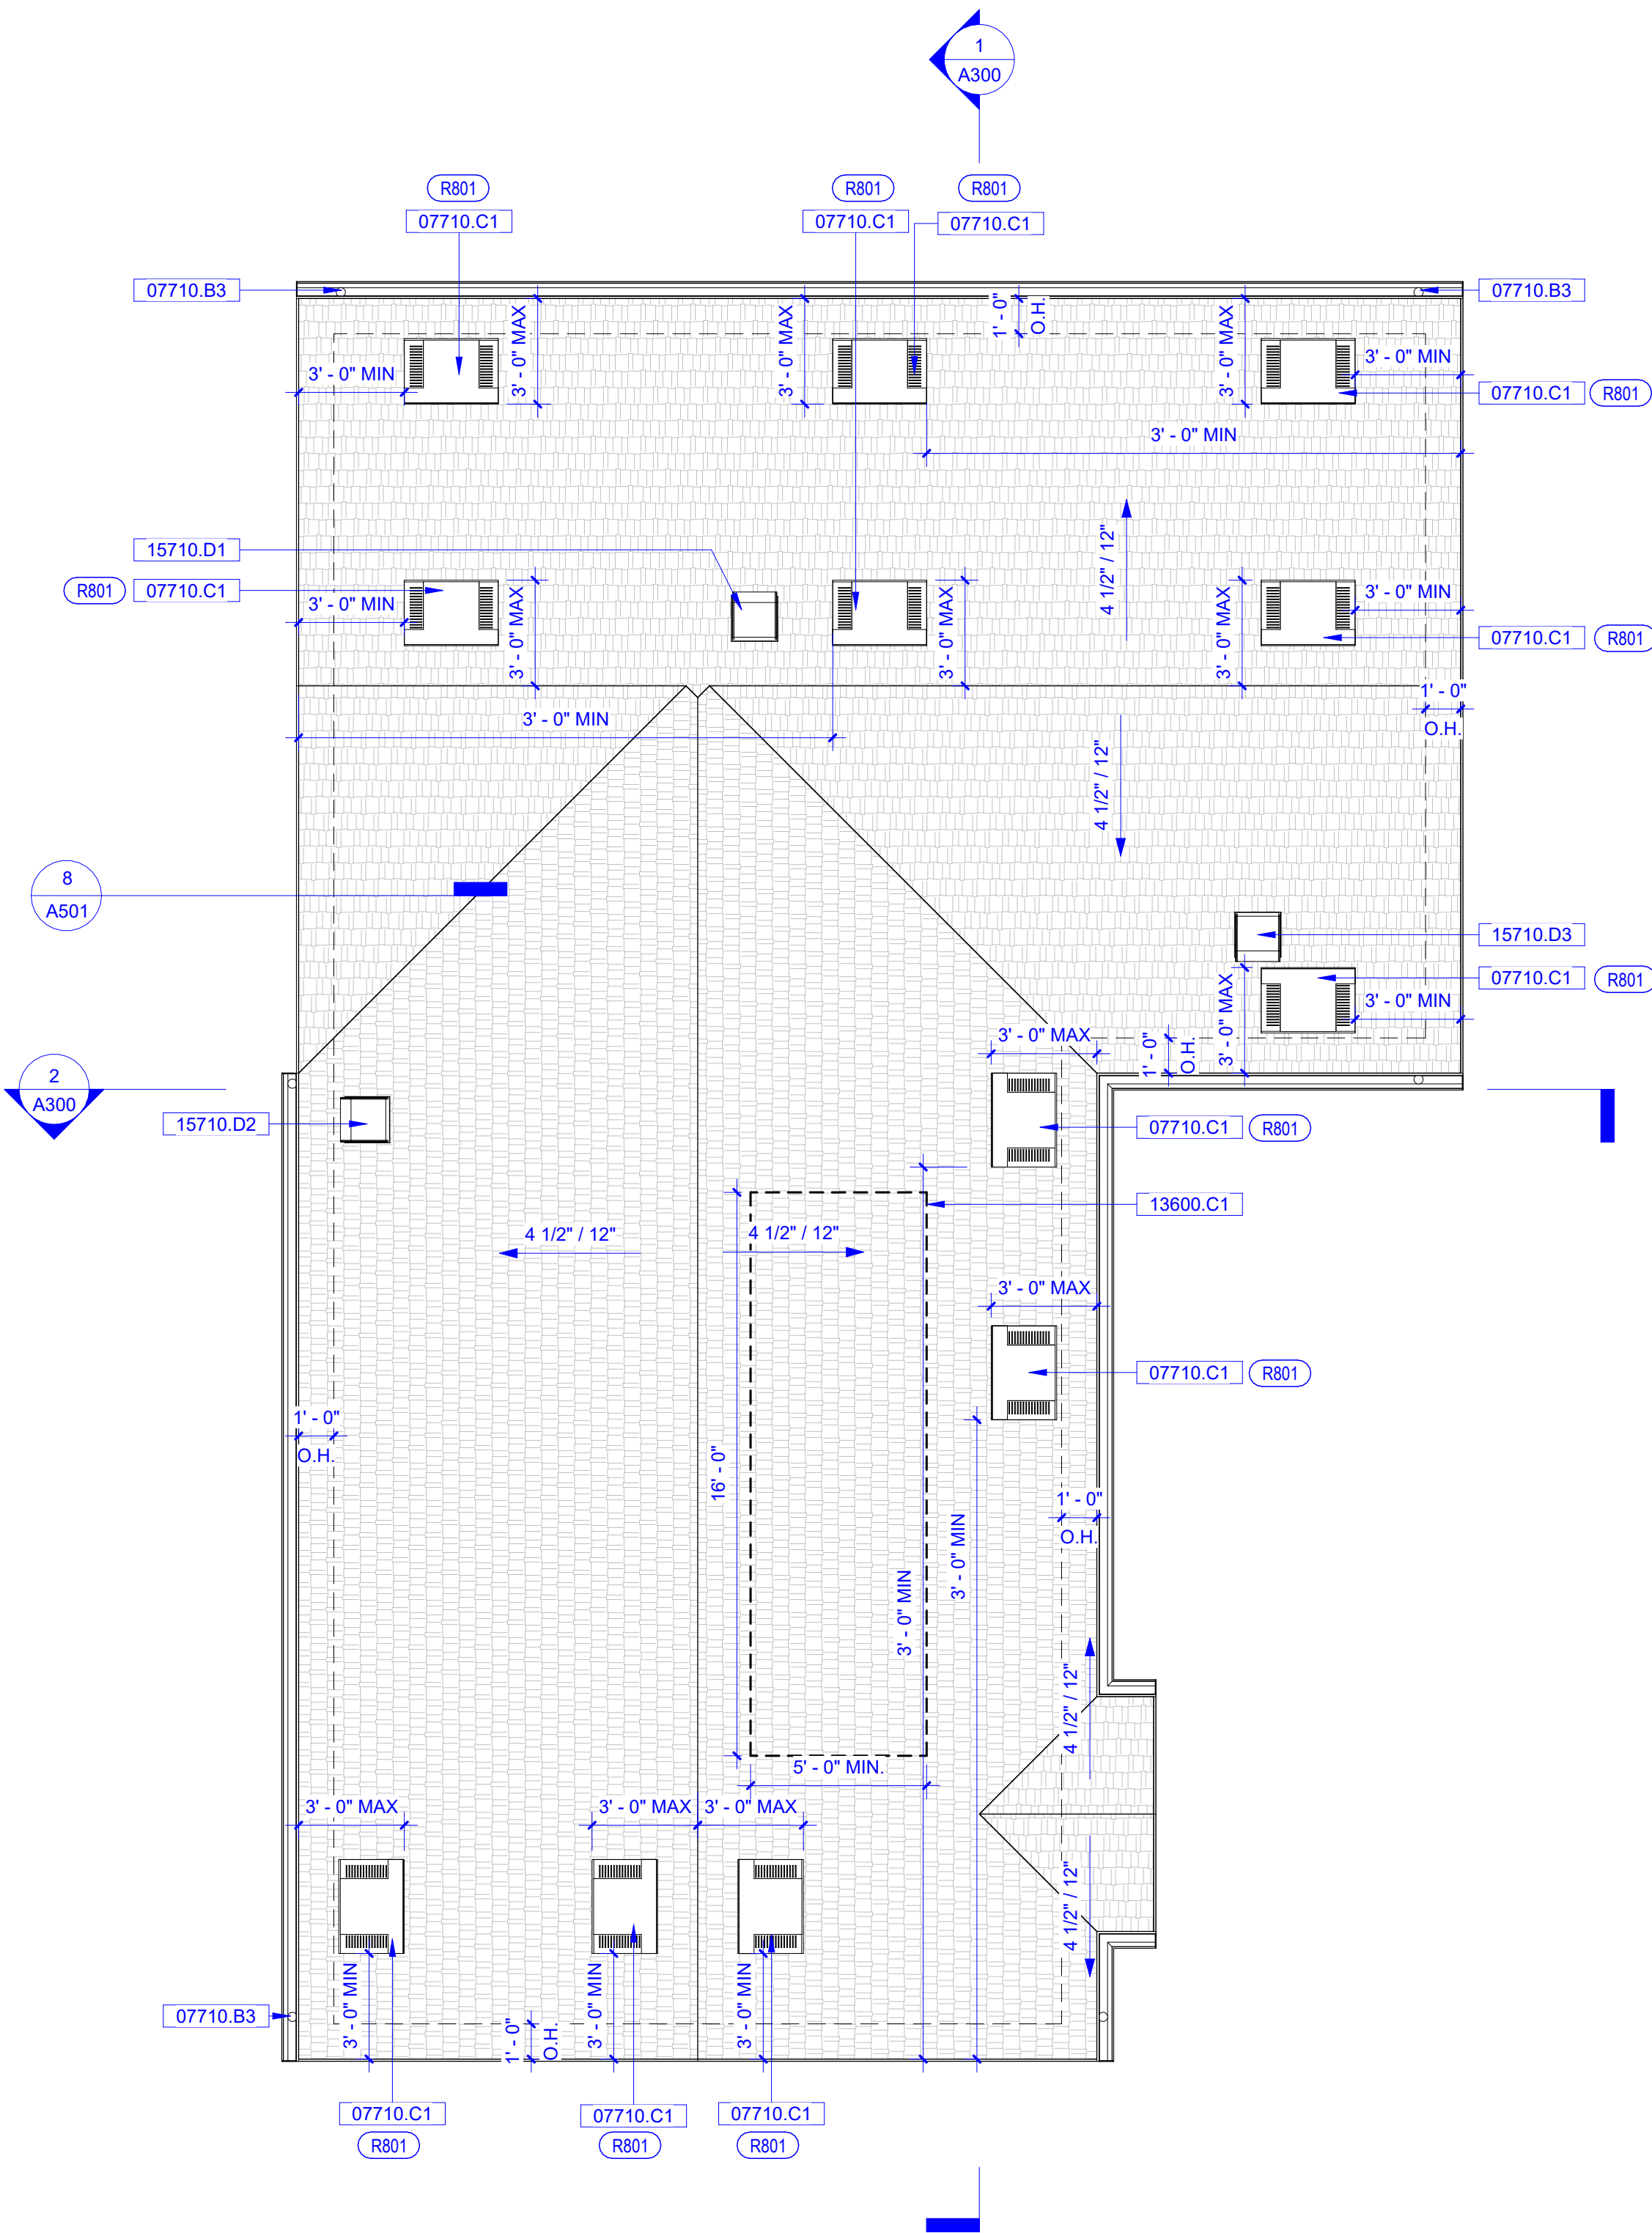

1 2-BEDROOM OPTION ROOF PLAN
SCALE: 1/4" = 1'-0"

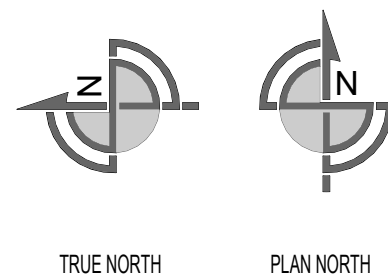

KEYNOTES:

KEYNOTE	DESCRIPTION
07710.B3	DOWNSPOUT
07710.C1	O'HAGIN STANDARD LOW PROFILE ATTIC VENTS, 0.68 SF NFVA
13600.C1	SOLAR ZONE FOR PV SYSTEM (SEE G102 CHECKLIST FOR SIZING PER T24 CALCULATIONS). SOLAR ZONE LOCATION MIGHT VARY PER SITE CONDITIONS
15710.D1	DRYER EXHAUST ROOF EXHAUST VENT
15710.D2	RANGE HOOD ROOF EXHAUST VENT
15710.D3	BATH EXHAUST FAN ROOF VENT

ROOF PLAN LEGEND

	ROOFING PER CHECKLIST SELECTION ON SHEET G102
	SOLAR ZONE OUTLINE. CEC 110.10(B)1
	WALL LINE BELOW
	DIRECTION OF DRAINAGE
	ROOF VENT
	EXHAUST ROOF JACK VENT
	SOLAR PV PANEL

ROOF NOTES:

- ROOF MATERIAL PER CHECKLIST SELECTION ON SHEET G102.
 - ROOF TYPE 1 - 242 HIGHLANDER NEX AR ASPHALT SHINGLE, MANUFACTURED BY MALARKY ROOFING PRODUCTS; ICC APPROVAL: ESR-3150; UL RATING 2218; OR EQUAL APPROVED.
 - SEE DETAILS: 1/A500, 4/A500, 1/A510, 4/A510, 1/A520, 4/A520, 1/A530, 4/A530.
 - ROOF TYPE 2 - LOW PROFILE 'BEL AIR' CONCRETE ROOF TILE BY EAGLE ROOFING; IAPMO ER-1900; OR EQUAL APPROVED.
 - SEE DETAILS 2/A500, 5/A500, 2/A510, 5/A510, 2/A520, 5/A520, 2/A530, 5/A530.
 - ROOF TYPE 3 - HIGH PROFILE 'CAPISTRANO' CONCRETE S-TILE ROOF BY EAGLE ROOFING; IAPMO ER-1900; OR EQUAL APPROVED.
 - SEE DETAILS 3/A500, 6/A500, 3/A510, 6/A510, 3/A520, 6/A520, 3/A530, 6/A530.
 - OTHER ROOF TYPE MODEL:
 - MAKE:
 - MODEL:
 - ICC ESR NUMBER:
- ROOF UNDERLAYMENT SHALL BE DOUBLE NEX POLYMER MODIFIED FIBERGLASS UNDERLAYMENT ON ROOF SLOPES EQUAL OR LESS TO 4:12 PER P905.1.1(2); ICC APPROVAL: ESR-1561; OR EQUAL APPROVED
- ROOF GUTTERS SHALL BE PROVIDED WITH THE MEANS TO PREVENT THE ACCUMULATION OF LEAVES AND DEBRIS IN THE GUTTER. (CBC 92.1.705A.4)
- ALL VENTS (ROOF, FOUNDATION, COMBUSTION-AIR, ETC.) SHALL RESIST THE INTRUSION OF FLAMES AND EMBERS. (CBC 92.1.706A.1)
- VENTILATION OPENING FOR ENCLOSED ATTICS: EAVE SOFFIT SPACES, ENCLOSED RAFTER SPACES FORMED WHERE CEILINGS ARE APPLIED DIRECTLY TO THE UNDERSIDE OF ROOF RAFTERS, UNDERFLOOR VENTILATION OPENINGS, AND VENT OPENINGS IN EXTERIOR WALLS AND EXTERIOR DOORS SHALL BE LISTED TO ASTM E 2886 AND COMPLY WITH ALL OF THE FOLLOWING: (CBC 92.1.706A.2, CBC 92.1.707A5)
 - THERE SHALL BE NO FLAMING IGNITION OF THE COTTON MATERIAL DURING THE EMBER ENTRUSION TEST.
 - THERE SHALL BE NO FLAMING IGNITION DURING THE INTEGRITY TEST PORTION OF THE FLAME INTRUSION TEST.
 - THE MAXIMUM TEMPERATURE OF THE UNEXPOSED SIDE OF THE VENT SHALL NOT EXCEED 662 DEGREES FAHRENHEIT (350 DEGREES CELSIUS)
- EXHAUST DUCT TERMINATION IS AS FOLLOWS PER CMC 502.2:
 - 3 FEET FROM A PROPERTY LINE.
 - 10 FEET FROM A FORCED AIR INLET, AND
 - 3 FEET FROM OPENINGS INTO THE BUILDING.
- EXHAUST DUCT SHALL NOT DISCHARGE ONTO A PUBLIC WAY. CMC 502.2
- UNLESS OTHERWISE PERMITTED OR REQUIRED BY THE DRYER MANUFACTURER'S INSTALLATION INSTRUCTIONS AND APPROVED BY THE CITY, DOMESTIC DRYER MOISTURE EXHAUST DUCTS SHALL NOT EXCEED A TOTAL COMBINED HORIZONTAL AND VERTICAL LENGTH OF FOURTEEN FEET, INCLUDING TWO 90-DEGREE ELBOWS. TWO FEET SHALL BE DEDUCTED FOR EACH 90 DEGREE ELBOW IN EXCESS OF TWO. CMC 504.4.2.

ROOF VENT CALCULATION

CLASS-1 VAPOR BARREIR PROVIDED ON WINTER-WARM-SIDE: NO
TOTAL ROOF VENT AREA REQUIRED: ROOF AREA / 150 SF

CALCULATIONS:

DESCRIPTION	AREA	REQ. ROOF VENT
ATTIC AREA	1199 SF	8.00 SF

TOTAL NET FREE VENTILATION AREA (NFVA) PROVIDE:

O'HAGIN CONC.TILE LOW PROF.VENT NFVA = 98.75 SQ.IN.=0.68 SF./V.
8.00 SF. / 0.68 SF./VENT = 11.76 12 VENTS WILL BE PROVIDED AS FOLLOWS:

5 EXHAUST VENTS WITHIN 3 FT. BELOW THE RIDGE HIGHEST POINT
& 7 INTAKE VENTS AT THE BOTTOM THIRD OF THE ATTIC SPACE

TOTAL VENT AREA = 12 VENTS X 0.68 SF./VENT = 8.16 SF.
TOTAL PROVIDE = 8.16 SF > 8.00 SF REQ. ROOF VENT.



SNAPADU
DESIGN HOUSE
YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 1,199 L-SHAPE
CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:

LUIS CALDERON
SnapADU


SIGNATURE

RELEASE	DATE	BY	APP.	RELEASED FOR...
A	03/22/2024	LAG		


ROOF PLAN -
2-BEDROOM

A121


22040

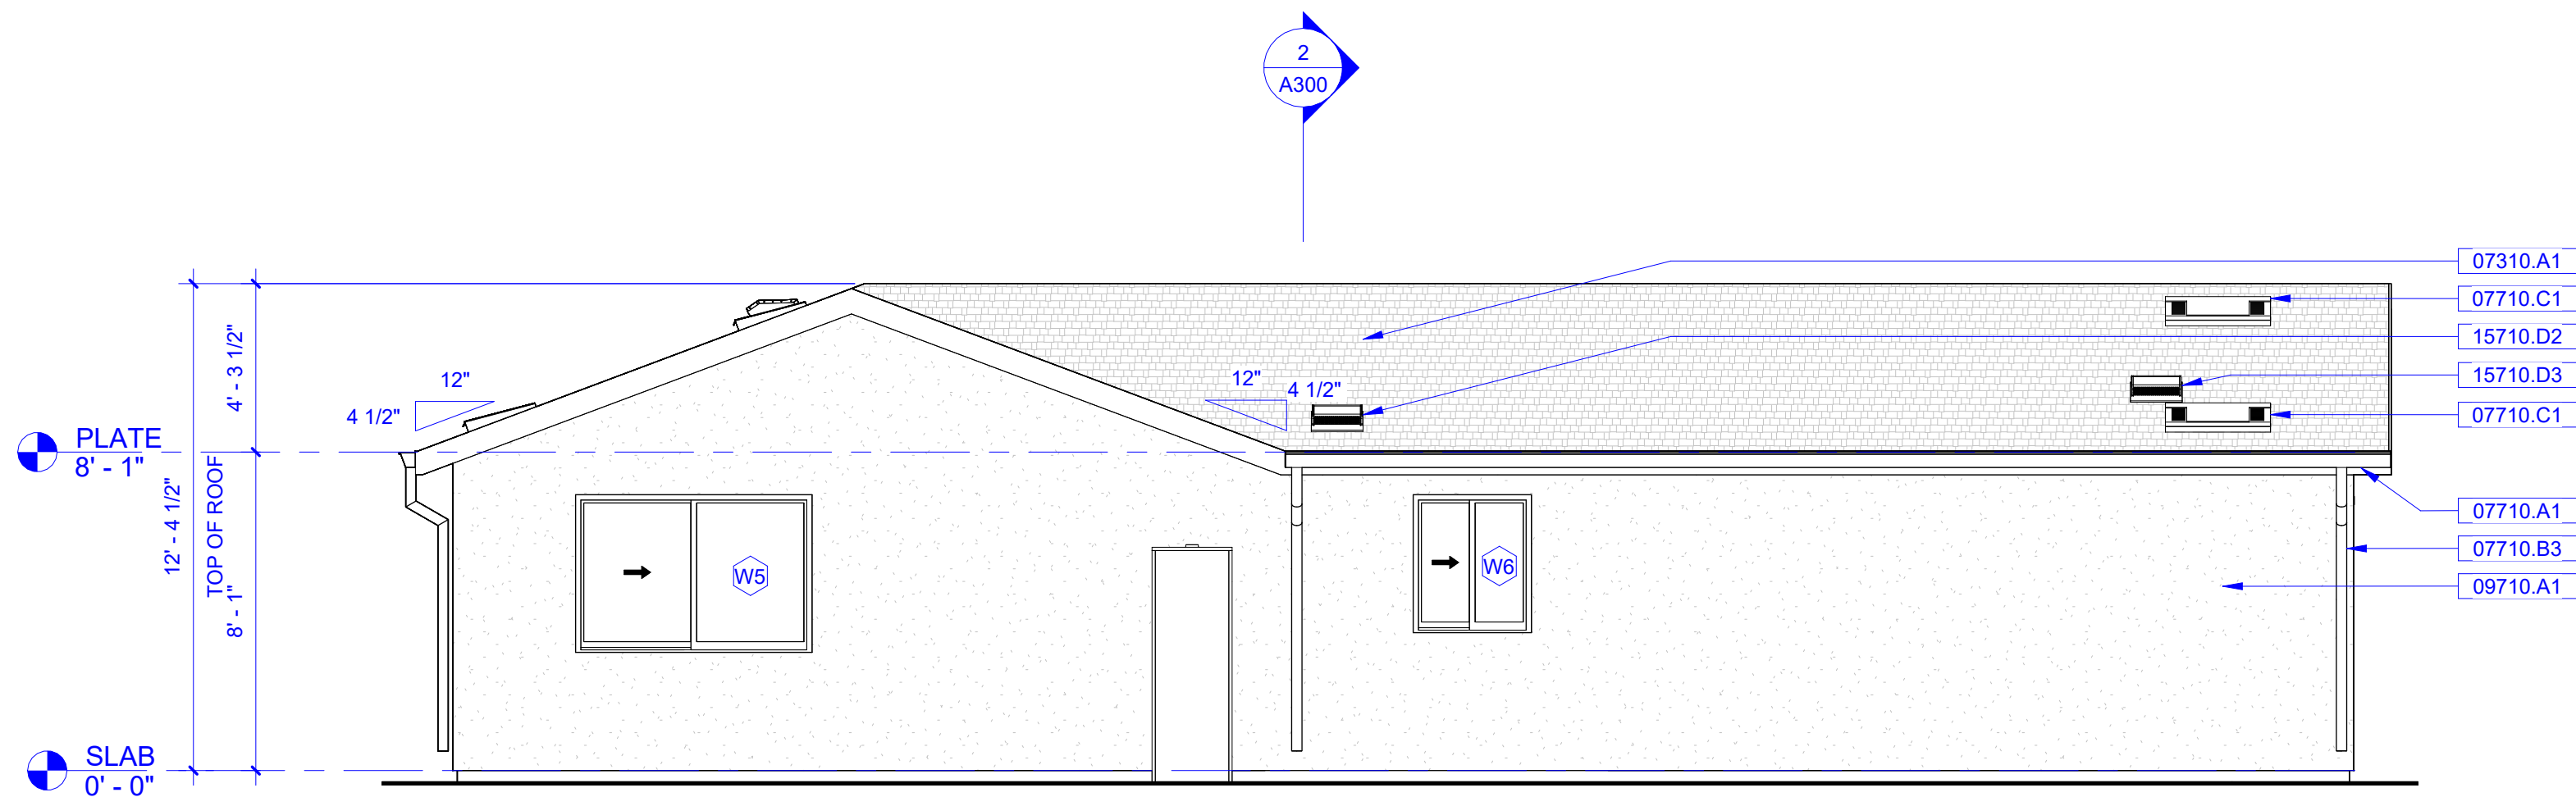


1 NORTH ELEVATION - STUCCO
SCALE: 1/4" = 1'-0"

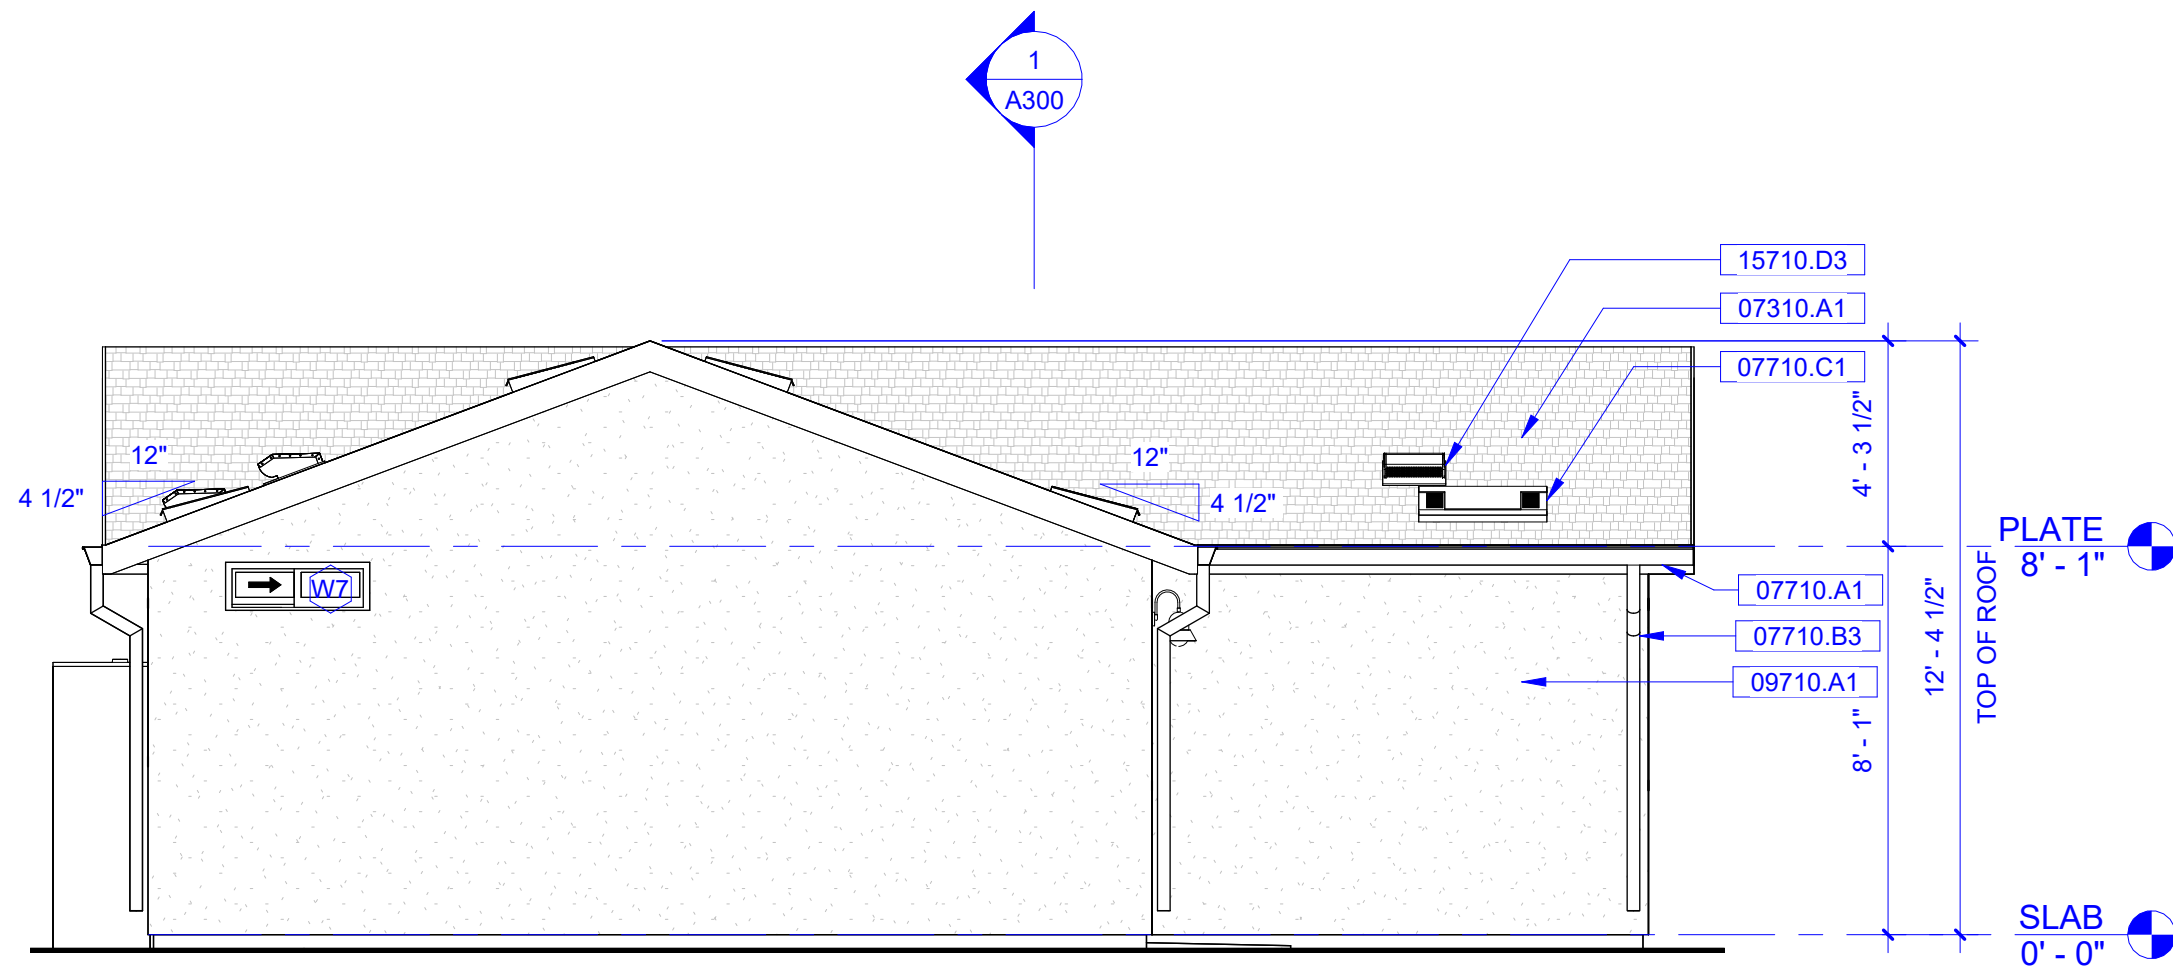

2 WEST ELEVATION - STUCCO
SCALE: 1/4" = 1'-0"

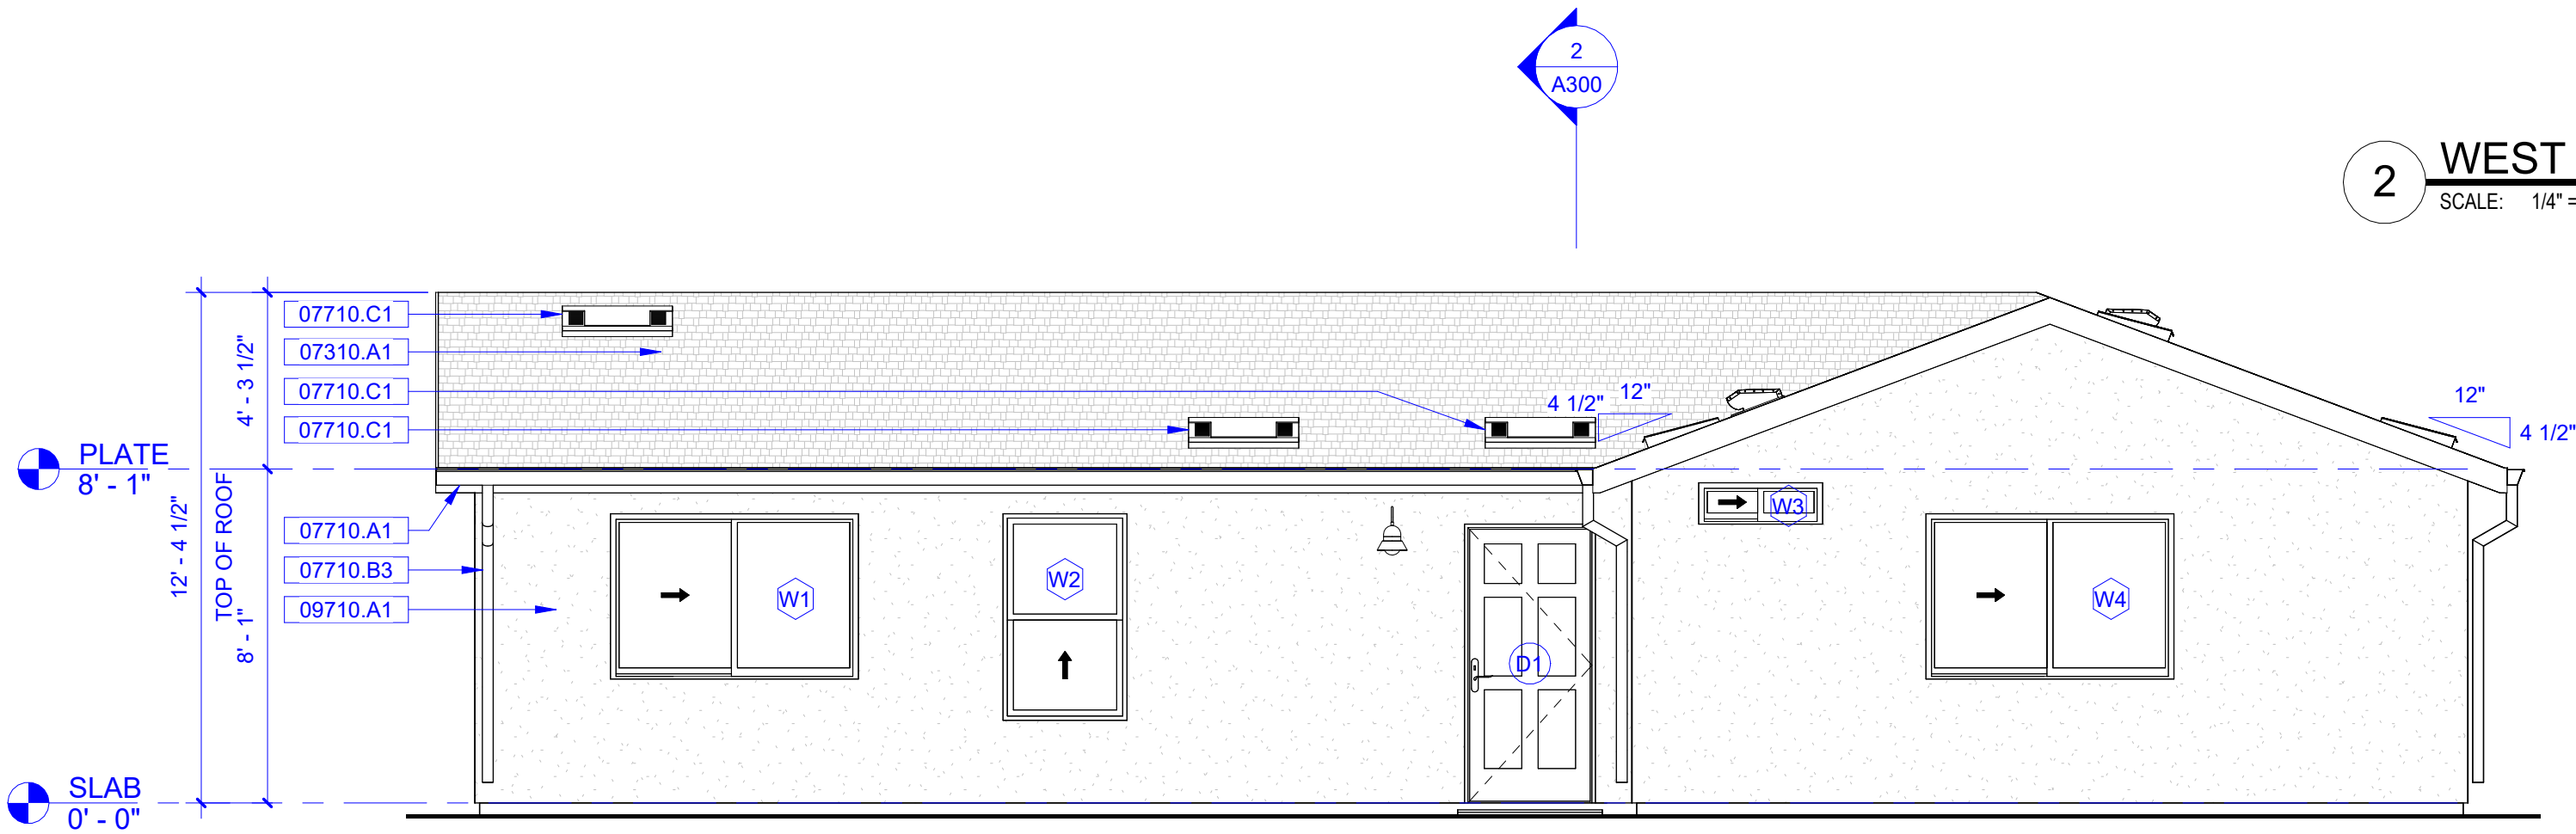

3 SOUTH ELEVATION - STUCCO
SCALE: 1/4" = 1'-0"

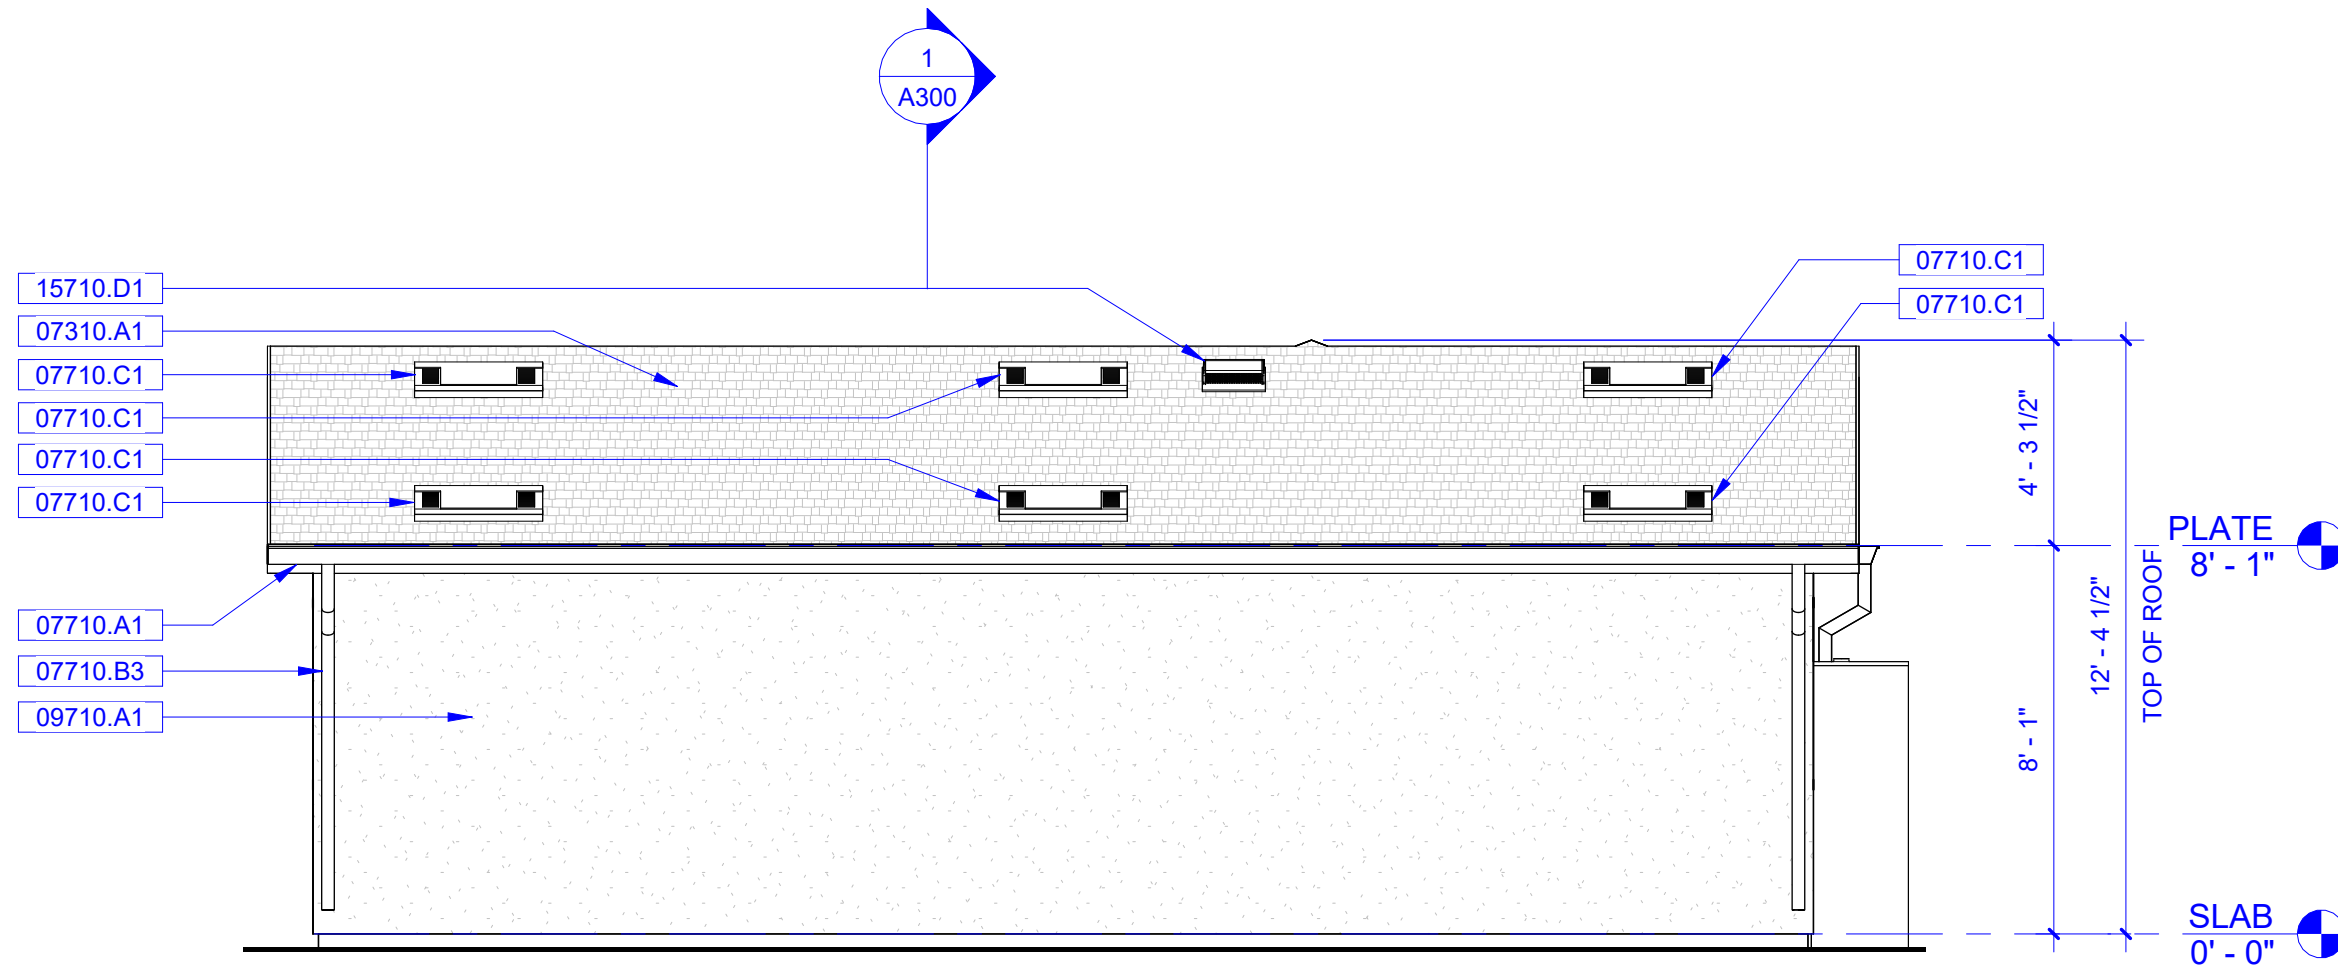

4 EAST ELEVATION - STUCCO
SCALE: 1/4" = 1'-0"

KEYNOTES:

KEYNOTE	DESCRIPTION
07310.A1	ROOFING MATERIAL PER CHECKLIST ON SHEET G102
07710.A1	GUTTER
07710.B3	DOWNSPOUT
07710.C1	O'HAGIN STANDARD LOW PROFILE ATTIC VENTS, 0.68 SF NFVA
09710.A1	STUCCO FINISH, COLOR TBD
15710.D1	DRYER EXHAUST ROOF EXHAUST VENT
15710.D2	RANGE HOOD ROOF EXHAUST VENT
15710.D3	BATH EXHAUST FAN ROOF VENT



SNAPADU
DESIGN HOUSE
YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 1,199 L-SHAPE
CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:
LUIS CALDERON
SnapADU

Luis Calderon
SIGNATURE

RELEASE	DATE	BY	APP.	RELEASED FOR...
A	03/22/2024	LAG		

GENERAL NOTES

- THE EXTERIOR ROOFING, TRIM, WALLS, WINDOWS, AND COLOR PALETTE OF THE ADU SHALL INCORPORATE THE SAME FEATURES AS THE MAIN DWELLING UNIT.
- THE TYPE, LOCATION, AND SIZE OF THE BUILDING ADDRESS IDENTIFICATION MUST BE CLEARLY VISIBLE AND LEGIBLE FROM THE ADJACENT PUBLIC WAY OR STREET. ADDRESS LETTERS/NUMBERS SHALL BE MINIMUM 4 INCHES HIGH, WITH A MINIMUM STROKE WIDTH OF 1/2 INCH, AND SHALL CONTRAST WITH THEIR BACKGROUND. CRC R319.1.

ELEVATIONS A -
STUCCO

A201

22040



YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 1,199 L-SHAPE

CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

ESIGNER:

LUIS CALDERON
SnapADU

SIGNATURE

[illegible]

ELEVATIONS A - STUCCO - OPTIONS

A202


2040

KEYNOTES:


KEYNOTE	DESCRIPTION
07310.A1	ROOFING MATERIAL PER CHECKLIST ON SHEET G102
07710.A1	GUTTER
07710.B3	DOWNSPOUT
07710.C1	OHAGIN STANDARD LOW PROFILE ATTIC VENTS, 0.68 SF NFVA
15710.D2	RANGE HOOD ROOF EXHAUST VENT
15710.D3	BATH EXHAUST FAN ROOF VENT

GENERAL NOTES


1. THE EXTERIOR ROOFING, TRIM, WALLS, WINDOWS, AND COLOR PALETTE OF THE ADU SHALL INCORPORATE THE SAME FEATURES AS THE MAIN DWELLING UNIT.
2. THE TYPE, LOCATION, AND SIZE OF THE BUILDING ADDRESS IDENTIFICATION MUST BE CLEARLY VISIBLE AND LEGIBLE FROM THE ADJACENT PUBLIC WAY OR STREET. ADDRESS LETTERS/NUMBERS SHALL BE MINIMUM 4 INCHES HIGH, WITH A MINIMUM STROKE WIDTH OF 1/2 INCH, AND SHALL CONTRAST WITH THEIR BACKGROUND. CRC R319.1.

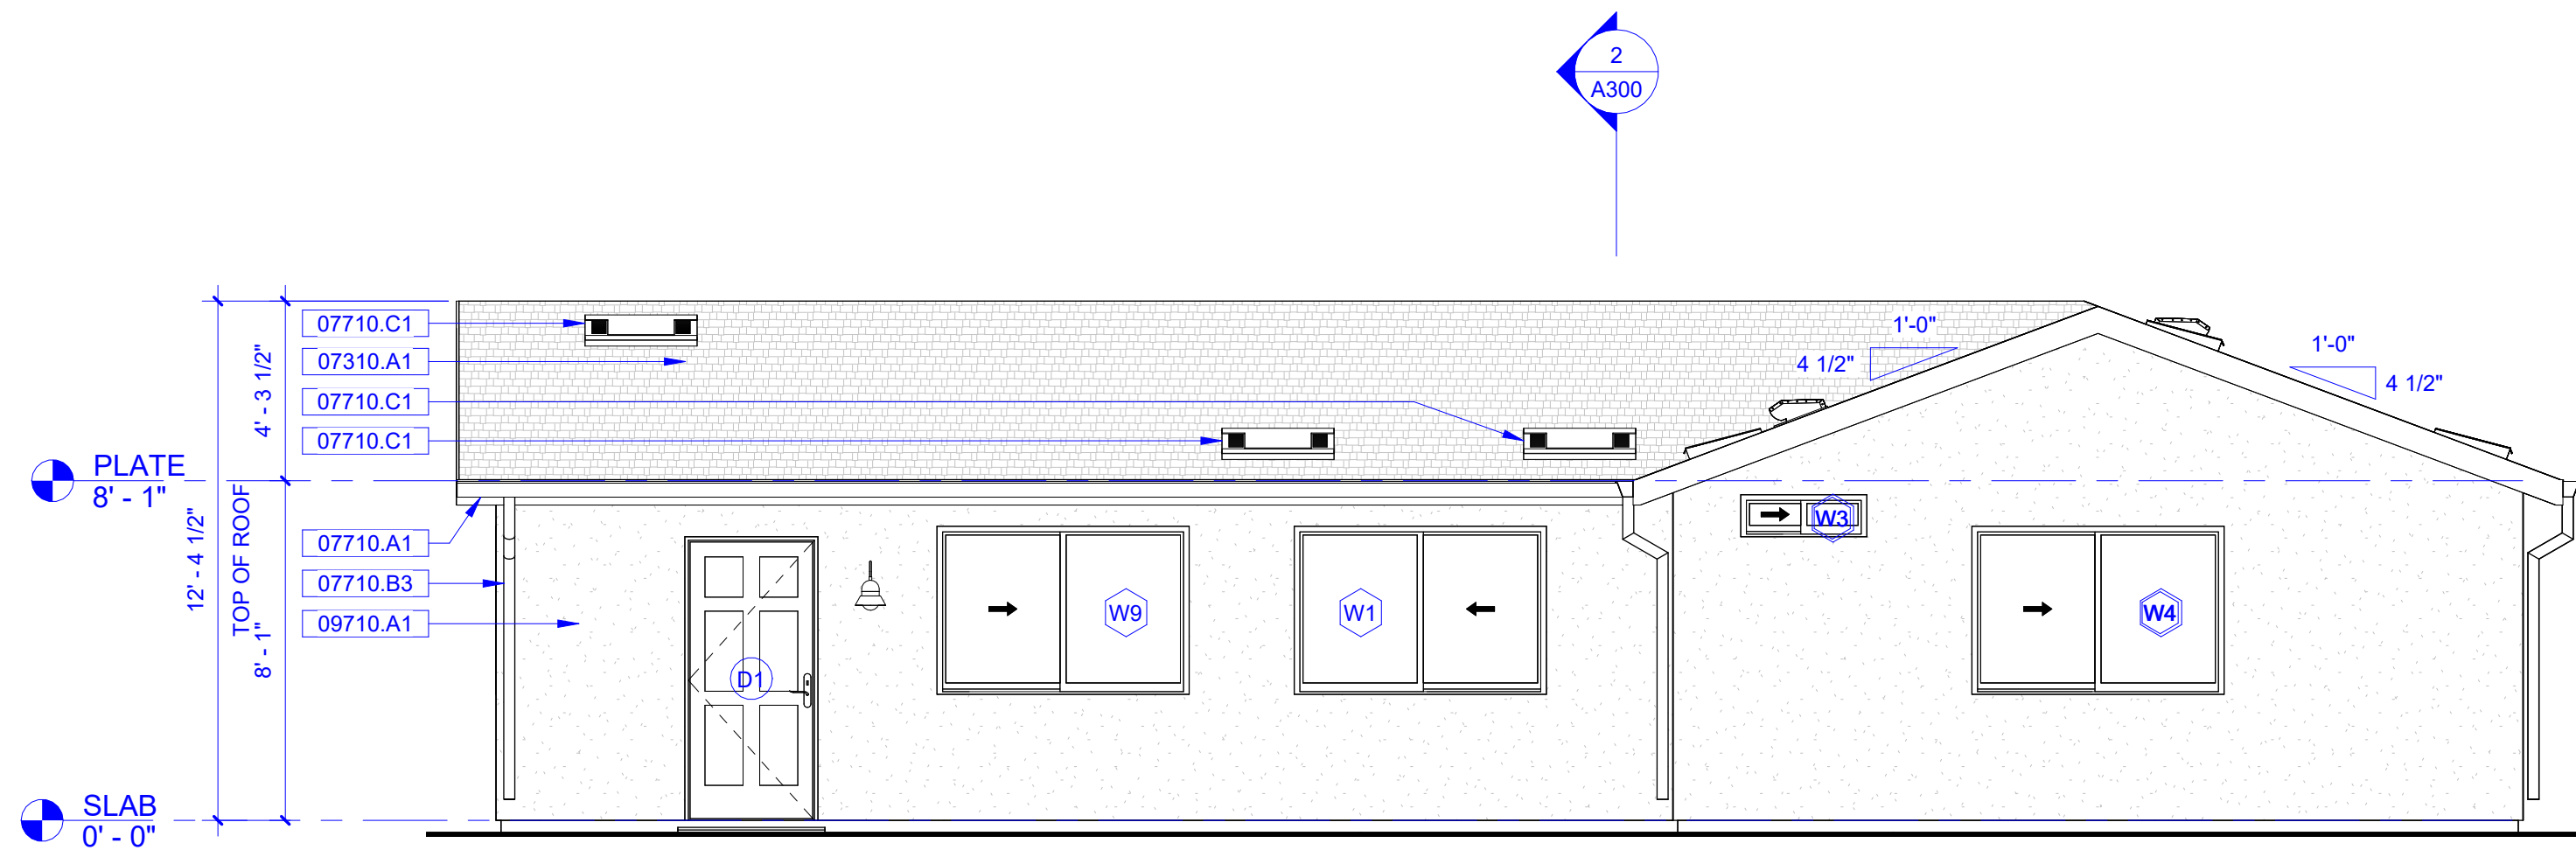


1 SOUTH ELEVATION - STUCCO - 2-BEDROOM
SCALE: 1/4" = 1'-0"

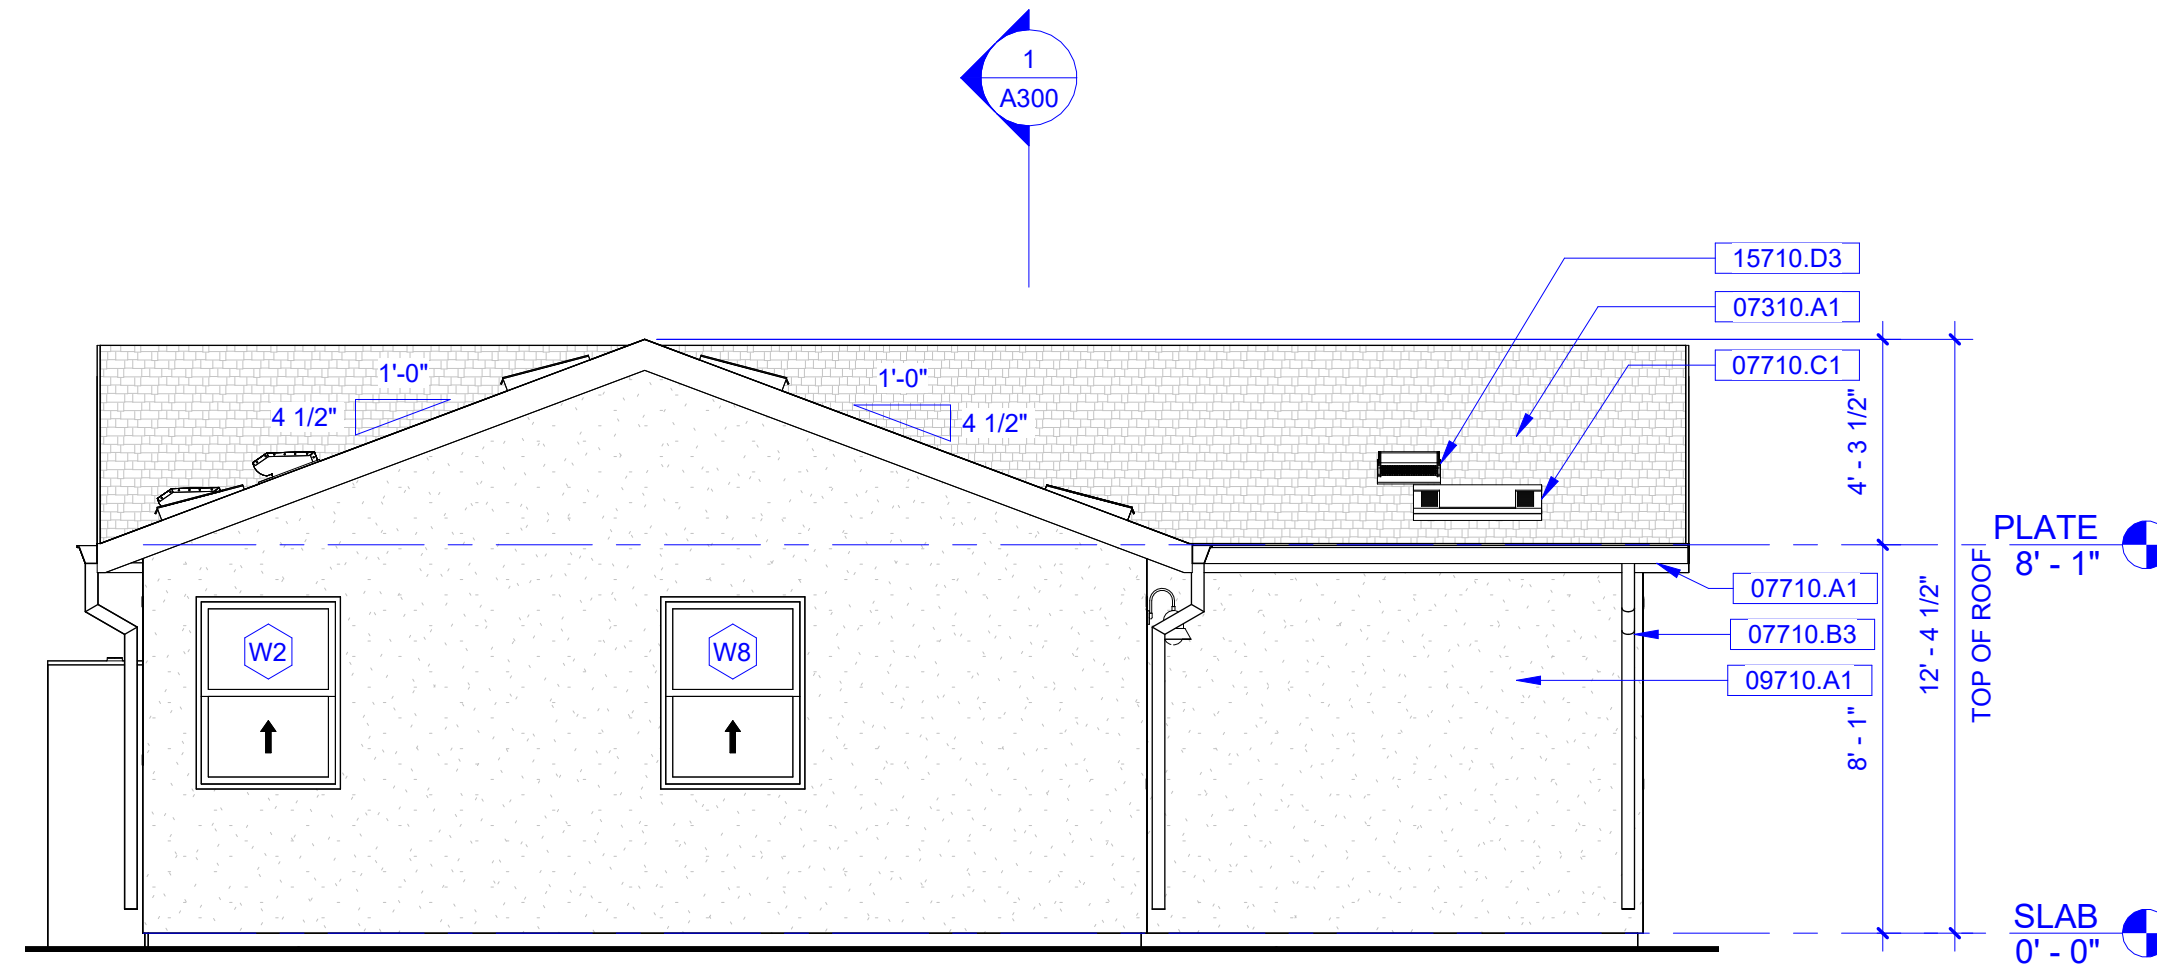


2 WEST ELEVATION - STUCCO - 2-BEDROOM
SCALE: 1/4" = 1'-0"

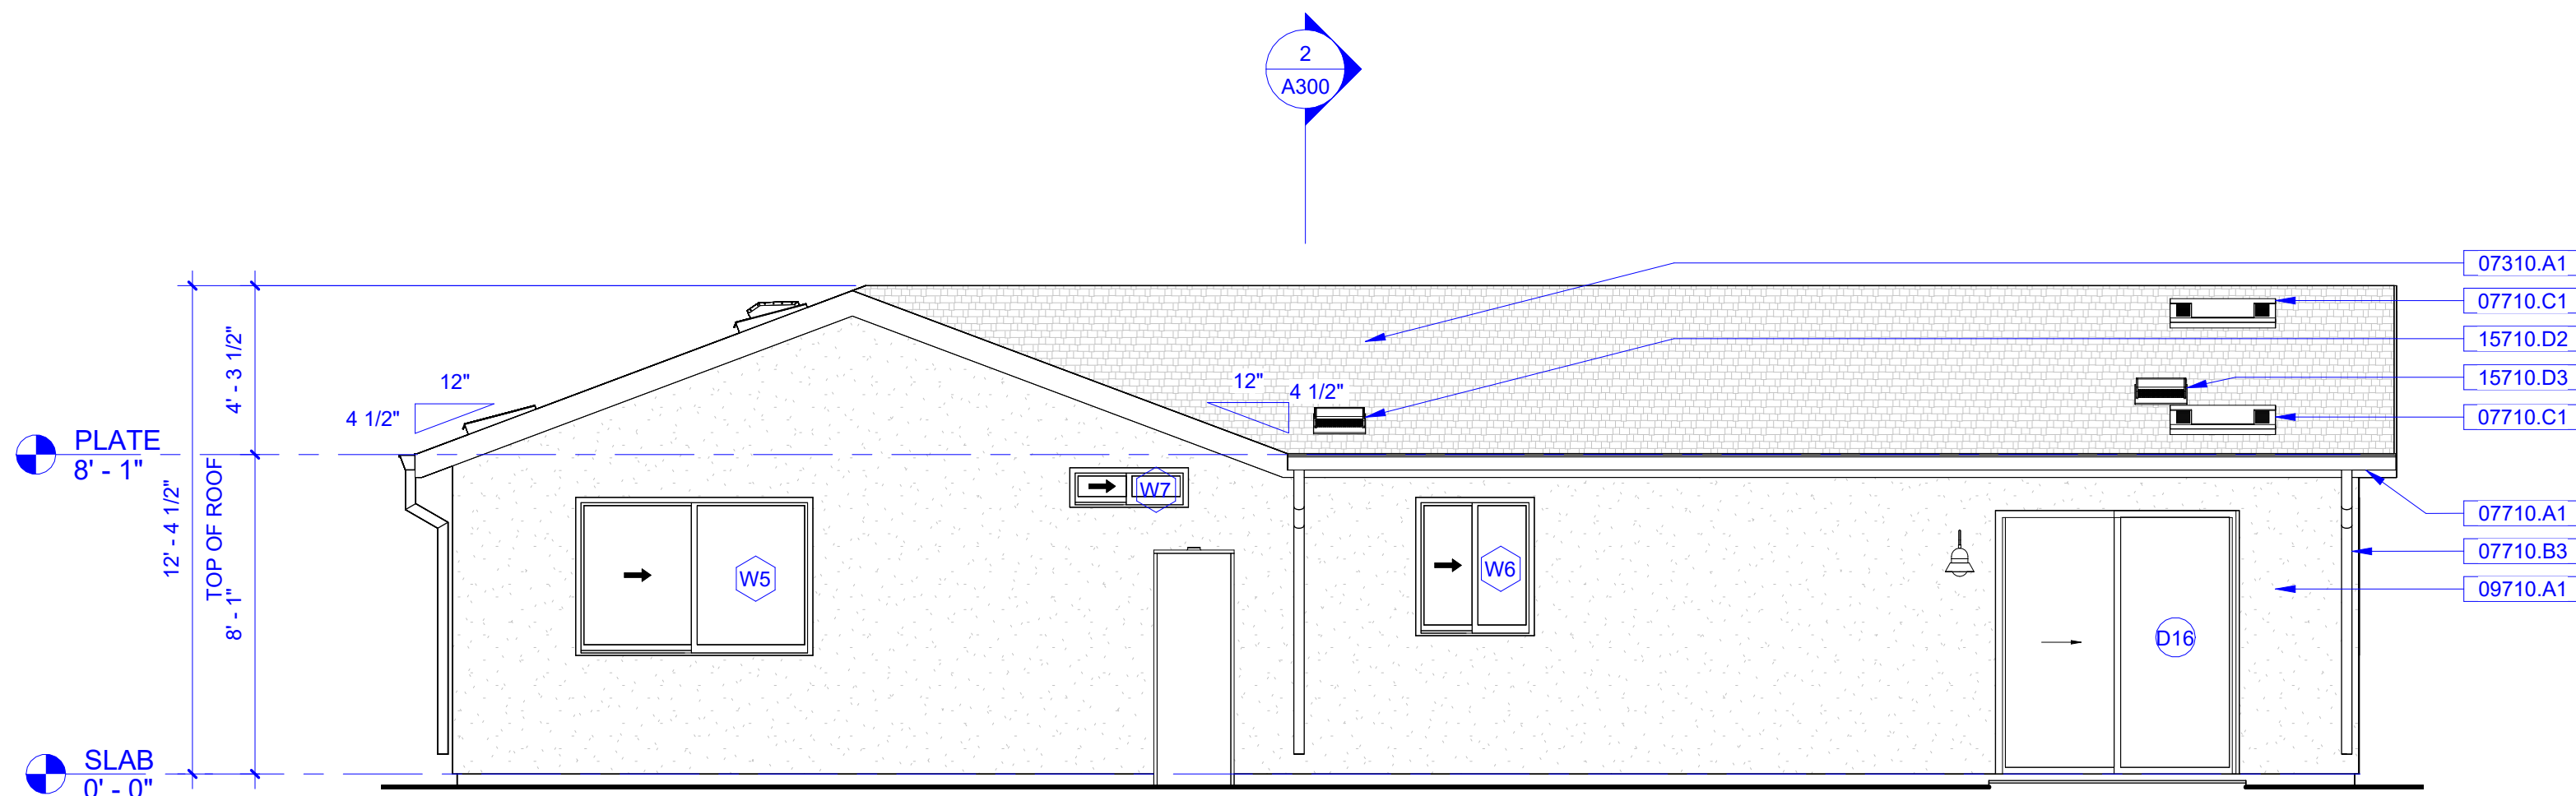


3 NORTH ELEVATION - STUCCO - 6068 SLIDING GLASS DOOR
SCALE: 1/4" = 1'-0"

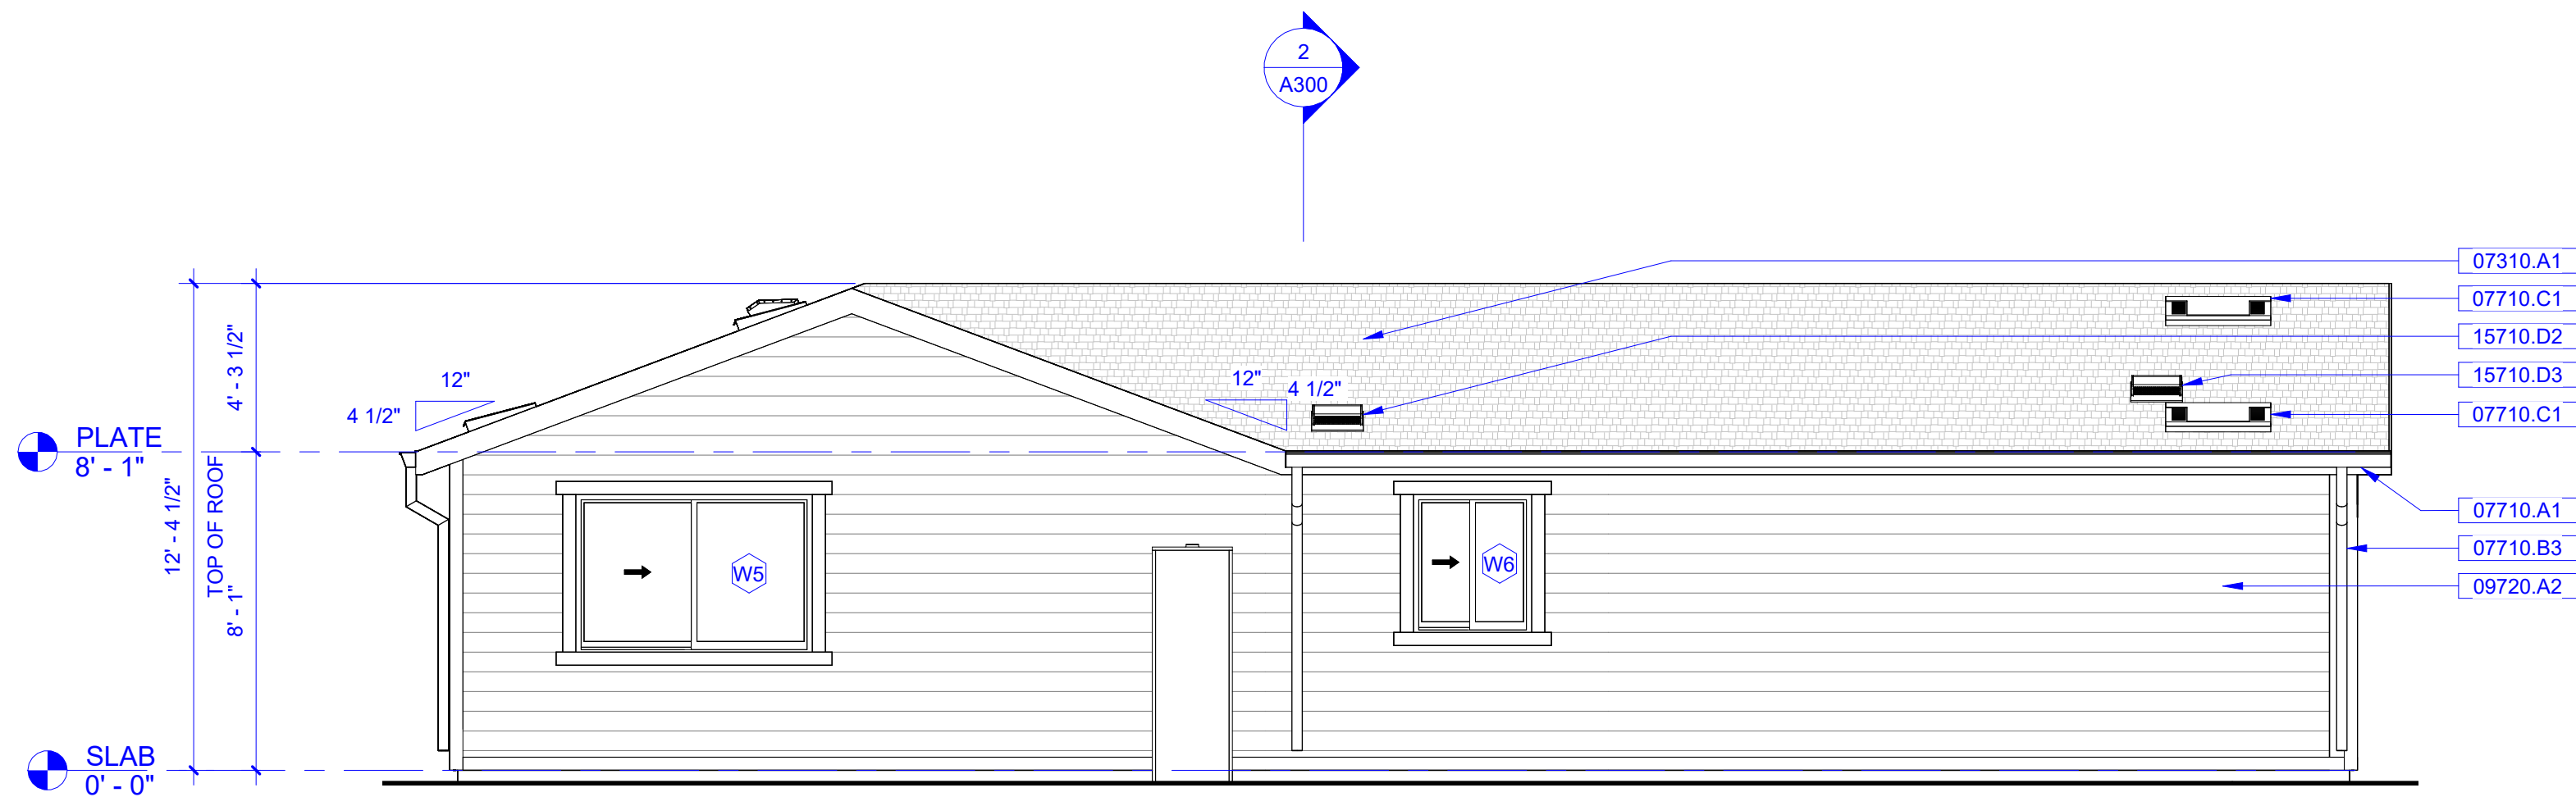


1 NORTH ELEVATION - LAP SIDING
SCALE: 1/4" = 1'-0"

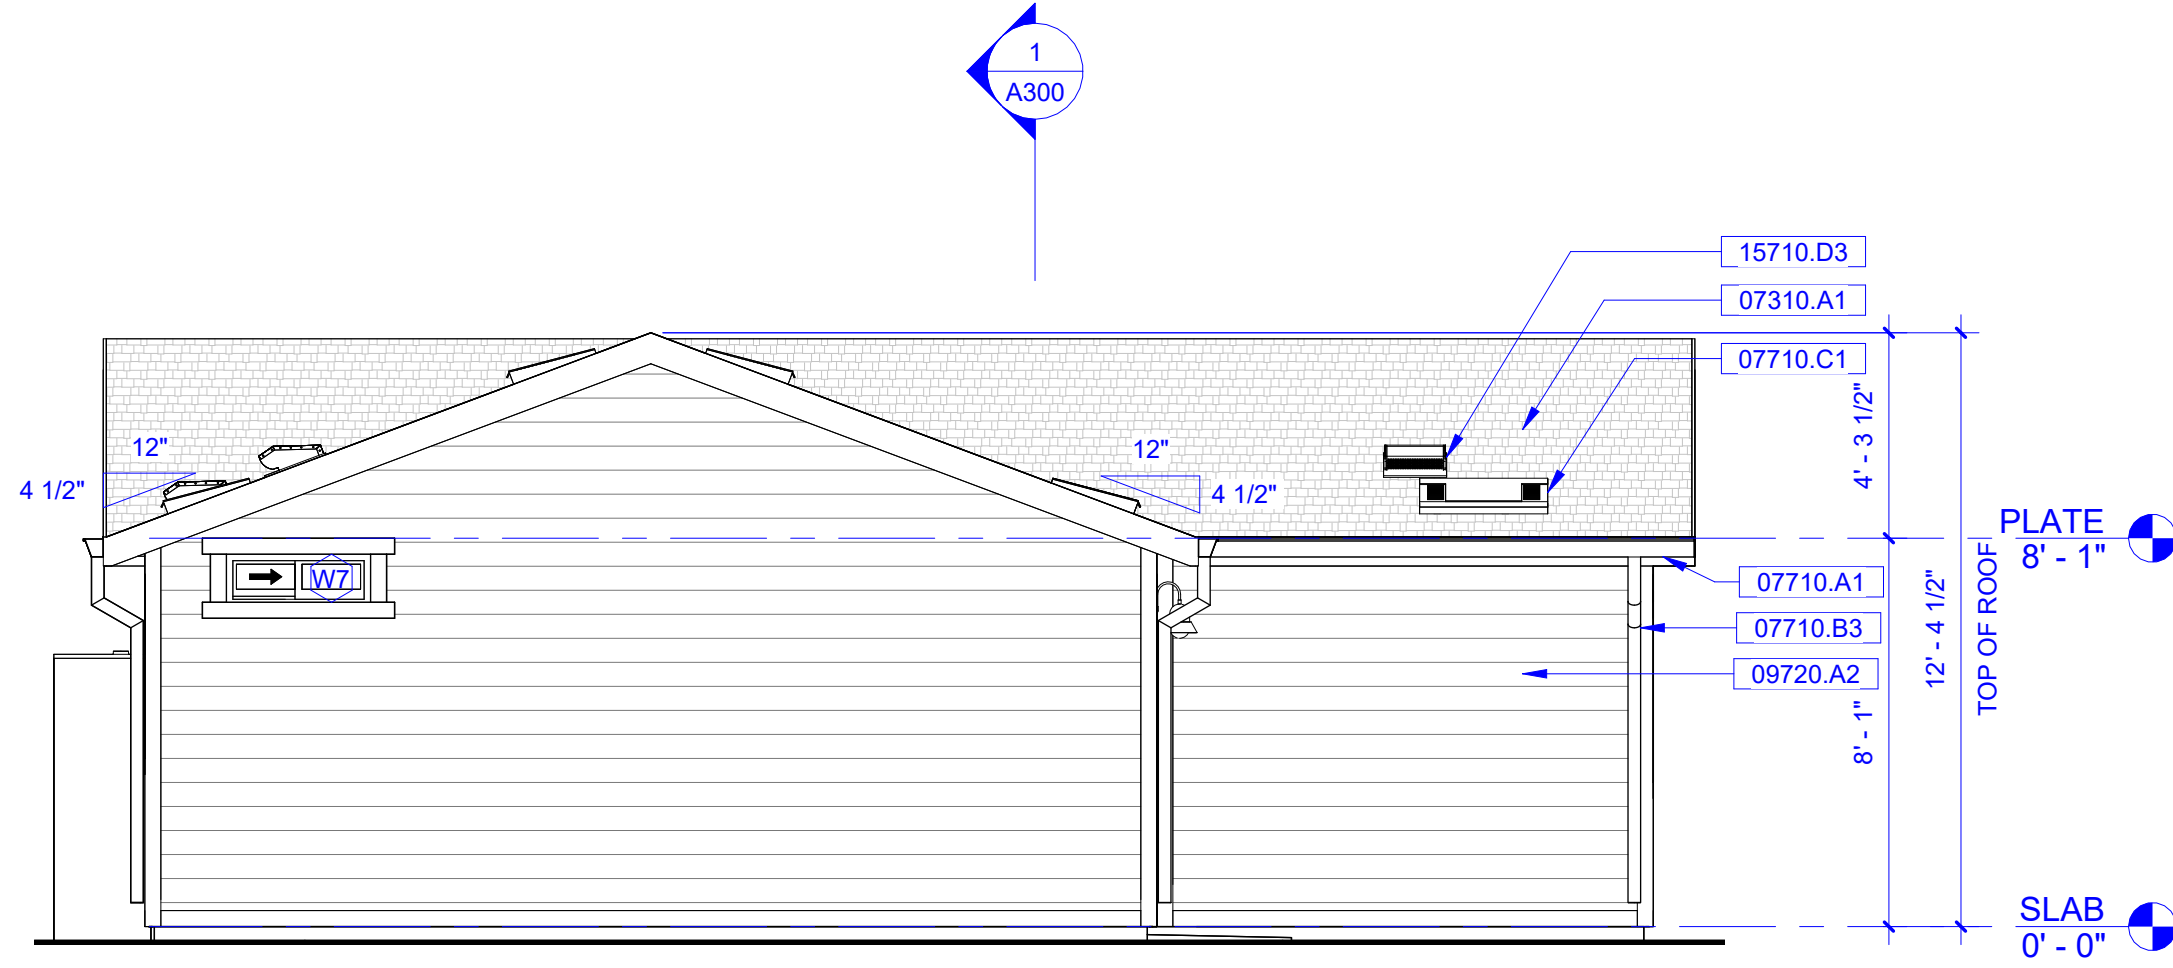

2 WEST ELEVATION - LAP SIDING
SCALE: 1/4" = 1'-0"

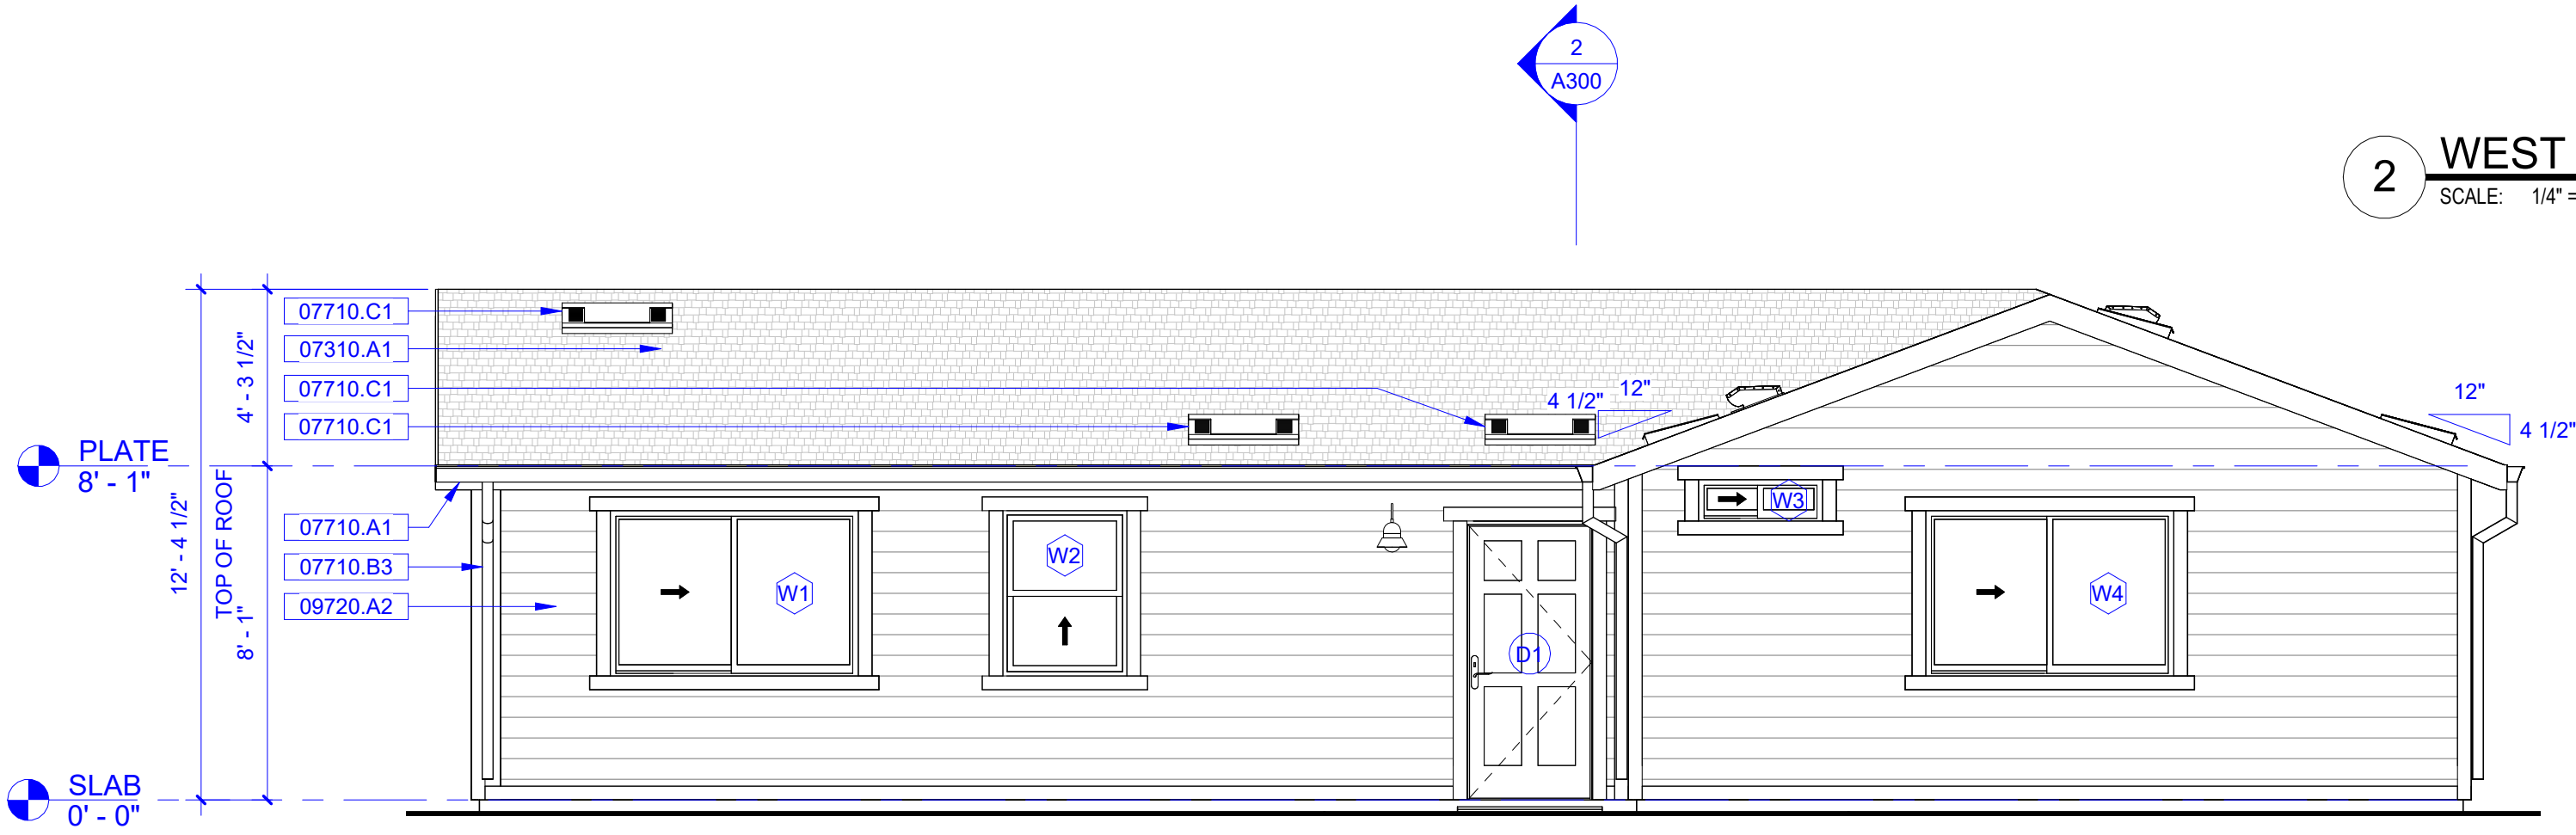

3 SOUTH ELEVATION - LAP SIDING
SCALE: 1/4" = 1'-0"

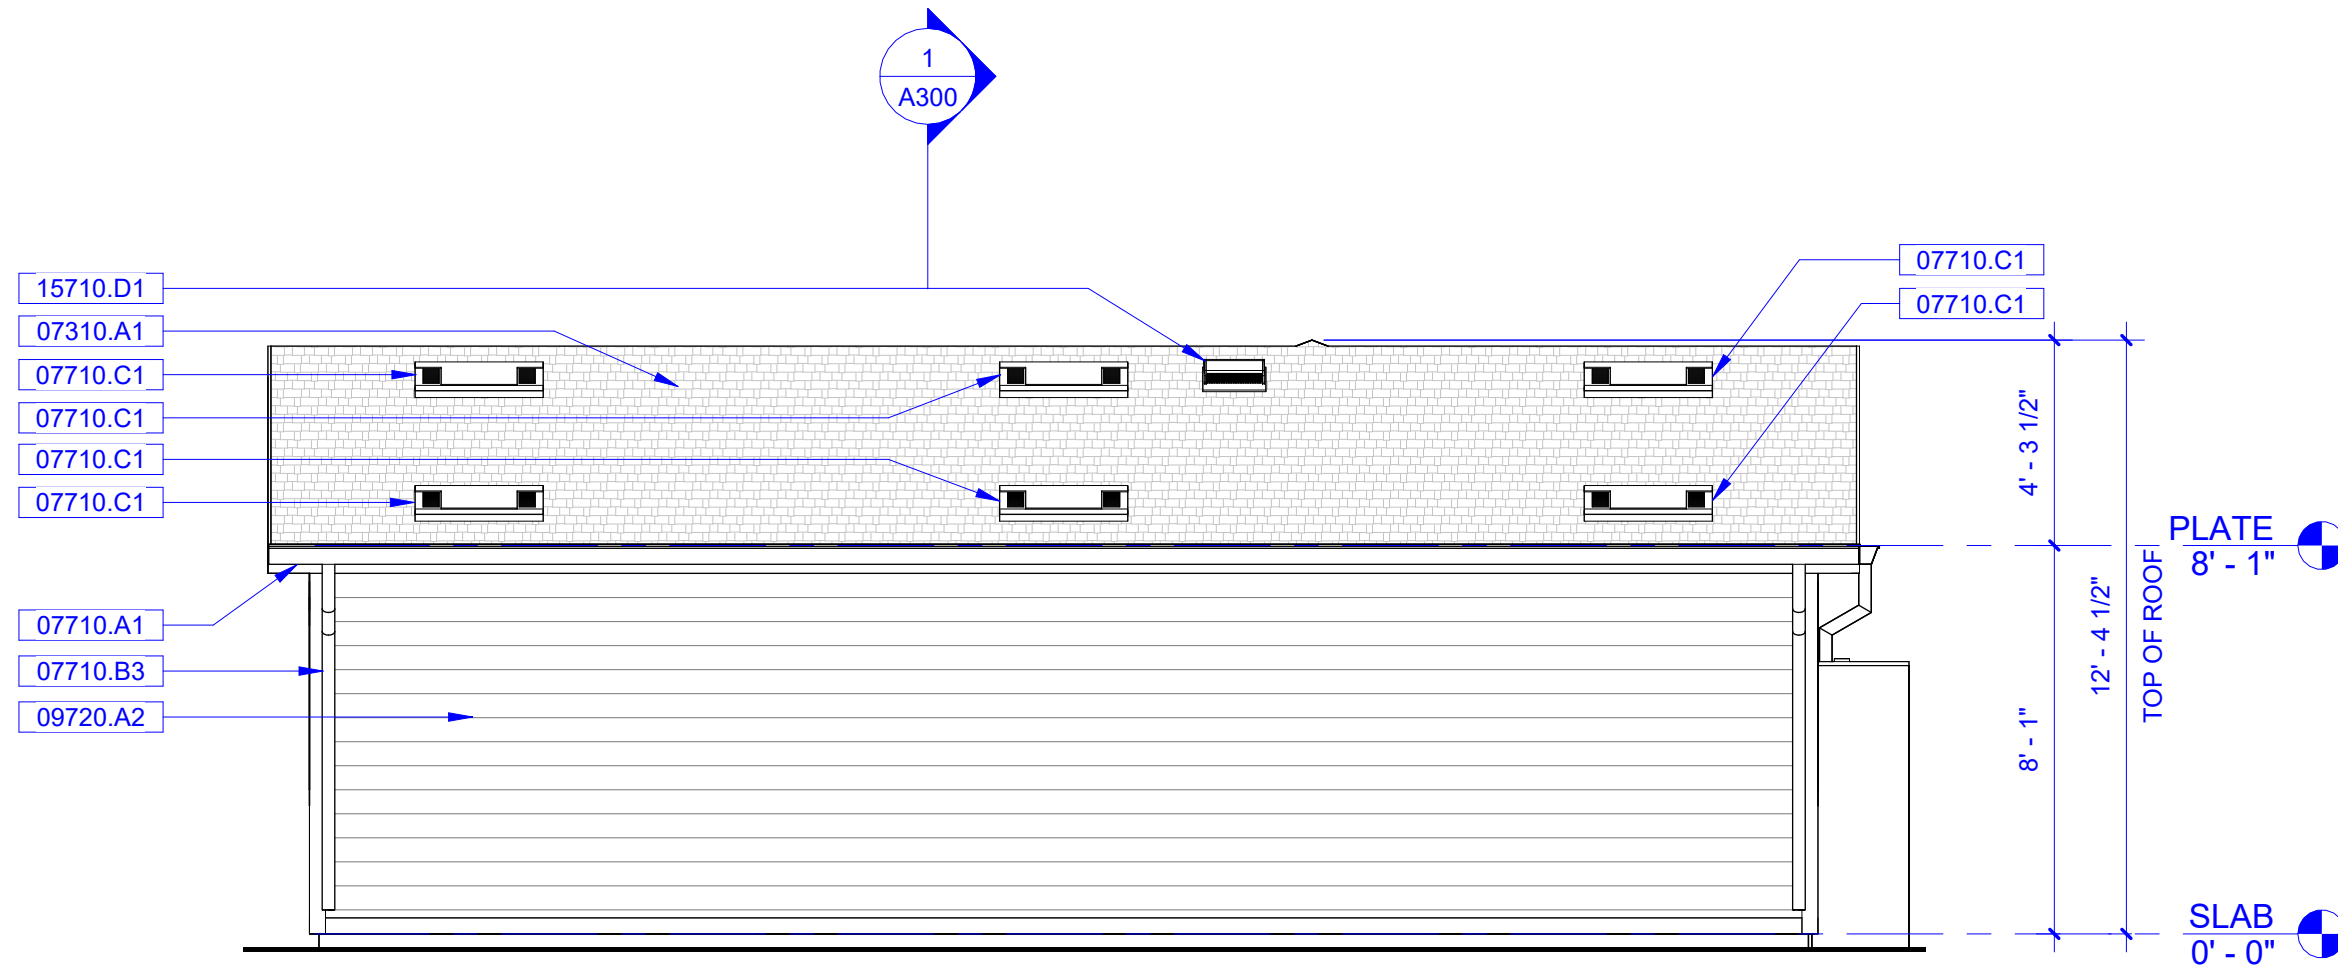

4 EAST ELEVATION - LAP SIDING
SCALE: 1/4" = 1'-0"

KEYNOTES:

KEYNOTE	DESCRIPTION
07310.A1	ROOFING MATERIAL PER CHECKLIST ON SHEET G102
07710.A1	GUTTER
07710.B3	DOWNSPOUT
07710.C1	O'HAGIN STANDARD LOW PROFILE ATTIC VENTS, 0.68 SF NFVA
09720.A2	FIBER CEMENT WALL LAP SIDING 'HARDIEPLANK' ESR-2290 OR SIMILAR, COLOR TBD TO MATCH MAIN RESIDENCE
15710.D1	DRYER EXHAUST ROOF EXHAUST VENT
15710.D2	RANGE HOOD ROOF EXHAUST VENT
15710.D3	BATH EXHAUST FAN ROOF VENT



SNAPADU
DESIGN HOUSE
YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 1,199 L-SHAPE
CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:
LUIS CALDERON
SnapADU

Luis Calderon
SIGNATURE

RELEASE	DATE	BY	APP.	RELEASED FOR...
A	03/22/2024	LAG		


GENERAL NOTES

- THE EXTERIOR ROOFING, TRIM, WALLS, WINDOWS, AND COLOR PALETTE OF THE ADU SHALL INCORPORATE THE SAME FEATURES AS THE MAIN DWELLING UNIT.
- THE TYPE, LOCATION, AND SIZE OF THE BUILDING ADDRESS IDENTIFICATION MUST BE CLEARLY VISIBLE AND LEGIBLE FROM THE ADJACENT PUBLIC WAY OR STREET. ADDRESS LETTERS/NUMBERS SHALL BE MINIMUM 4 INCHES HIGH, WITH A MINIMUM STROKE WIDTH OF 1/2 INCH, AND SHALL CONTRAST WITH THEIR BACKGROUND. CRC R319.1.


ELEVATIONS B -
LAP SIDING

A211


22040

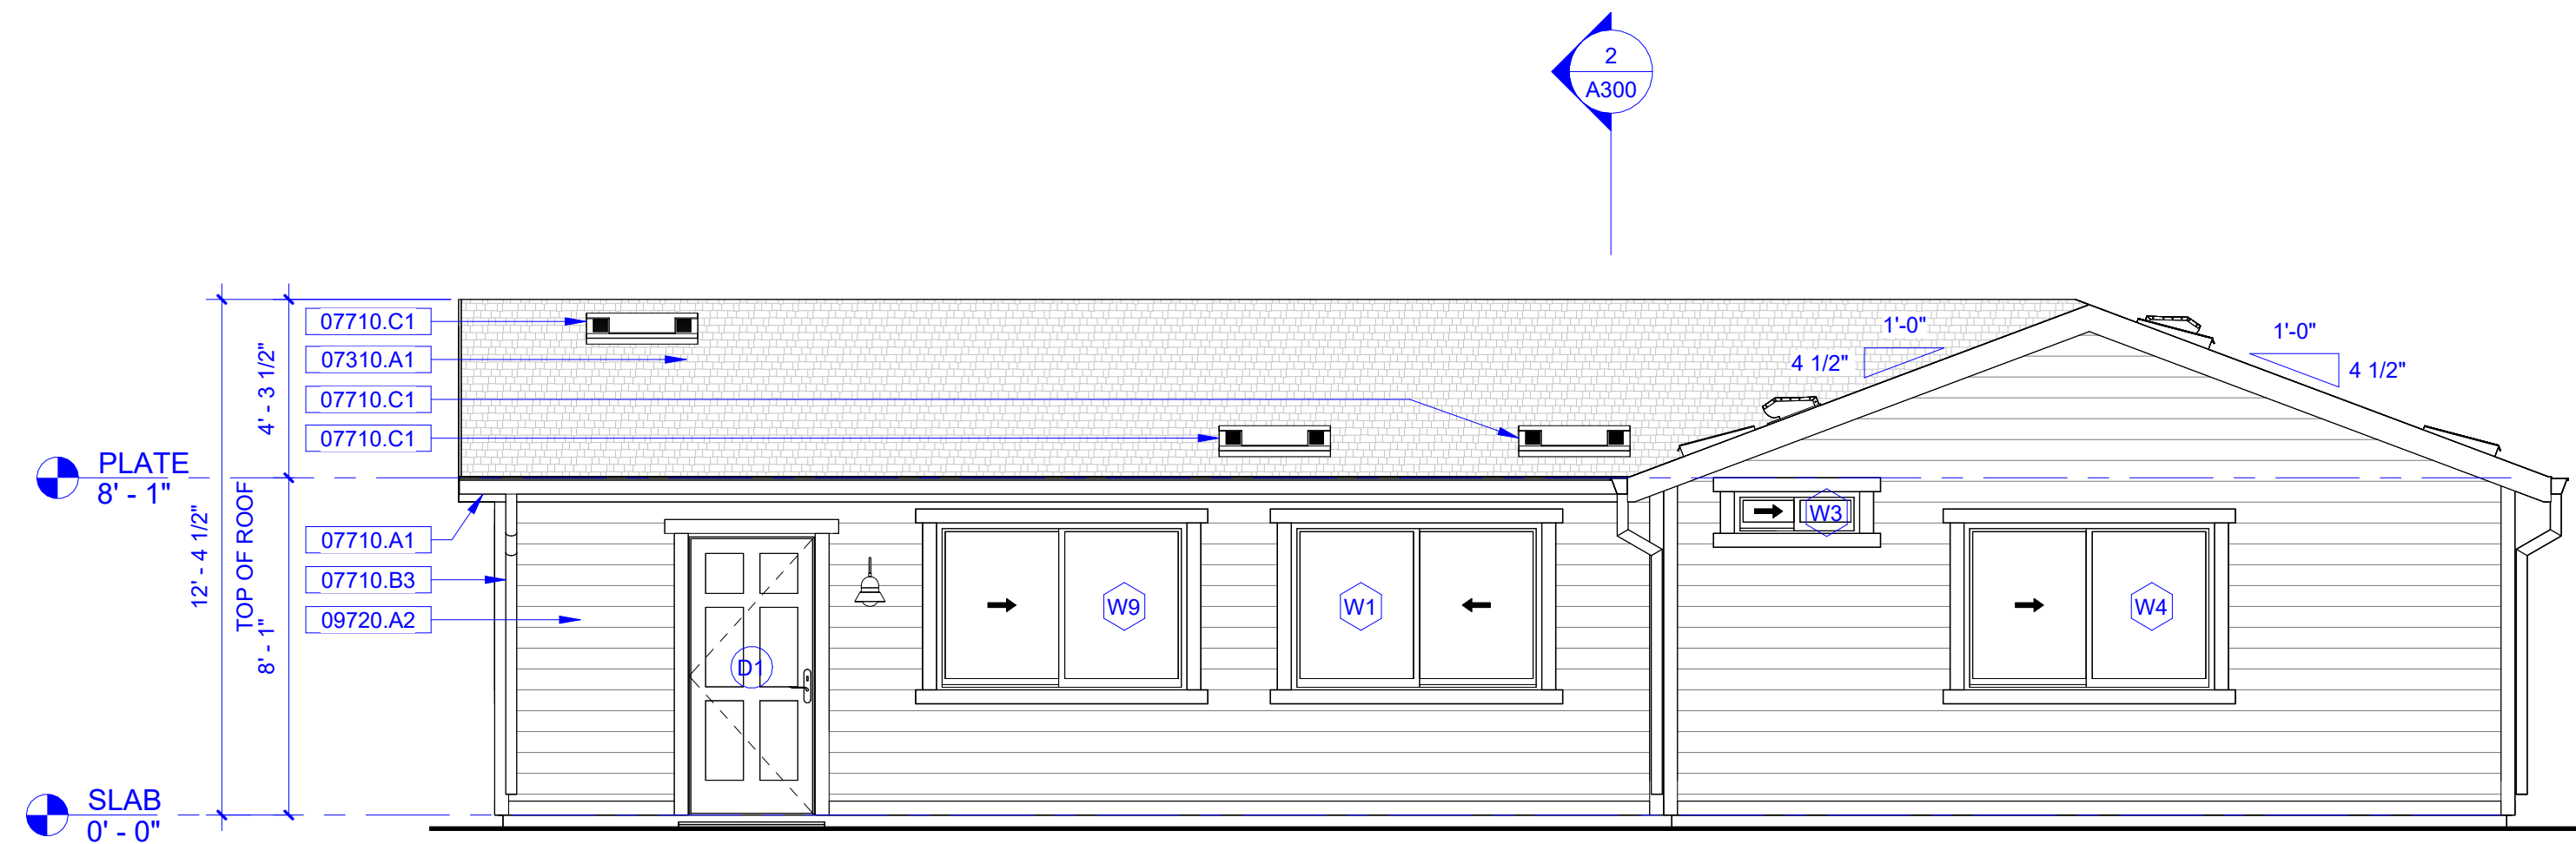

1 SOUTH ELEVATION - LAP SIDING - 2-BEDROOM
SCALE: 1/4" = 1'-0"

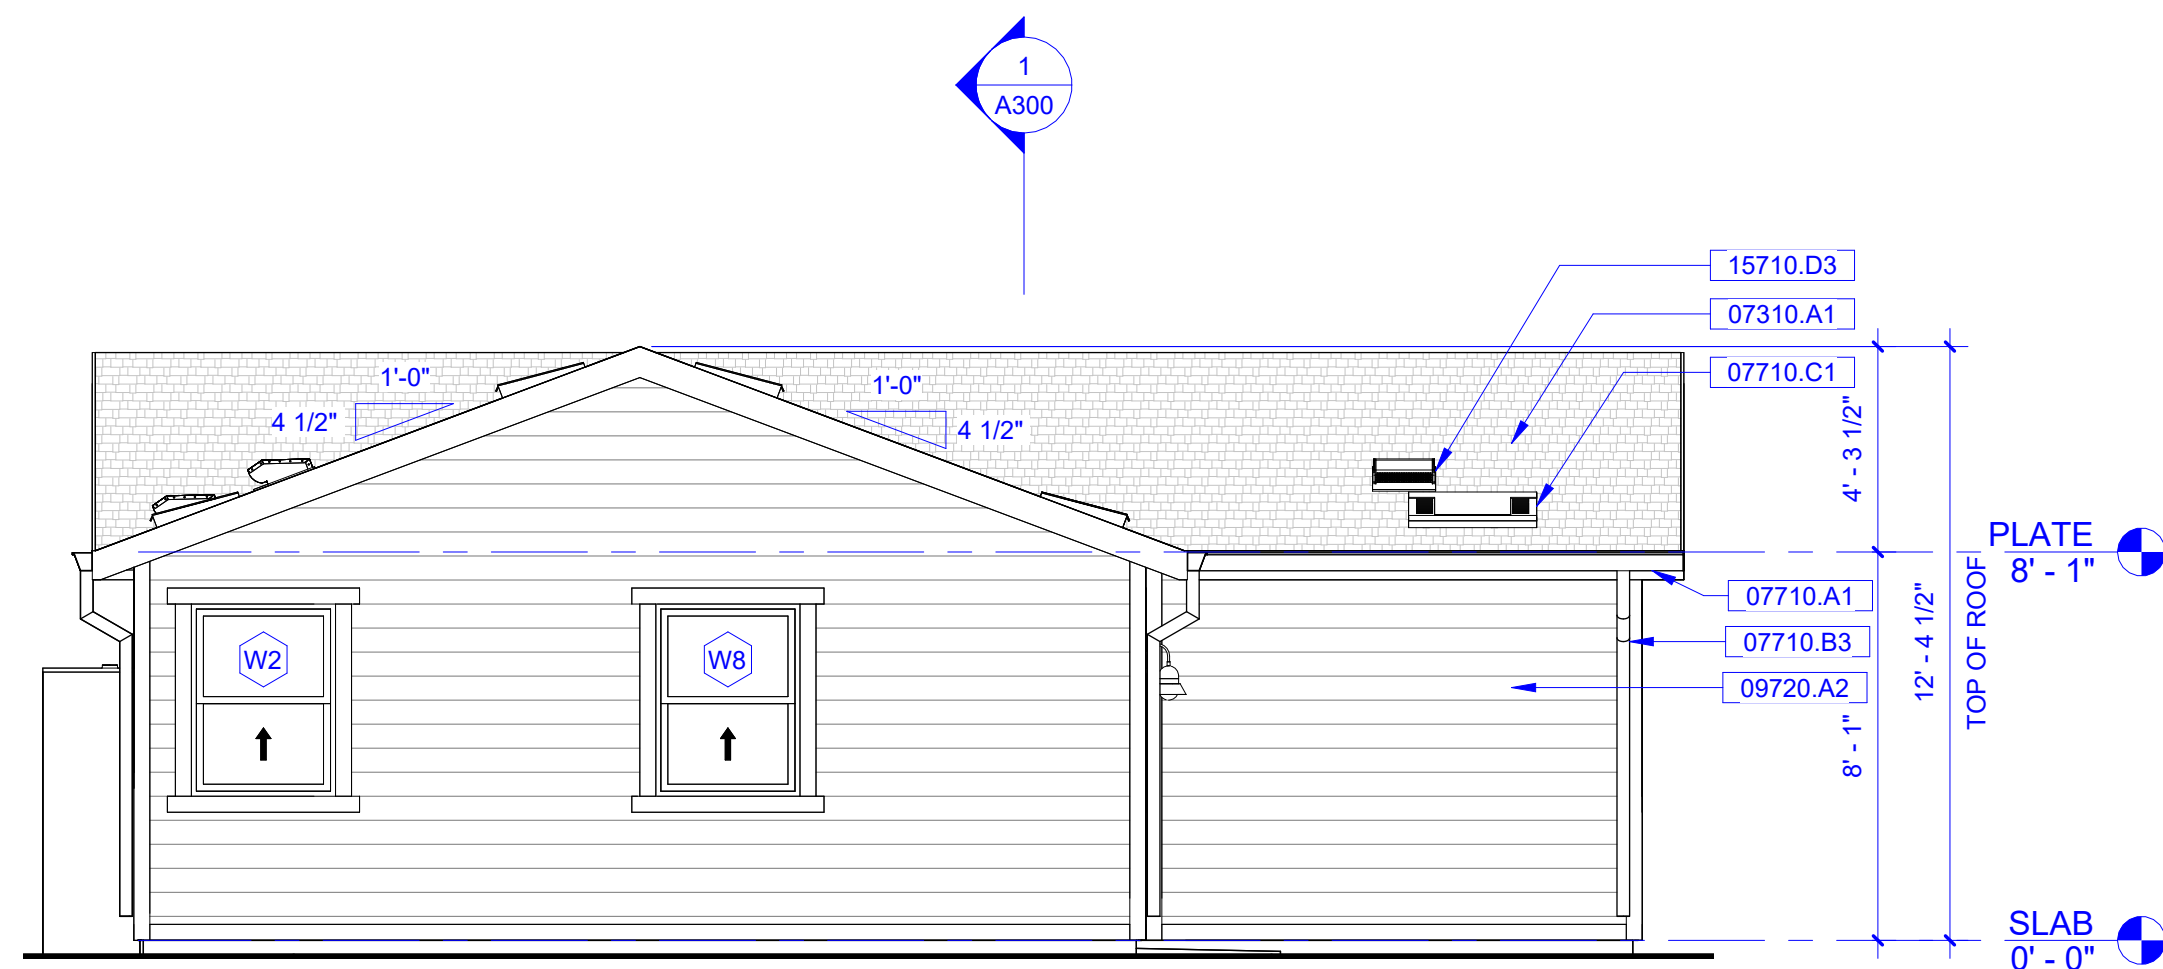

2 WEST ELEVATION - LAP SIDING - 2-BEDROOM
SCALE: 1/4" = 1'-0"

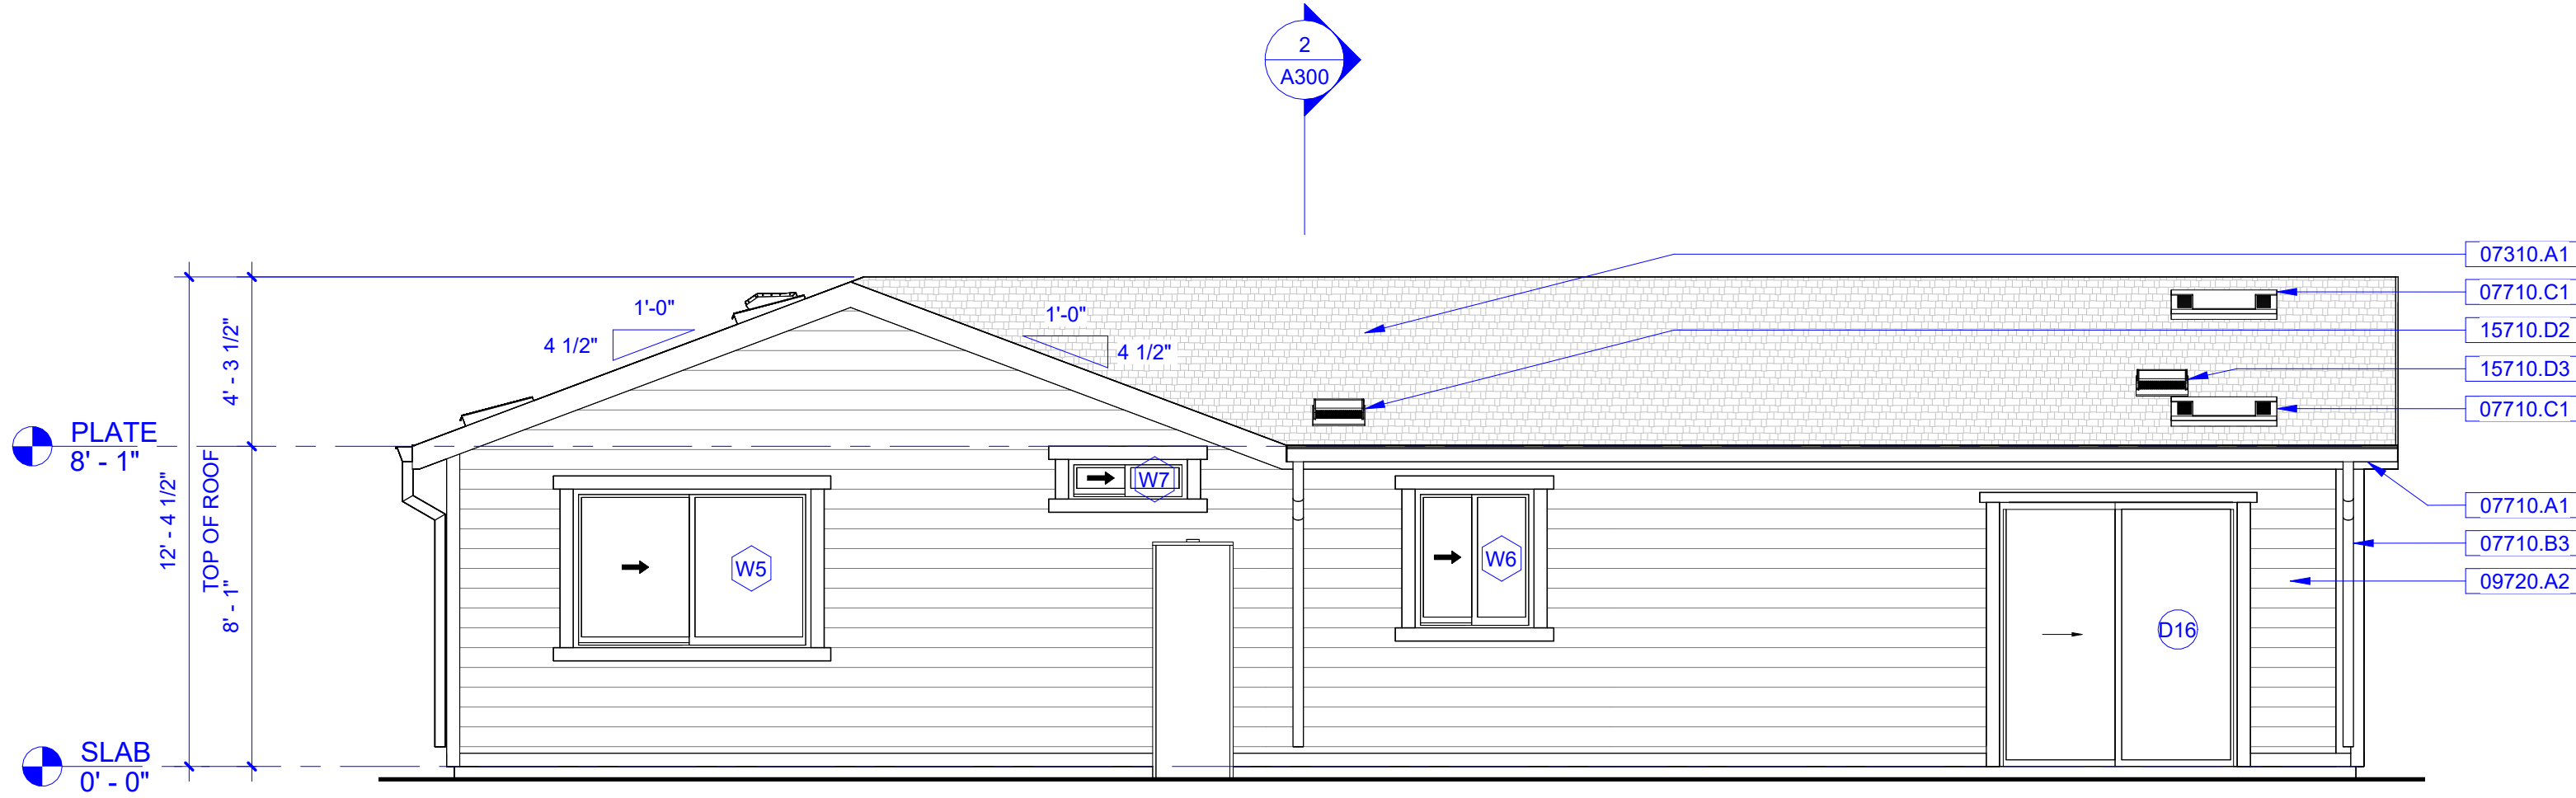

3 NORTH ELEVATION - LAP SIDING - 6068 SLIDING GLASS DOOR
SCALE: 1/4" = 1'-0"

KEYNOTES:

KEYNOTE	DESCRIPTION
07310.A1	ROOFING MATERIAL PER CHECKLIST ON SHEET G102
07710.A1	GUTTER
07710.B3	DOWNSPOUT
07710.C1	O'HAGIN STANDARD LOW PROFILE ATTIC VENTS, 0.68 SF NFVA
15710.D2	RANGE HOOD ROOF EXHAUST VENT
15710.D3	BATH EXHAUST FAN ROOF VENT



SNAPADU
DESIGN HOUSE

YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 1,199 L-SHAPE
CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:
LUIS CALDERON
SnapADU

SIGNATURE

RELEASE	DATE	BY	APP.	LAG	RELEASED FOR...
A	03/22/2024				

GENERAL NOTES


- THE EXTERIOR ROOFING, TRIM, WALLS, WINDOWS, AND COLOR PALETTE OF THE ADU SHALL INCORPORATE THE SAME FEATURES AS THE MAIN DWELLING UNIT.
- THE TYPE, LOCATION, AND SIZE OF THE BUILDING ADDRESS IDENTIFICATION MUST BE CLEARLY VISIBLE AND LEGIBLE FROM THE ADJACENT PUBLIC WAY OR STREET. ADDRESS LETTERS/NUMBERS SHALL BE MINIMUM 4 INCHES HIGH, WITH A MINIMUM STROKE WIDTH OF 1/2 INCH, AND SHALL CONTRAST WITH THEIR BACKGROUND. CRC R319.1.

ELEVATIONS B -
LAP SIDING -
OPTIONS


A212

22040


Autodesk Docs://22040_City of Chula Vista/22040_City of Chula Vista_1199 L-Shape_V2_CD_RVT22.rvt 3/23/2024 12:47:40 PM

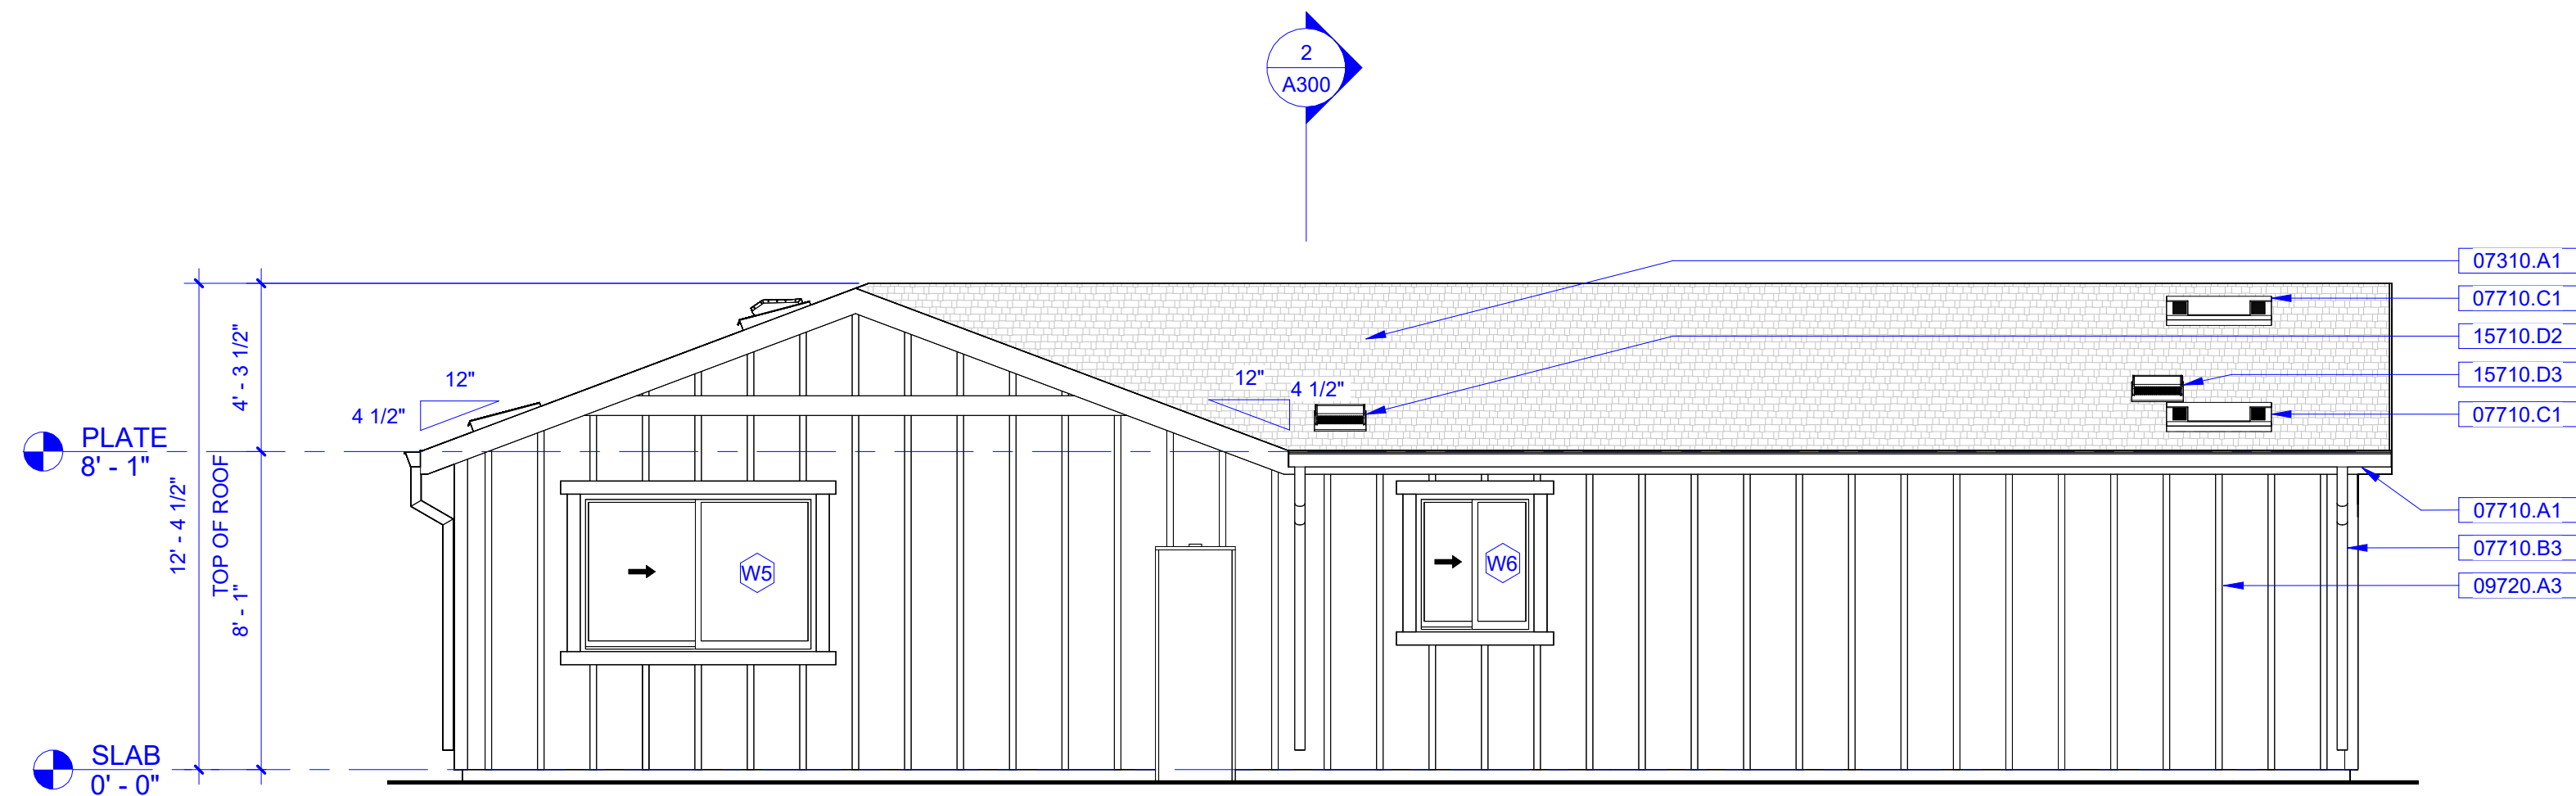


1 NORTH ELEVATION - BOARD AND BATTEN
SCALE: 1/4" = 1'-0"

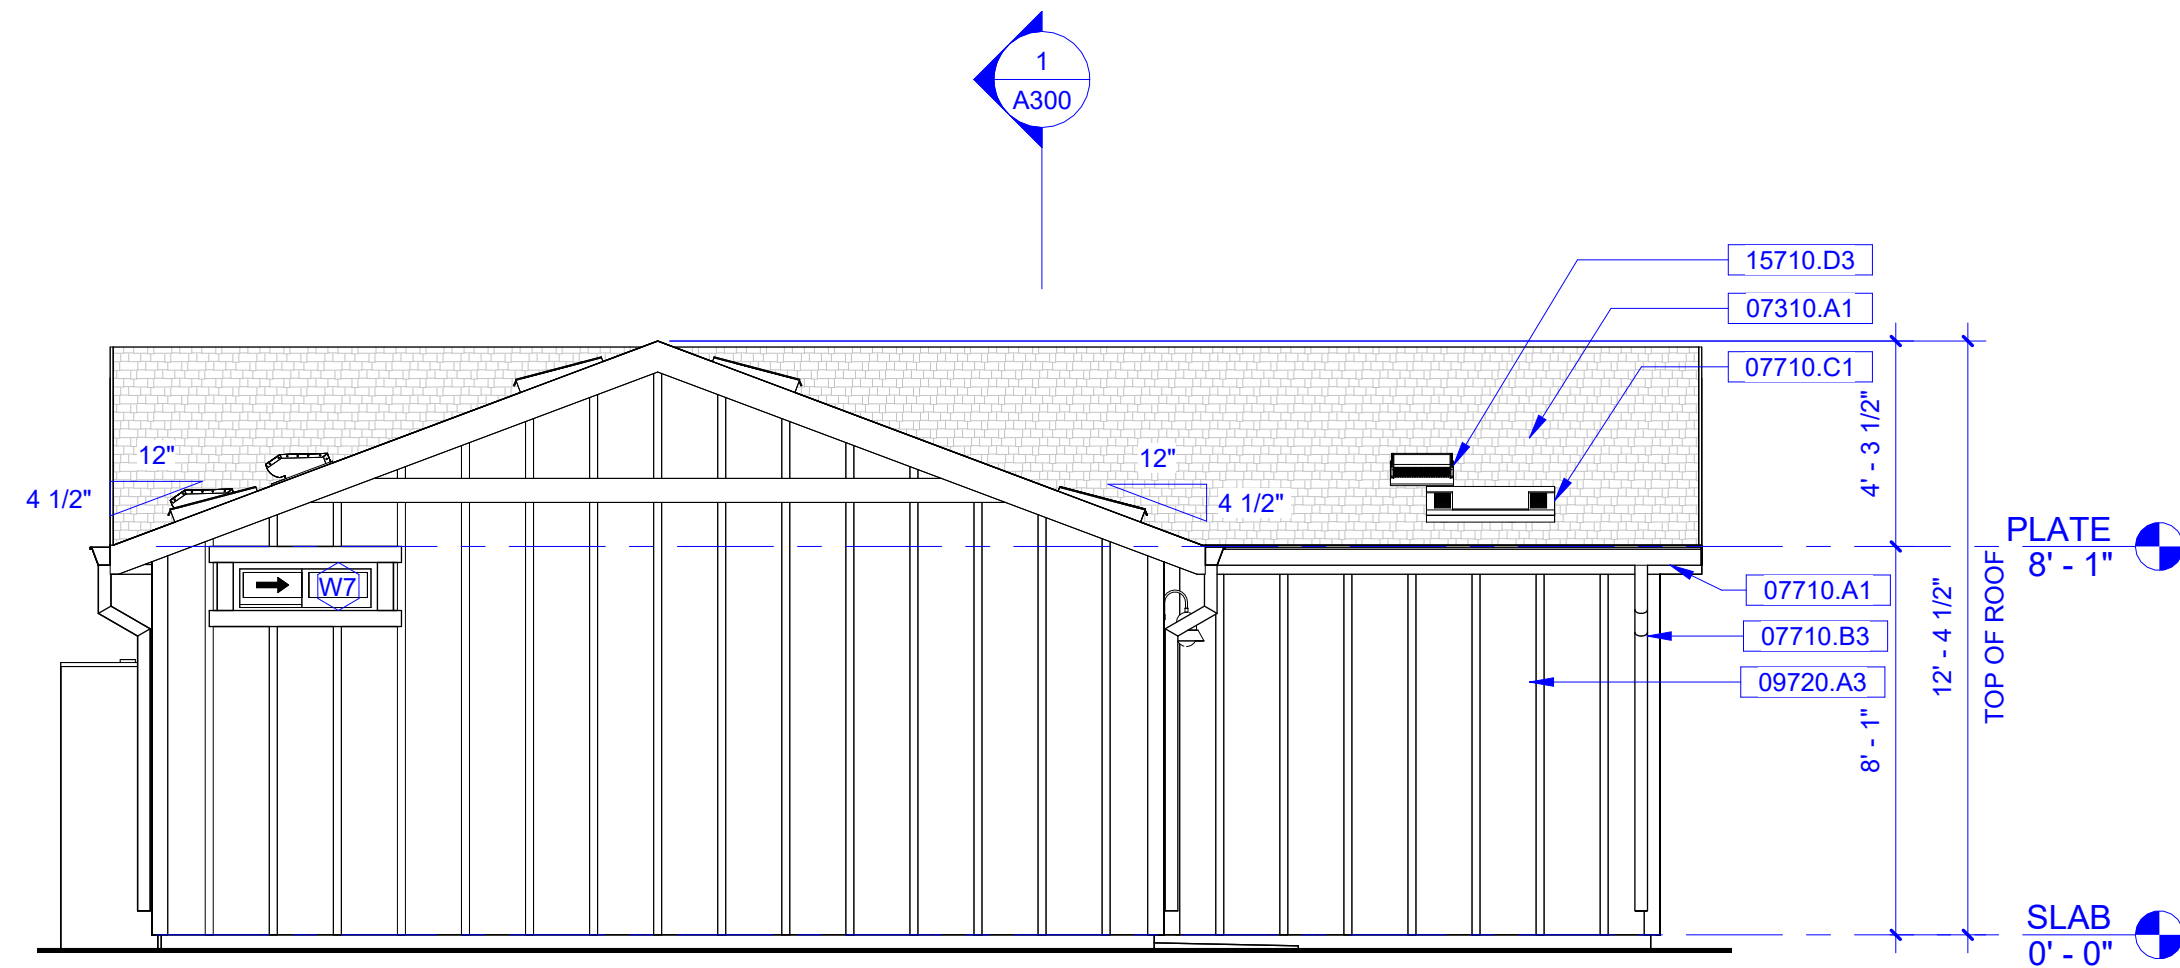

2 WEST ELEVATION - BOARD AND BATTEN
SCALE: 1/4" = 1'-0"

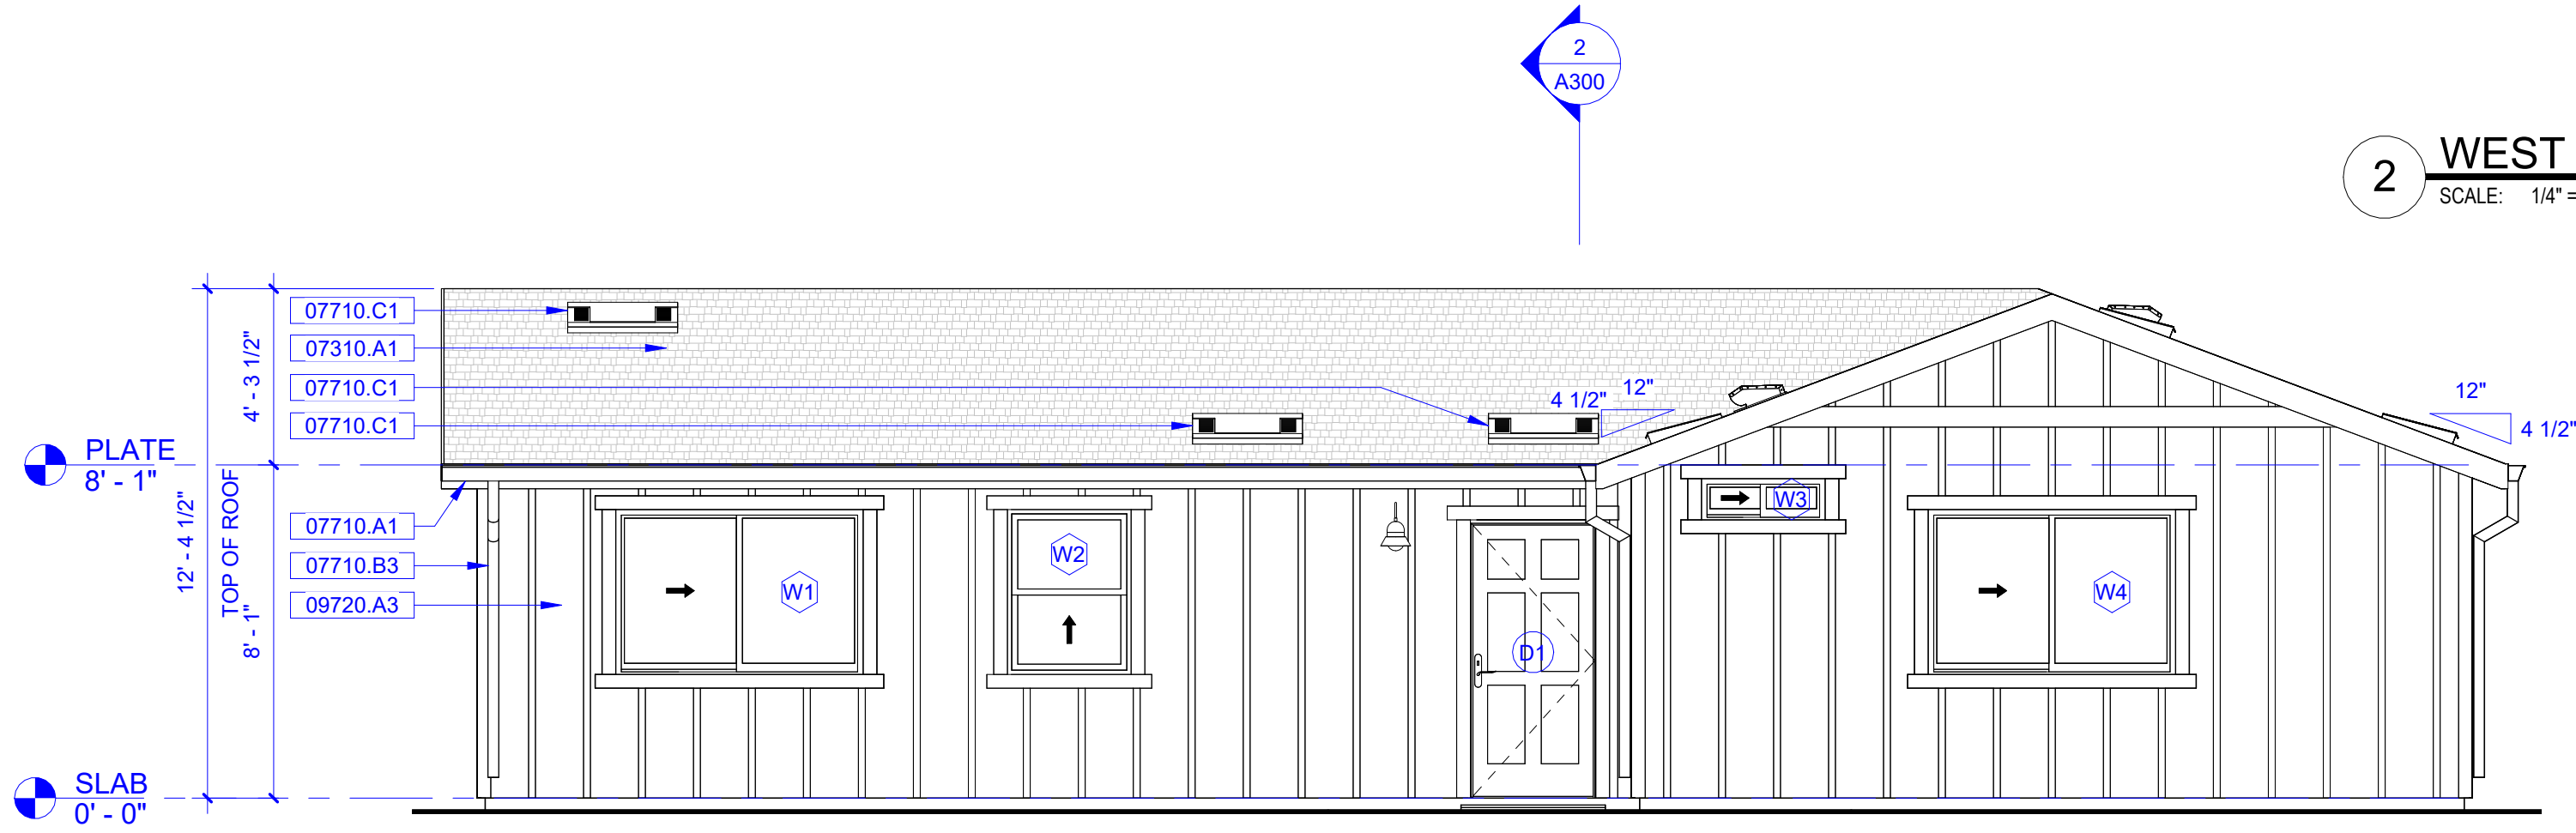

3 SOUTH ELEVATION - BOARD AND BATTEN
SCALE: 1/4" = 1'-0"

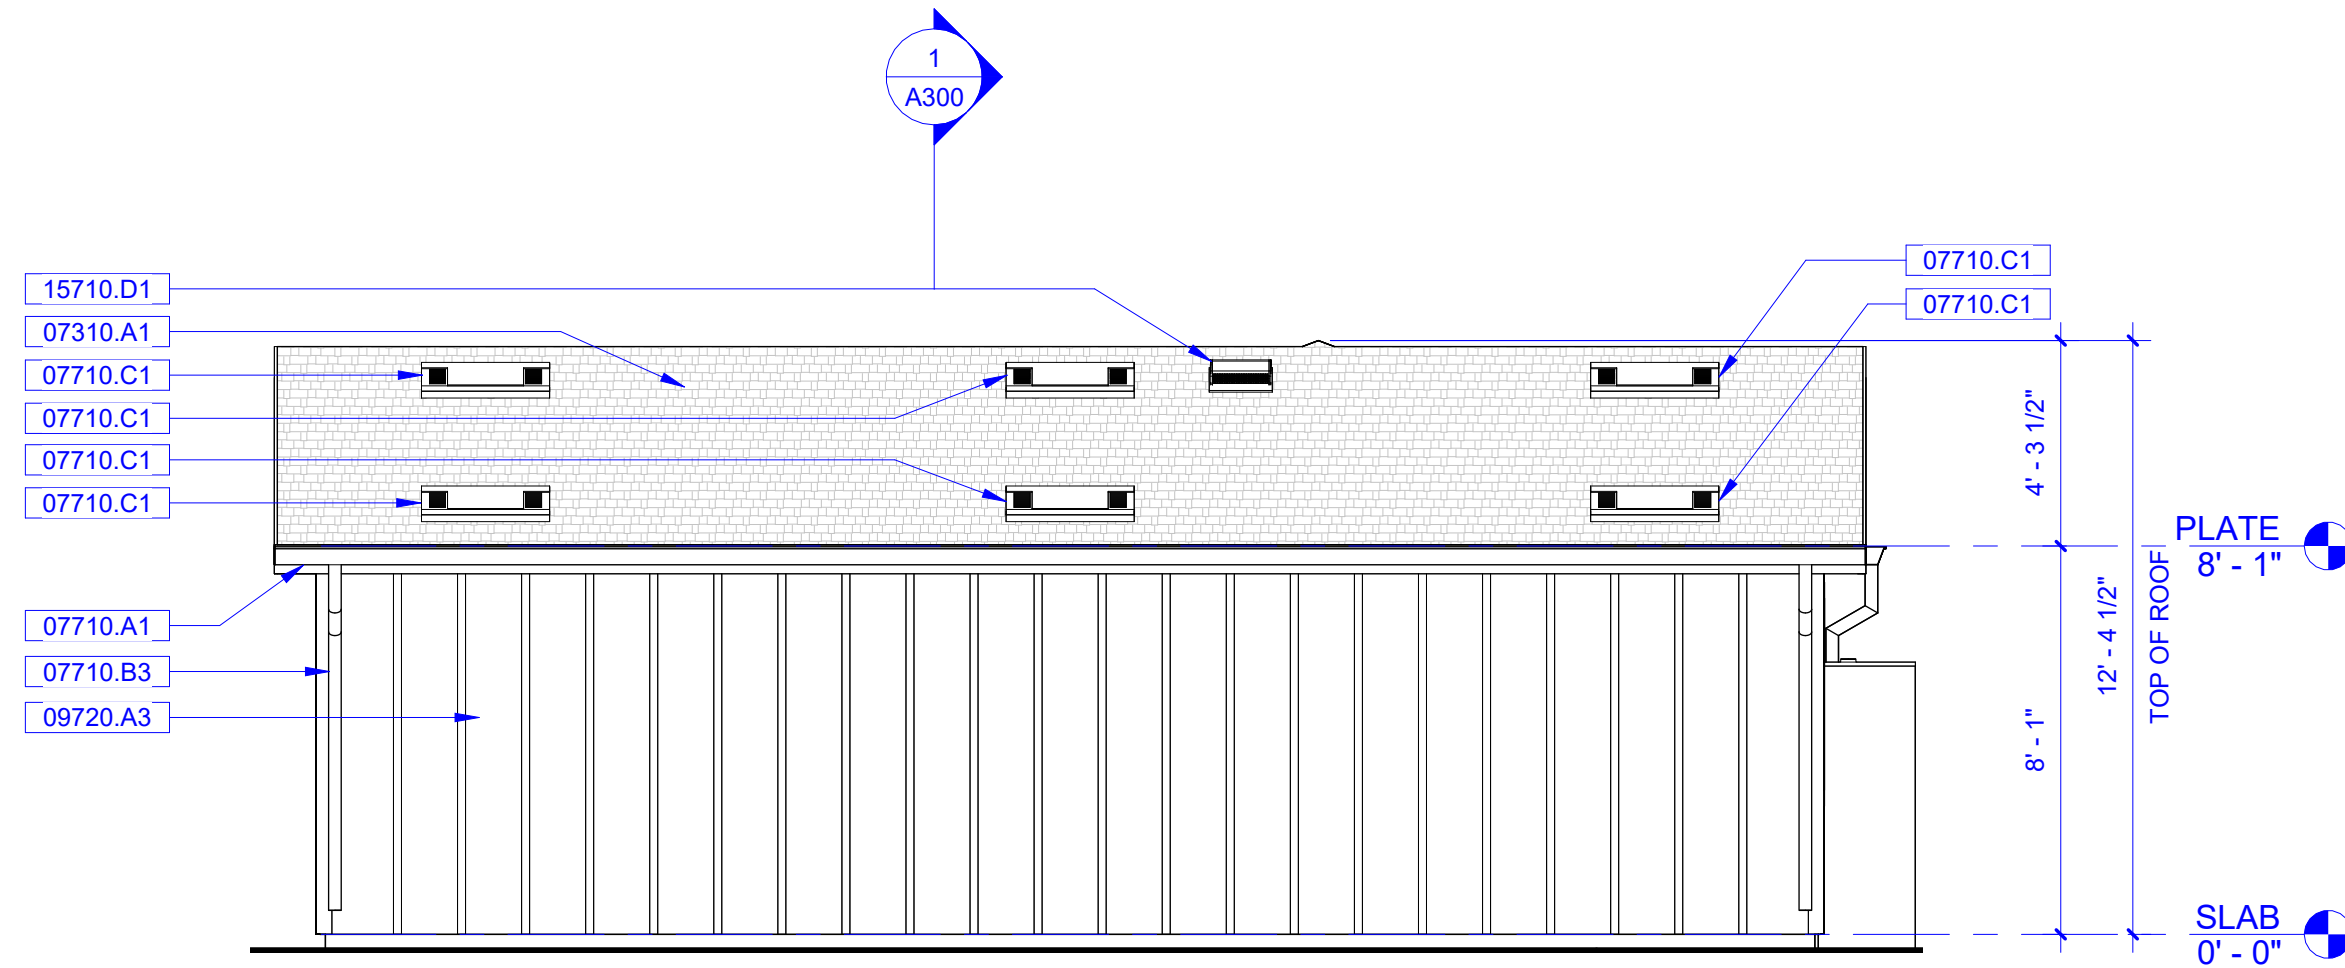

4 EAST ELEVATION - BOARD AND BATTEN
SCALE: 1/4" = 1'-0"

KEYNOTES:

KEYNOTE	DESCRIPTION
07310.A1	ROOFING MATERIAL PER CHECKLIST ON SHEET G102
07710.A1	GUTTER
07710.B3	DOWNSPOUT
07710.C1	O'HAGIN STANDARD LOW PROFILE ATTIC VENTS, 0.68 SF NFVA
09720.A3	FIBER CEMENT WALL VERTICAL B&B SIDING 'HARDIEPANEL' ESR-1844 OR SIMILAR, COLOR TBD TO MATCH MAIN RESIDENCE
15710.D1	DRYER EXHAUST ROOF EXHAUST VENT
15710.D2	RANGE HOOD ROOF EXHAUST VENT
15710.D3	BATH EXHAUST FAN ROOF VENT



SNAPADU
DESIGN HOUSE
YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 1,199 L-SHAPE
CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:
LUIS CALDERON
SnapADU

Luis Calderon
SIGNATURE

RELEASE	DATE	BY	APP.	RELEASED FOR...
A	03/22/2024	LAG		


GENERAL NOTES

- THE EXTERIOR ROOFING, TRIM, WALLS, WINDOWS, AND COLOR PALETTE OF THE ADU SHALL INCORPORATE THE SAME FEATURES AS THE MAIN DWELLING UNIT.
- THE TYPE, LOCATION, AND SIZE OF THE BUILDING ADDRESS IDENTIFICATION MUST BE CLEARLY VISIBLE AND LEGIBLE FROM THE ADJACENT PUBLIC WAY OR STREET. ADDRESS LETTERS/NUMBERS SHALL BE MINIMUM 4 INCHES HIGH, WITH A MINIMUM STROKE WIDTH OF 1/2 INCH, AND SHALL CONTRAST WITH THEIR BACKGROUND. CRC R319.1.


ELEVATIONS C -
BOARD & BATTEN

A221


22040

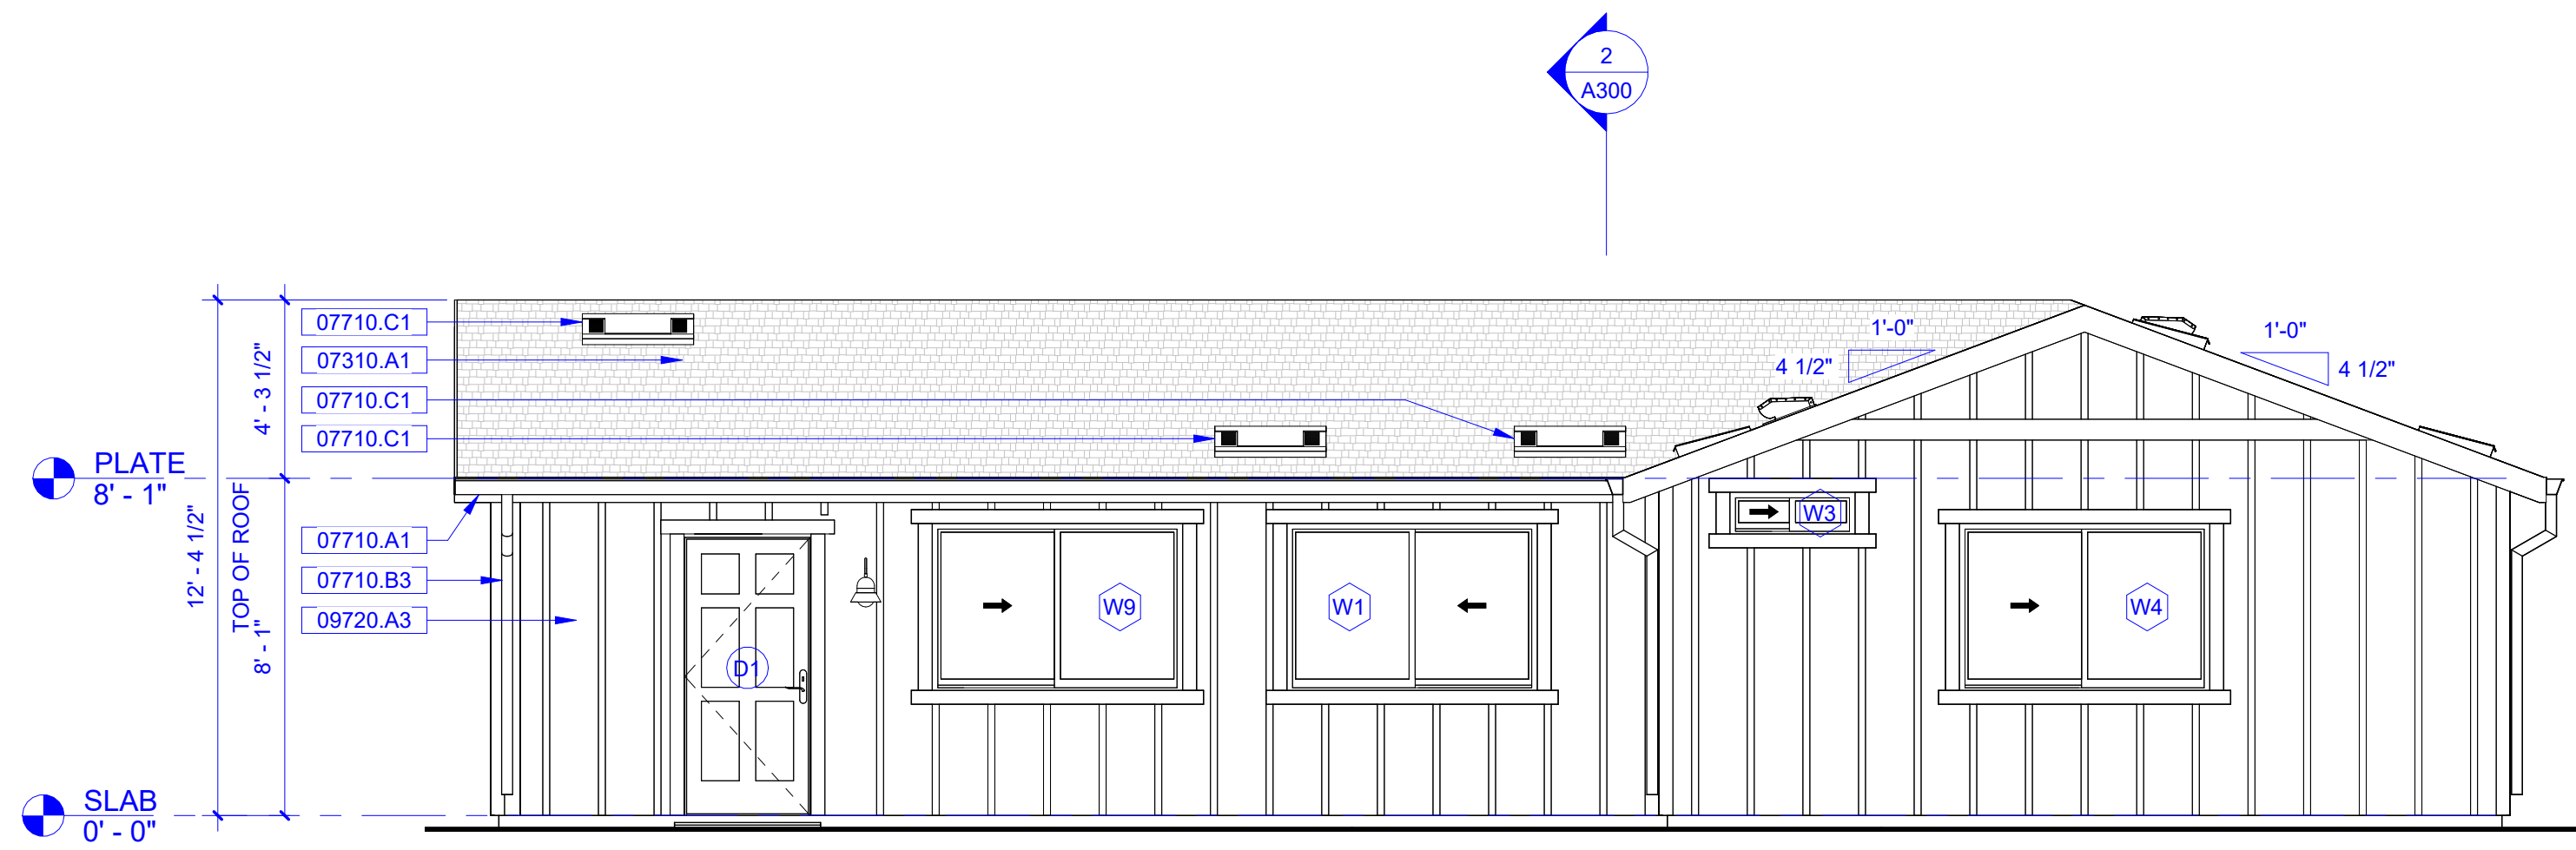

1 SOUTH ELEVATION - BOARD AND BATTEN -
2-BEDROOM
SCALE: 1/4" = 1'-0"

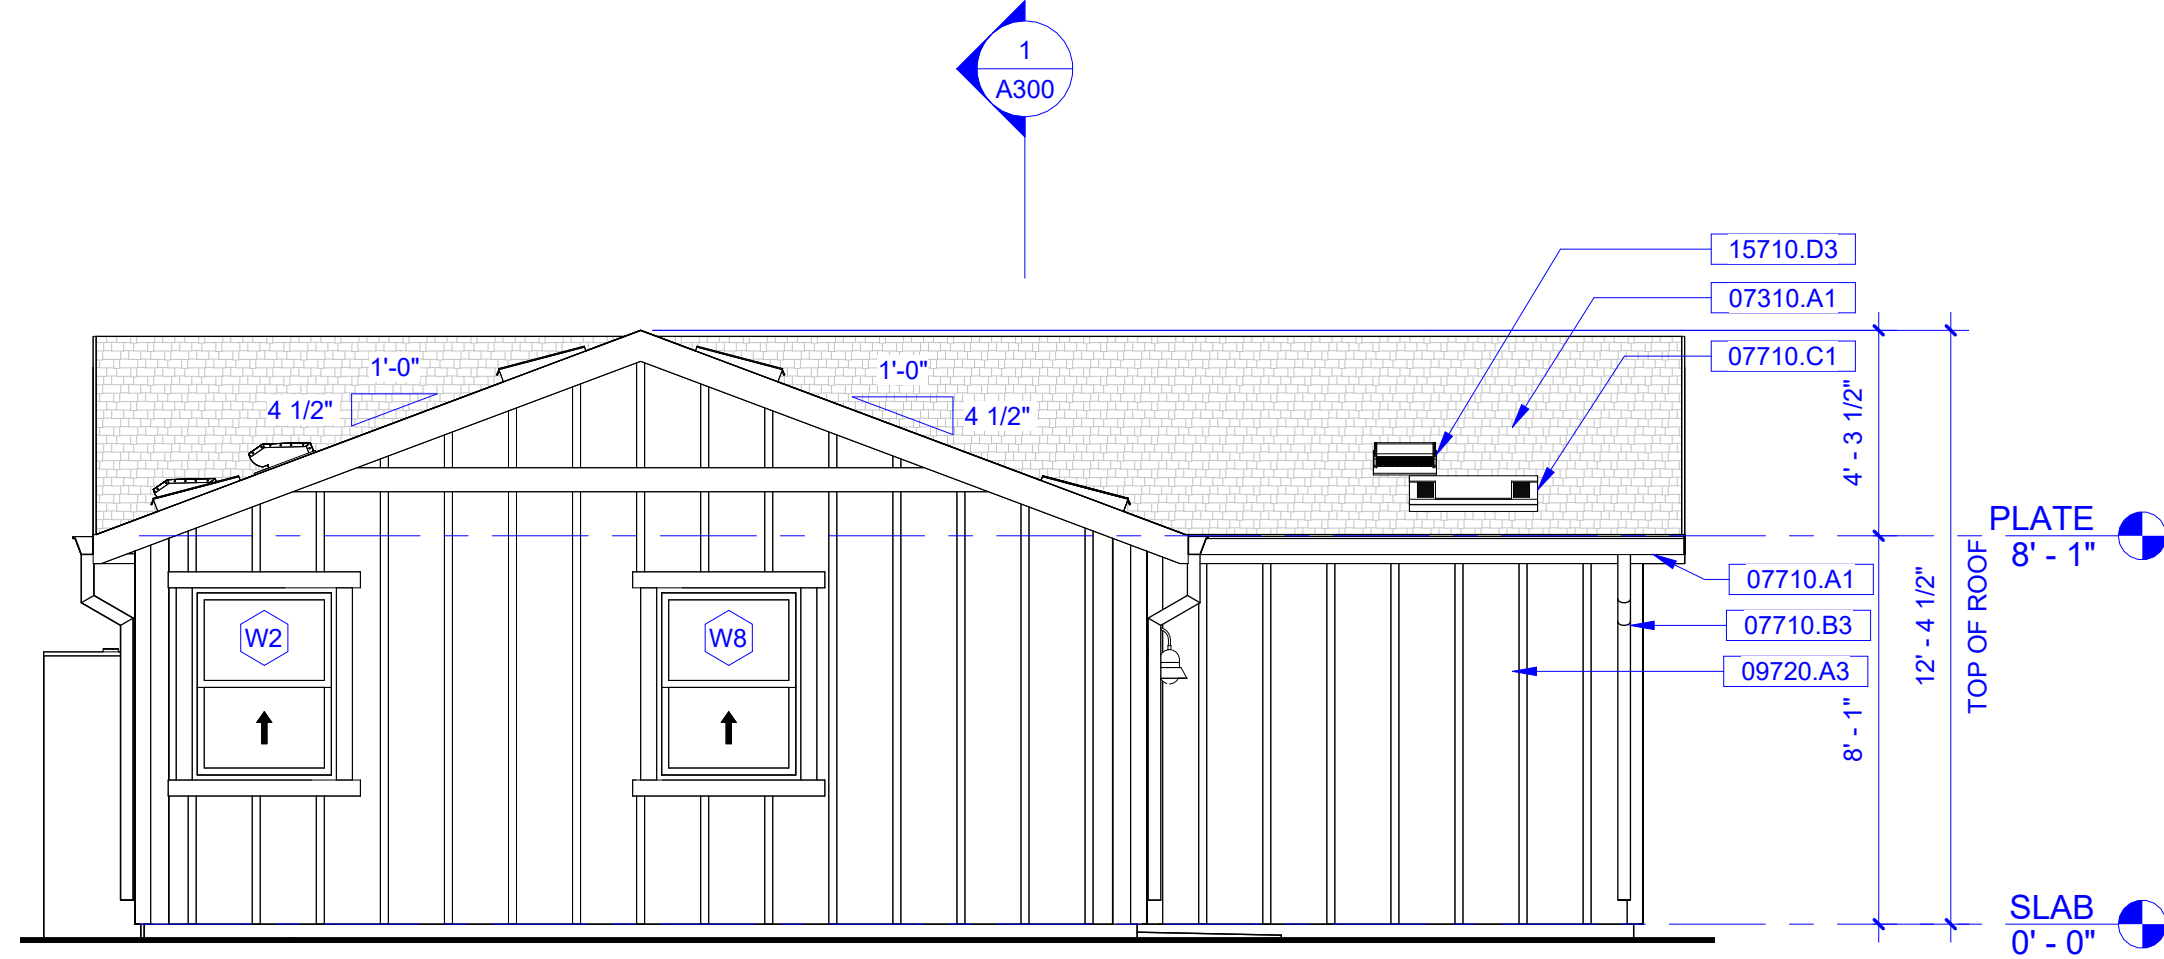

2 WEST ELEVATION - BOARD AND BATTEN -
2-BEDROOM
SCALE: 1/4" = 1'-0"

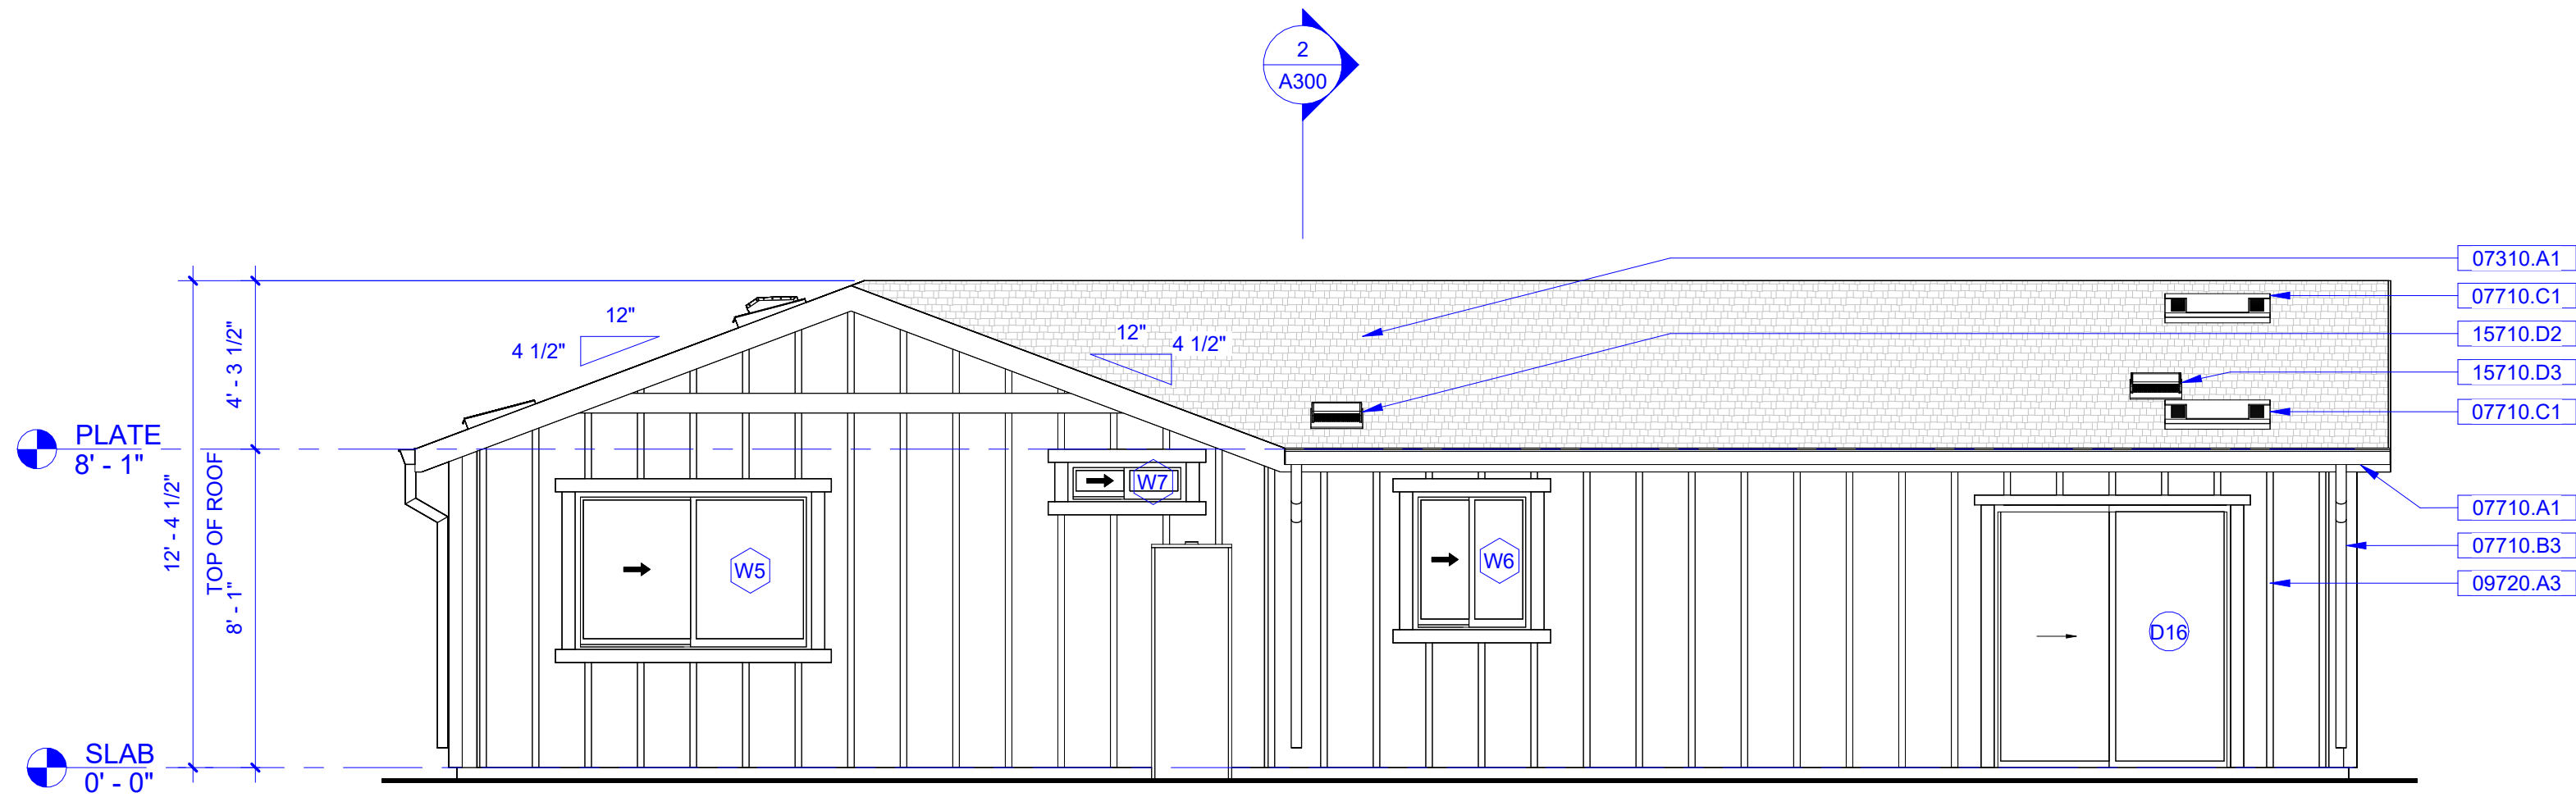

3 NORTH ELEVATION - BOARD AND BATTEN - 6068
SLIDING GLASS DOOR
SCALE: 1/4" = 1'-0"

KEYNOTES:

KEYNOTE	DESCRIPTION
07310.A1	ROOFING MATERIAL PER CHECKLIST ON SHEET G102
07710.A1	GUTTER
07710.B3	DOWNSPOUT
07710.C1	O'HAGIN STANDARD LOW PROFILE ATTIC VENTS, 0.68 SF NFVA
09720.A3	FIBER CEMENT WALL VERTICAL B&B SIDING 'HARDIEPANEL' ESR-1844 OR SIMILAR, COLOR TBD TO MATCH MAIN RESIDENCE
15710.D2	RANGE HOOD ROOF EXHAUST VENT
15710.D3	BATH EXHAUST FAN ROOF VENT



SNAPADU
DESIGN HOUSE

YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 1,199 L-SHAPE
CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:
LUIS CALDERON
SnapADU

Luis Calderon
SIGNATURE

RELEASE	DATE	BY	APP.	RELEASED FOR...
A	03/22/2024	LAG		


GENERAL NOTES

- THE EXTERIOR ROOFING, TRIM, WALLS, WINDOWS, AND COLOR PALETTE OF THE ADU SHALL INCORPORATE THE SAME FEATURES AS THE MAIN DWELLING UNIT.
- THE TYPE, LOCATION, AND SIZE OF THE BUILDING ADDRESS IDENTIFICATION MUST BE CLEARLY VISIBLE AND LEGIBLE FROM THE ADJACENT PUBLIC WAY OR STREET. ADDRESS LETTERS/NUMBERS SHALL BE MINIMUM 4 INCHES HIGH, WITH A MINIMUM STROKE WIDTH OF 1/2 INCH, AND SHALL CONTRAST WITH THEIR BACKGROUND. CRC R319.1.


ELEVATIONS C -
BOARD & BATTEN -
OPTIONS

A222

22040

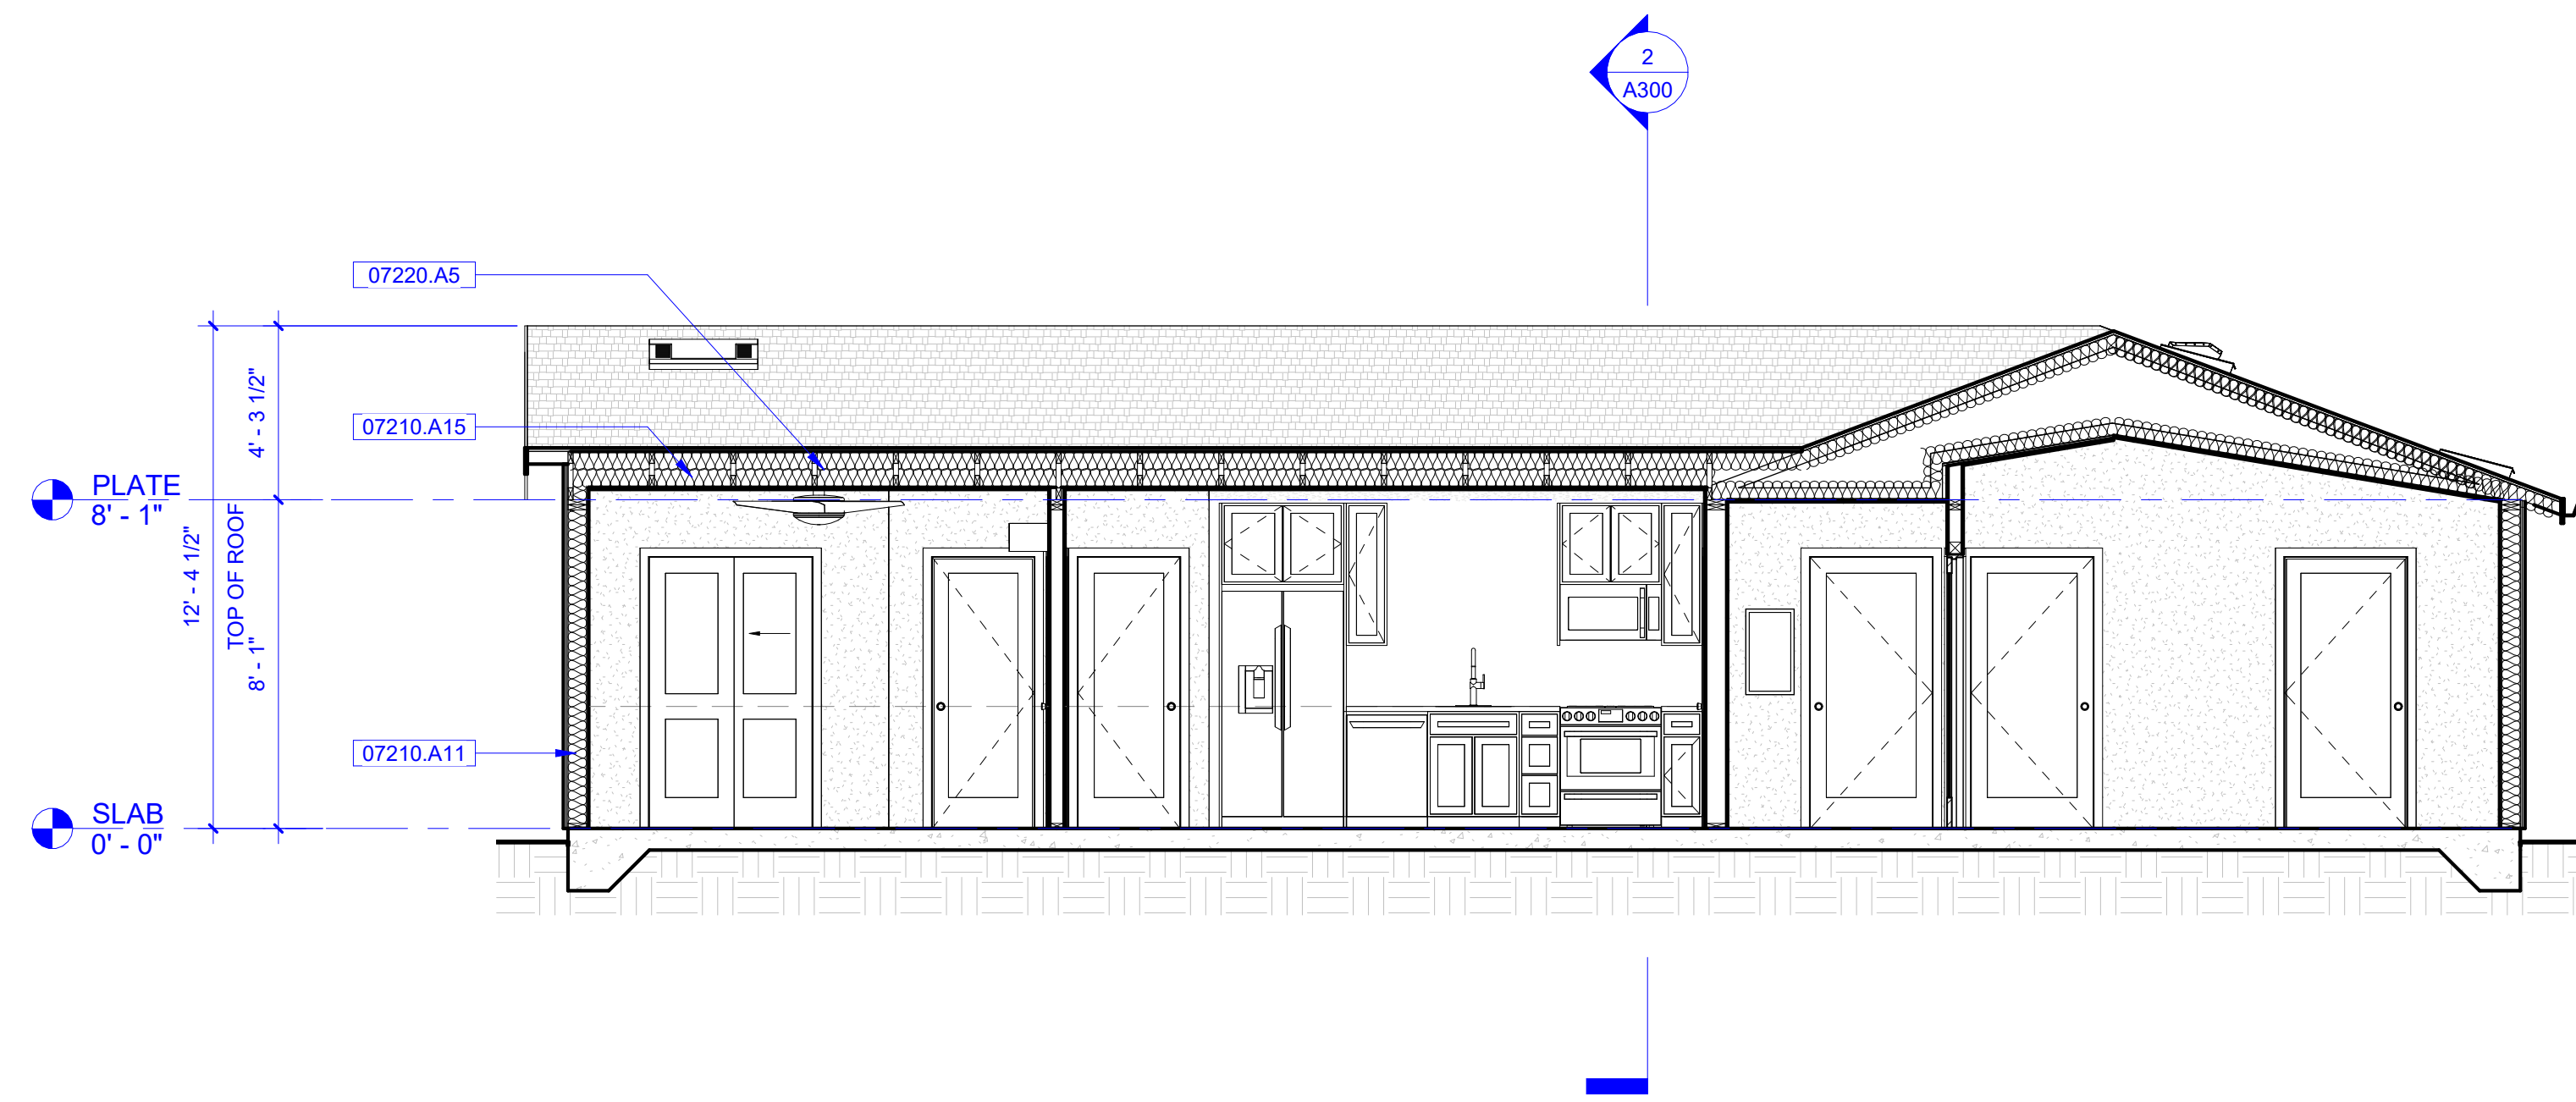

1 SECTION 1
SCALE: 1/4" = 1'-0"

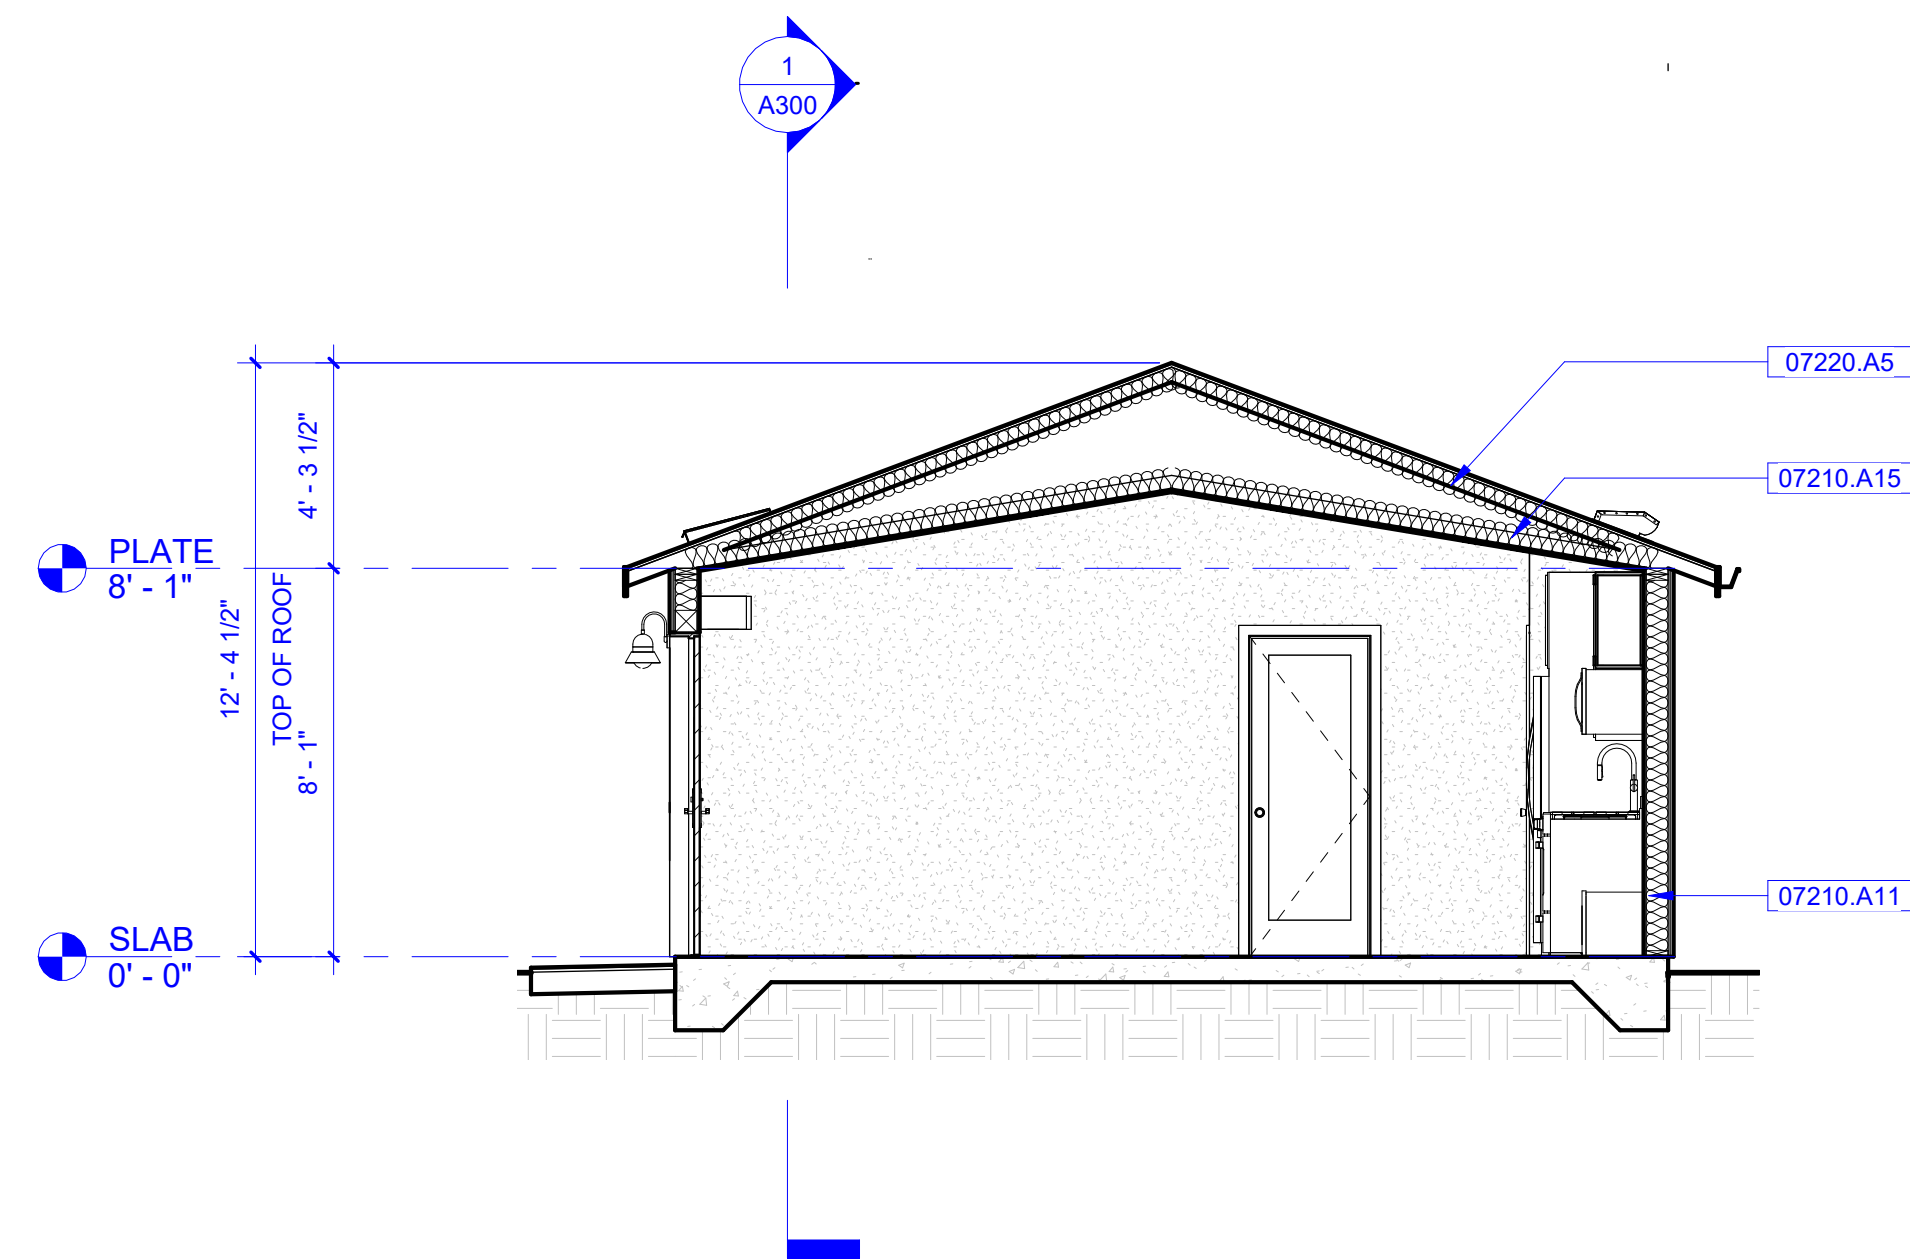

2 SECTION 2
SCALE: 1/4" = 1'-0"

KEYNOTES:

KEYNOTE	DESCRIPTION
07210.A11	WALL BATT INSULATION PER TITLE 24 CALCULATIONS
07210.A15	CEILING BATT INSULATION PER TITLE 24 CALCULATIONS
07220.A5	BATT INSULATION BELOW ROOF DECK PER TITLE 24 CALCULATIONS



SNAPADU
DESIGN HOUSE

YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 1,199 L-SHAPE

DESIGNER:
LUIS CALDERON
napADU

SIGNATURE


[illegible]

BUILDING SECTIONS


A300

22040


Autodesk Docs://22040_City of Chula Vista/22040_City of Chula Vista_1199 L-Shape_V2_CD_RVT22.rvt 3/23/2024 12:47:44 PM

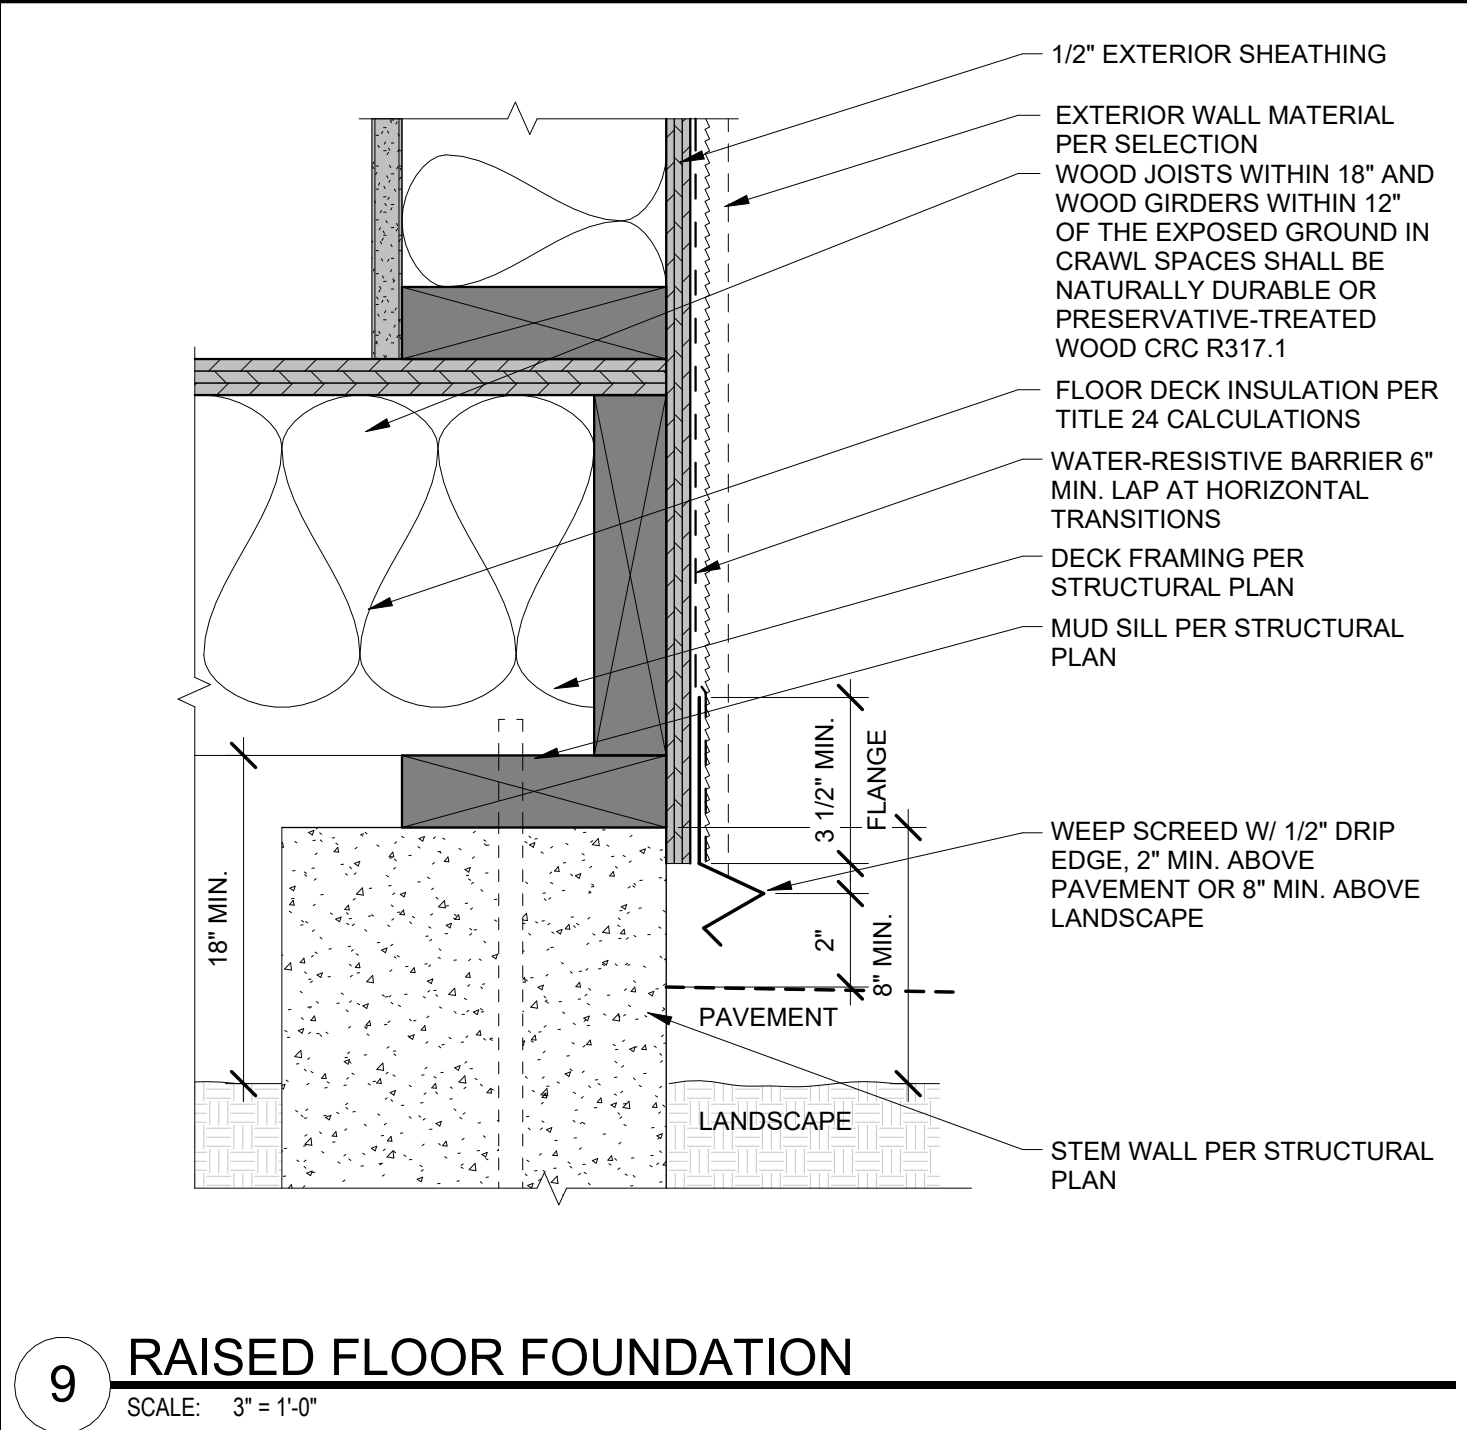


9 RAISED FLOOR FOUNDATION
SCALE: 3" = 1'-0"

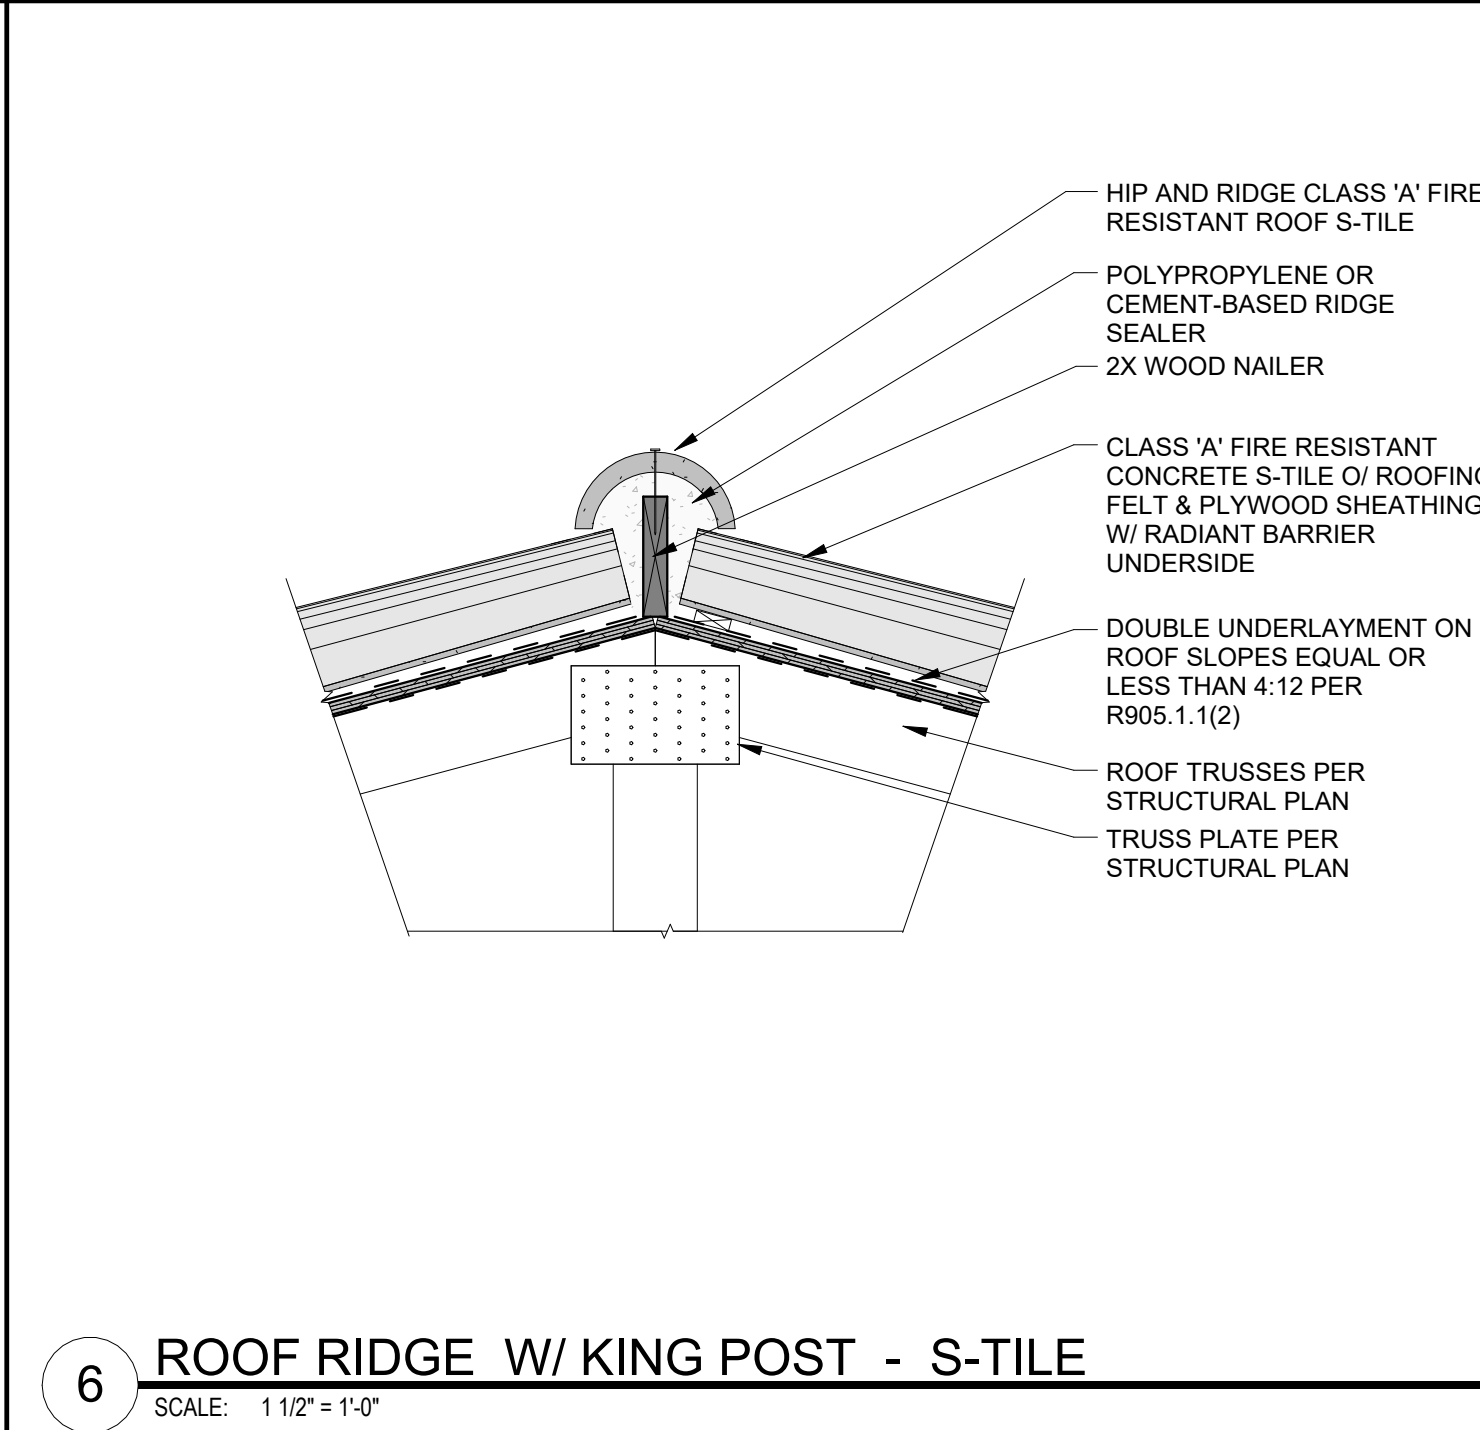


6 ROOF RIDGE W/ KING POST - S-TILE
SCALE: 1 1/2" = 1'-0"

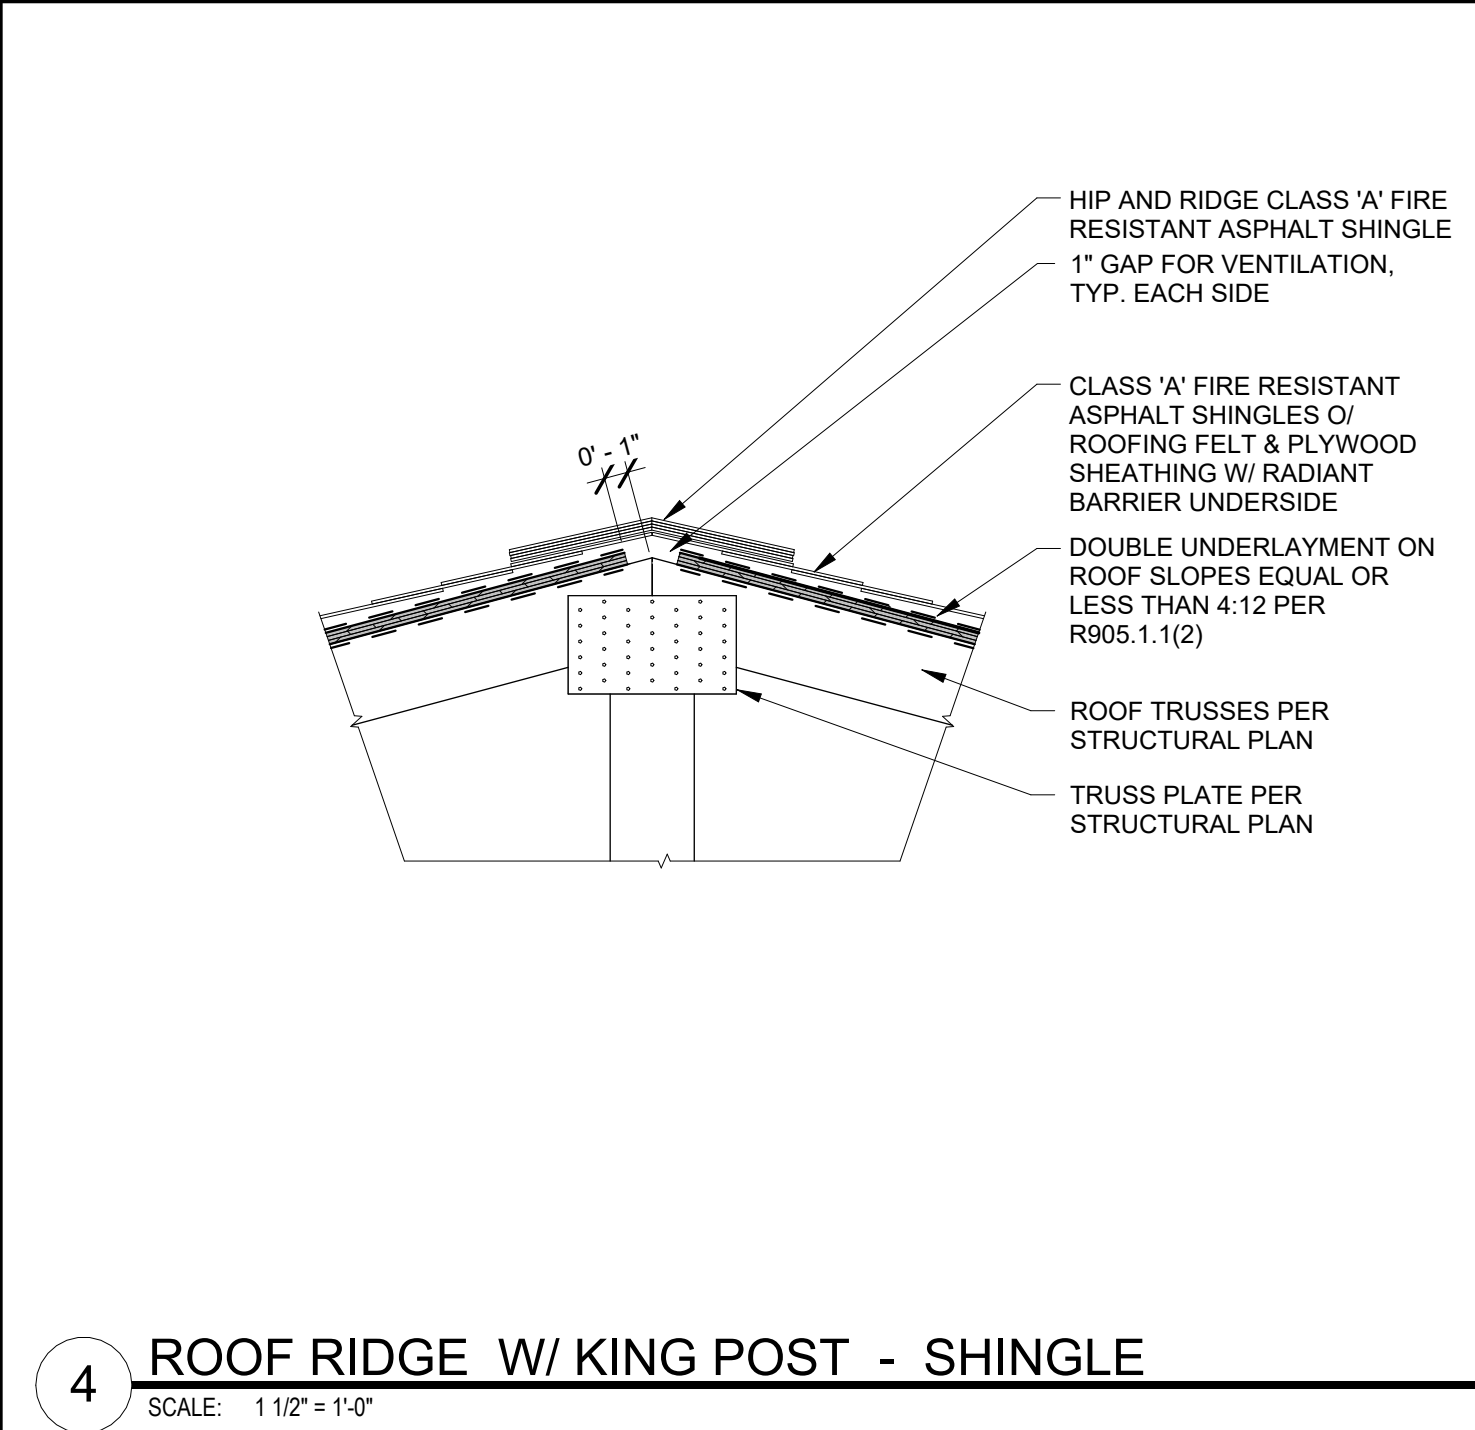

4 ROOF RIDGE W/ KING POST - SHINGLE
SCALE: 1 1/2" = 1'-0"

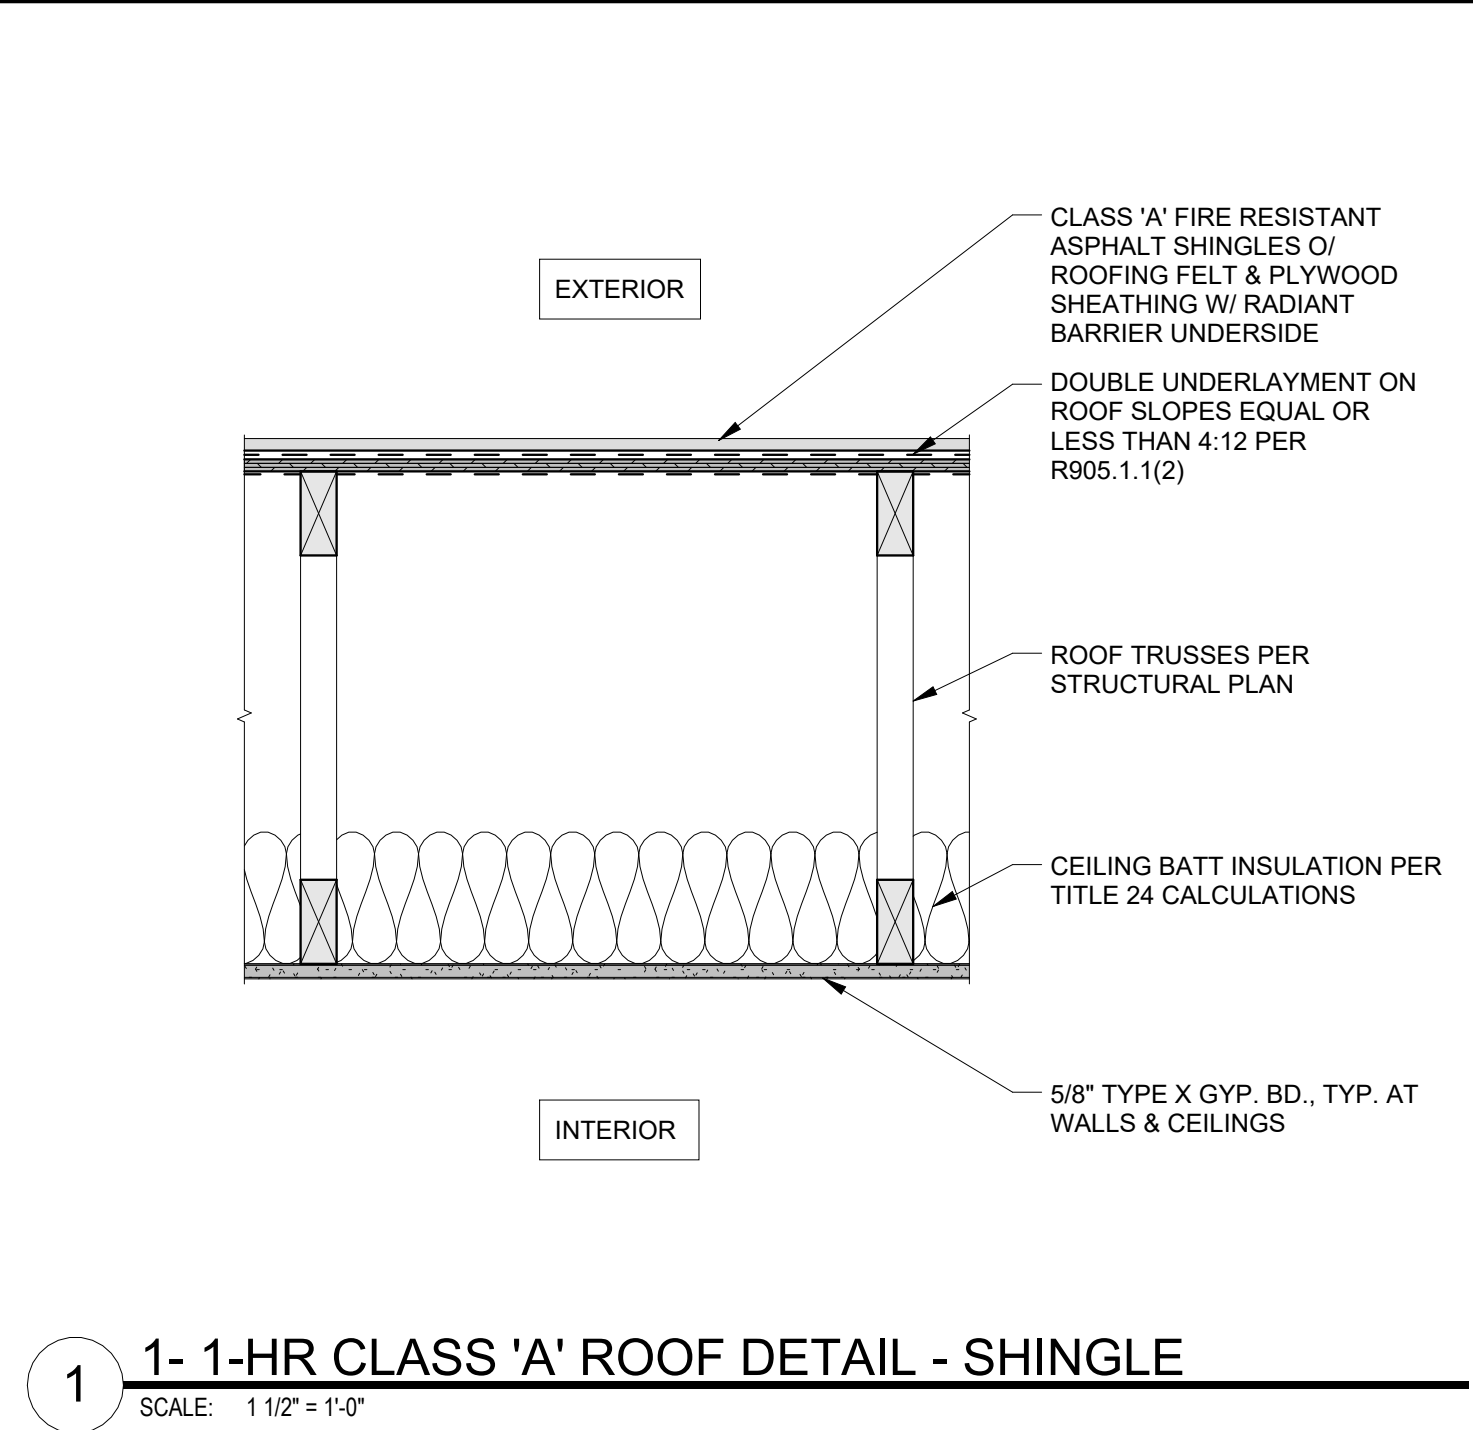

1 1- 1-HR CLASS 'A' ROOF DETAIL - SHINGLE
SCALE: 1 1/2" = 1'-0"

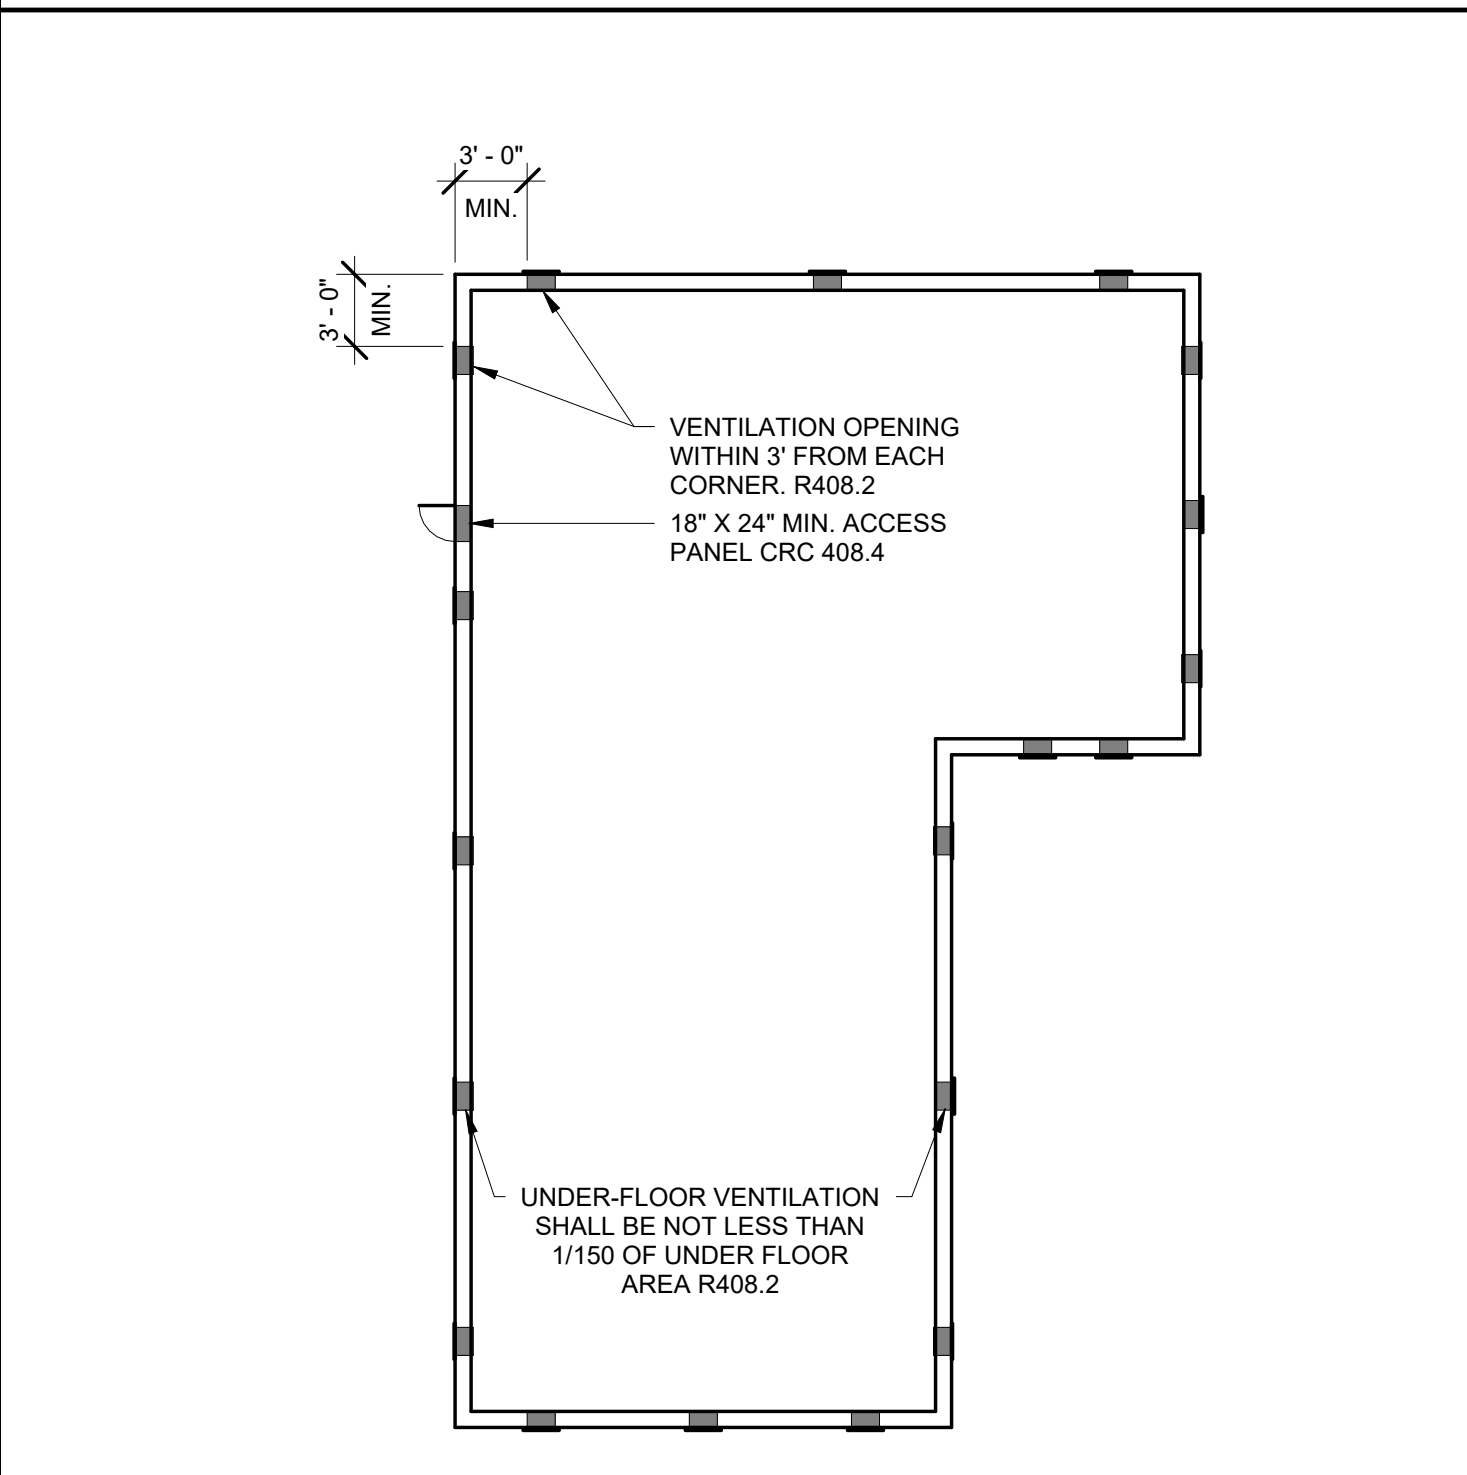


* FOUNDATION VENTS AND ACCESS PANEL LOCATION MIGHT VARY ACCORDING TO SITE CONDITIONS.


FOUNDATION VENT CALCULATIONS:

NET FREE VENTED AREA CALC.	CRAWL SPACE AREA	REQUIRED NFVA	
CRAWL SPACE AREA / 150 SF	1,199 SF	7.99 SF	
CRAWL SPACE VENT NFVA	REQUIRED NFVA / CRAWLSPACE VENT NFVA	REQUIRED VENTS	NFVA TO BE PROVIDED
VULCAN FOUNDATION VENT MODEL VFS814S OR EQUAL. (NFVA = 62 SQ.IN. = 0.43 SF)	18.58 SF	19	8.17 SF


10 FOUNDATION VENT CALCS
SCALE: 1" = 1'-0"

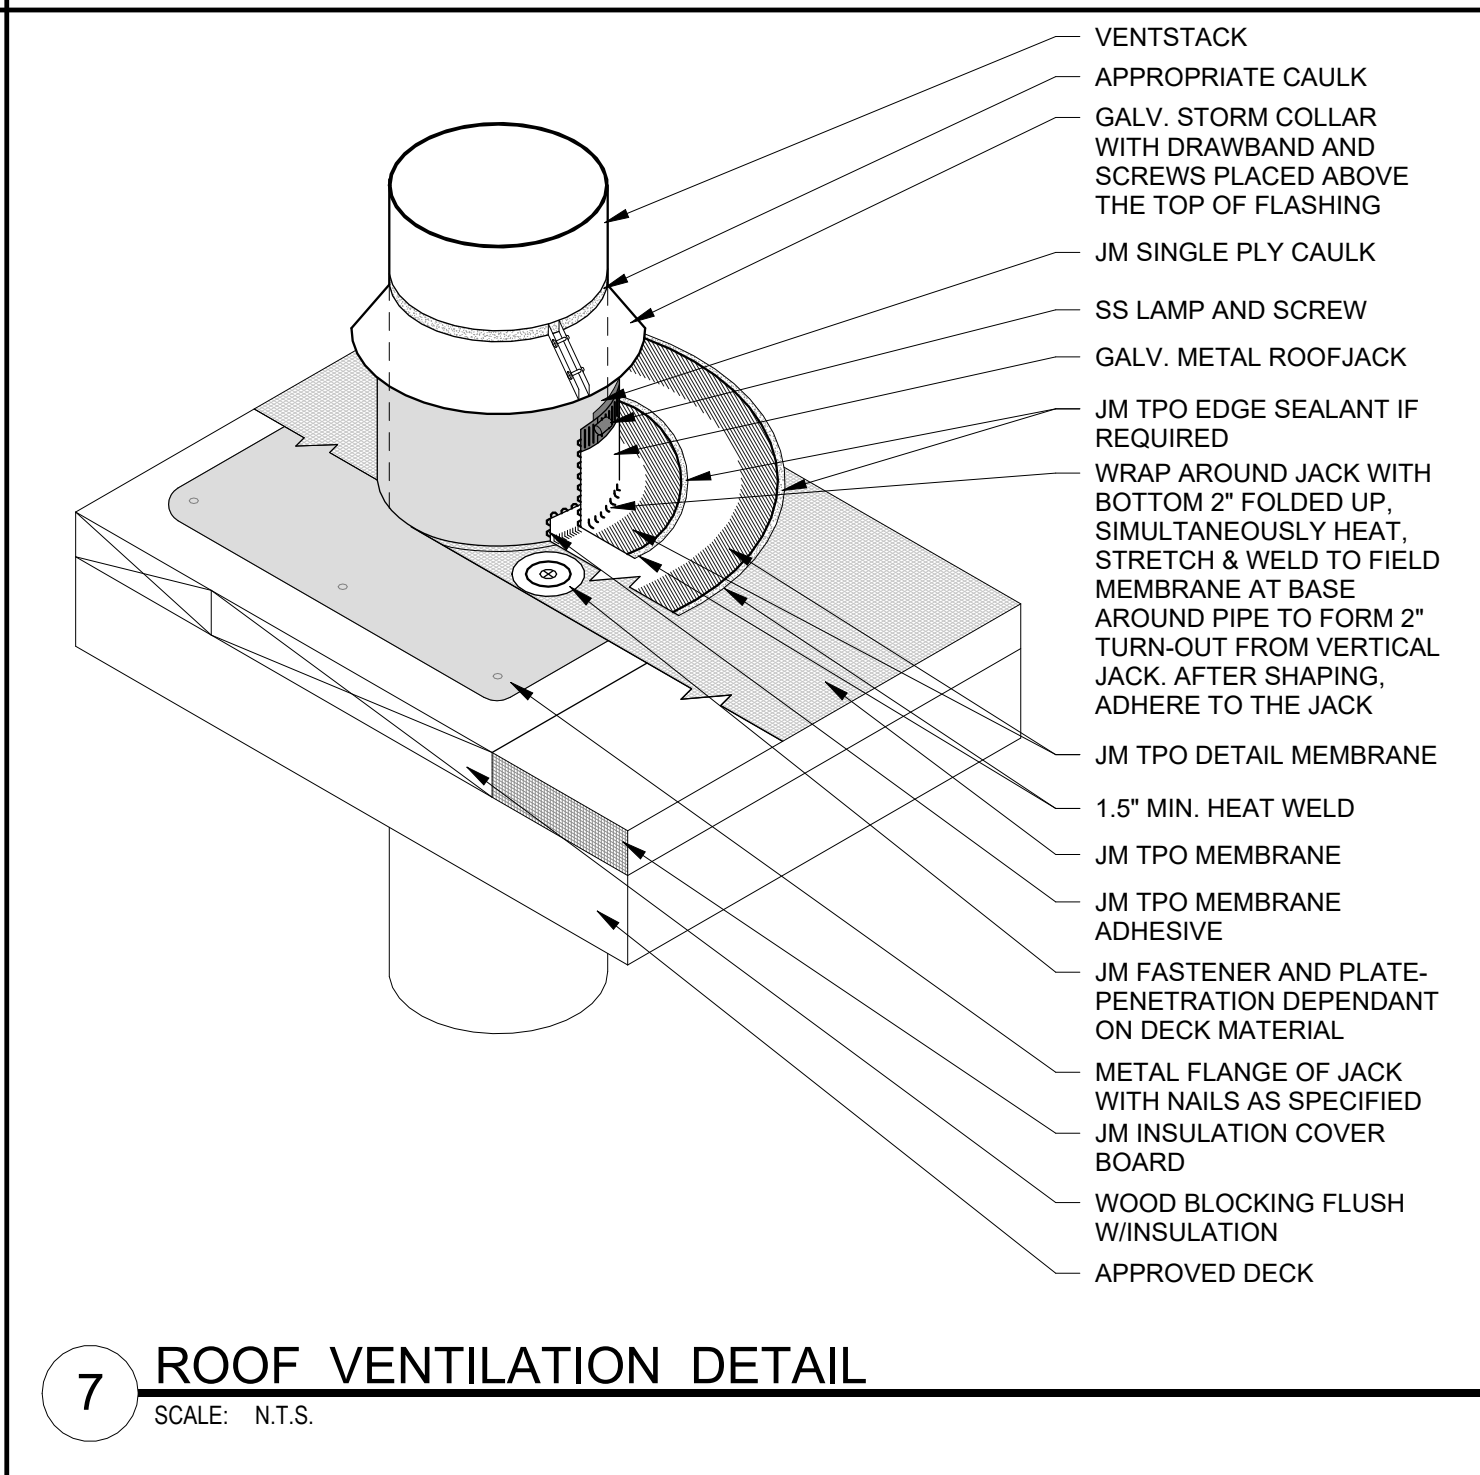


7 ROOF VENTILATION DETAIL
SCALE: N.T.S.

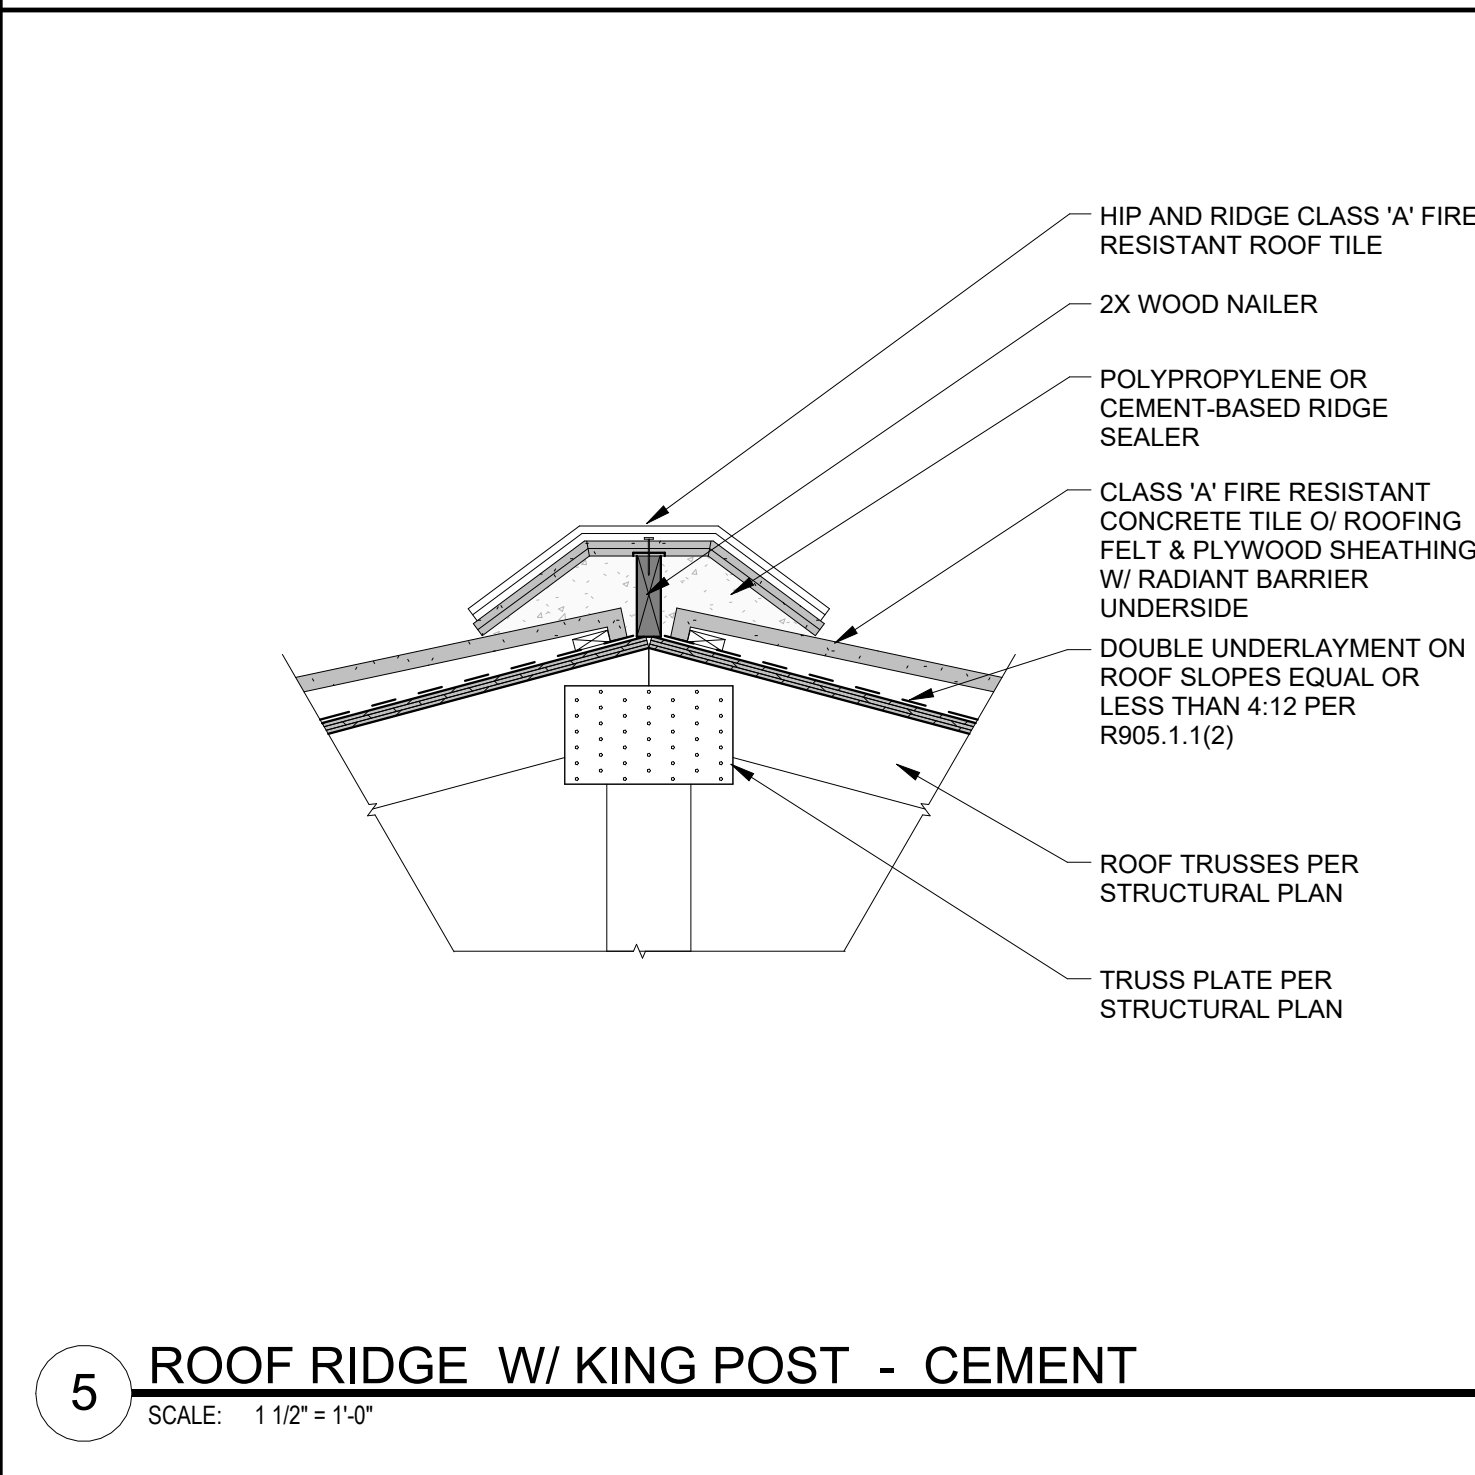

5 ROOF RIDGE W/ KING POST - CEMENT
SCALE: 1 1/2" = 1'-0"

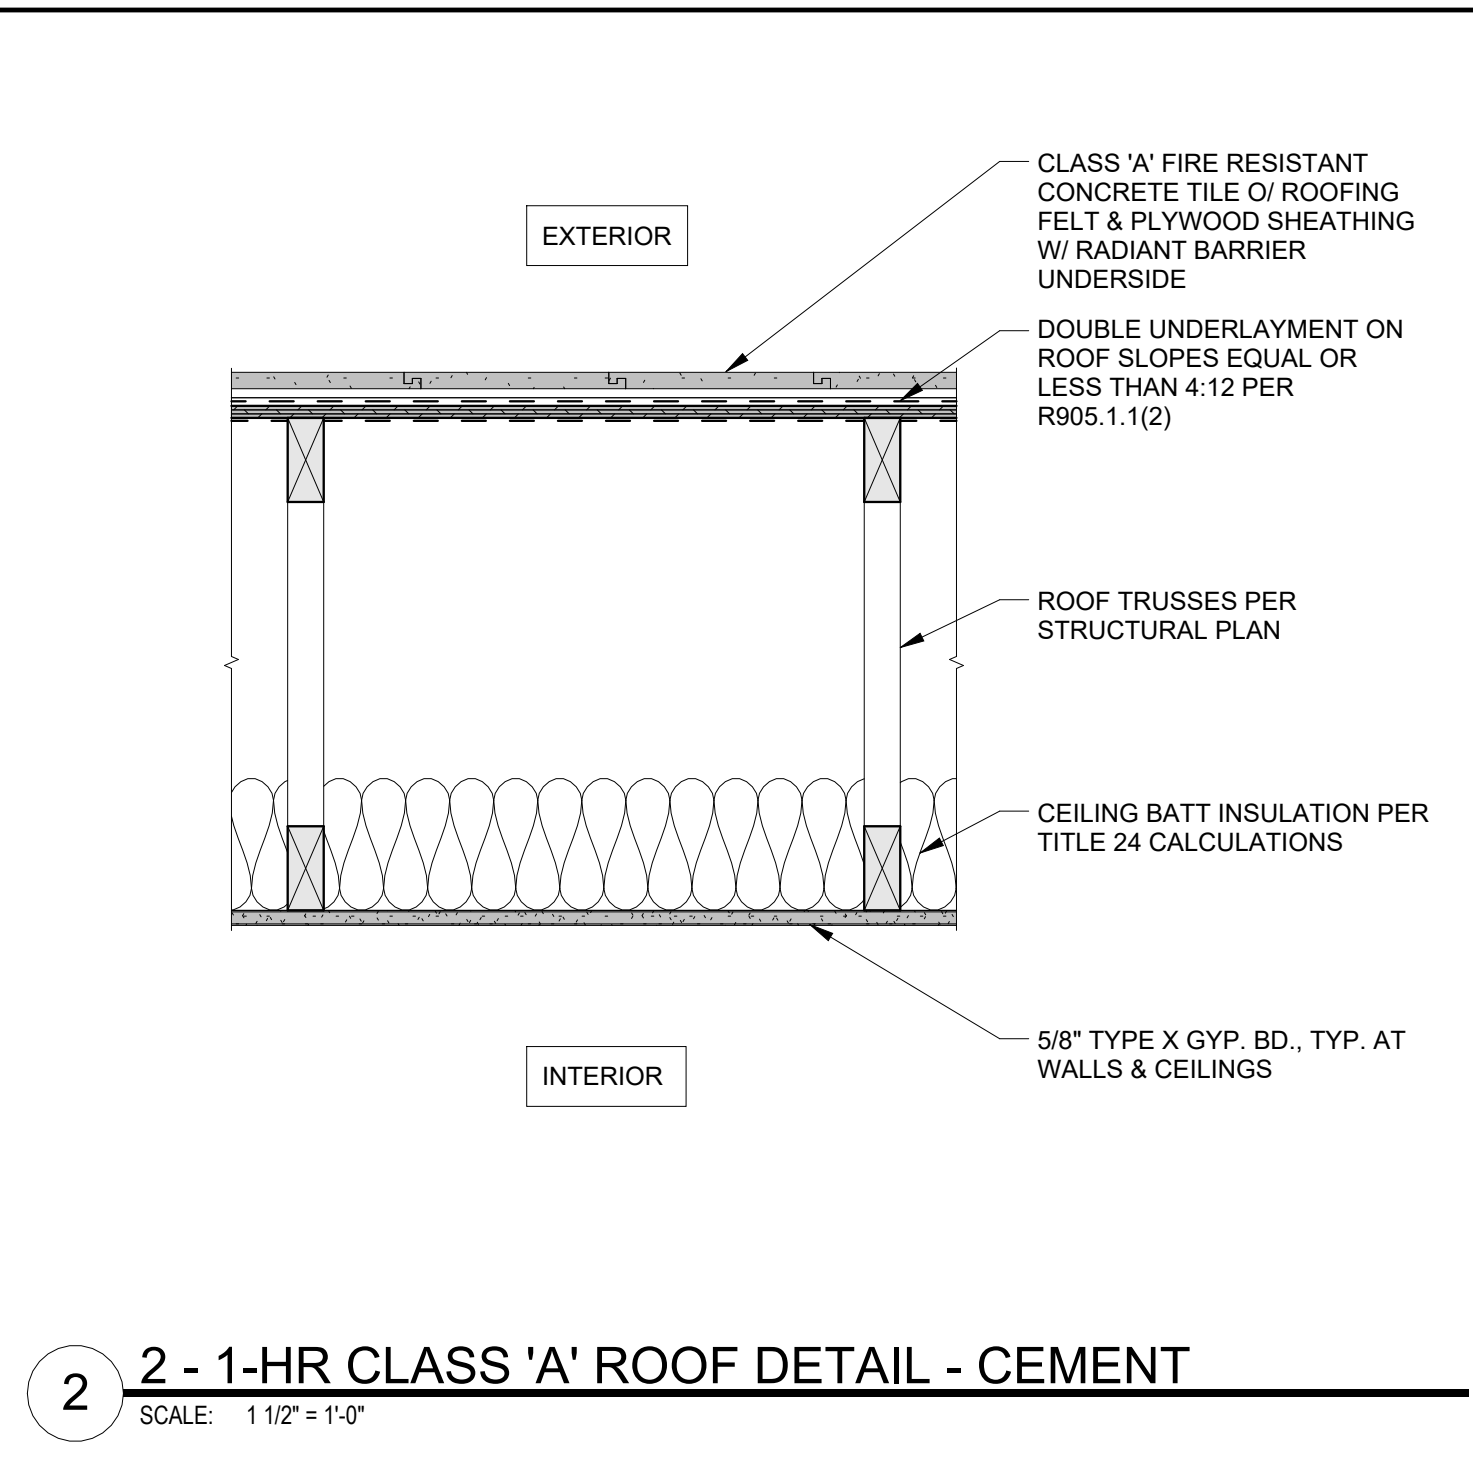


2 2- 1-HR CLASS 'A' ROOF DETAIL - CEMENT
SCALE: 1 1/2" = 1'-0"

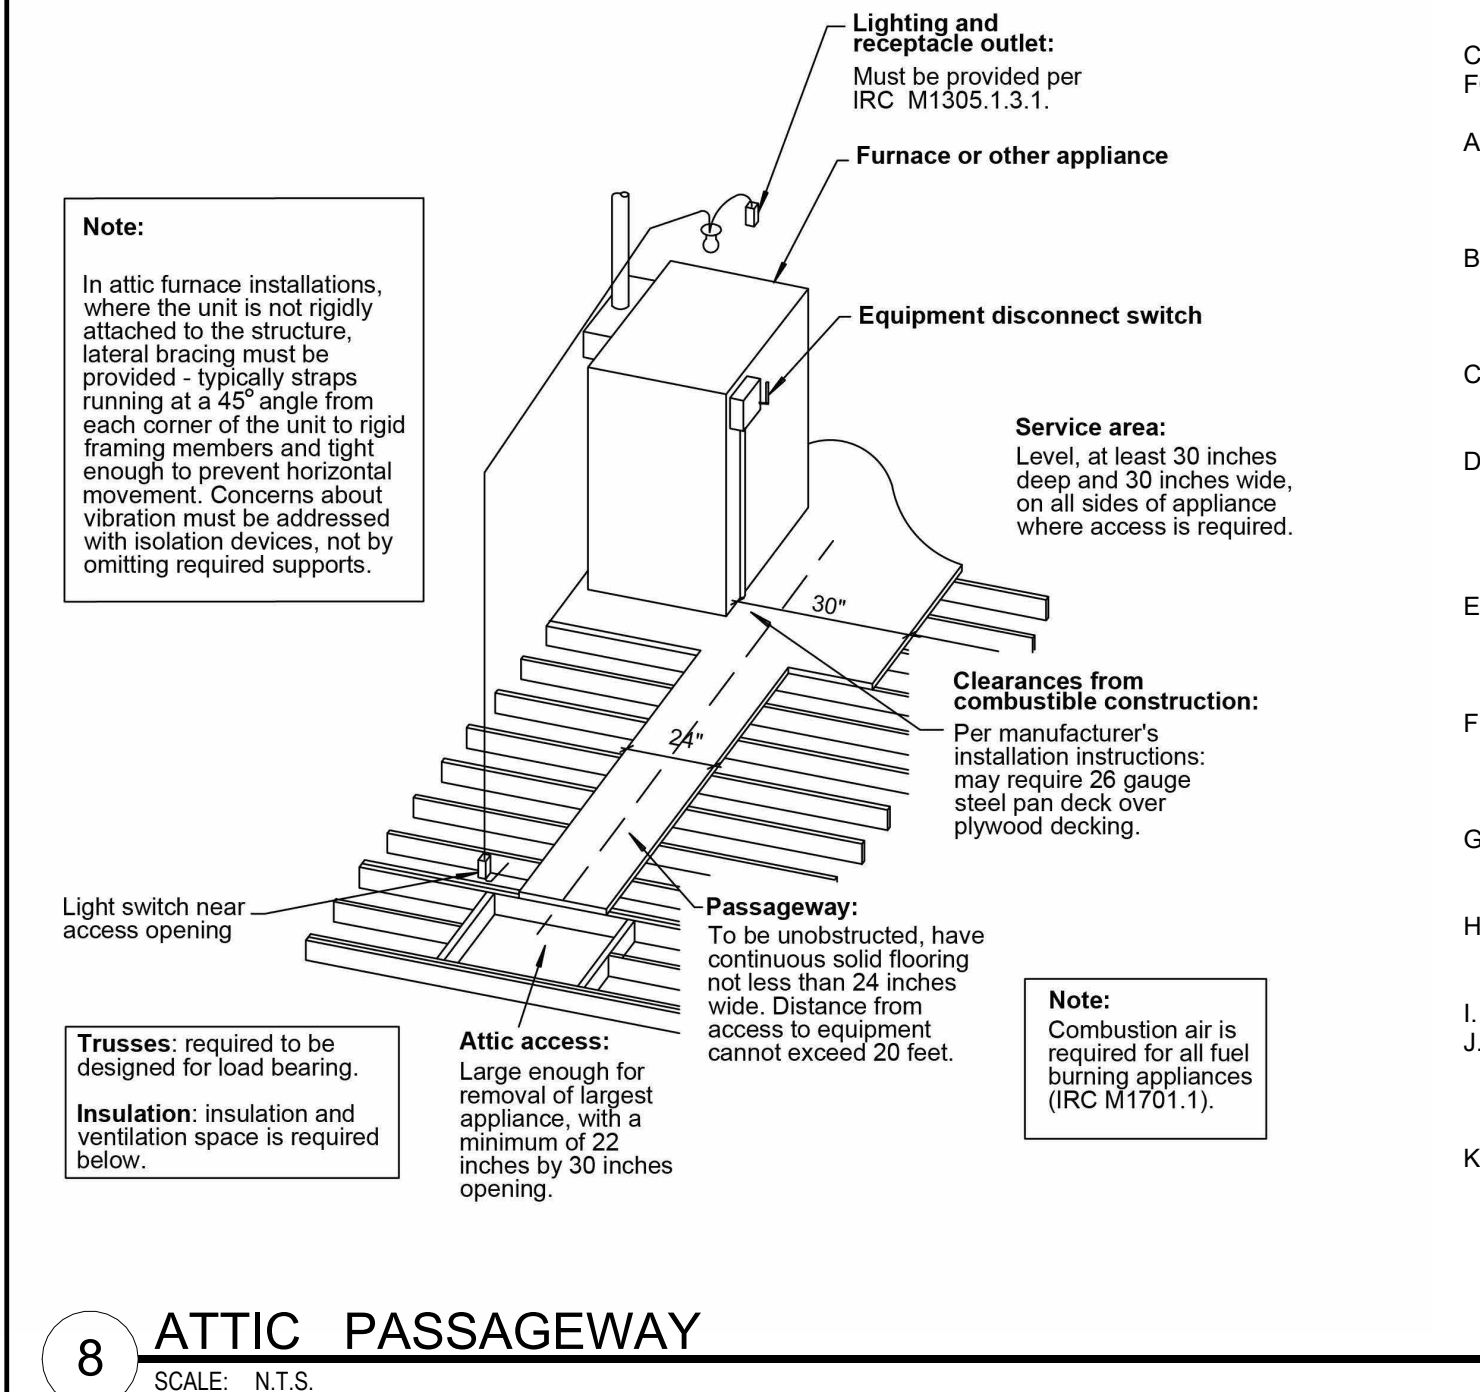

8 ATTIC PASSAGEWAY
SCALE: N.T.S.

CMC SECTION 304 REQUIRES THAT APPLIANCES INSTALLED IN ATTICS OR UNDERFLOOR AREAS BE ACCESSIBLE AS FOLLOWS:

- ACCESS OPENING. AN ACCESS OPENING (THROUGH CEILING, FLOOR OR WALL) AND PASSAGEWAY (WOOD, CONCRETE, ETC.) SIZED TO ALLOW FOR REMOVAL OF THE LARGEST COMPONENT OF THE APPLIANCE, AND NOT LESS THAN 22 INCHES BY 30 INCHES, SHALL BE PROVIDED.
- LENGTH OF PASSAGEWAY. WHERE THE HEIGHT OF THE PASSAGEWAY IS LESS THAN 6 FEET, THE DISTANCE FROM THE PASSAGEWAY ACCESS TO THE APPLIANCE SHALL NOT EXCEED 20 FEET MEASURED ALONG THE CENTERLINE OF THE PASSAGEWAY.
- WIDTH OF PASSAGEWAY. THE PASSAGEWAY SHALL BE UNOBSTRUCTED AND SHALL HAVE SOLID FLOORING NOT LESS THAN 24 INCHES WIDE FROM THE ENTRANCE OPENING TO THE APPLIANCE.
- WORK PLATFORM. A LEVEL WORKING PLATFORM (WOOD, CONCRETE, ETC.) NOT LESS THAN 30 INCHES BY 30 INCHES SHALL BE PROVIDED IN FRONT OF THE SERVICE SIDE OF THE APPLIANCE. EXCEPTION: A WORKING PLATFORM NEED NOT BE PROVIDED WHERE THE FURNACE IS CAPABLE OF BEING SERVICED FROM THE REQUIRED ACCESS OPENING. THE FURNACE SERVICE SIDE SHALL NOT EXCEED 12 INCHES FROM THE ACCESS OPENING.
- LIGHTING AND CONVENIENCE OUTLET. A PERMANENT 120-VOLT RECEPTACLE OUTLET AND A LIGHTING FIXTURE SHALL BE INSTALLED NEAR THE APPLIANCE. THE SWITCH CONTROLLING THE LIGHTING FIXTURE SHALL BE LOCATED AT THE ENTRANCE TO THE PASSAGEWAY.
- EQUIPMENT DISCONNECT SWITCH. WHEN AN APPLIANCE REQUIRES AN EXTERNAL SOURCE OF ELECTRICAL POWER FOR ITS OPERATION, IT SHALL BE PROVIDED WITH A READILY ACCESSIBLE ELECTRICAL DISCONNECT MEANS WITHIN SIGHT OF THE APPLIANCE.
- CLEARANCE FROM COMBUSTIBLE CONSTRUCTION. THE APPLIANCE SHALL BE SEPARATED FROM COMBUSTIBLE CONSTRUCTION IN ACCORDANCE WITH THE MANUFACTURER'S INSTALLATION INSTRUCTIONS.
- TRUSSES. WHERE TRUSSES ARE USED AS ATTIC FLOOR FRAMING, THEY SHALL BE DESIGNED FOR BEARING THE LOAD FROM THE APPLIANCE. PLANS SHALL SPECIFICALLY INDICATE THE TRUSS LOADING LIMITATIONS.
- INSULATION. INSULATION AND VENTILATION SPACE IS REQUIRED BELOW THE EQUIPMENT.
- COMBUSTION AIR. COMBUSTION AIR SHALL BE PROVIDED IN ACCORDANCE WITH THE APPLIANCE LISTING INFORMATION AND MANUFACTURERS SPECIFICATIONS. PLANS SHALL SPECIFICALLY INDICATE HOW COMBUSTION AIR WILL BE PROVIDED.
- SEISMIC SUPPORT AND ATTACHMENT. IN ATTIC APPLIANCE INSTALLATIONS, WHERE THE UNIT IS NOT RIGIDLY ATTACHED TO THE STRUCTURE, LATERAL BRACING MUST BE PROVIDED. BRACING IS TYPICALLY STRAPS RUNNING AT A 45 DEGREE ANGLE FROM EACH CORNER OF THE UNIT TO RIGID FRAMING MEMBERS. STRAPS SHALL BE TIGHT ENOUGH TO PREVENT HORIZONTAL MOVEMENT. CONCERNS ABOUT VIBRATION MUST BE ADDRESSED WITH ISOLATION DEVICES, NOT BY OMITTING REQUIRED SUPPORTS.

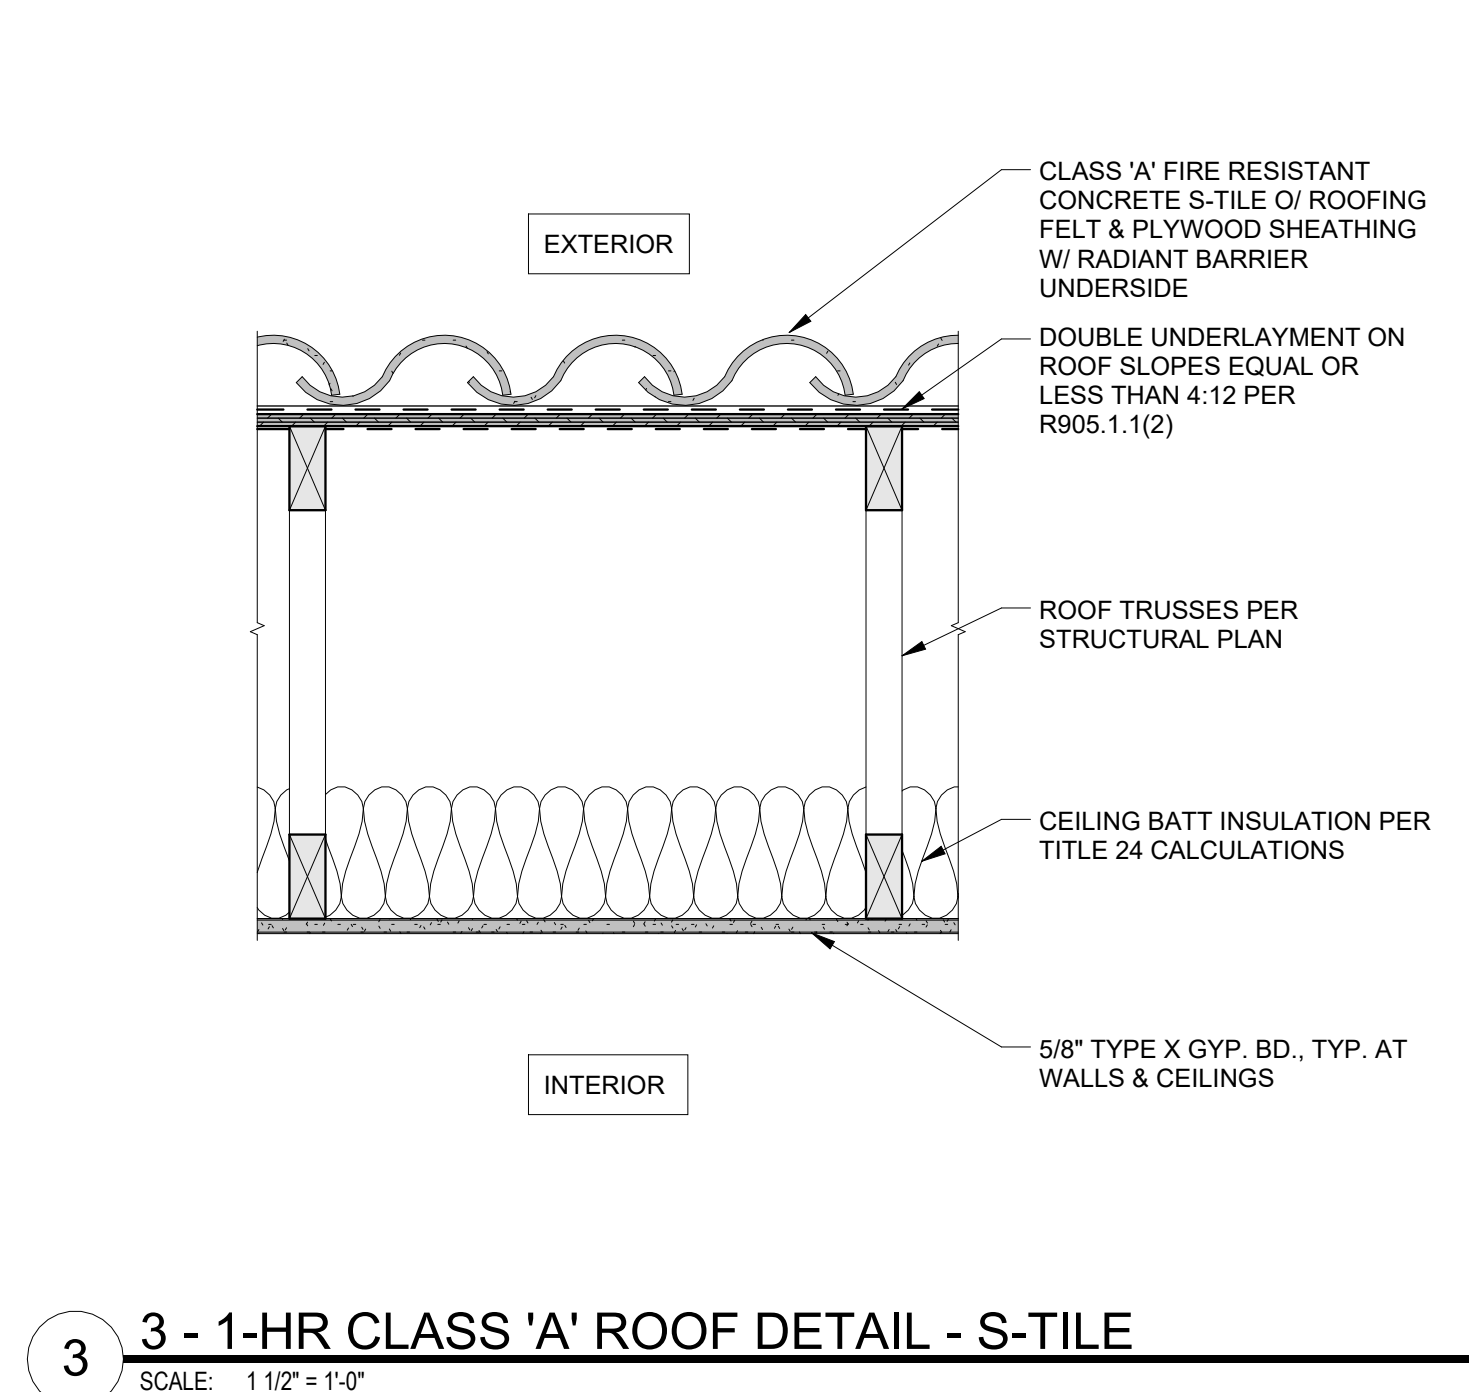

3 3- 1-HR CLASS 'A' ROOF DETAIL - S-TILE
SCALE: 1 1/2" = 1'-0"




SNAPADU
DESIGN HOUSE

YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 1,199 L-SHAPE
CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:
LUIS CALDERON
SnapADU



SIGNATURE

RELEASE	DATE	BY	APP.	RELEASED FOR...
	03/22/2024	LAG		

GENERIC ROOF &
MISC. DETAILS

A500

22040

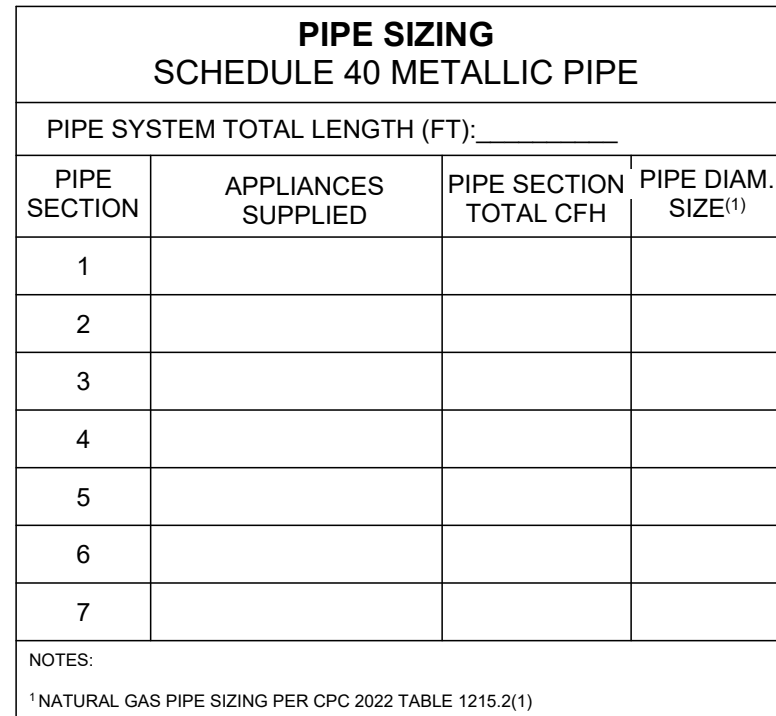


6



7

SCALE: 3/8" = 1'-0"




(2)

SCALE: 3" = 1'-0"




3

SCALE: 3" = 1'-0"




Autodesk Docs://22040_City of Chula Vista/22040_City of Chula Vista_1199
L-Shape_V2_CD_RVT22.rvt 3/23/2024 12:47:47 PM

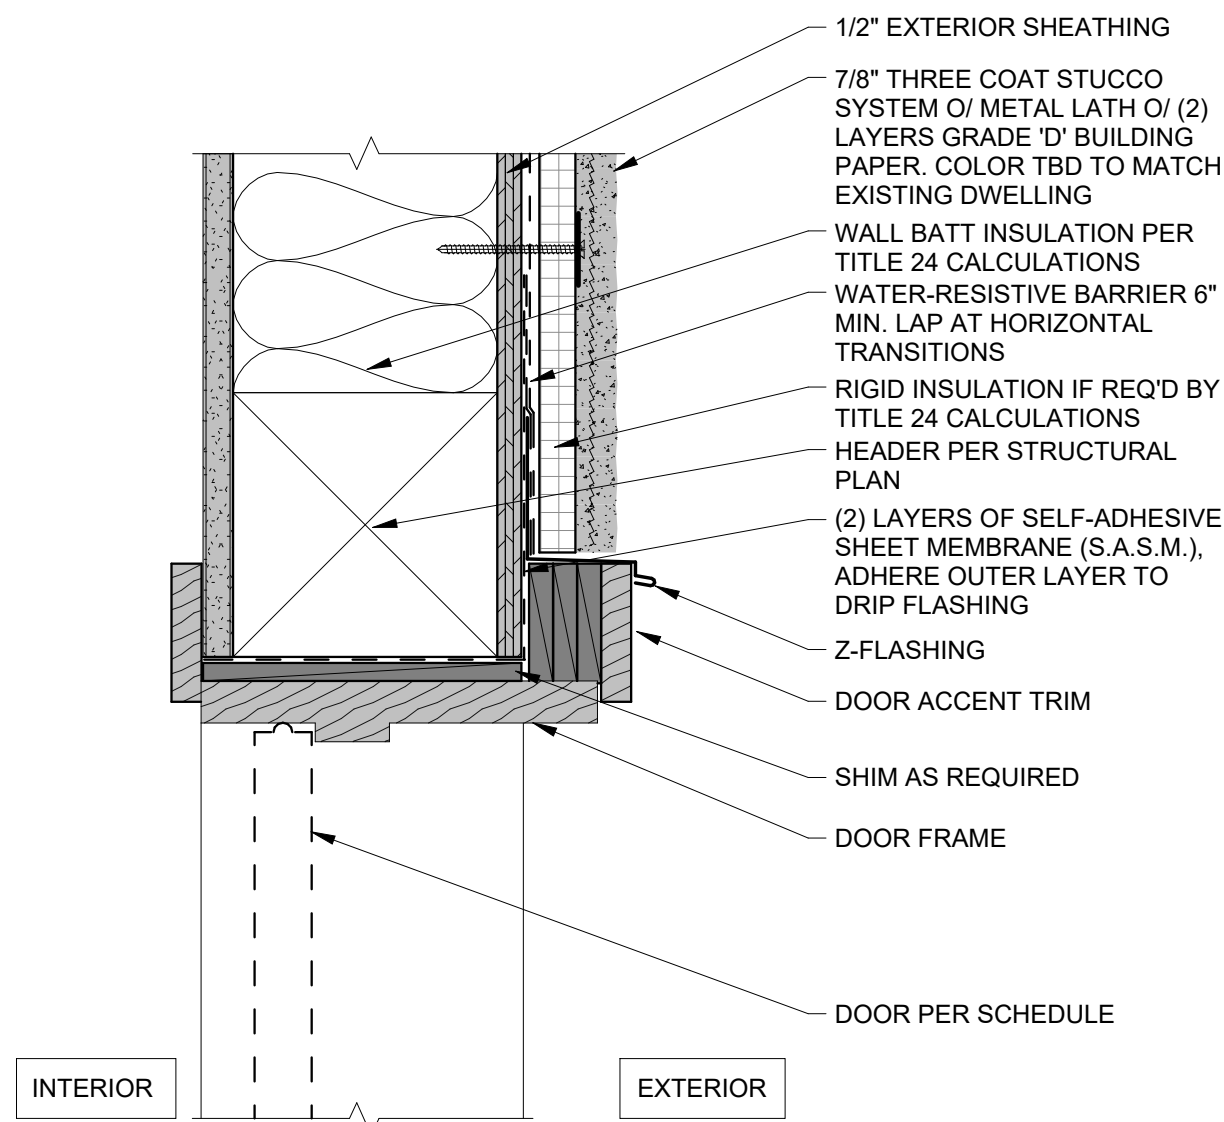


10 DOOR - EXTERIOR HEAD @ STUCCO
W/ CONT. INSULATION (JAMB SIM.)

SCALE: 3" = 1'-0"

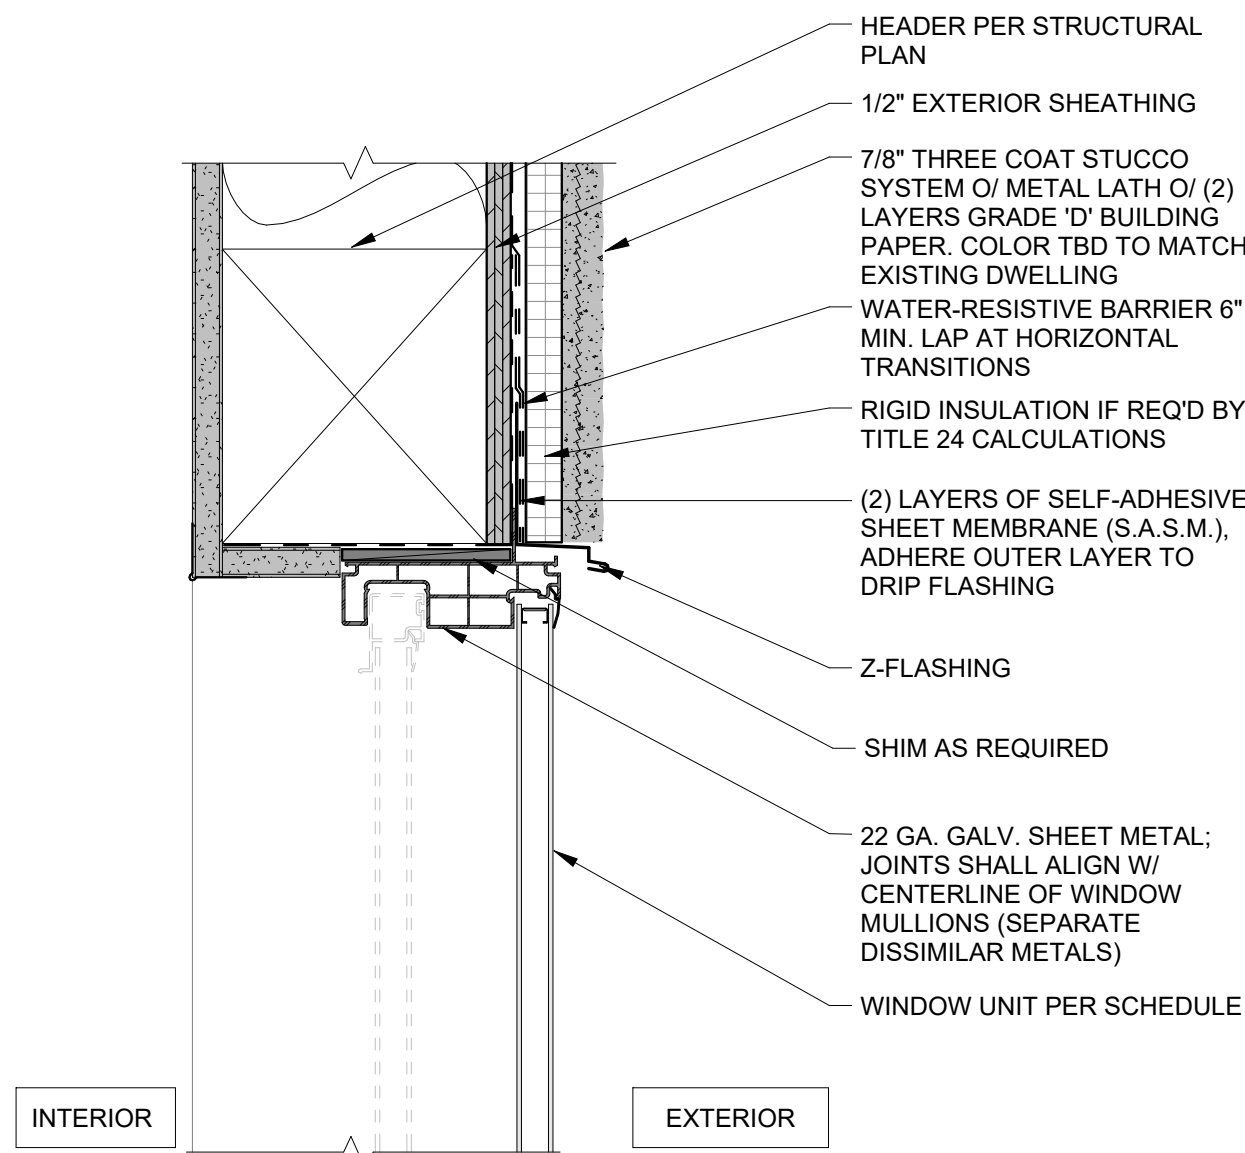


7 WINDOW - EXTERIOR HEAD @ STUCCO
W/ CONT. INSULATION (JAMB SIM.)

SCALE: 3" = 1'-0"

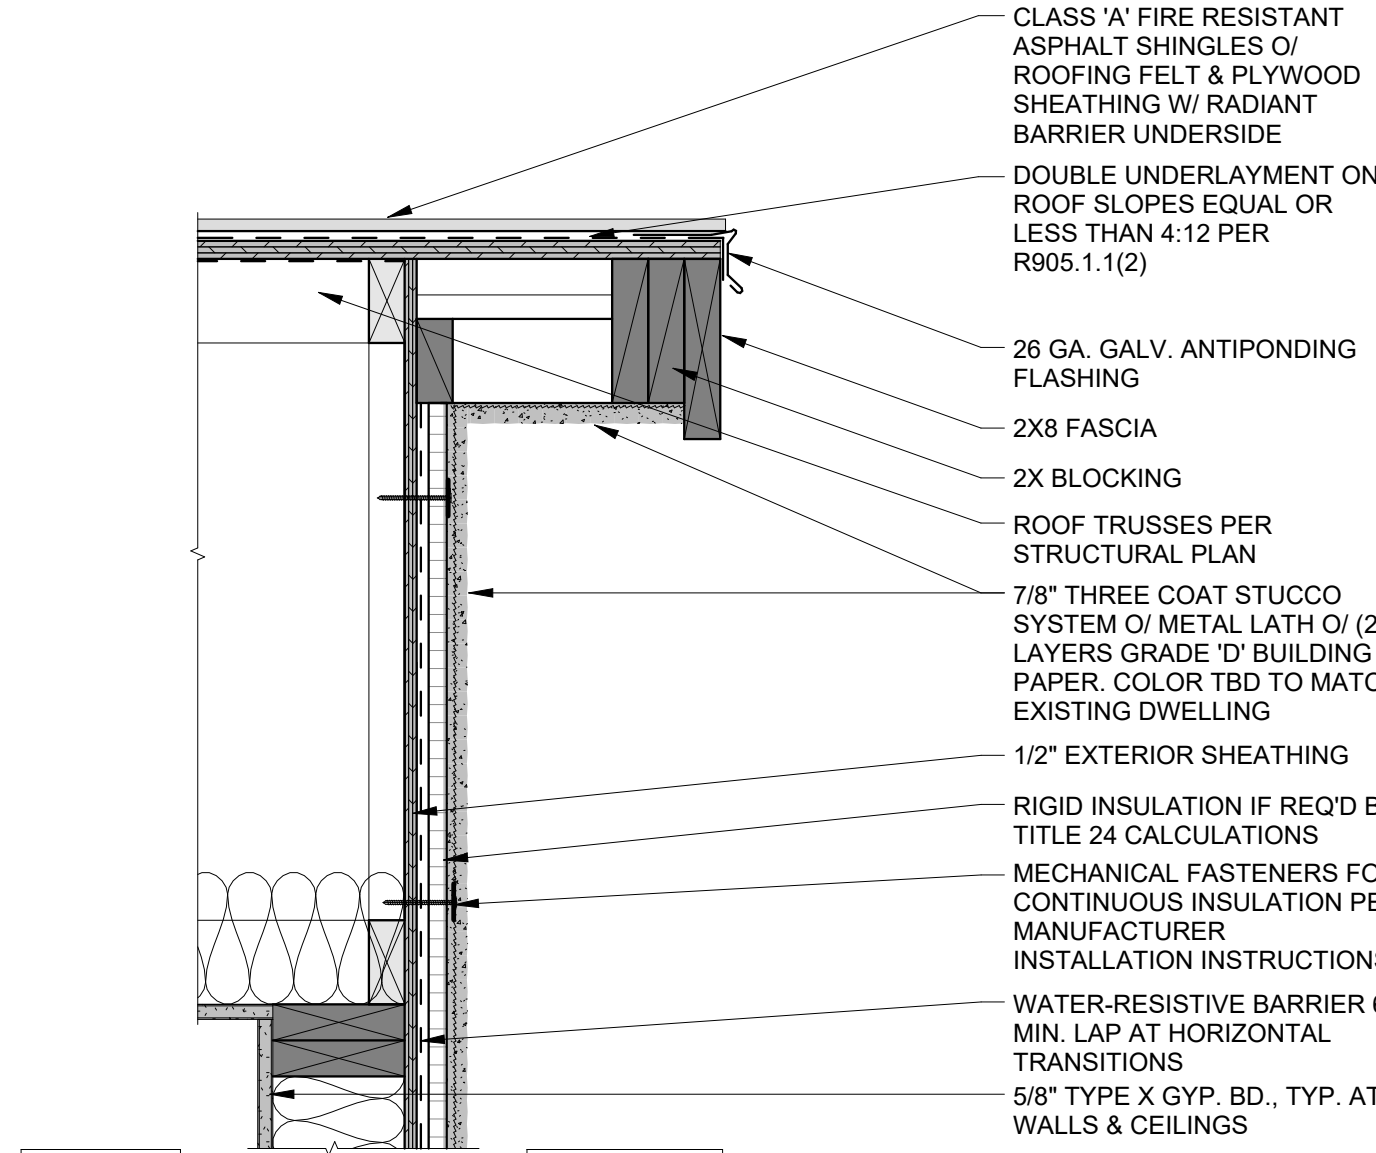


4 A1 - ROOF RAKE - SHINGLE PROTECTED
W/ CONT. INSULATION AND STUCCO

SCALE: 1 1/2" = 1'-0"

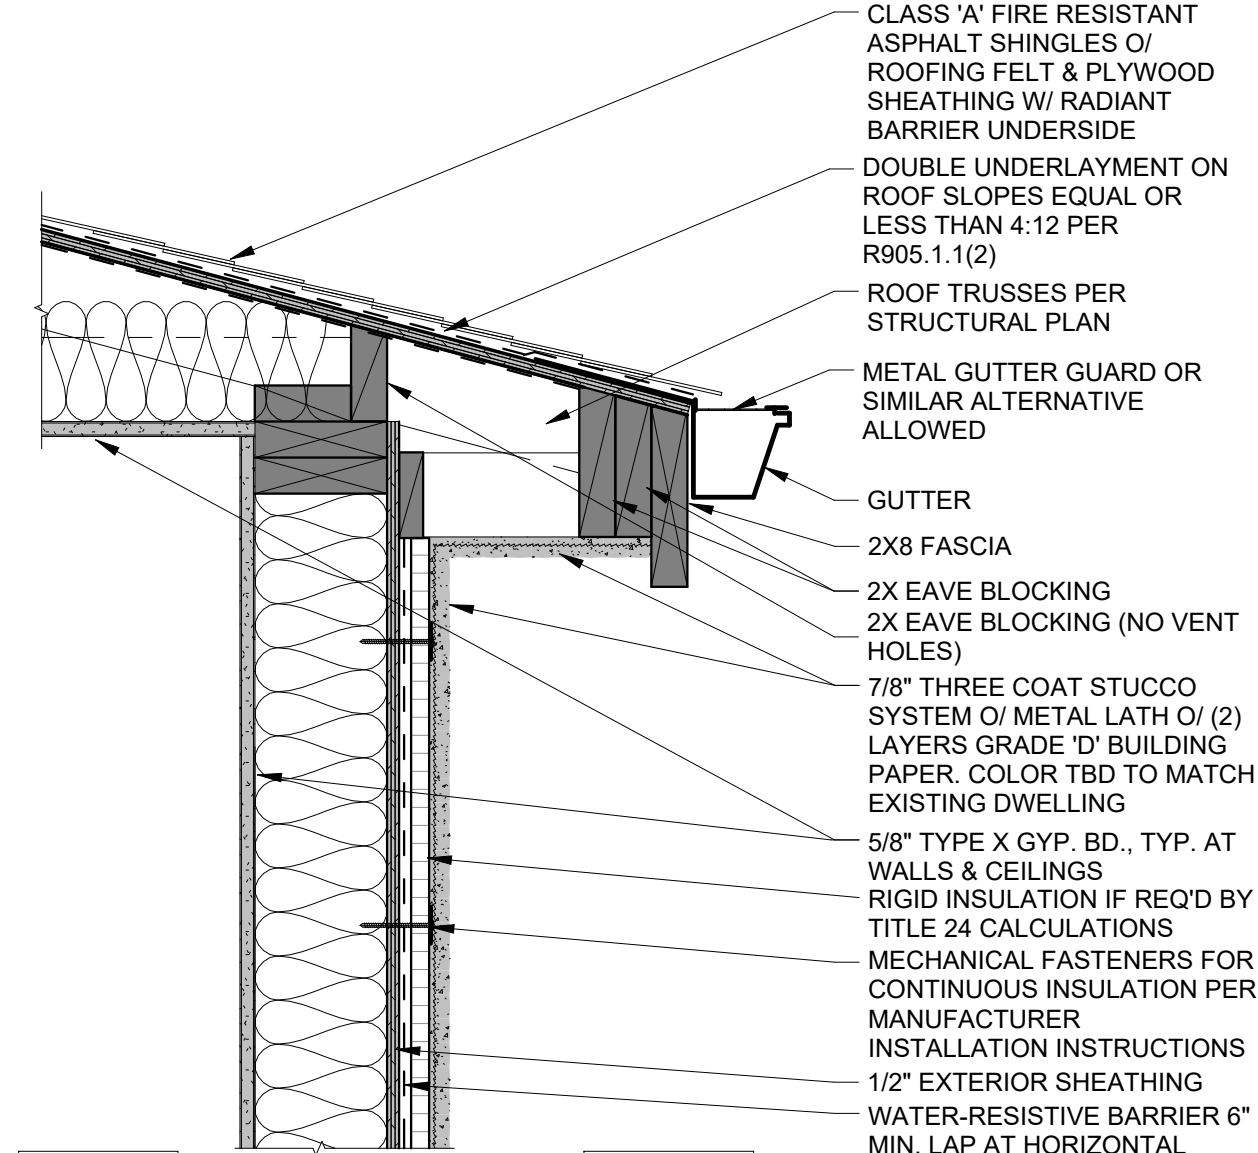


1 A1 - ROOF EAVE - SHINGLE PROTECTED
W/ CONT. INSULATION AND STUCCO

SCALE: 1 1/2" = 1'-0"

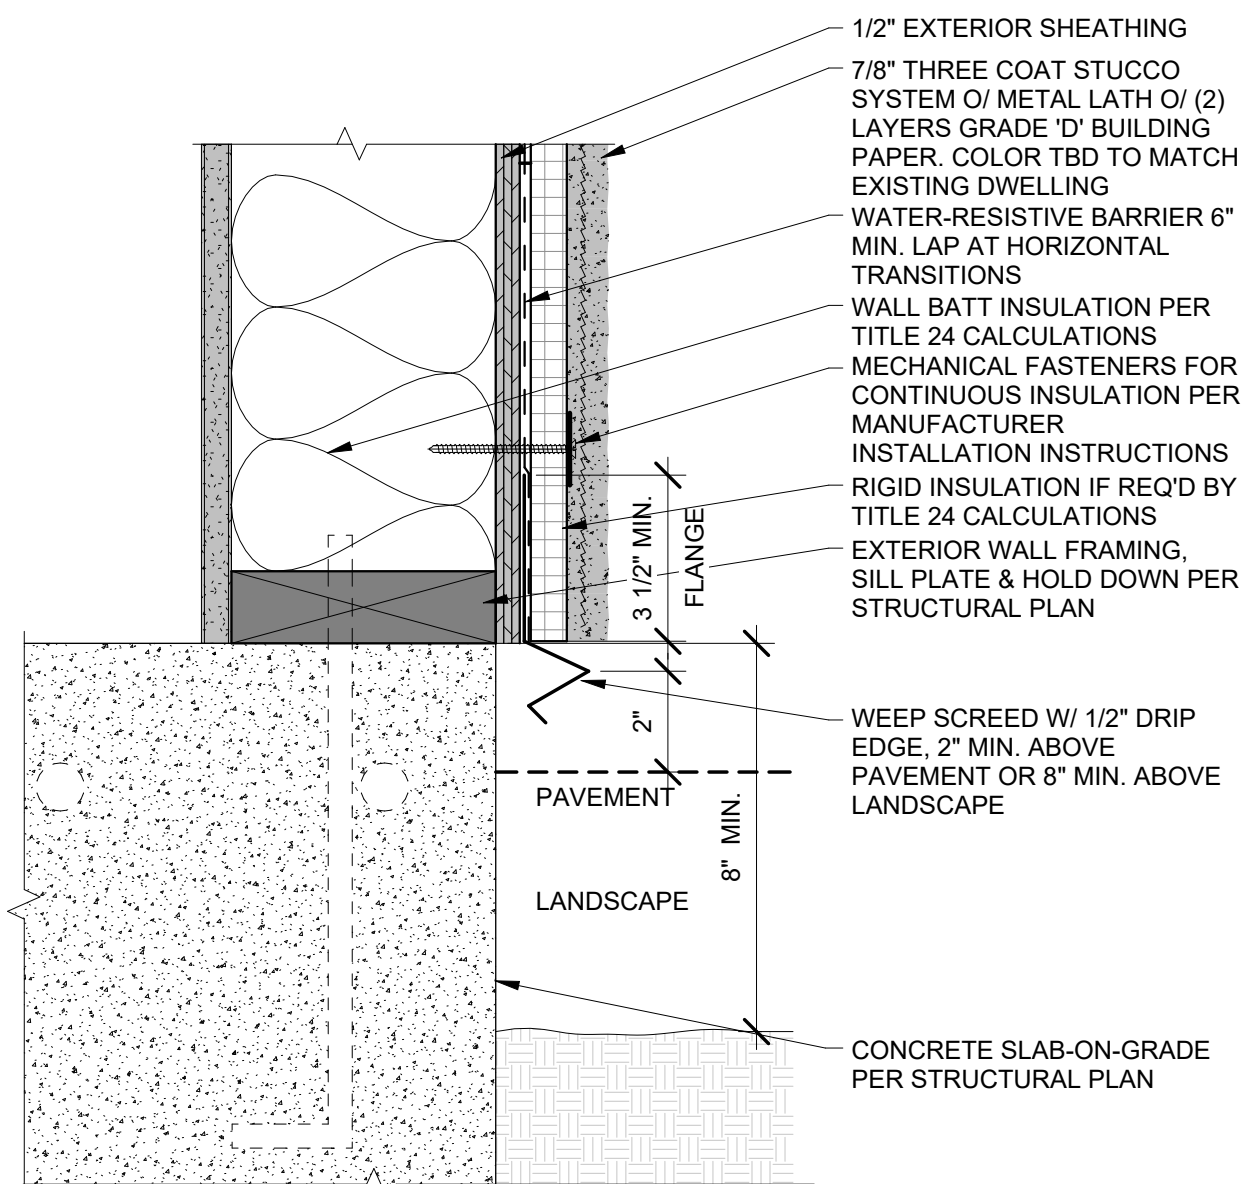


11 WALL - EXTERIOR STUCCO SCREED
W/ CONT. INSULATION

SCALE: 3" = 1'-0"

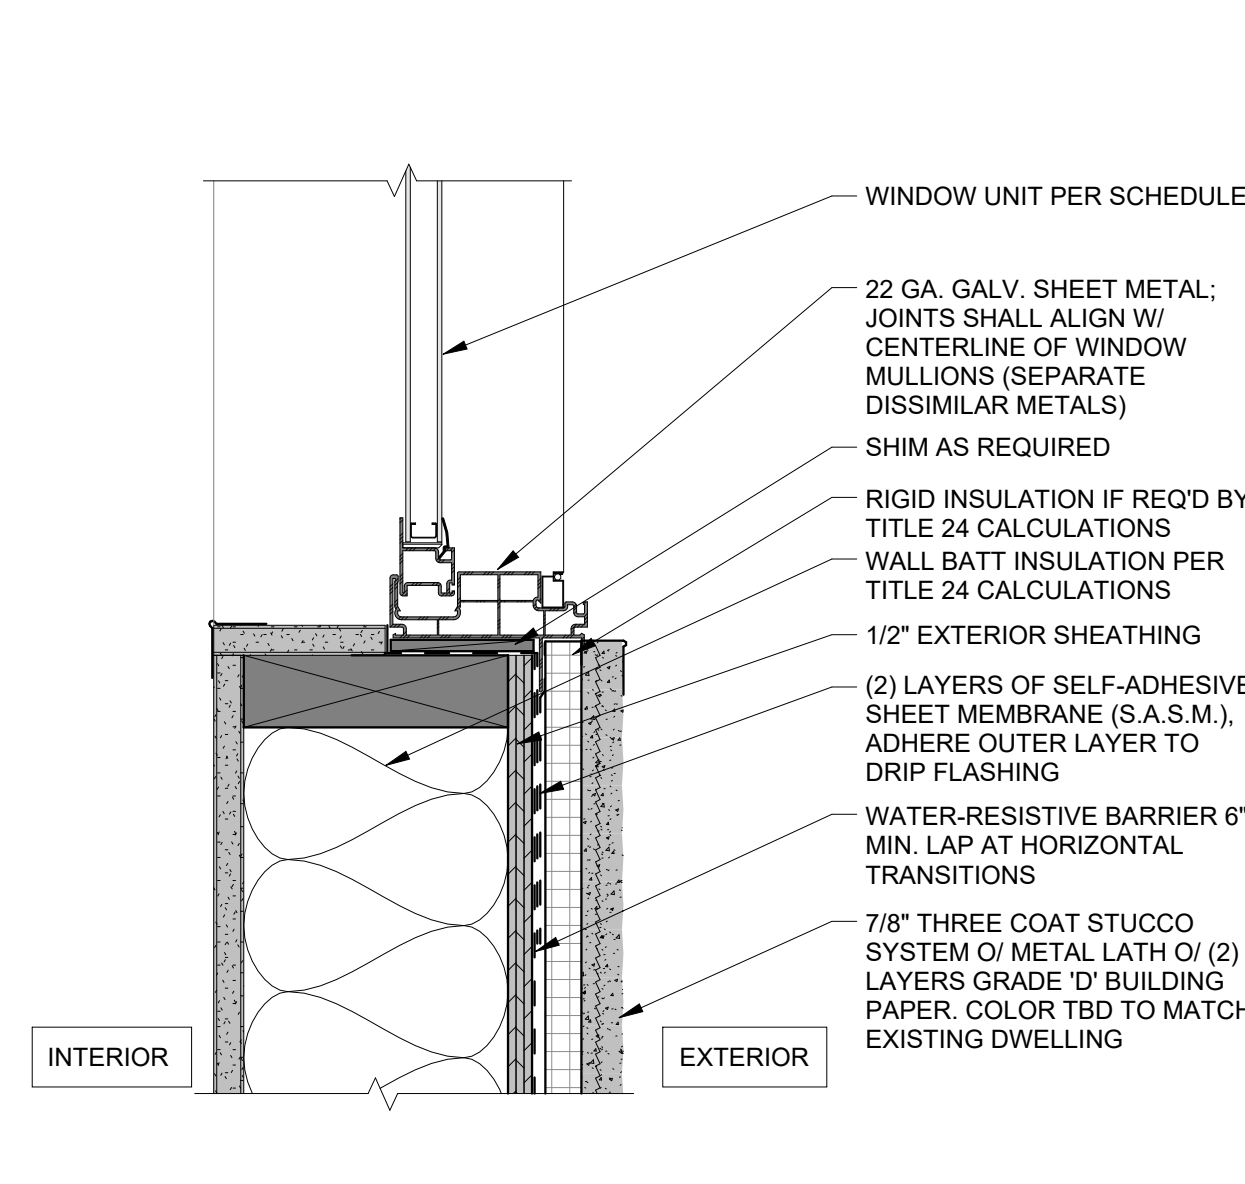


8 WINDOW - EXTERIOR SILL @ STUCCO
W/ CONT. INSULATION

SCALE: 3" = 1'-0"

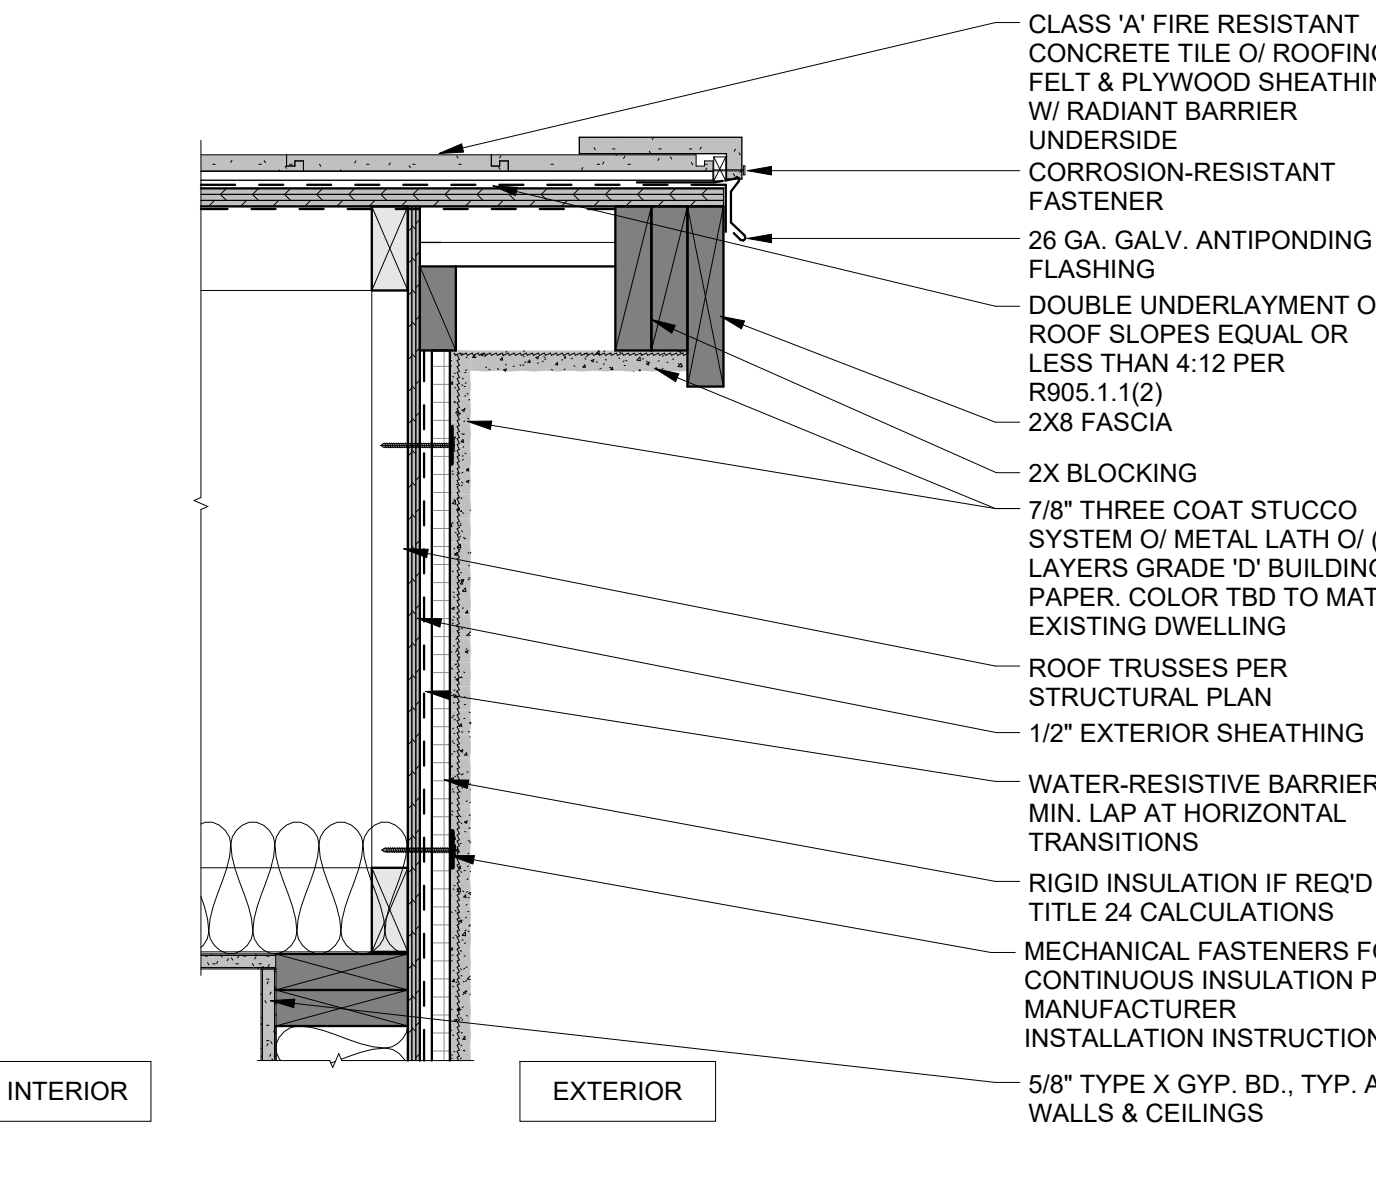


5 A2 - ROOF RAKE - CEMENT PROTECTED
W/ CONT. INSULATION AND STUCCO

SCALE: 1 1/2" = 1'-0"

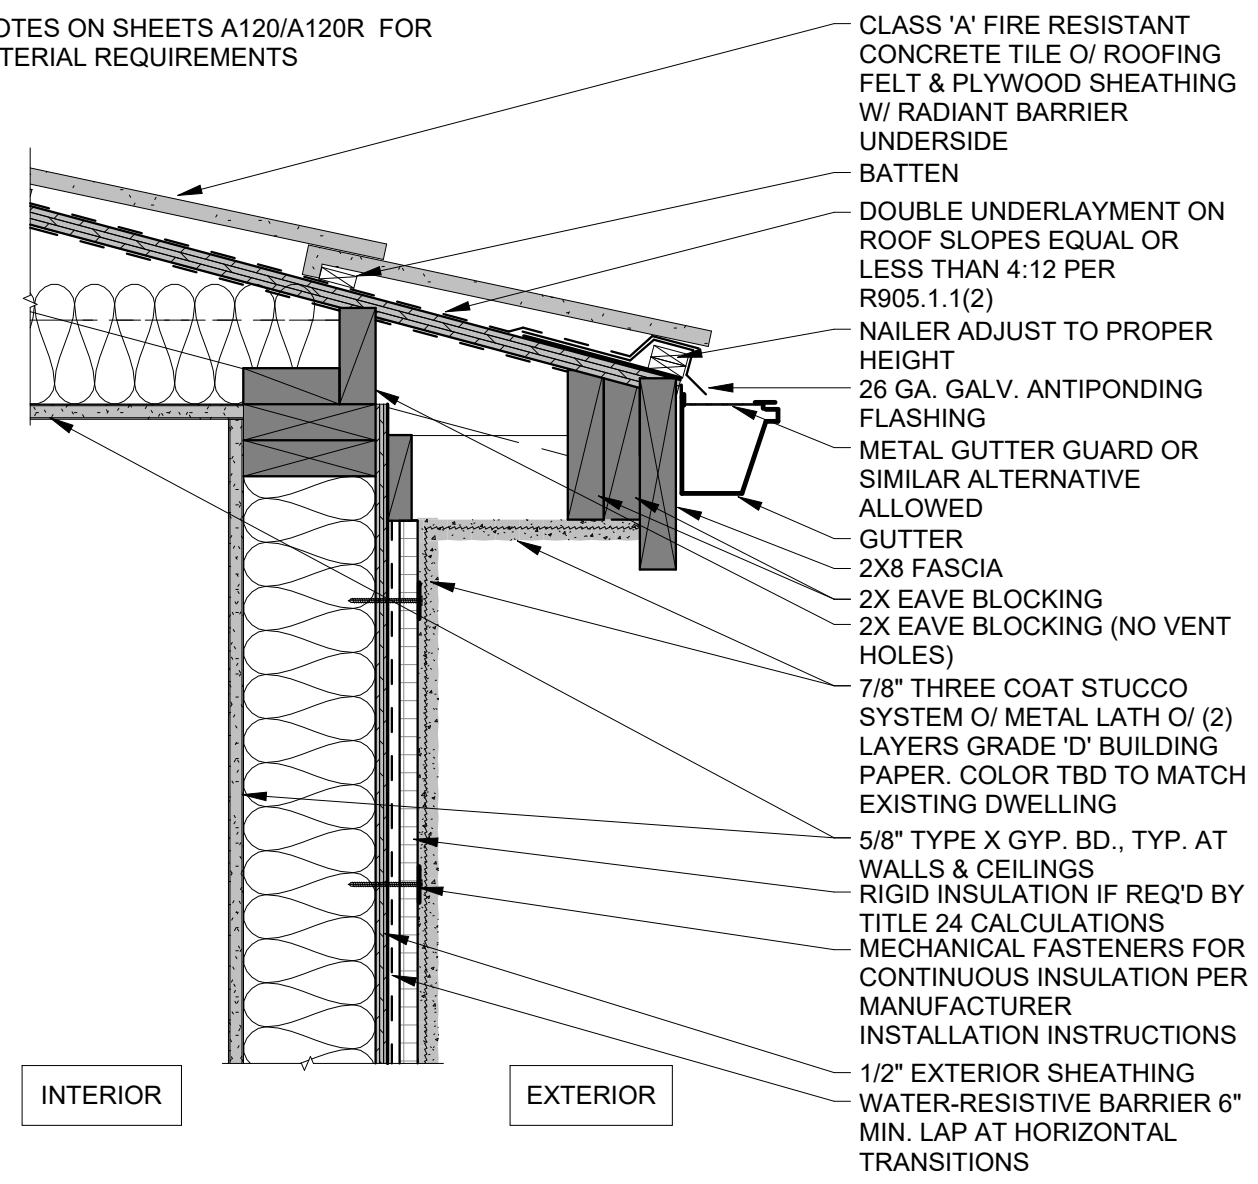


2 A2 - ROOF EAVE - CEMENT PROTECTED
W/ CONT. INSULATION AND STUCCO

SCALE: 1 1/2" = 1'-0"

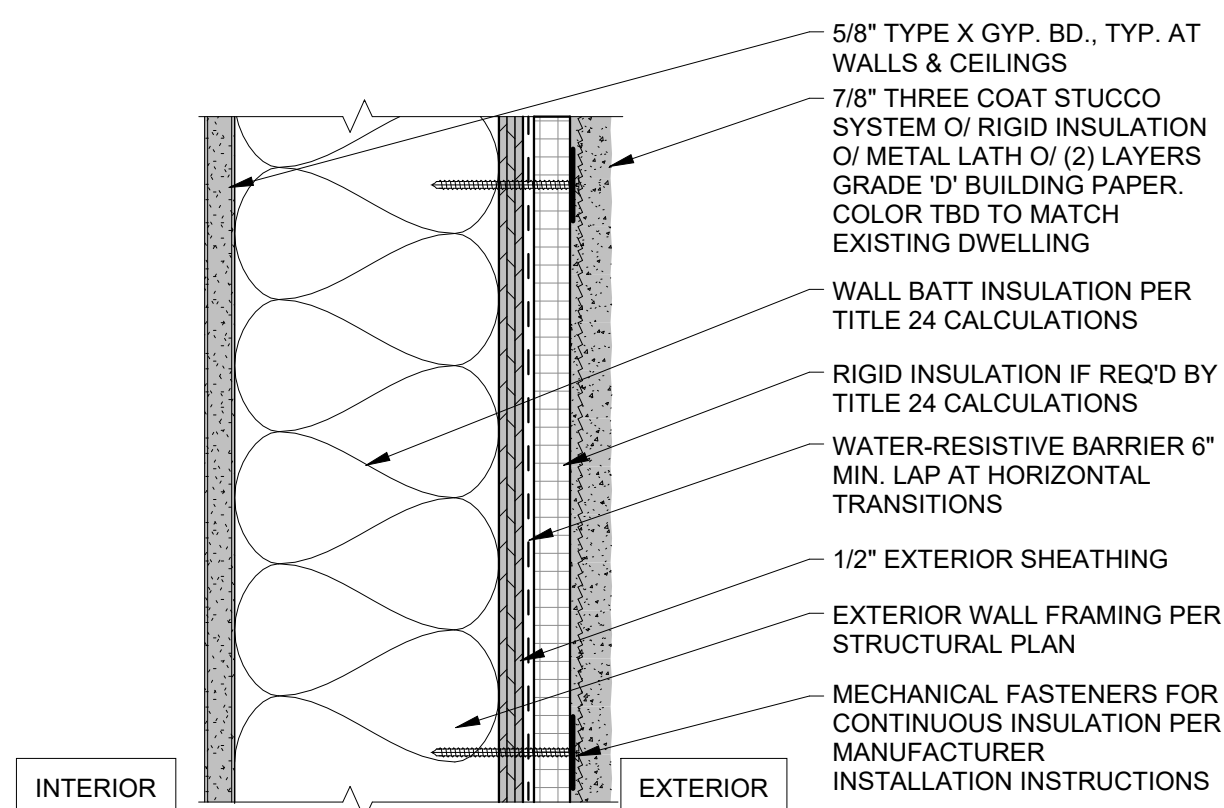


12 A - WALL - EXTERIOR 1-HOUR RATED - STUCCO
W/ CONT. INSULATION

SCALE: 3" = 1'-0"

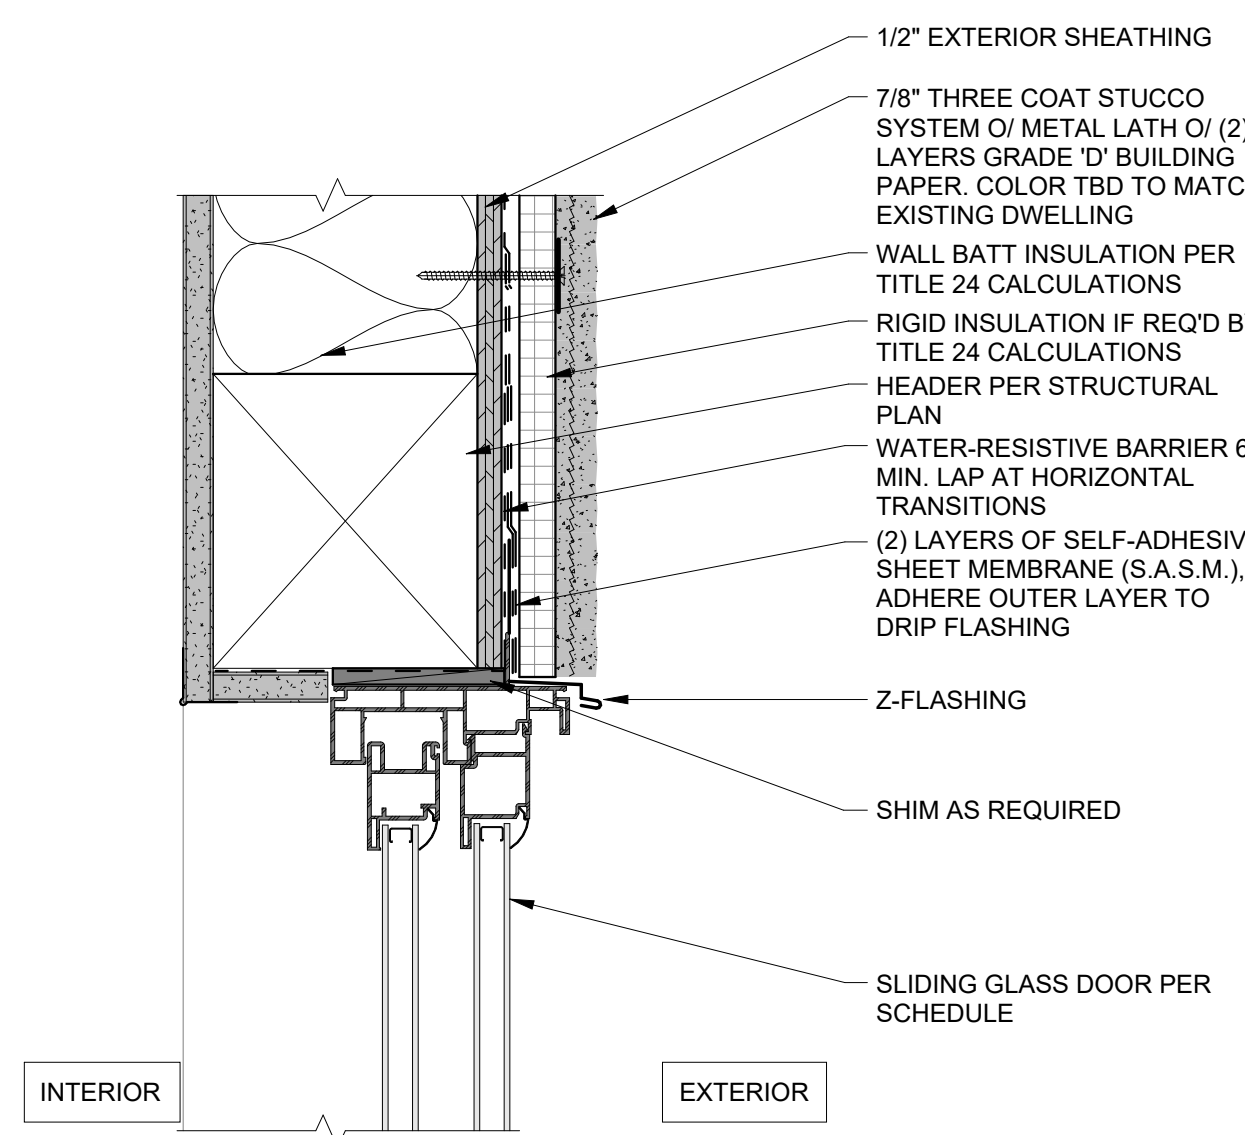


9 DOOR - SLIDING GLASS DOOR HEAD @ STUCCO
W/ CONT. INSULATION (JAMB SIM.)

SCALE: 3" = 1'-0"

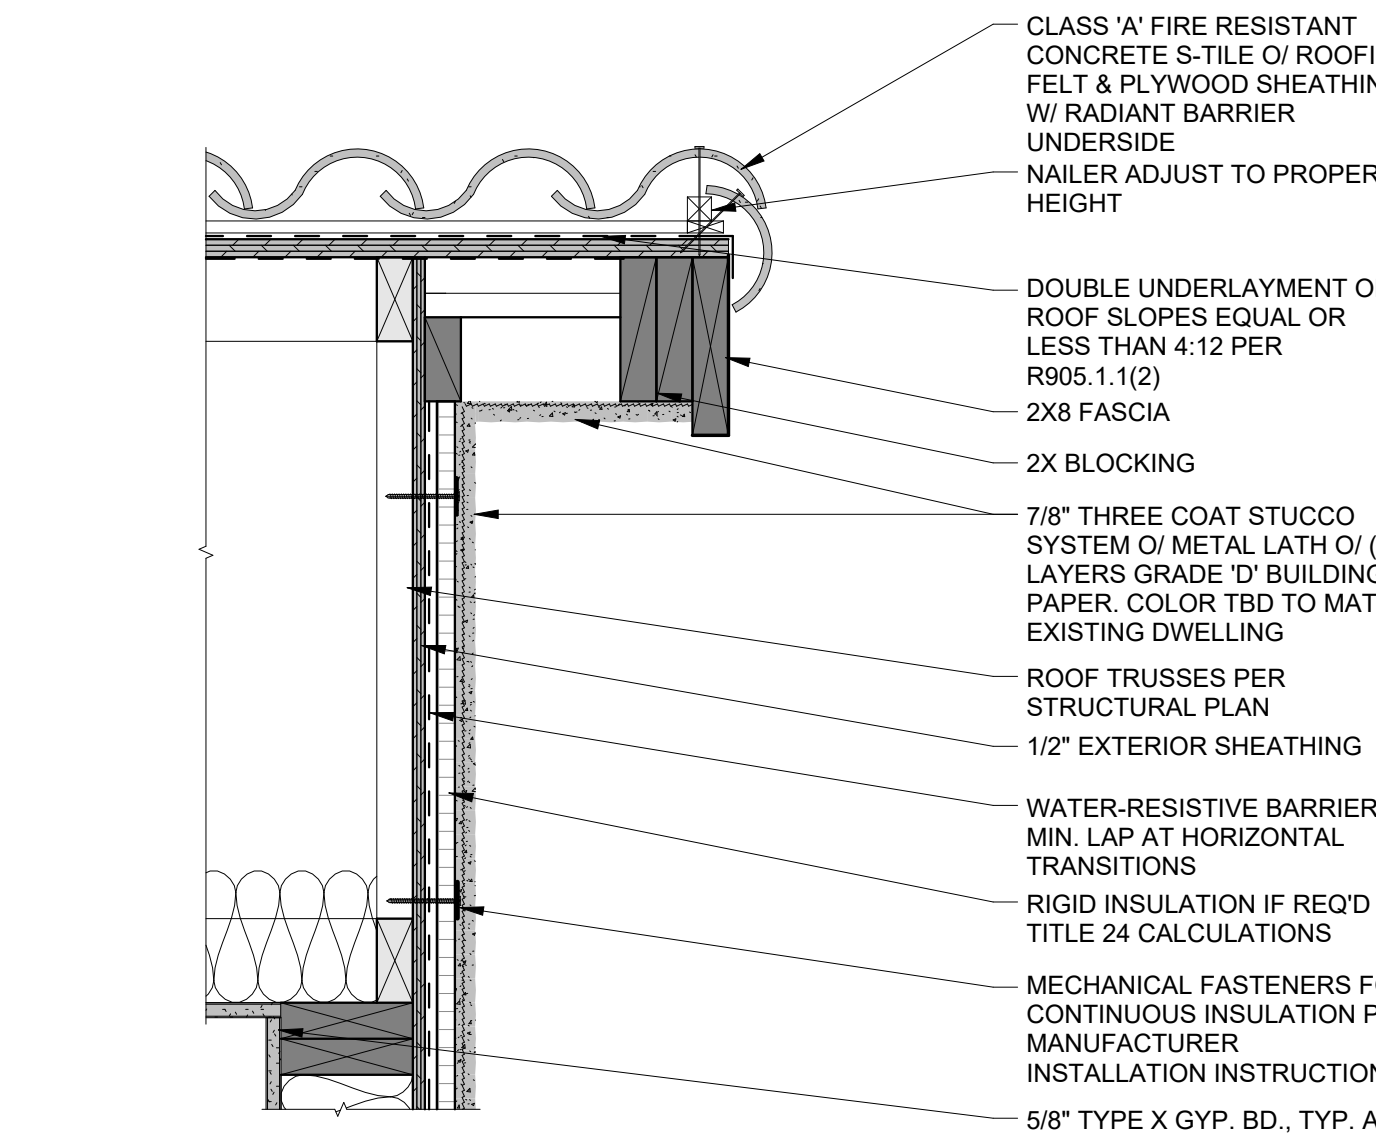

6 A3 - ROOF RAKE - S-TILE PROTECTED
W/ CONT. INSULATION AND STUCCO

SCALE: 1 1/2" = 1'-0"

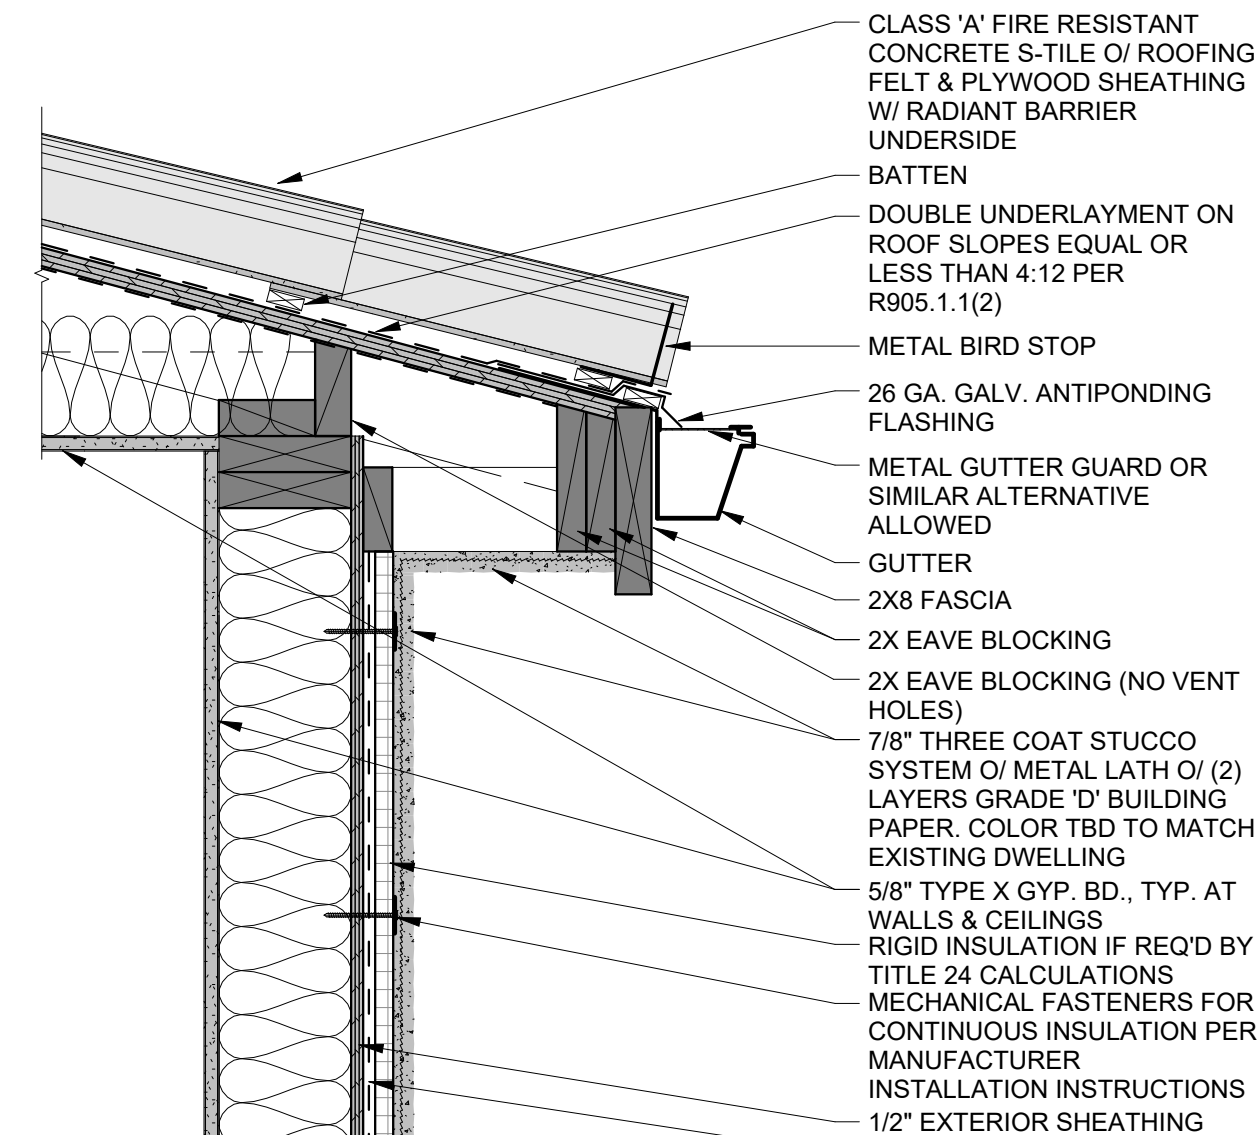

3 A3 - ROOF EAVE - S-TILE PROTECTED
W/ CONT. INSULATION AND STUCCO

SCALE: 1 1/2" = 1'-0"



SNAPADU
DESIGN HOUSE

YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 1,199 L-SHAPE
CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:
LUIS CALDERON
SnapADU

Luis Calderon
SIGNATURE













RELEASE	DATE	BY	APP.	RELEASED FOR...
	03/22/2024		LAC	

STUCCO DETAILS

A510

22040

Autodesk Docs://22040_City of Chula Vista/22040_City of Chula Vista_1199 L-Shape_V2_CD_RVT22.rvt 3/23/2024 12:47:48 PM

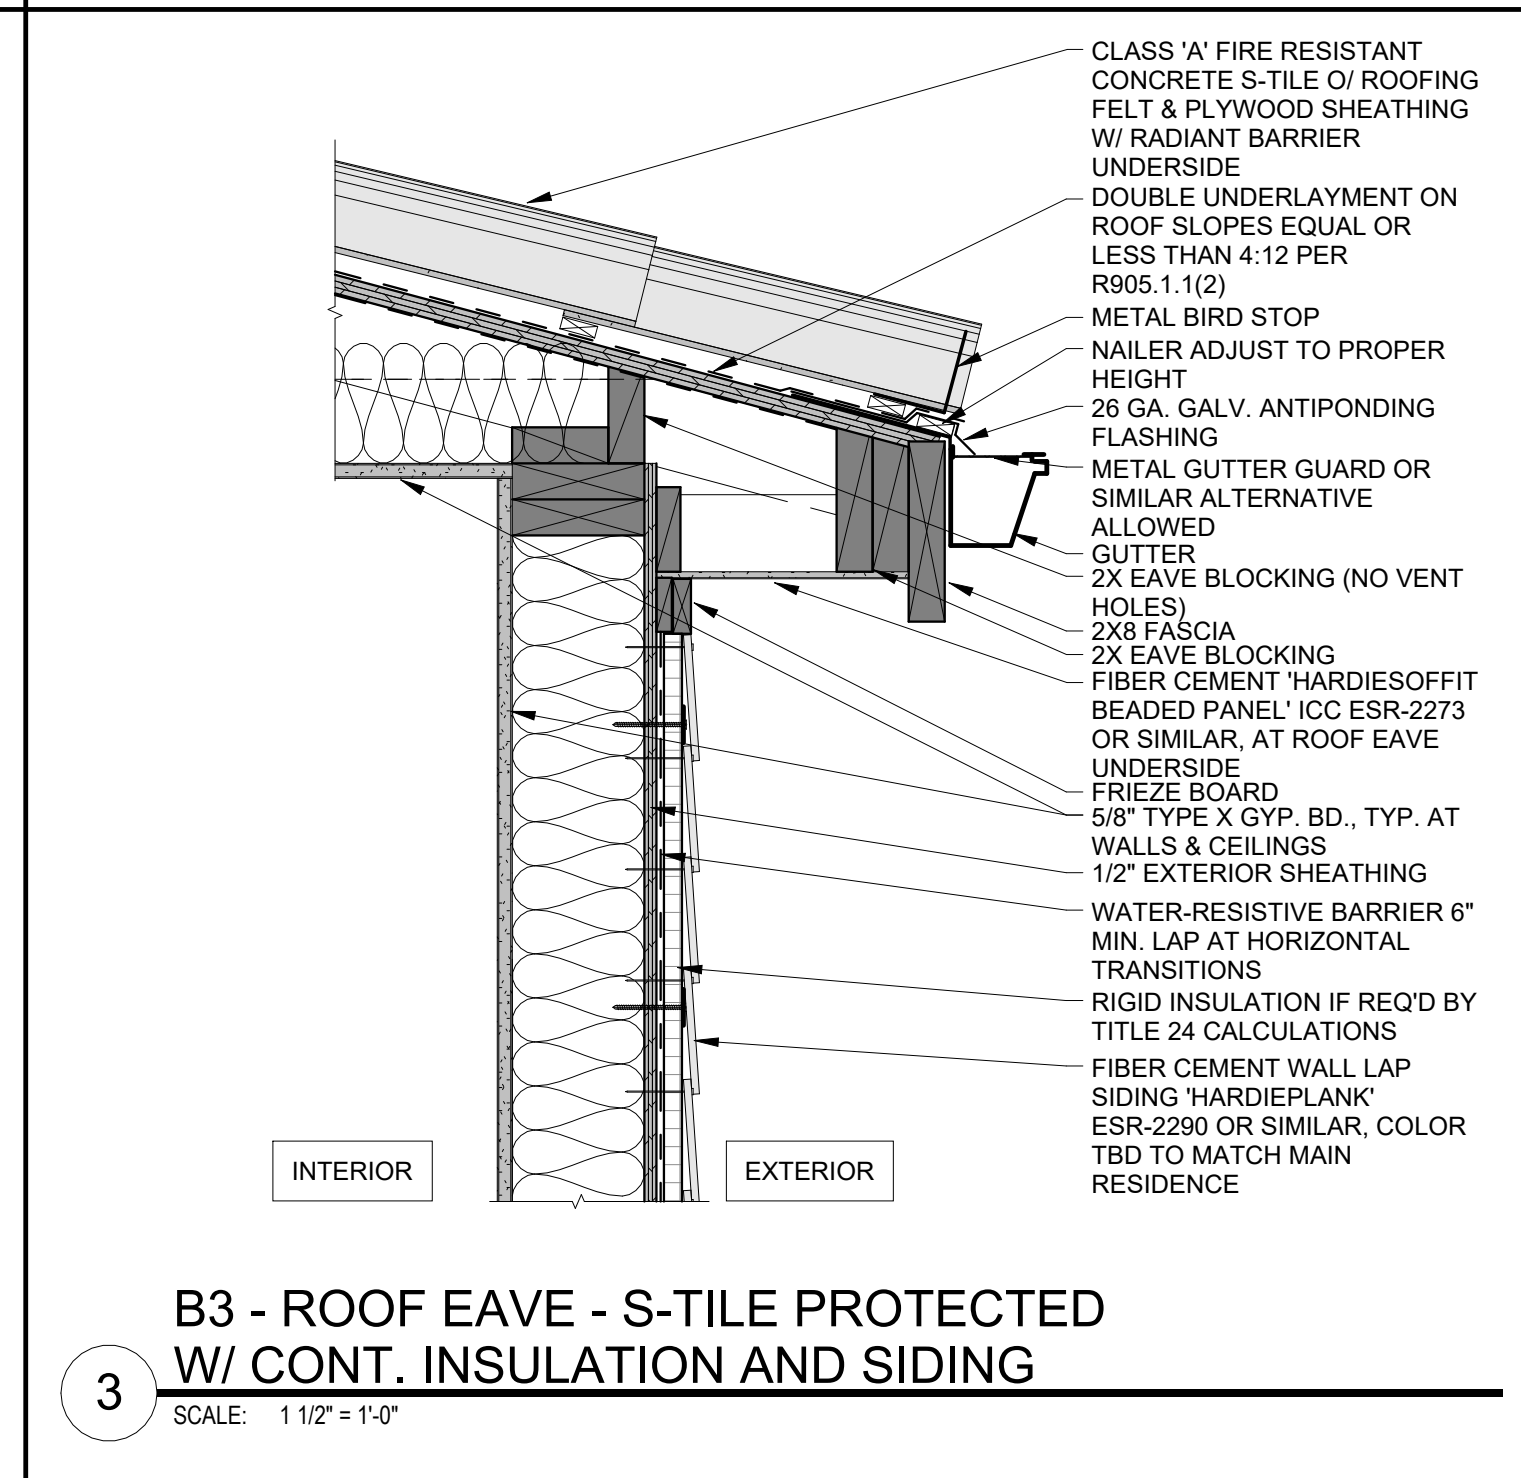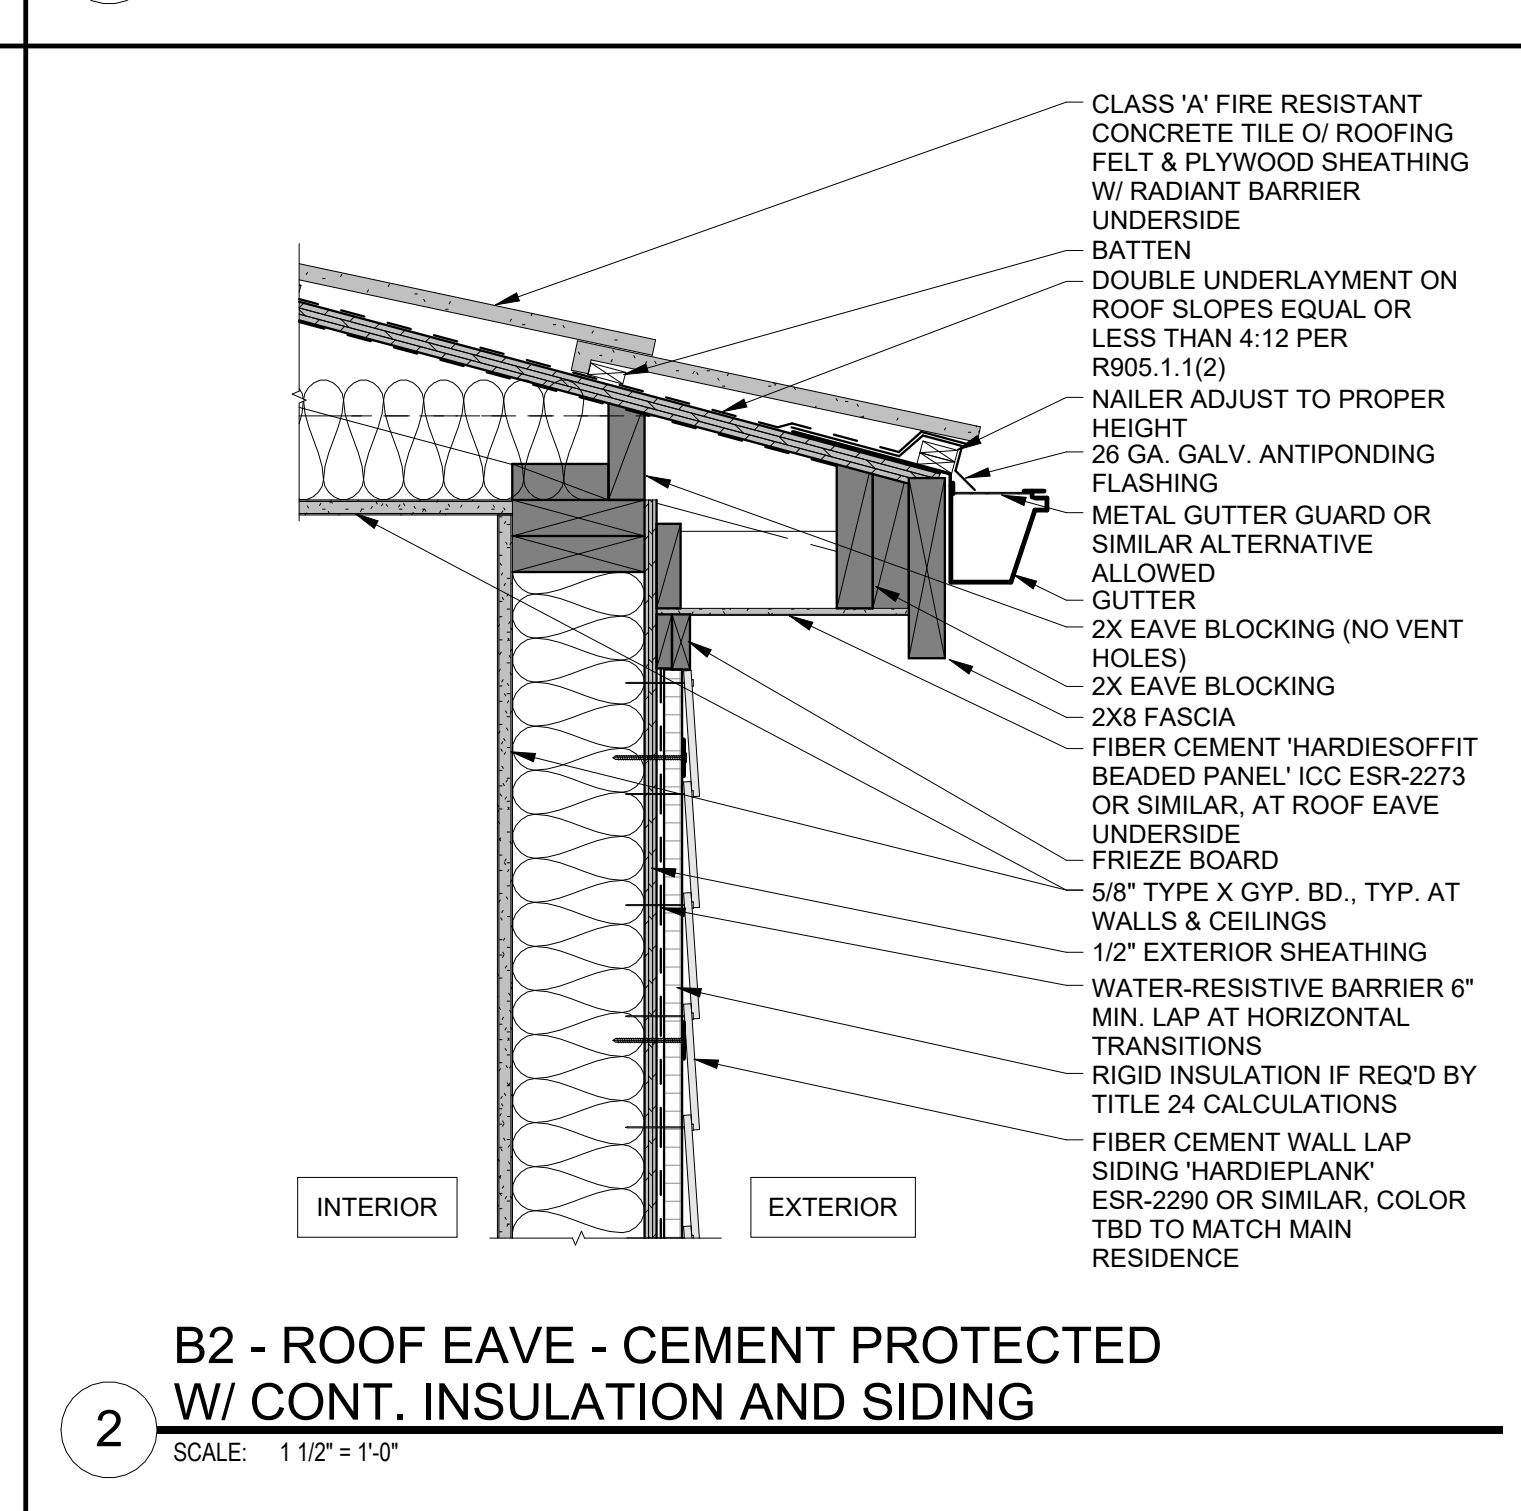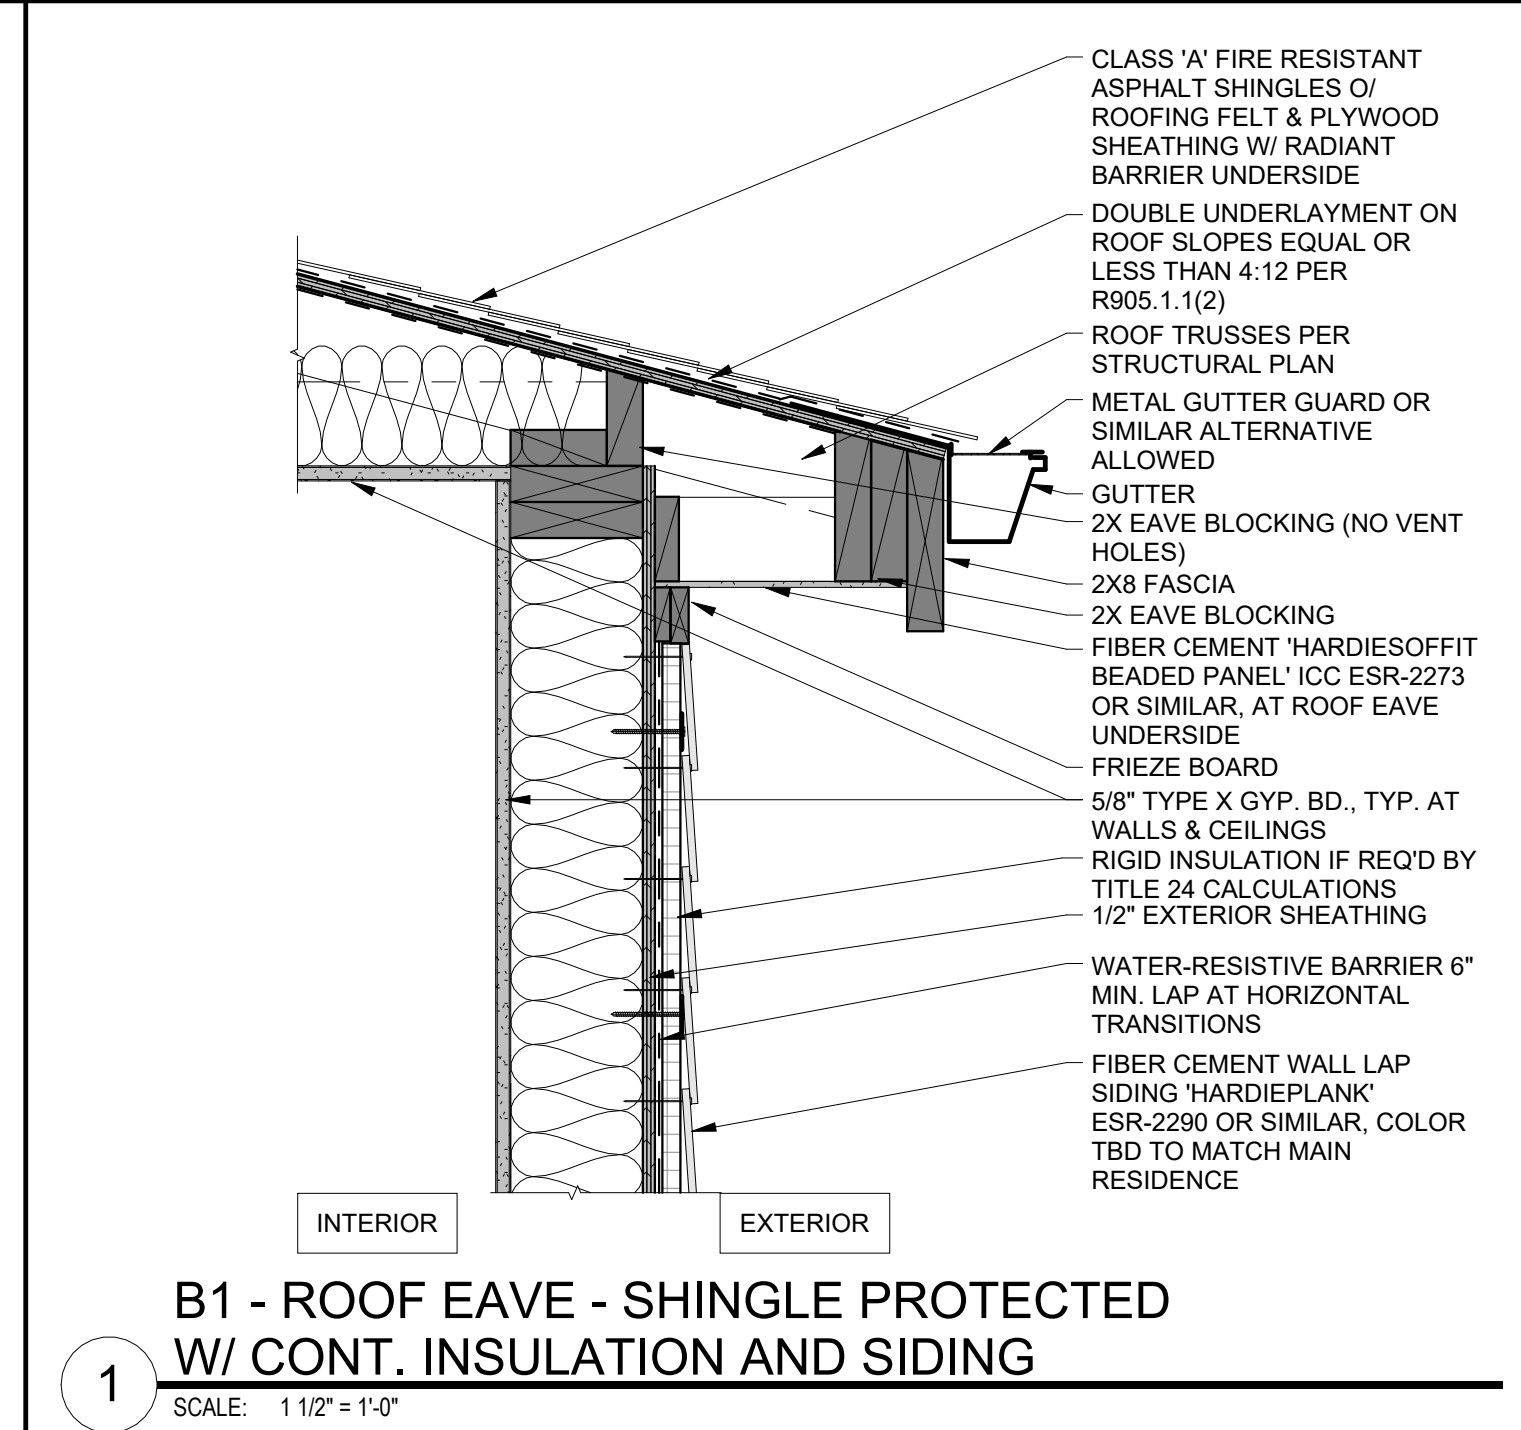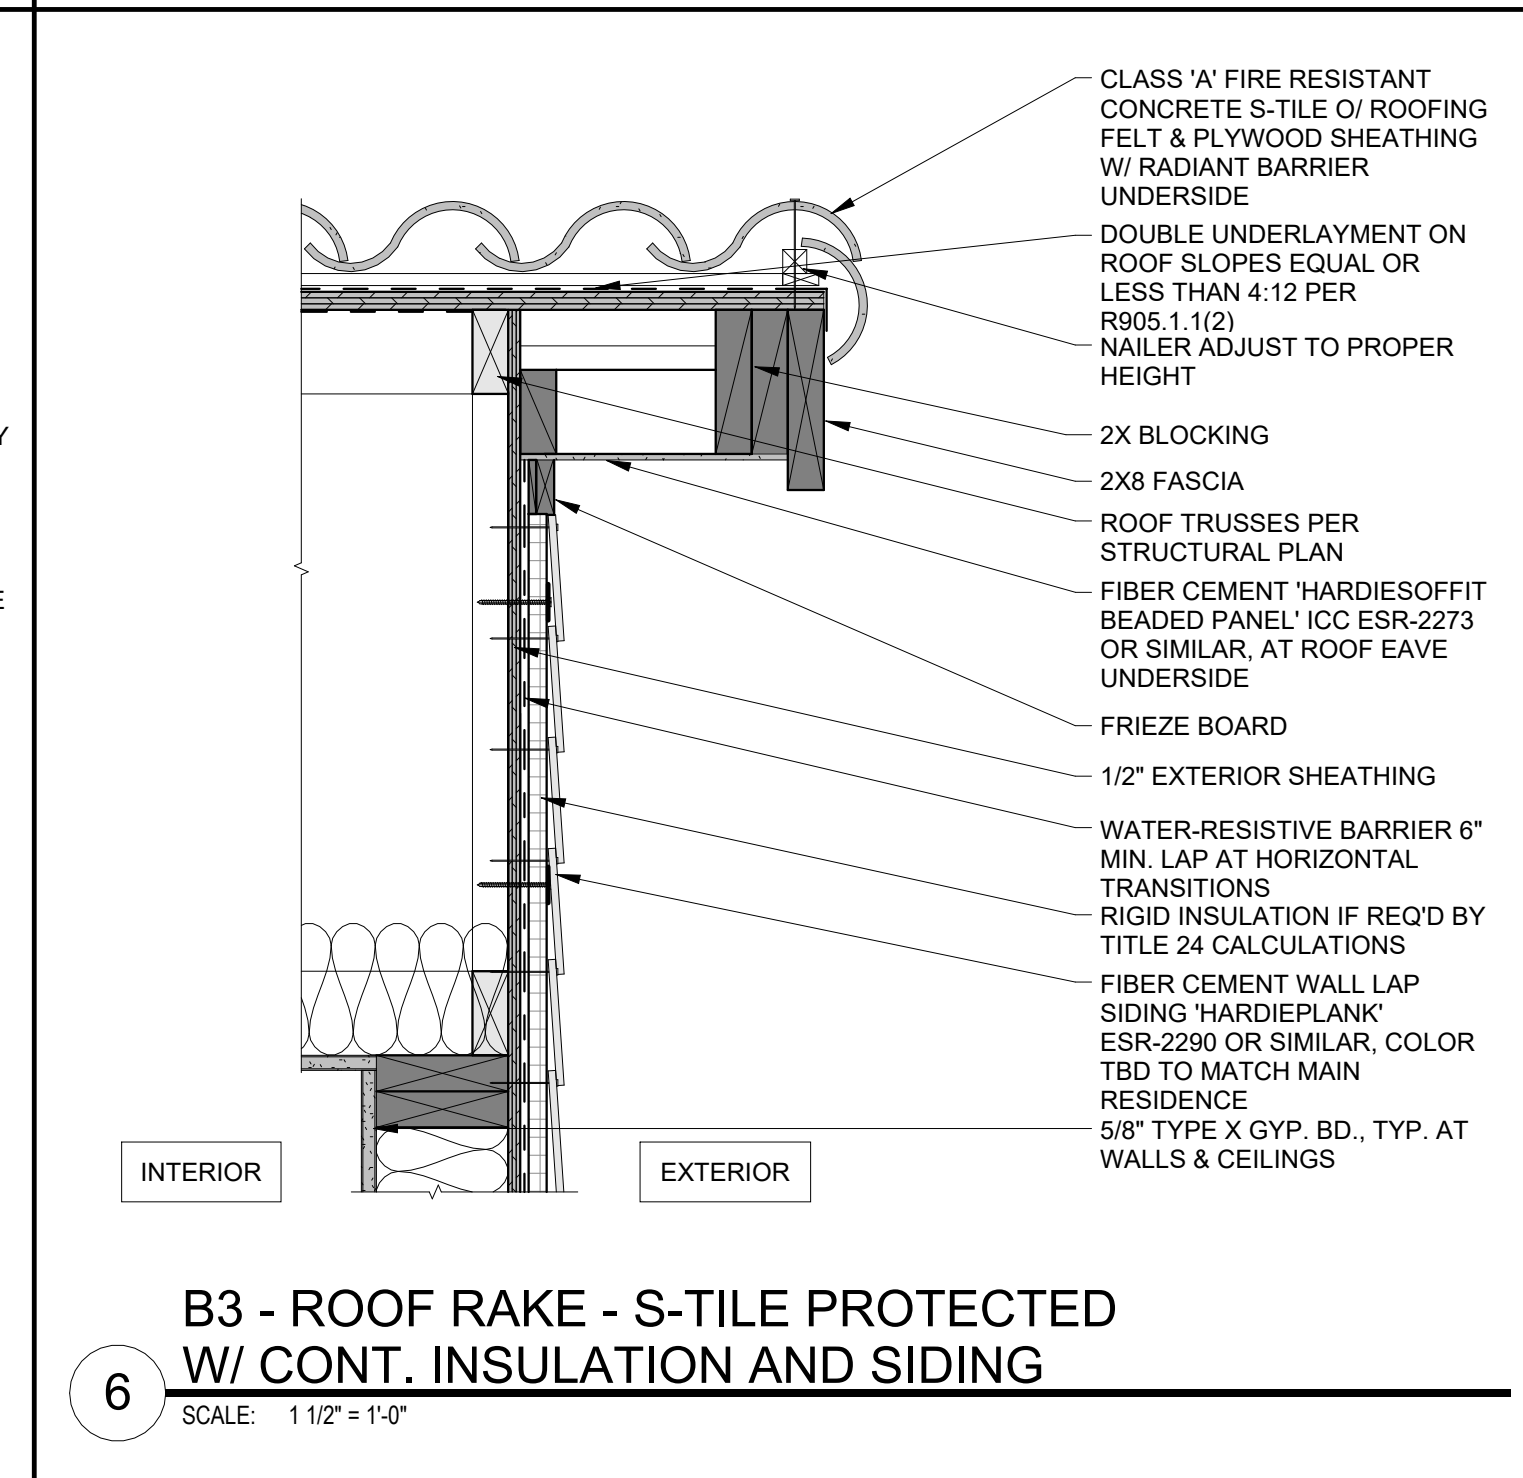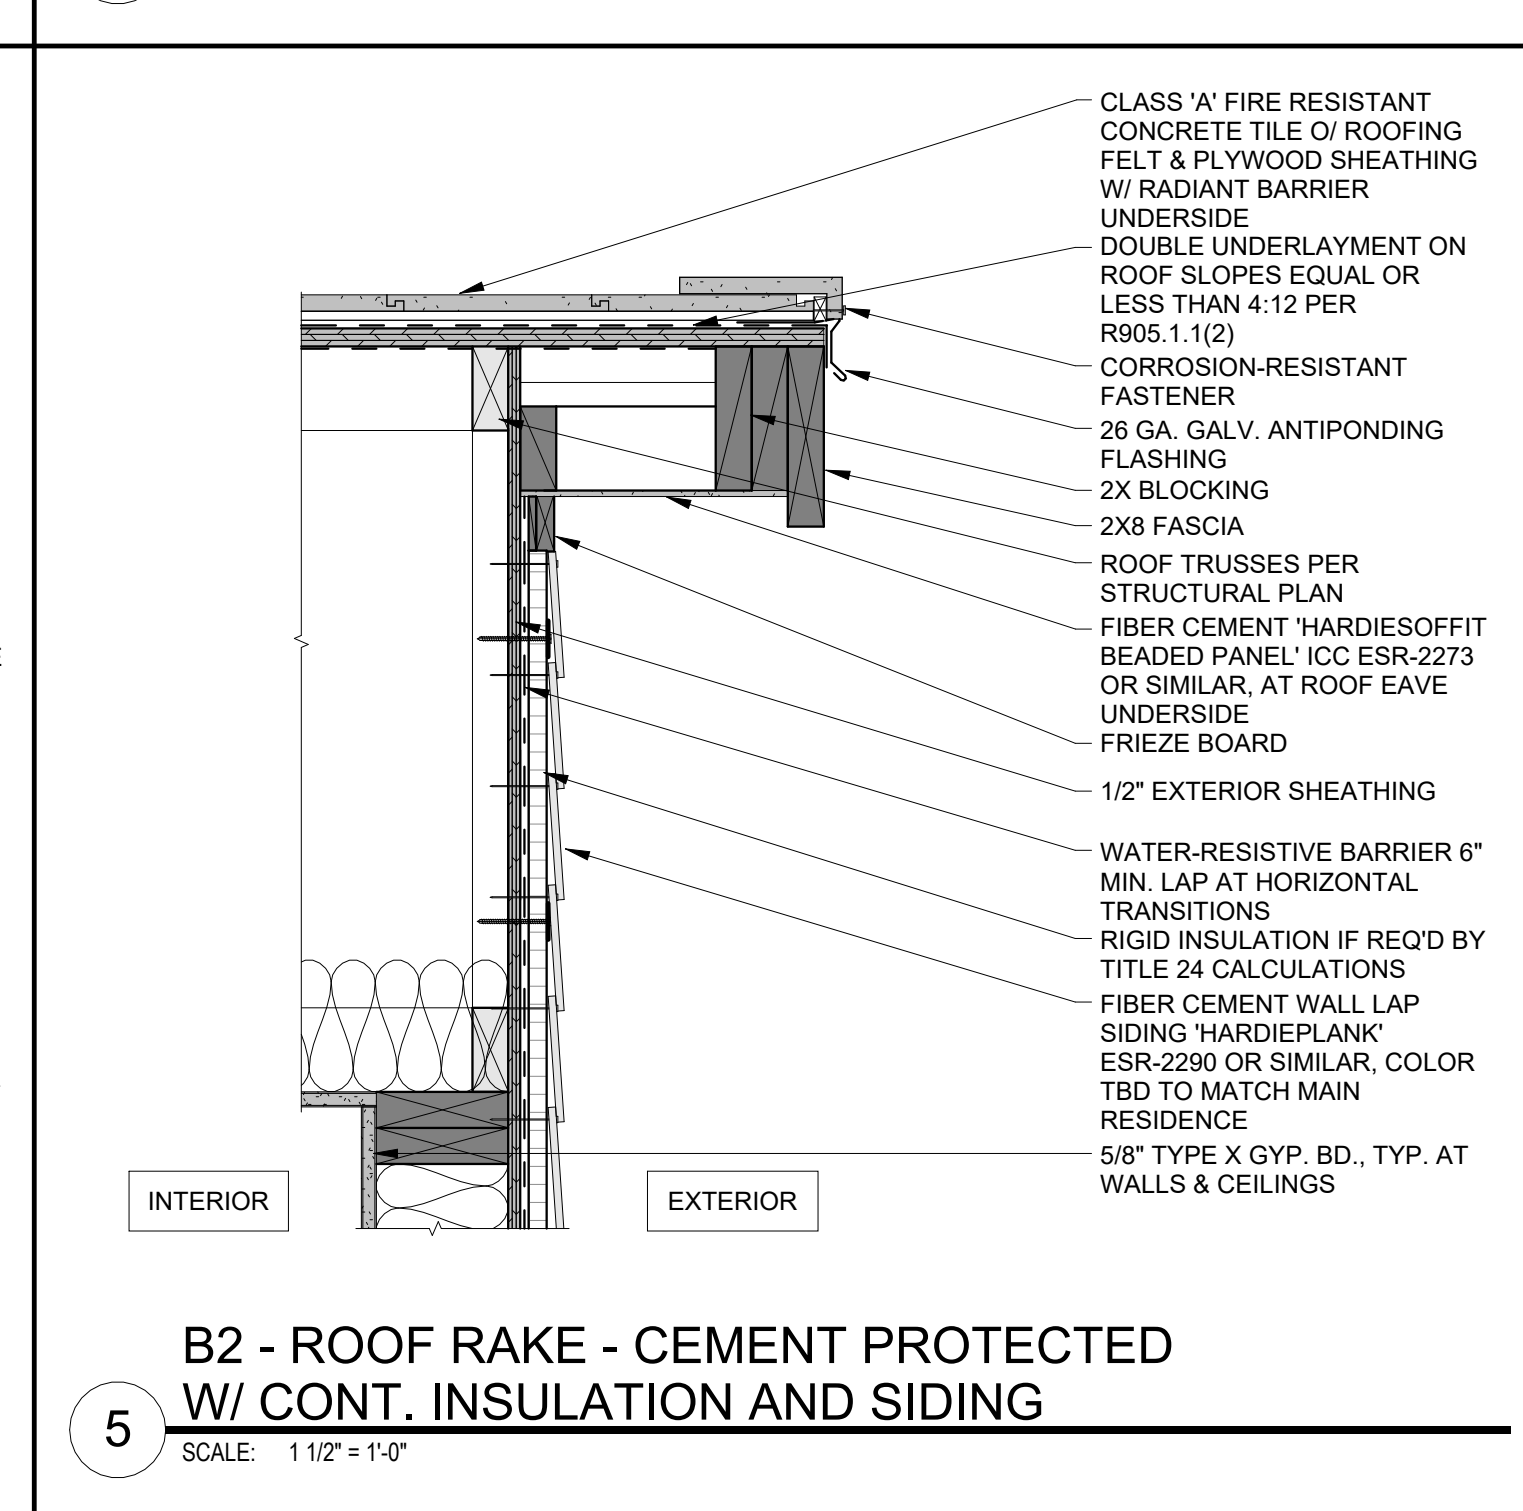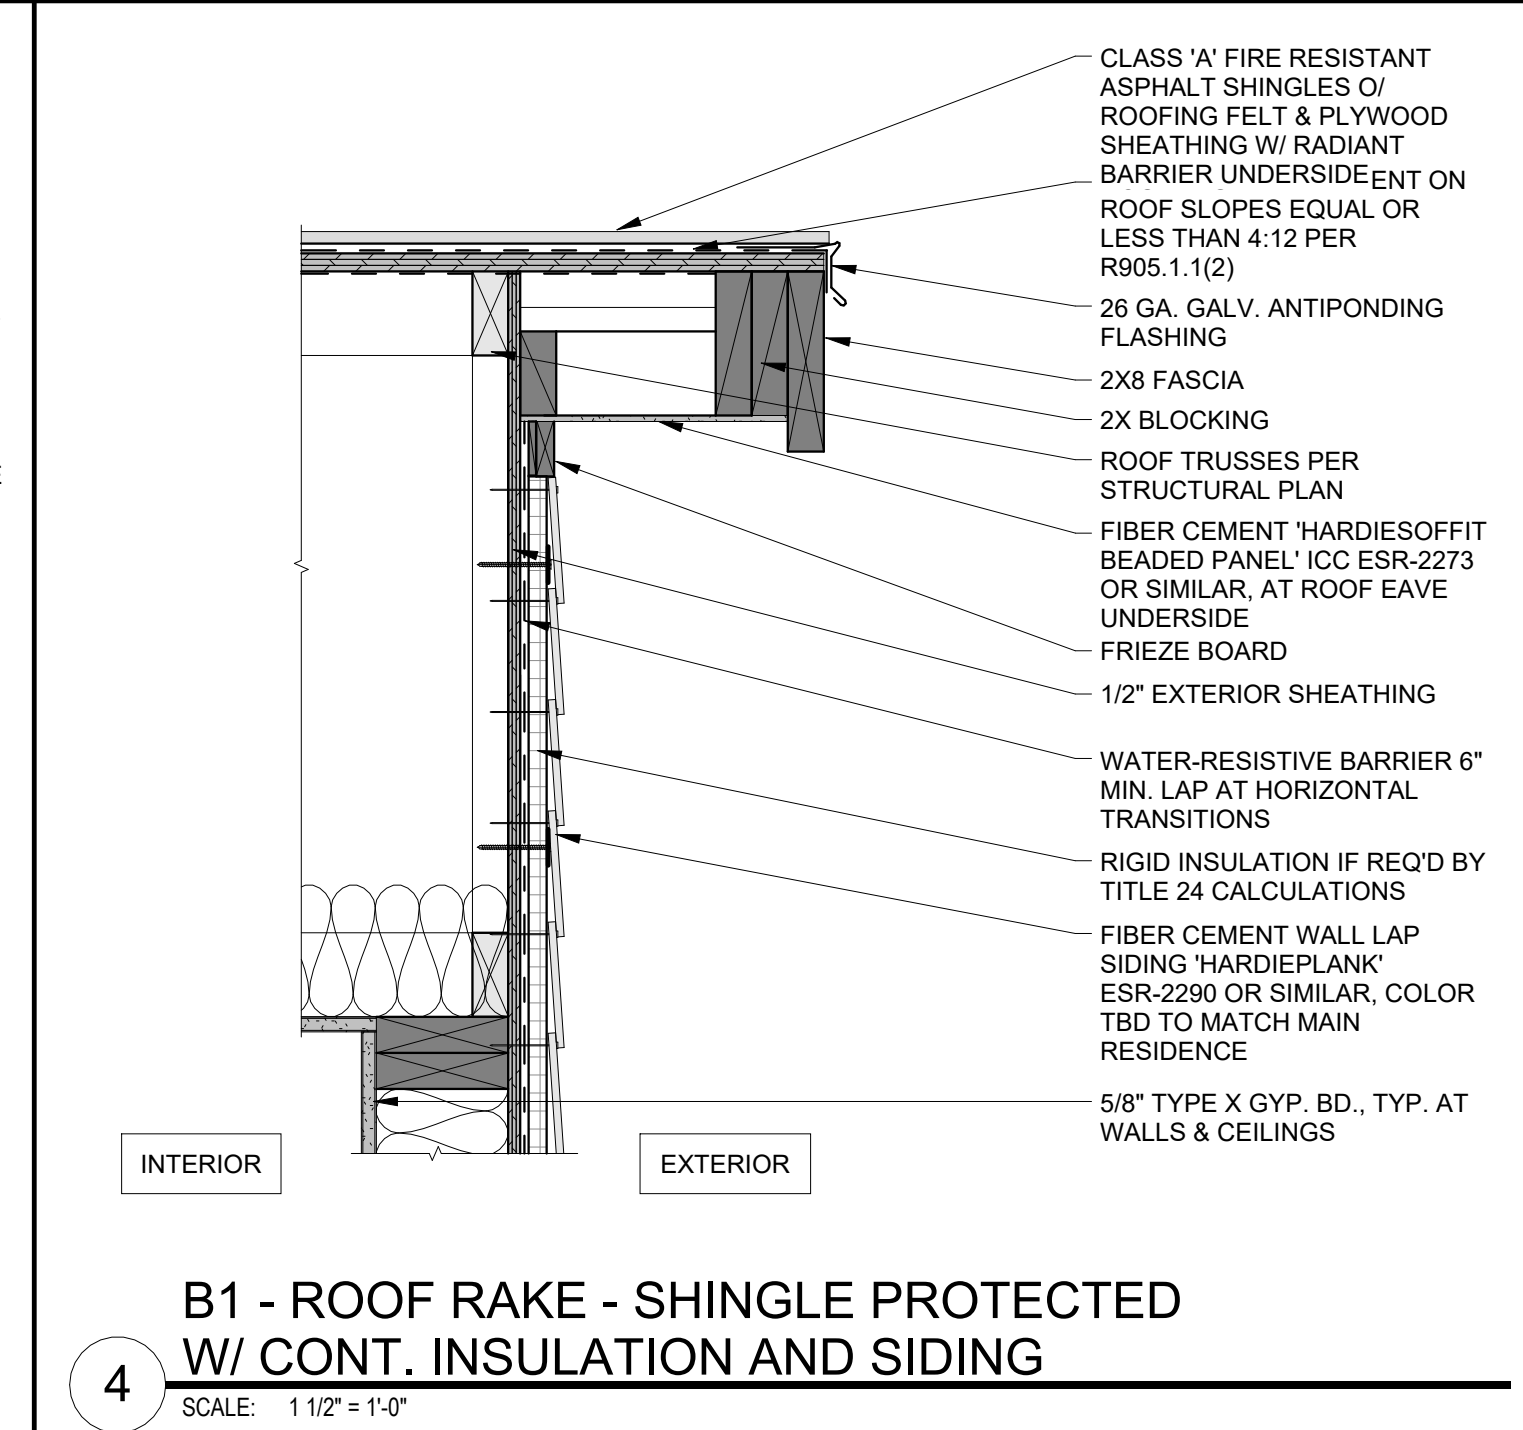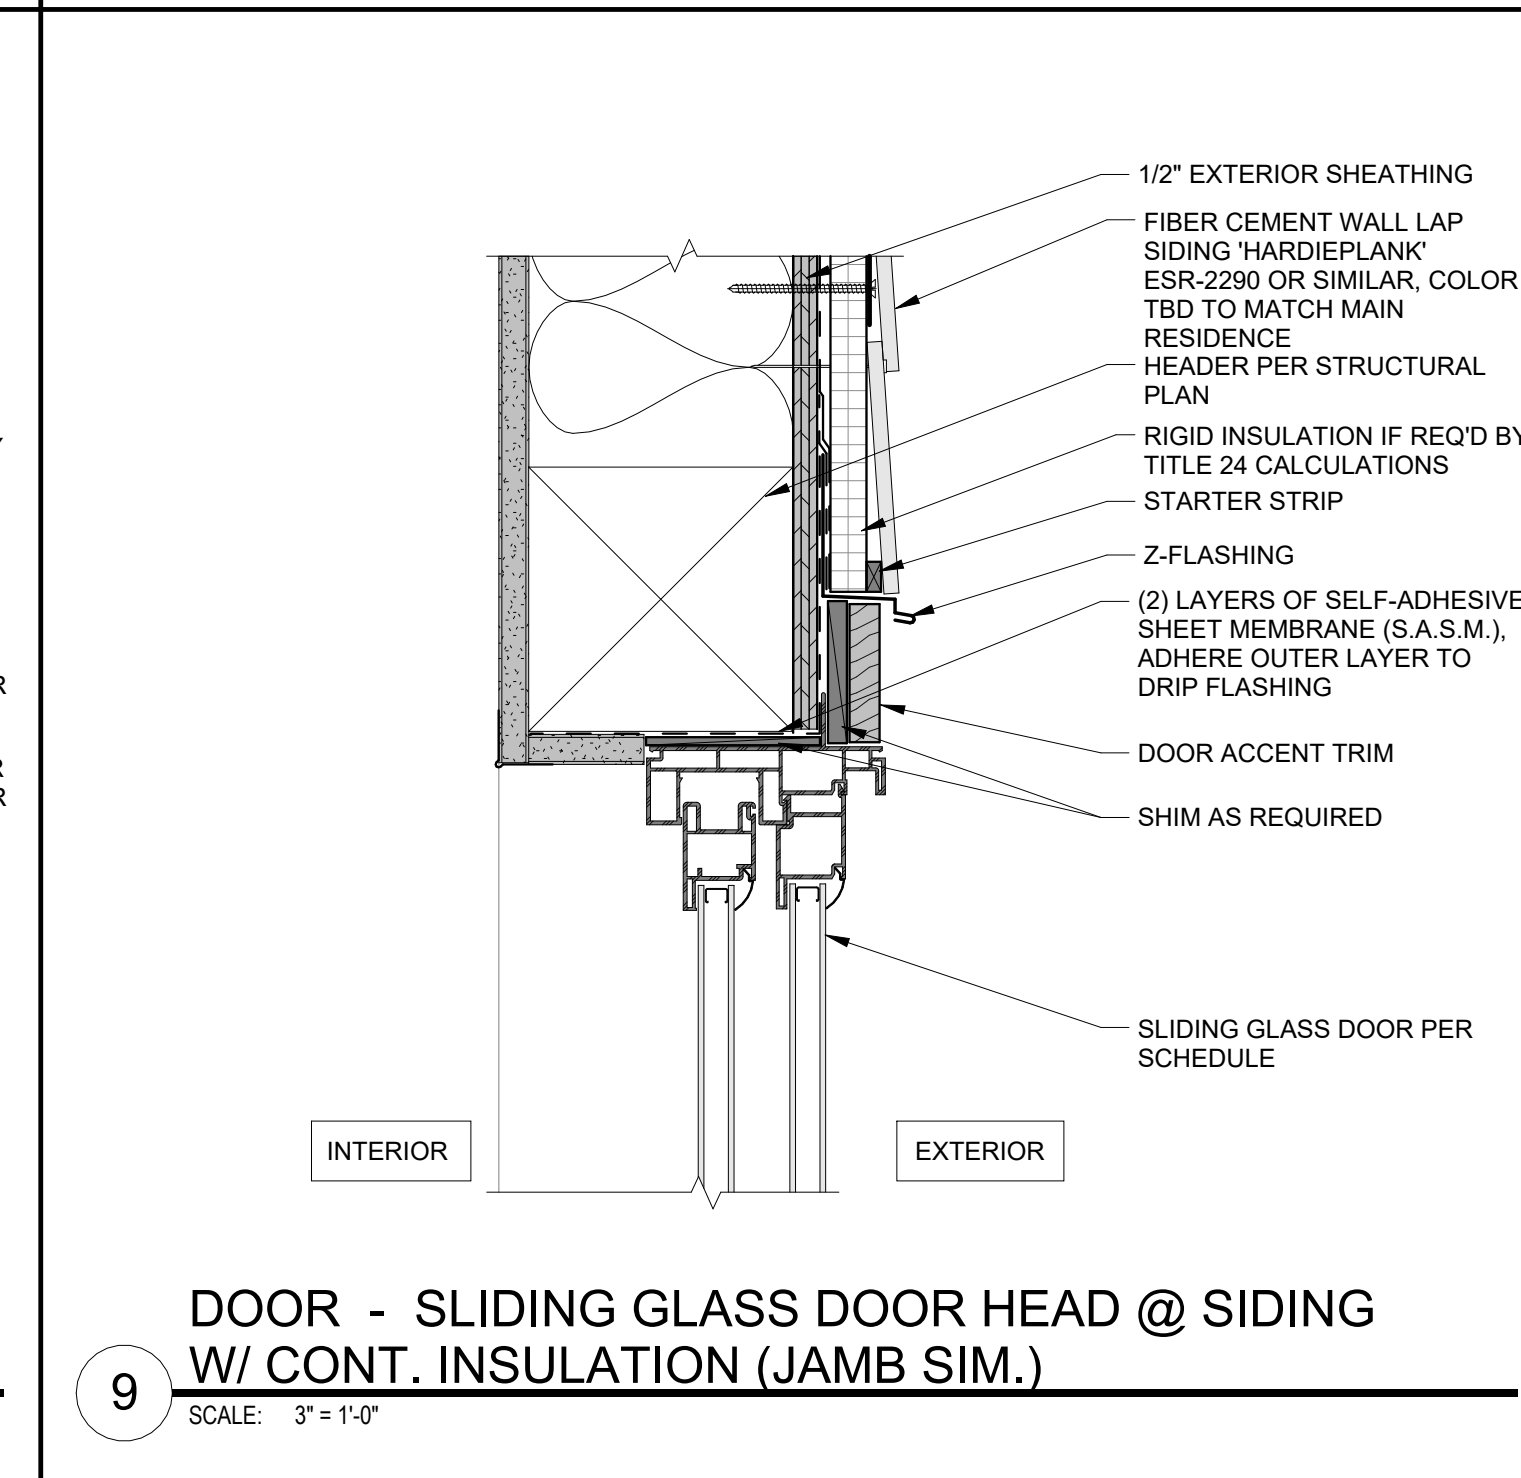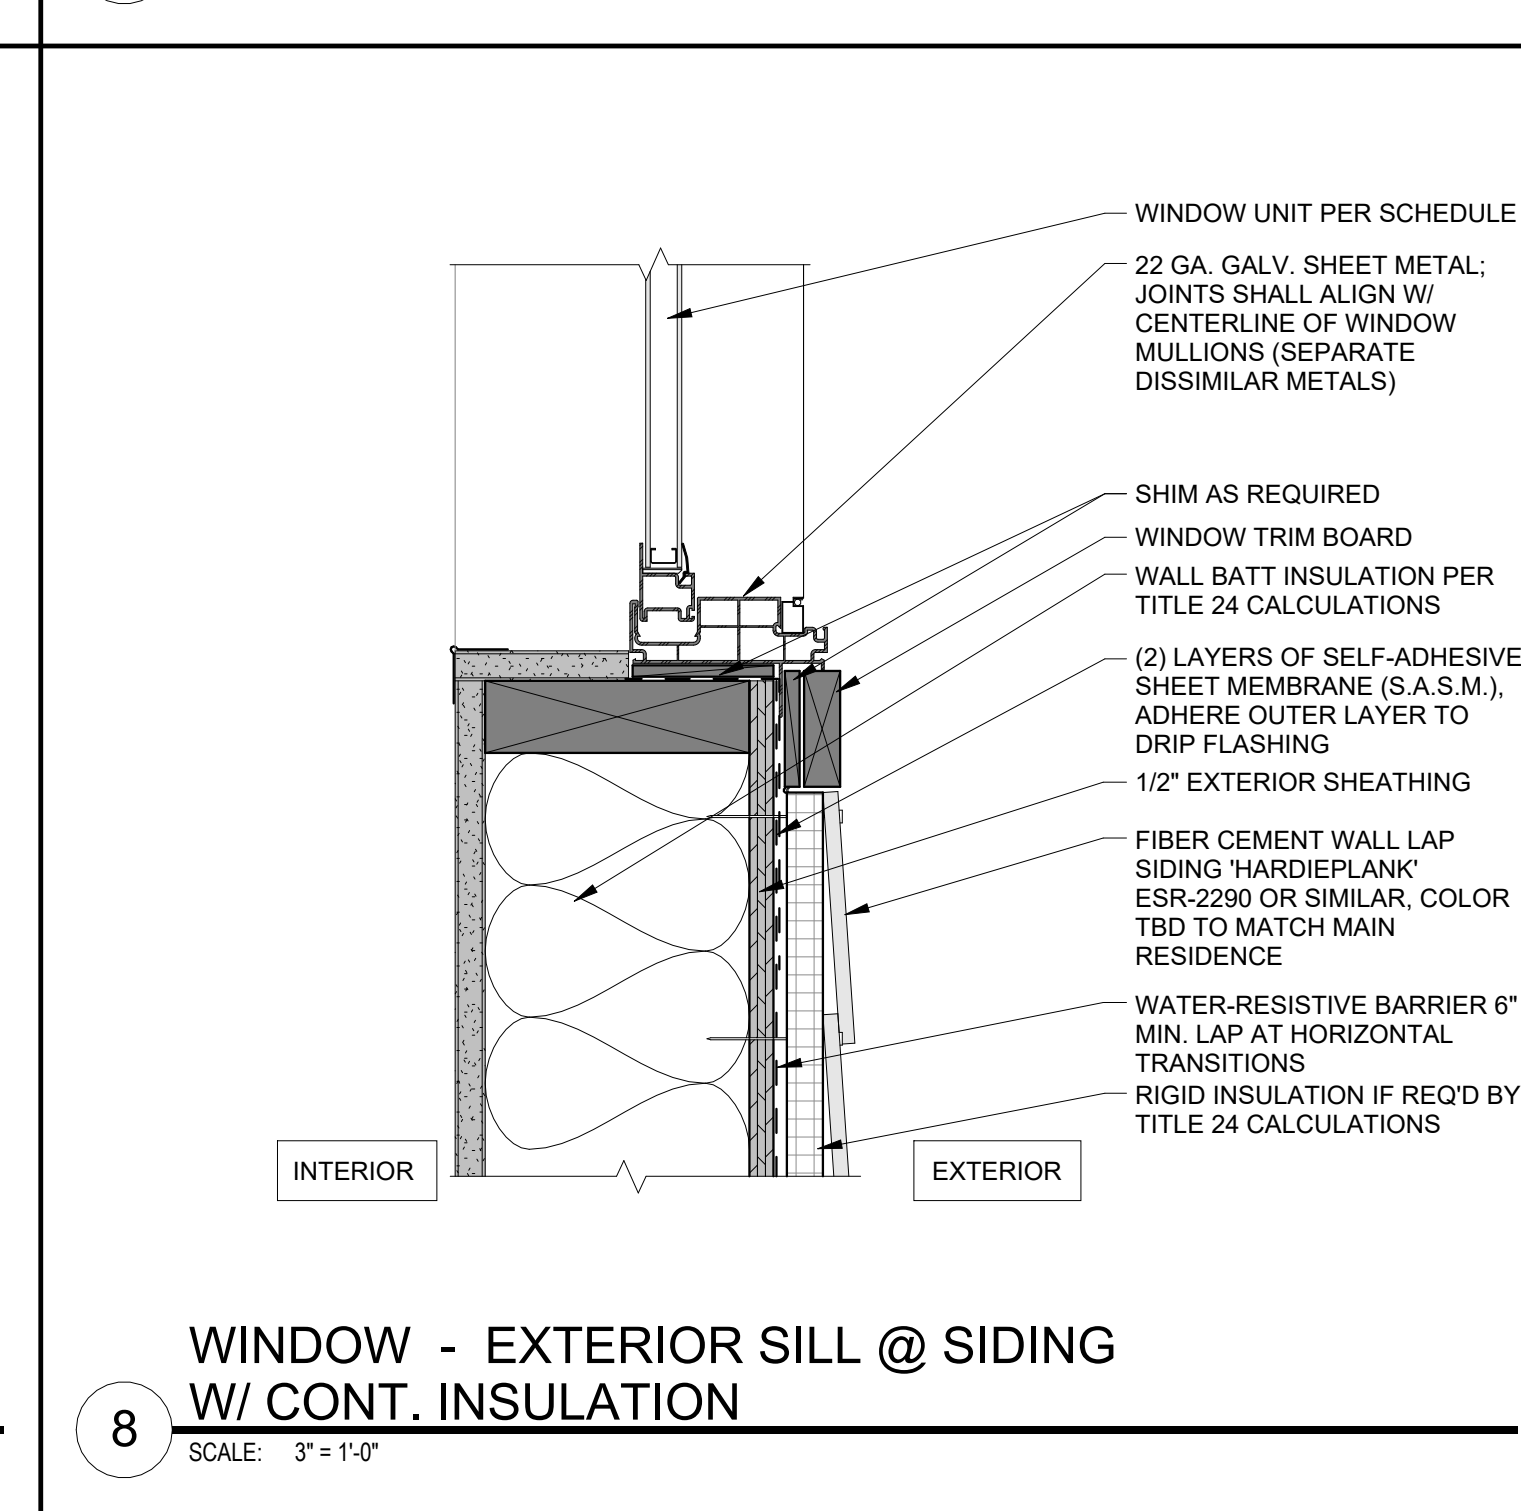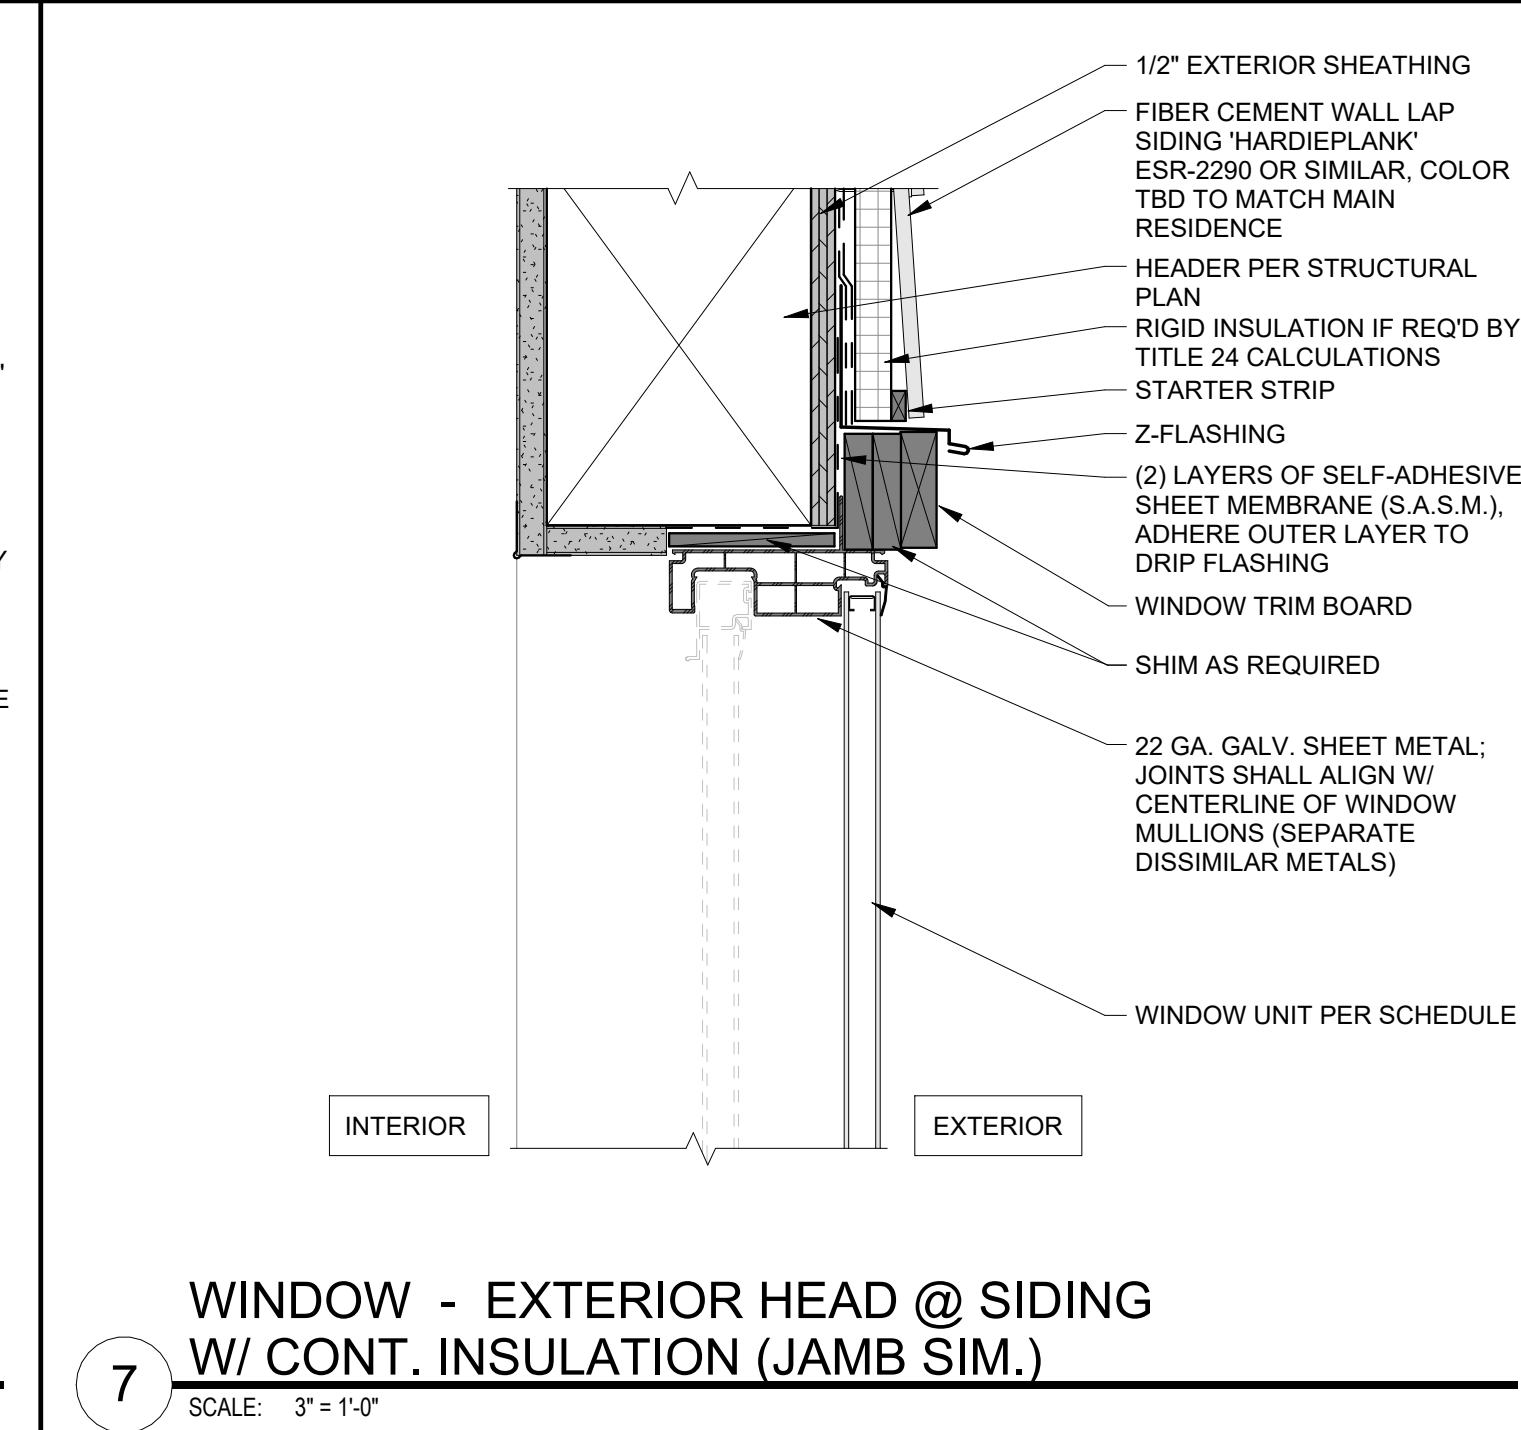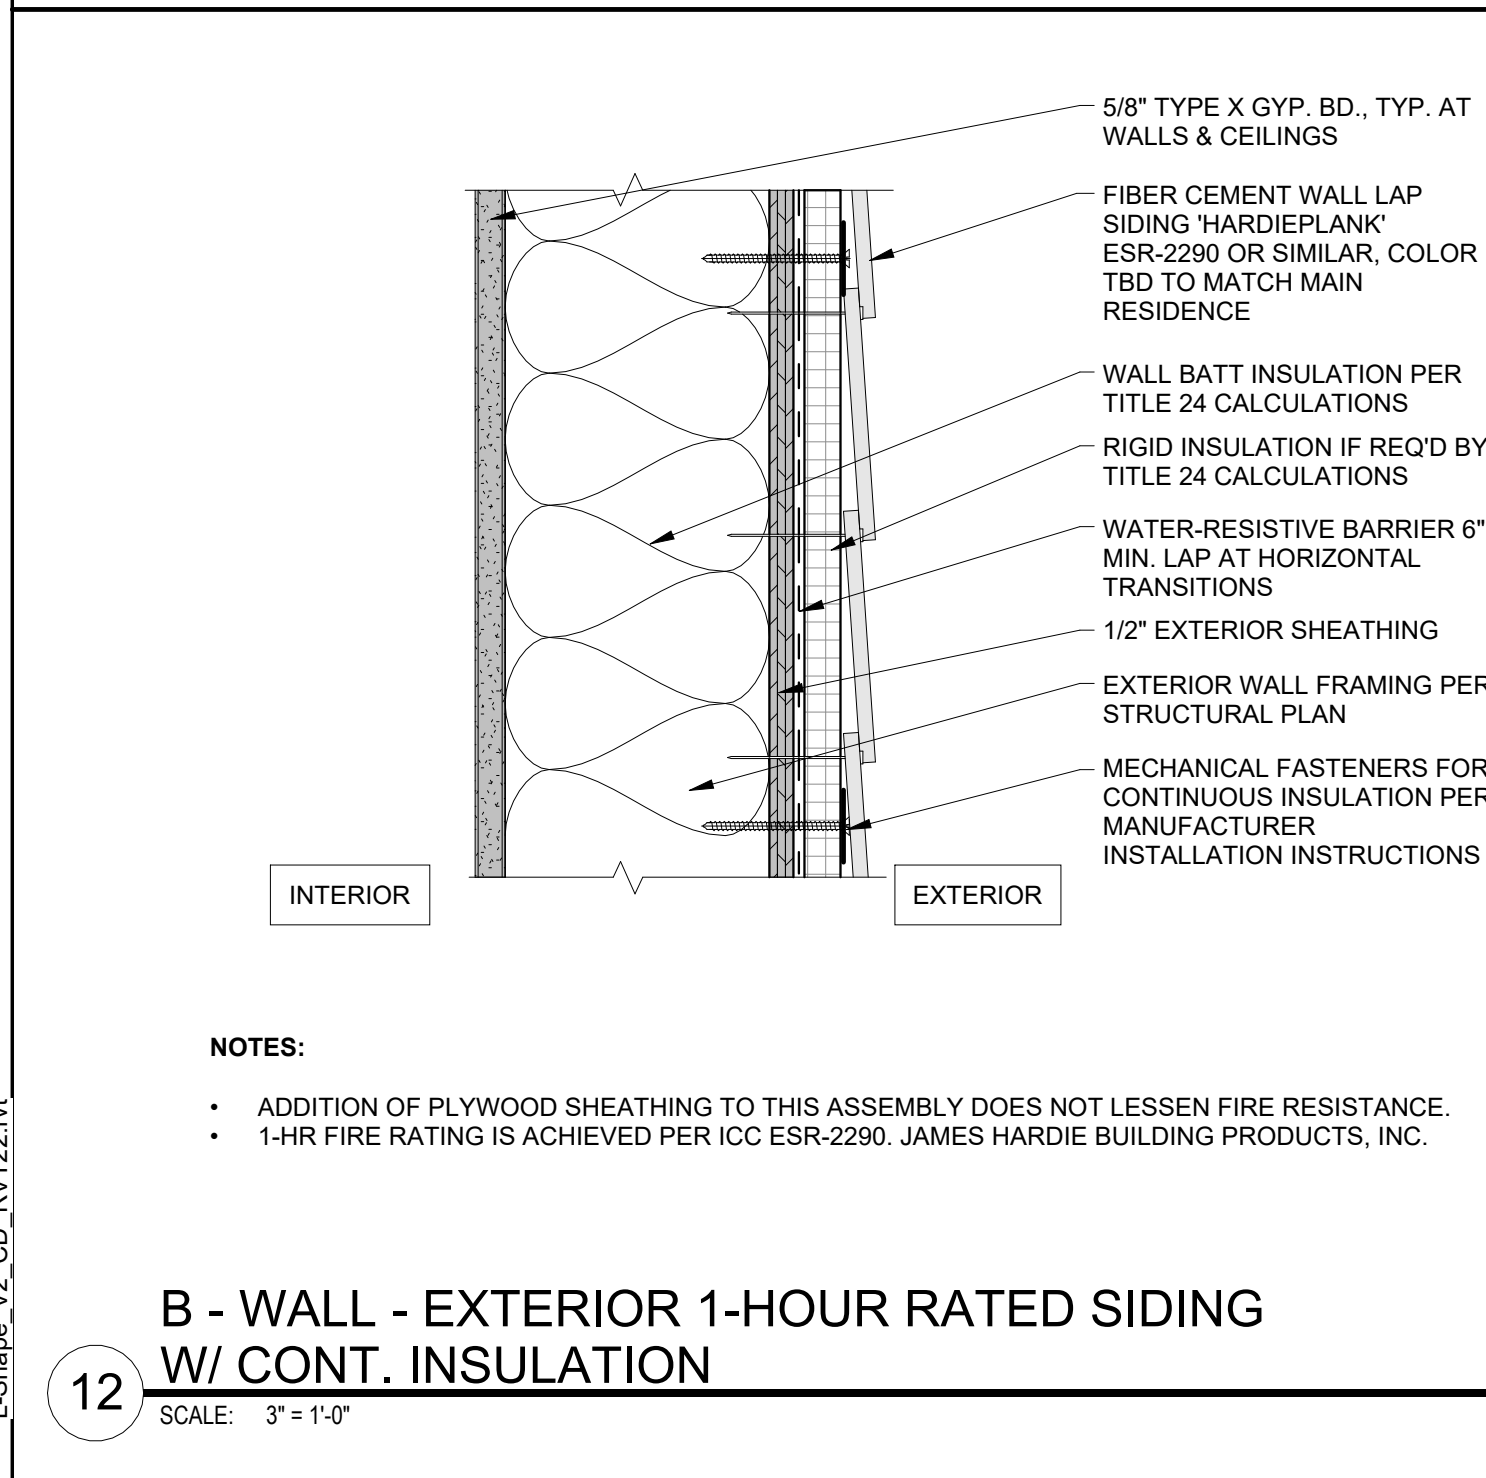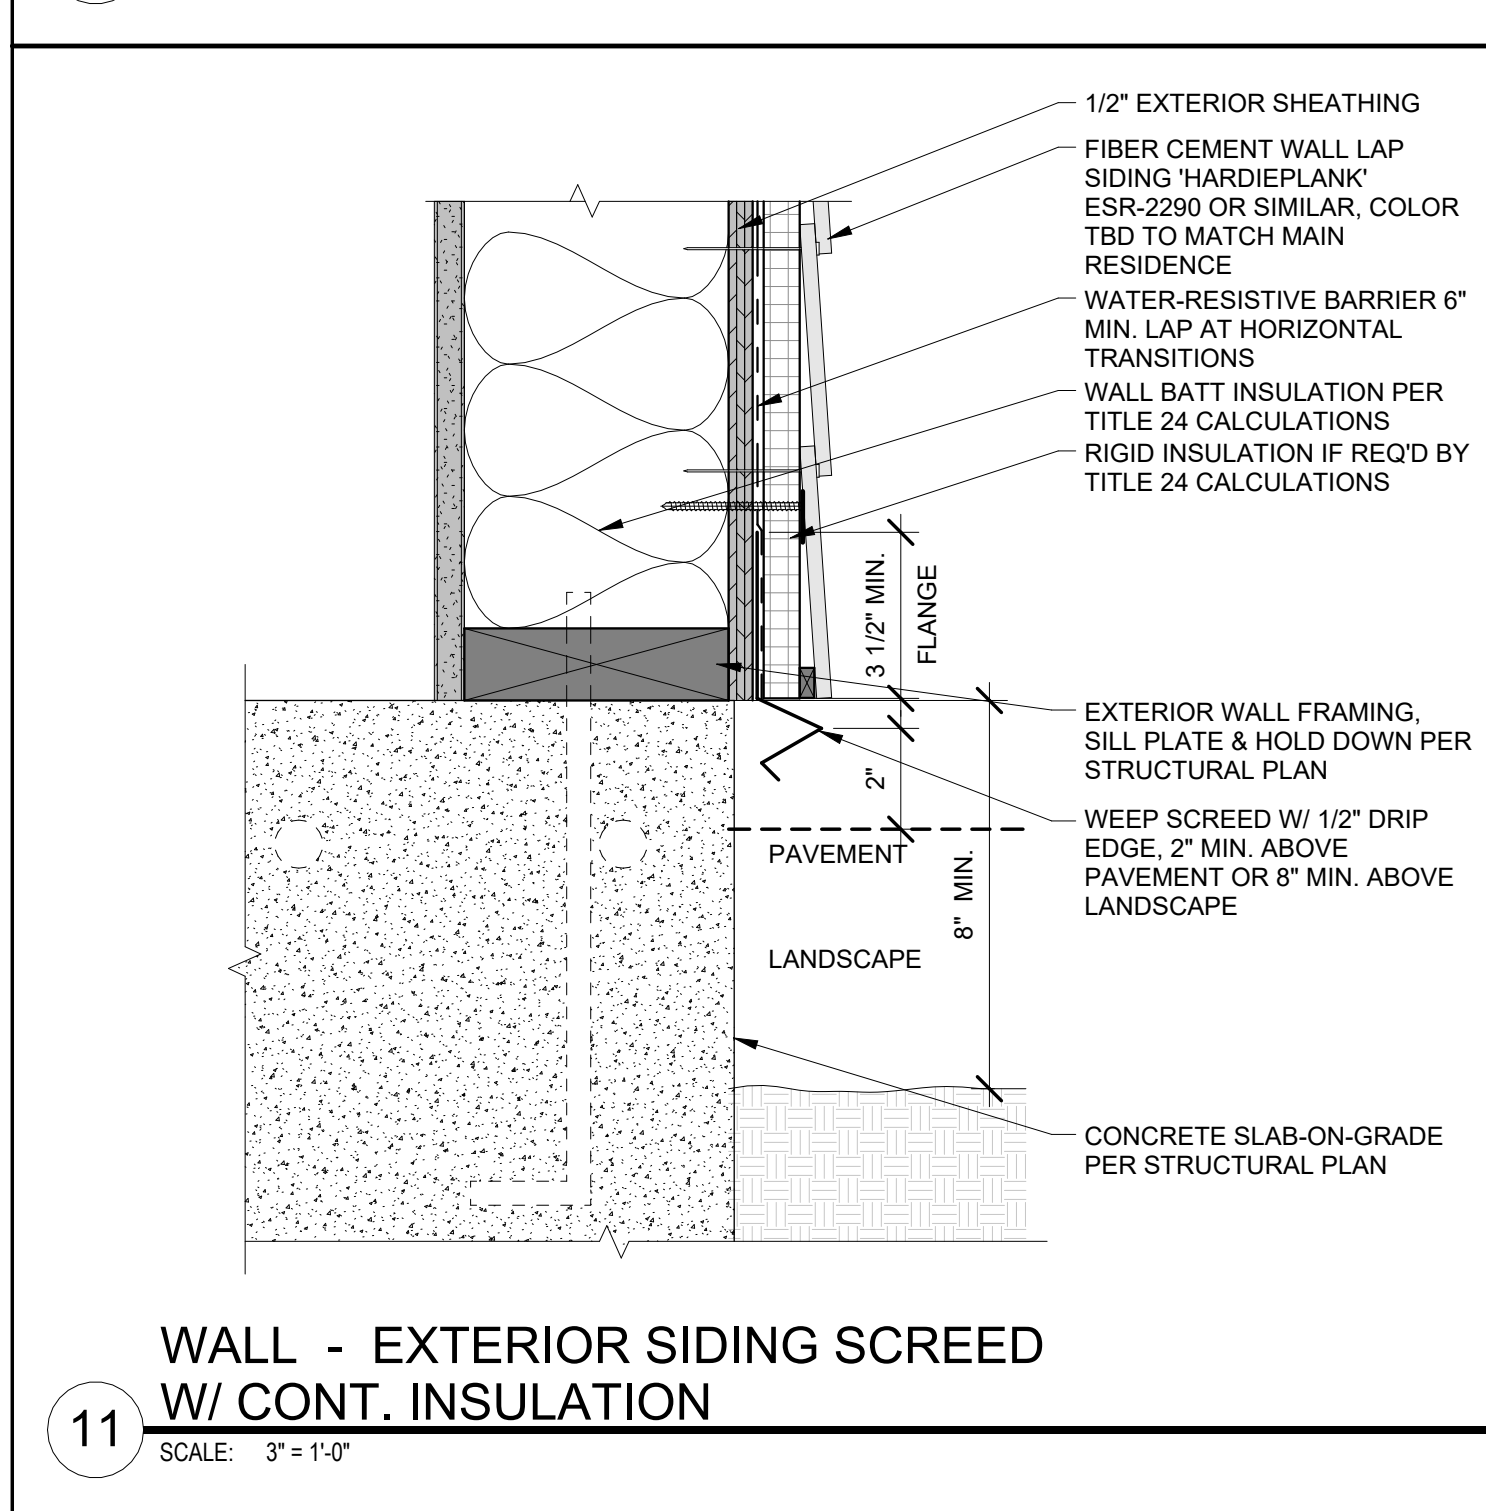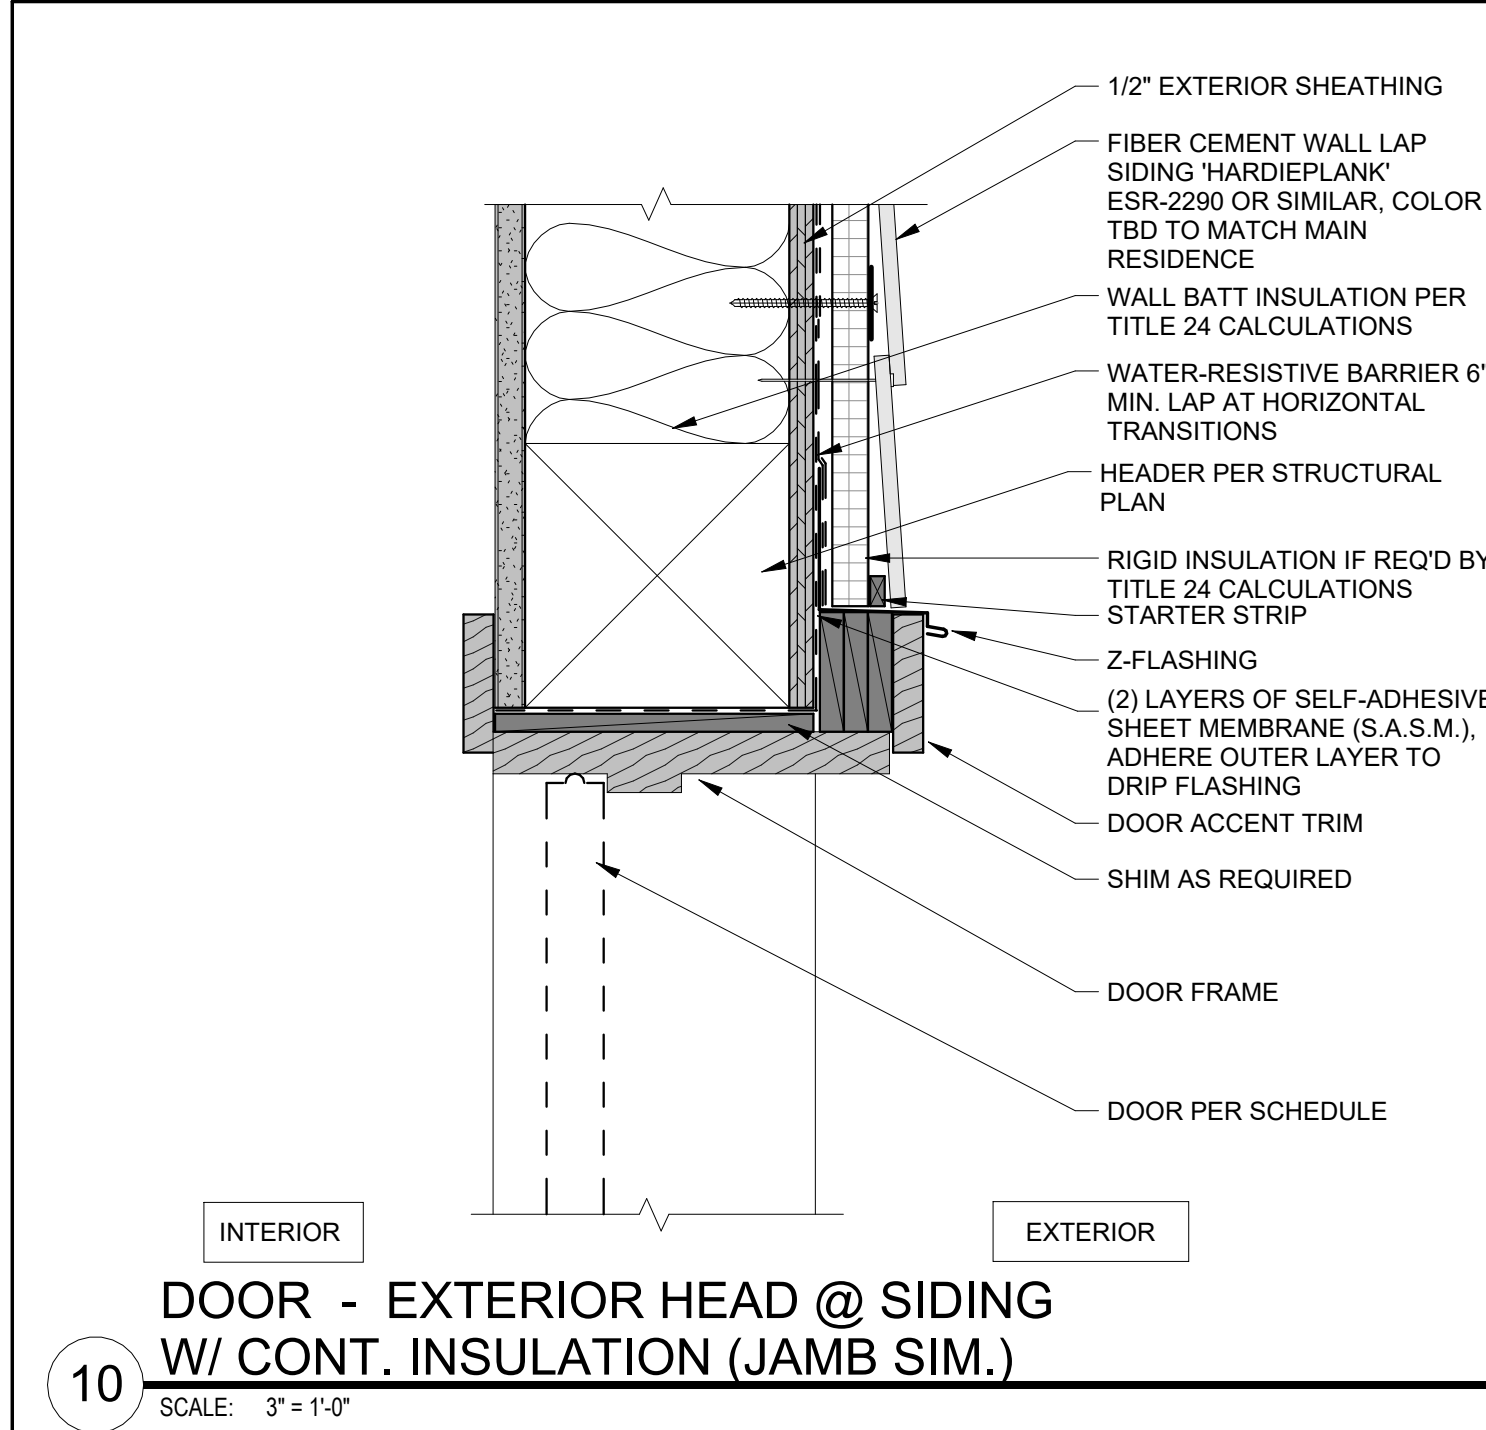



SNAPADU
DESIGN HOUSE

YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 1,199 L-SHAPE
CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:
LUIS CALDERON
SnapADU








SIGNATURE

RELEASE	DATE	BY	APP.	RELEASED FOR...
	03/22/2024		LAG	




LAP SIDING
DETAILS

A520

22040

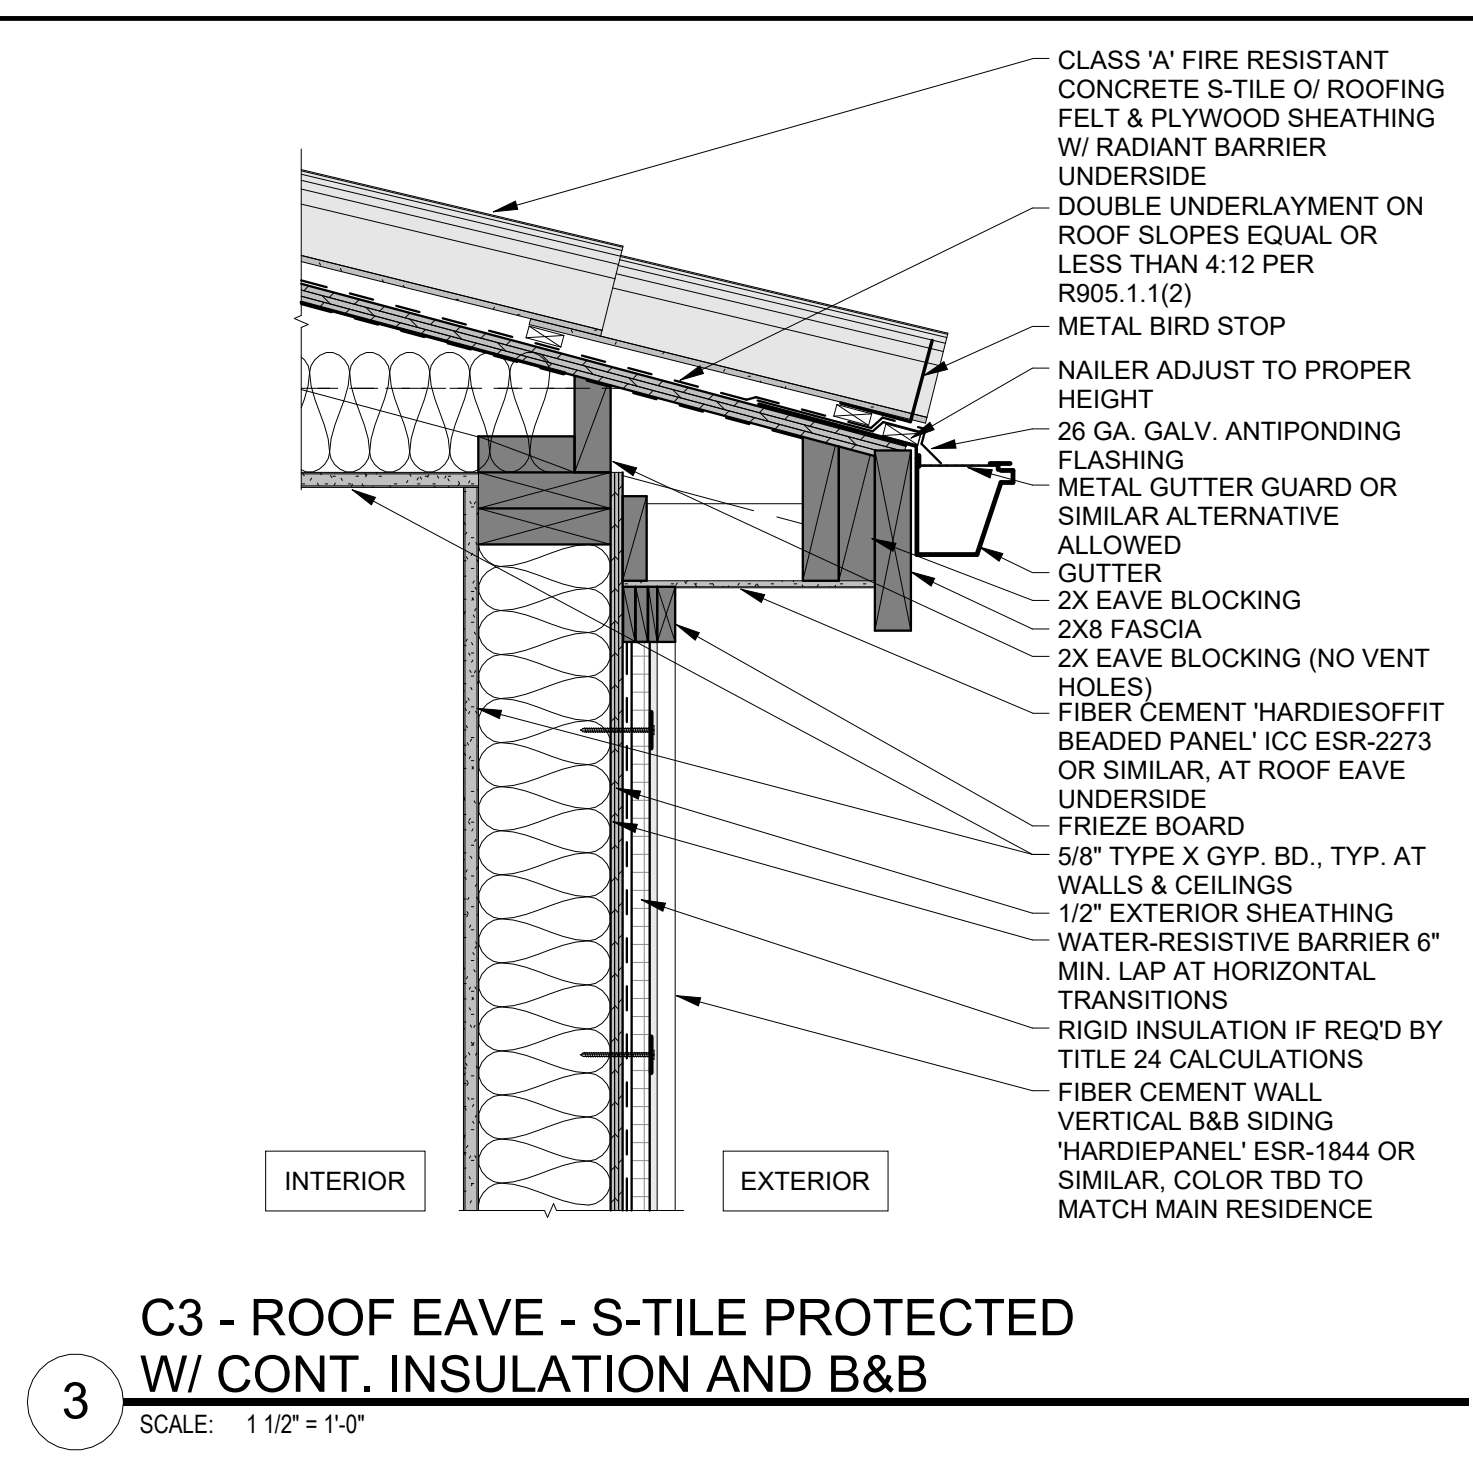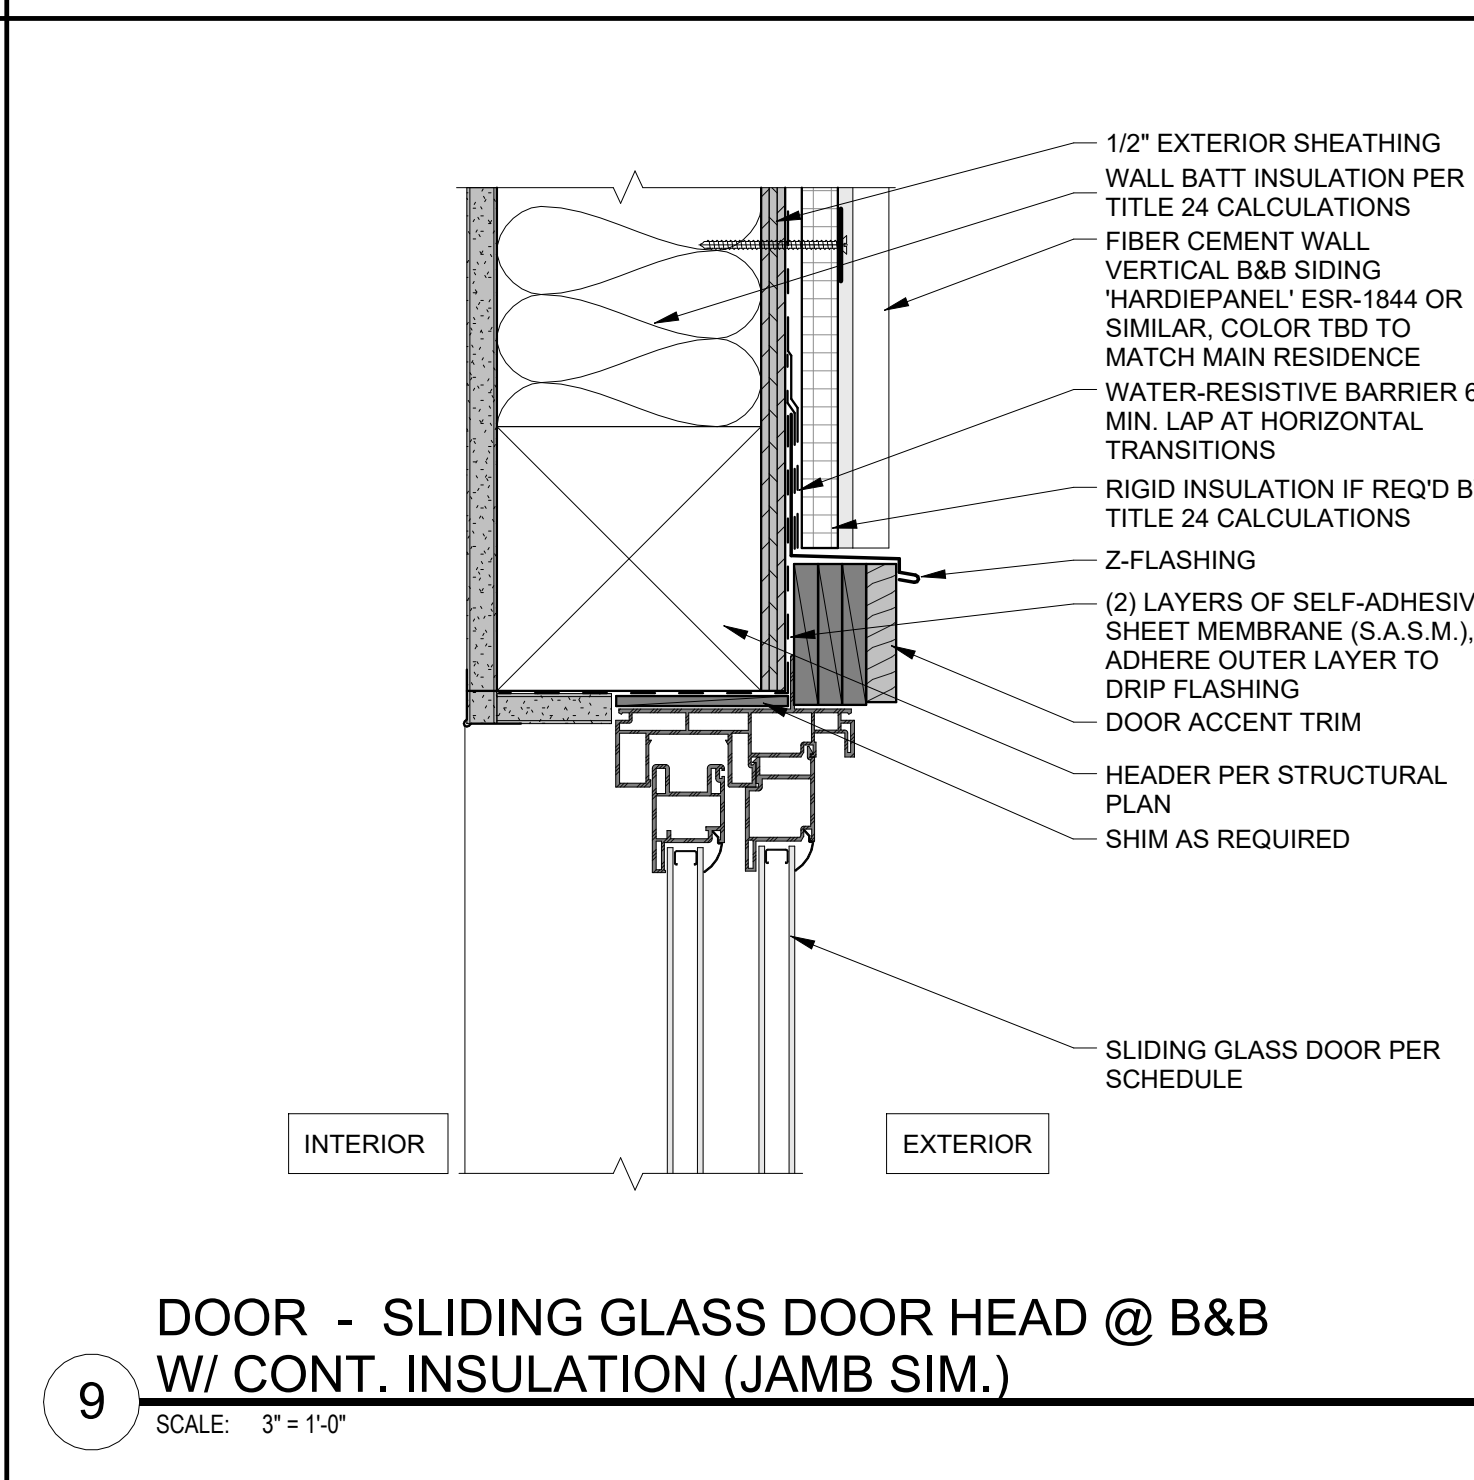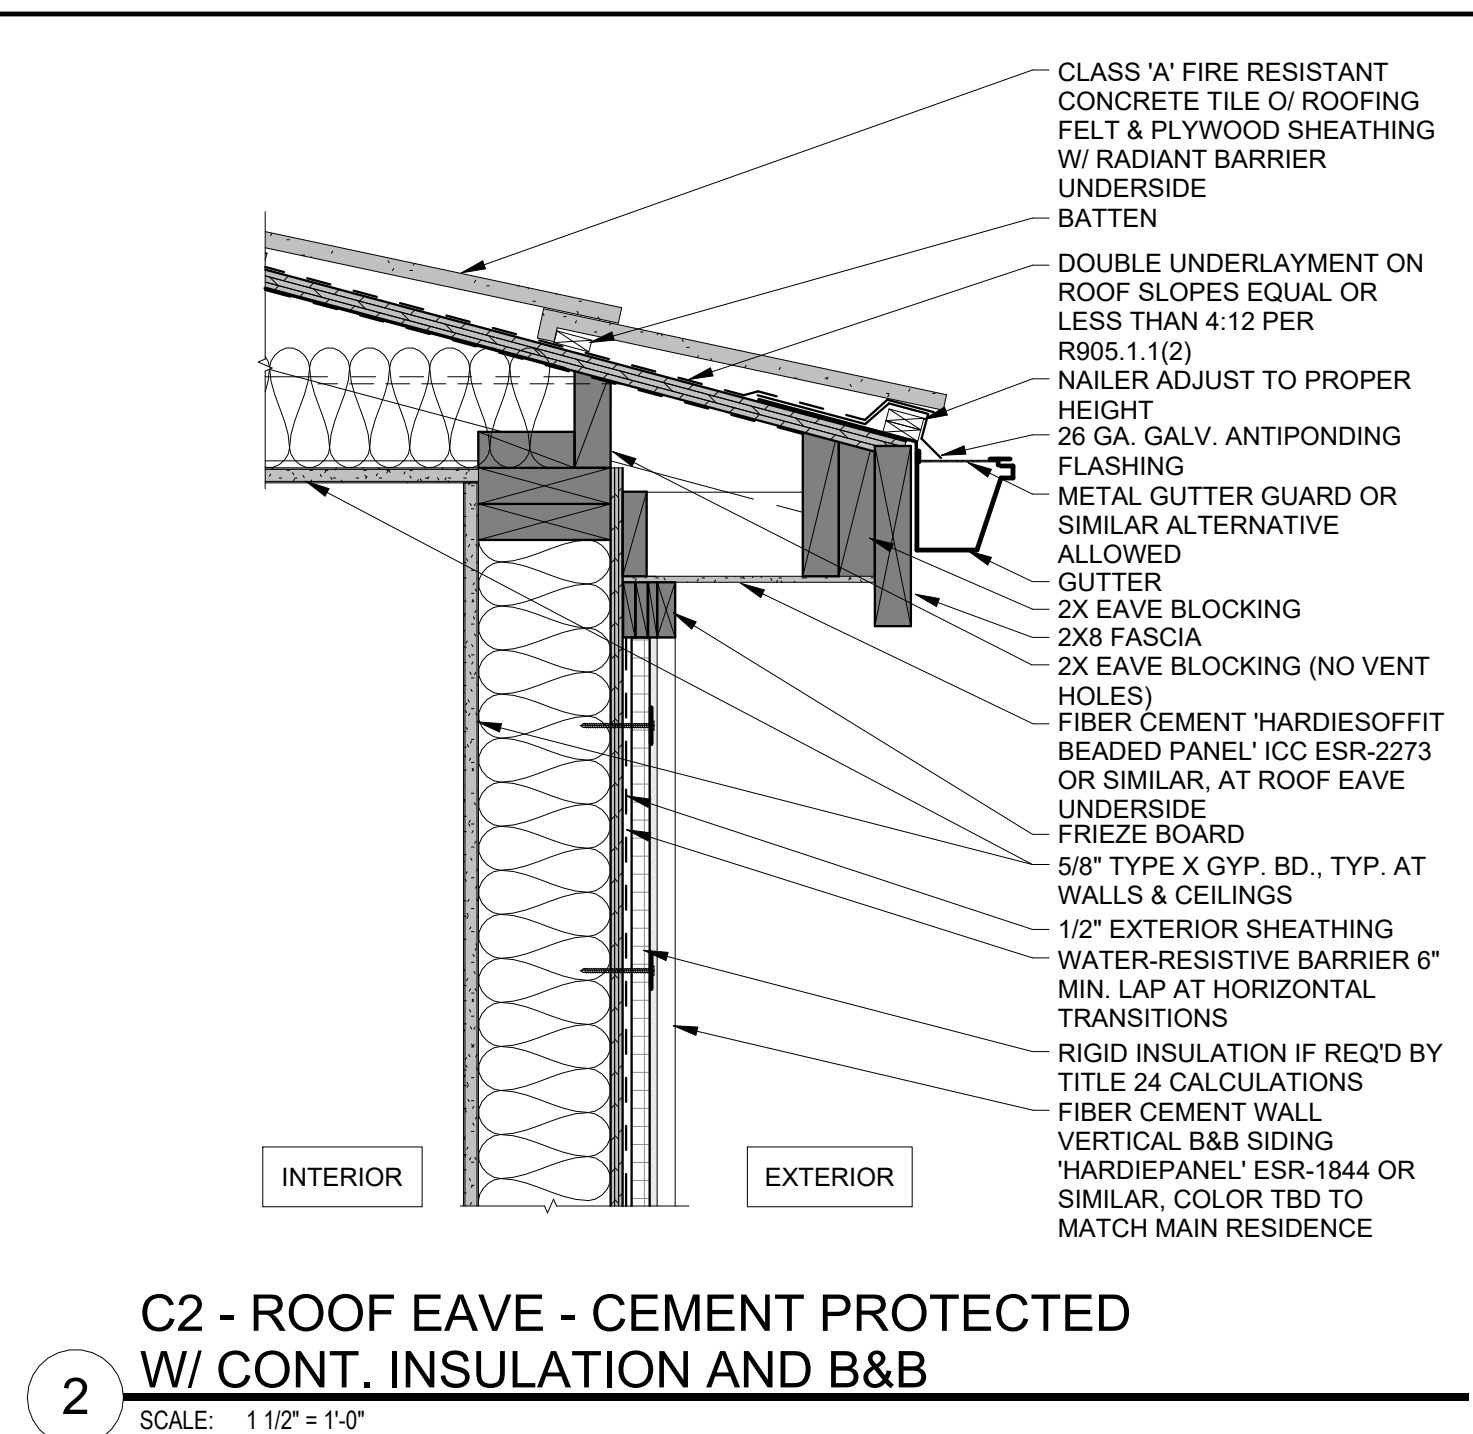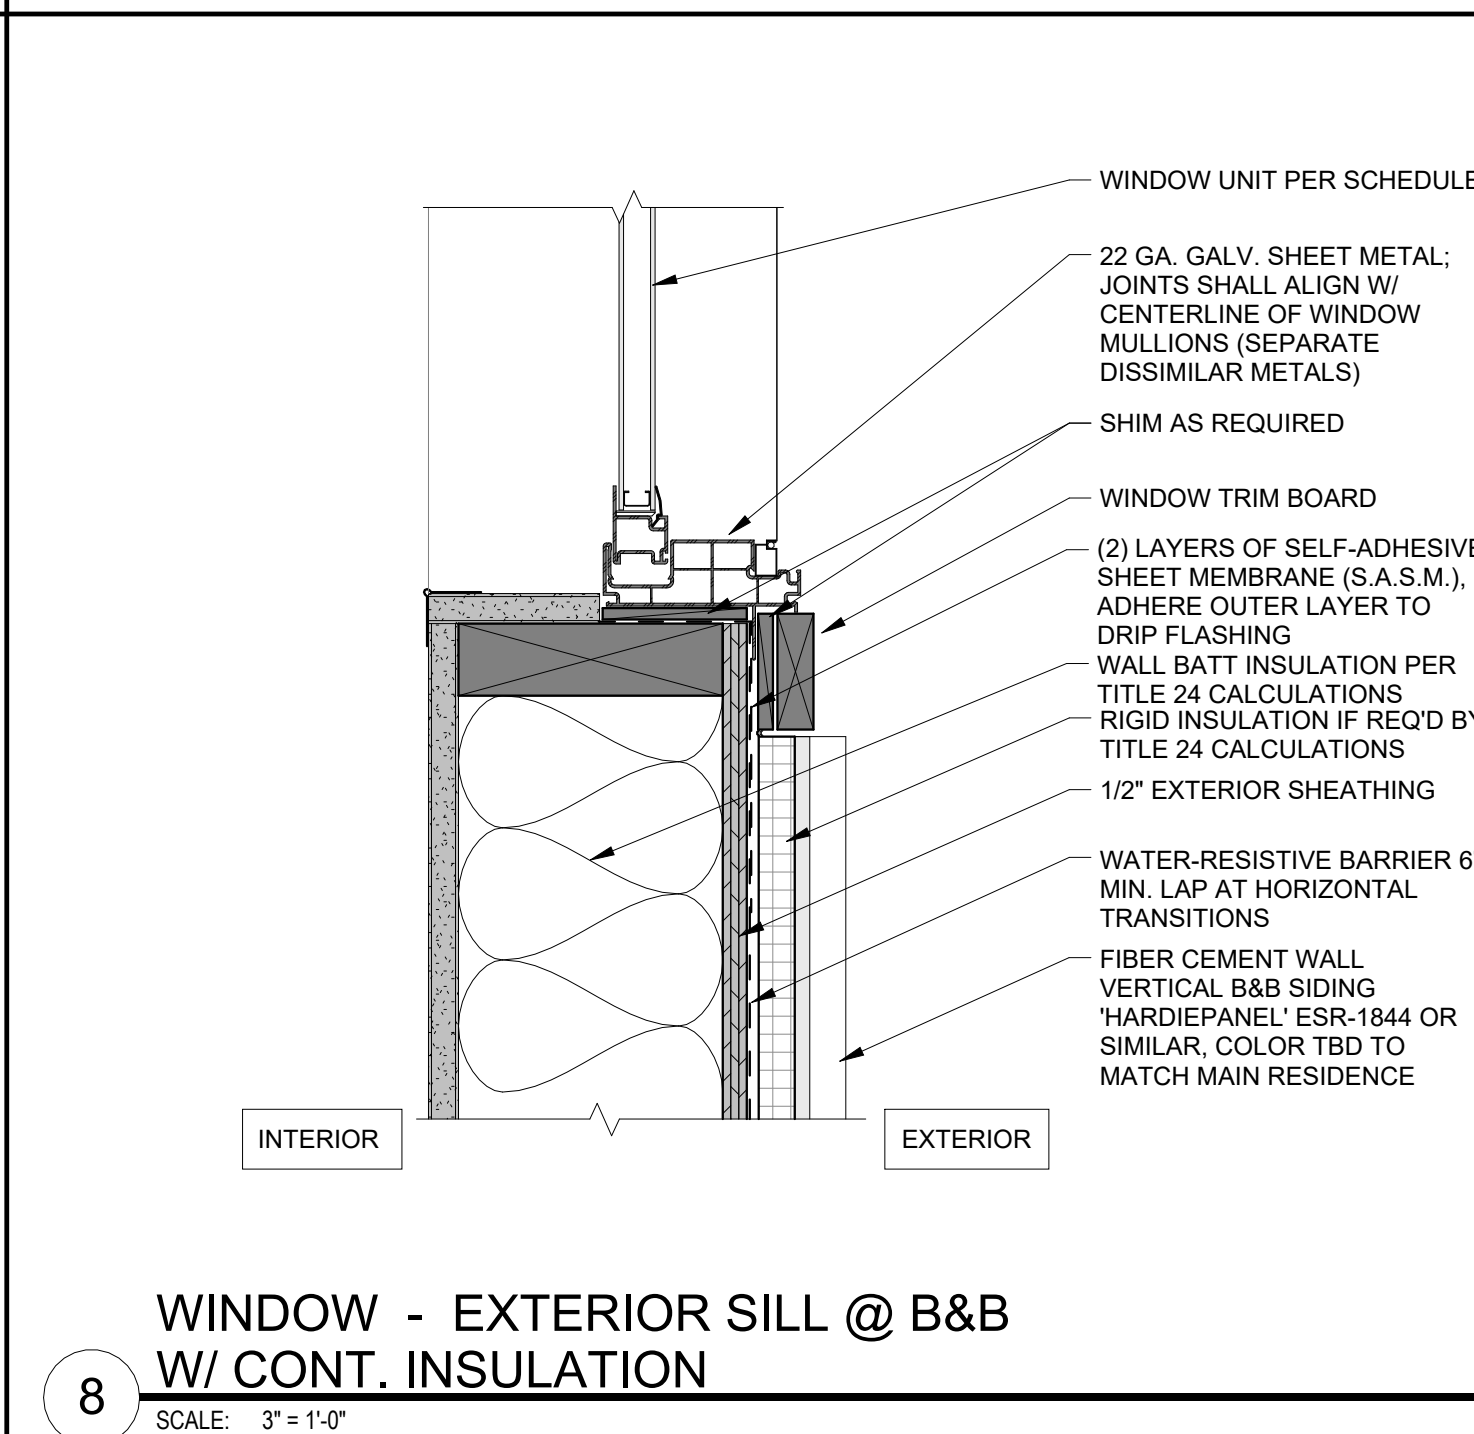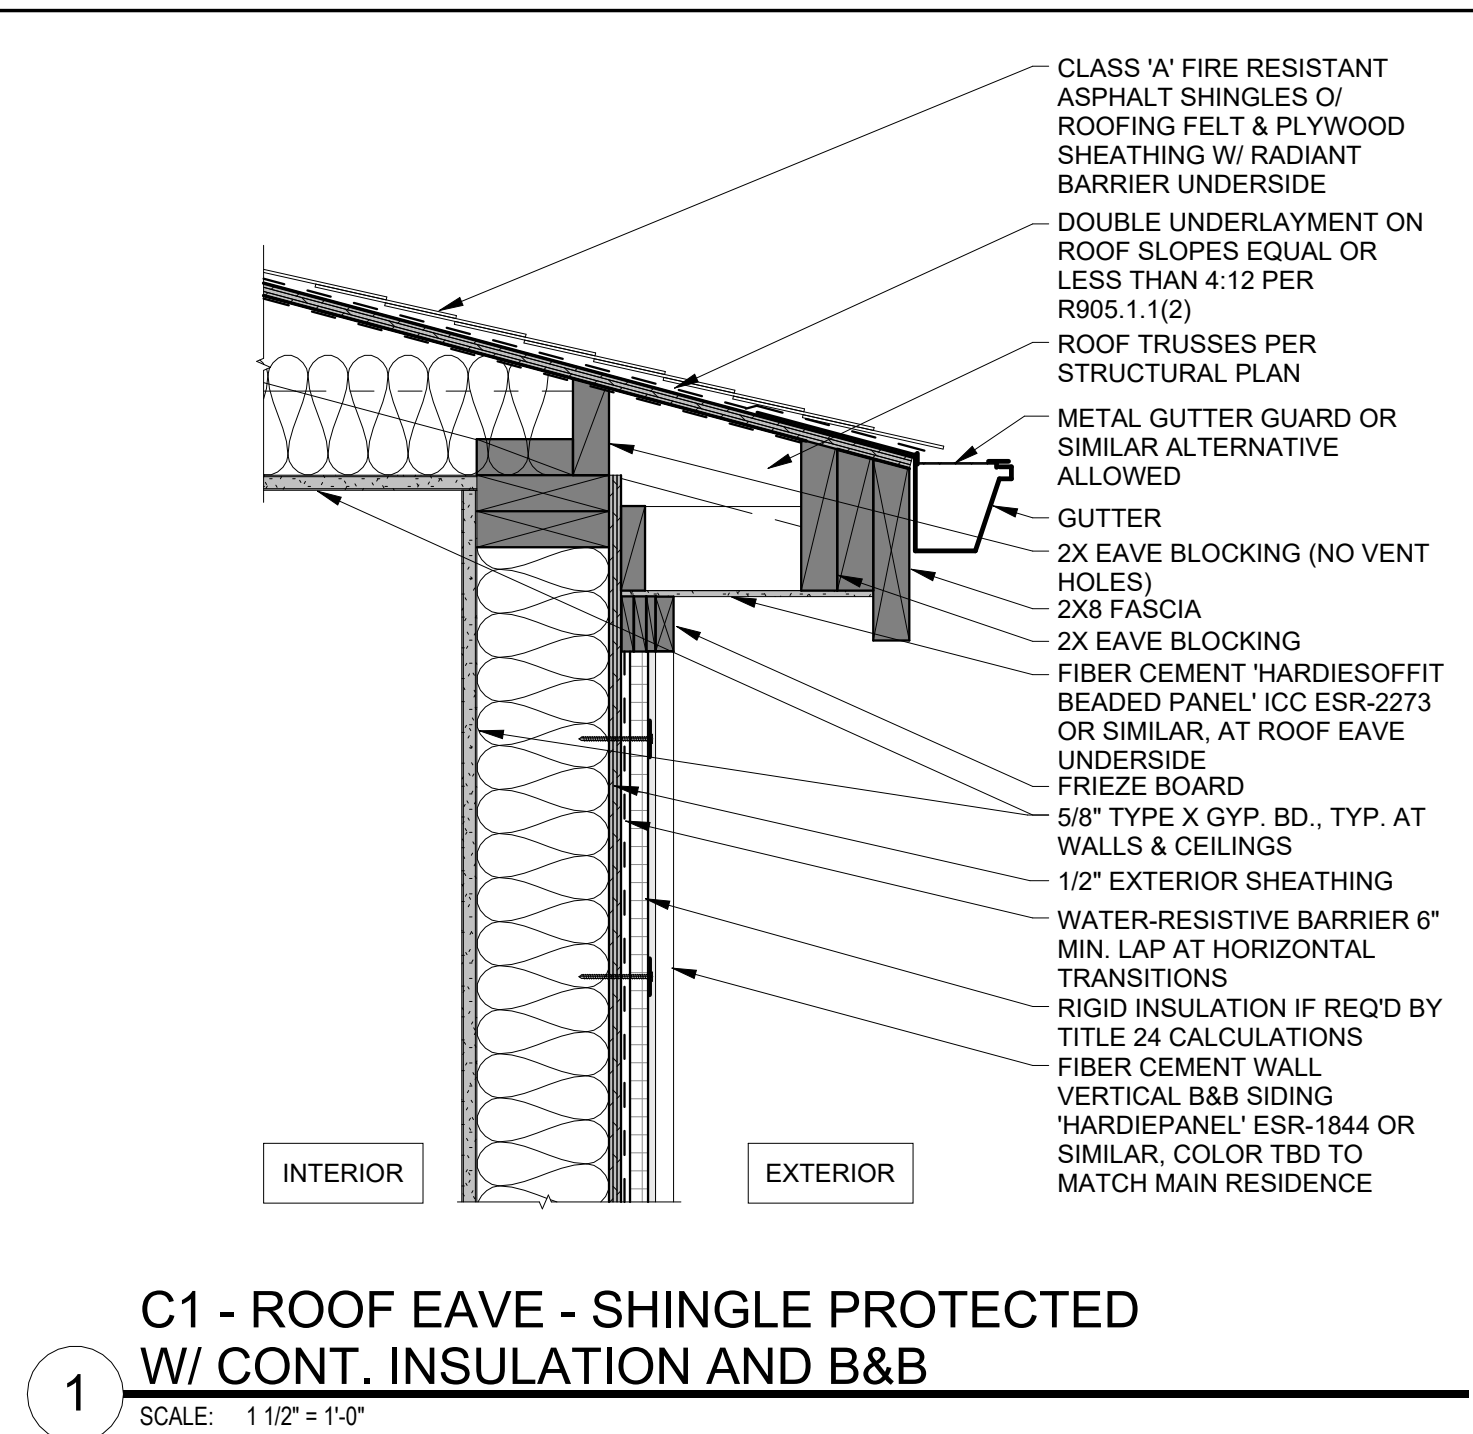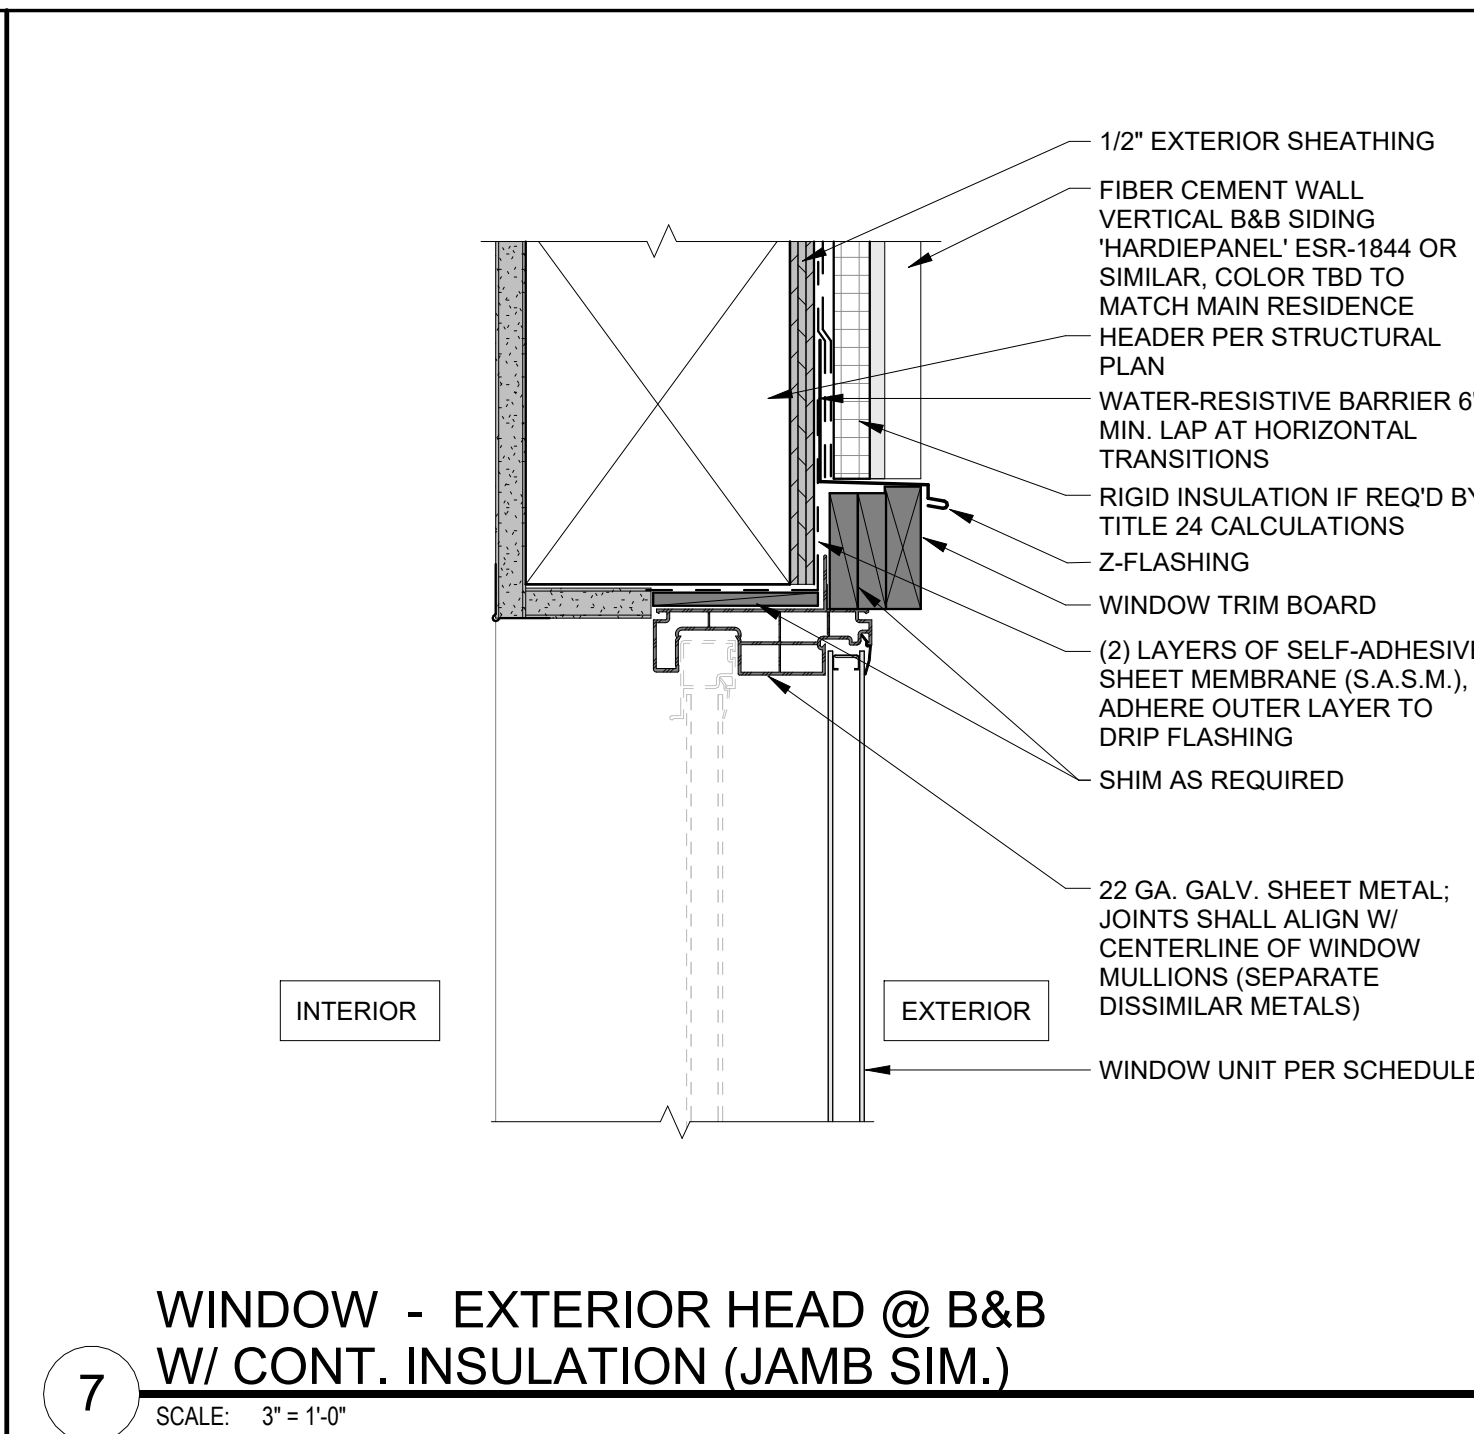

1 STANDARD 3-BEDROOM ELECTRICAL PLAN
SCALE: 1/4" = 1'-0"

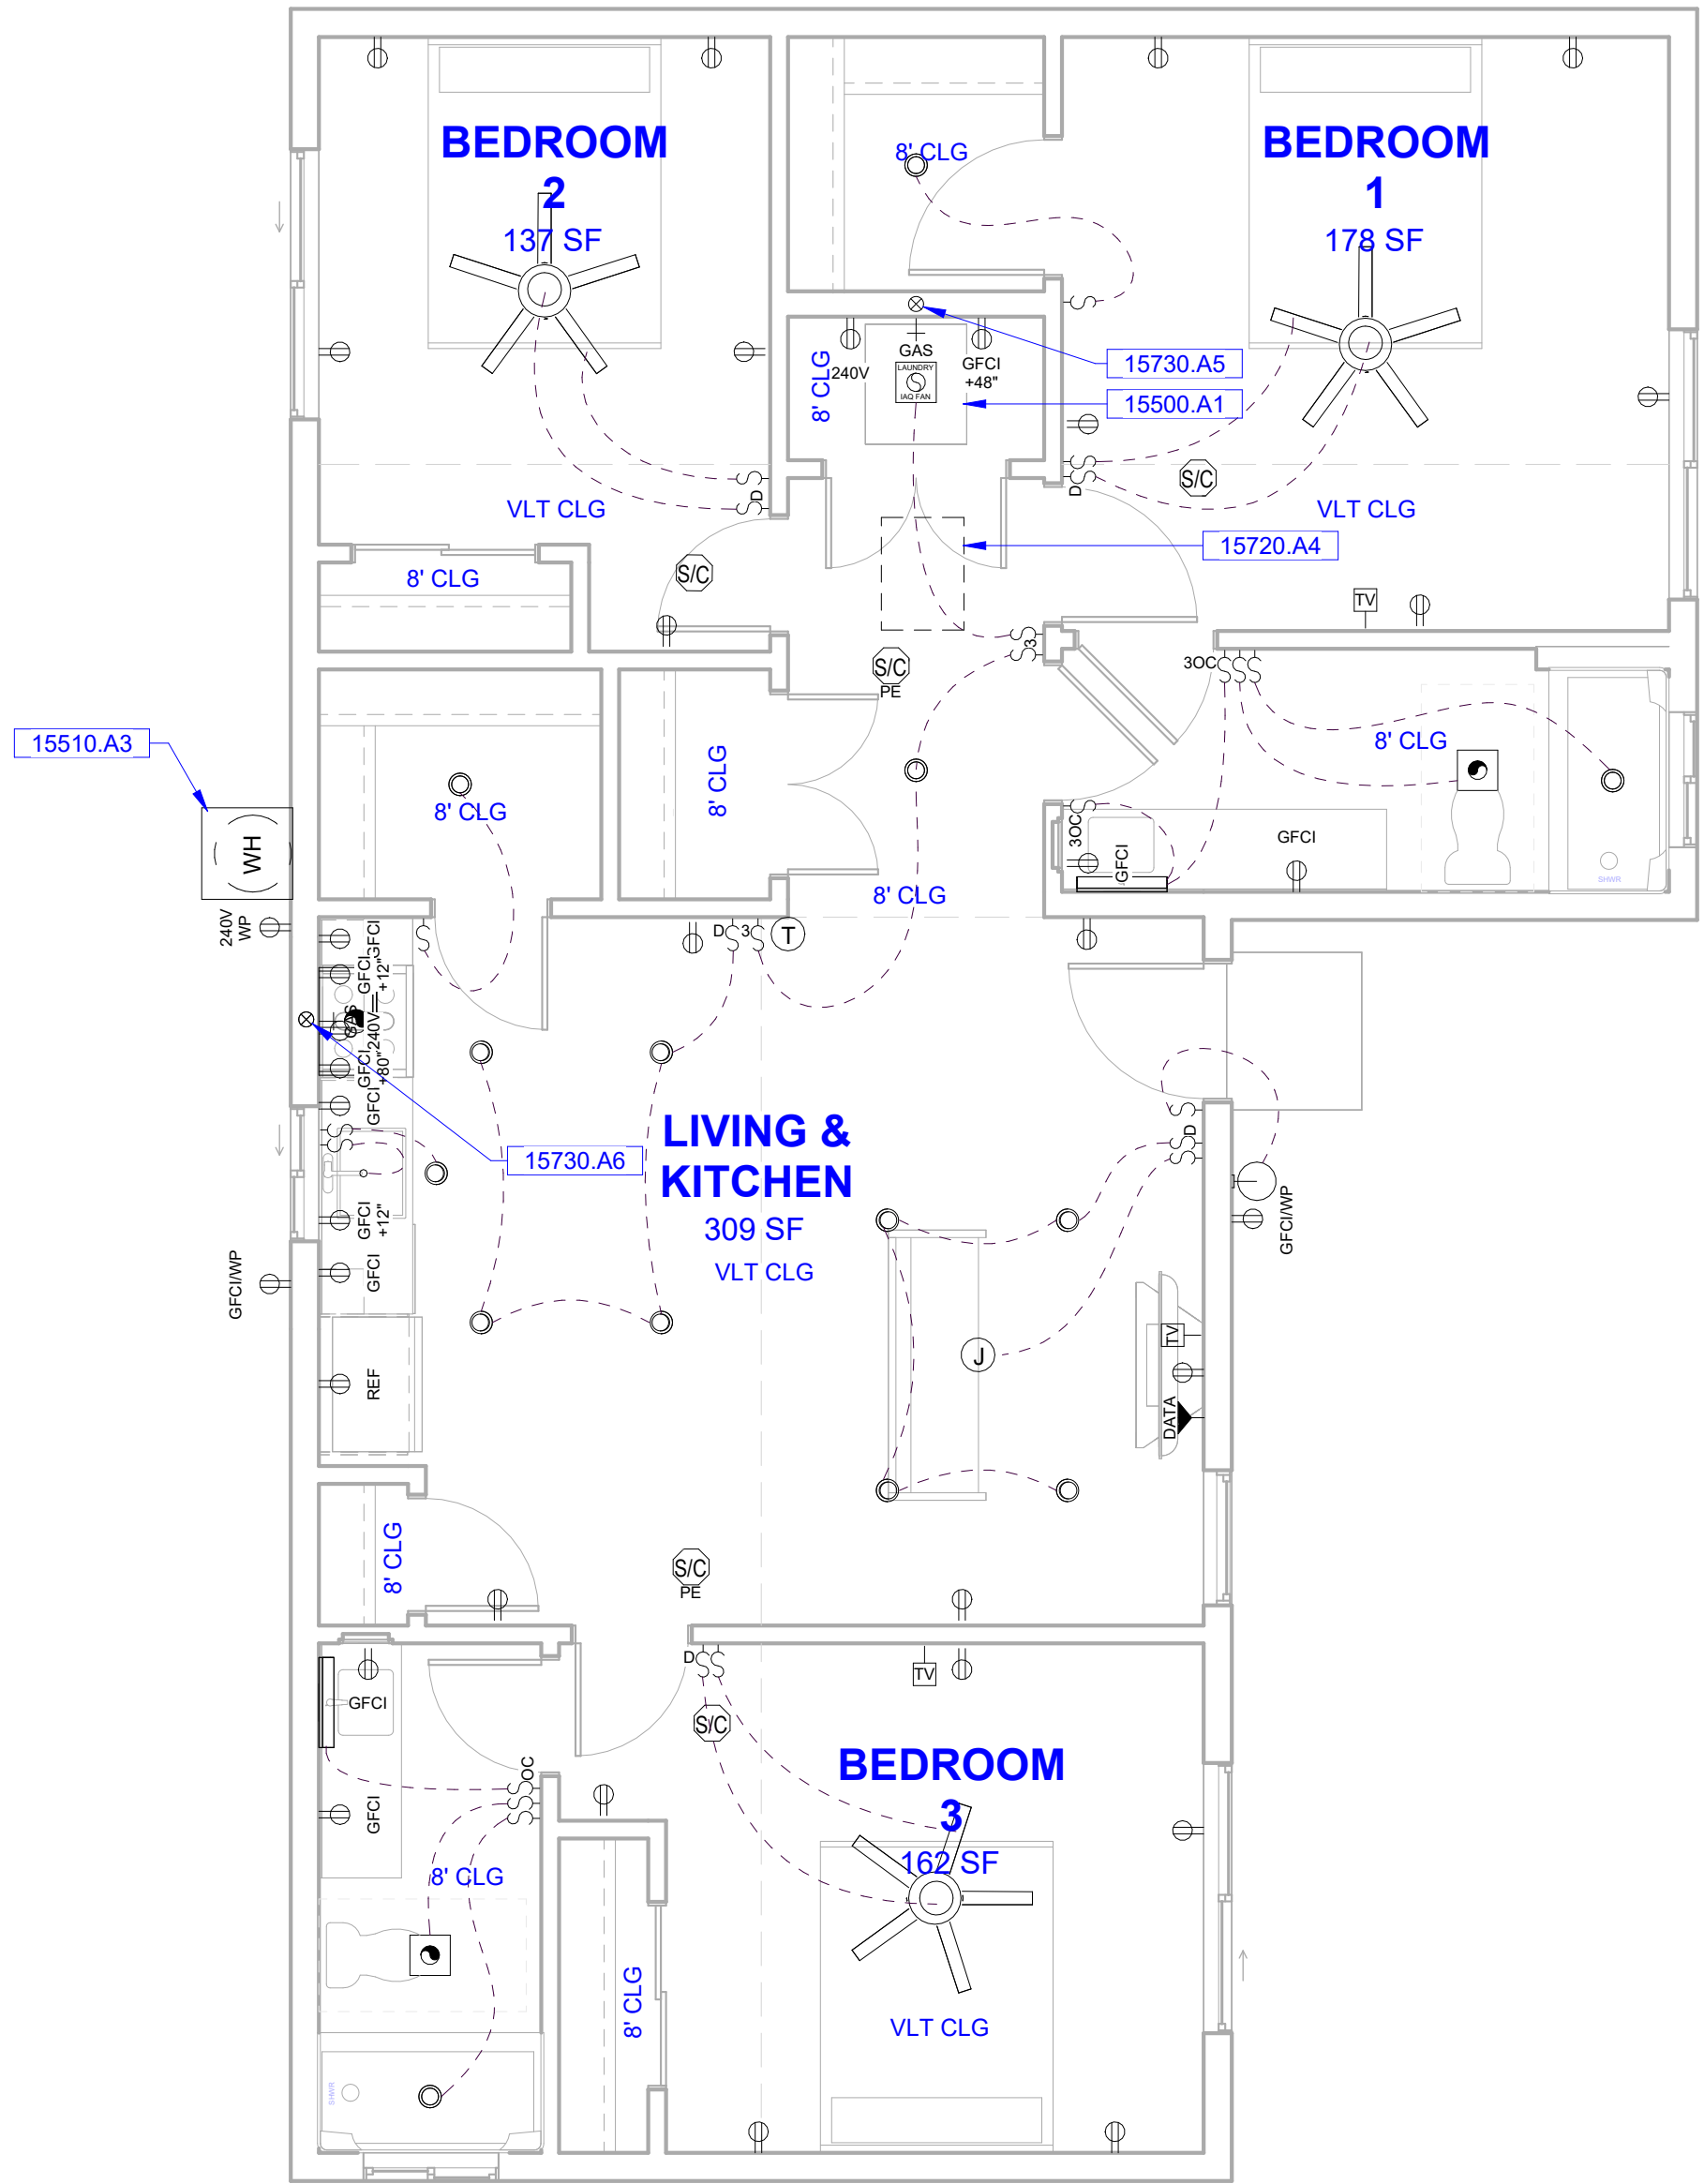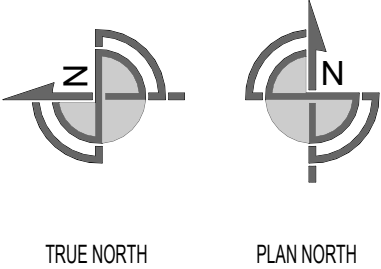

KEYNOTES

KEYNOTE	DESCRIPTION
15500.A1	ELECTRIC CLOTHES DRYER (GAS DRYER ALTERN SHALL COMPLY WITH CMC 701.4)
15510.A3	APPLICANT/OWNER TO PROVIDE CUT SHEET FOR WATER HEATER TO MEET MINIMUM REQUIREMENTS OF TITLE 24 CALCULATIONS
15720.A4	22"x30" ATTIC ACCESS
15730.A5	4" DRYER VENT, SEE SHEET G200 CODE EXCERPTS CHAPTER 5: EXHAUST SYSTEMS FOR MORE INFORMATION
15730.A6	HOOD EXHAUST FAN ABOVE ELECTRIC RANGE 110 CFM OR 50% CE MIN. (GAS RANGE 250 CFM OR 80% CE MIN.); 2022 BEES TABLE 150.0-G

ELECTRICAL FLOOR PLAN LEGEND

	SINGLE POLE SWITCH
	THREE-WAY SWITCH
	OCCUPANCY SENSOR SWITCH
	DIMMER SWITCH
	DUPLEX RECEPTACLE OUTLET
	INDICATES OUTLET HEIGHT ABOVE FINISH FLOOR
	GROUND FAULT CIRCUIT INTERRUPTER DUPLEX OUTLET
	INDICATES 240V
	INDICATES WEATHER PROOF
	SMOKE / CARBON MONOXIDE DETECTOR HARDWIRED W/ BATTERY BACKUP
	PHOTOELECTRIC SMOKE / CARBON MONOXIDE DETECTOR HARDWIRED W/ BATTERY BACKUP
	JUNCTION BOX
	THERMOSTAT
	(1) OUTLET AND BRUSH PLATE BOX @ +12" AND @ +60"
	COAX CABLE
	EXHAUST VENT FAN - INTERMITTENT 50 CFM MIN / CONTINUOUS 20 CFM MIN
	EXHAUST VENT FAN SHALL BE USED TO MEET THE REQUIREMENTS FOR INDOOR AIR QUALITY (IAQ) PER T24 REPORT (IF GAS RANGE 250 CFM MIN. TO BE PROVIDED)
	GAS POINT OF CONNECTION W/ SHUT OFF VALVE
	HOSE BIB
	RECESSED CAN LIGHT
	EXTERIOR WALL MOUNTED LIGHT
	VANITY SCONCE LIGHT
	ELECTRIC HEAT PUMP WATER HEATER
	POWER AND DISCONNECT FOR A/C CONDENSER
	A/C CONDENSER
	EVAPORATOR
	CEILING FAN WITH LIGHT

INDOOR AIR QUALITY NOTES:

- PROPOSED DWELLING UNIT FOLLOW THE **EXHAUST-ONLY APPROACH** TO COMPLY INDOOR AIR QUALITY (IAQ) REQUIREMENTS.
 - MANDATORY (CBEES 150.0(O), ASHRAE STANDARD 62.2):
EXCEPTION: ADDITIONS 1000 S.F. OR LESS AND ALTERATIONS:
 - A MECHANICAL EXHAUST VENTILATION SYSTEM, SUPPLY VENTILATION SYSTEM, OR COMBINATION THEREOF SHALL BE INSTALLED FOR EACH DWELLING UNIT TO PROVIDE WHOLE-BUILDING VENTILATION WITH OUTDOOR AIR IN COMPLIANCE WITH ASHRAE STANDARD 62.2 AS ADOPTED BY THE CALIFORNIA ENERGY COMMISSION.
 - HERS VERIFICATION REQUIRED TO CONFIRM WHOLE-BUILDING VENTILATION AIRFLOW.
 - AN INTERMITTENTLY OR CONTINUOUSLY OPERATING LOCAL MECHANICAL EXHAUST VENTILATION SYSTEM SHALL BE INSTALLED IN EACH BATHROOM WITH A BATHTUB, SHOWER, OR SIMILAR MOISTURE SOURCE AND IN EACH KITCHEN IN COMPLIANCE WITH ASHRAE STANDARD 62.2 AS ADOPTED BY THE CALIFORNIA ENERGY COMMISSION. INTERMITTENT LOCAL EXHAUST VENTILATION AIRFLOW RATES SHALL BE 20 CFM IN BATHROOMS AND 5 AIR CHANGES PER HOUR IN KITCHENS BASED ON KITCHEN VOLUME.

INDOOR AIR QUALITY NOTES:

ASHRAE STANDARD 62.2 EQUATION 4.1(a)	
THE WHOLE-BUILDING EXHAUST FAN SHALL PROVIDE A MINIMUM VENTILATION RATE ACCORDING TO EQUATION 4.1(A) BELOW:	
$Q_{fan} = 0.03A_{floor} + 7.5 (N_{br} + 1)$	
WHERE:	
Q_{fan} = FAN FLOW RATE (CFM)	
A_{floor} = CONDITIONED FLOOR AREA (S.F.)	
N_{br} = NUMBER OF BEDROOM, NOT LESS THAN ONE	
CALCULATIONS:	
$Q_{fan} = 0.03(1,199) + 7.5 (3 + 1)$	
$Q_{fan} = 35.97 + 30$	
$= 65.97 \text{ CFM (50 CFM MIN.)}$	
IAQ FAN SHALL PROVIDE 65.97 CFM PER T-24 REPORT	
LISTED WHOLE-HOUSE FAN NOT REQUIRED	
EXHAUST FAN MODEL: S&P PCD110 PREMIUM CHOICE WITH DC MOTOR; 4" DUCT SONE RATING RANGE: 0.7 - 1.2; 6" DUCT SONE RATING RANGE: 0.3 - 1.1	

ELECTRICAL NOTES:

POWER NOTES

- ALL ELECTRICAL WORK SHALL BE DESIGN PER 2022 CALIFORNIA ELECTRICAL CODE, 2022 NATIONAL ELECTRICAL CODE, AND 2022 BUILDING ENERGY EFFICIENCY STANDARDS.
- ALL ELECTRICAL EQUIPMENT SHALL BE LABELED, LISTED, OR CERTIFIED BY A NATIONALLY RECOGNIZED TESTING LABORATORY ACCREDITED BY THE UNITED STATES OCCUPATIONAL SAFETY HEALTH ADMINISTRATION.
- THE MAXIMUM COMBINED VOLTAGE DROP ON BOTH INSTALLED FEEDER CONDUCTORS AND BRANCH CIRCUIT CONDUCTORS TO THE FARTHEST CONNECTED LOAD OR OUTLET SHALL NOT EXCEED 5 PERCENT.
- ALL THE CONDUCTORS SPECIFIED IN THE PANEL SCHEDULES ARE GROUNDED SEPARATELY.
- PURCHASE RTU WITH FACTORY INSTALLED DISCONNECT. COORDINATE PROPER RATING OF DISCONNECT WITH MANUFACTURER.
- INSTALL WEATHERPROOF (WP), GFI PROTECTED, WEATHER RESISTANT RECEPTACLE OUTLETS ON THE ROOFTOP AND WITHIN 25 FT OF HEATING/AIR CONDITIONING AND IDENTIFIED AND LISTED AS "EXTRA DUTY" PER ARTICLE 408.9 (B)(1) & 408.4(D)(6).
- ALL WORK PERFORMED SHALL COMPLY WITH ALL STATE AND LOCAL ALL ELECTRICAL CODES.
- ALL BRANCH CIRCUIT BREAKERS SHALL BE 10,000 AIC RATING, UNLESS NOTED OTHERWISE.
- ALL THE HVAC UNITS ARE EQUIPPED WITH FACTORY INSTALLED DISCONNECT SWITCH UNLESS NOTIFIED OTHERWISE. COORDINATE WITH MANUFACTURE BEFORE INSTALLATION AND IN THE ABSENCE OF DISCONNECT SWITCH PROVIDE REQUIRED DISCONNECT AS PER NEC 430.104 AND 430.110.
- THE BATHROOM CIRCUITING SHALL BE EITHER A 20-AMP, CIRCUIT DEDICATED TO EACH BATHROOM, OR AT LEAST ONE 20 AMP, CIRCUIT SUPPLYING ONLY BATHROOM RECEPTACLE OUTLETS PER CEC 210.11(C)(3).
- ALL ELECTRICAL DEVICES INSTALLED IN DWELLINGS SHALL BE PROVIDED WITH ARC-FAULT PROTECTION OUTLETS (NOT JUST RECEPTACLES) LOCATED IN ROOMS DESCRIBED IN NEC 210.12(A); KITCHENS, LAUNDRY AREAS, FAMILY, LIVING, BEDROOMS, DINING, HALLS, ETC. CEC ARTICLE 210 & 406.
- ALL 120-VOLT, SINGLE-PHASE, 15- AND 20-AMPERE BRANCH CIRCUITS SUPPLYING OUTLETS OR DEVICES INSTALLED IN DWELLING UNITS KITCHENS, FAMILY ROOMS, SUNROOMS, DINING ROOMS, LIVING ROOMS, PARLORS, LIBRARIES, DENS, BEDROOMS, AND SUNROOMS, RECREATION ROOMS, CLOSETS, HALLWAYS, LAUNDRY AREAS, OR SIMILAR ROOMS OR AREA SHALL BE PROTECTED BY ANY OF THE MEANS DESCRIBED IN 210.12(A)(1) THROUGH (6).
- INSTALL A MINIMUM OF 2 SMALL APPLIANCE BRANCH CIRCUITS WITHIN THE KITCHEN AND DINING AREAS PER CEC 210.11(C)(1) & 210.52(B).
- ALL OUTLETS IN KITCHEN AND BATHROOMS SHALL BE GFCI PER CEC 210.8.
- ALL RECEPTACLES INSTALLED IN THE DWELLING SHOULD BE TAMPER RESISTANT PER ARTICLE 210.52 & 550.13.
- PER CEC 210.11(C)(3), BATHROOM CIRCUITING SHALL BE EITHER:
 - A 20 AMP CIRCUIT DEDICATED TO EACH BATHROOM, OR
 - AT LEAST ONE 20 AMP CIRCUIT SUPPLYING ONLY BATHROOM RECEPTACLE OUTLETS.
- ELECTRIC POWERED APPLIANCES SHALL BE PROVIDED WITH A 30A CIRCUIT. CEC 220.54.
- ELECTRICAL RECEPTACLE OUTLETS, SWITCHES AND CONTROLS (INCLUDING CONTROLS FOR HEATING, VENTILATION AND AIR CONDITIONING) INTENDED TO BE USED BY OCCUPANTS SHALL BE LOCATED NO MORE THAN 48 INCHES MEASURED FROM THE TOP OF THE OUTLET BOX AND NOT LESS THAN 15 INCHES MEASURED FROM THE BOTTOM OF THE OUTLET BOX ABOVE THE FINISH FLOOR. R327.1.2.
- DOORBELL BUTTONS OR CONTROLS, WHEN INSTALLED, SHALL NOT EXCEED 48 INCHES (1219.2 MM) ABOVE EXTERIOR FLOOR OR LANDING, MEASURED FROM THE TOP OF THE DOORBELL BUTTON ASSEMBLY, WHERE DOORBELL BUTTONS INTEGRATED WITH OTHER FEATURES ARE REQUIRED TO BE INSTALLED ABOVE 48 INCHES (1219.2 MM) MEASURED FROM THE EXTERIOR FLOOR OR LANDING. A STANDARD DOORBELL BUTTON OR CONTROL SHALL ALSO BE PROVIDED AT A HEIGHT NOT EXCEEDING 48 INCHES (1219.2 MM) ABOVE EXTERIOR FLOOR OR LANDING, MEASURED FROM THE TOP OF THE DOORBELL BUTTON OR CONTROL. R327.1.4.
- SURGE PROTECTION REQUIREMENTS:
 - ALL SERVICES SUPPLYING DWELLING UNITS SHALL BE PROVIDED WITH A SURGE-PROTECTIVE DEVICE (SPD).
 - LOCATION - THE SPD SHALL BE AN INTEGRAL PART OF THE SERVICE EQUIP-MENT OR SHALL BE LOCATED IMMEDIATELY ADJACENT THERETO.
 - EXCEPTION: THE SPD SHALL NOT BE REQUIRED TO BE IN THE SERVICE EQUIPMENT AS REQUIRED IN.
 - IF LOCATED AT EACH NEXT LEVEL DISTRIBUTION EQUIPMENT DOWN-STREAM TOWARD THE LOAD.
 - E. TYPE - THE SPD SHALL BE A TYPE 1 OR TYPE 2 SPD.

LIGHTING NOTES

- PROVIDE LIGHTING CONTROL WITH CONTINUOUS DIMMING IN ALL AREAS. PROVIDE REQUIRED DRIVERS AND DIMMER SWITCHES FOR CONTINUOUS DIMMING USING 0-10 VOLT DIMMING.
- LIGHTING SHALL PROVIDE NOT LESS THAN 215 LUX (20 FOOTCANDLES) AS MEASURED 30" ABOVE FLOOR.
- IF APPLICABLE, SPECIFY THAT THE EXHAUST FANS TO BE ON A SEPARATE SWITCH FROM LIGHTS PER CENC 150.0(K)2B.
- ALL INSTALLED LUMINAIRES SHALL BE HIGH-EFFICACY IN ACCORDANCE WITH ES TABLE 150.0-A.
 - LUMINAIRES MUST HAVE A LABEL CERTIFIED FOR AIRTIGHT CONSTRUCTION.
 - LIGHT SOURCES THAT ARE NOT MARKED "JAB8-2019-E" SHALL NOT BE INSTALLED IN ENCLOSED LUMINAIRES. ES 150.0(K)
- BATHROOMS, GARAGE, LAUNDRY ROOMS, AND UTILITY ROOM LIGHTING TO HAVE ONE LUMINAIRE CONTROLLED BY A VACANCY OR OCCUPANCY SENSOR PROVIDING AUTOMATIC-OFF FUNCTIONALITY PER CENC SECTION 150.0(K)2. IF AN OCCUPANT SENSOR IS INSTALLED, IT SHALL BE INITIALLY CONFIGURED TO MANUAL-ON OPERATION USING THE MANUAL CONTROL REQUIRED UNDER SECTION 150.0(K)2C.
- ALL OTHER LUMINAIRES THAT CONTAIN LIGHT SOURCES THAT MEET REFERENCE JOINT APPENDIX JAB REQUIREMENTS ARE TO BE CONTROLLED BY A VACANCY/OCCUPANCY SENSOR OR DIMMER PER CENC SECTION 150.0(K)2J. NOTE THAT CLOSETS WITH AN AREA LESS THAN 70 FT² AND HALLWAY LIGHTING ARE EXEMPT FROM THIS REQUIREMENT.
- RECESSED CAN LIGHT FIXTURES SHALL BE IC LISTED, AIR-TIGHT LABELED, AND NOT BE EQUIPPED WITH A STANDARDS-MEDIUM BASE SCREW SH BASE AMP HOLDER. ES 150.0(K)
- IF OUTDOOR LIGHTING FIXTURES THAT ARE ATTACHED TO A BUILDING ARE REQUIRED TO BE HIGH EFFICACY, BE MANUALLY ON/OFF SWITCH CONTROLLED, AND HAVE BOTH MOTION SENSOR AND PHOTOCCELL CONTROL. SEE ES 150.0(K) 3 FOR ADDITIONAL CONTROL OPTIONS.

SDGE NOTES:

- SDGE HAS SPECIFIC REQUIREMENTS ABOUT THE NUMBER OF MAIN ELECTRICAL SERVICE PANELS (HOW MANY ELECTRICAL DROPS) ALLOWED ON THE SAME LOT, WHICH IS DIFFERENT FROM THE REQUIREMENTS OF THE CITY OF CHULA VISTA AND CALIFORNIA ELECTRICAL CODE.
- SDGE MAY REQUIRE ALL NEW ADU(S)/JADU(S) TO BE PLACED ON A SEPARATE ELECTRIC METER.
- IT IS THE RESPONSIBILITY OF THE PROJECT DESIGNER TO CONTACT SDGE FOR THE REQUIREMENTS FOR SETTING UP THE NEW ELECTRICAL UTILITIES TO ALL NEW ADU(S)/JADU(S).
- REFER TO THE CURRENT SDGE SERVICE STANDARDS AND GUIDE TO ENSURE THAT PROJECT COMPLIES WITH THEIR REQUIREMENTS.

MECHANICAL NOTES:

EXHAUST FAN NOTES

- KITCHENS REQUIRE EXHAUST FANS WITH A MINIMUM 110 CFM (250 CFM IF GAS RANGE) DUCTED TO THE EXTERIOR. DETAIL COMPLIANCE BY INCLUDING A COMPLYING EXHAUST FAN OR A DUCTED RANGE HOOD TO THE EXTERIOR.
- BATHROOMS REQUIRE EXHAUST FANS (MINIMUM 50 CFM) TO BE DUCTED TO THE EXTERIOR. A BATHROOM IS DEFINED "AS A ROOM WITH A BATHTUB, SHOWER, OR SPA OR SOME SIMILAR SOURCE OF MOISTURE."
- RESIDENTIAL BATHROOM EXHAUST FANS SHALL BE ENERGY STAR RATED AND SHALL BE CONTROL BY A HUMIDISTAT CAPABLE OF AN ADJUSTMENT BETWEEN 50 AND 80% HUMIDITY. CALGREEN 4.508.1. EXCEPTION: CONTROL BY A HUMIDISTAT IS NOT REQUIRED IF THE BATHROOM EXHAUST FAN IS ALSO THE DWELLING WHOLE HOUSE VENTILATION.

SMOKE & CARBON MONOXIDE NOTES:

SMOKE & CARBON MONOXIDE ALARM NOTES

- SMOKE ALARMS SHALL BE INTERCONNECTED PER CRC R314.4.
- SMOKE ALARMS SHALL BE HARD-WIRED WITH BATTERY BACK-UP PER CRC R314.6 IN THE FOLLOWING LOCATIONS ON FLOOR PLANS OR UTILITY PLANS (CRC R314.3):
 - OUTSIDE EACH SEPARATE SLEEPING AREA IN IMMEDIATE VICINITY OF BEDROOMS
 - ON EACH STORY OF DWELLING
 - IN ANY BEDROOM WITH A FUEL-BURNING APPLIANCE LOCATED WITHIN THAT BEDROOM OR ITS ATTACHED BATHROOM
- CARBON MONOXIDE DETECTOR SHALL BE INTERCONNECTED PER CRC R315.1.7 AND HARD-WIRED WITH BATTERY BACK-UP PER CRC R315.5 - IN THE FOLLOWING LOCATIONS ON FLOOR PLANS OR UTILITY PLANS IN DWELLING UNITS WITH FUEL-BURNING APPLIANCES, FIREPLACE, OR AN ATTACHED GARAGE COMMUNICATING WITH THE DWELLING UNIT (CRC R315):
 - OUTSIDE EACH SEPARATE SLEEPING AREA IN IMMEDIATE VICINITY OF BEDROOMS
 - ON EACH STORY OF DWELLING
 - IN ANY BEDROOM WITH A FUEL-BURNING APPLIANCE LOCATED WITHIN THAT BEDROOM OR ITS ATTACHED BATHROOM
- COMBINATION SMOKE AND CARBON MONOXIDE ALARMS SHALL BE LISTED IN ACCORDANCE WITH UL-217 AND UL-2034. CRC R314.1.1 & R315.1.1.
- SMOKE ALARMS SHALL BE LOCATED AT LEAST 3 FT FROM THE ENTRY DOOR TO ANY BATHROOM CONTAINING A BATHTUB/SHOWER. CRC R314.3.3.
- ALL SMOKE ALARMS SHALL BE LOCATED AT LEAST 20 FT FROM A PERMANENTLY INSTALLED COOKING APPLIANCE. CRC R314.3.3.
 - SMOKE ALARMS ARE ALLOWED TO BE 10 FT FROM A PERMANENTLY INSTALLED COOKING APPLIANCE IF THE SMOKE ALARM IS AN IONIZATION SMOKE ALARM WITH ALARM SILENCING SWITCH, OR PHOTOELECTRIC SMOKE ALARM IN ACCORDANCE CRC R314.3.3. (4) EXCEPTION.

YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 1,199 L-SHAPE
CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:
LUIS CALDERON
SnapADU


SIGNATURE

RELEASE	DATE	BY	APP.	RELEASED FOR...
	03/22/2024		LAG	



ELECTRICAL PLAN
- 3-BEDROOM

E100

22040

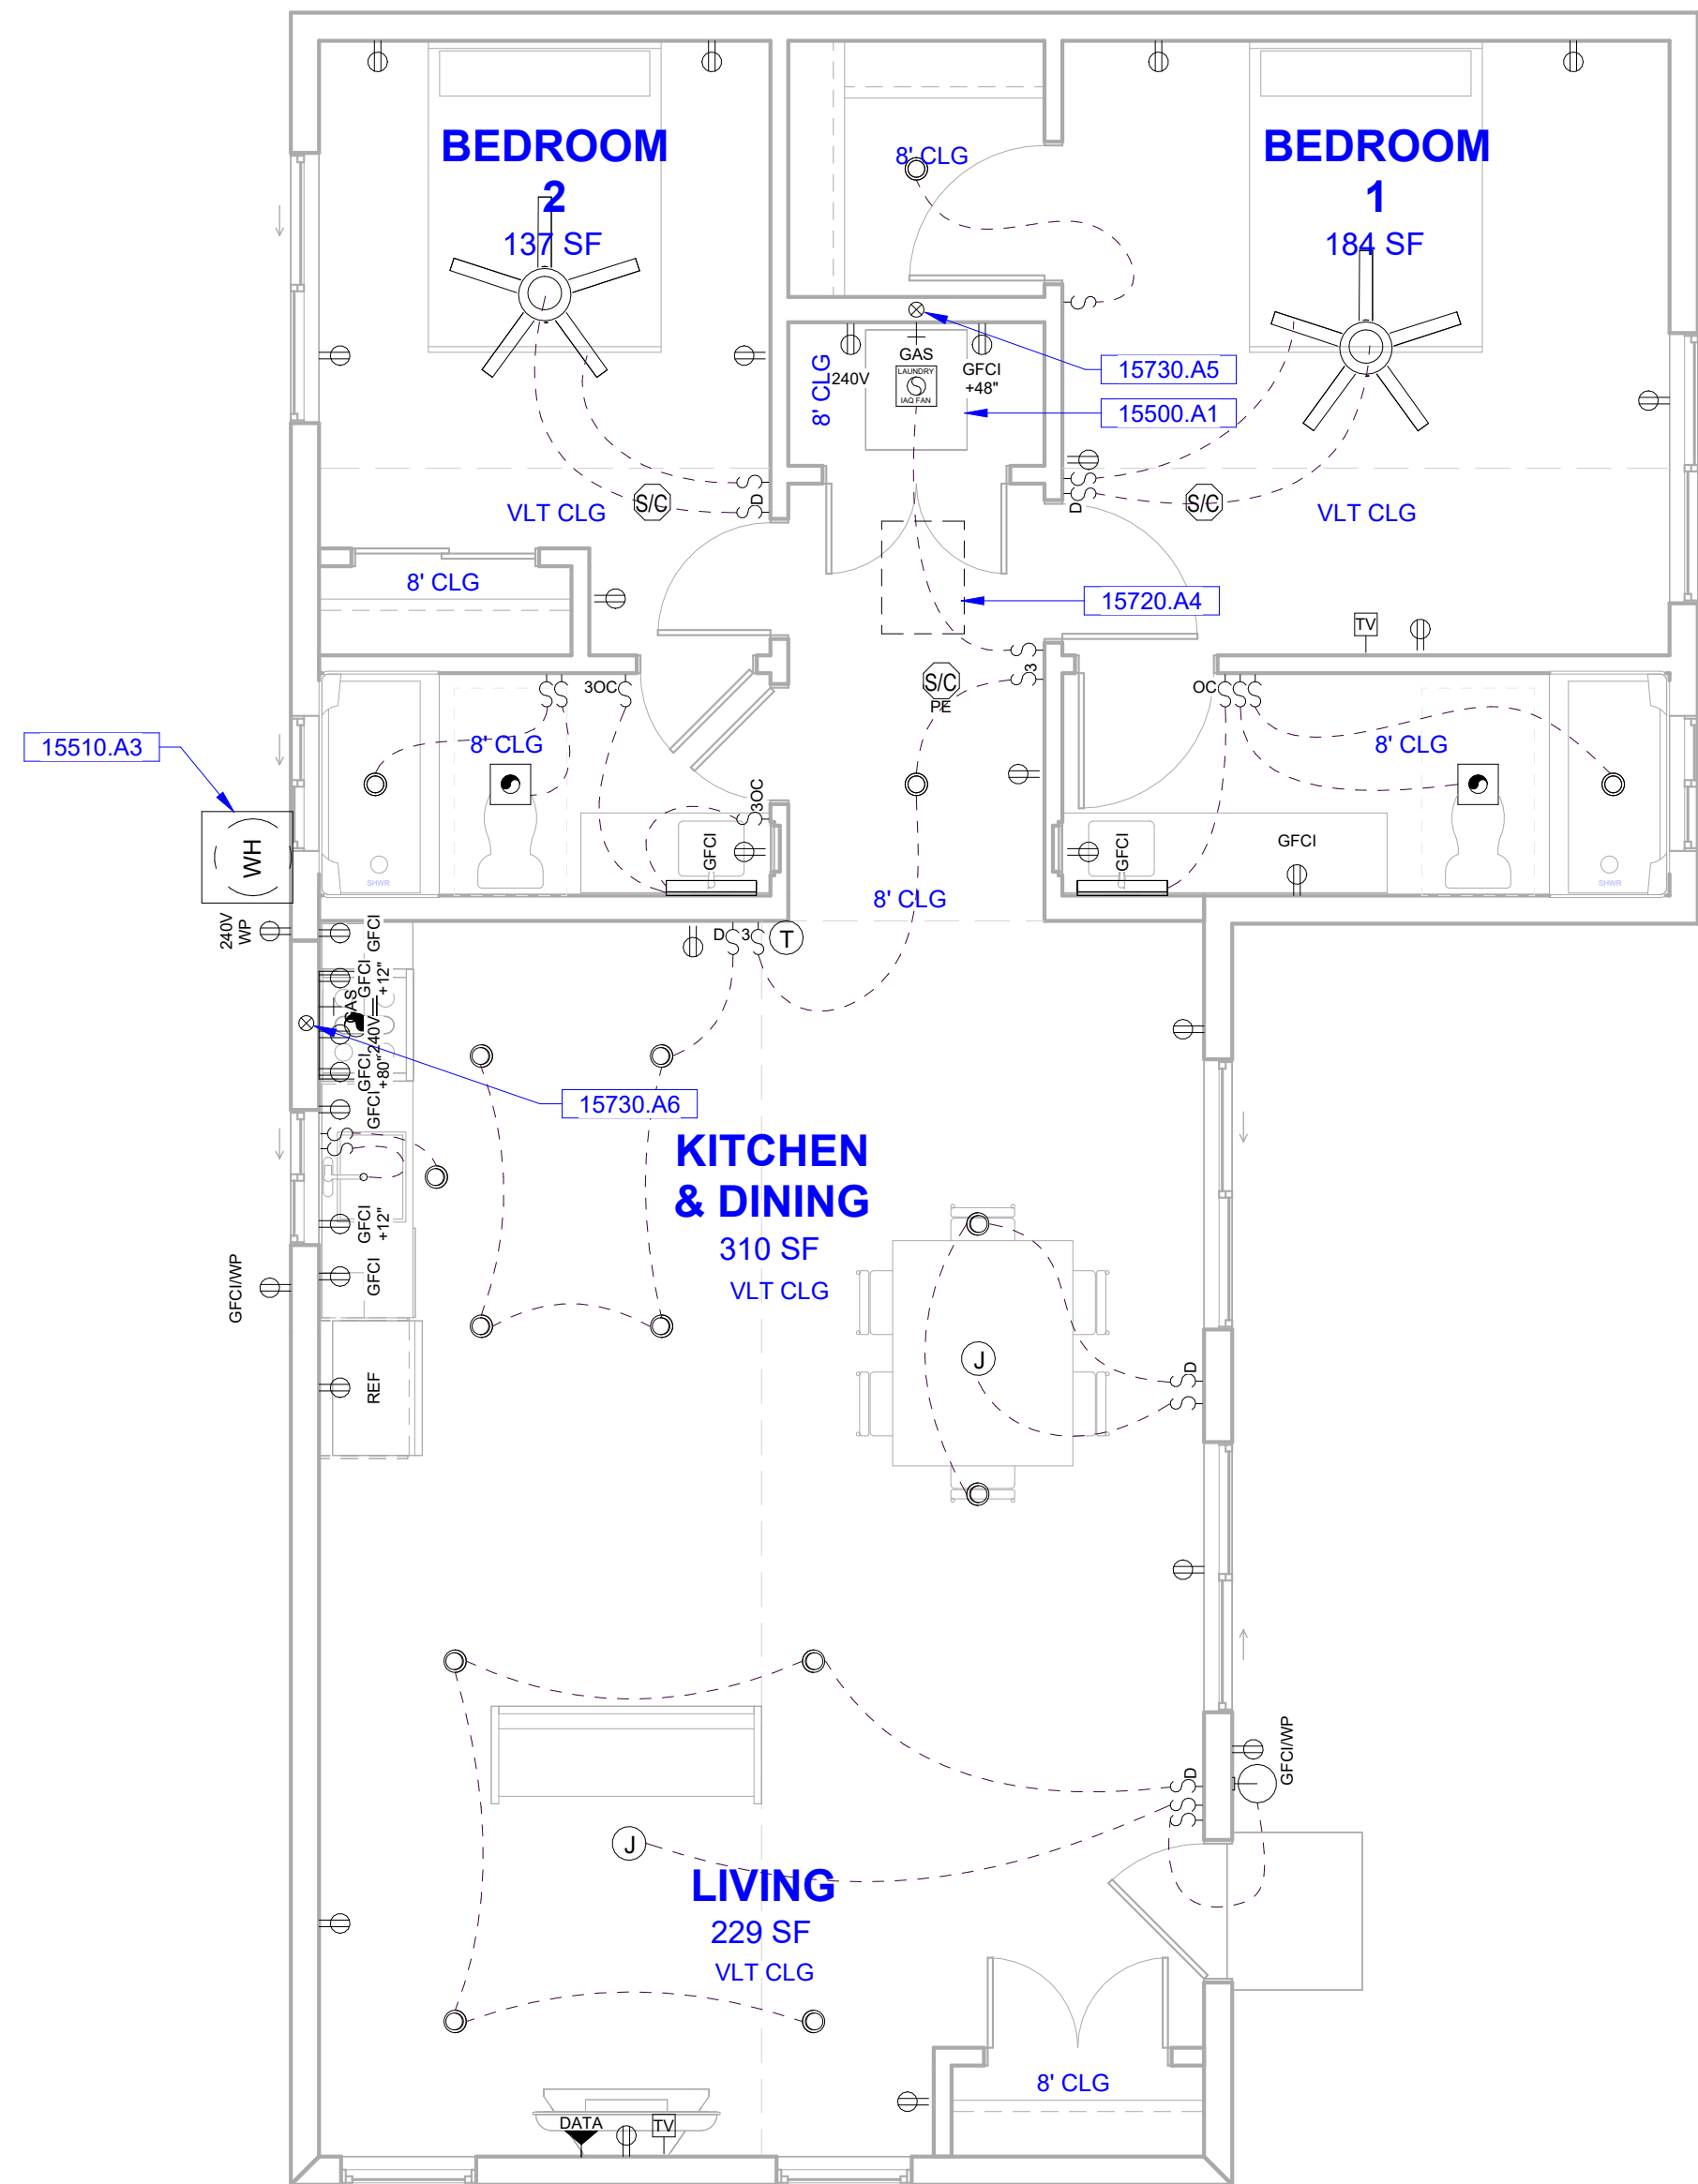



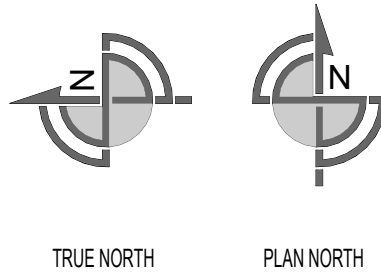

























1 2-BEDROOM OPTION ELECTRICAL PLAN
SCALE: 1/4" = 1'-0"



KEYNOTES

KEYNOTE	DESCRIPTION
15500.A1	ELECTRIC CLOTHES DRYER (GAS DRYER ALTERN SHALL COMPLY WITH CMC 701.4)
15510.A3	APPLICANT/OWNER TO PROVIDE CUT SHEET FOR WATER HEATER TO MEET MINIMUM REQUIREMENTS OF TITLE 24 CALCULATIONS
15720.A4	22"x30" ATTIC ACCESS
15730.A5	4" DRYER VENT CHUTE SHEET G200 CODE EXCERPTS CHAPTER 5: EXHAUST SYSTEMS FOR MORE INFORMATION
15730.A6	HOOD EXHAUST FAN ABOVE ELECTRIC RANGE 110 CFM OR 50% CE MIN. (GAS RANGE 250 CFM OR 80% CE MIN.) 2022 BEES TABLE 150.0-0

ELECTRICAL FLOOR PLAN LEGEND

	THREE-WAY SWITCH
	OCCUPANCY SENSOR SWITCH
	DIMMER SWITCH
	DUPLEX RECEPTACLE OUTLET
	INDICATES OUTLET HEIGHT ABOVE FINISH FLOOR
	GROUND FAULT CIRCUIT INTERRUPTER DUPLEX OUTLET
	INDICATES 240V
	INDICATES WEATHER PROOF
	SMOKE / CARBON MONOXIDE DETECTOR HARDWIRED W/ BATTERY BACKUP
	PHOTOELECTRIC SMOKE / CARBON MONOXIDE DETECTOR HARDWIRED W/ BATTERY BACKUP
	JUNCTION BOX
	THERMOSTAT
	(1) OUTLET AND BRUSH PLATE BOX @ +12" AND @ +60"
	COAX CABLE
	EXHAUST VENT FAN - INTERMITTENT 50 CFM MIN / CONTINUOUS 20 CFM MIN
	EXHAUST VENT FAN SHALL BE USED TO MEET THE REQUIREMENTS FOR INDOOR AIR QUALITY (IAQ) PER T24 REPORT
	MICROWAVE-HOOD EXHAUST FAN COMBO 110 CFM MIN (IF GAS RANGE 250 CFM MIN. TO BE PROVIDED)
	GAS POINT OF CONNECTION W/ SHUT OFF VALVE
	WATER CONNECTION
	HOSE BIB
	RECESSED CAN LIGHT
	EXTERIOR WALL MOUNTED LIGHT
	VANITY SCONCE LIGHT
	ELECTRIC HEAT PUMP WATER HEATER
	POWER AND DISCONNECT FOR A/C CONDENSER
	A/C CONDENSER
	EVAPORATOR
	Ceiling fan with light

INDOOR AIR QUALITY NOTES:

1. PROPOSED DWELLING UNIT FOLLOW THE **EXHAUST-ONLY APPROACH** TO COMPLY INDOOR AIR QUALITY (IAQ) REQUIREMENTS
- A. MANDATORY (CBEES 150.0 (F), ASHRAE STANDARD 62.2):
- EXCEPTION: ADDITIONS 100.0 (F) OR LESS AND ALTERATIONS:
- A MECHANICAL EXHAUST VENTILATION SYSTEM, SUPPLY VENTILATION SYSTEM, OR COMBINATION THEREOF SHALL BE INSTALLED FOR EACH DWELLING UNIT TO PROVIDE WHOLE-BUILDING VENTILATION WITH OUTDOOR AIR IN COMPLIANCE WITH ASHRAE STANDARD 62.2 AS ADOPTED BY THE CALIFORNIA ENERGY COMMISSION.
 - HEREIN VERIFICATION SHALL BE REQUIRED TO COMPLY WITH WHOLE-BUILDING VENTILATION AIRFLOW.
 - AN INTERMITTENTLY OR CONTINUOUSLY OPERATING LOCAL MECHANICAL EXHAUST VENTILATION SYSTEM SHALL BE INSTALLED IN EACH BATHROOM WITH A BATHTUB, SHOWER, OR SIMILAR MOISTURE SOURCE AND IN EACH KITCHEN IN COMPLIANCE WITH ASHRAE STANDARD 62.2 AS ADOPTED BY THE CALIFORNIA ENERGY COMMISSION. INTERMITTENT LOCAL EXHAUST VENTILATION AIRFLOW RATE SHALL BE 10 CFM IN BATHROOMS AND 5 AIR CHANGES PER HOUR IN KITCHENS BASED ON KITCHEN VOLUME.

INDOOR AIR QUALITY NOTES:

ASHRAE STANDARD 62.2 EQUATION 4.1(a)	
THE WHOLE-BUILDING EXHAUST FAN SHALL PROVIDE A MINIMUM VENTILATION RATE ACCORDING TO EQUATION 4.1(A) BELOW:	
$Q_{fan} = 0.03A_{floor} + 7.5 (Nbr + 1)$	
WHERE:	$Q_{fan} = \text{FAN FLOW RATE (CFM)}$ $A_{floor} = \text{CONDITIONED FLOOR AREA (S.F.)}$ $Nbr = \text{NUMBER OF BEDROOM, NOT LESS THAN ONE}$
CALCULATIONS:	$Q_{fan} = 0.03(1,199) + 7.5 (3 + 1)$ $Q_{fan} = 35.97 + 30$ $= 65.97 \text{ CFM (50 CFM MIN.)}$
IAQ FAN SHALL PROVIDE 65.97 CFM PER T-24 REPORT	
LISTED WHOLE-HOUSE FAN NOT REQUIRED	
EXHAUST FAN MODEL: S&P PCD110-PREMIUM CHOICE WITH DC MOTOR; 4" DUCT SONE RATING RANGE: 0.7 - 1.2; 6" DUCT SONE RATING RANGE: 0.3 - 1.1	

ELECTRICAL NOTES:

POWER NOTES

1. ALL ELECTRICAL WORK SHALL BE DESIGN PER 2022 CALIFORNIA ELECTRICAL CODE, 2022 NATIONAL ELECTRICAL CODE, AND 2022 BUILDING ENERGY EFFICIENCY STANDARDS.
2. ALL ELECTRICAL EQUIPMENT SHALL BE LABELED, LISTED, OR CERTIFIED BY A NATIONALLY RECOGNIZED LISTING LABORATORY ACCREDITED BY THE UNITED STATES OCCUPATIONAL SAFETY HEALTH ADMINISTRATION.
3. THE MAXIMUM COMBINED VOLTAGE DROP ON BOTH INSTALLED FEEDER CONDUCTORS AND BRANCH CIRCUIT CONDUCTORS TO THE FARTHEST CONNECTED LOAD OR OUTLET SHALL NOT EXCEED 5 PERCENT.
4. ALL THE CONDUCTOR'S SPECIFIED IN THE PANEL SCHEDULES ARE GROUNDED SEPARATELY.
5. PURCHASE RTU WITH FACTORY INSTALLED DISCONNECT. COORDINATE PROPER RATING OF DISCONNECT WITH MANUFACTURER.
6. INSTALL WEATHERPROOF (WP), GIP PROTECTED, WEATHER RESISTANT RECEPTACLE OUTLETS ON THE ROOFTOP AND WITHIN 25 FT OF HEATING/AIR CONDITIONING AND IDENTIFIED AND LISTED AS "EXTRA DUTY" PER ARTICLE 406.9 (B)(1) & 406.4(D)(6).
7. ALL WORK PERFORMED SHALL COMPLY WITH ALL STATE AND LOCAL ALL ELECTRICAL CODES.
8. ALL BRANCH CIRCUIT BREAKERS SHALL BE 10,000 AIC RATING, UNLESS NOTED OTHERWISE.
9. ALL THE HVAC UNITS ARE EQUIPPED WITH FACTORY INSTALLED DISCONNECT SWITCH UNLESS NOTIFIED OTHERWISE. COORDINATE WITH MANUFACTURE BEFORE INSTALLATION AND IN THE ABSENCE OF DISCONNECT SWITCH PROVIDED REQUIRE DISCONNECT AS PER NEC 430.104 AND 430.110.
10. THE BATHROOM CIRCUITING SHALL BE EITHER A 20-AMP, CIRCUIT DEDICATED TO EACH BATHROOM, OR AT LEAST ONE 20-AMP, CIRCUIT SUPPLYING ONLY BATHROOM RECEPTACLE OUTLETS PER NEC 210.11(C)(3).
11. ALL ELECTRICAL DEVICES INSTALLED IN DWELLINGS SHALL BE PROVIDED WITH ARC-FULT PROTECTION OUTLETS (NOT JUST RECEPTACLES) LOCATED IN ROOMS DESCRIBED IN NEC 210.12(A): KITCHENS, LAUNDRY AREAS, FAMILY, LIVING, BEDROOMS, DINING, HALLS, ETC. CEC ARTICLE 210 & 406.
12. ALL 120-VOLT, SINGLE-PHASE, 15- AND 20-AMPERE BRANCH CIRCUITS SUPPLYING OUTLETS OR DEVICES INSTALLED IN DWELLING UNIT KITCHENS, FAMILY ROOMS, SUNROOMS, DINING ROOMS, LIVING ROOMS, PAINTED LIBRARIES, RECREATION ROOMS, RECREATION ROOMS, CLOSETS, HALLWAYS, LAUNDRY AREAS, OR SIMILAR ROOMS OR AREA SHALL BE PROTECTED BY ANY OF THE MEANS DESCRIBED IN 210.12(A)(1) THROUGH (6).
13. INSTALL A MINIMUM OF 2 SMALL APPLIANCE BRANCH CIRCUITS WITHIN THE KITCHEN AND DINING AREAS PER NEC 210.11(C)(1) & 210.52(B).
14. ALL OUTLETS IN KITCHEN AND BATHROOMS SHALL BE GFCI PER CEC 210.8.
15. ALL RECEPTACLES INSTALLED IN THE DWELLING SHOULD BE TAMPER RESISTANT PER ARTICLE 210.52 & 550.13.
16. PER CEC 210.11(C)(3), BATHROOM CIRCUITING SHALL BE EITHER:
 - A. A 20 AMP CIRCUIT DEDICATED TO EACH BATHROOM, OR
 - B. AT LEAST ONE 20 AMP CIRCUIT SUPPLYING ONLY BATHROOM RECEPTACLE OUTLETS.
17. ELECTRICAL POWERED APPLIANCES SHALL BE PROVIDED WITH A 30A CIRCUIT, CEC 220.54.
18. ELECTRICAL RECEPTACLE OUTLETS, SWITCHES AND CONTROLS (INCLUDING CONTROLS FOR HEATING, VENTILATION AND AIR CONDITIONING) INTENDED TO BE USED BY OCCUPANTS SHALL BE LOCATED NO MORE THAN 48 INCHES MEASURED FROM THE TOP OF THE OUTLET BOX AND NOT LESS THAN 15 INCHES MEASURED FROM THE BOTTOM OF THE OUTLET BOX TO THE TOP OF THE OUTLET BOX, R327.1.2.
19. DOORBELL BUTTONS OR CONTROLS, WHEN INSTALLED, SHALL NOT EXCEED 48 INCHES (1219.2 MM) ABOVE EXTERIOR FLOOR OR LANDING, MEASURED FROM THE TOP OF THE DOORBELL BUTTON ASSEMBLY, WHERE DOORBELL BUTTONS INTEGRATED WITH OTHER FEATURES ARE REQUIRED TO BE INSTALLED ABOVE 48 INCHES (1219.2 MM) MEASURED FROM THE EXTERIOR FLOOR OR LANDING, A STANDARD DOORBELL BUTTON OR CONTROL SHALL ALSO BE PROVIDED AT A HEIGHT NOT EXCEEDING 48 INCHES (1219.2 MM) ABOVE EXTERIOR FLOOR OR LANDING, MEASURED FROM THE TOP OF THE DOORBELL BUTTON OR CONTROL. R327.1.4.
20. SURGE PROTECTION REQUIREMENTS:
 - A. ALL SERVICES SUPPLYING DWELLING UNITS SHALL BE PROVIDED WITH A SURGE-PROTECTIVE DEVICE (SPD).
 - B. LOCATION - THE SPD SHALL BE AN INTEGRAL PART OF THE SERVICE EQUIP-MENT OR SHALL BE LOCATED IMMEDIATELY ADJACENT THERETO.
 - C. THE LOCATION OF THE SPD SHALL NOT BE REQUIRED TO BE IN THE SERVICE EQUIPMENT AS REQUIRED IN 11.4.
 - D. IF LOCATED AT EACH NEXT LEVEL DISTRIBUTION EQUIPMENT DOWN-STREAM TOWARD THE LOAD.
 - E. TYPE - THE SPD SHALL BE A TYPE I OR TYPE 2 SPD.

LIGHTING NOTES

1. PROVIDE LIGHTING CONTROL WITH CONTINUOUS DIMMING IN ALL AREAS. PROVIDE REQUIRED DRIVERS AND DIMMER SWITCHES FOR CONTINUOUS DIMMING USING 0-10 VOLT DIMMING.
2. LIGHTING SHALL PROVIDE NOT LESS THAN 215 LUX (20 FOOT-CANDLES) AS MEASURED 30" ABOVE FLOOR.
3. IF APPLICABLE, SPECIFY THAT THE EXHAUST FANS TO BE ON A SEPARATE SWITCH FROM LIGHTS PER CEC 150.0(K)(2B).
4. ALL INSTALLED LUMINAIRES SHALL BE HIGH-EFFICACY IN ACCORDANCE WITH ES TABLE 150.0-A.
5. LUMINAIRIES MUST HAVE A LABEL CERTIFIED FOR AIRTIGHT CONSTRUCTION.
6. LIGHT SOURCES THAT ARE NOT MARKED "JAB-919-R" SHALL NOT BE INSTALLED IN ENCLOSED LUMINAIRIES. ES 150.0(K)
7. BATHROOMS, GARAGE, LAUNDRY ROOMS, AND UTILITY ROOM LIGHTING TO HAVE ONE LUMINAIRE CONTROLLED BY A VACANCY OR OCCUPANCY SENSOR PROVIDING AUTOMATIC-OFF FUNCTIONALITY PER CEC SECTION 150.0(K)(2). IF AN OCCUPANT SENSOR IS INSTALLED, IT SHALL BE INITIALLY CONFIGURED TO MANUAL-ON OPERATION USING THE MANUAL CONTROL REQUIRED UNDER SECTION 150.0(K)(2C).
8. ALL OTHER LUMINAIRIES THAT CONTAIN LIGHT SOURCES THAT MEET REFERENCE JUNE APPENDIX JAB REQUIREMENTS ARE TO BE AUTOMATICALLY CONTROLLED BY A VACANCY/OCCUPANCY SENSOR OR DIMMER PER CEC SECTION 150.0(K)(2). NOTE THAT CLOSETS WITH AN AREA LESS THAN 70 FT² AND HALLWAY LIGHTING ARE EXEMPT FROM THIS REQUIREMENT.
9. RECESSED CAN LIGHT FIXTURES SHALL BE IC LISTED, AIR-TIGHT LABELED, AND NOT BE EQUIPPED WITH A STANDARDS MEDIUM BASE SCREW SHELL LAMP HOLDER. ES 150.0(K)
10. SPECIAL REQUIREMENTS FOR LIGHTING CONTROLS: ALL LIGHTING CONTROLS ARE REQUIRED TO BE HIGH EFFICACY. BE MANUALLY ON/OFF SWITCH CONTROLLED, AND HAVE BOTH MOTION SENSOR AND PHOTOCELL CONTROL. SEE ES 150.0(K)(3) FOR ADDITIONAL CONTROL OPTIONS.

SDGE NOTES:

1. SDGE HAS SPECIFIC REQUIREMENTS ABOUT THE NUMBER OF MAIN ELECTRICAL SERVICE PANELS (HOW MANY ELECTRICAL DROPS) ALLOWED ON THE SAME LOT, WHICH IS DIFFERENT FROM THE REQUIREMENTS OF THE CITY OF CHULA VISTA AND CALIFORNIA ELECTRICAL CODE.
2. SDGE MAY REQUIRE ALL NEW ADU(S)/JADU(S) TO BE PLACED ON A SEPARATE ELECTRIC METER.
3. IT IS THE RESPONSIBILITY OF THE PROJECT DESIGNER TO CONTACT SDGE FOR THE REQUIREMENTS FOR SETTING UP THE NEW ELECTRICAL UTILITIES TO ALL NEW ADU(S)/JADU(S).
4. REFER TO THE CURRENT SDGE SERVICE STANDARDS AND GUIDE TO ENSURE THAT PROJECT COMPLIES WITH THEIR REQUIREMENTS.

MECHANICAL NOTES:

EXHAUST FAN NOTES

1. KITCHENS REQUIRE EXHAUST FANS WITH A MINIMUM 110 CFM (250 CFM IF GAS RANGED) DUCTED TO THE EXTERIOR. DETAIL COMPLIANCE BY INCLUDING A COMPLYING EXHAUST FAN OR A DUCTED RANGE HOOD TO THE EXTERIOR.
2. BATHROOMS REQUIRE EXHAUST FANS (MINIMUM 50 CFM) TO BE DUCTED TO THE EXTERIOR. A BATHROOM IS DEFINED "AS A ROOM WITH A BATHTUB, SHOWER, OR SPA OR SOME SIMILAR SOURCE OF MOISTURE".
3. RESIDENTIAL BATHROOM EXHAUST FANS SHALL BE ENERGY STAR RATED AND SHALL BE CONTROL BY A HUMIDISTAT CAPABLE OF AN ADJUSTMENT BETWEEN 50 AND 80% HUMIDITY. CALGREEN 4.506.1. EXCEPTION: CONTROL BY A HUMIDISTAT IS NOT REQUIRED IF THE BATHROOM EXHAUST FAN IS ALSO THE DWELLING WHOLE HOUSE VENTILATION.

SMOKE & CARBON MONOXIDE NOTES:**SMOKE & CARBON MONOXIDE ALARM NOTES**

1. SMOKE ALARMS SHALL BE INTERCONNECTED PER CRC R314.4.
2. SMOKE ALARMS SHALL BE HARD-WIRED WITH BATTERY BACK-UP PER CRC R314.6 IN THE FOLLOWING LOCATIONS ON FLOOR PLANS OR UTILITY PLANS (CRC R314.3):
 - A. OUTSIDE EACH SEPARATE SLEEPING AREA IN IMMEDIATE VICINITY OF BEDROOMS
 - B. ON EACH STORY OF DWELLING
 - C. IN ANY BEDROOM WITH A FUEL-BURNING APPLIANCE LOCATED WITHIN THAT BEDROOM OR ITS ATTACHED BATHROOM
3. CARBON MONOXIDE DETECTOR SHALL BE INTERCONNECTED PER CRC R315.1.7 AND HARD-WIRED WITH BATTERY BACK-UP PER CRC R315.5. IN THE FOLLOWING LOCATIONS ON FLOOR PLANS OR UTILITY PLANS IN DWELLING UNITS WITH FUEL-BURNING APPLIANCES, FIREPLACE, OR AN ATTACHED GARAGE COMMUNICATING WITH THE DWELLING UNIT (CRC R315.5):
 - A. OUTSIDE EACH SEPARATE SLEEPING AREA IN IMMEDIATE VICINITY OF BEDROOMS
 - B. ON EACH STORY OF DWELLING
 - C. IN ANY BEDROOM WITH A FUEL-BURNING APPLIANCE LOCATED WITHIN THAT BEDROOM OR ITS ATTACHED BATHROOM
4. COMBINATION SMOKE AND CARBON MONOXIDE ALARMS SHALL BE LISTED IN ACCORDANCE WITH UL-217 AND UL-2034. CRC R314.1.8 & R315.1.1.
5. SMOKE ALARMS SHALL BE LOCATED AT LEAST 3 FT FROM THE ENTRY DOOR TO ANY BATHROOM CONTAINING A BATHTUB/SHOWER. CRC R314.3.3.
6. ALL SMOKE ALARMS SHALL BE LOCATED AT LEAST 20 FT FROM A PERMANENTLY INSTALLED COOKING APPLIANCE. CRC R314.3.3.
 - A. SMOKE ALARMS ARE ALLOWED TO BE 10 FT FROM A PERMANENTLY INSTALLED COOKING APPLIANCE IF THE SMOKE ALARM IS AN IONIZATION SMOKE ALARM WITH ALARM SILENCING SWITCH, OR PHOTOELECTRIC SMOKE ALARM IN ACCORDANCE CRC R314.3.3. (4) EXCEPTION.



ADU: 1,199 L-SHAPE
CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:
LUIS CALDERON
SnapADU

SIGNATURE


[illegible]

ELECTRICAL PLAN


- 2-BEDROOM

E101


22040

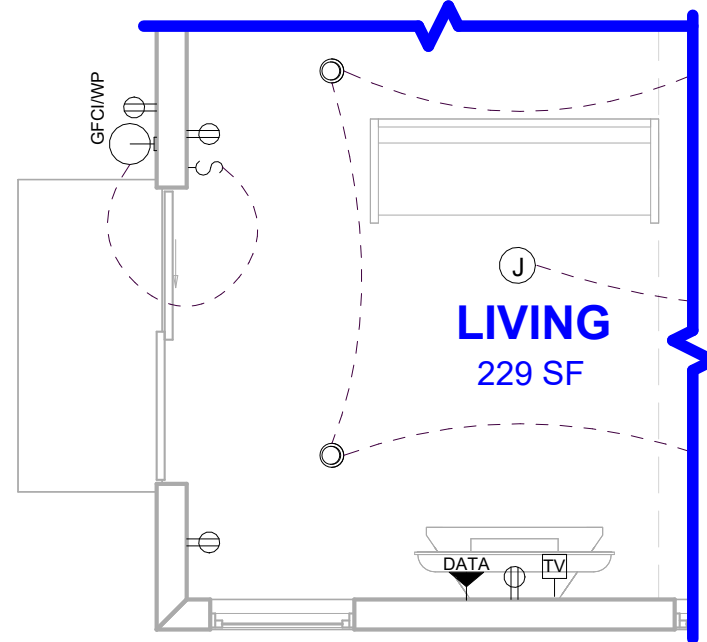


4 6'-0" x 6'-8" SLIDING GLASS DOOR OPTION AT
2-BEDROOM OPTION ELECTRICAL PLAN
SCALE: 1/4" = 1'-0"

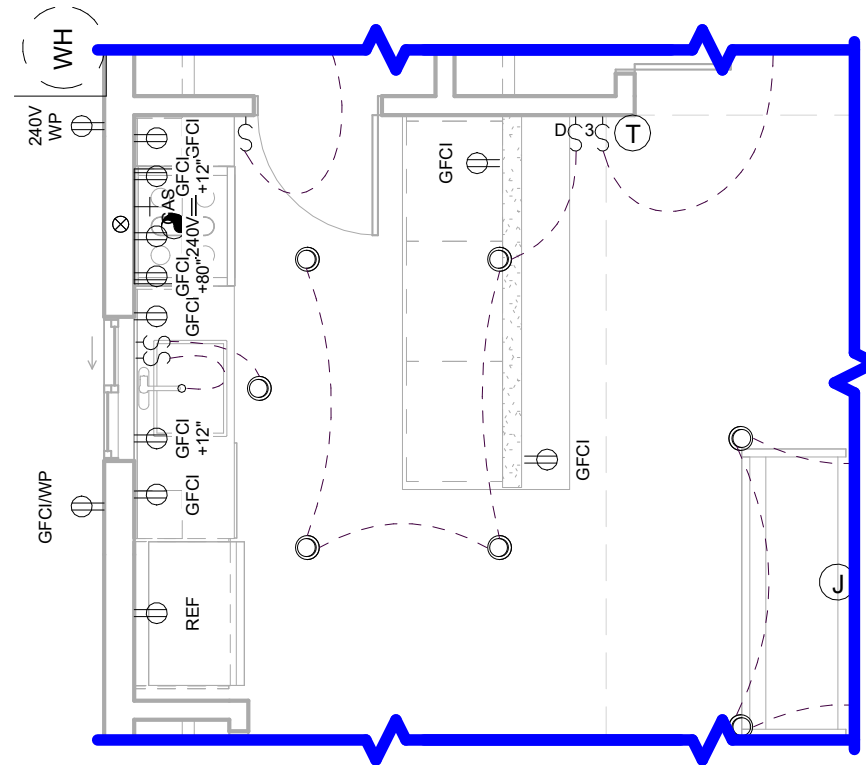


1 8' PENINSULA OPTION ELECTRICAL PLAN
SCALE: 1/4" = 1'-0"

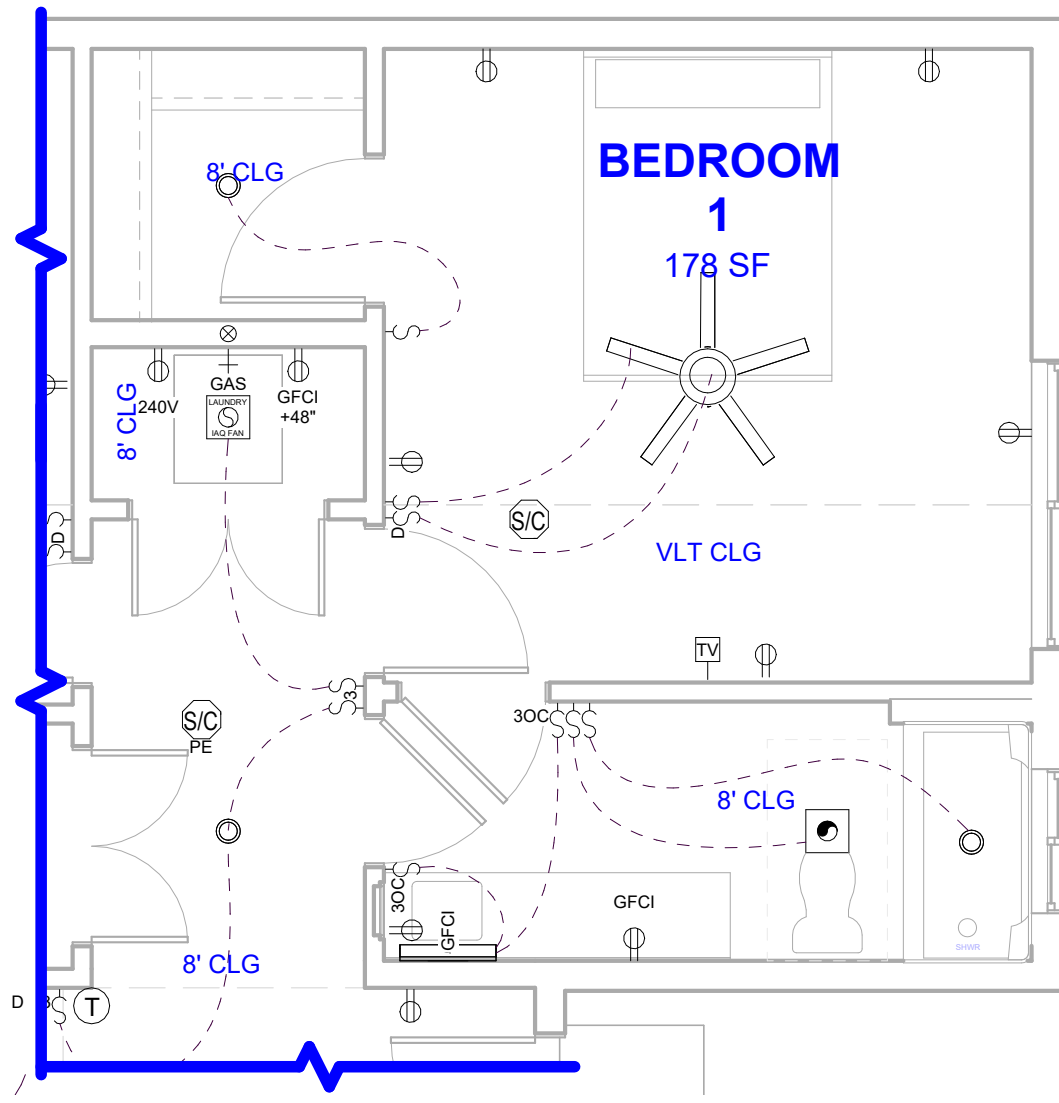


5 ENLARGED BEDROOM & BATH DOOR AT STANDARD
3-BEDROOM ELECTRICAL PLAN
SCALE: 1/4" = 1'-0"

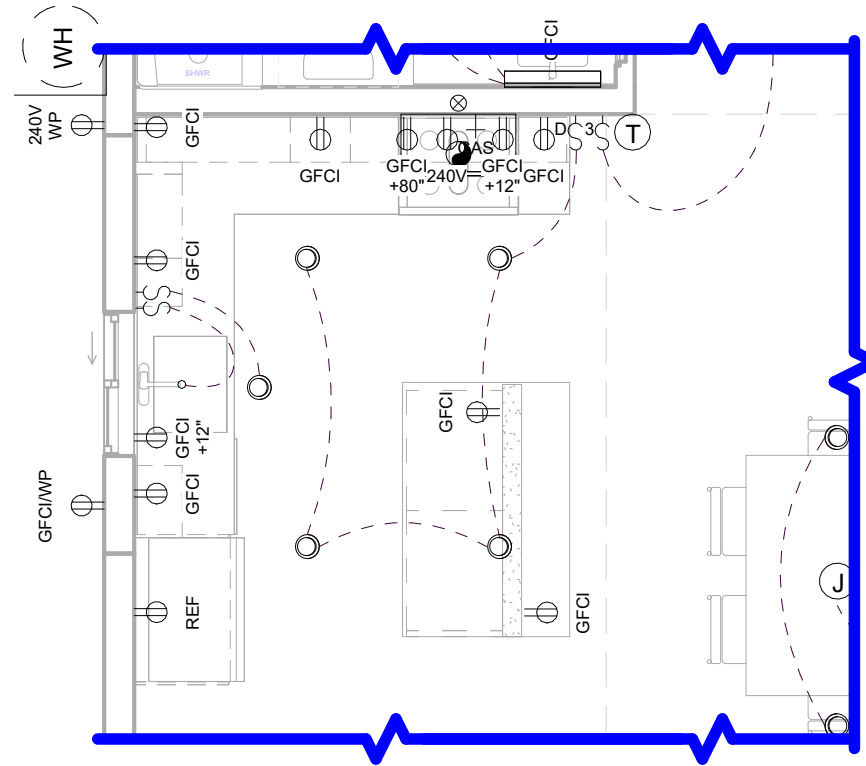

2 L-KITCHEN W/ 5' ISLAND AT 2-BEDROOM OPTION
ELECTRICAL PLAN
SCALE: 1/4" = 1'-0"

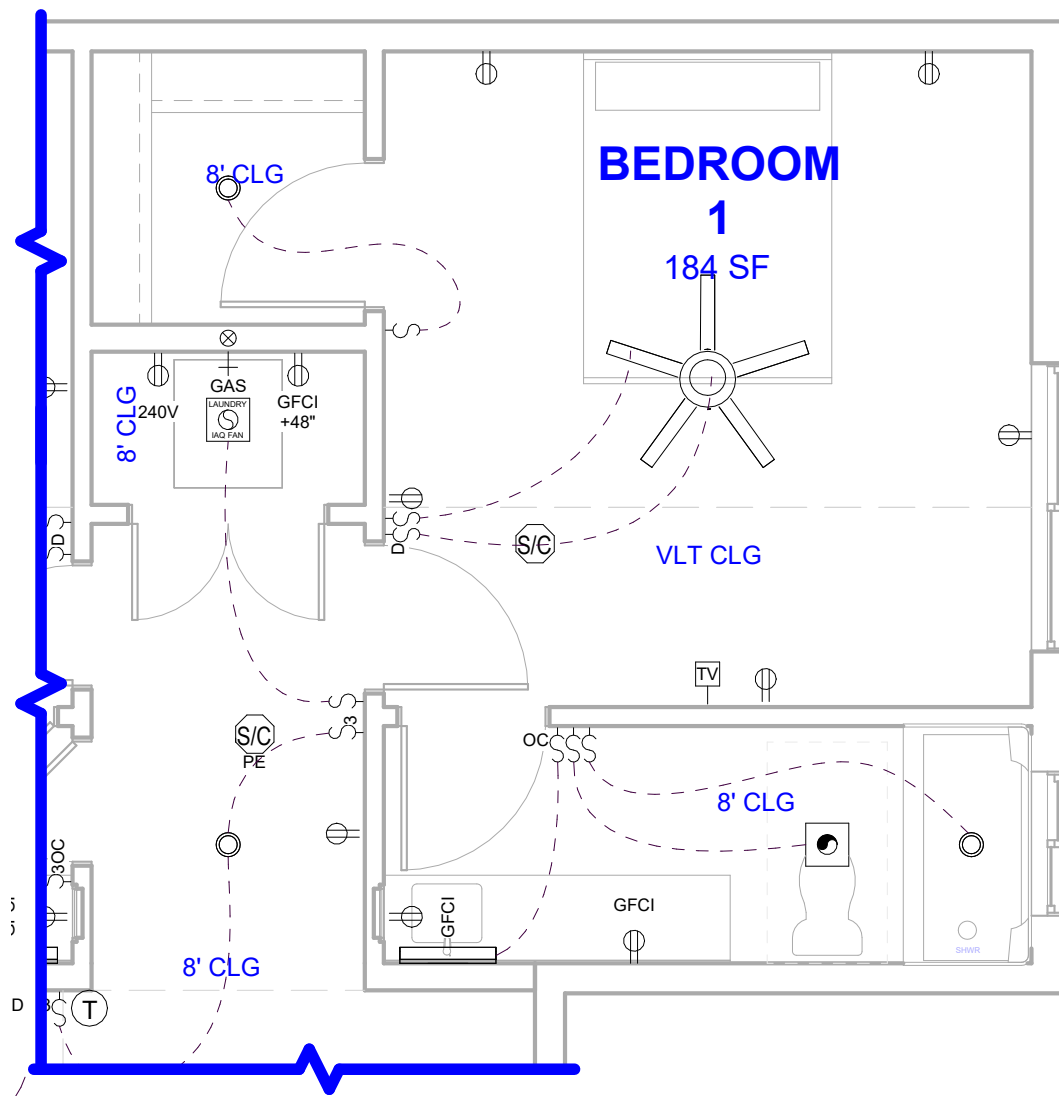


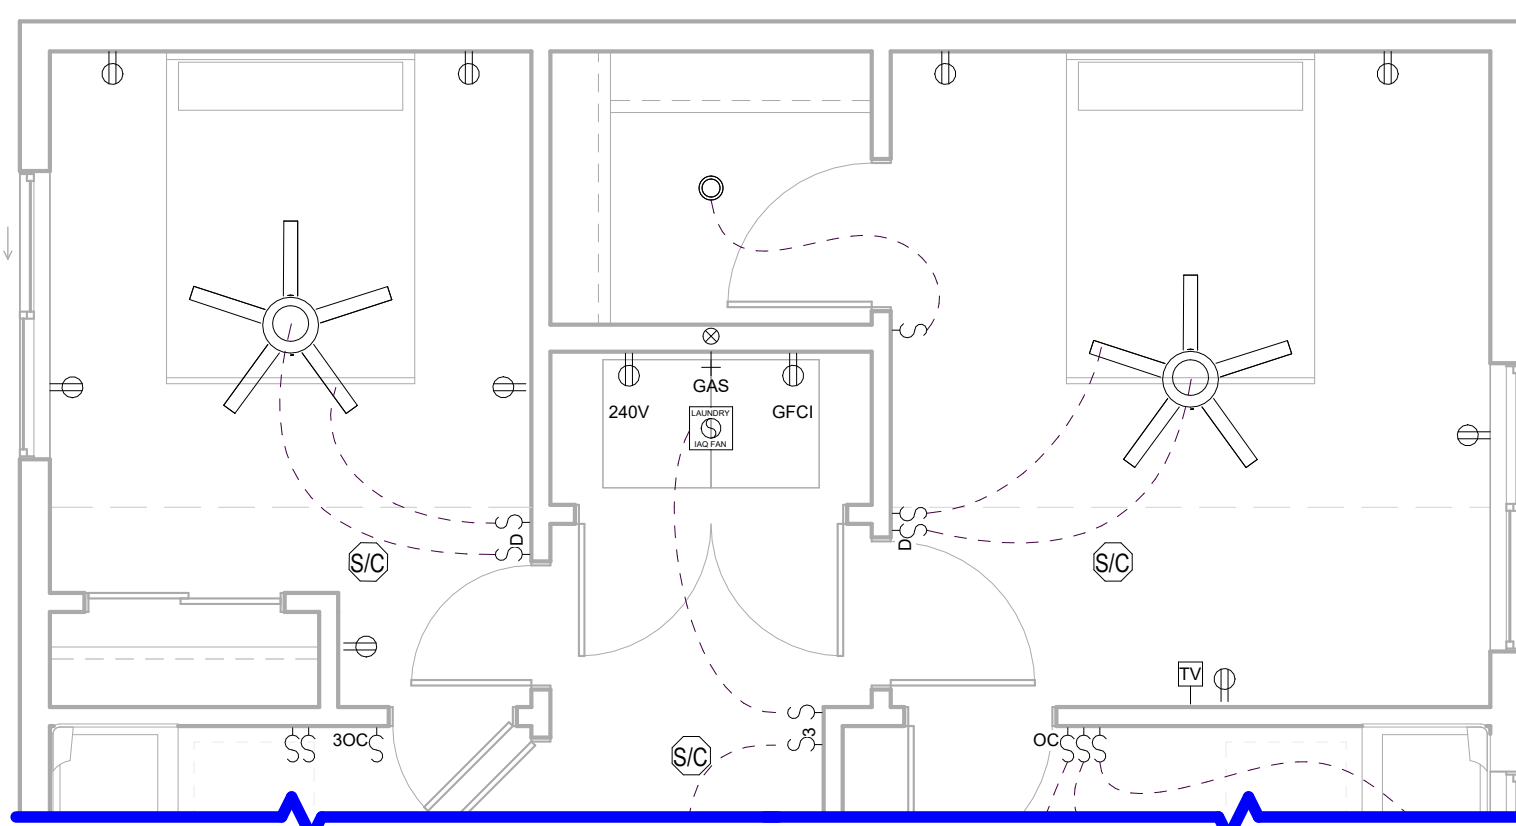



























6 ENLARGED BEDROOM & BATH DOOR AT 2-BEDROOM
OPTION ELECTRICAL PLAN
SCALE: 1/4" = 1'-0"



3 SIDE BY SIDE LAUNDRY OPTION ELECTRICAL PLAN
SCALE: 1/4" = 1'-0"

KEYNOTES

KEYNOTE	DESCRIPTION
	SINGLE POLE SWITCH
	THREE-WAY SWITCH
	OCCUPANCY SENSOR SWITCH
	DIMMER SWITCH
	DUPLEX RECEPTACLE OUTLET
	INDICATES OUTLET HEIGHT ABOVE FINISH FLOOR
	GROUND FAULT CIRCUIT INTERRUPTER DUPLEX OUTLET
	INDICATES 240V
	INDICATES WEATHER PROOF
	SMOKE / CARBON MONOXIDE DETECTOR HARDWIRED W/ BATTERY BACKUP
	PHOTOELECTRIC SMOKE / CARBON MONOXIDE DETECTOR HARDWIRED W/ BATTERY BACKUP
	JUNCTION BOX
	THERMOSTAT
	(1) OUTLET AND BRUSH PLATE BOX @ +12" AND @ +60"
	COAX CABLE
	EXHAUST VENT FAN - INTERMITTENT 50 CFM MIN / CONTINUOUS 20 CFM MIN
	EXHAUST VENT FAN SHALL BE USED TO MEET THE REQUIREMENTS FOR INDOOR AIR QUALITY (IAQ) PER T24 REPORT
	MICROWAVE-HOOD EXHAUST FAN COMBO 110 CFM MIN (IF GAS RANGE 250 CFM MIN. TO BE PROVIDED)
	GAS POINT OF CONNECTION W/ SHUT OFF VALVE
	WATER CONNECTION
	HOSE BIB
	RECESSED CAN LIGHT
	EXTERIOR WALL MOUNTED LIGHT
	VANITY SCONCE LIGHT
	ELECTRIC HEAT PUMP WATER HEATER
	POWER AND DISCONNECT FOR A/C CONDENSER
	A/C CONDENSER
	EVAPORATOR
	CEILING FAN WITH LIGHT

INDOOR AIR QUALITY NOTES:

1. PROPOSED DWELLING UNIT FOLLOW THE **EXHAUST-ONLY APPROACH** TO COMPLY INDOOR AIR QUALITY (IAQ) REQUIREMENTS
- A. MANDATORY (CBEES 150.0 (O), ASHRAE STANDARD 62.2):
- EXCEPTION: ADDITIONS 1000 S.F. OR LESS AND ALTERATIONS:
- MECHANICAL EXHAUST VENTILATION SYSTEM, SUPPLY VENTILATION SYSTEM, OR COMBINATION THEREOF SHALL BE INSTALLED FOR EACH DWELLING UNIT TO PROVIDE WHOLE-BUILDING VENTILATION WITH OUTDOOR AIR IN COMPLIANCE WITH ASHRAE STANDARD 62.2 AS ADOPTED BY THE CALIFORNIA ENERGY COMMISSION.
 - HERMETICALLY SEALED BUILDING ENVELOPE TO MAINTAIN BUILDING VENTILATION AIRFLOW.
 - AN INTERMITTENTLY OR CONTINUOUSLY OPERATING LOCAL MECHANICAL EXHAUST VENTILATION SYSTEM SHALL BE INSTALLED IN EACH BATHROOM WITH A BATHTUB, SHOWER, OR SIMILAR MOISTURE SOURCE AND IN EACH KITCHEN IN COMPLIANCE WITH ASHRAE STANDARD 62.2 AS ADOPTED BY THE CALIFORNIA ENERGY COMMISSION. AN INTERMITTENT LOCAL MECHANICAL EXHAUST VENTILATION AIRFLOW RATE SHALL BE 100 CFM IN BATHROOMS AND 5 AIR CHANGES PER HOUR IN KITCHENS BASED ON KITCHEN VOLUME.

INDOOR AIR QUALITY NOTES:

ASHRAE STANDARD 62.2 EQUATION 4.1(a)	
THE WHOLE-BUILDING EXHAUST FAN SHALL PROVIDE A MINIMUM VENTILATION RATE ACCORDING TO EQUATION 4.1(a) BELOW:	
$Q_{fan} = 0.03A_{floor} + 7.5 (N_{br} + 1)$	
WHERE:	Q_{fan} = FAN FLOW RATE (CFM) A_{floor} = CONDITIONED FLOOR AREA (S.F.) N_{br} = NUMBER OF BEDROOM, NOT LESS THAN ONE
CALCULATIONS:	$Q_{fan} = 0.03(1,199) + 7.5 (3 + 1)$ $Q_{fan} = 35.97 + 30$ $= 65.97 \text{ CFM (50 CFM MIN.)}$
IAQ FAN SHALL PROVIDE 65,97 CFM PER T-24 REPORT	
LISTED WHOLE-HOUSE FAN NOT REQUIRED	
EXHAUST FAN MODEL: S&P PCD110-PREMIUM CHOICE WITH DC MOTOR; 4" DUCT SONE RATING RANGE: 0.7 - 1.2; 6" DUCT SONE RATING RANGE: 0.3 - 1.1	

ELECTRICAL NOTES:

POWER NOTES

1. ALL ELECTRICAL WORK SHALL BE DESIGN PER 2022 CALIFORNIA ELECTRICAL CODE, 2022 NATIONAL ELECTRICAL CODE, AND 2022 BUILDING ENERGY EFFICIENCY STANDARDS.
2. ALL ELECTRICAL EQUIPMENT SHALL BE LABELED, LISTED, OR CERTIFIED BY A NATIONALLY RECOGNIZED TESTING LABORATORY ACCREDITED BY THE UNITED STATES OCCUPATIONAL SAFETY HEALTH ADMINISTRATION.
3. THE MAXIMUM COMBINED VOLTAGE DROP ON BOTH INSTALLED FEEDER CONDUCTORS AND BRANCH CIRCUIT CONDUCTORS TO THE FARTHEST CONNECTED LOAD OR OUTLET SHALL NOT EXCEED 5 PERCENT.
4. ALL THE CONDUCTOR(S) SPECIFIED IN THE PANEL SCHEDULES ARE GROUNDED SEPARATELY.
5. PURCHASE RTU WITH FACTORY INSTALLED DISCONNECT. COORDINATE PROPER RATING OF DISCONNECT WITH MANUFACTURER.
6. INSTALL WEATHERPROOF (WP), GFI PROTECTED, WEATHER RESISTANT RECEPTACLE OUTLETS ON THE ROOFTOP AND WITHIN 25 FT OF HEATING/AIR CONDITIONING AND IDENTIFIED AND LISTED AS "EXTRA DUTY" PER ARTICLE 406.9(B)(1) & 406.4(D)(6)
7. ALL WORK PERFORMED SHALL COMPLY WITH ALL STATE AND LOCAL ALL ELECTRICAL CODES.
8. ALL BRONCH CIRCUIT SHALL BE 10.000 A/C RATING, UNLESS NOTIFIED OTHERWISE.
9. ALL THE HVAC UNITS ARE EQUIPPED WITH FACTORY INSTALLED DISCONNECT SWITCH UNLESS NOTIFIED OTHERWISE. COORDINATE WITH MANUFACTURE BEFORE INSTALLATION AND IN THE ABSENCE OF DISCONNECT SWITCH PROVIDED REQUIRE DISCONNECT AS PER NEC 430.104 AND 430.110.
10. THE BATHROOM CIRCUITING SHALL BE EITHER A 20-AMP CIRCUIT DEDICATED TO EACH BATHROOM, OR AT LEAST ONE 20 AMP CIRCUIT. ONLY BATHROOM RECEPTACLE OUTLETS PER NEC 210.11(C)(3)
11. ALL ELECTRICAL DEVICES INSTALLED IN DWELLINGS SHALL BE PROVIDED WITH ARC-Fault (11C)(13) OUTLETS (NOT JUST RECEPTACLES) LOCATED IN ROOMS DESCRIBED IN NEC 210.12(A): KITCHENS, LAUNDRY AREAS, FAMILY, LIVING, BEDROOMS, DINING, HALLS, ETC. EEC ARTICLE 210.12(A) & 406.
12. ALL 120-VOLT, SINGLE-PHASE, 15- AND 20-AMPERE BRANCH CIRCUITS SUPPLYING OUTLETS OR DEVICES INSTALLED IN DWELLING UNIT KITCHENS, FAMILY ROOMS, SUNROOMS, DINING ROOMS, LIVING ROOMS, PARADES, HALLWAYS, BEDROOMS, BATHROOMS, CLOSET, ENTRY, PORCHES, PATIOS, TERRACES, PORCHES, LAUNDRY AREAS, OR SIMILAR ROOMS OR AREA SHALL BE PROTECTED BY ANY OF THE MEANS DESCRIBED IN 210.12(A)(1) THROUGH (6).
13. INSTALL A MINIMUM OF 2 SMALL APPLIANCE BRANCH CIRCUITS WITHIN THE KITCHEN AND DINING AREAS PER NEC 210.11(C)(1) & 210.52(B).
14. ALL OUTLETS IN KITCHEN AND BATHROOMS SHALL BE GFCI PER NEC 210.8.
15. ALL RECEPTACLES INSTALLED IN THE DWELLING SHOULD BE TAMPER RESISTANT PER ARTICLE 210.52 & 550.13.
16. PER NEC 210.11(C)(3), BATHROOM CIRCUITING SHALL BE EITHER:
 - A. A 20 AMP CIRCUIT DEDICATED TO EACH BATHROOM, OR
 - B. AT LEAST ONE 20 AMP CIRCUIT SUPPLYING ONLY BATHROOM RECEPTACLE OUTLETS.
17. ELECTRIC POWERED APPLIANCE SHALL BE PROVIDED WITH A 30A CIRCUIT. NEC 220.54.
18. ELECTRICAL RECEPTACLE OUTLETS, SWITCHES AND CONTROLS (INCLUDING CONTROLS FOR HEATING, VENTILATION AND AIR CONDITIONING) INTENDED TO BE USED BY OCCUPANTS SHALL BE LOCATED NO MORE THAN 48 INCHES MEASURED FROM THE TOP OF THE OUTLET BOX AND NOT LESS THAN 15 INCHES MEASURED FROM THE BOTTOM OF THE OUTLET BOX ABOVE THE FINISH FLOOR. R327.1.2
19. DOORBELL, BUTTONS, CONTROLS, SWITCHES, AND CONTROLS SHALL NOT EXCEED 48 INCHES (1219.2 MM) ABOVE EXTERIOR FLOOR OR LANDING, MEASURED FROM THE TOP OF THE DOORBELL BUTTON ASSEMBLY, WHERE DOORBELL BUTTONS INTEGRATED WITH OTHER FEATURES ARE REQUIRED TO BE INSTALLED ABOVE 48 INCHES (1219.2 MM) MEASURED FROM THE EXTERIOR FLOOR OR LANDING. A STANDARD DOORBELL BUTTON OR CONTROL SHALL ALSO BE PROVIDED AT A HEIGHT NOT EXCEEDING 48 INCHES (1219.2 MM) ABOVE EXTERIOR FLOOR OR LANDING, AND 48 INCHES (1219.2 MM) FROM THE TOP OF THE DOORBELL BUTTON OR CONTROL. R327.1.4.
20. SURGE PROTECTION REQUIREMENTS:
 - A. ALL SERVICES SUPPLYING DWELLING UNITS SHALL BE PROVIDED WITH A SURGE-PROTECTIVE DEVICE (SPD).
 - B. LOCATION - THE SPD SHALL BE AN INTEGRAL PART OF THE SERVICE EQUIP-MENT OR SHALL BE LOCATED IMMEDIATELY ADJACENT THERE TO.
 - C. LOCATION - THE SPD SHALL NOT BE REQUIRED TO BE IN THE SERVICE EQUIPMENT AS REQUIRED IN 210.12(A).
 - D. IF LOCATED AT EACH NEXT LEVEL DISTRIBUTION EQUIPMENT DOWN-STREAM TOWARD THE LOAD.
 - E. TYPE - THE SPD SHALL BE A TYPE 1 OR TYPE 2 SPD.

LIGHTING NOTES

1. PROVIDE LIGHTING CONTROL WITH CONTINUOUS DIMMING IN ALL AREAS. PROVIDE REQUIRED DRIVERS AND DIMMER SWITCHES FOR CONTINUOUS DIMMING USING 0-10 VOLT DIMMING.
2. LIGHTING SHALL PROVIDE NOT LESS THAN 215 LUX (20 FOOTCANDLES) AS MEASURED 30" ABOVE FLOOR.
3. IF APPLICABLE, SPECIFY THAT THE EXHAUST FANS TO BE ON A SEPARATE SWITCH FROM LIGHTS PER CEC 150.0(K)2.
4. ALL INSTALLED LUMINAIRES SHALL BE HIGH-EFFICACY IN ACCORDANCE WITH ES TABLE 150.0-A.
 - A. LUMINAIRES MUST HAVE A LABEL CERTIFIED FOR AIRTIGHT CONSTRUCTION.
 - B. LIGHT SOURCES THAT ARE NOT MARKED "JA8-2019-E" SHALL NOT BE INSTALLED IN ENCLOSED LUMINAIRES. ES 150.0(K)2.
5. BATHROOMS, GARAGE, LAUNDRY ROOMS, AND UTILITY ROOM LIGHTING TO HAVE ONE LUMINAIRE CONTROLLED BY A VACANCY OR OCCUPANCY SENSOR PROVIDING AUTOMATIC-OFF FUNCTIONALITY PER CEC SECTION 150.0(K)2. IF AN OCCUPANT SENSOR IS INSTALLED, IT SHALL BE INITIALLY CONFIGURED TO MANUAL-ON OPERATION USING THE MANUAL CONTROL, REQUIRED UNDER SECTION 150.0(K)2C.
6. ALL OTHER LUMINAIRES THAT CONTAIN LIGHT SOURCES THAT MEET REFERENCE JOINT APPENDIX JA8 REQUIREMENTS ARE TO BE INITIALLY CONTROLLED BY A VACANCY/OCCUPANCY SENSOR OR DIMMER PER CEC SECTION 150.0(K)2. NOTE THAT CLOSETS WITH AN AREA LESS THAN 70 FT2 AND HALLWAY LIGHTING ARE EXEMPT FROM THIS REQUIREMENT.
7. RECESSED CAN LIGHT FIXTURES SHALL BE IC LISTED, AIR-TIGHT LABELED, AND NOT BE EQUIPPED WITH A STANDARDS MEDIUM BASE SCREW SHELL PLUG HOLDER. ES 150.0(K)2.
8. SEEN THROUGH GLASS PARTITIONS ATTACHED TO A BUILDING ARE REQUIRED TO BE HIGH EFFICACY, BE MANUALLY ON/OFF SWITCH CONTROLLED, AND HAVE BOTH MOTION SENSOR AND PHOTOCELL CONTROL. ES 150.0(K) 3 FOR ADDITIONAL CONTROL OPTIONS.

SDGE NOTES:

1. SDGE HAS SPECIFIC REQUIREMENTS ABOUT THE NUMBER OF MAIN ELECTRICAL SERVICE PANELS (HOW MANY ELECTRICAL DRUPS) ALLOWED ON THE SAME LOT, WHICH IS DIFFERENT FROM THE REQUIREMENTS OF THE CITY OF CHULA VISTA AND CALIFORNIA ELECTRICAL CODE.
2. SDGE MAY REQUIRE ALL NEW ADU(S)/JADU(S) TO BE PLACED ON A SEPARATE ELECTRIC METER.
3. IT IS THE RESPONSIBILITY OF THE PROJECT DESIGNER TO CONTACT SDGE FOR THE REQUIREMENTS FOR SETTING UP THE NEW ELECTRICAL UTILITIES TO ALL NEW ADU(S)/JADU(S).
4. REFER TO THE CURRENT SDGE SERVICE STANDARDS AND GUIDE TO ENSURE THAT PROJECT COMPLIES WITH THEIR REQUIREMENTS.

MECHANICAL NOTES:

EXHAUST FAN NOTES

1. KITCHENS REQUIRE EXHAUST FANS WITH A MINIMUM 110 CFM (250 CFM IF GAS RANGE) DUCTED TO THE EXTERIOR. DETAIL COMPLIANCE BY INCLUDING A COMPLYING EXHAUST FAN OR A DUCTED RANGE HOOD TO THE EXTERIOR.
2. BATHROOMS REQUIRE EXHAUST FANS (MINIMUM 50 CFM) TO BE DUCTED TO THE EXTERIOR. A BATHROOM IS DEFINED "AS A ROOM WITH A BATHTUB, SHOWER, OR SPA OR SOME SIMILAR SOURCE OF MOISTURE".
3. RESIDENTIAL BATHROOM EXHAUST FANS SHALL BE ENERGY STAR RATED AND SHALL BE CONTROL BY A HUMIDISTAT CAPABLE OF AN ADJUSTMENT BETWEEN 50 AND 80% HUMIDITY. CALGREEN 4.506.1. EXCEPTION: CONTROL BY A HUMIDISTAT IS NOT REQUIRED IF THE BATHROOM EXHAUST FAN IS ALSO THE DWELLING WHOLE HOUSE VENTILATION.

SMOKE & CARBON MONOXIDE NOTES:

SMOKE & CARBON MONOXIDE ALARM NOTES

1. SMOKE ALARMS SHALL BE INTERCONNECTED PER CRC R314.4.
2. SMOKE ALARMS SHALL BE HARD-WIRED WITH BATTERY BACK-UP PER CRC R314.6 IN THE FOLLOWING LOCATIONS ON FLOOR PLANS OR UTILITY PLANS (CRC R314.3):
 - A. OUTSIDE EACH SEPARATE SLEEPING AREA IN IMMEDIATE VICINITY OF BEDROOMS
 - B. ON EACH STORY OF DWELLING
 - C. IN ANY BEDROOM WITH A FUEL-BURNING APPLIANCE LOCATED WITHIN THAT BEDROOM OR ITS ATTACHED BATHROOM
3. CARBON MONOXIDE DETECTOR SHALL BE INTERCONNECTED PER CRC R315.1.7 AND HARD-WIRED WITH BATTERY BACK-UP PER CRC R315.5 - IN THE FOLLOWING LOCATIONS ON FLOOR PLANS OR UTILITY PLANS IN DWELLING UNITS WITH FUEL-BURNING APPLIANCES, FIREPLACE, OR AN ATTACHED GARAGE COMMUNICATING WITH THE DWELLING (CRC R315.6):
 - A. OUTSIDE EACH SEPARATE SLEEPING AREA IN IMMEDIATE VICINITY OF BEDROOMS
 - B. ON EACH STORY OF DWELLING
 - C. IN ANY BEDROOM WITH A FUEL-BURNING APPLIANCE LOCATED WITHIN THAT BEDROOM OR ITS ATTACHED BATHROOM.
4. COBINIT-217 SMOKE AND CARBON MONOXIDE ALARMS SHALL BE LISTED IN ACCORDANCE WITH UL-217 AND UL-203. (CRC R314.1.1 & R315.1.1)
5. SMOKE ALARMS SHALL BE LOCATED AT LEAST 3 FT FROM THE ENTRY DOOR TO ANY BATHROOM CONTAINING A BATHTUB/SHOWER. CRC R314.3.3.
6. ALL SMOKE ALARMS SHALL BE LOCATED AT LEAST 20 FT FROM A PERMANENTLY INSTALLED COOKING APPLIANCE. CRC R314.3.3.
 - A. A SMOKE ALARM AREA IS ALLOWED TO BE 10 FT FROM A PERMANENTLY INSTALLED COOKING APPLIANCE IF THE SMOKE ALARM IS AN IONIZATION SMOKE ALARM WITH ALARM SILENCING SWITCH, OR PHOTOELECTRIC SMOKE ALARM IN ACCORDANCE CRC R314.3.3. (4) EXCEPTION.



ADU: 1,199 L-SHAPE
CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:
LUIS CALDERON
SnapADU



SIGNATURE

[illegible]


ELECTRICAL PLAN - OPTIONS

E102


22040

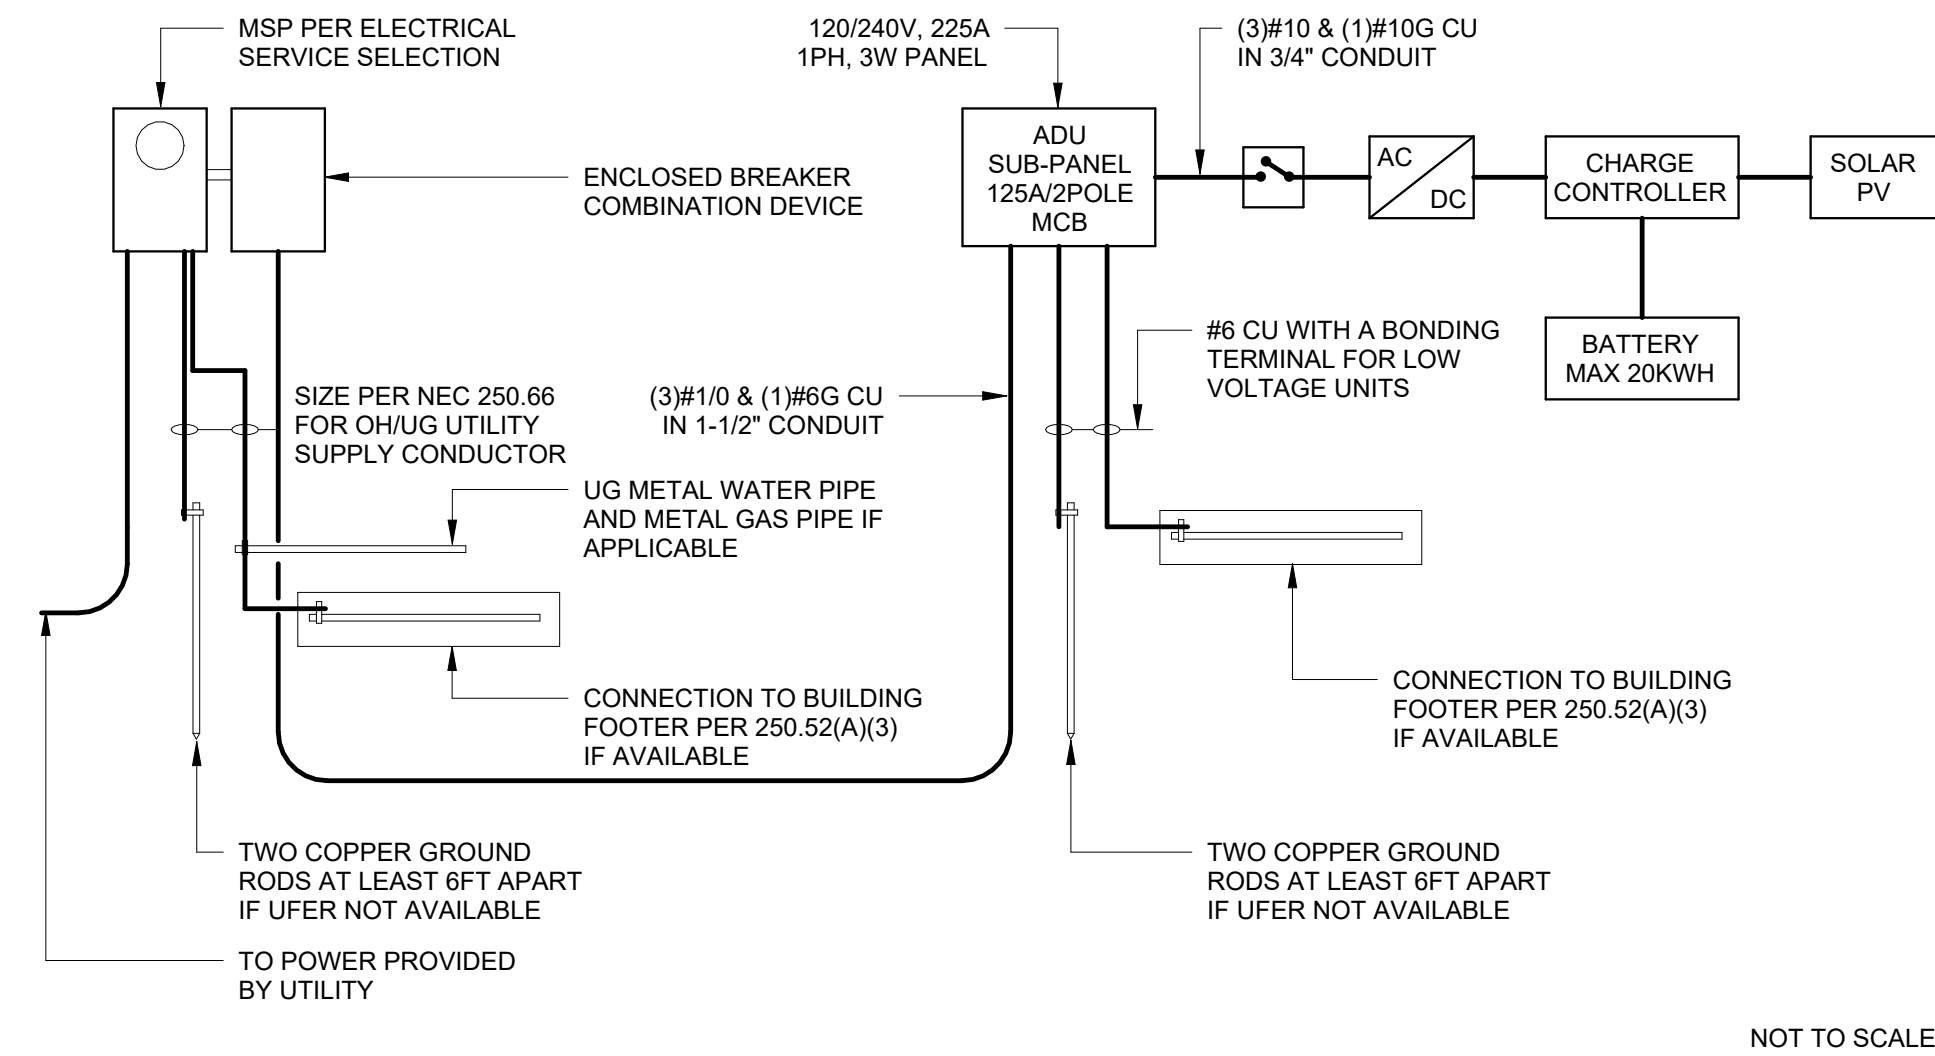


NOT TO SCALE

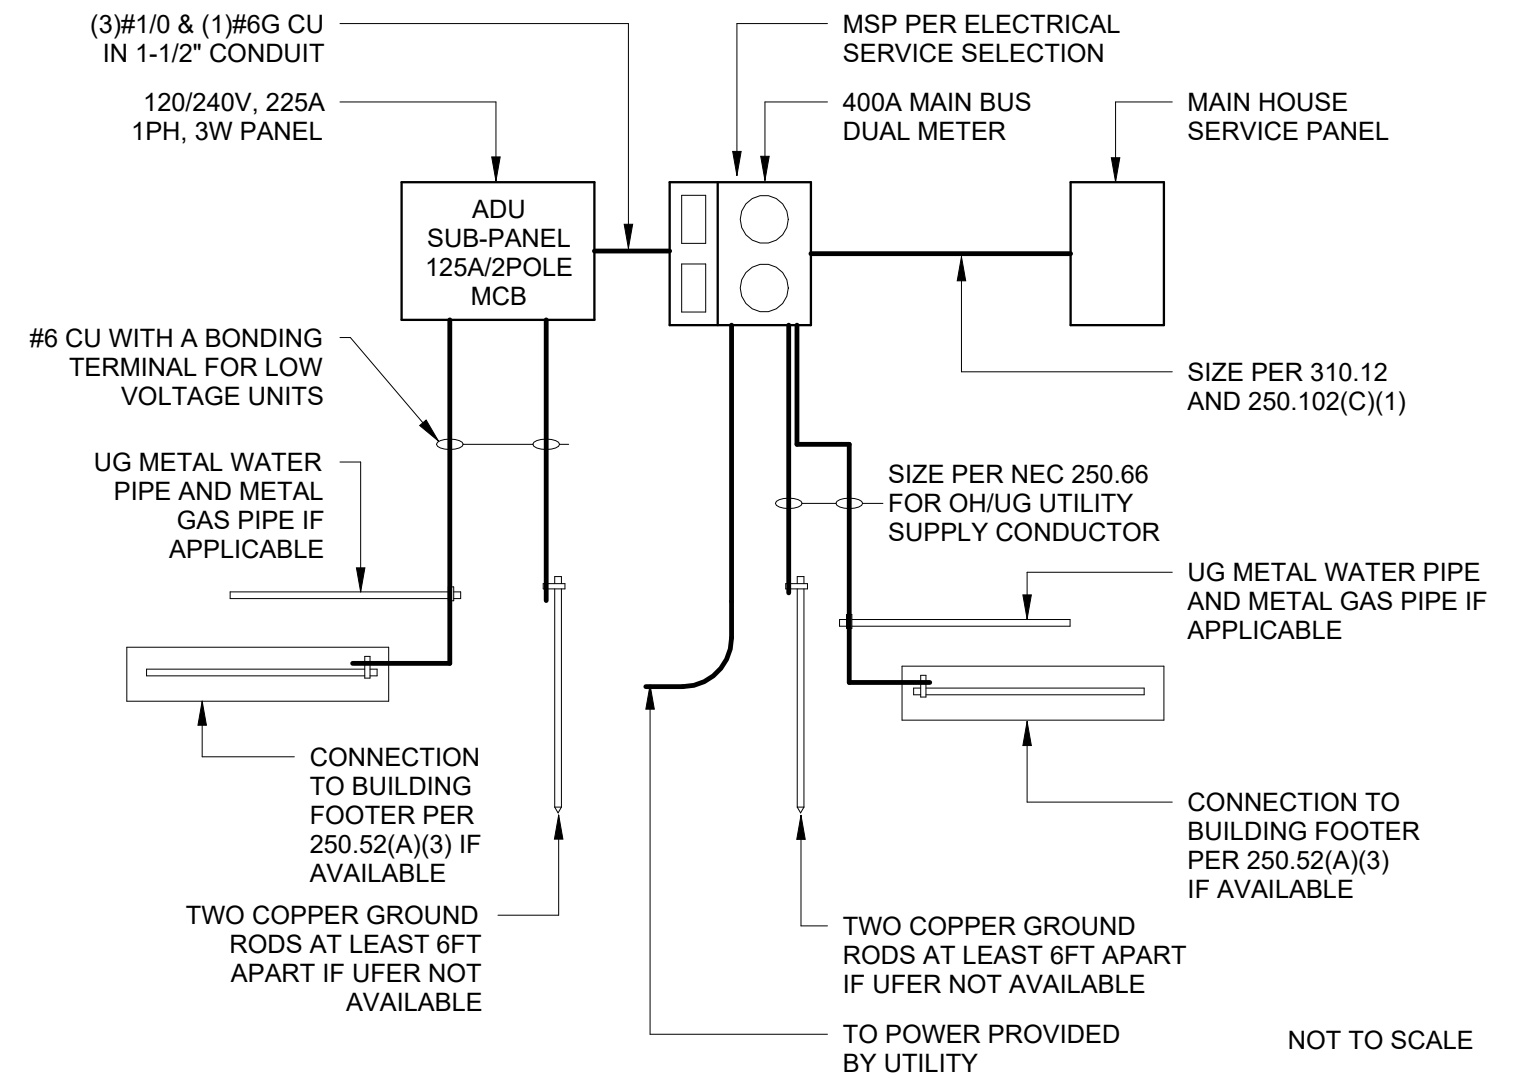

NOT TO SCALE

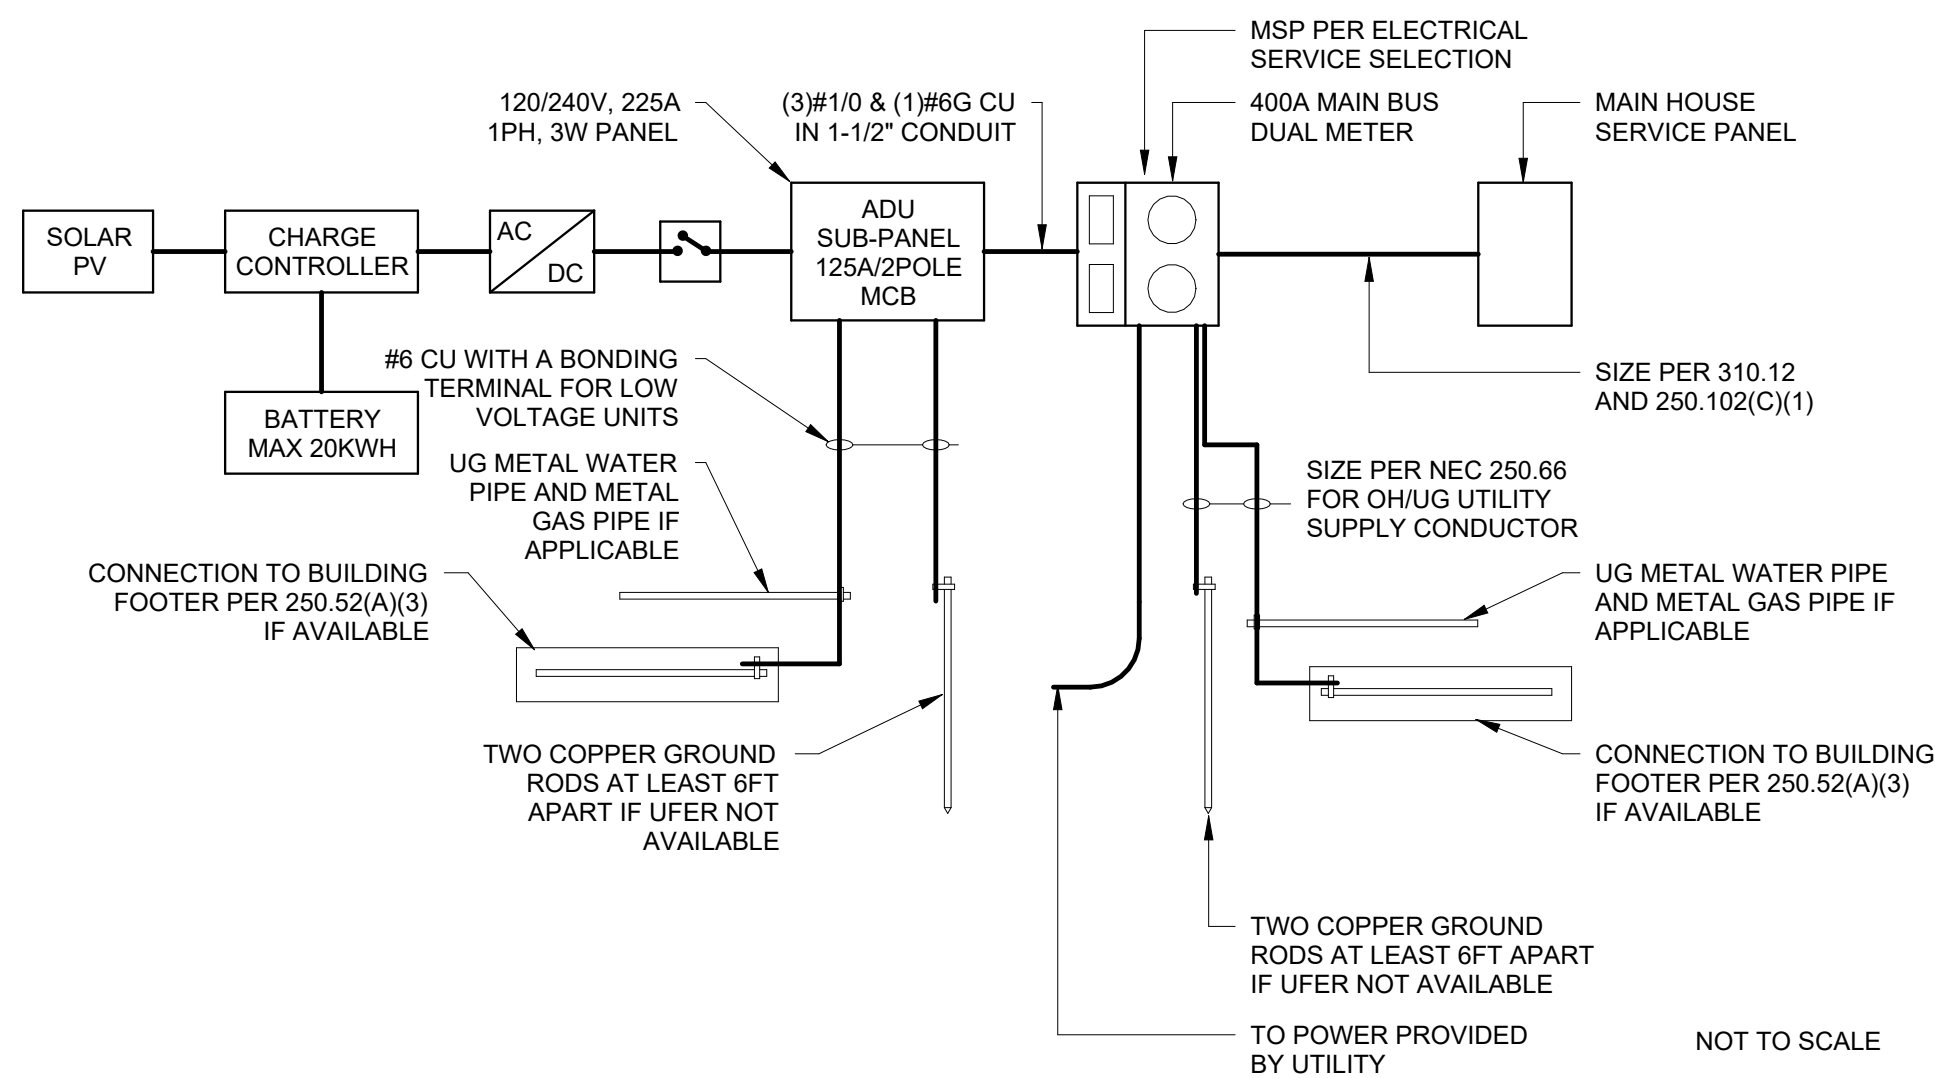

NOT TO SCALE

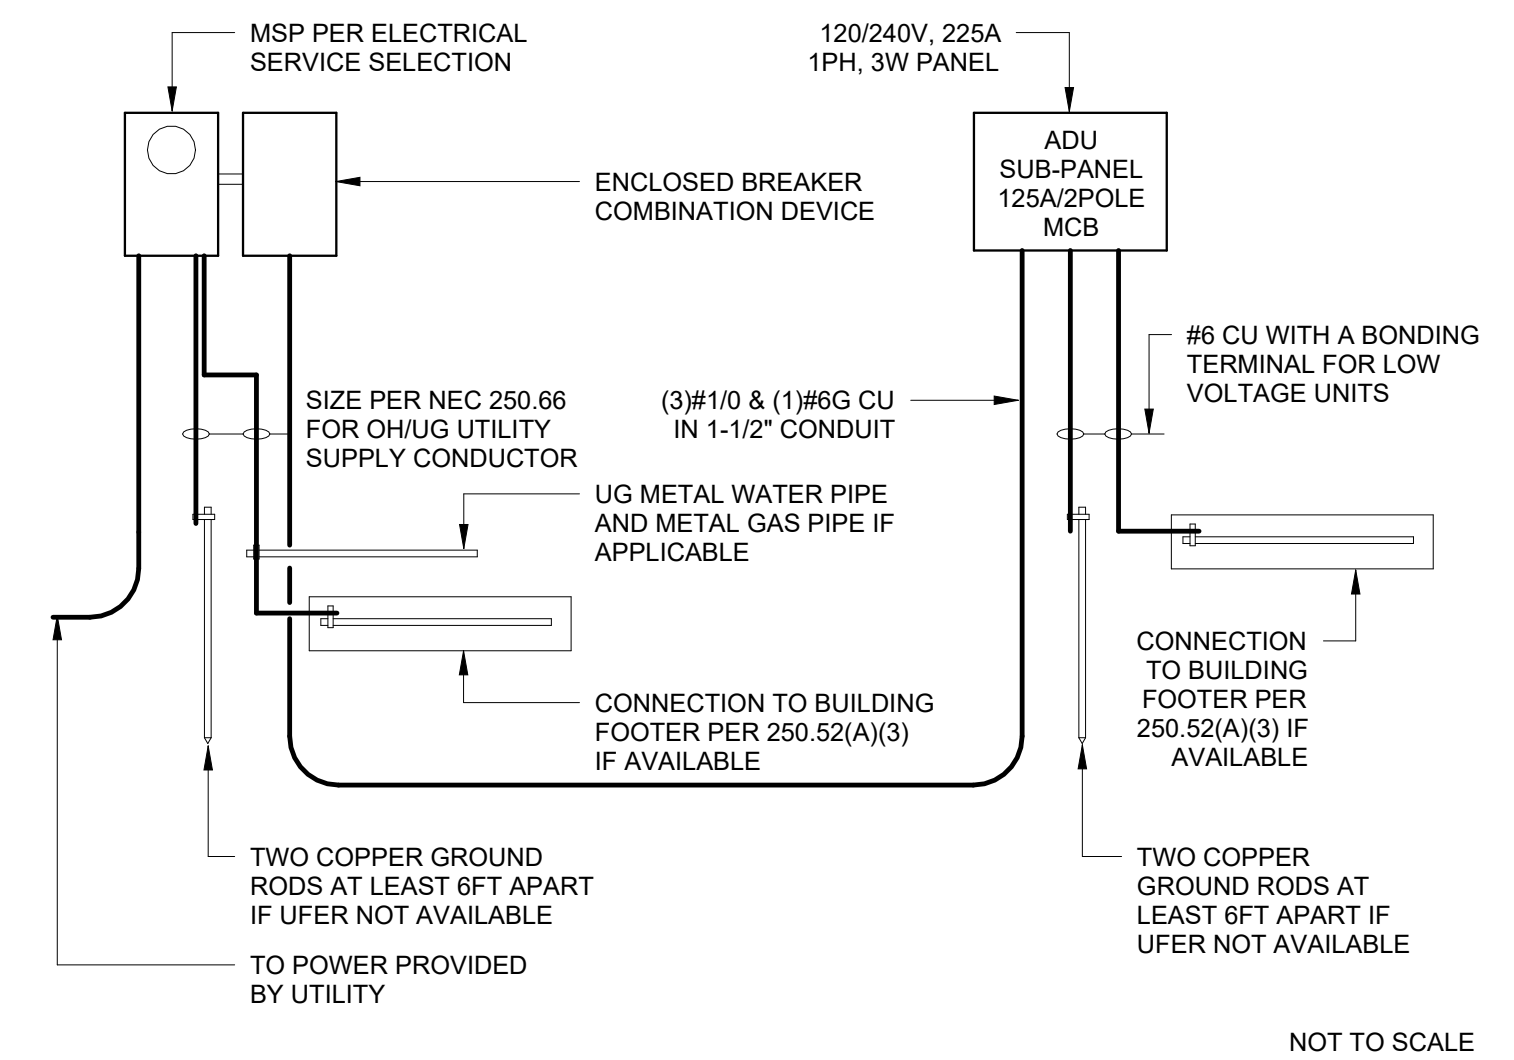

NOT TO SCALE

ESS PANEL SCHEDULE

ESS PANEL - 20/40 CKT 225A BUS 60A MLO 120/240V 1PH 3W OUTDOOR					
CKT #	C/B	LOAD	CKT #	C/B	LOAD
1			2		
3			4		
5			6		
7			8		
9			10		
11			12		
13			14		
15			16		
17			18		
19			20		

ELECTRICAL PANEL SCHEDULE

SUBPANEL - 30/60 CKT 225A BUS 100A MLO 120/240V 1PH 3W OUTDOOR					
CKT #	C/B	LOAD	CKT #	C/B	LOAD
1			2		
3			4		
5			6		
7			8		
9			10		
11			12		
13			14		
15			16		
17			18		
19			20		
21			22		
23			24		
25			26		
27			28		
29			30		



SNAPADU
DESIGN HOUSE

YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 1,199 L-SHAPE
CITY OF CHILL A VISTA

CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:

LUIS CALDERON
napADU

SIGNATURE

RELEASE	DATE	BY	APP. RELEASED FOR...
---------	------	----	----------------------



DATE _____

373

ELECTRIC PANEL SCHEDULE

E103

22040

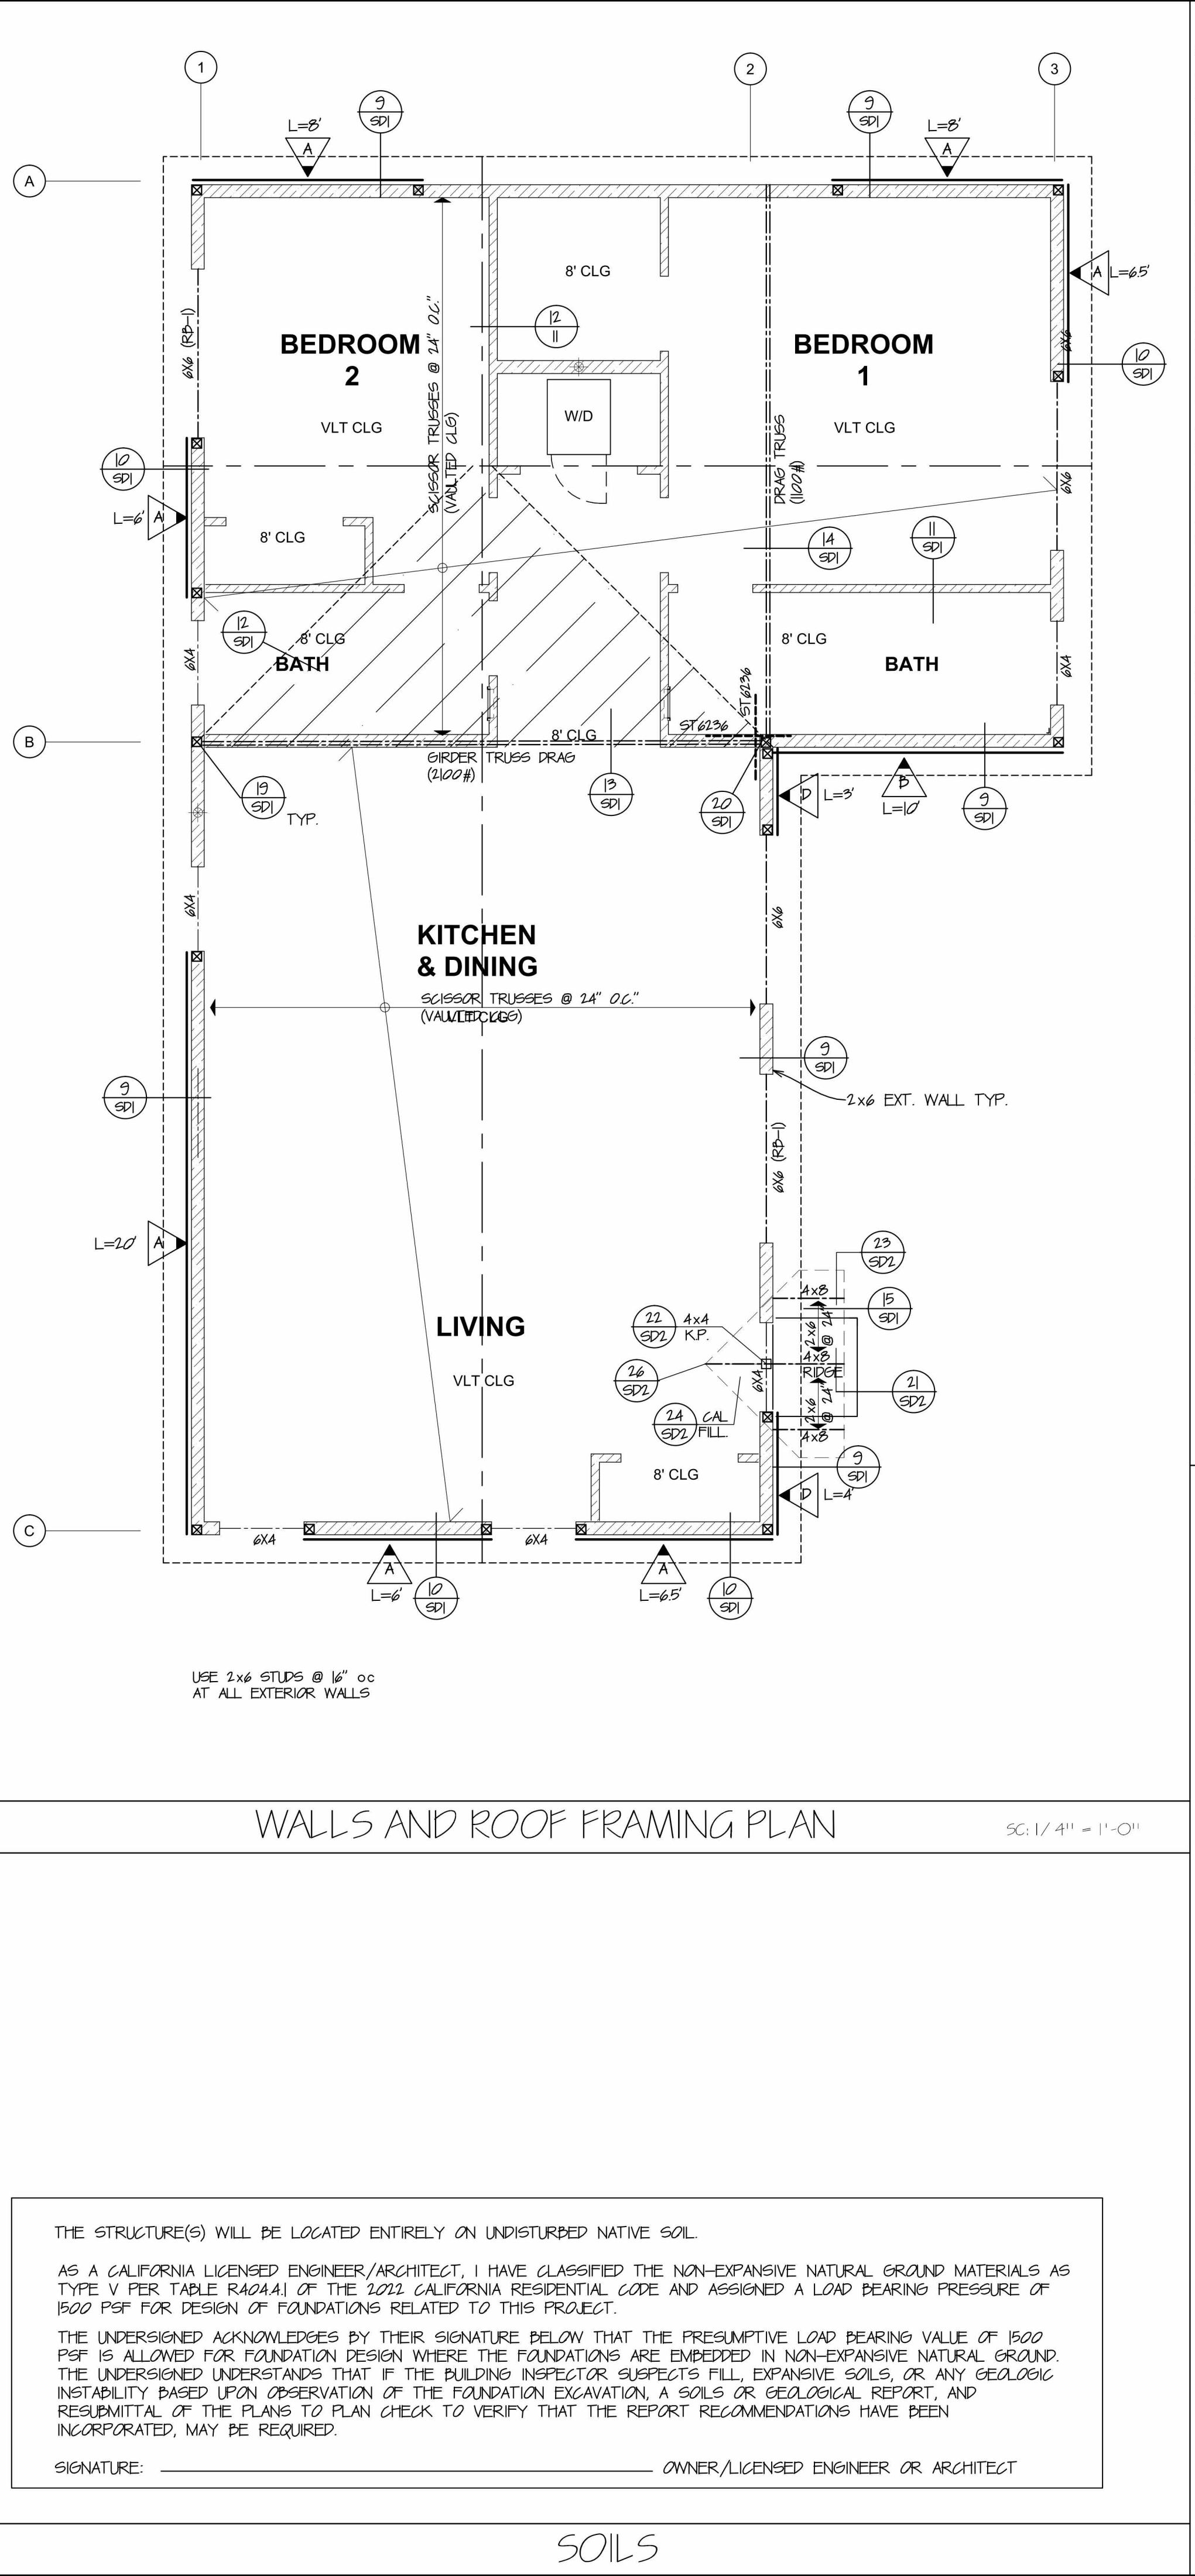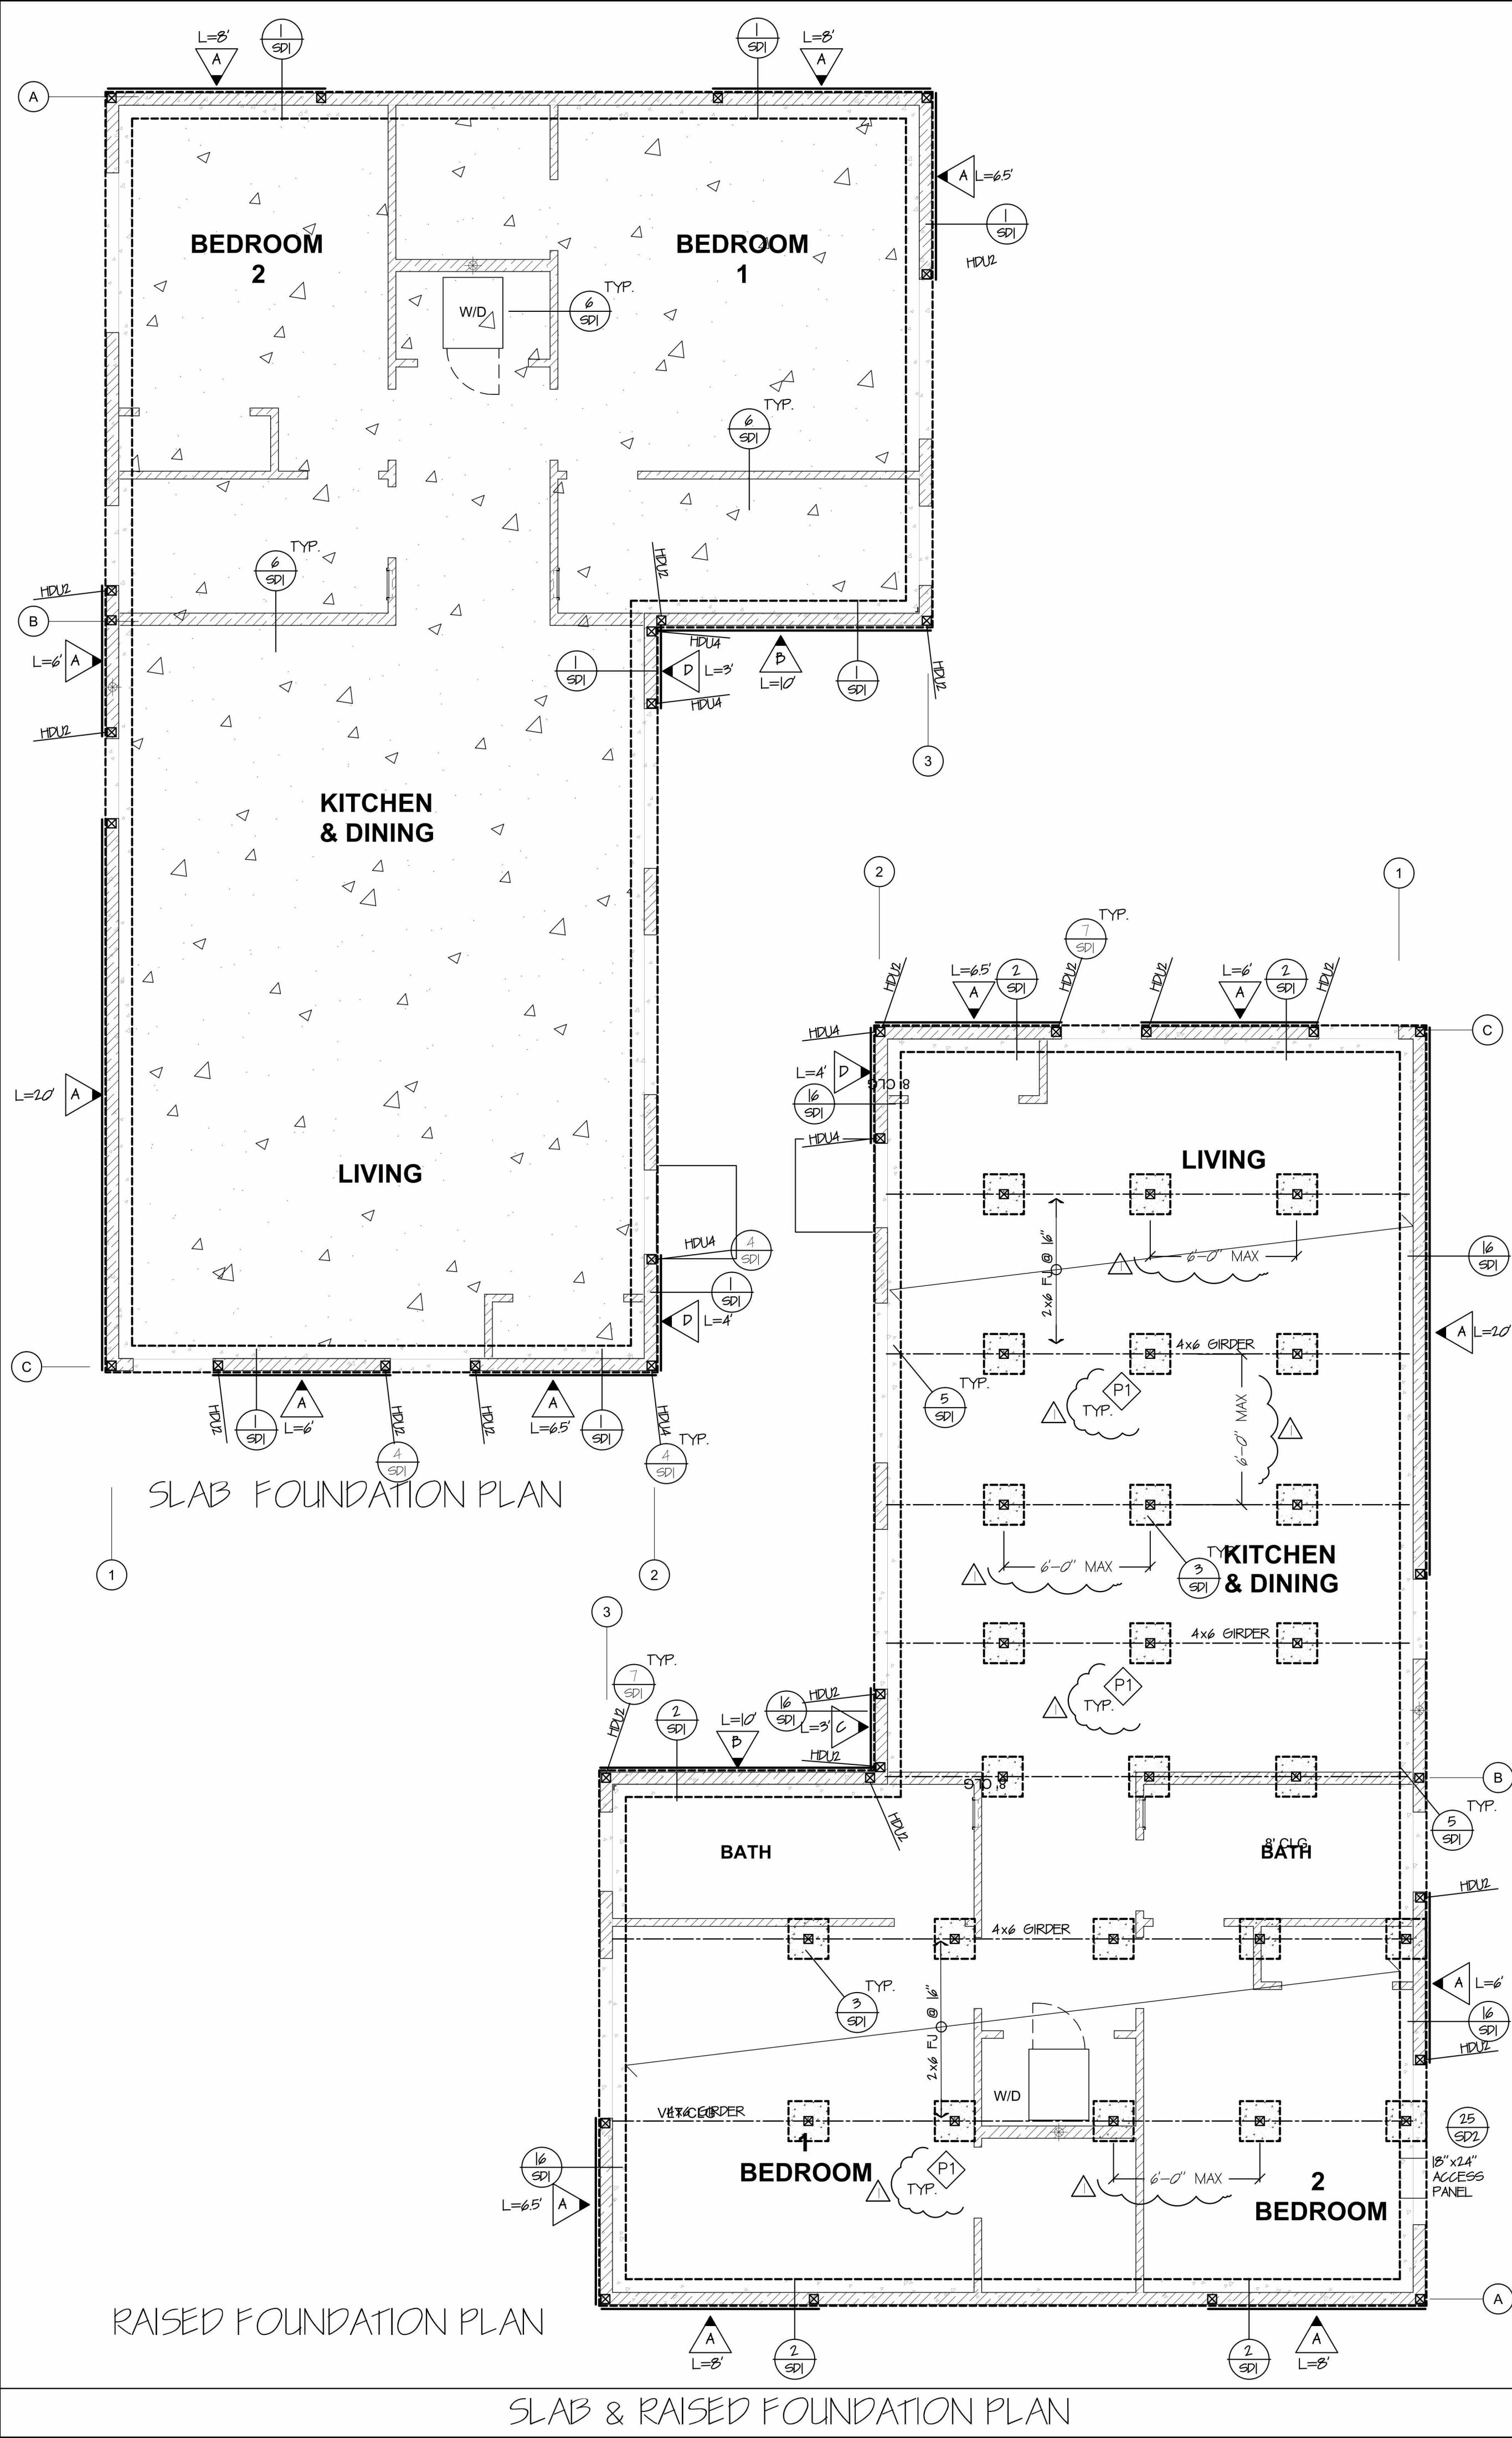

REVISIONS

NO.	DESCRIPTION	DATE
1	9-29-23	PCD

FOUNDATION NOTES

1) CONCRETE SHALL HAVE A MINIMUM ULTIMATE COMPRESSIVE STRENGTH OF 1500 PSI AT 28 DAYS FOR FORMED-IN-PLACE CONTINUOUS AND SPREAD FOOTINGS, AND 3000 PSI (SPECIAL INSPECTION REQUIRED) AT 28 DAYS FOR GRADE BEAMS.

2) PORTLAND CEMENT SHALL BE TYPE I PER ASTM C 150. AGGREGATES SHALL BE PER ASTM C 39 WITH MAXIMUM SIZE OF 1/2" FOR FOOTINGS AND 1" FOR ALL OTHER WORK.

3) REINFORCING STEEL SHALL BE ASTM A615, GRADE 60, CLEAN AND RUST FREE. LAPS AT SPLICES AND JOINTS TO BE 40 BAR DIAMETERS (2'-0" MINIMUM) UNLESS NOTED OTHERWISE ON PLANS.

4) ALL NEW SILL PLATE ANCHOR BOLTS TO BE INSTALLED IN FRESH CONCRETE SHALL BE 5/8" DIAMETER A307 "L" BOLTS SPACED PER PLAN AND SHEARWALL SCHEDULE WITH MINIMUM 7" EMBEDMENT. MAXIMUM ANCHOR BOLT SPACING SHALL BE 4'-0" O.C. ANCHOR BOLTS AT ENDS OF WALL PANELS SHALL BE LOCATED WITHIN 12" AND GREATER THAN 7 BOLT DIAMETERS FROM THE END OF SILL PLATE. THERE SHALL BE A MINIMUM OF TWO ANCHOR BOLTS PER WALL PANEL (ANCHOR BOLTS TO EXISTING FOOTINGS PER NOTE #3 BELOW). PLATE WASHERS A MINIMUM 3"x3"x22G THICK SHALL BE USED ON EACH BOLT. ALL CONNECTORS AND METAL HARDWARE IN CONTACT WITH PRESSURE TREATED TIMBER SHALL HAVE CORROSION RESISTANT COATINGS OR PROTECTION, SUCH AS "ZMAX", HOT DIPPED GALVANIZED, OR BE STAINLESS STEEL.

6) IF NO SOILS REPORT IS PROVIDED, ASSUMED ALLOWABLE SOIL BEARING PRESSURE (ASPP) SHALL BE 1500 PSF (PER SOL SITE CLASS D) & EMBED FOOTINGS A MINIMUM OF 12" INTO COMPETENT SOIL.

7) REINFORCING SHALL BE CONTINUOUS AROUND CORNERS AND THROUGH INTERSECTIONS.

9) CONSTRUCTION JOINTS SHALL BE PREPARED BY WIRE BRUSHING, CLEANING AND BRUSHING IN A PASTE OF NEAT CEMENT MORTAR IMMEDIATELY PRIOR TO POURING. LOCATION OF CONSTRUCTION JOINT SHALL BE APPROVED BY THE PROJECT STRUCTURAL ENGINEER.

12) ALL CONNECTORS AND METAL HARDWARE IN CONTACT WITH PRESSURE TREATED TIMBER SHALL HAVE CORROSION RESISTANT COATINGS OR PROTECTION, SUCH AS "ZMAX", HOT DIPPED GALVANIZED, OR BE STAINLESS STEEL.

13) PRIOR TO POURING INTERIOR CONCRETE FLOOR SLABS, ALL SOIL BELOW FLOOR SHALL BE COMPACTED TO REQUIRED 90% DENSITY AND MOISTENED TO A DEPTH NOT LESS THAN 18" OR PER SOILS REPORT.

12) DEEPEN NEW FOOTINGS AS NECESSARY TO OBTAIN REQUIRED EMBEDMENT FOR ALL NEW HAD DOWN BOLTS. ALL HAD DOWN BOLTS TO HAVE A MINIMUM OF 3" OF CONCRETE COVER TO SOIL @ BOTTOM. ALL HAD DOWN BOLTS MUST BE TIED IN PLACE PRIOR TO FOUNDATION INSPECTION.

13) ALL HAD DOWNS MUST BE TIED IN PLACE PRIOR TO FOUNDATION INSPECTION.

14) MINIMUM HORIZONTAL DISTANCE FROM BOTTOM LEADING EDGE OF FOOTING TO DAYLIGHT SHALL BE 7'-0"

FOUNDATION LEGEND

(N) 12" WIDE x 24" DEEP FOOTING W/ 2-#4 T. & P.

(N) CONC. PAD PER PLAN

4x BM WIDTH POST UNO.

POST ABOVE

SHEARWALL PER PLAN

CONCRETE SLAB

USE 4" THK. CONC. SLAB W/ #3 @ 16" O.C. E.W. @ MID-HEIGHT, 0/ 2" SAND, 0/ 10 ML VAPOR BARRIER (ASTM E36 & E1145), 0/ 2" SAND BASE.

CONCRETE PAD SCHEDULE

PAD	SIZE
P1	18" SQ x 24" THK. CONC. PAD W/ 2-#4 E.W.

LEGEND

RF TRUSSES @ 24" o.c. UNO.

2x6 F.J. @ 16" o.c. UNO.

4x BM WIDTH POST UNO.

POST ABOVE

PLYWOOD SHEARWALL PER PLAN

ST63% SIMPSON STRAP, UNO.

DRAW LINE PER PLAN SEE SHEARWALL NOTES ON SHEET S11

STUD SIZE

STUD SIZE	MAX. HEIGHT
2x4 @ 16" o.c.	10 FT
2x6 @ 16" o.c.	12 FT
2x6 @ 8" o.c.	14 FT
2x8 @ 16" o.c.	16 FT

SLAB FOUNDATION PLAN

RAISED FOUNDATION PLAN

SLAB & RAISED FOUNDATION PLAN

WALLS AND ROOF FRAMING PLAN

SOILS

THE STRUCTURE(S) WILL BE LOCATED ENTIRELY ON UNDISTURBED NATIVE SOIL.

AS A CALIFORNIA LICENSED ENGINEER/ARCHITECT, I HAVE CLASSIFIED THE NON-EXPANSIVE NATURAL GROUND MATERIALS AS TYPE V PER TABLE R404.1 OF THE 2022 CALIFORNIA RESIDENTIAL CODE AND ASSIGNED A LOAD BEARING PRESSURE OF 1500 PSF FOR DESIGN OF FOUNDATIONS RELATED TO THIS PROJECT.

THE UNDERSIGNED ACKNOWLEDGES BY THEIR SIGNATURE BELOW THAT THE PRESUMPTIVE LOAD BEARING VALUE OF 1500 PSF IS ALLOWED FOR FOUNDATION DESIGN WHERE THE FOUNDATIONS ARE EMBEDDED IN NON-EXPANSIVE NATURAL GROUND. THE UNDERSIGNED UNDERSTANDS THAT IF THE BUILDING INSPECTOR SUSPECTS FILL, EXPANSIVE SOILS, OR ANY GEOLOGIC INSTABILITY BASED UPON OBSERVATION OF THE FOUNDATION EXCAVATION, A SOILS OR GEOLOGICAL REPORT, AND RESUBMITTAL OF THE PLANS TO PLAN CHECK TO VERIFY THAT THE REPORT RECOMMENDATIONS HAVE BEEN INCORPORATED, MAY BE REQUIRED.

SIGNATURE: _____ OWNER/LICENSED ENGINEER OR ARCHITECT

PROJECT: New Detached ADU

PROJECT: Accessory Dwelling Unit

Standard L-2-Bedroom 199 SF. Plan

DRAWING:

JOB #: 23-169

FILE: CV-199-L-ADU.dwg

DRAWN: PC

ENGINEER: PC

DATE: 6-26-23

SCALE: 1/4" = 1'-0"

REGISTERED PROFESSIONAL ENGINEER

NO. 057182

EXP. 12-31-23



CIVIL

STATE OF CALIFORNIA

SHEET

S1

SHEET - OF

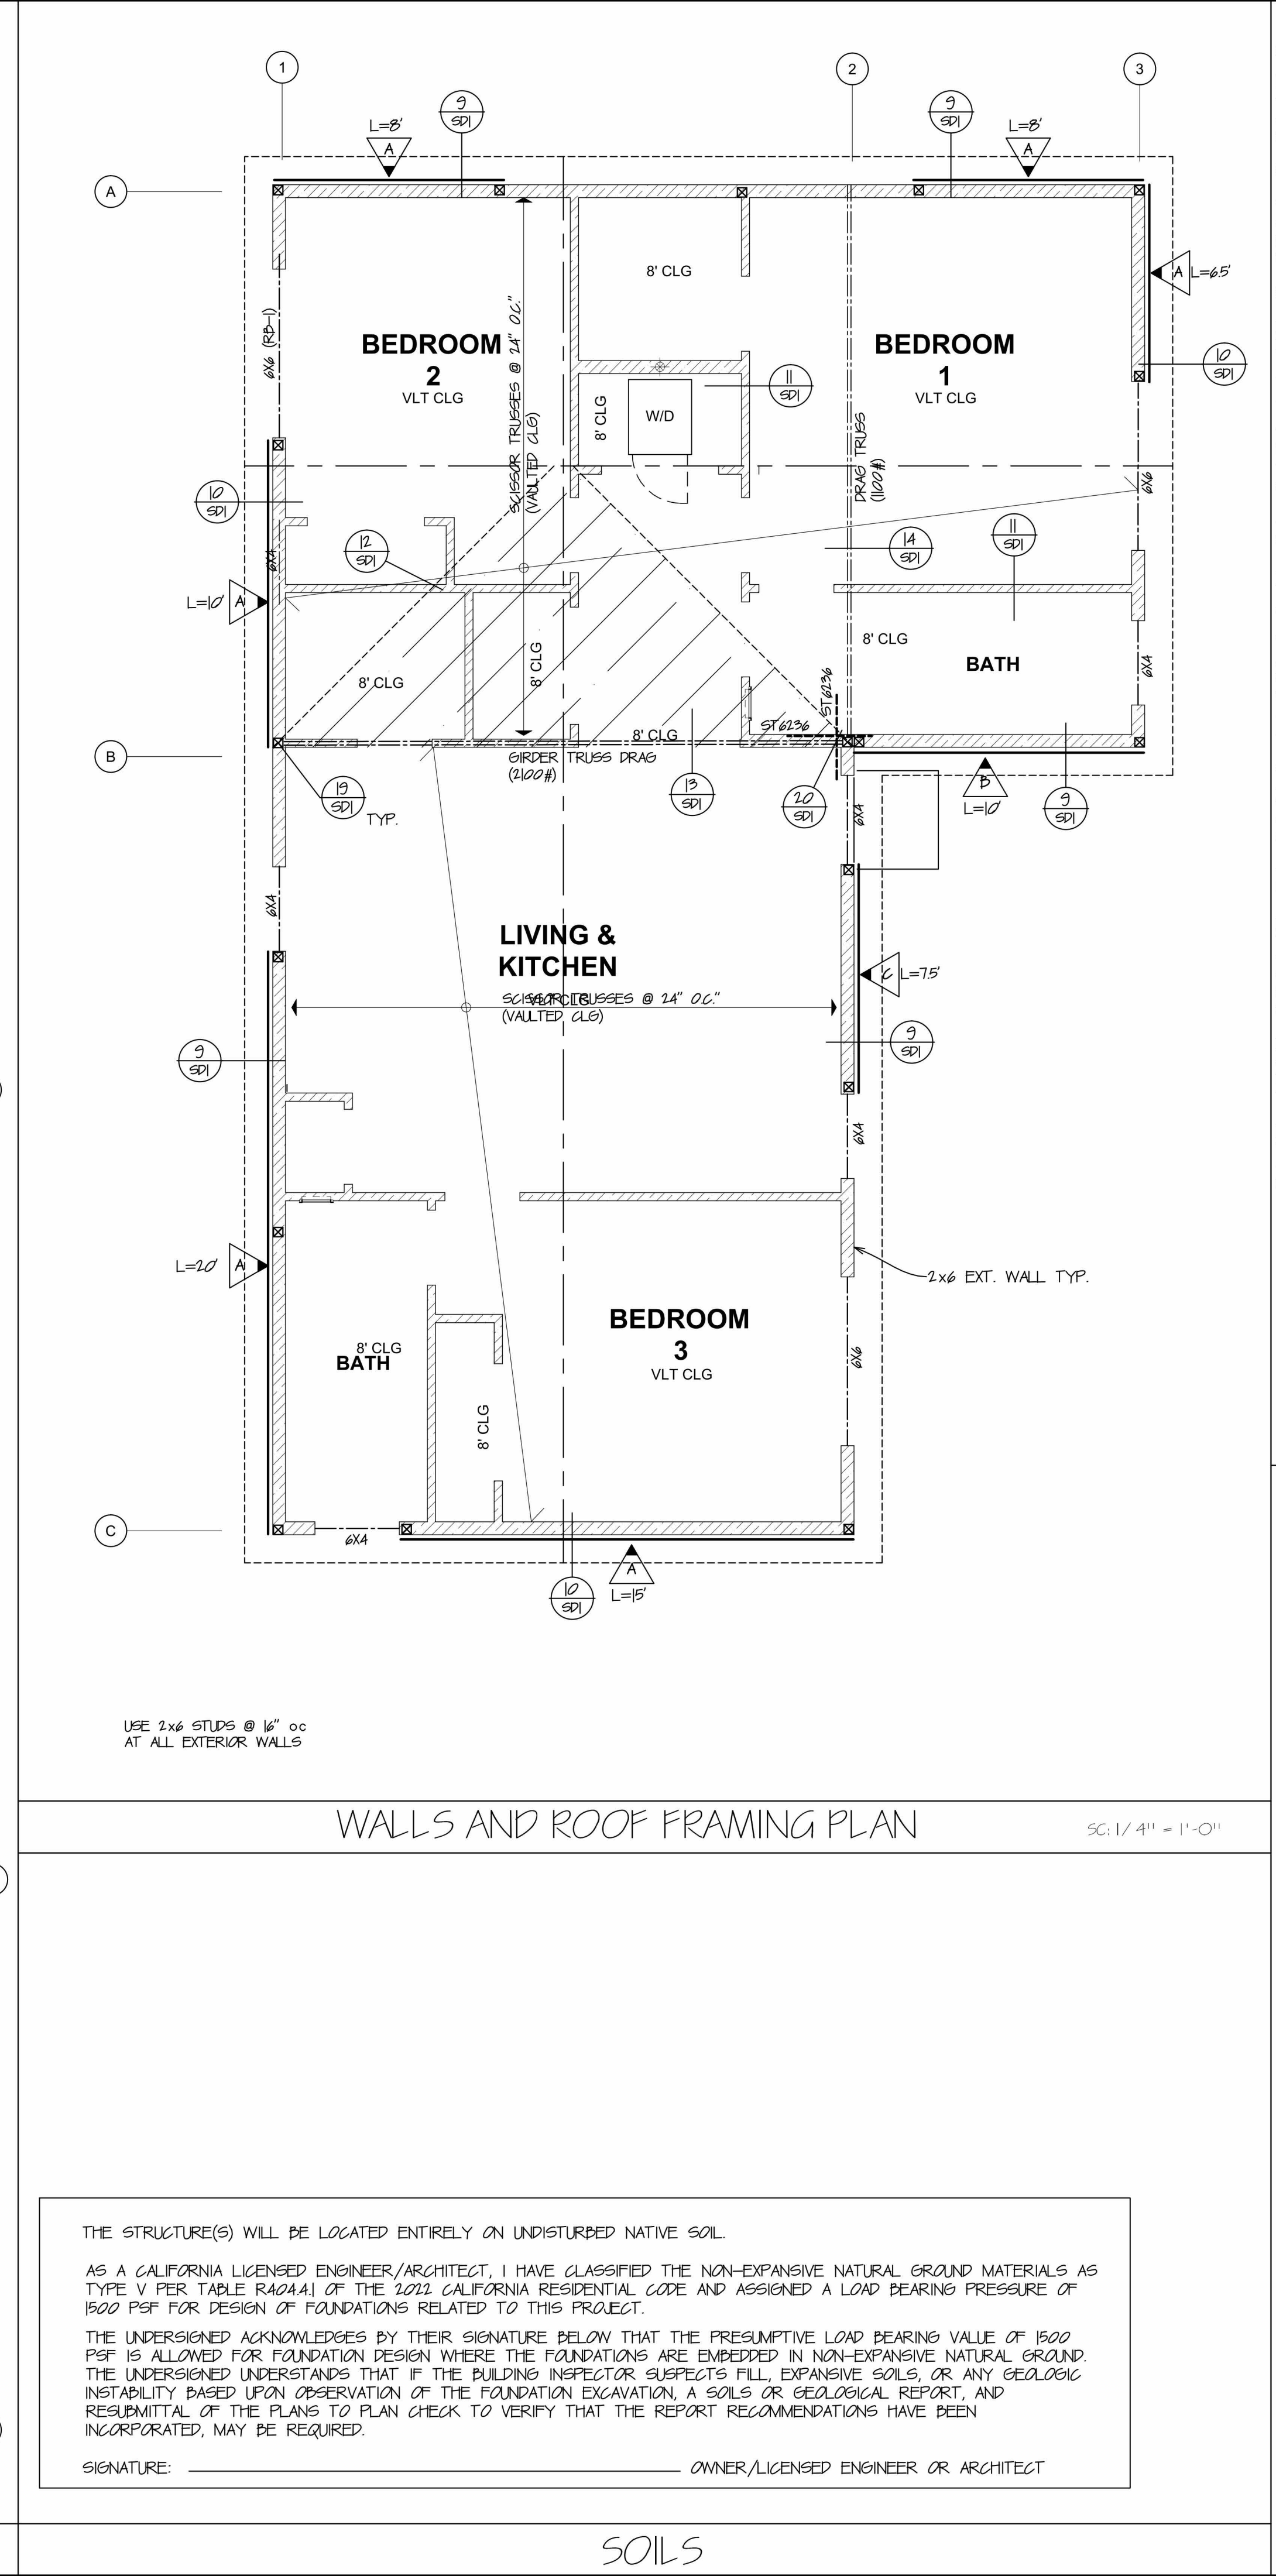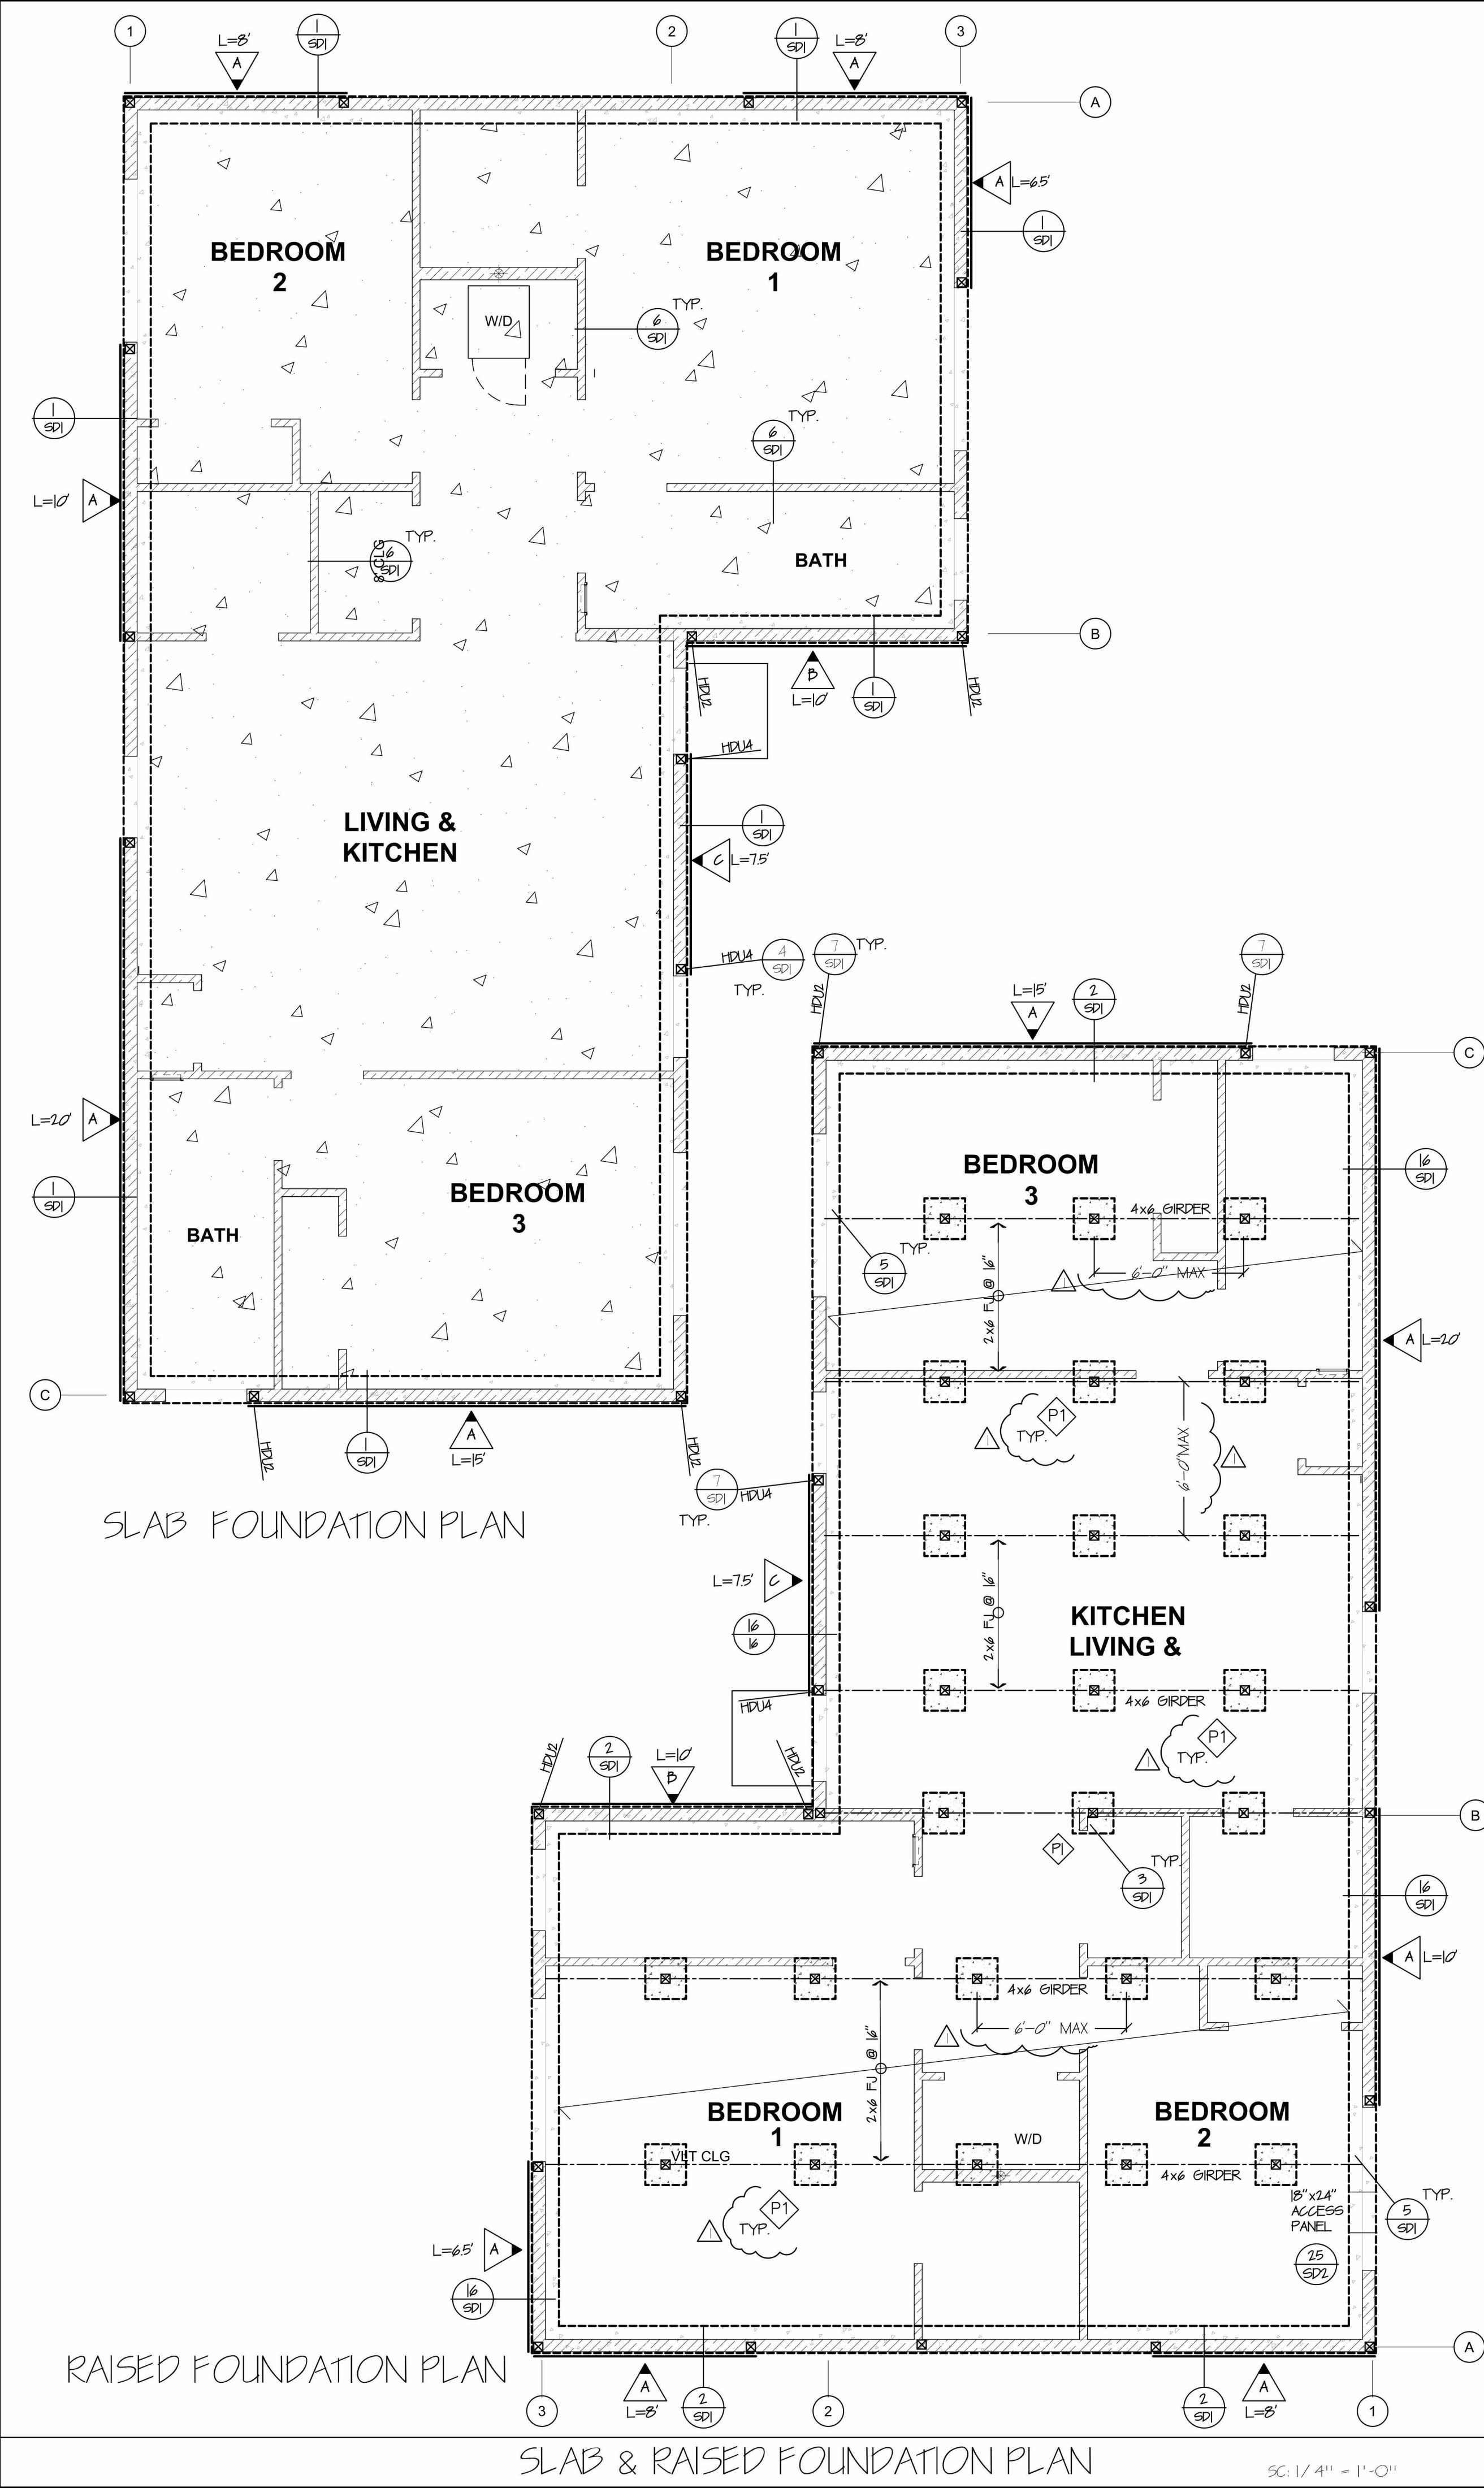

REVISIONS

NO.	DATE	BY
1	9-29-23	PC

FOUNDATION NOTES

1) CONCRETE SHALL HAVE A MINIMUM ULTIMATE COMPRESSIVE STRENGTH OF 1500 PSI AT 28 DAYS FOR FORD-IN-PLACE CONTINUOUS AND SPREAD FOOTINGS, AND 3000 PSI (SPECIAL INSP. REQ'D) AT 28 DAYS FOR GRADE BEAMS.

2) PORTLAND CEMENT SHALL BE TYPE I PER ASTM C 150. AGGREGATES SHALL BE PER ASTM C 39 WITH MAXIMUM SIZE OF 1/2" FOR FOOTINGS AND 1" FOR ALL OTHER WORK.

3) REINFORCING STEEL SHALL BE ASTM A615, GRADE 60, CLEAN AND RUST FREE. LAPS AT SPLICES AND JOINT LINES TO BE 40 BAR DIAMETERS (2'-0" MINIMUM) UNLESS NOTED OTHERWISE ON PLANS.

4) ALL NEW SILL PLATE ANCHOR BOLTS TO BE INSTALLED IN FRESH CONCRETE SHALL BE 5/8" DIAMETER A307 "L" BOLTS SPACED PER PLAN AND SHEARWALL SCHEDULE WITH MINIMUM 7' EMBEDMENT. MAXIMUM ANCHOR BOLT SPACING SHALL BE 4'-0" o.c. ANCHOR BOLTS AT ENDS OF WALL PANELS SHALL BE LOCATED WITHIN 12" AND GREATER THAN 7 BOLT DIAMETERS FROM THE END OF SILL PLATE. THERE SHALL BE A MINIMUM OF TWO ANCHOR BOLTS PER WALL PANEL (ANCHOR BOLTS TO EXISTING FOOTINGS PER NOTE #3 BELOW). PLATE WASHERS A MINIMUM 3"x3"x1/2" THICK SHALL BE USED ON EACH BOLT. ALL CONNECTORS AND METAL HARDWARE IN CONTACT WITH PRESSURE TREATED TIMBER SHALL HAVE CORROSION RESISTANT COATINGS OR PROTECTION, SUCH AS "ZMAX", HOT DIPPED GALVANIZED, OR BE STAINLESS STEEL.

6) IF NO SOILS REPORT IS PROVIDED, ASSUMED ALLOWABLE SOIL BEARING PRESSURE (ASBP) SHALL BE 1500 PSF (PER SOL SITE CLASS D) & EMBED FOOTINGS A MINIMUM OF 12" INTO COMPETENT SOIL.

7) REINFORCING SHALL BE CONTINUOUS AROUND CORNERS AND THROUGH INTERSECTIONS.

9) CONSTRUCTION JOINTS SHALL BE PREPARED BY WIRE BRUSHING, CLEANING AND BRUSHING IN A PASTE OF NEAT CEMENT MORTAR IMMEDIATELY PRIOR TO POURING. LOCATION OF CONSTRUCTION JOINT SHALL BE APPROVED BY THE PROJECT STRUCTURAL ENGINEER.

10) ALL CONNECTORS AND METAL HARDWARE IN CONTACT WITH PRESSURE TREATED TIMBER SHALL HAVE CORROSION RESISTANT COATINGS OR PROTECTION, SUCH AS "ZMAX", HOT DIPPED GALVANIZED, OR BE STAINLESS STEEL.

11) PRIOR TO POURING INTERIOR CONCRETE FLOOR SLABS, ALL SOIL BELOW FLOOR SHALL BE COMPACTED TO REQUIRED 90% DENSITY AND MOISTENED TO A DEPTH NOT LESS THAN 18" OR PER SOILS REPORT.

12) DEEPEN NEW FOOTINGS AS NECESSARY TO OBTAIN REQUIRED EMBEDMENT FOR ALL NEW HAD DOWN BOLTS. ALL HAD DOWN BOLTS TO HAVE A MINIMUM OF 3" OF CONCRETE COVER TO SOIL @ BOTTOM. ALL HAD DOWN BOLTS MUST BE TIED IN PLACE PRIOR TO FOUNDATION INSPECTION.

13) ALL HAD DOWNS MUST BE TIED IN PLACE PRIOR TO FOUNDATION INSPECTION.

14) MINIMUM HORIZONTAL DISTANCE FROM BOTTOM LEADING EDGE OF FOOTING TO DAYLIGHT SHALL BE 7'-0"

FOUNDATION LEGEND

(N) 12" WIDE x 24" DEEP FOOTING W/ 2-#4 T. & P.

(N) CONC. PAD PER PLAN

4x BM WIDTH POST UNO.

POST ABOVE

SHEARWALL PER PLAN

CONCRETE SLAB

USE 4" THK. CONC. SLAB W/ #3 @ 16" O.C. EW. @ MID-HEIGHT, 0/ 2" SAND, 0/ 10 ML VAPOR BARRIER (ASTM E36 & E1145), 0/ 2" SAND BASE.

CONCRETE PAD SCHEDULE

PAD	SIZE
P1	18" SQ x 14" THK. CONC. PAD W/ 2-#4 EW.

LEGEND

RF TRUSSES @ 24" o.c. UNO.

2x6 F.J. @ 16" o.c. UNO.

4x BM WIDTH POST UNO.

POST ABOVE

PLYWOOD SHEARWALL PER PLAN

ST#36 SIMPSON STRAP, UNO.

DRAG LINE PER PLAN SEE SHEARWALL NOTES ON SHEET S11

SOILS

THE STRUCTURE(S) WILL BE LOCATED ENTIRELY ON UNDISTURBED NATIVE SOIL.

AS A CALIFORNIA LICENSED ENGINEER/ARCHITECT, I HAVE CLASSIFIED THE NON-EXPANSIVE NATURAL GROUND MATERIALS AS TYPE V PER TABLE RA0441 OF THE 2012 CALIFORNIA RESIDENTIAL CODE AND ASSIGNED A LOAD BEARING PRESSURE OF 1500 PSF FOR DESIGN OF FOUNDATIONS RELATED TO THIS PROJECT.

THE UNDERSIGNED ACKNOWLEDGES BY THEIR SIGNATURE BELOW THAT THE PRESUMPTIVE LOAD BEARING VALUE OF 1500 PSF IS ALLOWED FOR FOUNDATION DESIGN WHERE THE FOUNDATIONS ARE EMBEDDED IN NON-EXPANSIVE NATURAL GROUND. THE UNDERSIGNED UNDERSTANDS THAT IF THE BUILDING INSPECTOR SUSPECTS FILL, EXPANSIVE SOILS, OR ANY GEOLOGIC INSTABILITY BASED UPON OBSERVATION OF THE FOUNDATION EXCAVATION, A SOILS OR GEOLOGICAL REPORT, AND RESUBMITTAL OF THE PLANS TO PLAN CHECK TO VERIFY THAT THE REPORT RECOMMENDATIONS HAVE BEEN INCORPORATED, MAY BE REQUIRED.

SIGNATURE: _____ OWNER/LICENSED ENGINEER OR ARCHITECT

PROJECT: New Detached ADU

PROJECT: Accessory Dwelling Unit

PROJECT: Standard L-5-Bedroom 199 SF. Plan

DATE: 9-29-23

FILE: CV-1093-L-ADU.dwg

DRAWN: PC

ENGINEER: PC

DATE: 9-29-23

SCALE: 1/4" = 1'-0"

REGISTERED PROFESSIONAL ENGINEER

REGISTERED PROFESSIONAL ARCHITECT







STATE OF CALIFORNIA

SHEET

52


SHEET

OF

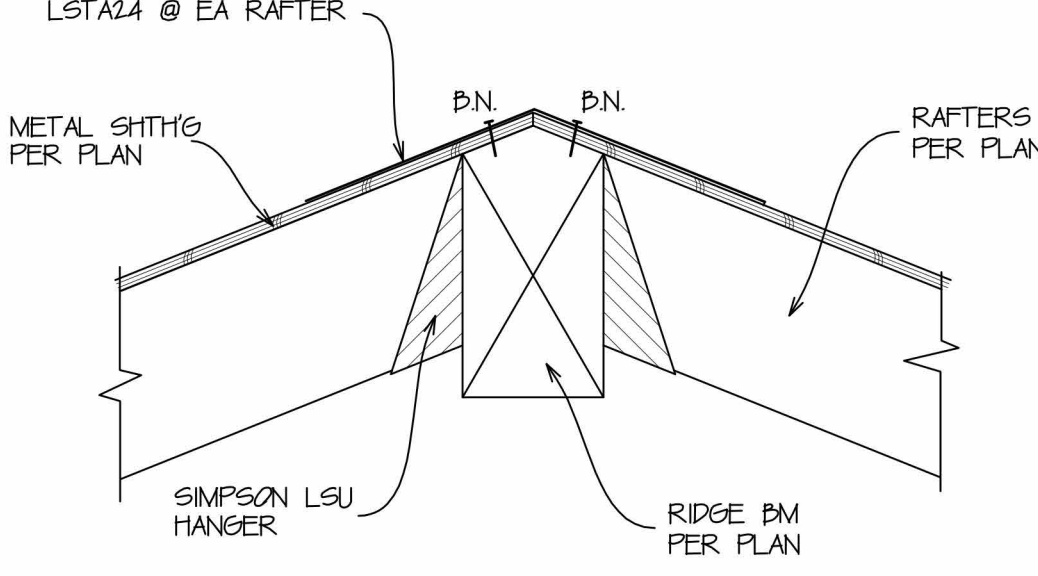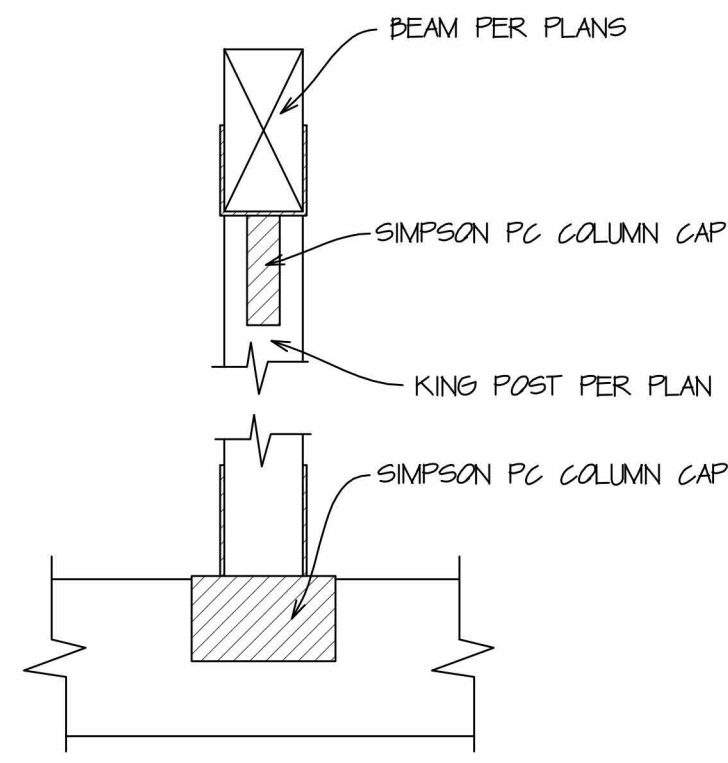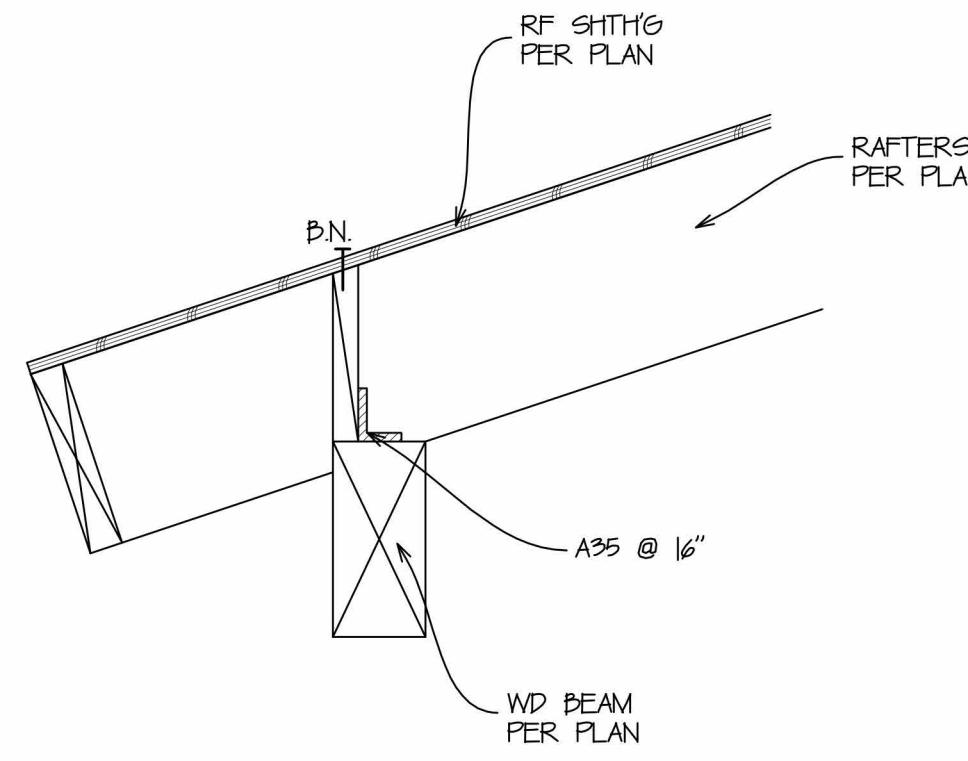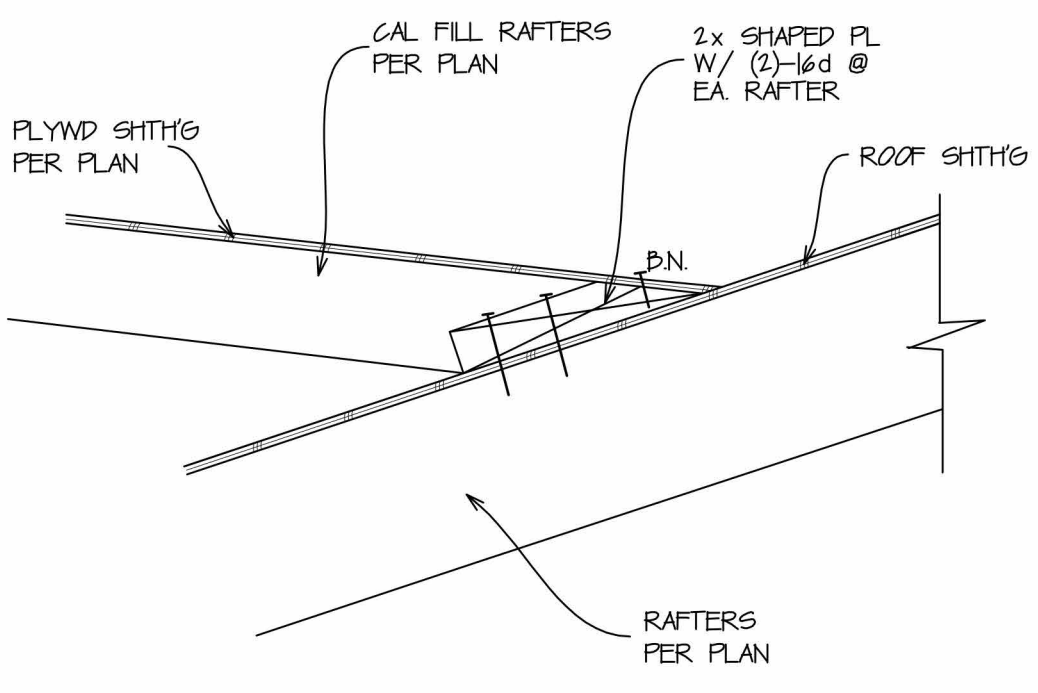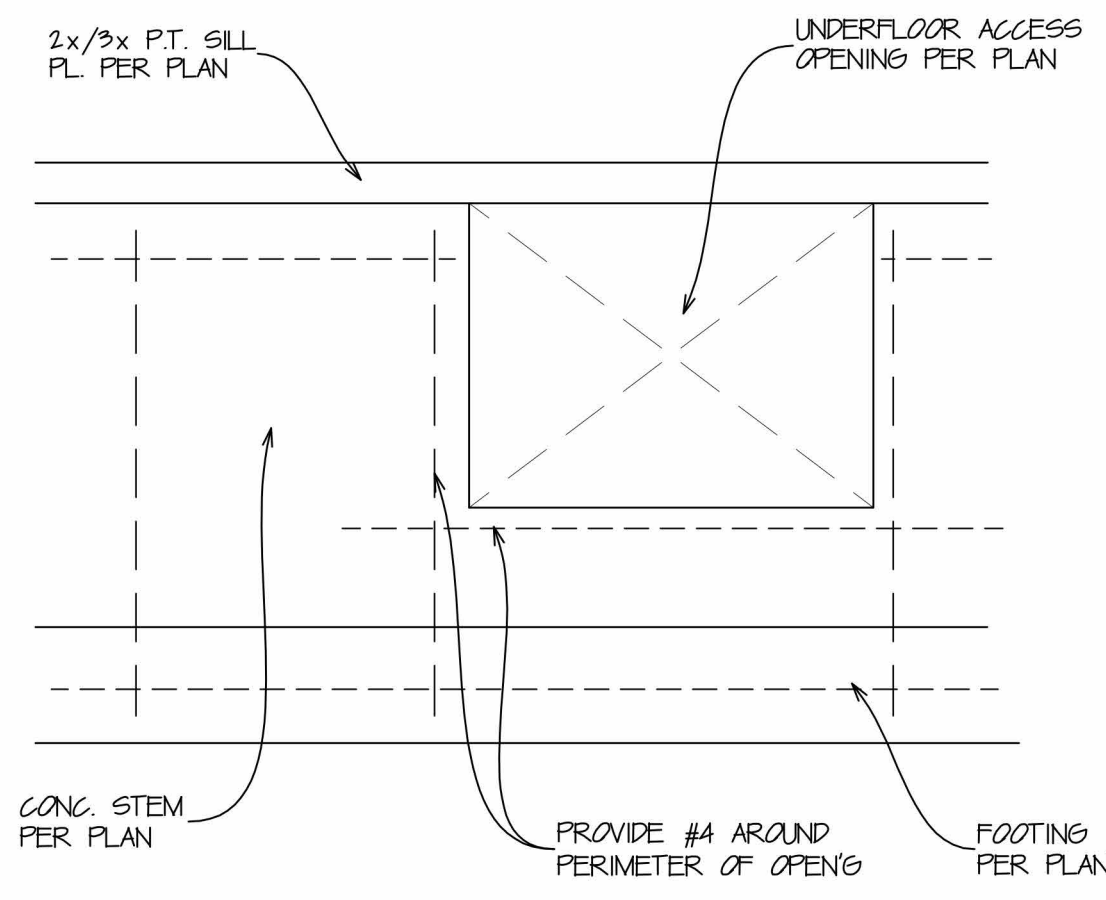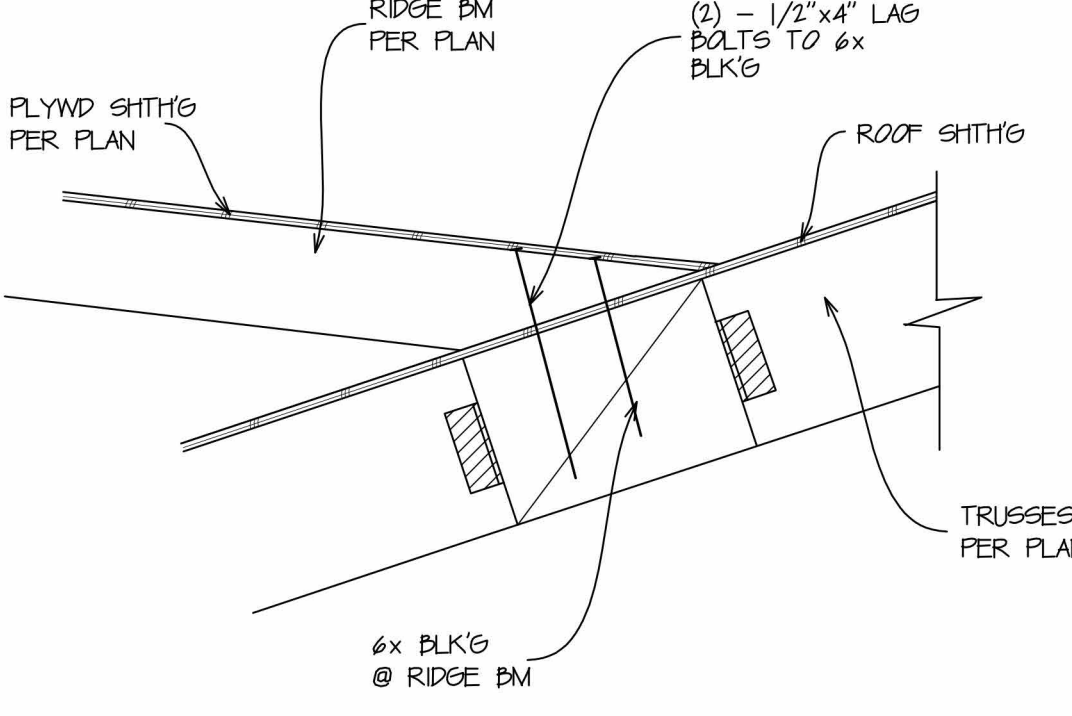 <p>LSTA24 @ EA RAFTER METAL SHTHG PER PLAN RAFTERS PER PLAN SIMPSON LSH HANGER RIDGE BM PER PLAN</p>	21	 <p>BEAM PER PLANS SIMPSON PC COLUMN CAP KING POST PER PLAN SIMPSON PC COLUMN CAP</p>	22	 <p>RF SHTHG PER PLAN RAFTERS PER PLAN WD BEAM PER PLAN A35 @ 1/8"</p>	23	 <p>PLYWD SHTHG PER PLAN CAL FILL RAFTERS PER PLAN 2x SHAPED PL W/ (2)-1/4" @ EA RAFTER RAFTERS PER PLAN ROOF SHTHG</p>	24	 <p>2x/3x P.T. SILL PL PER PLAN UNDERFLOOR ACCESS OPENING PER PLAN CONC. STEM PER PLAN PROVIDE #4 AROUND PERIMETER OF OPENG FOOTING PER PLAN</p>	25
 <p>PLYWD SHTHG PER PLAN RIDGE BM PER PLAN (2) - 1/2"x4" LAG BOLTS TO 6x BLKG ROOF SHTHG TRUSSES PER PLAN 6x BLKG @ RIDGE BM</p>	26		27		28		29		30
	31		32		33		34		35
	36		37		38		39		40

REVISIONS

1-16-23	BY
	PC



PCSD
Paul C. S. Design
Full-Service Engineering
PH 760.207.1885
paul.pcsd@gmail.com

PROJECT

New Detached ADU

CHULA VISTA, CA

DRAWING

Details

JOB #:

23-169

FILE:

CV-1193-L-ADU.dwg

DRAWN:

PC

ENGINEER:

PC

DATE:


6-16-23

SCALE:

1/4" = 1'-0"

ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE NOTED
NOT DIMENSIONED AND TOLERANCES TO FACE UNLESS OTHERWISE NOTED

STAMP



SHEET

SD2

SHEET - OF -

GENERAL

1) ALL DESIGN, CONSTRUCTION, AND WORKMANSHIP SHALL CONFORM TO:
2022 EDITION OF THE CALIFORNIA BUILDING CODE (CBC), AMERICAN SOCIETY OF CIVIL ENGINEERS (ASCE)
7-16, 2022 CALIFORNIA MECHANICAL CODE (CMC), 2022 CALIFORNIA PLUMBING CODE, AND ALL LOCAL ORDINANCES AND REQUIREMENTS.

2) THE APPROVED CONTRACT STRUCTURAL DRAWINGS AND SPECIFICATIONS REPRESENT THE FINISHED STRUCTURE. THEY DO NOT INDICATE THE METHOD OF CONSTRUCTION.

3) IT SHALL BE THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO PROVIDE ALL MEASURES NECESSARY TO PROTECT THE STRUCTURE DURING CONSTRUCTION. SUCH MEASURES SHALL INCLUDE, BUT ARE NOT LIMITED TO, BRACING AND SHORING FOR LOADS DUE TO CONSTRUCTION EQUIPMENT, ETC., THE METHODS, TECHNIQUES, SEQUENCES, PROCEDURES, SUPERVISION, AND INSTALLATION OF ALL TEMPORARY BRACING AND SHORING SHOULD ENSURE THE SAFETY OF THE WORK. BRACING AND SHORING IS TO BE INSTALLED PER THE LATEST OSHA STANDARDS. ALL BRACING AND/OR SHORING SHALL STAY IN PLACE UNTIL ALL WORK HAS BEEN SUITABLY COMPLETED.

4) THE GENERAL CONTRACTOR SHALL VERIFY ALL DIMENSIONS PRIOR TO STARTING CONSTRUCTION. THE ENGINEER SHALL BE NOTIFIED OF ANY DISCREPANCIES OR INCONSISTENCIES.

5) DIMENSIONS SHALL TAKE PRECEDENCE OVER SCALES ON DRAWINGS. NOTES AND DETAILS ON DRAWINGS SHALL TAKE PRECEDENCE OVER GENERAL NOTES AND TYPICAL DETAILS.

6) IT SHALL BE THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO ENSURE THAT ALL APPLICABLE SAFETY LAWS ARE STRICTLY ENFORCED AND TO MAINTAIN A SAFE CONSTRUCTION PROJECT.

7) IT SHALL BE THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO PROVIDE SUPERVISION OF THE CONSTRUCTION WORK TO ENSURE THAT IT IS BUILT IN CONFORMANCE WITH THE APPROVED PLANS AND SPECIFICATIONS. THE ENGINEER WILL PROVIDE ONLY OBSERVATION OF THE WORK DURING CONSTRUCTION.

8) THE APPROVED SET OF CONSTRUCTION DOCUMENTS, INCLUDING ALL APPROVED REVISIONS, SHALL BE PRESENT AT THE JOB SITE AT ALL TIMES.

9) CONSTRUCTION MATERIALS SHALL BE SPREAD OUT IF PLACED ON FRAMED FLOORS OR ROOFS. LOADS SHALL NOT EXCEED THE DESIGN LOADING FOR THE SUPPORTING MEMBERS.

10) NO CHANGES IN THE PLANS WILL BE MADE AND NO EXTRA WORK PERFORMED UNLESS SO APPROVED BY THE OWNER, CIVIL/STRUCTURAL ENGINEER, SOILS ENGINEER/GEOLGISTS, COUNTY/CITY INSPECTOR AND BUILDING OFFICIALS.

11) A CLAIM FOR EXTRAS WILL BE CONSIDERED IF A CONDITION ARISES WHICH WAS CHANGED BY DESIGN BY OTHERS, UNFORESEEN OR HAS NOT BEEN SHOWN ON THE PLANS. SUCH CLAIMS FOR EXTRAS WILL NOT BE ALLOWED UNLESS THE CONTRACTOR HAS NOTIFIED THE OWNER AND SUPERVISING ENGINEER IN WRITING, INCLUDING AN AGREED-TO REIMBURSEMENT SCHEDULE, PRIOR TO PERFORMING THE EXTRA WORK.

INTENT OF THE DOCUMENTS

IT IS THE INTENT OF THE DRAWINGS AND THE SPECIFICATIONS TO REQUIRE THE COMPLETION OF THE WORK IN A THOROUGH AND WORKMANLIKE MANNER IN EVERY RESPECT.

DESCRIPTION OF WORK

THE CONTRACTOR SHALL FURNISH PERMITS, LICENSES, FEES, MATERIAL, LABOR, TOOLS, PLANT, SUPPLIES, EQUIPMENT, TRANSPORTATION, SUPERINTENDENCE, TEMPORARY CONSTRUCTION OF EVERY NATURE, INSURANCE, TAXES, CONTRIBUTIONS, AND ALL OTHER SERVICES AND FACILITIES, UNLESS SPECIFICALLY EXCEPTED NECESSARY TO COMPLETE THIS PROJECT.

LIABILITY AND COMPENSATION INSURANCE

THE CONTRACTOR SHALL MAINTAIN AT ALL TIMES, FULL AND UNLIMITED WORKMANS COMPENSATION INSURANCE IN ACCORDANCE WITH THE LABOR CODE OF THE STATE OF CALIFORNIA AND SHALL CARRY PUBLIC CONTINGENT LIABILITY OF INSURANCE, IN AMOUNTS SATISFACTORY TO AND IN COMPANIES SELECTED WITH THE CONSENT OF THE OWNER.

PERMITS

THE CONTRACTOR SHALL OBTAIN THE BUILDING PERMIT, AND ALL OTHER CERTIFICATIONS, INSPECTION REPORTS, RELEASES, JURISDICTIONAL SETTLEMENTS, NOTICES, RECEIPTS FOR FEE PAYMENTS, JUDGMENTS, AND SIMILAR DOCUMENTS, CORRESPONDENCE AND RECORDS IN COLLECTION.

SUBCONTRACTOR'S STATUS

EVERY ITEM MENTIONED IN THE SPECIFICATIONS IS INTENDED TO REPRESENT THE QUALITY OF MATERIALS THAT WILL BE DEMANDED. SHOULD THE SUBCONTRACTOR WISH TO SUGGEST ANY SUBSTITUTES THAT HE CONSIDERS EQUAL IN VALUE AND EFFICIENCY WITH THE ONE SPECIFIED, HE SHALL STATE WHAT THE ITEM SUGGESTED IS, AND THE DIFFERENCE IN COST, IF ANY.

IF SUBSTITUTES OF MATERIALS (EQUIVALLY 6000) ARE OFFERED AT THE TIME BIDS ARE SUBMITTED, THEY WILL BE CONSIDERED. IN THE EVENT THE OWNER WISHES TO ACCEPT THE SUBSTITUTE, ARRANGEMENTS WILL BE MADE FOR THE CHANGE BEFORE ENTERING INTO A CONTRACT.

IF NO ITEMS ARE SUGGESTED AS A SUBSTITUTE AT THE TIME THE BIDS ARE SUBMITTED, THEN NO DEVIATION WILL BE ALLOWED FROM THE MATERIALS SPECIFIED WITHOUT FIRST SECURING THE APPROVAL OF THE OWNER.

WORKMAN SAFETY-EXCAVATIONS

ALL REGULATIONS OF THE STATE OR FEDERAL AGENCY SHOULD BE FOLLOWED BEFORE ALLOWING WORKMEN IN A TRENCH OR OTHER EXCAVATION.

IF EXCAVATIONS ARE TO BE MADE DURING THE RAINY SEASON PARTICULAR CARE SHOULD BE GIVEN TO INSURE THAT PERMS OR OTHER DEVICES PREVENT SURFACE WATER FROM FLOWING OVER THE TOP OF THE EXCAVATION OR PONDING AT THE TOP OF THE EXCAVATIONS.

NO TRENCHES OR EXCAVATIONS SHALL BE 5' OR MORE IN DEPTH INTO WHICH A PERSON IS REQUIRED TO DESCEND, OR OBTAIN NECESSARY PERMIT FROM THE STATE OF CALIFORNIA DIVISION OF INDUSTRIAL SAFETY PRIOR TO ISSUANCE OF A BUILDING OR GRADING PERMIT.

WRAP AND PROTECT ALL UTILITY LINES IN WAY OF CONSTRUCTION PER STANDARD CONSTRUCTION PRACTICES

TIMBER

1) ALL TIMBER DESIGN AND CONSTRUCTION SHALL BE PER 2022 CBC CHAPTER 23 AND 2020 NATIONAL DESIGN SPECIFICATION (NDS). ALL SAWN LUMBER SHALL BE GRADED BY EITHER NWFA OR WCLB.

2) UNJO, ALL WOOD SILL PLATES AND LEDGERS BEARING ON CONCRETE OR MASONRY SHALL BE PRESSURE TREATED DOUGLAS FIR-LARCH. ANCHOR BOLTS SHALL BE 5/8" DIAMETER SPACED A MAXIMUM 4'-0" O.C. AND WITHIN 12" AND GREATER THAN SEVEN BOLT DIAMETERS FROM EACH END OF A SILL FROM A HOLE, OR FROM A NOTCH GREATER THAN 1/3 THE WIDTH OF THE SILL. SEE SHEARWALL SCHEDULE FOR OTHER REQUIREMENTS.

3) ALL WALL BRACING AND MATCHING OF STUDS SHALL CONFORM TO SECTION 2302B.33 OF THE 2022 CALIFORNIA BUILDING CODE.

4) UNLESS NOTED OTHERWISE ON FRAMING PLANS:

ROOF SHEATHING SHALL BE 15/32" APA-RATED SHEATHING, EXPOSURE I, MIN. SPAN RATING 24/0, NAILED WITH 8d COMMON @ 6" O.C. AT EDGES & BOUNDARIES AND 12" O.C. AT INTERMEDIATE FRAMING MEMBERS.

FLOOR SHEATHING SHALL BE 23/32" APA-RATED STURD-I-FLOOR, T&G, EXPOSURE I, MIN. SPAN RATING 20" O.C., NAILED WITH 1d COMMON @ 6" O.C. AT EDGES & BOUNDARIES AND 12" O.C. AT INTERMEDIATE FRAMING MEMBERS.

SHEARWALL SHEATHING SHALL BE APA "STRUCTURAL I" RATED, EXPOSURE I, GROUP 1, NAILING PER SHEARWALL SCHEDULE.

ALL WOOD STRUCTURAL PANEL SHEATHING SHALL BE GRADE MARKED BY APA, T&G, OR PTL AND SHALL CONFORM TO PS-1-9, PS-2-18, OR FRP-1-20.

TRASH REMOVAL

THE CONTRACTOR SHALL PROMPTLY REMOVE FROM THE BUILDING, LOT, SIDEWALKS, AND STREETS - ALL RUBBISH AND DIRT, AS IT ACCUMULATES, DUE TO THE WORK DONE UNDER THIS CONTRACT.

ALL COMBUSTIBLE DEBRIS SHALL BE REMOVED FROM THE BUILDING ON A DAILY BASIS.

FOUNDATION

1) CONCRETE SHALL HAVE A MINIMUM ULTIMATE COMPRESSIVE STRENGTH OF 3500 PSI AT 28 DAYS FOR POURED-IN-PLACE CONTINUOUS AND SPREAD FOOTINGS, AND 3000 PSI (SPECIAL INSP. REQ'D) AT 28 DAYS FOR GRADE BEAMS.

2) PORTLAND CEMENT SHALL BE TYPE II PER ASTM C 150. AGGREGATES SHALL BE PER ASTM C39 WITH MAXIMUM SIZE OF 1 1/2" FOR FOOTINGS AND 1" FOR ALL OTHER WORK.

3) REINFORCING STEEL SHALL BE ASTM A615, GRADE 60, CLEAN AND RUST FREE. LAPS AT SPLICES AND FOUR LINES TO BE 40 BAR DIAMETERS (3'-0" MINIMUM) UNLESS NOTED OTHERWISE ON PLANS.

4) UNJO, SLABS ON GRADE SHALL BE 4" THICK WITH #2 BARS @ 16" O.C. EACH WAY WITH 2 INCH COVER AT BOTTOM. 4" CLEAN SAND SHALL BE PLACED BELOW THE SLAB WITH A 10 MIL PLASTIC VAPOR BARRIER PER ASTM E266 & ASTM E146 PLACED AT MID-HEIGHT. BARS SHALL BE LAPPED 20". SEE SOILS REPORT (IF AVAILABLE) FOR OTHER REQUIREMENTS.

5) ALL NEW SILL PLATE ANCHOR BOLTS TO BE INSTALLED IN FRESH CONCRETE SHALL BE 5/8" DIAMETER ABOUT 1" LONG SPACED PER PLAN AND SHEARWALL SCHEDULE WITH MINIMUM 7' EMBEDMENT. MAXIMUM ANCHOR BOLT SPACING SHALL BE 4'-0" O.C. ANCHOR BOLTS AT ENDS OF WALL PANELS SHALL BE LOCATED WITHIN 12" AND GREATER THAN 7 BOLT DIAMETERS FROM THE END OF SILL PLATE. THERE SHALL BE A MINIMUM OF TWO ANCHOR BOLTS PER WALL PANEL. ANCHOR BOLTS TO EXISTING FOOTINGS PER NOTE #10 (SEE BELOW). PLATE WASHERS A MINIMUM 9/32X2 1/2" THICK SHALL BE USED ON EACH BOLT. ALL CONNECTORS AND METAL HARDWARE IN CONTACT WITH PRESSURE TREATED TIMBER SHALL HAVE CORROSION RESISTANT COATINGS OR PROTECTION, SUCH AS "ZMAX", HOT DIPPED GALVANIZED, OR BE STAINLESS STEEL.

6) IF NO SOILS REPORT IS PROVIDED, ASSUMED ALLOWABLE SOIL BEARING PRESSURE (ASBP) SHALL BE 100 PSF (PER SOIL SITE CLASS D) & EMBED FOOTINGS A MINIMUM OF 24" INTO COMPETENT SOIL.

7) REINFORCEMENT CLEARANCES FOR FOOTINGS AND GRADE BEAMS, (UNJO):

A) FURRED AGAINST EARTH - 3"

B) FORMED SURFACE - 2"

8) REMOVAL OF FORMS:

A) SUPPORTING VERTICAL SURFACES - 2 DAYS MINIMUM

B) SUPPORTING BEAMS & GIRDERS - 15 DAYS MINIMUM

9) REINFORCING SHALL BE CONTINUOUS AROUND CORNERS AND THROUGH INTERSECTIONS.

10) ALL NEW SILL PLATE ANCHOR BOLTS TO BE INSTALLED INTO EXISTING FOOTINGS SHALL BE SIMPSON TITAN HD ANCHOR (ICC-ES ESR-1056/LARR# 25560)

14) CONSTRUCTION JOINTS SHALL BE PREPARED BY WIRE BRUSHING, CLEANING AND BRUSHING IN A PASTE OF NEAT CEMENT MORTAR IMMEDIATELY PRIOR TO POURING. LOCATION OF CONSTRUCTION JOINT SHALL BE APPROVED BY THE PROJECT STRUCTURAL ENGINEER.

15) ALL CONNECTORS AND METAL HARDWARE IN CONTACT WITH PRESSURE TREATED TIMBER SHALL HAVE CORROSION RESISTANT COATINGS OR PROTECTION, SUCH AS "ZMAX", HOT DIPPED GALVANIZED, OR BE STAINLESS STEEL.

16) PRIOR TO POURING INTERIOR CONCRETE FLOOR SLABS, ALL SOL BELOW FLOOR SHALL BE COMPACTED TO REQUIRED 90% RELATIVE DENSITY AND MOISTENED TO A DEPTH NOT LESS THAN 18".

17) DEEPEN NEW FOOTINGS AS NECESSARY TO OBTAIN REQUIRED EMBEDMENT FOR ALL NEW HOLD DOWN BOLTS. ALL HOLD DOWN BOLTS TO HAVE A MINIMUM OF 3" OF CONCRETE COVER TO SOIL & BOTTOM.

FRAMING

ROOF DIAPHRAGM

15/32" APA RATED SHEATHING (MN), EXPOSURE I, 24/0 MAX SPAN RATING, w/ 8d COMMON NAILS @ 6" O.C. AT BOUNDARY & PANEL EDGE NAILING (EN), AND 12" O.C. AT INTERMEDIATE FRAMING MEMBERS

FLOOR DIAPHRAGM

23/32" APA STURD-I-FLOOR, EXPOSURE I, TONGUE AND GROOVE, w/ 1d COMMON NAILS @ 6" O.C. AT BOUNDARY & PANEL EDGE NAILING (EN), AND 12" O.C. AT INTERMEDIATE FRAMING MEMBERS

FRAMING

BUILT-UP WOOD FRAMING MEMBERS MAY NOT BE SUBSTITUTED FOR 4x AND WIDER BEAMS UNLESS NOTED BY ENGINEER.

ALL (1) 2x ROOF & FLOOR FRAMING TO HAVE MIN. 16d AT 12" O.C. T&G, STAGGERED

ALL (2) 3x FRAMING TO HAVE MIN. 1 1/2" DIAMETER BOLTS AT 18" O.C. T&G, STAGGERED

2x solid blocking REQUIRED AT POINTS OF SUPPORT FOR ALL HORIZONTAL FRAMING MEMBERS. IN ADDITION, ALL 2x10 AND LARGER MEMBERS SHALL HAVE SOLID FULL DEPTH BLOCKING OR BRACING AT MAX. 8'-0" O.C. ON PLANS AND SECURELY WIRED.

ALL WOOD POSTS AT UPPER FLOORS TO CONTINUE TO BEAM OR FOUNDATION.

UNLESS DETAILED OTHERWISE, ALL RIDGE / HIP / VALLEY CONNECTIONS TO HAVE A SIMPSON A95 CONNECTOR AT EACH CORNER WITH A 2x KICKER TO BEARING WALL.

AT ROOF-TO-WALL FRAMING, PROVIDE A95 FRAMING ANCHORS PER SHEARWALL SCHEDULE OR AT MAX. 48" O.C. FROM PLATES TO RAFTERS AND RAFTER BLOCKING AROUND PERIMETER OF BUILDING AND AT DRAG LINES AS INDICATED ON PLANS (SEE PLANS WHERE OTHER REQUIREMENTS MAY OCCUR).

ALL WOOD POSTS AT UPPER FLOORS TO CONTINUE TO BEAM OR FOUNDATION.

UNLESS DETAILED OTHERWISE, ALL RIDGE / HIP / VALLEY CONNECTIONS TO HAVE A SIMPSON A95 CONNECTOR AT EACH CORNER WITH A 2x KICKER TO BEARING WALL.

AT ROOF-TO-WALL FRAMING, PROVIDE A95 FRAMING ANCHORS PER SHEARWALL SCHEDULE OR AT MAX. 48" O.C. FROM PLATES TO RAFTERS AND RAFTER BLOCKING AROUND PERIMETER OF BUILDING AND AT DRAG LINES AS INDICATED ON PLANS (SEE PLANS WHERE OTHER REQUIREMENTS MAY OCCUR).

ALL WOOD POSTS AT UPPER FLOORS TO CONTINUE TO BEAM OR FOUNDATION.

UNLESS DETAILED OTHERWISE, ALL RIDGE / HIP / VALLEY CONNECTIONS TO HAVE A SIMPSON A95 CONNECTOR AT EACH CORNER WITH A 2x KICKER TO BEARING WALL.

AT ROOF-TO-WALL FRAMING, PROVIDE A95 FRAMING ANCHORS PER SHEARWALL SCHEDULE OR AT MAX. 48" O.C. FROM PLATES TO RAFTERS AND RAFTER BLOCKING AROUND PERIMETER OF BUILDING AND AT DRAG LINES AS INDICATED ON PLANS (SEE PLANS WHERE OTHER REQUIREMENTS MAY OCCUR).

ALL WOOD POSTS AT UPPER FLOORS TO CONTINUE TO BEAM OR FOUNDATION.

UNLESS DETAILED OTHERWISE, ALL RIDGE / HIP / VALLEY CONNECTIONS TO HAVE A SIMPSON A95 CONNECTOR AT EACH CORNER WITH A 2x KICKER TO BEARING WALL.

AT ROOF-TO-WALL FRAMING, PROVIDE A95 FRAMING ANCHORS PER SHEARWALL SCHEDULE OR AT MAX. 48" O.C. FROM PLATES TO RAFTERS AND RAFTER BLOCKING AROUND PERIMETER OF BUILDING AND AT DRAG LINES AS INDICATED ON PLANS (SEE PLANS WHERE OTHER REQUIREMENTS MAY OCCUR).

ALL WOOD POSTS AT UPPER FLOORS TO CONTINUE TO BEAM OR FOUNDATION.

TIMBER

1) HORIZONTAL WOOD STRUCTURAL PANELS SHALL BE LAP WITH THE LONG DIMENSION AND FACE GRAIN PERPENDICULAR TO THE RAFTERS OR JOISTS, AND THE SHEETS SHALL BE STAGGERED AS SHOWN IN 2022 CBC TABLE 23061.2 (CASES I AND 9). EACH SHEET SHALL CONTAIN A MINIMUM OF 8 SQUARE FEET AND EXTEND TO 3 SUPPORTS. 1/8" SPACING BETWEEN PANEL ENDS AND EDGES IS REQUIRED. ALL WOOD STRUCTURAL PANEL DIAPHRAGMS SHALL BE REVIEWED BY CONTRACTOR FOR COMPLIANCE WITH NAILING AND PANEL REQUIREMENTS BEFORE FINISH IS APPLIED.

2) UNJO, ALL 2x ROOF RAFTER AND FLOOR JOIST FRAMING MEMBERS SHALL BE MINIMUM GRADE DOUGLAS FIR-LARCH NO. 2 OR BETTER. ALL BEAMS, HEADERS, AND POSTS SHALL BE MINIMUM DOUGLAS FIR-LARCH NO. 1 OR BETTER. ALL VERTICAL WALL FRAMING MEMBERS SHALL BE DOUGLAS FIR-LARCH NO. 2 OR BETTER.

3) ALL PS1 AND LVL ENGINEERED FRAMING MEMBERS SHOWN ON PLANS TO BE 23E PARALLAM (E=2200 ksi) AND 10E MICROLAM BEAMS (E=1000 ksi), RESPECTIVELY, AS DESCRIBED IN ICC-ES ESR-1056 & ICC-ES ESR-1057. ALL WOOD I-JOIST MEMBERS SHOWN ON PLANS TO BE AS DESCRIBED IN ESR-1059.

4) MOISTURE CONTENT OF SAWN LUMBER AT TIME OF INSTALLATION SHALL NOT EXCEED 19%.

5) ALL BOLT HEADS AND NUTS BEARING ON WOOD SHALL HAVE WASHERS. HOLES IN WOOD FOR BOLTS SHALL BE DRILLED MAX. 1/16" LARGER THAN NOMINAL BOLT SIZE.

12) NOTCHING OR DRILLING HOLES IN BEAMS OR JOISTS SHALL BE ONLY AS DETAILED PER ENGINEER AND SHALL COMPLY WITH 2022 CBC SECTION 2302B.31 & 2302B.33.

13) ALL SAWN LUMBER (2x, 4x, 6x) RAFTERS, FLOOR JOISTS, AND BEAMS SHALL HAVE SOLID WOOD BLOCKING AT ALL POINTS OF SUPPORT. MEMBERS WITH NOMINAL DEPTH 10" OR GREATER SHALL HAVE 2x FULL DEPTH SOLID BLOCKING OR CROSS BRACING SPACED AT 8'-0" FOR MAXIMUM.

14) UNJO, ALL FRAMING CONNECTION HARDWARE SHALL BE AS MANUFACTURED BY THE SIMPSON STRONG-TIE COMPANY AND SHALL BE REFERENCED AS SHOWN IN THEIR LATEST CATALOGS. ALL CONNECTOR WALLS AND BOLTS SHALL BE AS DESIGNATED PER MANUFACTURER. ALTERNATE MANUFACTURER CONNECTOR HARDWARE MAY BE USED PROVIDED ENGINEER'S WRITTEN APPROVAL IS OBTAINED BY CONTRACTOR AND ICC APPROVAL IS PROVIDED.

15) TOP PLATES SHALL LAP LOWER PLATES AT CORNERS, AND BREAKS AT PLATE SHALL BE LAPPED A MINIMUM OF 4'-0", WITH 20-6d NAILS ON EACH SIDE.

16) ALL BEAMS SHALL BE SUPPORTED BY POSTS OR GIRDERS. FOR 4x8 AND SMALLER BEAMS A MINIMUM (2)-2X4 DF. #2 POST SHALL BE USED. UNJO. FOR 4x10 AND LARGER BEAMS A MINIMUM 4x4 DF. #1 POST SHALL BE USED. UNJO. ALL POSTS SHALL PROVIDE FULL BEARING WIDTH FOR THE BEAM. UNJO.

17) ALL POSTS SHALL BE CONTINUED BETWEEN FLOORS WITH SOLID FULL WIDTH BLOCKING AND A POST OF EQUAL OR GREATER SIZE BELOW, UNTIL A BEAM OR FOUNDATION IS ENCOUNTERED. ALL POSTS INSIDE WALLS MAY BEAR ON THE SOLE OR SILL PLATE. UNJO. ISOLATED POSTS SHALL BE SEATED IN POST OR COLUMN DEAKS PER PLAN.

18) ALL WALLS HIGHER THAN 10'-0" SHALL BE 2x8 OR 3x8 STUDS @ 16" O.C., UNLESS SPECIFICALLY DESIGNED OTHERWISE BY ENGINEER. ALL WALLS CONTAINING MECHANICAL PIPING 2" IN DIAMETER OR LARGER SHALL BE FRAMED WITH 2x8 STUDS @ 16" O.C.

19) CUTTING, NOTCHING, OR BORING HOLES IN STUDS SHALL COMPLY WITH 2022 CBC SECTION 2302B.310 & 2302B.311.

20) FRAMING AND NAILING NOT SPECIFICALLY DETAILED ON THE PLANS ARE TO CONFORM TO 2022 CBC TABLE 23061.2. COMMON NAILS ARE REQUIRED FOR ALL SHEARWALL, FLOOR AND ROOF DIAPHRAGMS. USE DOUBLE JOISTS UNDER PARALLEL PARTITIONS. UNJO. DOUBLED HORIZONTAL MEMBERS SHALL BE STITCH-WALLED TOGETHER WITH TWO ROWS OF 16d NAILS @ 12" O.C. STAGGERED, UNLESS OTHERWISE DETAILED. TRIPLED HORIZONTAL MEMBERS SHALL HAVE MIN. 1/2" DIAMETER BOLTS AT 18" O.C. T&G, STAGGERED.

21) ANCHOR BOLTS TO SILL AND SOLE PLATES SHALL HAVE NUTS DRIVEN FLUSH WITH SQUARE PLATE WASHERS IN ACCORDANCE WITH THE FOLLOWING SCHEDULE:

BOLT DIAMETER	PLATE SIZE
5/8"	02129" x 3" x 3"
3/4"	5/16" x 3" x 3"
1"	5/8" x 3" x 3"
1 1/8"	3/8" x 3 1/2" x 3 1/2"

THE ABOVE SCHEDULE ALSO APPLIES TO LAG SCREWS DRIVEN INTO SOLE PLATES FOR RAISED FLOOR AND UPPER STORY CONDITIONS.

22) LAG SCREWS SHALL BE INSTALLED IN PRE-DRILLED HOLES. THE CLEARANCE HOLE FOR THE SHANK PORTION SHALL HAVE THE SAME DIAMETER AND DEPTH AS THE SHANK. THE LEAD HOLE FOR THE THREADED PORTION SHALL HAVE A MINIMUM EQUAL TO 40%-100% OF THE SHANK DIAMETER FOR ALL DUAL-FIR LARCH MEMBERS). LAG SCREWS ARE TO BE INSTALLED WITH THE TURN OF A WRENCH. DRIVING, AS WITH A HAMMER, IS NOT PERMITTED.

23) MINIMUM NAILING SHALL BE PER TABLE 2304A.1 OF THE 2022 CBC.

24) ALL CONNECTORS AND METAL HARDWARE IN CONTACT WITH PRESSURE TREATED TIMBER SHALL HAVE CORROSION RESISTANT COATINGS OR PROTECTION, SUCH AS "ZMAX", HOT DIPPED GALVANIZED, OR BE STAINLESS STEEL.

STRUCTURAL STEEL

1) ALL STRUCTURAL STEEL SHALL CONFORM TO SECTION 22021 - 2022 CBC.

W-WIDE FLANGE SHAPES: ASTM A992, Fy = 50-65 KSI
PLATES, ANGLES, CHANNELS: ASTM A36, Fy = 36 KSI
HOLLOW TUBE SHAPES: ASTM A500, GRADE B, Fy = 46 KSI
ROUND PIPE SHAPES: ASTM A53, GRADE B, Fy = 36 KSI

2) ALL STRUCTURAL STEEL SHALL BE FABRICATED IN A SHOP APPROVED BY THE LOCAL MUNICIPAL BUILDING DEPARTMENT.

3) STRUCTURAL SHOP DRAWINGS SHALL BE SUBMITTED TO THE STRUCTURAL ENGINEER FOR REVIEW PRIOR TO FABRICATION.

4) ALL STRUCTURAL STEEL SHALL BE IDENTIFIED PER 2022 CBC. DESIGN OF STEEL MEMBERS SHALL BE PER ASD PROVISIONS IN THE 2022 CBC SECTION 22051 & 22052.

5) STRUCTURAL STEEL SHALL HAVE A SHOP CONT OF RED-OXIDE PRIMER.

6) AFTER ERECTION, ALL FIELD CONNECTIONS, BOLTS, WELDS, AND ALL ABRADED PLACES ON THE SHOP PAINT SHALL BE TOUCHED UP WITH THE SAME TYPE OF PAINT AS THE SHOP COAT.

7) FIELD AND SHOP WELDING SHALL BE DONE BY A FULLY CERTIFIED WELDER USING LOW-HYDROGEN E70-T4 ELECTRODE RODS, UNLESS NOTED OTHERWISE. CONTINUOUS INSPECTION BY A REGISTERED INSPECTOR IS REQUIRED FOR FIELD WELDING. ALL WELDING SHALL BE PER AWS, LATEST EDITION, AND AWS SPECIFICATIONS.

8) BOLTS SHALL BE OF A307 QUALITY WITH WASHERS, UNLESS OTHERWISE SPECIFIED ON PLANS. ANY HIGH STRENGTH A305 OR A307 BOLTS SHALL HAVE SPECIAL INSPECTION, UNLESS NOTED OTHERWISE.

9) STEEL ERECTOR SHALL PROVIDE ALL ERECTION DRAGGING REQUIRED TO MAINTAIN STRUCTURE PLUMB AND PROPERLY BRACED DURING CONSTRUCTION.

10) ALL STRUCTURAL STEEL SHALL BE DESIGNED BASED UPON THE ALLOWABLE STRESS DESIGN METHOD PER AISI 360.

ALL TIES AND STIRRUPS SHALL CONFORM TO ASTM A-495, GRADE 60 KSI STEEL.

SPICES OF REINFORCING SHALL BE LAPPED A MINIMUM OF 40 BAR DIAMETERS UNLESS SPECIFIED ON PLANS AND SECURELY WIRED TOGETHER, USING A MINIMUM OF 6 GA. WIRE. SPICES OF ADJACENT REINFORCING BARS SHALL BE STAGGERED WHEREVER POSSIBLE.

ALL TIES AND STIRRUPS SHALL CONFORM TO ASTM A-495, GRADE 60 KSI STEEL.

SPICES OF REINFORCING SHALL BE LAPPED A MINIMUM OF 40 BAR DIAMETERS UNLESS SPECIFIED ON PLANS AND SECURELY WIRED TOGETHER, USING A MINIMUM OF 6 GA. WIRE. SPICES OF ADJACENT REINFORCING BARS SHALL BE STAGGERED WHEREVER POSSIBLE.

ALL TIES AND STIRRUPS SHALL CONFORM TO ASTM A-495, GRADE 60 KSI STEEL.

SPICES OF REINFORCING SHALL BE LAPPED A MINIMUM OF 40 BAR DIAMETERS UNLESS SPECIFIED ON PLANS AND SECURELY WIRED TOGETHER, USING A MINIMUM OF 6 GA. WIRE. SPICES OF ADJACENT REINFORCING BARS SHALL BE STAGGERED WHEREVER POSSIBLE.

ALL TIES AND STIRRUPS SHALL CONFORM TO ASTM A-495, GRADE 60 KSI STEEL.

CONCRETE

1) ALL PHASES OF WORK PERTAINING TO CONCRETE CONSTRUCTION SHALL CONFORM TO 2022 CBC CHAPTER 19 (BASED ON ACI-308, LATEST ADOPTED EDITION) FOR REINFORCED CONCRETE.

2) MINIMUM ULTIMATE COMPRESSIVE CONCRETE STRENGTHS (F'c) SHALL BE:
SLAB ON GRADE: 3500 PSI @ 28 DAYS
STRUCTURAL DECK: 3000 PSI @ 28 DAYS
COLUMNS: 3000 PSI @ 28 DAYS
FOOTINGS: 3500 PSI @ 28 DAYS
CONCRETE/GRADE BEAMS: 3000 PSI @ 28 DAYS
CAISSONS: 3000 PSI @ 28 DAYS

3) CONTINUOUS INSPECTION BY AN APPROVED DEPUTY INSPECTOR IS REQUIRED FOR CAISSONS, GRADE BEAMS, STRUCTURAL SLABS, AND OTHER CONCRETE MEMBERS WHERE DESIGN COMPRESSIVE STRENGTH VALUE EXCEEDS 2500 PSI.

4) CEMENT SHALL BE TYPE II, LOW ALKALI, CONFORMING TO ASTM C-602.

5) ALL PRIMARY REINFORCEMENT SHALL BE PER ASTM A-495, GRADE 60 KSI STEEL. ALL TIES AND STIRRUPS SHALL CONFORM TO ASTM A-495, GRADE 60 KSI STEEL.

6) UNLESS NOTED OTHERWISE, SPICES OF REINFORCING SHALL BE LAPPED A MINIMUM OF 40 BAR DIAMETERS AND SECURELY WIRED TOGETHER, USING A MINIMUM OF 6 GA. WIRE. SPICES OF ADJACENT REINFORCING BARS SHALL BE STAGGERED WHEREVER POSSIBLE. WHERE SPECIFICALLY CALLED OUT, WELDING OF REINFORCING BARS SHALL BE PERFORMED BY A CERTIFIED WELDER USING E50 SERIES ELECTRODES PER AWS, LATEST EDITION.

7) INTERIOR CONCRETE SLABS ON GRADE SHALL HAVE A STEEL TROWEL FINISH. DRIVEWAYS, WALKS, AND GARAGE SLABS SHALL HAVE A BROOM FINISH AND SHALL BE FITTED TO SLED WATER.

8) PRIOR TO POURING INTERIOR CONCRETE FLOOR SLABS, ALL SOL BELOW FLOOR SHALL BE COMPACTED TO REQUIRED DENSITY AND MOISTENED TO A DEPTH NOT LESS THAN 18" PER SOILS REPORT.

9) CLEAR COVERAGE OF CONCRETE OVER REINFORCING BARS, ANCHOR BOLTS, AND ALL OTHER CONCRETE INSERTS, UNLESS OTHERWISE SPECIFIED, SHALL BE AS FOLLOWS:
FOURED AGAINST EARTH: 3" CLEAR
FORMED CONCRETE: 2" CLEAR

10) FORMS FOR CONCRETE SHALL BE LAP OUT AND CONSTRUCTED TO PROVIDE THE SPECIFIED CAMBERS SHOWN. THE FORMS' DECK CAMBERING SHOWN ON PLANS IS INTENDED TO PROVIDE A LEVEL DECK. ANY SLOPING FOR DRAINAGE SHALL BE ADDED OR SUBTRACTED FROM CAMBERING AS APPROPRIATE. THE DECK THICKNESS SHALL NOT BE REDUCED IN ORDER TO ACHIEVE DECK SLOPES.

11) DRYPACK UNDER BASEPLATES, SILL PLATES, AND WHERE OTHERWISE NOTED ON DRAWINGS SHALL CONSIST OF APPROVED NON-SHRINK HIGH STRENGTH GROUT. WHEN SPACE BETWEEN TWO SURFACES REQUIRES DRYPACK, IT SHALL BE PACKED BY TAMPING OR RAMMING WITH A BAR OR ROD UNTIL THE VOIDS ARE COMPLETELY FILLED.

12) PLACEMENT OF CONCRETE SHALL CONFORM TO ACI LATEST STANDARD AND PROJECT SPECIFICATIONS. WIRE BRUSH OR SANDPLAST ALL CONCRETE SURFACES AGAINST WHICH CONCRETE IS TO BE PLACED.

13) IF COLUMNS AND WALLS ARE PLACED WITH FLOORS, MINIMUM TIME OF TWO HOURS MUST ELAPSE BETWEEN END OF COLUMN OR WALL POUR AND BEGINNING OF FLOOR POUR.

14) PROVIDE SLEEVES FOR PLUMBING AND ELECTRICAL OPENINGS IN CONCRETE BEFORE PLACING. DO NOT CUT ANY REINFORCING WHICH MAY CONFLICT. COPIING IN CONCRETE IS NOT PERMITTED, EXCEPT AS SHOWN. NOTIFY THE PROJECT STRUCTURAL ENGINEER IN ADVANCE OF CONDITIONS NOT SHOWN ON THE STRUCTURAL DRAWINGS.

15) COVER TO BEAM REINFORCEMENT TO BE 2" MINIMUM FORMED CONCRETE & 3" MINIMUM AGAINST EARTH, UNLESS NOTED OTHERWISE.

16) ARCHITECTURAL DRAWINGS TO BE REFERRED TO FOR DECK SLOPES, DRAINAGE, PLUMBING, FRAMING AND ELECTRICAL HARDWARE & ALL DIMENSIONS.

17) REINFORCEMENT CALLED OUT IN DETAILS SHALL BE IN ADDITION TO THAT SHOWN ON PLANS (UNJO). REINFORCING METHODS SHOWN IN DETAILS SHALL BE USED AS APPLICABLE.

18) WHEN A MONOLITHIC PAIR IS NOT POSSIBLE, CONSTRUCTION JOINTS SHALL BE APPROVED BY THE PROJECT STRUCTURAL ENGINEER.

19) SHORING SHALL NOT BE REMOVED UNTIL CONCRETE HAS ACHIEVED MINIMUM 28 DAY COMPRESSIVE STRENGTH. FIFTEEN DAYS AFTER CONCRETE POUR IS COMPLETED THE PROJECT STRUCTURAL ENGINEER MAY RETEST, BASED ON COMPRESSION TESTS, IF SHORING MAY BE REMOVED.

20) ALL DECK SURFACES EXPOSED TO WEATHER SHALL BE WATERPROOFED. SEE ARCHITECTURAL DOCUMENTS FOR SPECIFICATIONS.