

CITY STANDARD ACCESSORY DWELLING UNIT
ADU: 999 L-SHAPE

CITY OF CHULA VISTA
276 FOURTH AVENUE,
CHULA VISTA, CA 91910

Release Date: 03/22/2024

Release #: A

[illegible]

SNAPADU
DESIGN HOUSE

YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 999 L-SHAPE

CITY OF CHULA VISTA
276 FOURTH AVENUE,
CHULA VISTA, CA 91910

DESIGNER:

UIS CALDERON
napADU


SIGNATURE

[illegible]

TITLE SHEET

G100

22040

1. SDGE HAS SPECIFIC REQUIREMENTS ABOUT THE NUMBER OF MAIN ELECTRICAL SERVICE PANELS (HOW MANY ELECTRICAL DROPS) ALLOWED ON THE SAME LOT, WHICH IS DIFFERENT FROM THE REQUIREMENTS OF THE CITY OF CHULA VISTA AND CALIFORNIA ELECTRICAL CODE.
2. SDGE MAY REQUIRE ALL NEW ADU(S)/JADU(S) TO BE PLACED ON A SEPARATE ELECTRIC METER.
3. IT IS THE RESPONSIBILITY OF THE PROJECT DESIGNER TO CONTACT SDGE FOR THE REQUIREMENTS FOR SETTING UP THE NEW ELECTRICAL UTILITIES TO ALL NEW ADU(S)/JADU(S).
4. REFER TO THE CURRENT SDGE SERVICE STANDARDS AND GUIDE TO ENSURE THAT PROJECT COMPLIES WITH THEIR REQUIREMENTS.

1. THE PLACEMENT OF BUILDINGS AND STRUCTURES ON OR ADJACENT TO SLOPES STEEPER THAN 1 UNIT VERTICAL IN 3 UNITS HORIZONTAL (33.3-PERCENT SLOPE) SHALL CONFORM TO SECTIONS R403.1.7.1 THROUGH R403.1.7.4.



1. DURING CONSTRUCTION, AT LEAST ONE EXTINGUISHER SHALL BE PROVIDED ON EACH FLOOR LEVEL AT EACH STAIRWAY, IN ALL STORAGE CONSTRUCTION SHEEDS IN LOCATIONS WHERE FLAMMABLE OR COMBUSTIBLE LIQUIDS ARE STORED OR USED AND WHERE OTHER SPECIAL HAZARDS ARE PRESENT PER CFC 3315.1.
2. DUMPSTERS AND TRASH CONTAINERS EXCEEDING 1.5 CUBIC YARDS SHALL NOT BE STORED IN BUILDINGS OR PLACED WITHIN 5 FEET OF COMBUSTIBLE WALLS, OPENINGS OR COMBUSTIBLE ROOF EAVE LINES UNLESS PROTECTED BY AN APPROVED SPRINKLER SYSTEM OR LOCATED IN A TYPE I OR IIA STRUCTURE SEPARATED BY A FIVE FOOT FIRE RATED WALL.
3. CONTAINERS LARGER THAN 1 CUBIC YARD SHALL BE OF NON-OR LIMITED-COMBUSTIBLE MATERIALS OR SIMILARLY PROTECTED OR SEPARATED.
4. OPEN FLAMES, FIRE, AND BURNING ON ALL PREMISES IS PROHIBITED EXCEPT AS SPECIFICALLY PERMITTED BY CFC 308.
5. NEW EXISTING ELECTRICAL AND DUCTWORK INCLUDING DETACHED ADUs ARE REQUIRED TO COMPLY WITH AGING-IN-PLACE REQUIREMENTS IN ACCORDANCE WITH CRC 327.1 ADDRESS THE FOLLOWING:
 - A. AT LEAST ONE BATHROOM ON THE ENTRY LEVEL SHALL BE PROVIDED WITH REINFORCEMENT INSTALLED IN ACCORDANCE WITH THIS SECTION.
 1. SPECIFY THE REINFORCEMENT TO BE SOLID LUMBER AND NOT LESS THAN 2X8.
 2. DIMENSION THE REINFORCEMENT SHALL BE LOCATED BETWEEN 32 - 39 1/2 INCHES ABOVE THE FINISHED FLOOR.
 3. SPECIFY THE WATER CLOSET REINFORCEMENT TO BE INSTALLED ON BOTH SIDE WALLS OF THE FLOURE, OR ONE SIDE WALL AND THE BACK WALL.(1) WHERE THE WATER CLOSET IS NOT LOCATED ADJACENT TO THE SIDE WALL, GRAB BAR REINFORCEMENT FOR A GROUND-MOUNTED INSTALLATION IS ACCEPTABLE.
 4. SPECIFY THE SHOWER REINFORCEMENT SHALL BE CONTINUOUS WHERE WALL FRAMING IS PROVIDED.
 - B. ELECTRICAL RECEPTACLE, SWITCHES AND CONTROLS INTENDED TO BE USED BY OCCUPANTS SHALL BE LOCATED NO MORE THAN 48 INCHES MEASURED FROM THE TOP OF THE OUTLET BOX AND NOT LESS THAN 15 INCHES MEASURED FROM THE BOTTOM OF THE OUTLET BOX ABOVE THE FINISH FLOOR.
 - C. SPECIFY DOORBELL CONTROLS TO BE NOT EXCEED 48 INCHES ABOVE EXTERIOR FLOOR, MEASURED FROM THE TOP OF THE DOORBELL BUTTON ASSEMBLY.

1. A PLUMBING FIXTURE CERTIFICATION MUST BE COMPLETED AND SIGNED BY EITHER A LICENSED GENERAL CONTRACTOR, A PLUMBING CONTRACTOR, OR THE BUILDING OWNER CERTIFYING THE FLOW RATE OF THE FIXTURES INSTALLED. A COPY OF THE CERTIFICATION CAN BE OBTAINED FROM THE DEVELOPMENT SERVICES DEPARTMENT.
2. ALL PLUMBING FIXTURES AND FITTINGS WILL BE WATER CONSERVING.
3. PERMANENT WATER BREAKERS SHALL BE INCLUDED WITH ALL NEW HOSE BIBBS.
4. PER CPC 402.5, 30" CLEAR WIDTH REQUIRED FOR THE WATER CLOSET COMPARTMENT AND MINIMUM 24" CLEARANCE REQUIRED IN FRONT OF THE WATER CLOSET.
5. PLUMBING FIXTURES (WATER CLOSETS AND URINALS) AND FITTINGS (FAUCETS AND SHOWERHEADS) SHALL BE INSTALLED IN ACCORDANCE WITH THE CALIFORNIA PLUMBING CODE (CPC).
6. ALL NEW RESIDENTIAL BUILDINGS (SINGLE FAMILY, DUPLEXES, OR TOWNHOMES) SHALL BE CONSTRUCTED TO INCLUDE WASTE PIPING TO DISCHARGE GRAY WATER FROM CLOTHES WASHERS TO A PLACE WHERE IT MAY BE USED FOR OUTDOOR IRRIGATION, IN COMPLIANCE WITH SECTION 1802 OF THE CALIFORNIA PLUMBING CODE.
7. OUTDOOR SHOWER DRAINS AND SINKS ARE NOT PERMITTED TO CONNECT TO THE PUBLIC SEWER SYSTEM UNLESS EQUIPPED WITH AN APPROVED COVER, HOT AND COLD WATER CONNECTIONS ALLOWED.
8. HOT WATER CONTROL VALVES IN SHOWERS, TUB/SHOWERS, BATHTUBS, AND BIDETS MUST BE PRESSURE BALANCED OR THERMOSTATIC MIXING VALVES. CPC 408, 409, 410, 411.
9. MECHANICAL EXHAUST FANS WHICH EXHAUST DIRECTLY FROM BATHROOMS SHALL COMPLY WITH THE FOLLOWING:
 - A. FANS SHALL BE ENERGY STAR COMPLIANT AND BE DUCTED TO TERMINATE OUTSIDE THE BUILDING.
 - B. UNLESS FUNCTIONING AS A COMPONENT OF A WHOLE HOUSE VENTILATION SYSTEM, FANS MUST BE CONTROLLED BY A HUMIDISTAT WHICH SHALL BE READILY ACCESSIBLE. HUMIDISTAT CONTROLS SHALL BE CAPABLE OF ADJUSTMENT BETWEEN 20% AND 80% HUMIDITY RANGE OF 50 TO 80 PERCENT.
10. FOR WATER HEATER, ADDRESS THE FOLLOWING:
 - A. PROVIDE T & P RELIEF VALVE AND SHOW TERMINATION POINT.
 - B. PROVIDE PLATFORM FOR THE WATER HEATER.
 - C. PROVIDE SEISMIC STRAPPING FOR THE WATER HEATER PER CPC 507.2.
 - a. STRAPPING SHALL BE LOCATED WITHIN THE UPPER ONE THIRD AND LOWER ONE-THIRD OF THE WATER HEATER.
 - b. AT THE LOWER POINT, A MINIMUM DISTANCE OF FOUR INCHES SHALL BE MAINTAINED ABOVE THE CONTROLS WITH THE STRAPPING.
11. HEAT PUMP WATER HEATER SHALL BE INSTALLED PER MANUFACTURER'S RECOMMENDATIONS.
12. HEAT PUMP WATER HEATER AND WATER LINES SHALL BE PROTECTED FROM FREEZING TEMPERATURES AND NOT INSTALLED IN OUTDOOR UNPROTECTED AREAS.
13. VERIFY WATER HEATER IS RATED FOR EXTERIOR INSTALLATION.
14. 150.0(T) HEAT PUMP SPACE HEATER READY. SYSTEMS USING GAS OR PROPANE FUELED TO SERVE INDIVIDUAL DWELLING UNITS SHALL INCLUDE THE FOLLOWING:
 - A. A DEDICATED 240 VOLT BRANCH CIRCUIT WIRING SHALL BE INSTALLED WITHIN 3 FEET FROM THE FURNACE AND ACCESSIBLE TO THE FURNACE WITH NO OBSTRUCTIONS. THE BRANCH CIRCUIT CONDUCTORS SHALL BE RATED AT 30 AMPS MINIMUM. THE BLANK COVER SHALL BE IDENTIFIED AS "240V READY."
 - B. THE MAIN ELECTRICAL SERVICE PANEL SHALL HAVE A RESERVED SPACE TO ALLOW FOR THE INSTALLATION OF A DOUBLE POLE CIRCUIT BREAKER FOR A FUTURE HEAT PUMP SPACE HEATER INSTALLATION. THE RESERVED SPACE SHALL BE PERMANENTLY MARKED AS "FOR FUTURE 240V USE."
15. 150.0(U) ELECTRIC COOKTOP READY. SYSTEMS USING GAS OR PROPANE COOKTOP TO SERVE INDIVIDUAL DWELLING UNITS SHALL INCLUDE THE FOLLOWING:
 - A. A DEDICATED 240 VOLT BRANCH CIRCUIT WIRING SHALL BE INSTALLED WITHIN 3 FEET FROM THE COOKTOP AND ACCESSIBLE TO THE COOKTOP WITH NO OBSTRUCTIONS. THE BRANCH CIRCUIT CONDUCTORS SHALL BE RATED AT 50 AMPS MINIMUM. THE BLANK COVER SHALL BE IDENTIFIED AS "240V READY."
 - B. THE MAIN ELECTRICAL SERVICE PANEL SHALL HAVE A RESERVED SPACE TO ALLOW FOR THE INSTALLATION OF A DOUBLE POLE CIRCUIT BREAKER FOR A FUTURE ELECTRIC COOKTOP INSTALLATION. THE RESERVED SPACE SHALL BE PERMANENTLY MARKED AS "FOR FUTURE 240V USE."
16. 150.0(V) ELECTRIC CLOTHES DRYER READY. CLOTHES DRYER LOCATIONS WITH GAS OR PROPANE PLUMBING TO SERVE INDIVIDUAL DWELLING UNITS SHALL INCLUDE THE FOLLOWING:
 - A. A DEDICATED 240 VOLT BRANCH CIRCUIT WIRING SHALL BE INSTALLED WITHIN 3 FEET FROM THE CLOTHES DRYER LOCATION AND ACCESSIBLE TO THE CLOTHES DRYER LOCATION WITH NO OBSTRUCTIONS. THE BRANCH CIRCUIT CONDUCTORS SHALL BE RATED AT 30 AMPS MINIMUM. THE BLANK COVER SHALL BE IDENTIFIED AS "240V READY."
 - B. THE MAIN ELECTRICAL SERVICE PANEL SHALL HAVE A RESERVED SPACE TO ALLOW FOR THE INSTALLATION OF A DOUBLE POLE CIRCUIT BREAKER FOR A FUTURE ELECTRIC CLOTHES DRYER INSTALLATION. THE RESERVED SPACE SHALL BE PERMANENTLY MARKED AS "FOR FUTURE 240V USE."
17. 150.0(T) SYSTEMS USING GAS OR PROPANE FUELED TO SERVE INDIVIDUAL DWELLING UNITS SHALL INCLUDE THE FOLLOWING:
 - A. A DEDICATED 240 VOLT BRANCH CIRCUIT WIRING SHALL BE INSTALLED WITHIN 3 FEET FROM THE FURNACE AND ACCESSIBLE TO THE FURNACE WITH NO OBSTRUCTIONS. THE BRANCH CIRCUIT CONDUCTORS SHALL BE RATED AT 30 AMPS MINIMUM. THE BLANK COVER SHALL BE IDENTIFIED AS "240V READY."
 - B. THE MAIN ELECTRICAL SERVICE PANEL SHALL HAVE A RESERVED SPACE TO ALLOW FOR THE INSTALLATION OF A DOUBLE POLE CIRCUIT BREAKER FOR A FUTURE HEAT PUMP SPACE HEATER INSTALLATION. THE RESERVED SPACE SHALL BE PERMANENTLY MARKED AS "FOR FUTURE 240V USE."
18. AT THE LAUNDRY CLOSET, PROVIDE MEANS OF PROVIDING COMMODITY AIR PER CM 701.4.
19. FOR WASHER/DRYER, UNLESS OTHERWISE PERMITTED OR REQUIRED BY THE CITY, MANUFACTURER'S INSTALLATION INSTRUCTIONS AND APPROVED BY THE CITY, DOMESTIC DRYER MOISTURE EXHAUST DUCTS SHALL NOT EXCEED A TOTAL COMBINED HORIZONTAL AND VERTICAL LENGTH OF FOURTEEN FEET, INCLUDING TWO 90-DEGREE ELBOWS. TWO FEET SHALL BE DEDUCTED FOR EACH 90-DEGREE ELBOW MORE THAN TWO. CM 504.4.2.

A/C	AIR CONDITIONING	LAV	LAVATORY
AC	AIR CURTAIN	L	LOUVER
AFF	ABOVE FINISHED FLOOR		
ALUM	ALUMINUM	MAX	MAXIMUM
ARCH	ARCHITECTURAL	MECH	MECHANICAL
		MTL	METAL
B	BOLLARD	MFR	MANUFACTURER
BLDG	BUILDING	MIN	MINIMUM
BLKG	BLOCKING	MWO	MICROWAVE OVEN
BTW	BETWEEN		
		N/A	NOT APPLICABLE
CAB	CABINET	(N)	NEW
CA	COMPRESSED AIR	NIC	NOT IN CONTRACT
CL	CENTER LINE	NTS	NOT TO SCALE
CLG	CEILING		
CLO.	CLOSET	OC	ON CENTER
CLR	CLEAR	o/	OVER
CMU	CONCRETE MASONRY UNIT		
CO	CLEAN OIL (PLUMBING)	P LAM	PLASTIC LAMINATE
CONC	CONCRETE	PLYWD	PLYWOOD
CONST.	CONSTRUCTION	PTW	PRESSURE TREATED WOOD
CONT.	CONTINUOUS	ℓ	PROPERTY LINE
CONTR	CONTRACTOR		
CORR	CORRIDOR	REFR.	REFRIGERATOR
		REQ'D	REQUIRED
D	DRYER	RD	ROOF DRAIN
DS	DOWNSPOUT	RDO	ROOF DRAIN OVERFLOW
DSN	DOWNSPOUT NOZZLE	RE:	REFER TO
DV	DRYER VENT	RO	ROUGH OPENING
DW	DISHWASHER		
		S/A	SUPPLY AIR
(E)	EXISTING	SIM	SIMILAR
EQ	ELECTRICAL PANEL DRAWINGS	SLD	SLOT DRAIN
EP	EQUAL	SOD	SCOUR OVERFLOW DRAIN
EQUIP	EQUIPMENT	SRD	SCUPPER ROOF DRAIN
		SUSP	SUSPENDED
FIN	FINISHED	STL	STEEL
FO	FINISHED OPENING		
FOC	FACE OF CONCRETE	T	THERMOSTAT
FOF	FACE OF FINISH	TD	TRENCH DRAIN
FOM	FACE OF MASONRY	TEL	TELEPHONE
FOS	FACE OF STUD	TY	TYPICAL
FURR	FURRED, FURRING	T.O.	TOP OF ..
		T.O.D	TOP OF DRAIN
GA	GAUGE		
GB	GRAB BAR	UNO	UNLESS NOTED OTHERWISE
GWB	GYPSUM WALL BOARD		
GYP.BD.	GYPSUM BOARD	VIF	VERIFY IN FIELD
GALV.	GALVANIZED		
		W	WASHER
HB	HOSE BIB	W/	WITH
HDWR	HARDWARE	W/O	WITHOUT
HM	HOLLOW METAL	WD	WOOD
HPW	HOT WATER - SEE PLUMBING	WH	WATER HEATER
DWGS			
HVAC	HEATING, VENTILATING, & AIR CONDITIONING		

SEE DISCIPLINE SHEETS FOR DISCIPLINE SPECIFIC SYMBOLS

A100

SHEET NUMBER

Sheet No. Sequence

Sheet Type

Discipline

PLAN NORTH TRUE NORTH

NORTH ARROW

EXTERIOR ELEVATION

Elevation No.

Sheet No.

ROOM TAG

NAME

SF Room Name

Area

DOOR TAG

D1 Door number

WINDOW TAG

W1 Window type

R000 ADDITIONAL NOTES

→ FLOW ARROW

BUILDING SECTION

Section No.

Sheet No.

DETAIL - CALLOUT

Detail No.

Sheet No.

DETAIL - SECTION

Detail No.

Sheet No.

SPOT ELEVATION MARKER

FLOOR LEVEL MARKER

Level Name

Floor Elevation

REVISION TAG

Revision Number


Revision Cloud

STAIR TAG w/ number of Risers & Riser Height

20 R @ 7 1/2"



DESIGNER:
LUIS CALDERON
SnapADU


SIGNATURE

[illegible]

G101

22040

CODE COMPLIANCE NOTES

EXCERPTS FROM THE 2022 CALIFORNIA RESIDENTIAL CODE

CHAPTER 3 - BUILDING PLANNING

R302 FIRE-RESISTANT CONSTRUCTION

R302.1 EXTERIOR WALLS
CONSTRUCTION, PROJECTIONS, OPENINGS AND PENETRATIONS OF EXTERIOR WALLS OF DWELLINGS AND ACCESSORY BUILDINGS SHALL COMPLY WITH TABLE R302.1(1). OR DWELLINGS AND ACCESSORY BUILDINGS EQUIPPED THROUGHOUT WITH AN AUTOMATIC SPRINKLER SYSTEM INSTALLED IN ACCORDANCE WITH SECTION R313 SHALL COMPLY WITH TABLE R302.1(2).

R302.2 DWELLING-GARAGE OPENING AND PENETRATION PROTECTION
OPENINGS AND PENETRATIONS THROUGH THE WALLS OR CEILINGS SEPARATING THE DWELLING FROM THE GARAGE SHALL BE IN ACCORDANCE WITH SECTIONS R302.5.1 THROUGH R302.5.3.

R302.6 DWELLING/GARAGE AND/OR CARPORT FIRE SEPARATION
THE GARAGE AND/OR CARPORT SHALL BE SEPARATED AS REQUIRED BY TABLE R302.6. OPENINGS IN GARAGE WALLS SHALL COMPLY WITH SECTION R302.5. ATTACHMENT OF GYPSUM BOARD SHALL COMPLY WITH TABLE R702.3.5. THE WALL SEPARATION PROVISIONS OF TABLE R302.6 SHALL NOT APPLY TO GARAGE WALLS THAT ARE PERPENDICULAR TO THE ADJACENT DWELLING UNIT WALL. A SEPARATION IS NOT REQUIRED BETWEEN THE DWELLING UNIT AND A CARPORT, PROVIDED THE CARPORT IS ENTIRELY OPEN ON TWO OR MORE SIDES AND THERE ARE NOT ENCLOSED AREAS ABOVE.

R302.7 UNDER-STAIR PROTECTION
ENCLOSED SPACE UNDER STAIRS THAT IS ACCESSED BY A DOOR OR ACCESS PANEL SHALL HAVE WALLS, UNDER-STAIR SURFACE AND ANY SOFFITS PROTECTED ON THE ENCLOSED SIDE WITH 1/2-INCH (12.7 MM) GYPSUM BOARD.

R302.11 FIREBLOCKING
IN COMBUSTIBLE CONSTRUCTION, FIREBLOCKING SHALL BE PROVIDED TO CUT OFF BOTH VERTICAL AND HORIZONTAL CONCEALED DRAFT OPENINGS AND TO FORM AN EFFECTIVE FIRE BARRIER BETWEEN STORIES, AND BETWEEN A TOP STORY AND THE ROOF SPACE.

FIREBLOCKING SHALL BE PROVIDED IN WOOD-FRAMED CONSTRUCTION IN THE FOLLOWING LOCATIONS:

- IN CONCEALED SPACES OF STUD WALLS AND PARTITIONS, INCLUDING FURRED SPACES AND PARALLEL ROWS OF STUDS OR STAGGERED STUDS, AS FOLLOWS:
 - VERTICALLY AT THE CEILING AND FLOOR LEVELS.
 - HORIZONTALLY AT INTERVALS NOT EXCEEDING 10 FEET (3048 MM).
- AT INTERCONNECTIONS BETWEEN CONCEALED VERTICAL AND HORIZONTAL SPACES SUCH AS OCCUR AT SOFFITS, DROP CEILINGS AND COVE CEILINGS.
- IN CONCEALED SPACES BETWEEN STAIR STRINGERS AT THE TOP AND BOTTOM OF THE RUN. ENCLOSED SPACES UNDER STAIRS SHALL COMPLY WITH SECTION R302.7.
- AT OPENINGS AROUND VENTS, PIPES, DUCTS, CABLES AND WIRES AT CEILING AND FLOOR LEVEL, WITH AN APPROVED MATERIAL, TO RESIST THE FREE PASSAGE OF FLAME AND PRODUCTS OF COMBUSTION. THE MATERIAL FILLING THIS ANNULAR SPACE SHALL NOT BE REQUIRED TO MEET THE ASTM E136 REQUIREMENTS.
- FOR THE FIREBLOCKING OF CHIMNEYS AND FIREPLACES, SEE SECTION R1003.19.
- FIREBLOCKING OF CORNICES OF A TWO-FAMILY DWELLING IS REQUIRED AT THE LINE OF DWELLING UNIT SEPARATION.

R303 LIGHT, VENTILATION AND HEATING

R303.1 HABITABLE ROOMS
HABITABLE ROOMS SHALL HAVE AN AGGREGATE GLAZING AREA OF NOT LESS THAN 8 PERCENT OF THE FLOOR AREA OF SUCH ROOMS. NATURAL VENTILATION SHALL BE THROUGH WINDOWS, DOORS, LOUVERS OR OTHER APPROVED OPENINGS TO THE OUTDOOR AIR. SUCH OPENINGS SHALL BE PROVIDED WITH READY ACCESS OR SHALL OTHERWISE BE READILY CONTROLLABLE BY THE BUILDING OCCUPANTS. THE OPENABLE AREA TO THE OUTDOORS SHALL BE NOT LESS THAN 4 PERCENT OF THE FLOOR AREA BEING VENTILATED.

R303.2 ADJOINING ROOMS
FOR THE PURPOSE OF DETERMINING LIGHT AND VENTILATION REQUIREMENTS, ROOMS SHALL BE CONSIDERED TO BE A PORTION OF AN ADJOINING ROOM WHERE NOT LESS THAN ONE-HALF OF THE AREA OF THE COMMON WALL IS OPEN AND UNOBSTRUCTED AND PROVIDES AN OPENING OF NOT LESS THAN ONE-TENTH OF THE FLOOR AREA OF THE INTERIOR ROOM AND NOT LESS THAN 25 SQUARE FEET (2.3 M2).

R307 TOILET, BATH AND SHOWER SPACES

R307.2 BATHTUB AND SHOWER SPACES
BATHTUB AND SHOWER FLOORS AND WALLS ABOVE BATHTUBS WITH INSTALLED SHOWER HEADS AND IN SHOWER COMPARTMENTS SHALL BE FINISHED WITH A NONABSORBENT SURFACE. SUCH WALL SURFACES SHALL EXTEND TO A HEIGHT OF NOT LESS THAN 6 FEET (1829 MM) ABOVE THE FLOOR.

R308 GLAZING

R308.1 IDENTIFICATION
EXCEPT AS INDICATED IN SECTION R308.1.1, EACH PANE OF GLAZING INSTALLED IN HAZARDOUS LOCATIONS AS DEFINED IN SECTION R308.4 SHALL BE PROVIDED WITH A MANUFACTURER'S DESIGNATION SPECIFYING WHO APPLIED THE DESIGNATION. THE TYPE OF GLAZING AND THE SAFETY OF GLAZING STANDARD WITH WHICH IT COMPLES, AND THAT IS VISIBLE IN THE FINAL INSTALLATION, THE DESIGNATION SHALL BE ACRYL ETCHED, SANDBLASTED, CERAMIC-FIRED, LASER ETCHED, EMBOSSED, OR BE OF A TYPE THAT ONCE APPLIED CANNOT BE REMOVED WITHOUT BEING DESTROYED. A LABEL SHALL BE PERMITTED IN LIEU OF THE MANUFACTURER'S DESIGNATION.

R308.4 HAZARDOUS LOCATIONS
THE LOCATIONS SPECIFIED IN SECTIONS R308.4.1 THROUGH R308.4.7 SHALL BE CONSIDERED TO BE SPECIFIC HAZARDOUS LOCATIONS FOR THE PURPOSES OF GLAZING.

R310 EMERGENCY ESCAPE AND RESCUE OPENINGS

R310.2.1 MINIMUM SIZE
EMERGENCY ESCAPE AND RESCUE OPENINGS SHALL HAVE A NET CLEAR OPENING OF NOT LESS THAN 5.7 SQUARE FEET (0.530 M2).

R310.2.2 MINIMUM DIMENSIONS

THE MINIMUM NET CLEAR OPENING HEIGHT DIMENSION SHALL BE 24 INCHES (610 MM). THE MINIMUM NET CLEAR OPENING WIDTH DIMENSION SHALL BE 20 INCHES (508 MM). THE NET CLEAR OPENING DIMENSIONS SHALL BE THE RESULT OF NORMAL OPERATION OF THE OPENING.

R310.2.3 WINDOW SILL HEIGHT
WHERE A WINDOW IS PROVIDED AS THE EMERGENCY ESCAPE AND RESCUE OPENING, IT SHALL HAVE THE BOTTOM OF THE CLEAR OPENING NOT GREATER THAN 44 INCHES (1118 MM) MEASURED FROM THE FLOOR.

R310.4 AREA WELLS
AN EMERGENCY ESCAPE AND RESCUE OPENING WHERE THE BOTTOM OF THE CLEAR OPENING IS BELOW THE ADJACENT GRADE SHALL BE PROVIDED WITH AN AREA WELL IN ACCORDANCE WITH SECTIONS R310.4.1 THROUGH R310.4.4.

R311 MEANS OF EGRESS

R311.3 FLOORS AND LANDINGS AT EXTERIOR DOORS
THERE SHALL BE A LANDING OR FLOOR ON EACH SIDE OF EACH EXTERIOR DOOR. THE WIDTH OF EACH LANDING SHALL BE NOT LESS THAN THE DOOR SWEPT. LANDINGS SHALL HAVE A DIMENSION OF NOT LESS THAN 36 INCHES (914 MM) MEASURED IN THE DIRECTION OF TRAVEL. THE SLOPE AT EXTERIOR LANDINGS SHALL NOT EXCEED 1/4 INCH VERTICAL, IN 12 UNITS HORIZONTAL (2 PERCENT).

R311.3.1 FLOOR ELEVATIONS AT THE REQUIRED EGRESS DOORS
LANDINGS OR FINISHED FLOORS AT THE REQUIRED EGRESS DOOR SHALL BE NOT MORE THAN 1 1/2 INCHES (38 MM) LOWER THAN THE TOP OF THE THRESHOLD.

EXCEPTION: THE LANDINGS OR FLOOR ON THE EXTERIOR SIDE SHALL BE NOT MORE THAN 7 3/4 INCHES (196 MM) BELOW THE TOP OF THE THRESHOLD PROVIDED THAT THE DOOR DOES NOT SWING OVER THE LANDING OR FLOOR.

WHERE EXTERIOR LANDINGS OR FLOORS SERVING THE REQUIRED EGRESS DOOR ARE NOT AT GRADE, THEY SHALL BE PROVIDED WITH ACCESS TO GRADE BY MEANS OF A RAMP IN ACCORDANCE WITH SECTION R311.8 OR A STAIRWAY IN ACCORDANCE WITH SECTION R311.7.

CHAPTER 3 - BUILDING PLANNING (CON'T)

R314 SMOKE ALARMS

- R314.3 LOCATION
SMOKE ALARMS SHALL BE INSTALLED IN THE FOLLOWING LOCATIONS:
- IN EACH SLEEPING ROOM.
 - OUTSIDE EACH SEPARATE SLEEPING AREA IN THE IMMEDIATE VICINITY OF THE BEDROOMS.
 - ON EACH ADDITIONAL STORY OF THE DWELLING, INCLUDING BASEMENTS AND HABITABLE ATTICS AND NOT INCLUDING CRAWL SPACES AND UNINHABITABLE ATTICS. IN DWELLINGS OR DWELLING UNITS WITH SPLIT LEVELS AND WITHOUT AN INTERVENING DOOR BETWEEN THE ADJACENT LEVELS, A SMOKE ALARM INSTALLED ON THE UPPER LEVEL SHALL SUFFICE FOR THE ADJACENT LOWER LEVEL PROVIDED THAT THE LOWER LEVEL IS LESS THAN ONE FULL STORY BELOW THE UPPER LEVEL.
 - SMOKE ALARMS SHALL BE INSTALLED NOT LESS THAN 3 FEET (914 MM) HORIZONTALLY FROM THE DOOR OR OPENING OF A BATHROOM THAT CONTAINS A BATHTUB OR SHOWER UNLESS THIS WOULD PREVENT PLACEMENT OF A SMOKE ALARM REQUIRED BY THIS SECTION.
 - IN THE HALLWAY AND IN THE ROOM OPEN TO THE HALLWAY IN DWELLING UNITS WHERE THE CEILING HEIGHT OF A ROOM OPEN TO A HALLWAY SERVING BEDROOMS EXCEEDS THAT OF THE HALLWAY BY 24 INCHES (610 MM) OR MORE.

R316 CARBON MONOXIDE ALARMS

- R316.3 LOCATION
CARBON MONOXIDE ALARMS IN DWELLING UNITS SHALL BE INSTALLED AND MAINTAINED IN ACCORDANCE WITH THE MANUFACTURER'S PUBLISHED INSTRUCTIONS IN THE FOLLOWING LOCATIONS:
- OUTSIDE OF EACH SEPARATE SLEEPING AREA IN THE IMMEDIATE VICINITY OF THE BEDROOMS.
 - ON EVERY OCCUPABLE LEVEL OF A DWELLING UNIT, INCLUDING BASEMENTS.
 - WHERE A FUEL-BURNING APPLIANCE IS LOCATED WITHIN A BEDROOM OR ITS ATTACHED BATHROOM, A CARBON MONOXIDE ALARM SHALL BE INSTALLED WITHIN THE BEDROOM.

R316 FOAM PLASTIC

R316.4 THERMAL BARRIER
UNLESS OTHERWISE ALLOWED IN SECTION R316.5, FOAM PLASTIC SHALL BE SEPARATED FROM THE INTERIOR OF A BUILDING BY AN APPROVED THERMAL BARRIER OF NOT LESS THAN 1/2-INCH (12.7 MM) GYPSUM WALLBOARD, 23/32-INCH (18.2 MM) WOOD STRUCTURAL PANEL, OR A MATERIAL THAT IS TESTED IN ACCORDANCE WITH AND MEETS THE ACCEPTANCE CRITERIA OF BOTH THE TEMPERATURE TRANSMISSION FIRE TEST AND THE INTEGRITY FIRE TEST OF NFPA 275.

R318 PROTECTION AGAINST SUBTERRANEAN TERMITES

R318.4 FOAM PLASTIC PROTECTION
IN AREAS WHERE THE PROBABILITY OF TERMITE INFESTATION IS "CONVEYED HEAVY" AS INDICATED IN FIGURE R318.4, FOAM PLASTIC SHALL BE INSTALLED ON THE EXTERIOR FACE OF UNDER INTERIOR OR EXTERIOR FOUNDATION WALLS OR SLAB FOUNDATIONS LOCATED BELOW GRADE. THE CLEARANCE BETWEEN FOAM PLASTICS INSTALLED ABOVE GRADE AND EXPOSED EARTH SHALL BE NOT LESS THAN 6 INCHES (152 MM).

EXCEPTIONS: BUILDINGS WHERE THE STRUCTURAL MEMBERS OF WALLS, FLOORS, CEILINGS AND ROOFS ARE ENTIRELY OF NONCOMBUSTIBLE MATERIALS OR PRESSURE-PRESERVATIVE-TREATED WOOD.

WHERE IN ADDITION TO THE REQUIREMENTS OF SECTION R318.1, AN APPROVED METHOD OF PROTECTING THE FOAM PLASTIC AND STRUCTURE FROM SUBTERRANEAN TERMITE DAMAGE IS USED ON THE INTERIOR SIDE OF BASEMENT WALLS.

CHAPTER 4 - FOUNDATIONS

R401 GENERAL

R401.3 DRAINAGE
SURFACE DRAINAGE SHALL BE DIVERTED TO A STORM SEWER CONVEYANCE OR OTHER APPROVED POINT OF COLLECTION THAT DOES NOT CREATE A HAZARD. LOTS SHALL BE GRADED TO DRAIN SURFACE WATER AWAY FROM FOUNDATION WALLS. THE GRADE SHALL FALL NOT FEWER THAN 6 INCHES (152 MM) WITHIN THE FIRST 10 FEET.

* SURFACE WATER MUST BE MOVING AWAY FROM THE BUILDING AND ADJACENT PROPERTIES AND TOWARDS THE PUBLIC WAY.

EXCEPTION: WHERE LOT LINES, WALLS, SLOPES OR OTHER PHYSICAL BARRIERS PROHIBIT 6 INCHES (152 MM) OF FLOOD WITHIN 10 FEET (3048 MM), DRAINS OR SWALES SHALL BE CONSTRUCTED TO ENSURE DRAINAGE AWAY FROM THE STRUCTURE. IMPERVIOUS SURFACES WITHIN 10 FEET (3048 MM) OF THE BUILDING FOUNDATION SHALL BE SLOPED NOT LESS THAN 2 PERCENT AWAY FROM THE BUILDING.

CHAPTER 7 - WALL COVERING

R702 INTERIOR COVERING

R702.3.7 WATER-RESISTANT GYPSUM BACKING BOARD
GYPSUM BOARD USED AS THE BASE OR BACKER FOR ADHESIVE APPLICATION OF CERAMIC TILE OR OTHER REQUIRED NONABSORBENT FINISH MATERIAL SHALL CONFORM TO ASTM C1178, C1278 OR C1396. USE OF WATER-RESISTANT GYPSUM BACKING BOARD SHALL BE PERMITTED ON CEILINGS. WATER-RESISTANT GYPSUM BOARD SHALL NOT BE INSTALLED OVER A CLASS I OR I VAPOR RETARDER IN A SHOWER OR TUB COMPARTEMENT, CUT OR EXPOSED EDGES, INCLUDING THOSE AT WALL INTERSECTIONS. SHALL BE SEALED AS RECOMMENDED BY THE MANUFACTURER.

R702.4 BACKER BOARDS

MATERIALS USED AS BACKERS FOR WALL TILE IN TUB AND SHOWER AREAS AND WALL PANELS IN SHOWER AREAS SHALL BE OF MATERIALS LISTED IN TABLE R702.4.2, AND INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS.

R703 EXTERIOR COVERING

R703.4 FLASHING
APPROVED CORROSION-RESISTANT FLASHING SHALL BE APPLIED SHINGLE-FASHION IN A MANNER TO PREVENT ENTRY OF WATER INTO THE WALL CAVITY OR PENETRATION OF WATER TO THE BUILDING STRUCTURE. FLASHING SHALL BE SELF-ADHERED MEMBRANES USED AS FLASHING SHALL COMPLY WITH AAMA 711. FLUID-APPLIED MEMBRANES USED AS FLASHING IN EXTERIOR WALLS SHALL COMPLY WITH AAMA 714. THE FLASHING SHALL EXTEND TO THE SURFACE OF THE EXTERIOR WALL FINISH. APPROVED CORROSION-RESISTANT FLASHINGS SHALL BE INSTALLED AT THE FOLLOWING LOCATIONS:

- EXTERIOR WINDOW AND DOOR OPENINGS. FLASHING AT EXTERIOR WINDOW AND DOOR OPENINGS SHALL EXTEND TO THE SURFACE OF THE EXTERIOR WALL FINISH OR TO THE WATER-RESISTIVE BARRIER COMPLYING WITH SECTION 703.2 FOR SUBSEQUENT DRAINAGE. MECHANICALLY ATTACHED FLEXIBLE FLASHINGS SHALL COMPLY WITH AAMA 712. FLASHING AT EXTERIOR WINDOW AND DOOR OPENINGS SHALL BE INSTALLED IN ACCORDANCE WITH ONE OR MORE OF THE FOLLOWING:
 - THE PENETRATION MANUFACTURER'S INSTALLATION AND FLASHING INSTRUCTIONS, OR FOR APPLICATIONS NOT ADDRESSED IN THE PENETRATION MANUFACTURER'S INSTRUCTIONS, IN ACCORDANCE WITH THE FLASHING MANUFACTURER'S INSTRUCTIONS. FLASHING INSTRUCTIONS OR DETAILS ARE NOT PROVIDED, PAN FLASHING SHALL BE INSTALLED AT THE SILL OF EXTERIOR WINDOW AND DOOR OPENINGS. PAN FLASHING SHALL BE SEALED OR SLOPED IN SUCH A MANNER AS TO DIRECT WATER TO THE SURFACE OF THE EXTERIOR WALL FINISH OR TO THE WATER RESISTIVE BARRIER FOR SUBSEQUENT DRAINAGE. OPENINGS USING PAN FLASHING SHALL INCORPORATE FLASHING OR PROTECTION AT THE HEAD AND SIDES.
 - IN ACCORDANCE WITH THE FLASHING DESIGN OR METHOD OF A REGISTERED DESIGN PROFESSIONAL.
 - IN ACCORDANCE WITH OTHER APPROVED METHODS.
- AT THE INTERSECTION OF CHIMNEYS OR OTHER MASONRY CONSTRUCTION WITH FRAME OR STUCCO WALLS, WITH PROJECTING LIPS ON BOTH SIDES UNDER STUCCO COPINGS.
- UNDER AND AT THE ENDS OF MASONRY, WOOD OR METAL COPINGS AND SILLS.
- CONTINUOUSLY ABOVE ALL PROJECTING WOOD TRIM.
- WHERE EXTERIOR PORCHES, DECKS OR STAIRS ATTACH TO A WALL OR FLOOR ASSEMBLY OF WOOD-FRAME CONSTRUCTION.
- AT WALL AND ROOF INTERSECTIONS.
- AT BUILT-IN GUTTERS.

R703.7.1 WEEP SCREENS

A MINIMUM 0.019-INCH (0.5 MM) (NO. 26 GALVANIZED SHEET GAGE) CORROSION-RESISTANT WEEP SCREEN OR PLASTIC WEEP SCREEN, WITH A MINIMUM VERTICAL ATTACHMENT FLANGE OF 3/12 INCHES (89 MM), SHALL BE PROVIDED AT OR BELOW THE FOUNDATION PLATE LINE ON EXTERIOR STUD WALLS IN ACCORDANCE WITH ASTM C926. THE WEEP SCREEN SHALL BE PLACED NOT LESS THAN 4 INCHES (102 MM) ABOVE THE EARTH OR 2 INCHES (51 MM) ABOVE THE FINISHED GRADE AND SHALL BE OF A TYPE THAT WILL ALLOW TRAPPED WATER TO DRAIN TO THE EXTERIOR OF THE BUILDING. THE WEATHER-RESISTANT BARRIER SHALL LAP THE ATTACHMENT FLANGE. THE EXTERIOR LATH SHALL COVER AND TERMINATE ON THE ATTACHMENT FLANGE OF THE WEEP SCREEN.

CHAPTER 7 - WALL COVERING (CON'T)

R703.10.1 PANEL SIDING

FIBER-CEMENT PANELS SHALL COMPLY WITH THE REQUIREMENTS OF ASTM C1186, TYPE A, MINIMUM GRADE II OR ISO 8336, CATEGORY A. MINIMUM CLASS 2. PANELS SHALL BE INSTALLED WITH THE LONG DIMENSION EITHER PARALLEL OR PERPENDICULAR TO FRAMING. VERTICAL AND HORIZONTAL JOINTS SHALL OCCUR OVER FRAMING MEMBERS AND SHALL BE PROTECTED WITH CAULKING, OR WITH BATTENS OR FLASHING, OR BE VERTICAL OR HORIZONTAL SHIP LAP, OR OTHERWISE DESIGNED TO COMPLY WITH SECTION R703.1. PANEL SIDING SHALL BE INSTALLED WITH FASTENERS IN ACCORDANCE WITH TABLE R703.3(1) OR THE APPROVED MANUFACTURER'S INSTRUCTIONS.

R703.10.2 LAP SIDING

FIBER-CEMENT LAP SIDING HAVING A MAXIMUM WIDTH OF 12 INCHES (305 MM) SHALL COMPLY WITH THE REQUIREMENTS OF ASTM C1186, TYPE A, MINIMUM GRADE II OR ISO 8336, CATEGORY A, MINIMUM CLASS 2. LAP SIDING SHALL BE LAPPED A MINIMUM OF 1 1/4 INCHES (32 MM) AND LAP SIDING NOT HAVING TONGUE-AND-GROOVE END JOINTS SHALL HAVE THE ENDS PROTECTED WITH CAULKING, COVERED WITH AN IN-SECTION JOINT COVER, LOCATED OVER A STRIP OF FLASHING, OR SHALL BE DESIGNED TO COMPLY WITH SECTION R703.1. LAP SIDING COURSES SHALL BE INSTALLED WITH THE FASTENER EDGES EXPOSED OR CONCEALED. IN ACCORDANCE WITH TABLE R703.3(1) OR APPROVED MANUFACTURER'S INSTRUCTIONS.

CHAPTER 8 - ROOF-CEILING CONSTRUCTION

R806 ROOF VENTILATION

R806.2 MINIMUM VENT AREA
THE MINIMUM NET FREE VENTILATING AREA SHALL BE 1/150 OF THE AREA OF THE VENTED SPACE.

EXCEPTION: THE MINIMUM NET FREE VENTILATION AREA SHALL BE 1/300 OF THE VENTED SPACE PROVIDED BOTH OF THE FOLLOWING CONDITIONS ARE MET:

- IN CLIMATE ZONES 7, 8 AND 8, A CLASS I OR I VAPOR RETARDER IS INSTALLED ON THE WARM-IN-WINTER SIDE OF THE CEILING.
- NOT LESS THAN 40 PERCENT AND NOT MORE THAN 50 PERCENT OF THE REQUIRED VENTILATING AREA IS PROVIDED BY VENTILATORS LOCATED IN THE UPPER PORTION OF THE ATTIC OR RAFTER SPACE. UPPER VENTILATORS SHALL BE LOCATED NOT MORE THAN 3 FEET (914 MM) BELOW THE RIDGE OR HIGHEST POINT OF THE SPACE, MEASURED VERTICALLY. THE BALANCE OF THE REQUIRED VENTILATION PROVIDED SHALL BE LOCATED IN THE BOTTOM ONE-THIRD OF THE ATTIC SPACE WHERE THE LOCATION OF WALL OR ROOF FRAMING MEMBERS CONFLICTS WITH THE INSTALLATION OF UPPER VENTILATORS. INSTALLATION MORE THAN 3 FEET (914 MM) BELOW THE RIDGE OR HIGHEST POINT OF THE SPACE SHALL BE PERMITTED.

R807.1 ATTIC ACCESS

BUILDINGS WITH COMBUSTIBLE CEILING OR ROOF CONSTRUCTION SHALL HAVE AN ATTIC ACCESS OPENING TO ATTIC AREAS THAT HAVE A VERTICAL HEIGHT OF 30 INCHES (762 MM) OR GREATER OVER AN AREA OF NOT LESS THAN 30 SQUARE FEET (2.8 M2). THE VERTICAL HEIGHT SHALL BE MEASURED FROM THE TOP OF THE CEILING FRAMING MEMBERS TO THE UNDERSIDE OF THE ROOF FRAMING MEMBERS.

THE ROUGH-FRAMED OPENING SHALL BE NOT LESS THAN 22 INCHES BY 30 INCHES (559 MM BY 762 MM) AND SHALL BE LOCATED IN A HALLWAY OR OTHER LOCATION WITH READY ACCESS, WHERE LOCATED IN A WALL, THE OPENING SHALL BE NOT LESS THAN 22 INCHES WIDE BY 30 INCHES HIGH (559 MM WIDE BY 762 MM HIGH). WHERE THE ACCESS IS LOCATED IN A CEILING, MINIMUM UNOBSTRUCTED HEADROOM IN THE ATTIC SPACE SHALL BE 30 INCHES (762 MM) AT SOME POINT ABOVE THE ACCESS MEASURED VERTICALLY FROM THE BOTTOM OF CEILING FRAMING MEMBERS. SEE THE CALIFORNIA MECHANICAL CODE FOR ACCESS REQUIREMENTS WHERE MECHANICAL EQUIPMENT IS LOCATED IN ATTICS.

EXCERPTS FROM THE 2022 CALIFORNIA MECHANICAL CODE

CHAPTER 3 - GENERAL REGULATIONS

M304.4 ACCESSIBILITY FOR SERVICE

M304.4.1 APPLIANCE UNDER-FLOOR SPACE
AN ATTIC OR UNDER-FLOOR SPACE IN WHICH AN APPLIANCE IS INSTALLED SHALL BE ACCESSIBLE THROUGH AN OPENING AND PASSAGEWAY NOT LESS THAN THE LARGEST COMPONENT OF THE APPLIANCE, AND NOT LESS THAN 22 INCHES BY 30 INCHES (559 MM BY 762 MM).

M304.4.1 LENGTH OF PASSAGEWAY

WHERE THE HEIGHT OF THE PASSAGEWAY IS LESS THAN 6 FEET (1829 MM), THE DISTANCE FROM THE PASSAGEWAY ACCESS TO THE APPLIANCE SHALL NOT EXCEED 20 FEET (6096 MM) MEASURED ALONG THE CENTERLINE OF THE PASSAGEWAY. [NFPA 54 9.5.1.2]

M304.4.2 WIDTH OF PASSAGEWAY

THE PASSAGEWAY SHALL BE UNOBSTRUCTED AND SHALL HAVE SOLID FLOORING NOT LESS THAN 24 INCHES (610 MM) WIDE FROM THE ENTRANCE OPENING TO THE APPLIANCE. [NFPA 54 9.5.1.2]

M304.4.3 WORK PLATFORM

A LEVEL WORKING PLATFORM NOT LESS THAN 30 INCHES BY 30 INCHES (762 MM BY 762 MM) SHALL BE PROVIDED IN FRONT OF THE SERVICE SIDE OF THE APPLIANCE. [NFPA 54 9.5.2]

EXCEPTION: A WORKING PLATFORM NEED NOT BE PROVIDED WHERE THE FURNACE IS CAPABLE OF BEING SERVICED FROM THE REQUIRED ACCESS OPENING. THE FURNACE SERVICE SIDE SHALL NOT EXCEED 12 INCHES (305 MM) FROM THE ACCESS OPENING.

M304.4.1 LIGHTING AND CONVENIENCE OUTLET

A PERMANENT 120V RECEPTACLE OUTLET AND A LIGHTING FIXTURE SHALL BE INSTALLED NEAR THE APPLIANCE. THE SWITCH CONTROLLING THE LIGHTING FIXTURE SHALL BE LOCATED AT THE ENTRANCE TO THE PASSAGEWAY. [NFPA 54 9.5.3]

CHAPTER 5 - EXHAUST SYSTEMS

M504.0 ENVIRONMENTAL AIR DUCTS

M504.0.1 CLOTHES DRYERS
A CLOTHES DRYER EXHAUST DUCT SHALL NOT BE CONNECTED TO A VENT CONNECTOR, GAS VENT, CHIMNEY, AND SHALL NOT TERMINATE INTO A CRAWL SPACE, ATTIC, OR OTHER CONCEALED SPACE. EXHAUST DUCTS SHALL NOT BE ASSEMBLED WITH SCREWS OR OTHER FASTENING MEANS THAT EXTEND INTO THE DUCT AND THAT ARE CAPABLE OF CATCHING LINT, AND THAT REDUCE THE EFFICIENCY OF THE EXHAUST SYSTEM. EXHAUST DUCTS SHALL BE CONSTRUCTED OF RIGID METALLIC MATERIAL. TRANSITION DUCTS USED TO CONNECT THE DRYER TO THE EXHAUST DUCT SHALL BE LISTED AND LABELED IN ACCORDANCE WITH UL 2158A, OR INSTALLED IN ACCORDANCE WITH THE CLOTHES DRYER MANUFACTURER'S INSTALLATION INSTRUCTIONS. CLOTHES DRYER EXHAUST DUCTS SHALL TERMINATE TO THE OUTSIDE OF THE BUILDING IN ACCORDANCE WITH SECTION 502.2.1 AND SHALL BE EQUIPPED WITH A BACKDRAFT DAMPER. SCREENS SHALL NOT BE INSTALLED AT THE DUCT TERMINATION DEVICES, SUCH AS FIRE OR SMOKE DAMPERS THAT WILL OBSTRUCT THE FLOW OF THE EXHAUST SHALL NOT BE USED. WHERE JOINING OF DUCTS, THE MALE END SHALL BE INSERTED IN THE DIRECTION OF FLOW.

M504.4.1 PROVISIONS FOR MAKEUP AIR

MAKEUP AIR SHALL BE PROVIDED IN ACCORDANCE WITH THE FOLLOWING:

- MAKEUP AIR SHALL BE PROVIDED FOR TYPE 1 CLOTHES DRYERS IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS. [NFPA 54 10.4.3.1] WHERE A CLOSET IS DESIGNED FOR THE INSTALLATION OF A CLOTHES DRYER, AN OPENING OF NOT LESS THAN 100 SQUARE INCHES (0.0065 M2) FOR MAKEUP AIR SHALL BE PROVIDED IN THE DOOR OR BY OTHER APPROVED MEANS.
- PROVISION FOR MAKEUP AIR SHALL BE PROVIDED FOR TYPE 2 CLOTHES DRYERS, WITH A FREE AREA OF NOT LESS THAN 1 SQUARE INCH (0.0006 M2) FOR EACH 1000 BRITISH THERMAL UNITS PER HOUR (BTUH) (0.293 KW) TOTAL INPUT RATING OF THE DRYER(S) INSTALLED. [NFPA 54 10.4.3.2]

M504.4.2 DOMESTIC CLOTHES DRYERS

WHERE A COMPARTMENT OR SPACE FOR A TYPE 1 CLOTHES DRYER IS PROVIDED, NOT LESS THAN A 4 INCH DIAMETER (102 MM) EXHAUST DUCT OF APPROVED MATERIAL SHALL BE INSTALLED IN ACCORDANCE WITH SECTION 504.0.

TYPE 1 CLOTHES DRYER EXHAUST DUCTS SHALL BE OF RIGID METAL AND SHALL HAVE SMOOTH INTERIOR SURFACES. THE DIAMETER SHALL BE NOT LESS THAN 4 INCHES NOMINAL (100 MM), AND THE THICKNESS SHALL BE NOT LESS THAN 0.016 OF AN INCH (0.406 MM).

CHAPTER 5 - EXHAUST SYSTEMS (CON'T)

M504.4.2.1 LENGTH LIMITATION

UNLESS OTHERWISE PERMITTED OR REQUIRED BY THE DRYER MANUFACTURER'S INSTRUCTIONS AND APPROVED BY THE AUTHORITY HAVING JURISDICTION, DOMESTIC DRYER MOISTURE EXHAUST DUCTS SHALL NOT EXCEED A TOTAL COMBINED HORIZONTAL AND VERTICAL LENGTH OF 14 FEET (4267 MM), INCLUDING TWO 90 DEGREE (1.57 RAD) ELBOWS. A LENGTH OF 2 FEET (610 MM) SHALL BE DEDUCTED FOR EACH 90 DEGREE (1.57 RAD) ELBOW IN EXCESS OF TWO.

EXCEPTION: WHERE AN EXHAUST DUCT POWER VENTILATOR, IN ACCORDANCE WITH SECTION 504.4.2.3, IS USED, THE MAXIMUM LENGTH OF THE DRYER EXHAUST DUCT SHALL BE PERMITTED TO EXCEED THE MAXIMUM LENGTH OF THE DRYER EXHAUST DUCT POWER VENTILATOR MANUFACTURER'S INSTALLATION INSTRUCTIONS.

CHAPTER 11 - REFRIGERATION

M1105.0 GENERAL REQUIREMENTS

M1105.2 SUPPORTS AND ANCHORAGE
SUPPORTS AND ANCHORAGE FOR REFRIGERATION EQUIPMENT AND PIPING SHALL BE DESIGNED IN ACCORDANCE WITH THE BUILDING CODE AS OCCUPANCY CATEGORY H (HAZARDOUS FACILITIES). SUPPORTS SHALL BE MADE OF NONCOMBUSTIBLE MATERIALS.

EXCEPTIONS:
EQUIPMENT CONTAINING GROUP A1 REFRIGERANTS SHALL BE PERMITTED TO BE SUPPORTED BY THE SAME MATERIALS PERMITTED FOR THE BUILDING TYPE. THE USE OF APPROVED VIBRATION ISOLATORS SPECIFICALLY DESIGNED FOR THE NORMAL, WIND, AND SEISMIC LOADS ENCOUNTERED, SHALL BE PERMITTED.

A COMPRESSOR OR PORTION OF A CONDENSING UNIT SUPPORTED FROM THE GROUND SHALL REST ON A CONCRETE OR OTHER APPROVED BASE EXTENDING NOT LESS THAN 3 INCHES (76 MM) ABOVE THE ADJOINING GROUND LEVEL.

M1102.11 REFRIGERANT PORT PROTECTION

AIR CONDITIONING REFRIGERANT CIRCUIT ACCESS PORTS LOCATED OUTDOORS SHALL BE PROTECTED FROM UNAUTHORIZED ACCESS WITH AN EXISTING TYPE TAMPER-RESISTANT CAPS OR IN A MANNER APPROVED BY THE AUTHORITY HAVING JURISDICTION.

EXCEPTION: REFRIGERANT PORTS IN SECURE LOCATIONS PROTECTED BY WALLS OR FENCING AND REQUIRING KEY ACCESS.

EXCERPTS FROM THE 2022 CALIFORNIA PLUMBING CODE

CHAPTER 4 - PLUMBING FIXTURES AND FIXTURE FITTINGS

P401.2 RESIDENTIAL LAVATORY FAUCETS

[HCD] THE MAXIMUM FLOW RATE OF RESIDENTIAL LAVATORY FAUCETS SHALL NOT EXCEED 1.2 GALLONS (4.54 L) PER MINUTE AT 60 PSI. THE MINIMUM FLOW RATE OF RESIDENTIAL LAVATORY FAUCETS SHALL NOT BE LESS THAN 0.8 GALLONS (3.03 L) PER MINUTE AT 20 PSI.

P408.0 SHOWERS

P408.2 WATER CONSUMPTION
SHOWERHEADS SHALL HAVE A MAXIMUM FLOW RATE OF NOT MORE THAN 1.8 GPM AT 80 PSI (8.1 L/M AT 552 KPA). [HCD] 1) RESIDENTIAL SHOWERHEADS SHALL COMPLY WITH SECTION 4.3 OF THE CALIFORNIA GREEN BUILDING STANDARDS CODE (CALGREEN).

P408.2.1 SINGLE SHOWERHEAD

[BSC-CG, DSA-SS & DSA-SS(C)] SHOWERHEADS SHALL HAVE A MAXIMUM FLOW RATE OF NOT MORE THAN 1.8 GALLONS (8.1 L) PER MINUTE AT 80 PSI. SHOWERHEADS SHALL BE CERTIFIED TO THE PERFORMANCE CRITERIA OF THE U.S. EPA WATERSENSE SPECIFICATION FOR SHOWERHEADS IN COMPLIANCE WITH CHAPTER 5, DIVISION 5.3 OF THE CALIFORNIA GREEN BUILDING STANDARDS CODE (CAL GREEN).

P408.3 INDIVIDUAL SHOWER AND TUB-SHOWER COMBINATION CONTROL VALVES
SHOWER AND TUB-SHOWER COMBINATION VALVES SHALL BE PROVIDED WITH INDIVIDUAL CONTROL VALVES OF THE PRESSURE BALANCE, THERMOSTATIC, OR COMBINATION PRESSURE-BALANCE/THERMOSTATIC MIXING VALVE TYPE THAT PROVIDE SCALD AND THERMAL SHOCK PROTECTION FOR THE RATED FLOW RATE OF THE INSTALLED SHOWERHEAD. THESE VALVES SHALL BE INSTALLED AT THE POINT OF USE AND COMPLY WITH ASSE 1016/ASSE A112 1016/CSA B125.16 OR ASME A112.16.1/CSA B125.1.

GANG SHOWERS, WHERE SUPPLIED WITH A SINGLE TEMPERATURE-CONTROLLED WATER SUPPLY PIPE, SHALL BE CONTROLLED BY A MIXING VALVE THAT COMPLIES WITH ASSE 1069. HANDLE POSITION STOPS SHALL BE PROVIDED ON SUCH VALVES AND SHALL BE ADJUSTED PER THE MANUFACTURER'S INSTRUCTIONS TO DELIVER MAXIMUM MIXED WATER SETTING OF 120° (49°C). WATER HEATER THERMOSTATS SHALL NOT BE CONSIDERED A SUITABLE CONTROL FOR MEETING THIS PROVISION.

P408.6 SHOWER COMPARTMENTS

SHOWER COMPARTMENTS, REGARDLESS OF SHAPE, SHALL HAVE A MINIMUM FINISHED INTERIOR OF 1024 SQUARE INCHES (66.0608 M2) AND SHALL ALSO BE CAPABLE OF ENCOMPASSING A 30 INCH (762 MM) CIRCLE. THE MINIMUM REQUIRED AREA AND DIMENSIONS SHALL BE MEASURED AT A HEIGHT EQUAL TO THE TOP OF THE THRESHOLD AND A POINT TANGENT TO ITS CENTERLINE. THE AREA AND DIMENSIONS SHALL BE MAINTAINED TO A POINT OF NOT LESS THAN 70 INCHES (1778 MM) ABOVE THE SHOWER DRAIN OR TUB OR SHOWER PAN OUTLET WITH NO PROTRUSIONS OTHER THAN A VALVE OR VALVES, SHOWERHEADS, SOAP DISHES, SHELVES, AND SAFETY GRAB BARS, OR RAILS. FOLD-DOWN SEATS IN ACCESSIBLE SHOWER STALLS SHALL BE PERMITTED TO PROTRUDE INTO THE 30 INCH (762 MM) CIRCLE.

EXCEPTIONS:
SHOWERS THAT ARE DESIGNED TO BE IN ACCORDANCE WITH CHAPTER 11A OF THE CALIFORNIA BUILDING CODE.
THE MINIMUM REQUIRED AREA AND DIMENSION SHALL NOT APPLY FOR A SHOWER RECEPTOR HAVING OVERALL DIMENSIONS OF NOT LESS THAN 30 INCHES (762 MM) IN WIDTH AND 60 INCHES (1524 MM) IN LENGTH.

P411.0 WATER CLOSETS

P411.2 WATER CONSUMPTION
THE EFFECTIVE FLUSH VOLUME OF ALL WATER CLOSETS SHALL NOT EXCEED 1.28 GALLONS (4.8 L) PER FLUSH WHEN TESTED IN ACCORDANCE WITH ASME A112.19/CSA B45.1.

P420.0 SINKS

P420.2.1 KITCHEN FAUCETS
[BSC-CG, DSA-SS & DSA-SS(C)] KITCHEN FAUCETS SHALL HAVE A MAXIMUM FLOW RATE OF NOT MORE THAN 1.2 GALLONS (8.1 L) PER MINUTE AT 60 PSI. KITCHEN FAUCETS MAY TEMPORARILY INCREASE THE FLOW ABOVE THE MAXIMUM RATE, BUT NOT TO EXCEED 2.2 GALLONS (8.3 L) PER MINUTE AT 60 PSI, AND MUST DEFAULT TO A MAXIMUM FLOW RATE OF 1.8 GALLONS (8.1 L) PER MINUTE AT 60 PSI IN COMPLIANCE WITH CHAPTER 5, DIVISION 5.3 OF THE CAL

CODE COMPLIANCE NOTES

TABLE R302.1(1)				TABLE 610.4																	TABLE 703.2										
EXTERIOR WALLS: DWELLINGS AND ACCESSORY BUILDINGS WITHOUT AUTO RESIDENTIAL FIRE SPRINKLER PROTECTION				FIXTURE UNIT TABLE FOR DETERMINING WATER PIPE AND METER SIZES																	MAXIMUM UNIT LOADING AND MAXIMUM LENGTH OF DRAINAGE AND VENT PIPING										
EXTERIOR WALL ELEMENT		MINIMUM FIRE-RESISTANCE RATING	MINIMUM FIRE SEPARATION DISTANCE	METER AND STREET SERVICE (inches)	BUILDING SUPPLY AND BRANCHES (inches)	MAXIMUM ALLOWABLE LENGTH (feet)															SIZE OF PIPE (inches)	1 ¹ / ₄	1 ¹ / ₂	2	3	4	5	6	8	10	12
WALLS	FIRE-RESISTANCE RATED	1 HOUR-TESTED IN ACCORDANCE WITH ASTM E119, UL 263 OR SECTION 703.3 OF THE CALIFORNIA BUILDING CODE WITH EXPOSURE FROM BOTH SIDES	0 FEET																		Maximum Units										
	NOT FIRE-RESISTANCE RATED	0 HOURS	≥ 5 FEET			PRESSURE RANGE - 30 to 45 psi ¹															Drainage Piping ¹										
PROJECTIONS	NOT ALLOWED	NA	< 2 FEET	3/4	1/2 ²	6	5	4	3	2	1	1	1	0	0	0	0	0	0	0	0	0	0								
	FIRE-RESISTANCE RATED	1 HOUR ON THE UNDERSIDE, OR HEAVY TIMBER, OR FIRE-RETARDANT-TREATED WOOD ^{A,B}	≥ 2 FEET < 5 FEET	3/4	3/4	16	16	14	12	9	6	5	5	4	4	3	2	2	2	2	1										
	NOT FIRE-RESISTANCE RATED	0 HOURS	≥ 5 FEET	3/4	1	29	25	23	21	17	15	13	12	10	8	6	6	6	6	6											
OPENINGS IN WALLS	NOT ALLOWED	NA	< 3 FEET	1	1	36	31	27	25	20	17	15	13	12	10	8	6	6	6	6											
	25% MAXIMUM OF WALL AREA	0 HOURS	3 FEET	3/4	1 ¹ / ₄	36	33	31	28	24	23	21	19	17	16	13	12	12	11	11											
	UNLIMITED	0 HOURS	5 FEET	1	1 ¹ / ₄	54	47	42	38	32	28	25	23	19	17	14	12	12	11	11											
PENETRATIONS	ALL	COMPLY WITH SECTION R302.4	< 3 FEET	1 ¹ / ₂	1 ¹ / ₄	78	68	57	48	38	32	28	25	21	18	15	12	12	11	11	FOR SI UNITS: 1 INCH = 25 MM, 1 FOOT = 304.8 MM NOTES: 1. EXCLUDING TRAP ARM. 2. EXCEPT FOR SINKS, URINALS, AND DISHWASHERS - EXCEEDING 1 FIXTURE UNIT. 3. EXCEPT FOR SIX-UNIT TRAPS OR WATER CLOSETS. 4. NOT TO EXCEED FIVE WATER CLOSETS OR FIVE SIX-UNIT TRAPS. 5. BASED ON 1/4 INCH PER FOOT (20.8 MM/M) SLOPE. FOR 1/8 OF AN INCH PER FOOT (10.4 MM/M) SLOPE, MULTIPLY HORIZONTAL FIXTURE UNITS BY A FACTOR OF 0.8. 6. THE DIAMETER OF AN INDIVIDUAL VENT SHALL BE NOT LESS THAN 1 1/4 INCHES (32 MM) NOR LESS THAN ONE-HALF THE DIAMETER OF THE DRAIN TO WHICH IT IS CONNECTED. FIXTURE UNIT LOAD VALUES FOR DRAINAGE AND VENT PIPING SHALL BE COMPUTED FROM TABLE 702.1 AND TABLE 702.2. NOT TO EXCEED ONE-THIRD OF THE TOTAL PERMITTED LENGTH OF A VENT SHALL BE PERMITTED TO BE INSTALLED IN A HORIZONTAL POSITION. WHERE VENTS ARE INCREASED ONE PIPE SIZE FOR THEIR ENTIRE LENGTH, THE MAXIMUM LENGTH LIMITATIONS SPECIFIED IN THIS TABLE DO NOT APPLY. THIS TABLE IS IN ACCORDANCE WITH THE REQUIREMENTS OF SECTION 901.3. 7. UP TO 8 PUBLIC LAVATORIES ARE PERMITTED TO BE INSTALLED ON A 1 1/2 INCH (40 MM) VERTICAL BRANCH OR HORIZONTAL SANITARY BRANCH SLOPED AT 1/4 INCH PER FOOT (20.8 MM/M).										
		NONE REQUIRED	3 FEET	1	1 ¹ / ₂	85	84	79	65	56	48	43	38	32	28	26	22	21	20	20											
FOR SI: 1 FOOT = 304.8 MM. NA = NOT APPLICABLE. A. THE FIRE-RESISTANCE RATING SHALL BE PERMITTED TO BE REDUCED TO 0 HOURS ON THE UNDERSIDE OF THE EAVE OVERHANG IF FIREBLOCKING IS PROVIDED FROM THE WALL TOP PLATE TO THE UNDERSIDE OF THE ROOF SHEATHING. B. THE FIRE-RESISTANCE RATING SHALL BE PERMITTED TO BE REDUCED TO 0 HOURS ON THE UNDERSIDE OF THE RAKE OVERHANG WHERE GABLE VENT OPENINGS ARE NOT INSTALLED.				1 ¹ / ₂	1 ¹ / ₂	150	124	105	91	70	57	49	45	36	31	26	23	21	20	20											
				2	1 ¹ / ₂	151	129	129	110	80	64	53	46	38	32	27	23	21	20	20											
				1	2	85	85	85	85	85	85	82	80	66	61	57	52	49	46	43											
				1 ¹ / ₂	2	220	205	190	176	155	138	127	120	104	85	70	61	57	54	51											
				2	2	370	327	292	265	217	185	164	147	124	96	70	61	57	54	51											
				2	2 ¹ / ₂	445	418	390	370	330	300	280	265	240	220	198	175	158	143	133											
				PRESSURE RANGE - 46 to 60 psi ¹																											
				3/4	1/2 ²	7	7	6	5	4	3	2	2	1	1	1	0	0	0	0											
				3/4	3/4	20	20	19	17	14	11	9	8	6	5	4	4	3	3	3											
				3/4	1	39	39	36	33	28	23	21	19	17	14	12	10	9	8	8											
				1	1	39	39	39	36	30	25	23	20	18	15	12	10	9	8	8											
				3/4	1 ¹ / ₄	39	39	39	39	39	39	34	32	27	25	22	19	19	17	16											
				1	1 ¹ / ₄	78	78	76	67	52	44	39	36	30	27	24	20	19	17	16											
				1 ¹ / ₂	1 ¹ / ₄	78	78	78	78	66	52	44	39	33	29	24	20	19	17	16											
				1	1 ¹ / ₂	85	85	85	85	85	85	80	67	55	49	41	37	34	32	30											
				1 ¹ / ₂	1 ¹ / ₂	151	151	151	151	128	105	90	78	62	52	42	38	35	32	30											
				2	1 ¹ / ₂	151	151	151	151	150	117	98	84	67	55	42	38	35	32	30											
				1	2	85	85	85	85	85	85	85	85	85	85	85	85	85	85	83	80										
				1 ¹ / ₂	2	370	370	340	318	272	240	220	198	170	150	135	123	110	102	94											
				2	2	370	370	370	370	368	318	280	250	205	165	142	123	110	102	94											
				2	2 ¹ / ₂	654	640	610	580	535	500	470	440	400	365	335	315	285	267	250											
				PRESSURE RANGE - Over 60 psi ¹																											
				3/4	1/2 ²	7	7	7	6	5	4	3	3	2	1	1	1	1	1	0											
				3/4	3/4	20	20	20	20	17	13	11	10	8	7	6	6	5	4	4											
				3/4	1	39	39	39	39	35	30	27	24	21	17	14	13	12	12	11											
				1	1	39	39	39	39	38	32	29	26	22	18	14	13	12	12	11											
				3/4	1 ¹ / ₄	39	39	39	39	39	39	39	39	34	28	26	25	23	22	21											
				1	1 ¹ / ₄	78	78	78	78	74	62	53	47	39	31	26	25	23	22	21											
				1 ¹ / ₂	1 ¹ / ₄	78	78	78	78	78•	74	65	54	43	34	26	25	23	22	21											
				1	1 ¹ / ₂	85	85	85	85	85	85	85	85	81	64	51	48	46	43	40											
				1 ¹ / ₂	1 ¹ / ₂	151	151	151	151	151	151	130	113	88	73	51	51	46	43	40											
				2	1 ¹ / ₂	151	151	151	151	151	151	142	122	98	82	64	51	46	43	40											
				1	2	85	85	85	85	85	85	85	85	85	85	85	85	85	85	85											
				1 ¹ / ₂	2	370	370	370	370	360	335	305	282	244	212	187	172	153	141	129											
				2	2	370	370	370	370	370	370	370	340	288	245	204	172	153	141	129											
				2	2 ¹ / ₂	654	654	654	654	654	650	610	570	510	460	430	404	380	356	329											
				FOR SI UNITS: 1 INCH = 25 MM, 1 FOOT = 304.8 MM, 1 POUND-FORCE PER SQUARE INCH = 6.8947 KPA NOTES: 1. AVAILABLE STATIC PRESSURE AFTER HEAD LOSS. 2. BUILDING SUPPLY, NOT LESS THAN 3/4 OF AN INCH (20 MM) NOMINAL SIZE.																											



California

2022 CALIFORNIA GREEN BUILDING STANDARDS CODE

RESIDENTIAL MANDATORY MEASURES, SHEET 1 (January 2023)

Y N/A RESPON. PARTY
* YES
* NOT APPLICABLE
RESPONSIBLE PARTY (i.e. ARCHITECT, ENGINEER, OWNER, CONTRACTOR, INSPECTOR ETC.)

CHAPTER 3 GREEN BUILDING SECTION 301 GENERAL

301.1 SCOPE. Buildings shall be designed to include the green building measures specified as mandatory in the application checklists contained in this code. Voluntary green building measures are also included in the application checklists and may be included in the design and construction of structures covered by this code, but are not required unless adopted by a city, county, or city and county as specified in Section 101.7.

301.1.1 Additions and alterations. [HCD] The mandatory provisions of Chapter 4 shall be applied to additions or alterations of existing residential buildings where the addition or alteration increases the building's conditioned area, volume, or size. The requirements shall apply only to and/or within the specific area of the addition or alteration.

The mandatory provision of Section 4.106.4.2 may apply to additions or alterations of existing parking facilities or the addition of new parking facilities serving existing multifamily buildings. See Section 4.106.4.3 for application.

Note: Repairs including, but not limited to, resurfacing, restriping and repairing or maintaining existing lighting fixtures are not considered alterations for the purpose of this section.

Note: On and after January 1, 2014, residential buildings undergoing permitted alterations, additions, or improvements shall replace noncompliant plumbing fixtures with water-conserving plumbing fixtures. Plumbing fixture replacement is required prior to issuance of a certificate of final completion, certificate of occupancy or final permit approval by the local building department. See Civil Code Section 1101.1, et seq., for the definition of a noncompliant plumbing fixture, types of residential buildings affected and other important enactment dates.

301.2 LOW-RISE AND HIGH-RISE RESIDENTIAL BUILDINGS. [HCD] The provisions of individual sections of CALGreen may apply to either low-rise residential buildings (high-rise residential buildings, or both. Individual sections will be designated by banners to indicate where the section applies specifically to low-rise only (LR) or high-rise only (HR). When the section applies to both low-rise and high-rise buildings, no banner will be used.

SECTION 302 MIXED OCCUPANCY BUILDINGS

302.1 MIXED OCCUPANCY BUILDINGS. In mixed occupancy buildings, each portion of a building shall comply with the specific green building measures applicable to each specific occupancy.

- Exceptions:
- [HCD] Accessory structures and accessory occupancies serving residential buildings shall comply with Chapter 4 and Appendix A4, as applicable.
 - [HCD] For purposes of CALGreen, live/work units, complying with Section 419 of the *California Building Code*, shall not be considered mixed occupancies. Live/Work units shall comply with Chapter 4 and Appendix A4, as applicable.

DIVISION 4.1 PLANNING AND DESIGN

ABBREVIATION DEFINITIONS:

HCD Department of Housing and Community Development
BSC California Building Standards Commission
DSA-SS Division of the State Architect, Structural Safety
OSHPD Office of Statewide Health Planning and Development
LR Low Rise
HR High Rise
AA Additions and Alterations
N New

CHAPTER 4 RESIDENTIAL MANDATORY MEASURES

SECTION 4.102 DEFINITIONS

4.102.1 DEFINITIONS
The following terms are defined in Chapter 2 (*and are included here for reference*)

FRENCH DRAIN. A trench, hole or other depressed area loosely filled with rock, gravel, fragments of brick or similar pervious material used to collect or channel drainage or runoff water.

WATTLES. Wattles are used to reduce sediment in runoff. Wattles are often constructed of natural plant materials such as hay, straw or similar material shaped in the form of tubes and placed on a downflow slope. Wattles are also used for perimeter and inlet controls.

4.106 SITE DEVELOPMENT

4.106.1 GENERAL. Preservation and use of available natural resources shall be accomplished through evaluation and careful planning to minimize negative effects on the site and adjacent areas. Preservation of slopes, management of storm water drainage and erosion controls shall comply with this section.

4.106.2 STORM WATER DRAINAGE AND RETENTION DURING CONSTRUCTION. Projects which disturb less than one acre of soil and are not part of a larger common plan of development which in total disturbs one acre or more, shall manage storm water drainage during construction. In order to manage storm water drainage during construction, one or more of the following measures shall be implemented to prevent flooding of adjacent property, prevent erosion and retain soil runoff on the site.

- Retention basins of sufficient size shall be utilized to retain storm water on the site.
- Where storm water is conveyed to a public drainage system, collection point, gutter or similar disposal method, water shall be filtered by use of a barrier system, wattle or other method approved by the enforcing agency.
- Compliance with a lawfully enacted storm water management ordinance.

Note: Refer to the State Water Resources Control Board for projects which disturb one acre or more of soil, or are part of a larger common plan of development which in total disturbs one acre or more of soil.

(Website: https://www.waterboards.ca.gov/water_issues/programs/stormwater/construction.html)

4.106.3 GRADING AND PAVING. Construction plans shall indicate how the site grading or drainage system will manage all surface water flows to keep water from entering buildings. Examples of methods to manage surface water include, but are not limited to, the following:

- Swales
- Water collection and disposal systems
- French drains
- Water retention gardens
- Other water measures which keep surface water away from buildings and aid in groundwater recharge.

Exception: Additions and alterations not altering the drainage path.

4.106.4 Electric vehicle (EV) charging for new construction. New construction shall comply with Sections 4.106.4.1 and 4.106.4.2 to facilitate future installation and use of EV chargers. Electric vehicle supply equipment (EVSE) shall be installed in accordance with the *California Electrical Code*, Article 625.

Exceptions:

- On a case-by-case basis, where the local enforcing agency has determined EV charging and infrastructure are not feasible based upon one or more of the following conditions:
 - Where there is no local utility power supply or the local utility is unable to supply adequate power.
 - Where there is evidence suitable to the local enforcing agency substantiating that additional local utility infrastructure design requirements, directly related to the implementation of Section 4.106.4, may adversely impact the construction cost of the project.
- Accessory Dwelling Units (ADU) and Junior Accessory Dwelling Units (JADU) without additional parking facilities.

4.106.4.1 New one- and two-family dwellings and townhouses with attached private garages. For each dwelling unit, install a listed raceway to accommodate a dedicated 208/240-volt branch circuit. The raceway shall not be less than trade size 1 (nominal 1-inch inside diameter). The raceway shall originate at the main service or subpanel and shall terminate into a listed cabinet, box or other enclosure in close proximity to the proposed location of an EV charger. Raceways are required to be continuous at enclosed, inaccessible or concealed areas and spaces. The service panel and/or subpanel shall provide capacity to install a 40-ampere 208/240-volt minimum dedicated branch circuit and space(s) reserved to permit installation of a branch circuit overcurrent protective device.

Exception: A raceway is not required if a minimum 40-ampere 208/240-volt dedicated EV branch circuit is installed in close proximity to the proposed location of an EV charger at the time of original construction in accordance with the *California Electrical Code*.

4.106.4.1.1 Identification. The service panel or subpanel circuit directory shall identify the overcurrent protective device space(s) reserved for future EV charging as "EV CAPABLE". The raceway termination location shall be permanently and visibly marked as "EV CAPABLE".

4.106.4.2 New multifamily dwellings, hotels and motels and new residential parking facilities. When parking is provided, parking spaces for new multifamily dwellings, hotels and motels shall meet the requirements of Sections 4.106.4.2.1 and 4.106.4.2.2. Calculations for spaces shall be rounded up to the nearest whole number. A parking space served by electric vehicle supply equipment or designed as a future EV charging space shall count as at least one standard automobile parking space only for the purpose of complying with any applicable minimum parking space requirements established by a local jurisdiction. See Vehicle Code Section 22511.2 for further details.

4.106.4.2.1 Multifamily development projects with less than 20 dwelling units; and hotels and motels with less than 20 sleeping facilities or guest rooms. The number of dwelling units, sleeping units or guest rooms shall be based on all buildings on a project site subject to this section.

1. EV Capable. Ten (10) percent of the total number of parking spaces on a building site, provided for all types of parking facilities, shall be electric vehicle charging spaces (EV spaces) capable of supporting future Level 2 EVSE. Electrical load calculations shall demonstrate that the electrical panel service capacity and electrical system, including any on-site distribution transformer(s), have sufficient capacity to simultaneously charge all EVs at all required EV spaces at a minimum of 40 amperes.

The service panel or subpanel circuit directory shall identify the overcurrent protective device space(s) reserved for future EV charging purposes as "EV CAPABLE" in accordance with the *California Electrical Code*.

Exceptions:

- When EV chargers (Level 2 EVSE) are installed in a number equal to or greater than the required number of EV capable spaces.
- When EV chargers (Level 2 EVSE) are installed in a number less than the required number of EV capable spaces, the number of EV capable spaces required may be reduced by a number equal to the number of EV chargers installed.

Notes:

a. Construction documents are intended to demonstrate the project's capability and capacity for facilitating future EV charging.

b. There is no requirement for EV spaces to be constructed or available until receptacles for EV charging or EV chargers are installed for use.

2. EV Ready. Twenty-five (25) percent of the total number of parking spaces shall be equipped with low power Level 2 EV charging receptacles. For multifamily parking facilities, no more than one receptacle is required per dwelling unit when more than one parking space is provided for use by a single dwelling unit.

Exception: Areas of parking facilities served by parking lifts.

4.106.4.2.2 Multifamily development projects with 20 or more dwelling units, hotels and motels with 20 or more sleeping units or guest rooms. The number of dwelling units, sleeping units or guest rooms shall be based on all buildings on a project site subject to this section.

1. EV Capable. Ten (10) percent of the total number of parking spaces on a building site, provided for all types of parking facilities, shall be electric vehicle charging spaces (EV spaces) capable of supporting future Level 2 EVSE. Electrical load calculations shall demonstrate that the electrical panel service capacity and electrical system, including any on-site distribution transformer(s), have sufficient capacity to simultaneously charge all EVs at all required EV spaces at a minimum of 40 amperes.

The service panel or subpanel circuit directory shall identify the overcurrent protective device space(s) reserved for future EV charging purposes as "EV CAPABLE" in accordance with the *California Electrical Code*.

Exception: When EV chargers (Level 2 EVSE) are installed in a number greater than five (5) percent of parking spaces required by Section 4.106.4.2.2, Item 3, the number of EV capable spaces required may be reduced by a number equal to the number of EV chargers installed over the five (5) percent required.

Notes:

a. Construction documents shall show locations of future EV spaces.

b. There is no requirement for EV spaces to be constructed or available until receptacles for EV charging or EV chargers are installed for use.

2. EV Ready. Twenty-five (25) percent of the total number of parking spaces shall be equipped with low power Level 2 EV charging receptacles. For multifamily parking facilities, no more than one receptacle is required per dwelling unit when more than one parking space is provided for use by a single dwelling unit.

Exception: Areas of parking facilities served by parking lifts.

3. EV Chargers. Five (5) percent of the total number of parking spaces shall be equipped with Level 2 EVSE. Where common use parking is provided, at least one EV charger shall be located in the common use parking area and shall be available for use by all residents or guests.

When low power Level 2 EV charging receptacles or Level 2 EVSE are installed beyond the minimum required, an automatic load management system (ALMS) may be used to reduce the maximum required electrical capacity to each space served by the ALMS. The electrical system and any on-site distribution transformers shall have sufficient capacity to deliver at least 3.3 kW simultaneously to each EV charging station (EVCS) served by the ALMS. The branch circuit shall have a minimum capacity of 40 amperes, and installed EVSE shall have a capacity of not less than 30 amperes. ALMS shall not be used to reduce the minimum required electrical capacity to the required EV capable spaces.

4.106.4.2.2.1 Electric vehicle charging stations (EVCS). Electric vehicle charging stations required by Section 4.106.4.2.2, Item 3, shall comply with Section 4.106.4.2.2.1.

Exception: Electric vehicle charging stations serving public accommodations, public housing, motels and hotels shall not be required to comply with this section. See California Building Code, Chapter 11B, for applicable requirements.

4.106.4.2.2.1.1 Location.

EVCS shall comply with at least one of the following options:

- The charging space shall be located adjacent to an accessible parking space meeting the requirements of the California Building Code, Chapter 11A, to allow use of the EV charger from the accessible parking space, Chapter 2, to the building.
- The charging space shall be located on an accessible route, as defined in the California Building Code, Chapter 2, to the building.

Exception: Electric vehicle charging stations designed and constructed in compliance with the California Building Code, Chapter 11B, are not required to comply with Section 4.106.4.2.2.1.1 and Section 4.106.4.2.2.1.2, Item 3.

4.106.4.2.2.1.2 Electric vehicle charging stations (EVCS) dimensions.

The charging spaces shall be designed to comply with the following:

- The minimum length of each EV space shall be 18 feet (5486 mm).
- The minimum width of each EV space shall be 9 feet (2743 mm).
- One in every 25 charging spaces, but not less than one, shall also have an 8-foot (2438 mm) wide minimum aisle. A 5-foot (1524 mm) wide minimum aisle shall be permitted provided the minimum width of the EV space is 12 feet (3658 mm).

a. Surface slope for this EV space and the aisle shall not exceed 1 unit vertical in 48 units horizontal (2.083 percent slope) in any direction.

4.106.4.2.2.1.3 Accessible EV spaces.

In addition to the requirements in Sections 4.106.4.2.2.1.1 and 4.106.4.2.2.1.2, all EVSE, when installed, shall comply with the accessibility provisions for EV chargers in the California Building Code, Chapter 11B. EV ready spaces and EVCS in multifamily developments shall comply with California Building Code, Chapter 11A, Section 1109A.

4.106.4.2.3 EV space requirements.

1. Single EV space required. Install a listed raceway capable of accommodating a 208/240-volt dedicated branch circuit. The raceway shall not be less than trade size 1 (nominal 1-inch inside diameter). The raceway shall originate at the main service or subpanel and shall terminate into a listed cabinet, box or enclosure in close proximity to the proposed location of the EV space. Construction documents shall identify the raceway termination point, receptacle or charger location, as applicable. The service panel and/or subpanel shall have a 40-ampere minimum dedicated branch circuit, including branch circuit overcurrent protective device installed, or space(s) reserved to permit installation of a branch circuit overcurrent protective device.

Exception: A raceway is not required if a minimum 40-ampere 208/240-volt dedicated EV branch circuit is installed in close proximity to the location or the proposed location of the EV space, at the time of original construction in accordance with the *California Electrical Code*.

2. Multiple EV spaces required. Construction documents shall indicate the raceway termination point and the location of installed or future EV spaces, receptacles or EV chargers. Construction documents shall also provide information on ampacity of installed or future receptacles or EVSE, raceway methods, wiring schematics and electrical load calculations. Plan design shall be based upon a 40-ampere minimum branch circuit. Required raceways and related components that are planned to be installed underground, enclosed, inaccessible or in concealed areas and spaces shall be installed at the time of original construction.

Exception: A raceway is not required if a minimum 40-ampere 208/240-volt dedicated EV branch circuit is installed in close proximity to the location or the proposed location of the EV space at the time of original construction in accordance with the *California Electrical Code*.

4.106.4.2.4 Identification.

The service panel or subpanel circuit directory shall identify the overcurrent protective device space(s) reserved for future EV charging purposes as "EV CAPABLE" in accordance with the *California Electrical Code*.

4.106.4.2.5 Electric Vehicle Ready Space Signage.

Electric vehicle ready spaces shall be identified by signage or pavement markings, in compliance with Caltrans Traffic Operations Policy Directive 13-01 (Zero Emission Vehicle Signs and Pavement Markings) or its successor(s).

4.106.4.3 Electric vehicle charging for additions and alterations of parking facilities serving existing multifamily buildings.

When new parking facilities are added, or electrical systems or lighting of existing parking facilities are added or altered and the work requires a building permit, ten (10) percent of the total number of parking spaces added or altered shall be electric vehicle charging spaces (EV spaces) capable of supporting future Level 2 EVSE.

Notes:

1. Construction documents are intended to demonstrate the project's capability and capacity for facilitating future EV charging.

2. There is no requirement for EV spaces to be constructed or available until EV chargers are installed for use.

DIVISION 4.2 ENERGY EFFICIENCY

4.201 GENERAL

4.201.1 SCOPE. For the purposes of mandatory energy efficiency standards in this code, the California Energy Commission will continue to adopt mandatory standards.

DIVISION 4.3 WATER EFFICIENCY AND CONSERVATION

4.303 INDOOR WATER USE

4.303.1 WATER CONSERVING PLUMBING FIXTURES AND FITTINGS. Plumbing fixtures (water closets and urinals) and fittings (faucets and showerheads) shall comply with the sections 4.303.1.1, 4.303.1.2, 4.303.1.3, and 4.303.1.4.

Note: All noncompliant plumbing fixtures in any residential real property shall be replaced with water-conserving plumbing fixtures. Plumbing fixture replacement is required prior to issuance of a certificate of final completion, certificate of occupancy, or final permit approval by the local building department. See Civil Code Section 1101.1, et seq., for the definition of a noncompliant plumbing fixture, types of residential buildings affected and other important enactment dates.

4.303.1.1 Water Closets. The effective flush volume of all water closets shall not exceed 1.28 gallons per flush. Tank-type water closets shall be certified to the performance criteria of the U.S. EPA WaterSense Specification for Tank-type Toilets.

Note: The effective flush volume of dual flush toilets is defined as the composite, average flush volume of two reduced flushes and one full flush.

4.303.1.2 Urinals. The effective flush volume of wall mounted urinals shall not exceed 0.125 gallons per flush. The effective flush volume of all other urinals shall not exceed 0.5 gallons per flush.

4.303.1.3 Showerheads.

4.303.1.3.1 Single Showerhead. Showerheads shall have a maximum flow rate of not more than 1.8 gallons per minute at 80 psi. Showerheads shall be certified to the performance criteria of the U.S. EPA WaterSense Specification for Showerheads.

4.303.1.3.2 Multiple showerheads serving one shower. When a shower is served by more than one showerhead, the combined flow rate of all the showerheads and/or other shower outlets controlled by a single valve shall not exceed 1.8 gallons per minute at 80 psi, or the shower shall be designed to only allow one shower outlet to be in operation at a time.

Note: A hand-held shower shall be considered a showerhead.

4.303.1.4 Faucets.

4.303.1.4.1 Residential Lavatory Faucets. The maximum flow rate of residential lavatory faucets shall not exceed 1.2 gallons per minute at 60 psi. The minimum flow rate of residential lavatory faucets shall not be less than 0.8 gallons per minute at 20 psi.

4.303.1.4.2 Lavatory Faucets in Common and Public Use Areas. The maximum flow rate of lavatory faucets installed in common and public use areas (outside of dwellings or sleeping units) in residential buildings shall not exceed 0.5 gallons per minute at 60 psi.

4.303.1.4.3 Metering Faucets. Metering faucets when installed in residential buildings shall not deliver more than 0.2 gallons per cycle.

4.303.1.4.4 Kitchen Faucets. The maximum flow rate of kitchen faucets shall not exceed 1.8 gallons per minute at 60 psi. Kitchen faucets may temporarily increase the flow above the maximum rate, but not to exceed 2.2 gallons per minute at 60 psi, and must default to a maximum flow rate of 1.8 gallons per minute at 60 psi.

Note: Where complying faucets are unavailable, aerators or other means may be used to achieve reduction.

4.303.1.4.5 Pre-rinse spray valves.

When installed, shall meet the requirements in the *California Code of Regulations*, Title 20 (Appliance Efficiency Regulations), Sections 1605.1 (h)(4) Table H-2, Section 1605.3 (h)(4)(A), and Section 1607 (d)(7) and shall be equipped with an integral automatic shutoff.

FOR REFERENCE ONLY: The following table and code section have been reprinted from the *California Code of Regulations*, Title 20 (Appliance Efficiency Regulations), Section 1605.1 (h)(4) and Section 1605.3 (h)(4)(A).

TABLE H-2

STANDARDS FOR COMMERCIAL PRE-RINSE SPRAY VALUES MANUFACTURED ON OR AFTER JANUARY 28, 2019

PRODUCT CLASS [spray force in ounce force (ozf)]	MAXIMUM FLOW RATE (gpm)
Product Class 1 (≤ 5.0 ozf)	1.00
Product Class 2 (> 5.0 ozf and ≤ 8.0 ozf)	1.20
Product Class 3 (> 8.0 ozf)	1.28

Title 20 Section 1605.3 (h)(4)(A): Commercial pre-rinse spray valves manufactured on or after January 1, 2006, shall have a minimum spray force of not less than 4.0 ounces-force (ozf)[113 grams-force(gf)]

4.303.2 Submeters for multifamily buildings and dwelling units in mixed-used residential/commercial buildings.

Submeters shall be installed to measure water usage of individual residential dwelling units in accordance with the *California Plumbing Code*.

4.303.3 Standards for plumbing fixtures and fittings. Plumbing fixtures and fittings shall be installed in accordance with the *California Plumbing Code*, and shall meet the applicable standards referenced in Table T701.1 of the *California Plumbing Code*.

NOTE: THIS TABLE COMPILES THE DATA IN SECTION 4.303.1, AND IS INCLUDED AS A CONVENIENCE FOR THE USER.

TABLE - MAXIMUM FIXTURE WATER USE	
FIXTURE TYPE	FLOW RATE
SHOWER HEADS (RESIDENTIAL)	1.8 GMP @ 80 PSI
LAVATORY FAUCETS (RESIDENTIAL)	MAX. 1.2 GPM @ 60 PSI MIN. 0.8 GPM @ 20 PSI
LAVATORY FAUCETS IN COMMON & PUBLIC USE AREAS	0.5 GPM @ 60 PSI
KITCHEN FAUCETS	1.8 GPM @ 60 PSI
METERING FAUCETS	0.2 GAL/CYCLE
WATER CLOSET	1.28 GAL/FLUSH
URINALS	0.125 GAL/FLUSH

4.304 OUTDOOR WATER USE

4.304.1 OUTDOOR POTABLE WATER USE IN LANDSCAPE AREAS. Residential developments shall comply with a local water efficient landscape ordinance or the current California Department of Water Resources' Model Water Efficient Landscape Ordinance (MWELO), whichever is more stringent.

NOTES:

- The Model Water Efficient Landscape Ordinance (MWELO) is located in the *California Code Regulations*, Title 23, Chapter 2.7, Division 2. MWEL0 and supporting documents, including water budget calculator, are available at: <https://www.water.ca.gov/>

DIVISION 4.4 MATERIAL CONSERVATION AND RESOURCE EFFICIENCY

4.406 ENHANCED DURABILITY AND REDUCED MAINTENANCE

4.406.1 RODENT PROOFING. Annular spaces around pipes, electric cables, conduits or other openings in sole/bottom plates at exterior walls shall be protected against the passage of rodents by closing such openings with cement mortar, concrete masonry or a similar method acceptable to the enforcing agency.

4.408 CONSTRUCTION WASTE REDUCTION, DISPOSAL AND RECYCLING

4.408.1 CONSTRUCTION WASTE MANAGEMENT. Recycle and/or salvage for reuse a minimum of 65 percent of the non-hazardous construction and demolition waste in accordance with either Section 4.408.2, 4.408.3 or 4.408.4, or meet a more stringent local construction and demolition waste management ordinance.

Exceptions:

- Excavated soil and land-clearing debris.
- Alternate waste reduction methods developed by working with local agencies if diversion or recycle facilities capable of compliance with this item do not exist or are not located reasonably close to the jobsite.
- The enforcing agency may make exceptions to the requirements of this section when isolated jobsites are located in areas beyond the haul boundaries of the diversion facility.

4.408.2 CONSTRUCTION WASTE MANAGEMENT PLAN. Submit a construction waste management plan in conformance with Items 1 through 5. The construction waste management plan shall be updated as necessary and shall be available during construction for examination by the enforcing agency.

- Identify the construction and demolition waste materials to be diverted from disposal by recycling, reuse on the project or salvage for future use or sale.
- Specify if construction and demolition waste materials will be sorted on-site (source separated) or bulk mixed (single stream).
- Identify diversion facilities where the construction and demolition waste material collected will be taken.
- Identify construction methods employed to reduce the amount of construction and demolition waste generated.
- Specify that the amount of construction and demolition waste materials diverted shall be calculated by weight or volume, but not by both.

4.408.3 WASTE MANAGEMENT COMPANY. Utilize a waste management company, approved by the enforcing agency, which can provide verifiable documentation that the percentage of construction and demolition waste material diverted from the landfill complies with Section 4.408.1.

Note: The owner or contractor may make the determination if the construction and demolition waste materials will be diverted by a waste management company.

4.408.4 WASTE STREAM REDUCTION ALTERNATIVE [LR]. Projects that generate a total combined weight of construction and demolition waste disposed of in landfills, which do not exceed 3.4 lbs./sq.ft. of the building area shall meet the minimum 65% construction waste reduction requirement in Section 4.408.1.

4.408.4.1 WASTE STREAM REDUCTION ALTERNATIVE. Projects that generate a total combined weight of construction and demolition waste disposed of in landfills, which do not exceed 2 pounds per square foot of the building area, shall meet the minimum 65% construction waste reduction requirement in Section 4.408.1.

4.408.5 DOCUMENTATION. Documentation shall be provided to the enforcing agency which demonstrates compliance with Section 4.408.2, Items 1 through 5, Section 4.408.3 or Section 4.408.4.

NOTES:

- Sample forms found in "A Guide to the California Green Building Standards Code (Residential)" located at www.hcd.ca.gov/CALGreen.html may be used to assist in documenting compliance with this section.
- Mixed construction and demolition debris (C & D) processors can be located at the California Department of Resources Recycling and Recovery (CalRecycle).

4.410 BUILDING MAINTENANCE AND OPERATION

4.410.1 OPERATION AND MAINTENANCE MANUAL. At the time of final inspection, a manual, compact disc, web-based reference or other media acceptable to the enforcing agency which includes all of the following shall be placed in the building:

- Directions to the owner or occupant that the manual shall remain with the building throughout the life cycle of the structure.
- Operation and maintenance instructions for the following:
 - Equipment and appliances, including water-saving devices and systems, HVAC systems, photovoltaic systems, electric vehicle chargers, water-heating systems and other major appliances and equipment.
 - Roof and yard drainage, including gutters and downspouts.
 - Space conditioning systems, including condensers and air filters.
 - Landscape irrigation systems.
 - Water reuse systems.
- Information from local utility, water and waste recovery providers on methods to further reduce resource consumption, including recycle programs and locations.
- Public transportation and/or carpool options available in the area.
- Educational material on the positive impacts of an interior relative humidity between 30-60 percent and what methods an occupant may use to maintain the relative humidity level in that range.
- Information about water-conserving landscape and irrigation design and controllers which conserve water.
- Instructions for maintaining gutters and downspouts and the importance of diverting water at least 5 feet away from the foundation.
- Information on required routine maintenance measures, including, but not limited to, caulking, painting, grading around the building, etc.
- Information about state solar energy and incentive programs available.
- A copy of all special inspections verifications required by the enforcing agency or this code.
- Information from the Department of Forestry and Fire Protection on maintenance of defensible space around residential structures.
- Information and/or drawings identifying the location of grab bar reinforcements.



AIA California

2022 CALIFORNIA GREEN BUILDING STANDARDS CODE

RESIDENTIAL MANDATORY MEASURES, SHEET 2 (January 2023)

Y N/A RESPON
RESPON PARTY

Y N/A RESPON
RESPON PARTY

Y N/A RESPON
RESPON PARTY

Y N/A RESPON
RESPON PARTY

MAXIMUM INCREMENTAL REACTIVITY (MIR). The maximum change in weight of ozone formed by adding a compound to the "Base Reactive Organic Gas (ROG) Mixture" per weight of compound added, expressed to hundredths of a gram (g O₃/g ROG).
Note: MIR values for individual compounds and hydrocarbon solvents are specified in CCR, Title 17, Sections 94700 and 94701.

MOISTURE CONTENT. The weight of the water in wood expressed in percentage of the weight of the oven-dry wood.

PRODUCT-WEIGHTED MIR (PWMIR). The sum of all weighted-MIR for all ingredients in a product subject to this article. The PWMIR is the total product reactivity expressed to hundredths of a gram of ozone formed per gram of product (excluding container and packaging).
Note: PWMIR is calculated according to equations found in CCR, Title 17, Section 94521 (a).

REACTIVE ORGANIC COMPOUND (ROC). Any compound that has the potential, once emitted, to contribute to ozone formation in the troposphere.

VOC. A volatile organic compound (VOC) broadly defined as a chemical compound based on carbon chains or rings with vapor pressures greater than 0.1 millimeters of mercury at room temperature. These compounds typically contain hydrogen and may contain oxygen, nitrogen and other elements. See CCR Title 17, Section 94508(a).

4.503 FIREPLACES

4.503.1 GENERAL. Any installed gas fireplace shall be a direct-vent sealed-combustion type. Any installed woodstove or pellet stove shall comply with U.S. EPA New Source Performance Standards (NSPS) emission limits as applicable, and shall have a permanent label indicating they are certified to meet the emission limits. Woodstoves, pellet stoves and fireplaces shall also comply with applicable local ordinances.

4.504 POLLUTANT CONTROL

4.504.1 COVERING OF DUCT OPENINGS & PROTECTION OF MECHANICAL EQUIPMENT DURING CONSTRUCTION. At the time of rough installation, during storage on the construction site and until final startup of the heating, cooling and ventilating equipment, all duct and other related air distribution component openings shall be covered with tape, plastic, sheet metal or other methods acceptable to the enforcing agency to reduce the amount of water, dust or debris which may enter the system.

4.504.2 FINISH MATERIAL POLLUTANT CONTROL. Finish materials shall comply with this section.

4.504.2.1 Adhesives, Sealants and Caulks. Adhesives, sealant and caulks used on the project shall meet the requirements of the following standards unless more stringent local or regional air pollution or air quality management district rules apply:

- Adhesives, adhesive bonding primers, adhesive primers, sealants, sealant primers and caulks shall comply with local or regional air pollution control or air quality management district rules where applicable or SCAQMD Rule 1168 VOC limits, as shown in Table 4.504.1 or 4.504.2, as applicable. Such products also shall comply with the Rule 1168 prohibition on the use of certain toxic compounds (chloroform, ethylene dichloride, methylene chloride, perchloroethylene and trichloroethylene), except for aerosol products, as specified in Subsection 2 below.
- Aerosol adhesives, and smaller unit sizes of adhesives, and sealant or caulking compounds (in units of product, less packaging, which do not weigh more than 1 pound and do not consist of more than 16 fluid ounces) shall comply with statewide VOC standards and other requirements, including prohibitions on use of certain toxic compounds, of *California Code of Regulations*, Title 17, commencing with section 94507.

4.504.2.2 Paints and Coatings. Architectural paints and coatings shall comply with VOC limits in Table 1 of the ARB Architectural Suggested Control Measure, as shown in Table 4.504.3, unless more stringent local limits apply. The VOC content limit for coatings that do not meet the definitions for the specialty coatings categories listed in Table 4.504.3 shall be determined by classifying the coating as a Flat, Nonflat or Nonflat-High Gloss coating, based on its gloss, as defined in subsections 4.21, 4.36, and 4.37 of the 2007 California Air Resources Board, Suggested Control Measure, and the corresponding Flat, Nonflat or Nonflat-High Gloss VOC limit in Table 4.504.3 shall apply.

4.504.2.3 Aerosol Paints and Coatings. Aerosol paints and coatings shall meet the Product-weighted MIR Limits for ROC in Section 94522(a)(2) and other requirements, including prohibitions on use of certain toxic compounds and ozone depleting substances, in Sections 94522(e)(1) and (f)(1) of *California Code of Regulations*, Title 17, commencing with Section 94520; and in areas under the jurisdiction of the Bay Area Air Quality Management District additionally comply with the percent VOC by weight of product limits of Regulation 8, Rule 49.

4.504.2.4 Verification. Verification of compliance with this section shall be provided at the request of the enforcing agency. Documentation may include, but is not limited to, the following:

- Manufacturer's product specification.
- Field verification of on-site product containers.

TABLE 4.504.1 - ADHESIVE VOC LIMIT_{1,2}

(Less Water and Less Exempt Compounds in Grams per Liter)

ARCHITECTURAL APPLICATIONS	VOC LIMIT
INDOOR CARPET ADHESIVES	50
CARPET PAD ADHESIVES	50
OUTDOOR CARPET ADHESIVES	150
WOOD FLOORING ADHESIVES	100
RUBBER FLOOR ADHESIVES	60
SUBFLOOR ADHESIVES	50
CERAMIC TILE ADHESIVES	65
VCT & ASPHALT TILE ADHESIVES	50
DRYWALL & PANEL ADHESIVES	50
COVE BASE ADHESIVES	50
MULTIPURPOSE CONSTRUCTION ADHESIVE	70
STRUCTURAL GLAZING ADHESIVES	100
SINGLE-PLY ROOF MEMBRANE ADHESIVES	250
OTHER ADHESIVES NOT LISTED	50
SPECIALTY APPLICATIONS	
PVC WELDING	510
CPVC WELDING	490
ABS WELDING	325
PLASTIC CEMENT WELDING	250
ADHESIVE PRIMER FOR PLASTIC	550
CONTACT ADHESIVE	80
SPECIAL PURPOSE CONTACT ADHESIVE	250
STRUCTURAL WOOD MEMBER ADHESIVE	140
TOP & TRIM ADHESIVE	250
SUBSTRATE SPECIFIC APPLICATIONS	
METAL TO METAL	30
PLASTIC FOAMS	50
POROUS MATERIAL (EXCEPT WOOD)	50
WOOD	30
FIBERGLASS	80

1. IF AN ADHESIVE IS USED TO BOND DISSIMILAR SUBSTRATES TOGETHER, THE ADHESIVE WITH THE HIGHEST VOC CONTENT SHALL BE ALLOWED.

2. FOR ADDITIONAL INFORMATION REGARDING METHODS TO MEASURE THE VOC CONTENT SPECIFIED IN THIS TABLE, SEE SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT RULE 1168.

TABLE 4.504.2 - SEALANT VOC LIMIT

(Less Water and Less Exempt Compounds in Grams per Liter)

SEALANTS	VOC LIMIT
ARCHITECTURAL	250
MARINE DECK	760
NONMEMBRANE ROOF	300
ROADWAY	250
SINGLE-PLY ROOF MEMBRANE	450
OTHER	420
SEALANT PRIMERS	
ARCHITECTURAL	250
NON-POROUS	250
POROUS	775
MODIFIED BITUMINOUS	500
MARINE DECK	760
OTHER	750

TABLE 4.504.3 - VOC CONTENT LIMITS FOR ARCHITECTURAL COATINGS_{1,3}

GRAMS OF VOC PER LITER OF COATING, LESS WATER & LESS EXEMPT COMPOUNDS

COATING CATEGORY	VOC LIMIT
FLAT COATINGS	50
NON-FLAT COATINGS	100
NONFLAT-HIGH GLOSS COATINGS	150
SPECIALTY COATINGS	
ALUMINUM ROOF COATINGS	400
BASEMENT SPECIALTY COATINGS	400
BITUMINOUS ROOF COATINGS	50
BITUMINOUS ROOF PRIMERS	350
BOND BREAKERS	350
CONCRETE CURING COMPOUNDS	350
CONCRETE/MASONRY SEALERS	100
DRIVEWAY SEALERS	50
DRY FOG COATINGS	150
FAUX FINISHING COATINGS	350
FIRE RESISTIVE COATINGS	350
FLOOR COATINGS	100
FORM-RELEASE COMPOUNDS	250
GRAPHIC ARTS COATINGS (SIGN PAINTS)	500
HIGH TEMPERATURE COATINGS	420
INDUSTRIAL MAINTENANCE COATINGS	250
LOW SOLIDS COATINGS ₁	120
MAGNESITE CEMENT COATINGS	450
MASTIC TEXTURE COATINGS	100
METALLIC PIGMENTED COATINGS	500
MULTICOLOR COATINGS	250
PRETREATMENT WASH PRIMERS	420
PRIMERS, SEALERS, & UNDERCOATERS	100
REACTIVE PENETRATING SEALERS	350
RECYCLED COATINGS	250
ROOF COATINGS	50
RUST PREVENTATIVE COATINGS	250
SHELLACS	
CLEAR	730
OPAQUE	550
SPECIALTY PRIMERS, SEALERS & UNDERCOATERS	100
STAINS	250
STONE CONSOLIDANTS	450
SWIMMING POOL COATINGS	340
TRAFFIC MARKING COATINGS	100
TUB & TILE REFINISH COATINGS	420
WATERPROOFING MEMBRANES	250
WOOD COATINGS	275
WOOD PRESERVATIVES	350
ZINC-RICH PRIMERS	340

1. GRAMS OF VOC PER LITER OF COATING, INCLUDING WATER & EXEMPT COMPOUNDS

2. THE SPECIFIED LIMITS REMAIN IN EFFECT UNLESS REVISED LIMITS ARE LISTED IN SUBSEQUENT COLUMNS IN THE TABLE.

3. VALUES IN THIS TABLE ARE DERIVED FROM THOSE SPECIFIED BY THE CALIFORNIA AIR RESOURCES BOARD, ARCHITECTURAL COATINGS SUGGESTED CONTROL MEASURE, FEB. 1, 2008. MORE INFORMATION IS AVAILABLE FROM THE AIR RESOURCES BOARD.

TABLE 4.504.5 - FORMALDEHYDE LIMITS:

MAXIMUM FORMALDEHYDE EMISSIONS IN PARTS PER MILLION

PRODUCT	CURRENT LIMIT
HARDWOOD PLYWOOD VENEER CORE	0.05
HARDWOOD PLYWOOD COMPOSITE CORE	0.05
PARTICLE BOARD	0.09
MEDIUM DENSITY FIBERBOARD	0.11
THIN MEDIUM DENSITY FIBERBOARD ₂	0.13

1. VALUES IN THIS TABLE ARE DERIVED FROM THOSE SPECIFIED BY THE CALIF. AIR RESOURCES BOARD, AIR TOXICS CONTROL MEASURE FOR COMPOSITE WOOD AS TESTED IN ACCORDANCE WITH ASTM E 1333. FOR ADDITIONAL INFORMATION, SEE CALIF. CODE OF REGULATIONS, TITLE 17, SECTIONS 93120 THROUGH 93120.12.

2. THIN MEDIUM DENSITY FIBERBOARD HAS A MAXIMUM THICKNESS OF 5/16" (8 MM).

DIVISION 4.5 ENVIRONMENTAL QUALITY (continued)

4.504.3 CARPET SYSTEMS. All carpet installed in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specification 01350).

See California Department of Public Health's website for certification programs and testing labs.

<https://www.cdph.ca.gov/Programs/CDC/PHP/DEODC/EHLB/IAQ/Pages/VOC.aspx>.

4.504.3.1 Carpet cushion. All carpet cushion installed in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specification 01350).

See California Department of Public Health's website for certification programs and testing labs.

<https://www.cdph.ca.gov/Programs/CDC/PHP/DEODC/EHLB/IAQ/Pages/VOC.aspx>.

4.504.3.2 Carpet adhesive. All carpet adhesive shall meet the requirements of Table 4.504.1.

4.504.4 RESILIENT FLOORING SYSTEMS. Where resilient flooring is installed, at least 80% of floor area receiving resilient flooring shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specification 01350).

See California Department of Public Health's website for certification programs and testing labs.

<https://www.cdph.ca.gov/Programs/CDC/PHP/DEODC/EHLB/IAQ/Pages/VOC.aspx>.

4.504.5 COMPOSITE WOOD PRODUCTS. Hardwood plywood, particleboard and medium density fiberboard composite wood products used on the interior or exterior of the buildings shall meet the requirements for formaldehyde as specified in ARB's Air Toxics Control Measure for Composite Wood (17 CCR 93120 et seq.), by or before the dates specified in those sections, as shown in Table 4.504.5.

4.504.5.1 Documentation. Verification of compliance with this section shall be provided as requested by the enforcing agency. Documentation shall include at least one of the following:

- Product certifications and specifications.
- Chain of custody certifications.
- Product labeled and invoiced as meeting the Composite Wood Products regulation (see CCR, Title 17, Section 93120, et seq.).
- Exterior grade products marked as meeting the PS-1 or PS-2 standards of the Engineered Wood Association, the Australian AS/NZS 2269, European E36 3S standards, and Canadian CSA 0121, CSA 0151, CSA 0153 and CSA 0325 standards.
- Other methods acceptable to the enforcing agency.

4.505 INTERIOR MOISTURE CONTROL

4.505.1 General. Buildings shall meet or exceed the provisions of the *California Building Standards Code*.

4.505.2 CONCRETE SLAB FOUNDATIONS. Concrete slab foundations required to have a vapor retarder by California Building Code, Chapter 19, or concrete slab-on-ground floors required to have a vapor retarder by the California Residential Code, Chapter 5, shall also comply with this section.

4.505.2.1 Capillary break. A capillary break shall be installed in compliance with at least one of the following:

- A 4-inch (101.6 mm) thick base of 1/2 inch (12.7mm) or larger clean aggregate shall be provided with a vapor barrier in direct contact with concrete and a concrete mix design, which will address bleeding, shrinkage, and curling, shall be used. For additional information, see American Concrete Institute, ACI 302.2R-06.
- Other equivalent methods approved by the enforcing agency.
- A slab design specified by a licensed design professional.

4.505.3 MOISTURE CONTENT OF BUILDING MATERIALS. Building materials with visible signs of water damage shall not be installed. Wall and floor framing shall not be enclosed when the framing members exceed 19 percent moisture content. Moisture content shall be verified in compliance with the following:

- Moisture content shall be determined with either a probe-type or contact-type moisture meter. Equivalent moisture verification methods may be approved by the enforcing agency and shall satisfy requirements found in Section 101.8 of this code.
- Moisture readings shall be taken at a point 2 feet (610 mm) to 4 feet (1219 mm) from the grade stamped end of each piece verified.
- At least three random moisture readings shall be performed on wall and floor framing with documentation acceptable to the enforcing agency provided at the time of approval to enclose the wall and floor framing.

Insulation products which are visibly wet or have a high moisture content shall be replaced or allowed to dry prior to enclosure in wall or floor cavities. Wet-applied insulation products shall follow the manufacturers' drying recommendations prior to enclosure.

4.506 INDOOR AIR QUALITY AND EXHAUST

4.506.1 Bathroom exhaust fans. Each bathroom shall be mechanically ventilated and shall comply with the following:

- Fans shall be ENERGY STAR compliant and be ducted to terminate outside the building.
- Unless functioning as a component of a whole house ventilation system, fans must be controlled by a humidity control.
 - Humidity controls shall be capable of adjustment between a relative humidity range less than or equal to 50% to a maximum of 80%. A humidity control may utilize manual or automatic means of adjustment.
 - A humidity control may be a separate component to the exhaust fan and is not required to be integral (i.e., built-in).

Notes:

- For the purposes of this section, a bathroom is a room which contains a bathtub, shower or tub/shower combination.
- Lighting integral to bathroom exhaust fans shall comply with the *California Energy Code*.

4.507 ENVIRONMENTAL COMFORT

4.507.2 HEATING AND AIR-CONDITIONING SYSTEM DESIGN. Heating and air conditioning systems shall be sized, designed and have their equipment selected using the following methods:

- The heat loss and heat gain is established according to ANSI/ACCA 2 Manual J - 2011 (Residential Load Calculation), ASHRAE handbooks or other equivalent design software or methods.
- Duct systems are sized according to ANSI/ACCA 1 Manual D - 2014 (Residential Duct Systems), ASHRAE handbooks or other equivalent design software or methods.
- Select heating and cooling equipment according to ANSI/ACCA 3 Manual S - 2014 (Residential Equipment Selection), or other equivalent design software or methods.

Exception: Use of alternate design temperatures necessary to ensure the system functions are acceptable.

CHAPTER 7

INSTALLER & SPECIAL INSPECTOR QUALIFICATIONS

702 QUALIFICATIONS

702.1 INSTALLER TRAINING. HVAC system installers shall be trained and certified in the proper installation of HVAC systems including ducts and equipment by a nationally or regionally recognized training or certification program. Uncertified persons may perform HVAC installations when under the direct supervision and responsibility of a person trained and certified to install HVAC systems or contractor licensed to install HVAC systems. Examples of acceptable HVAC training and certification programs include but are not limited to the following:

- State certified apprenticeship programs.
- Public utility training programs.
- Training programs sponsored by trade, labor or statewide energy consulting or verification organizations.
- Programs sponsored by manufacturing organizations.
- Other programs acceptable to the enforcing agency.

702.2 SPECIAL INSPECTION [HCD]. When required by the enforcing agency, the owner or the responsible entity acting as the owner's agent shall employ one or more special inspectors to provide inspection or other duties necessary to substantiate compliance with this code. Special inspectors shall demonstrate competence to the satisfaction of the enforcing agency for the particular type of inspection or task to be performed. In addition to other certifications or qualifications acceptable to the enforcing agency, the following certifications or education may be considered by the enforcing agency when evaluating the qualifications of a special inspector:

- Certification by a national or regional green building program or standard publisher.
- Certification by a statewide energy consulting or verification organization, such as HERS raters, building performance contractors, and home energy auditors.
- Successful completion of a third party apprentice training program in the appropriate trade.
- Other programs acceptable to the enforcing agency.

Notes:

- Special inspectors shall be independent entities with no financial interest in the materials or the project they are inspecting for compliance with this code.
- HERS raters are special inspectors certified by the California Energy Commission (CEC) to rate homes in California according to the Home Energy Rating System (HERS).

[BSC] When required by the enforcing agency, the owner or the responsible entity acting as the owner's agent shall employ one or more special inspectors to provide inspection or other duties necessary to substantiate compliance with this code. Special inspectors shall demonstrate competence to the satisfaction of the enforcing agency for the particular type of inspection or task to be performed. In addition, the special inspector shall have a certification from a recognized state, national or international association, as determined by the local agency. The area of certification shall be closely related to the primary job function, as determined by the local agency.

Note: Special inspectors shall be independent entities with no financial interest in the materials or the project they are inspecting for compliance with this code.

703 VERIFICATIONS

703.1 DOCUMENTATION. Documentation used to show compliance with this code shall include but is not limited to, construction documents, plans, specifications, builder or installer certification, inspection reports, or other methods acceptable to the enforcing agency which demonstrate substantial conformance. When specific documentation or special inspection is necessary to verify compliance, that method of compliance will be specified in the appropriate section or identified applicable checklist.

ADU: 999 L-SHAPE
CITY OF CHULA VISTA
276 FOURTH AVENUE,
CHULA VISTA, CA 91910

DESIGNER:

LUIS CALDERON
SnapADU

SIGNATURE

RELEASE DATE 03/22/2024 BY APP. LAG RELEASED FOR...

CAL-GREEN
REQUIREMENTS

G301

22040

GENERAL INFORMATION											
01	Project Name 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 3BR SOG										
02	Run Title Title 24 Analysis										
03	Project Location 276 4th Avenue										
04	City	Chula Vista	05	Standards Version 2022							
06	Zip code	91910	07	Software Version EnergyPro 9.2							
08	Climate Zone	7	09	Front Orientation (deg/ Cardinal) All orientations							
10	Building Type	Single family	11	Number of Dwelling Units 1							
12	Project Scope		13	Number of Bedrooms 3							
14	Addition Cond. Floor Area (ft²)		15	Number of Stories 1							
16	Existing Cond. Floor Area (ft²)		17	Fenestration Average U-factor 0.3							
18	Total Cond. Floor Area (ft²)		19	Glazing Percentage (%) 13.51%							
20	ADU Bedroom Count		21	ADU Conditioned Floor Area n/a							
22	Fuel Type		23	No Dwelling Unit: No							

COMPLIANCE RESULTS											
01	Building Complies with Computer Performance										
02	This building incorporates features that require field testing and/or verification by a certified HERS rater under the supervision of a CEC-approved HERS provider.										
03	This building incorporates one or more Special Features shown below										

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 3BR SOG

Calculation Date/Time: 2023-11-01T13:41:42-07:00

Input File Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 3BR SOG.rbd22x

CF1R-PRF-01E
(Page 4 of 12)

ENERGY USE SUMMARY						
Energy Use	Standard Design Source Energy (EDR1) (kBtu/ft² · yr)	Standard Design TDV Energy (EDR2) (kTDV/ft² · yr)	Proposed Design Source Energy (EDR1) (kBtu/ft² · yr)	Proposed Design TDV Energy (EDR2) (kTDV/ft² · yr)	Compliance Margin (EDR1)	Compliance Margin (EDR2)
Space Heating	0.07	0.32	0.42	3.1	-0.35	-2.78
Space Cooling	0.66	13.93	0.14	4.26	0.52	9.67
IAQ Ventilation	0.46	4.94	0.46	4.94	0	0
Water Heating	2.08	23.3	1.61	18.78	0.47	4.52
Self Utilization/Flexibility Credit				0		0
South Facing Efficiency Compliance Total	3.27	42.49	2.63	31.08	0.64	11.41
Space Heating	0.07	0.32	0.38	2.75	-0.31	-2.43
Space Cooling	0.66	13.93	0.27	6.82	0.39	7.11
IAQ Ventilation	0.46	4.94	0.46	4.94	0	0
Water Heating	2.08	23.3	1.61	18.7	0.47	4.6
Self Utilization/Flexibility Credit				0		0
West Facing Efficiency Compliance Total	3.27	42.49	2.72	33.21	0.55	9.28

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 3BR SOG

Calculation Date/Time: 2023-11-01T13:41:42-07:00

Input File Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 3BR SOG.rbd22x

CF1R-PRF-01E
(Page 7 of 12)

OPAQUE SURFACES													
01	02	03	04	05	06	07	08	09	10	11	12	13	08
Name	Zone	Construction	Azimuth	Orientation	Gross Area (ft²)	Window and Door Area (ft2)	Tilt (deg)						
New Front Wall	New ADU	R-21 Wall	0	Front	294	59	0	90					
New Left Wall	New ADU	R-21 Wall	90	Left	257	0	90						
New Back Wall	New ADU	R-21 Wall	180	Back	306	72	90						
New Right Wall	New ADU	R-21 Wall	270	Right	259	24	90						
New Roof Attic	New ADU	R-30 Roof Attic	n/a	n/a	489	n/a	n/a						
New Roof Attic 2	New ADU	R-30 Roof Attic	n/a	n/a	510	n/a	n/a						

ATTIC													
01	02	03	04	05	06	07	08						
Name	Construction	Type	Roof Rise (x in 12)	Roof Reflectance	Roof Emittance	Radiant Barrier	Cool Roof						
Attic New ADU	Attic Roof/New ADU	Ventilated	3.76577	0.1	0.85	Yes	No						

FENESTRATION / GLAZING													
01	02	03	04	05	06	07	08	09	10	11	12	13	14
Name	Type	Surface	Orientation	Azimuth	Width (ft)	Height (ft)	Mult.	Area (ft²)	U-factor	U-factor Source	SHGC	SHGC Source	Exterior Shading
Window W8	Window	New Front Wall	Front	0			1	12	0.3	NFRC	0.23	NFRC	Bug Screen
Window W7	Window	New Front Wall	Front	0			1	3	0.3	NFRC	0.23	NFRC	Bug Screen
Window W6	Window	New Front Wall	Front	0			1	24	0.3	NFRC	0.23	NFRC	Bug Screen
Window W5	Window	New Back Wall	Back	180			1	24	0.3	NFRC	0.23	NFRC	Bug Screen
Window W4	Window	New Back Wall	Back	180			1	24	0.3	NFRC	0.23	NFRC	Bug Screen
Window W3	Window	New Back Wall	Back	180			1	24	0.3	NFRC	0.23	NFRC	Bug Screen
Window W2	Window	New Right Wall	Right	270			1	12	0.3	NFRC	0.23	NFRC	Bug Screen

Registration Number: 423-P010198896A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 11/01/2023 15:36
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CHEERS
Report Generated: 2023-11-01 13:42:26

ENERGY DESIGN RATINGS						
	Energy Design Ratings			Compliance Margins		
	Source Energy (EDR1)	Efficiency ¹ EDR (EDR2efficiency)	Total ² EDR (EDR2total)	Source Energy (EDR1)	Efficiency ¹ EDR (EDR2efficiency)	Total ² EDR (EDR2total)
Standard Design	39	49.3	35.6			
Proposed Design						
North Facing	36.8	36.2	30.7	2.2	13.1	4.9
East Facing	37.5	39.4	31.9	1.5	9.9	3.7
South Facing	36.9	36.1	30.7	2.1	13.2	4.9
West Facing	37.2	38.6	31.6	1.8	10.7	4
RESULT ³ : PASS						
¹ Efficiency EDR includes improvements like a better building envelope and more efficient equipment. ² Total EDR includes efficiency and demand response measures such as photovoltaic (PV) system and batteries ³ Building complies when source energy, efficiency and total compliance margins are greater than or equal to zero and unmet load hour limits are not exceeded						
• Standard Design PV Capacity: 2.33 kWdc • Proposed PV Capacity Scaling: North (2.33 kWdc) East (2.33 kWdc) South (2.33 kWdc) West (2.33 kWdc)						

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 3BR SOG

Calculation Date/Time: 2023-11-01T13:41:42-07:00

Input File Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 3BR SOG.rbd22x

CF1R-PRF-01E
(Page 5 of 12)

ENERGY USE INTENSITY				
	Standard Design (kBtu/ft² · yr)	Proposed Design (kBtu/ft² · yr)	Compliance Margin (kBtu/ft² · yr)	Margin Percentage
North Facing				
Gross EU1	19.87	18.69	1.18	5.94
Net EU1	7.33	6.14	1.19	16.23
East Facing				
Gross EU1	19.87	18.94	0.93	4.68
Net EU1	7.33	6.39	0.94	12.82
South Facing				
Gross EU1	19.87	18.71	1.16	5.84
Net EU1	7.33	6.16	1.17	15.96
West Facing				
Gross EU1	19.87	18.87	1	5.03
Net EU1	7.33	6.32	1.01	13.78
Notes 1. Gross EU1 is Energy Use Total (not including PV) / Total Building Area. 2. Net EU1 is Energy Use Total (including PV) / Total Building Area.				

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 3BR SOG

Calculation Date/Time: 2023-11-01T13:41:42-07:00

Input File Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 3BR SOG.rbd22x

CF1R-PRF-01E
(Page 8 of 12)

FENESTRATION / GLAZING													
01	02	03	04	05	06	07	08	09	10	11	12	13	14
Name	Type	Surface	Orientation	Azimuth	Width (ft)	Height (ft)	Mult.	Area (ft²)	U-factor	U-factor Source	SHGC	SHGC Source	Exterior Shading
Window W1	Window	New Right Wall	Right	270			1	12	0.3	NFRC	0.23	NFRC	Bug Screen

OPAQUE DOORS			
01	02	03	04
Name	Side of Building	Area (ft²)	U-factor
Front Door D1	New Front Wall	20	0.2

SLAB FLOORS							
01	02	03	04	05	06	07	08
Name	Zone	Area (ft²)	Perimeter (ft)	Edge Insul. R-value and Depth	Edge Insul. R-value and Depth	Carpeted Fraction	Heated
New Slab-on-Grade	New ADU	999	0.1	none	0	80%	No

OPAQUE SURFACE CONSTRUCTIONS							
01	02	03	04	05	06	07	08
Construction Name	Surface Type	Construction Type	Framing	Total Cavity R-value	Interior / Exterior Continuous R-value	U-factor	Assembly Layers
R-21 Wall	Exterior Walls	Wood Framed Wall	2x6 @ 16 in. O. C.	R-21	None / None	0.069	Inside Finish: Gypsum Board Cavity / Frame: R-21 / 2x6 Exterior Finish: 3 Coat Stucco
Attic Roof/New ADU	Attic Roofs	Wood Framed Ceiling	2x4 @ 24 in. O. C.	R-0	None / 0	0.644	Roofing: Light Roof (Asphalt Shingle) Roof Deck: Wood Siding/sheathing/decking Cavity / Frame: no Insul. / 2x4

ENERGY USE SUMMARY						
Energy Use	Standard Design Source Energy (EDR1) (kBtu/ft² · yr)	Standard Design TDV Energy (EDR2) (kTDV/ft² · yr)	Proposed Design Source Energy (EDR1) (kBtu/ft² · yr)	Proposed Design TDV Energy (EDR2) (kTDV/ft² · yr)	Compliance Margin (EDR1)	Compliance Margin (EDR2)
Space Heating	0.07	0.32	0.32	2.33	-0.25	-2.01
Space Cooling	0.66	13.93	0.19	5.16	0.47	8.77
IAQ Ventilation	0.46	4.94	0.46	4.94	0	0
Water Heating	2.08	23.3	1.61	18.73	0.47	4.57
Self Utilization/Flexibility Credit				0		0
North Facing Efficiency Compliance Total	3.27	42.49	2.58	31.16	0.69	11.33
Space Heating	0.07	0.32	0.47	3.49	-0.4	-3.17
Space Cooling	0.66	13.93	0.28	6.81	0.38	7.12
IAQ Ventilation	0.46	4.94	0.46	4.94	0	0
Water Heating	2.08	23.3	1.61	18.73	0.47	4.57
Self Utilization/Flexibility Credit				0		0
East Facing Efficiency Compliance Total	3.27	42.49	2.82	33.97	0.45	8.52



CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD Project Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 3BR SOG Calculation Description: Title 24 Analysis										Calculation Date/Time: 2023-10-11T13:41:42-07:00 Input File Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 3BR SOG: rld22x		
WATER HEATING - HERS VERIFICATION												
01	02	03		04	05	06		07				
Name	Pipe Insulation	Parallel Piping		Compact Distribution	Compact Distribution Type	Recirculation Control		Shower Drain Water Heat Recovery				
DHW Sys 1 - 1/1	Not Required	Not Required		Not Required	None	Not Required		Not Required				
SPACE CONDITIONING SYSTEMS												
01	02	03	04	05	06	07	08	09				
Name	System Type	Heating Unit Name	Heating Equipment Count	Cooling Unit Name	Cooling Equipment Count	Fan Name	Distribution Name	Required Thermostat Type				
New HVAC1	Heat pump heating cooling	Heat Pump System 1	1	Heat Pump System 1	1	n/a	n/a	Setback				
HVAC - HEAT PUMPS												
01	02	03	04	05	06	07	08	09	10	11	12	13
Name	System Type	Number of Units	Heating			Cooling Efficiency Type	SEER/SEER2	EER/EEER2/CEER	Zonally Controlled	Compressor Type	HERS Verification	
			Heating Efficiency Type	HSPF/HSPF2/COP	Cap 47	Cap 17						
Heat Pump System 1	Ductless MiniSplit HP	1	HSPF2	7.5	36000	24000	EER2SEER2	14.3	11.7	Not Zonal	Single Speed	Heat Pump System 1-hers-htpump
HVAC HEAT PUMPS - HERS VERIFICATION												
01	02	03	04	05	06	07	08	09	10	11	12	13
Name	Verified Airflow	Airflow Target	Verified EER/EEER2	Verified SEER/SEER2	Verified Refrigerant Charge	Verified HSPF/HSPF2	Verified Heating Cap 47	Verified Heating Cap 17				
Heat Pump System 1-hers-htpump	Not Required	0	Not Required	Not Required	No	No	Yes	Yes				

Registration Number: 423-P010198896A-000-000-0000000-0000	Registration Date/Time: 11/01/2023 15:36	HERS Provider: CHEERS
<p><i>NOTICE: This document has been generated by California Home Energy Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and does not guarantee the accuracy or completeness of the information contained in this document.</i></p>		
CA Building Energy Efficiency Standards - 2022 Residential Compliance	Report Version: 2022.0.000	Report Generated: 2023-11-01 13:42:26
	Schema Version: rev 20220901	

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD Project Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 3BR SOG Calculation Description: Title 24 Analysis										CF1R-PRF-01E (Page 11 of 12)
Calculation Date/Time: 2023-11-01T13:41:42-07:00 Input File Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 3BR SOG.rbd22x										

INDOOR AIR QUALITY (IAQ) FANS									
01	02	03	04	05	06	07	08	09	
Dwelling Unit	Airflow (CFM)	Fan Efficacy (W/CFM)	IAQ Fan Type	Includes Heat/Energy Recovery?	IAQ Recovery Effectiveness - SRE/ASRE	Includes Fan? Includes Display?	HERS Verification	Status	
SfAm IAQVentRgt	60	0.35	Exhaust	No	n/a / n/a	No	Yes		

Registration Number: 423-P010198896A-000-000-0000000-0000 Registration Date/Time: 11/01/2023 15:36 HERS Provider: CHEERS
 NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
 CA Building Energy Efficiency Standards - 2022 Residential Compliance Report Version: 2022.0.000 Report Generated: 2023-11-01 13:42:26
 Schema Version: rev 20220901

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD Project Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 3BR SOG		Calculation Date/Time: 2023-10-11T13:41:42-07:00 Input File Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 3BR SOG-rb22x
Calculation Description: Title 24 Analysis		
DOCUMENTATION AUTHOR'S DECLARATION STATEMENT I, 1. certify that this Certificate of Compliance documentation is accurate and complete.		
Documentation Author Name: Kenneth Ponce	Documentation Author Signature: 	
Company: So Cal Title 24	Signature Date: 11/01/2023	
Address: 8659 Red Oak Street, Suite I	CEA/ HERS Certification Identification (If applicable):	
City/State/Zip: Rancho Cucamonga, CA 91730	Phone: 909-257-7547	
RESPONSIBLE PERSON'S DECLARATION STATEMENT I certify the following, under penalty of perjury, under the laws of the State of California:		
1. I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design identified on this Certificate of Compliance. 2. I certify that the energy features and performance specifications identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations. 3. The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.		
Responsible Designer Name: Mike Moore	Responsible Designer Signature: 	
Company: Snap ADU	Date Signed: 11/01/2023	
Address: PO Box 2685	License:	
City/State/Zip: Carlsbad, CA 92018	Phone: (760) 259-1985	


Digitally signed by California Home Energy Efficiency Rating Services (CHEERS). This digital signature is provided in order to secure the content of this registered document, and in no way implies Registration Provider responsibility for the accuracy of the information.

Registration Number: 423-P010198896A-000-000-0000000-0000 Registration Date/Time: 11/01/2023 15:36 HERS Provider: CHEERS
 NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee the accuracy or completeness of the information contained in this document.
 CA Building Energy Efficiency Standards - 2022 Residential Compliance Report Version: 2022.0.000 Report Generated: 2023-11-01 13:42:26
 Schema Version: rev 20220901



ADU: 999 L-SHAPE
CITY OF CHULA VISTA
276 FOURTH AVENUE,
CHULA VISTA, CA 91910

DESIGNER:
LUIS CALDERON
SnapADU


SIGNATURE

[illegible]

TITLE 24 - 3-BEDROOM SOG - CZ7
G403
22040

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 3BR RF

Calculation Description: Title 24 Analysis

CF1R-PRF-01E

Calculation Date/Time: 2023-11-01T13:55:41-07:00

Input File Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 3BR RF.rbd22zx

Page 1 of 11

GENERAL INFORMATION													
01	Project Name		2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 3BR RF										
02	Run Title		Title 24 Analysis										
03	Project Location		276 4th Avenue										
04	City	Chula Vista	05	Standards Version		2022							
06	Zip code	91910	07	Software Version		EnergyPro 9.2							
08	Climate Zone	7	09	Front Orientation (deg/ Cardinal)		All orientations							
10	Building Type	Single family	11	Number of Dwelling Units		1							
12	Project Scope	Newly Constructed	13	Number of Bedrooms		3							
14	Addition Cond. Floor Area (ft²)		0	Number of Stories		1							
16	Existing Cond. Floor Area (ft²)		n/a	Fenestration Average U-factor		0.3							
18	Total Cond. Floor Area (ft²)		999	Glazing Percentage (%)		13.51%							
20	ADU Bedroom Count		n/a	ADU Conditioned Floor Area		n/a							
22	Fuel Type		Natural gas	No Dwelling Unit:		No							

COMPLIANCE RESULTS	
01	Building Complies with Computer Performance
02	This building incorporates features that require field testing and/or verification by a certified HERS rater under the supervision of a CEC-approved HERS provider.
03	This building incorporates one or more Special Features shown below

Registration Number: 423-P010198897A-000-000-0000000-0000

Registration Date/Time: 11/01/2023 15:37

HERS Provider: CHEERS

NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.

CA Building Energy Efficiency Standards - 2022 Residential Compliance

Report Version: 2022.0.000

Schema Version: rev 20220901

Report Generated: 2023-11-01 13:56:25

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 3BR RF

Calculation Description: Title 24 Analysis

CF1R-PRF-01E

Calculation Date/Time: 2023-11-01T13:55:41-07:00

Input File Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 3BR RF.rbd22zx

Page 4 of 11

ENERGY USE SUMMARY						
Energy Use	Standard Design Source Energy (EDR1) (kBtu/ft² - yr)	Standard Design TDV Energy (EDR2) (kTDV/ft² - yr)	Proposed Design Source Energy (EDR1) (kBtu/ft² - yr)	Proposed Design TDV Energy (EDR2) (kTDV/ft² - yr)	Compliance Margin (EDR1)	Compliance Margin (EDR2)
Space Heating	0.1	0.46	0.35	2.59	-0.25	-2.13
Space Cooling	1.01	19.68	0.43	9.93	0.58	9.75
IAQ Ventilation	0.46	4.94	0.46	4.94	0	0
Water Heating	2.07	23.25	1.61	18.67	0.46	4.58
Self Utilization/Flexibility Credit				0		0
South Facing Efficiency Compliance Total	3.64	48.33	2.85	36.13	0.79	12.2
Space Heating	0.1	0.46	0.32	2.31	-0.22	-1.85
Space Cooling	1.01	19.68	0.57	12.49	0.44	7.19
IAQ Ventilation	0.46	4.94	0.46	4.94	0	0
Water Heating	2.07	23.25	1.6	18.57	0.47	4.68
Self Utilization/Flexibility Credit				0		0
West Facing Efficiency Compliance Total	3.64	48.33	2.95	38.31	0.69	10.02

Registration Number: 423-P010198897A-000-000-0000000-0000

Registration Date/Time: 11/01/2023 15:37

HERS Provider: CHEERS

NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.

CA Building Energy Efficiency Standards - 2022 Residential Compliance

Report Version: 2022.0.000

Schema Version: rev 20220901

Report Generated: 2023-11-01 13:56:25

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 3BR RF

Calculation Description: Title 24 Analysis

CF1R-PRF-01E

Calculation Date/Time: 2023-11-01T13:55:41-07:00

Input File Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 3BR RF.rbd22zx

Page 7 of 11

OPAQUE SURFACES													
01	02	03	04	05	06	07	08						
Name	Zone	Construction	Azimuth	Orientation	Gross Area (ft²)	Window and Door Area (ft2)	Tilt (deg)						
New Front Wall	New ADU	R-21 Wall	0	Front	294	59	90						
New Left Wall	New ADU	R-21 Wall	90	Left	257	0	90						
New Back Wall	New ADU	R-21 Wall	180	Back	306	72	90						
New Right Wall	New ADU	R-21 Wall	270	Right	259	24	90						
New Roof Attic	New ADU	R-30 Roof Attic	n/a	n/a	489	n/a	n/a						
New Roof Attic 2	New ADU	R-30 Roof Attic	n/a	n/a	510	n/a	n/a						
New Raised Floor	New ADU	R-19 Floor Crawlspace	n/a	n/a	999	n/a	n/a						
ATTIC													
01	02	03	04	05	06	07	08						
Name	Construction	Type	Roof Rise (x in 12)	Roof Reflectance	Roof Emittance	Radiant Barrier	Cool Roof						
Attic New ADU	Attic RoofNew ADU	Ventilated	3.76577	0.1	0.85	Yes	No						
FENESTRATION / GLAZING													
01	02	03	04	05	06	07	08	09	10	11	12	13	14
Name	Type	Surface	Orientation	Azimuth	Width (ft)	Height (ft)	Mult.	Area (ft²)	U-factor	U-factor Source	SHGC	SHGC Source	Exterior Shading
Window W8	Window	New Front Wall	Front	0			1	12	0.3	NFRC	0.23	NFRC	Bug Screen
Window W7	Window	New Front Wall	Front	0			1	3	0.3	NFRC	0.23	NFRC	Bug Screen
Window W6	Window	New Front Wall	Front	0			1	24	0.3	NFRC	0.23	NFRC	Bug Screen
Window W5	Window	New Back Wall	Back	180			1	24	0.3	NFRC	0.23	NFRC	Bug Screen
Window W4	Window	New Back Wall	Back	180			1	24	0.3	NFRC	0.23	NFRC	Bug Screen
Window W3	Window	New Back Wall	Back	180			1	24	0.3	NFRC	0.23	NFRC	Bug Screen

Registration Number: 423-P010198897A-000-000-0000000-0000

Registration Date/Time: 11/01/2023 15:37

HERS Provider: CHEERS

NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.

CA Building Energy Efficiency Standards - 2022 Residential Compliance

Report Version: 2022.0.000

Schema Version: rev 20220901

Report Generated: 2023-11-01 13:56:25

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 3BR RF

Calculation Description: Title 24 Analysis

CF1R-PRF-01E

Calculation Date/Time: 2023-11-01T13:55:41-07:00

Input File Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 3BR RF.rbd22zx

Page 2 of 11

ENERGY DESIGN RATINGS						
	Energy Design Ratings			Compliance Margins		
	Source Energy (EDR1)	Efficiency ¹ EDR (EDR2efficiency)	Total ² EDR (EDR2total)	Source Energy (EDR1)	Efficiency ¹ EDR (EDR2efficiency)	Total ² EDR (EDR2total)
Standard Design	39.4	51.6	35.7			
Proposed Design						
North Facing	36.8	38.9	30.8	2.6	12.7	4.9
East Facing	37.4	41.1	31.6	2	10.5	4.1
South Facing	36.9	38.6	30.6	2.5	13	5.1
West Facing	37.2	40.9	31.5	2.2	10.7	4.2
RESULT ³ : PASS						
¹ Efficiency EDR includes improvements like a better building envelope and more efficient equipment ² Total EDR includes efficiency and demand response measures such as photovoltaic (PV) system and batteries ³ Building complies when source energy, efficiency and total compliance margins are greater than or equal to zero and unmet load hour limits are not exceeded						
• Standard Design PV Capacity: 2.44 kWdc • Proposed PV Capacity Scaling: North (2.44 kWdc) East (2.44 kWdc) South (2.44 kWdc) West (2.44 kWdc)						

Registration Number: 423-P010198897A-000-000-0000000-0000

Registration Date/Time: 11/01/2023 15:37

HERS Provider: CHEERS

NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.

CA Building Energy Efficiency Standards - 2022 Residential Compliance

Report Version: 2022.0.000

Schema Version: rev 20220901

Report Generated: 2023-11-01 13:56:25

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 3BR RF

Calculation Description: Title 24 Analysis

CF1R-PRF-01E

Calculation Date/Time: 2023-11-01T13:55:41-07:00

Input File Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 3BR RF.rbd22zx

Page 5 of 11

ENERGY USE INTENSITY				
	Standard Design (kBtu/ft² - yr)	Proposed Design (kBtu/ft² - yr)	Compliance Margin (kBtu/ft² - yr)	Margin Percentage
North Facing				
Gross EUI ¹	20.5	19.09	1.41	6.88
Net EUI ²	7.38	5.96	1.42	19.24
East Facing				
Gross EUI ¹	20.5	19.35	1.15	5.61
Net EUI ²	7.38	6.22	1.16	15.72
South Facing				
Gross EUI ¹	20.5	19.08	1.42	6.93
Net EUI ²	7.38	5.95	1.43	19.38
West Facing				
Gross EUI ¹	20.5	19.33	1.17	5.71
Net EUI ²	7.38	6.2	1.18	15.99
Notes 1. Gross EUI is Energy Use Total (not including PV) / Total Building Area. 2. Net EUI is Energy Use Total (including PV) / Total Building Area.				

Registration Number: 423-P010198897A-000-000-0000000-0000

Registration Date/Time: 11/01/2023 15:37

HERS Provider: CHEERS

NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.

CA Building Energy Efficiency Standards - 2022 Residential Compliance

Report Version: 2022.0.000

Schema Version: rev 20220901

Report Generated: 2023-11-01 13:56:25

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 3BR RF

Calculation Description: Title 24 Analysis

CF1R-PRF-01E

Calculation Date/Time: 2023-11-01T13:55:41-07:00

Input File Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 3BR RF.rbd22zx

Page 8 of 11

FENESTRATION / GLAZING													
01	02	03	04	05	06	07	08	09	10	11	12	13	14
Name	Type	Surface	Orientation	Azimuth	Width (ft)	Height (ft)	Mult.	Area (ft²)	U-factor	U-factor Source	SHGC	SHGC Source	Exterior Shading
Window W2	Window	New Right Wall	Right	270			1	12	0.3	NFRC	0.23	NFRC	Bug Screen
Window W1	Window	New Right Wall	Right	270			1	12	0.3	NFRC	0.23	NFRC	Bug Screen
OPAQUE DOORS													
01	02	03	04										
Name	Side of Building			Area (ft²)		U-factor							
Front Door D1	New Front Wall			20		0.2							
OPAQUE SURFACE CONSTRUCTIONS													
01	02	03	04	05	06	07	08						
Construction Name	Surface Type	Construction Type	Framing	Total Cavity R-value	Interior / Exterior Continuous R-value	U-factor	Assembly Layers						
R-21 Wall	Exterior Walls	Wood Framed Wall	2x6 @ 16 in. O. C.	R-21	None / None	0.069	Inside Finish: Gypsum Board Cavity / Frame: R-21 / 2x6 Exterior Finish: 3 Coat Stucco						
Attic RoofNew ADU	Attic Roofs	Wood Framed Ceiling	2x4 @ 24 in. O. C.	R-0	None / 0	0.644	Roofing: Light Roof (Asphalt Shingle) Roof Deck: Wood Siding/sheathing/decking Cavity / Frame: no insul. / 2x4						
R-19 Floor Crawlspace	Floors Over Crawlspace	Wood Framed Floor	2x10 @ 16 in. O. C.	R-19	None / None	0.046	Floor Surface: Carpeted Floor Deck: Wood Siding/sheathing/decking Cavity / Frame: R-19 / 2x10						
R-30 Roof Attic	Ceilings (below attic)	Wood Framed Ceiling	2x4 @ 24 in. O. C.	R-30	None / None	0.032	Over Ceiling Joists: R-20.9 Insul. Cavity / Frame: R-9.1 / 2x4 Inside Finish: Gypsum Board						

Registration Number: 423-P010198897A-000-000-0000000-0000

Registration Date/Time: 11/01/2023 15:37

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD
Project Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 2BR SOG
Calculation Description: Title 24 Analysis

CF1R-PRF-01E
(Page 1 of 12)
Input File Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 2BR SOG.rbd22x

GENERAL INFORMATION											
01	Project Name	2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 2BR SOG									
02	Run Title	Title 24 Analysis									
03	Project Location	276 4th Avenue									
04	City	Chula Vista	05	Standards Version	2022						
06	Zip code	91910	07	Software Version	EnergyPro 9.2						
08	Climate Zone	7	09	Front Orientation (deg/ Cardinal)	All orientations						
10	Building Type	Single family	11	Number of Dwelling Units	1						
12	Project Scope	Newly Constructed	13	Number of Bedrooms	2						
14	Addition Cond. Floor Area (ft ²)	0	15	Number of Stories	1						
16	Existing Cond. Floor Area (ft ²)	n/a	17	Fenestration Average U-factor	0.3						
18	Total Cond. Floor Area (ft ²)	999	19	Glazing Percentage (%)	13.51%						
20	ADU Bedroom Count	n/a	21	ADU Conditioned Floor Area	n/a						
22	Fuel Type	Natural gas	23	No Dwelling Units:	No						

COMPLIANCE RESULTS	
01	Building Complies with Computer Performance
02	This building incorporates features that require field testing and/or verification by a certified HERS rater under the supervision of a CEC-approved HERS provider.
03	This building incorporates one or more Special Features shown below

Registration Number: 423-P010198898A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 11/01/2023 15:37
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CHEERS
Report Generated: 2023-11-01 14:05:16

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD
Project Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 2BR SOG
Calculation Description: Title 24 Analysis

CF1R-PRF-01E
(Page 4 of 12)
Input File Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 2BR SOG.rbd22x

Energy Use	Standard Design Source Energy (EDR1) (kBtu/ft ² · yr)	Standard Design TDV Energy (EDR2) (kTDV/ft ² · yr)	Proposed Design Source Energy (EDR1) (kBtu/ft ² · yr)	Proposed Design TDV Energy (EDR2) (kTDV/ft ² · yr)	Compliance Margin (EDR1)	Compliance Margin (EDR2)
Space Heating	0.08	0.4	0.44	3.23	-0.36	-2.83
Space Cooling	0.55	11.99	0.11	3.44	0.44	8.55
IAQ Ventilation	0.4	4.31	0.4	4.31	0	0
Water Heating	1.86	20.78	1.46	16.8	0.4	3.98
Self Utilization/Flexibility Credit				0		0
South Facing Efficiency Compliance Total	2.89	37.48	2.41	27.78	0.48	9.7
Space Heating	0.08	0.4	0.39	2.85	-0.31	-2.45
Space Cooling	0.55	11.99	0.23	5.83	0.32	6.16
IAQ Ventilation	0.4	4.31	0.4	4.31	0	0
Water Heating	1.86	20.78	1.45	16.73	0.41	4.05
Self Utilization/Flexibility Credit				0		0
West Facing Efficiency Compliance Total	2.89	37.48	2.47	29.72	0.42	7.76

Registration Number: 423-P010198898A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 11/01/2023 15:37
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CHEERS
Report Generated: 2023-11-01 14:05:16

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD
Project Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 2BR SOG
Calculation Description: Title 24 Analysis

CF1R-PRF-01E
(Page 7 of 12)
Input File Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 2BR SOG.rbd22x

01	02	03	04	05	06	07	08
Name	Zone	Construction	Azimuth	Orientation	Gross Area (ft ²)	Window and Door Area (ft2)	Tilt (deg)
New Front Wall	New ADU	R-21 Wall	0	Front	294	59	90
New Left Wall	New ADU	R-21 Wall	90	Left	257	0	90
New Back Wall	New ADU	R-21 Wall	180	Back	306	72	90
New Right Wall	New ADU	R-21 Wall	270	Right	259	24	90
New Roof Attic	New ADU	R-30 Roof Attic	n/a	n/a	489	n/a	n/a
New Roof Attic 2	New ADU	R-30 Roof Attic	n/a	n/a	510	n/a	n/a

01	02	03	04	05	06	07	08
Name	Construction	Type	Roof Rise (x in 12)	Roof Reflectance	Roof Emittance	Radiant Barrier	Cool Roof
Attic New ADU	Attic RoofNew ADU	Ventilated	3.76577	0.1	0.85	Yes	No

01	02	03	04	05	06	07	08	09	10	11	12	13	14
Name	Type	Surface	Orientation	Azimuth	Width (ft)	Height (ft)	Mult.	Area (ft ²)	U-factor	U-factor Source	SHGC	SHGC Source	Exterior Shading
Window W8	Window	New Front Wall	Front	0			1	12	0.3	NFRC	0.23	NFRC	Bug Screen
Window W7	Window	New Front Wall	Front	0			1	3	0.3	NFRC	0.23	NFRC	Bug Screen
Window W6	Window	New Front Wall	Front	0			1	24	0.3	NFRC	0.23	NFRC	Bug Screen
Window W5	Window	New Back Wall	Back	180			1	24	0.3	NFRC	0.23	NFRC	Bug Screen
Window W4	Window	New Back Wall	Back	180			1	24	0.3	NFRC	0.23	NFRC	Bug Screen
Window W3	Window	New Back Wall	Back	180			1	24	0.3	NFRC	0.23	NFRC	Bug Screen
Window W2	Window	New Right Wall	Right	270			1	12	0.3	NFRC	0.23	NFRC	Bug Screen

Registration Number: 423-P010198898A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 11/01/2023 15:37
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CHEERS
Report Generated: 2023-11-01 14:05:16

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD
Project Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 2BR SOG
Calculation Description: Title 24 Analysis

CF1R-PRF-01E
(Page 2 of 12)
Input File Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 2BR SOG.rbd22x

	Energy Design Ratings			Compliance Margins		
	Source Energy (EDR1)	Efficiency ¹ EDR (EDR2efficiency)	Total ² EDR (EDR2total)	Source Energy (EDR1)	Efficiency ¹ EDR (EDR2efficiency)	Total ² EDR (EDR2total)
Standard Design	37.1	46.6	33.5			
Proposed Design						
North Facing	35.2	34.5	29.1	1.9	12.1	4.4
East Facing	36	37.8	30.3	1.1	8.8	3.2
South Facing	35.4	34.6	29.1	1.7	12	4.4
West Facing	35.7	37	30	1.4	9.6	3.5
RESULT ³ : PASS						
¹ Efficiency EDR includes improvements like a better building envelope and more efficient equipment ² Total EDR includes efficiency and demand response measures such as photovoltaic (PV) system and batteries ³ Building complies when source energy, efficiency and total compliance margins are greater than or equal to zero and unmet load hour limits are not exceeded						
• Standard Design PV Capacity: 2.03 kWdc • Proposed PV Capacity Scaling: North (2.03 kWdc) East (2.03 kWdc) South (2.03 kWdc) West (2.03 kWdc)						

Registration Number: 423-P010198898A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 11/01/2023 15:37
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CHEERS
Report Generated: 2023-11-01 14:05:16

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD
Project Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 2BR SOG
Calculation Description: Title 24 Analysis

CF1R-PRF-01E
(Page 5 of 12)
Input File Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 2BR SOG.rbd22x

ENERGY USE INTENSITY				
	Standard Design (kBtu/ft ² · yr)	Proposed Design (kBtu/ft ² · yr)	Compliance Margin (kBtu/ft ² · yr)	Margin Percentage
North Facing				
Gross EU1	17.61	16.58	1.03	5.85
Net EU1	6.7	5.66	1.04	15.52
East Facing				
Gross EU1	17.61	16.82	0.79	4.49
Net EU1	6.7	5.91	0.79	11.79
South Facing				
Gross EU1	17.61	16.62	0.99	5.62
Net EU1	6.7	5.7	1	14.93
West Facing				
Gross EU1	17.61	16.75	0.86	4.88
Net EU1	6.7	5.84	0.86	12.84
Notes 1. Gross EU1 is Energy Use Total (not including PV) / Total Building Area. 2. Net EU1 is Energy Use Total (including PV) / Total Building Area.				

Registration Number: 423-P010198898A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 11/01/2023 15:37
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CHEERS
Report Generated: 2023-11-01 14:05:16

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD
Project Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 2BR SOG
Calculation Description: Title 24 Analysis

CF1R-PRF-01E
(Page 8 of 12)
Input File Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 2BR SOG.rbd22x

01	02	03	04	05	06	07	08	09	10	11	12	13	14
Name	Type	Surface	Orientation	Azimuth	Width (ft)	Height (ft)	Mult.	Area (ft ²)	U-factor	U-factor Source	SHGC	SHGC Source	Exterior Shading
Window W1	Window	New Right Wall	Right	270			1	12	0.3	NFRC	0.23	NFRC	Bug Screen

01	02	03	04
Name	Side of Building	Area (ft ²)	U-factor
Front Door D1	New Front Wall	20	0.2

01	02	03	04	05	06	07	08
Name	Zone	Area (ft ²)	Perimeter (ft)	Edge Insul. R-value and Depth	Edge Insul. R-value and Depth	Carpeted Fraction	Heated
New Slab-on-Grade	New ADU	999	0.1	none	0	80%	No

01	02	03	04	05	06	07	08
Construction Name	Surface Type	Construction Type	Framing	Total Cavity R-value	Interior / Exterior Continuous R-value	U-factor	Assembly Layers
R-21 Wall	Exterior Walls	Wood Framed Wall	2x6 @ 16 in. O. C.	R-21	None / None	0.069	Inside Finish: Gypsum Board Cavity / Frame: R-21 / 2x6 Exterior Finish: 3 Coat Stucco
Attic RoofNew ADU	Attic Roofs	Wood Framed Ceiling	2x4 @ 24 in. O. C.	R-0	None / 0	0.644	Roofing: Light Roof (Asphalt Shingle) Roof Deck: Wood Sliding/sheathing/decking Cavity / Frame: no insul. / 2x4

Registration Number: 423-P010198898A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 11/01/2023 15:37
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CHEERS
Report Generated: 2023-11-01 14:05:16

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD
Project Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 2BR SOG
Calculation Description: Title 24 Analysis

CF1R-PRF-01E
(Page 3 of 12)
Input File Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 2BR SOG.rbd22x

Energy Use	Standard Design Source Energy (EDR1) (kBtu/ft ² · yr)	Standard Design TDV Energy (EDR2) (kTDV/ft ² · yr)	Proposed Design Source Energy (EDR1) (kBtu/ft ² · yr)	Proposed Design TDV Energy (EDR2) (kTDV/ft ² · yr)	Compliance Margin (EDR1)	Compliance Margin (EDR2)
Space Heating	0.08	0.4	0.32	2.39	-0.24	-1.99
Space Cooling	0.55	11.99	0.15	4.3	0.4	7.69
IAQ Ventilation	0.4	4.31	0.4	4.31	0	0
Water Heating	1.86	20.78	1.45	16.74	0.41	4.04
Self Utilization/Flexibility Credit				0		0
North Facing Efficiency Compliance Total	2.89	37.48	2.32	27.74	0.57	9.74
Space Heating	0.08	0.4	0.49	3.63	-0.41	-3.23
Space Cooling	0.55	11.99	0.23	5.67	0.32	6.32
IAQ Ventilation	0.4	4.31	0.4	4.31	0	0
Water Heating	1.86	20.78	1.46	16.75	0.4	4.03
Self Utilization/Flexibility Credit				0		0
East Facing Efficiency Compliance Total	2.89	37.48	2.58	30.36	0.31	7.12

Registration Number: 423-P010198898A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 11/01/2023 15:37
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CHEERS
Report Generated: 2023-11-01 14:05:16

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD
Project Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 2BR SOG
Calculation Description: Title 24 Analysis

CF1R-PRF-01E
(Page 6 of 12)
Input File Name: 2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 2BR SOG.rbd22x

REQUIRED PV SYSTEMS											
01	02	03	04	05	06	07	08	09	10	11	12
DC System Size (kWdc)	Exception	Module Type	Array Type	Power Electronics	CFI	Azimuth (deg)	Tilt Input	Array Angle (deg)	Tilt: (x in 12)	Inverter Eff. (%)	Annual Solar Access (%)
2.03	NA	Standard (14-17%)	Fixed	none	true	150-270	n/a	n/a	<=7:12	96	98

REQUIRED SPECIAL FEATURES	
The following are features that must be installed as condition for meeting the modeled energy performance for this computer analysis. • Northwest Energy Efficiency Alliance (NEEA) rated heat pump water heater; specific brand/model, or equivalent, must be installed	

HERS FEATURE SUMMARY	
The following is a summary of the features that must be field-verified by a certified HERS Rater as a condition for meeting the modeled energy performance for this computer analysis. Additional detail is provided in the building tables below. Registered CF2Rs and CF3Rs are required to be completed in the HERS Registry	
• Quality insulation installation (QII) • Indoor air quality ventilation • Kitchen range hood • Verified heat pump rated heating capacity	

BUILDING - FEATURES INFORMATION						
01	02	03	04	05	06	07
Project Name	Conditioned Floor Area (ft ²)	Number of Dwelling Units	Number of Bedrooms	Number of Zones	Number of Ventilation Cooling Systems	Number of Water Heating Systems
2310-22-0616 Chula-Vista ADU -- 999 L-Shape -- Standard 2BR SOG	999	1	2	1	0	1

ZONE INFORMATION						
01	02	03	04	05	06	07
Zone Name	Zone Type	HVAC System Name	Zone Floor Area (ft ²)	Avg. Ceiling Height	Water Heating System 1	Status
New ADU	Conditioned	New HVAC1	999	8	DHW Sys 1	New

Registration Number: 423-P010198898A-000-000-00000000-0000 Registration Date/Time: 11/01/2023 15:37 HERS Provider: CHEERS
 NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
 CA Building Energy Efficiency Standards - 2022 Residential Compliance Report Version: 2022.0.000 Report Generated: 2023-11-01 14:05:16
 Schema Version: rev 20220901

Registration Number: 423-P010198989A-000-000-00000000-0000
 Registration Date/Time: 11/01/2023 15:37
 HERS Provider: CHEERS
 NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
 CA Building Energy Efficiency Standards - 2022 Residential Compliance
 Report Version: 2022.0.000
 Schema Version: rev 20220901
 Report Generated: 2023-11-01 14:05:16

Digital signature by California Home Energy Rating Service (CHEERS). This digital signature is provided in order to secure the content of this registered document and in no way implies Registration Provider responsibility for the accuracy of the information.

Registration Number: 423-010198889A-000-000-0000000-0000	Registration Date/Time: 11/01/2023 15:37	HERS Provider: CHEERS
<small>NOTES: This document has been signed by California Home Energy Rating Service (CHEERS) using information submitted by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.</small>		
CA Building Energy Efficiency Standards - 2022 Residential Compliance	Report Version: rev 2022.0.00	Report Generated: 2023-11-01 14:05:16
	Schema Version: rev 20220901	

ADU: 999 L-SHAPE
CITY OF CHULA VISTA
276 FOURTH AVENUE,
CHULA VISTA, CA 91910

[illegible]

TITLE 24 - 2-BEDROOM SOG - CZ7
G423
22040

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

CF1R-PRF-01E

Project Name: 2306-22-0336 Chula-Vista ADU -- 999 L-Shape -- Standard 2BR RF

Calculation Date/Time: 2023-06-27T15:56:29-07:00

Input File Name: 2306-22-0336 Chula-Vista ADU -- 999 L-Shape -- Standard 2BR RF.rbd22x

Calculation Description: Title 24 Analysis

GENERAL INFORMATION

01	Project Name	2306-22-0336 Chula-Vista ADU -- 999 L-Shape -- Standard 2BR RF			
02	Run Title	Title 24 Analysis			
03	Project Location	276 4th Avenue			
04	City	Chula Vista	05	Standards Version	2022
06	Zip code	91910	07	Software Version	EnergyPro 9.1
08	Climate Zone	10	09	Front Orientation (deg/ Cardinal)	All orientations
10	Building Type	Single family	11	Number of Dwelling Units	1
12	Project Scope	Newly Constructed	13	Number of Bedrooms	2
14	Addition Cond. Floor Area (ft ²)	0	15	Number of Stories	1
16	Existing Cond. Floor Area (ft ²)	n/a	17	Fenestration Average U-factor	0.3
18	Total Cond. Floor Area (ft ²)	999	19	Glazing Percentage (%)	13.51%
20	ADU Bedroom Count	n/a			

COMPLIANCE RESULTS

01	Building Complies with Computer Performance
02	This building incorporates features that require field testing and/or verification by a certified HERS rater under the supervision of a CEC-approved HERS provider.
03	This building incorporates one or more Special Features shown below

Registration Number: 423-P01011153A-000-000-0000000-0000

Registration Date/Time: 06/27/2023 16:18

HERS Provider: CHEERS

NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.

CA Building Energy Efficiency Standards - 2022 Residential Compliance

Report Version: 2022.0.000

Report Generated: 2023-06-27 15:57:17

Schema Version: rev 20220901

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

CF1R-PRF-01E

Project Name: 2306-22-0336 Chula-Vista ADU -- 999 L-Shape -- Standard 2BR RF

Calculation Date/Time: 2023-06-27T15:56:29-07:00

Input File Name: 2306-22-0336 Chula-Vista ADU -- 999 L-Shape -- Standard 2BR RF.rbd22x

Calculation Description: Title 24 Analysis

ENERGY USE SUMMARY

Energy Use	Standard Design Source Energy (EDR1) (kBtu/ft² - yr)	Standard Design TDV Energy (EDR2) (kTDU/ft² - yr)	Proposed Design Source Energy (EDR1) (kBtu/ft² - yr)	Proposed Design TDV Energy (EDR2) (kTDU/ft² - yr)	Compliance Margin (EDR1)	Compliance Margin (EDR2)
Space Heating	0.85	3.79	1.25	8.96	-0.4	-5.17
Space Cooling	1.71	34.59	1.26	27.59	0.45	7
IAQ Ventilation	0.4	4.23	0.4	4.23	0	0
Water Heating	2.11	21.46	1.39	15.44	0.72	6.02
Self Utilization/Flexibility Credit				0		0
South Facing Efficiency Compliance Total	5.07	64.07	4.3	56.22	0.77	7.85
Space Heating	0.85	3.79	1.17	8.32	-0.32	-4.53
Space Cooling	1.71	34.59	1.43	31.89	0.28	2.7
IAQ Ventilation	0.4	4.23	0.4	4.23	0	0
Water Heating	2.11	21.46	1.38	15.39	0.73	6.07
Self Utilization/Flexibility Credit				0		0
West Facing Efficiency Compliance Total	5.07	64.07	4.38	59.83	0.69	4.24

Registration Number: 423-P01011153A-000-000-0000000-0000

Registration Date/Time: 06/27/2023 16:18

HERS Provider: CHEERS

NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.

CA Building Energy Efficiency Standards - 2022 Residential Compliance

Report Version: 2022.0.000

Report Generated: 2023-06-27 15:57:17

Schema Version: rev 20220901

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

CF1R-PRF-01E

Project Name: 2306-22-0336 Chula-Vista ADU -- 999 L-Shape -- Standard 2BR RF

Calculation Date/Time: 2023-06-27T15:56:29-07:00

Input File Name: 2306-22-0336 Chula-Vista ADU -- 999 L-Shape -- Standard 2BR RF.rbd22x

Calculation Description: Title 24 Analysis

OPAQUE SURFACES

01	02	03	04	05	06	07	08
Name	Zone	Construction	Asimuth	Orientation	Gross Area (ft²)	Window and Door Area (ft2)	Tilt (deg)
New Front Wall	New ADU	R-21 w/R-5 Wall	0	Front	294	59	90
New Left Wall	New ADU	R-21 w/R-5 Wall	90	Left	257	0	90
New Back Wall	New ADU	R-21 w/R-5 Wall	180	Back	306	72	90
New Right Wall	New ADU	R-21 w/R-5 Wall	270	Right	259	24	90
New Roof Attic	New ADU	R-38 w/R-19 B.R.D.	n/a	n/a	489	n/a	n/a
New Roof Attic 2	New ADU	R-38 w/R-19 B.R.D.	n/a	n/a	510	n/a	n/a
New Raised Floor	New ADU	R-19 Floor Crawlspace	n/a	n/a	999	n/a	n/a

ATTIC

01	02	03	04	05	06	07	08
Name	Construction	Type	Roof Rise [x in 12]	Roof Reflectance	Roof Emittance	Radiant Barrier	Cool Roof
Attic New ADU	Attic RoofNew ADU	Ventilated	3.76577	0.1	0.85	No	No

FENESTRATION / GLAZING

01	02	03	04	05	06	07	08	09	10	11	12	13	14
Name	Type	Surface	Orientation	Asimuth	Width (ft)	Height (ft)	Mult.	Area (ft²)	U-factor	U-factor Source	SHGC	SHGC Source	Exterior Shading
Window W8	Window	New Front Wall	Front	0			1	12	0.3	NFRC	0.23	NFRC	Bug Screen
Window W7	Window	New Front Wall	Front	0			1	3	0.3	NFRC	0.23	NFRC	Bug Screen
Window W6	Window	New Front Wall	Front	0			1	24	0.3	NFRC	0.23	NFRC	Bug Screen
Window W5	Window	New Back Wall	Back	180			1	24	0.3	NFRC	0.23	NFRC	Bug Screen
Window W4	Window	New Back Wall	Back	180			1	24	0.3	NFRC	0.23	NFRC	Bug Screen
Window W3	Window	New Back Wall	Back	180			1	24	0.3	NFRC	0.23	NFRC	Bug Screen

Registration Number: 423-P01011153A-000-000-0000000-0000

Registration Date/Time: 06/27/2023 16:18

HERS Provider: CHEERS

NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.

CA Building Energy Efficiency Standards - 2022 Residential Compliance

Report Version: 2022.0.000

Report Generated: 2023-06-27 15:57:17

Schema Version: rev 20220901

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

CF1R-PRF-01E

Project Name: 2306-22-0336 Chula-Vista ADU -- 999 L-Shape -- Standard 2BR RF

Calculation Date/Time: 2023-06-27T15:56:29-07:00

Input File Name: 2306-22-0336 Chula-Vista ADU -- 999 L-Shape -- Standard 2BR RF.rbd22x

Calculation Description: Title 24 Analysis

ENERGY DESIGN RATINGS

	Energy Design Ratings			Compliance Margins		
	Source Energy (EDR1)	Efficiency ¹ EDR (EDR2efficiency)	Total ² EDR (EDR2total)	Source Energy (EDR1)	Efficiency ¹ EDR (EDR2efficiency)	Total ² EDR (EDR2total)
Standard Design	36.7	40.6	28.8			
Proposed Design						
North Facing	34.1	35.8	26.2	2.6	4.8	2.6
East Facing	35.1	39	27.9	1.6	1.6	0.9
South Facing	34.5	35.6	26.2	2.2	5	2.6
West Facing	34.7	37.9	27.3	2	2.7	1.5

RESULT³: PASS

¹Efficiency EDR includes improvements like a better building envelope and more efficient equipment.
²Total EDR includes efficiency and demand response measures such as photovoltaic (PV) system and batteries
³Building complies when source energy, efficiency and total compliance margins are greater than or equal to zero and unmet load hour limits are not exceeded

- Standard Design PV Capacity: 2.21 kWdc
- Proposed PV Capacity Scaling: North (2.21 kWdc) East (2.21 kWdc) South (2.21 kWdc) West (2.21 kWdc)

Registration Number: 423-P01011153A-000-000-0000000-0000

Registration Date/Time: 06/27/2023 16:18

HERS Provider: CHEERS

NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.

CA Building Energy Efficiency Standards - 2022 Residential Compliance

Report Version: 2022.0.000

Report Generated: 2023-06-27 15:57:17

Schema Version: rev 20220901

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

CF1R-PRF-01E

Project Name: 2306-22-0336 Chula-Vista ADU -- 999 L-Shape -- Standard 2BR RF

Calculation Date/Time: 2023-06-27T15:56:29-07:00

Input File Name: 2306-22-0336 Chula-Vista ADU -- 999 L-Shape -- Standard 2BR RF.rbd22x

Calculation Description: Title 24 Analysis

ENERGY USE INTENSITY

	Standard Design (kBtu/ft² - yr)	Proposed Design (kBtu/ft² - yr)	Compliance Margin (kBtu/ft² - yr)	Margin Percentage
North Facing				
Gross EU1 ¹	20.58	19.03	1.55	7.53
Net EU1 ²	7.71	6.15	1.56	20.23
East Facing				
Gross EU1 ¹	20.58	19.57	1.01	4.91
Net EU1 ²	7.71	6.69	1.02	13.23
South Facing				
Gross EU1 ¹	20.58	19.08	1.5	7.29
Net EU1 ²	7.71	6.2	1.51	19.58
West Facing				
Gross EU1 ¹	20.58	19.51	1.07	5.2
Net EU1 ²	7.71	6.63	1.08	14.01

Notes

- Gross EU1 is Energy Use Total (not including PV) / Total Building Area.
- Net EU1 is Energy Use Total (including PV) / Total Building Area.

Registration Number: 423-P01011153A-000-000-0000000-0000

Registration Date/Time: 06/27/2023 16:18

HERS Provider: CHEERS

NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.

CA Building Energy Efficiency Standards - 2022 Residential Compliance

Report Version: 2022.0.000

Report Generated: 2023-06-27 15:57:17

Schema Version: rev 20220901

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

CF1R-PRF-01E

Project Name: 2306-22-0336 Chula-Vista ADU -- 999 L-Shape -- Standard 2BR RF

Calculation Date/Time: 2023-06-27T15:56:29-07:00

Input File Name: 2306-22-0336 Chula-Vista ADU -- 999 L-Shape -- Standard 2BR RF.rbd22x

Calculation Description: Title 24 Analysis

FENESTRATION / GLAZING

01	02	03	04	05	06	07	08	09	10	11	12	13	14
Name	Type	Surface	Orientation	Asimuth	Width (ft)	Height (ft)	Mult.	Area (ft²)	U-factor	U-factor Source	SHGC	SHGC Source	Exterior Shading
Window W2	Window	New Right Wall	Right	270			1	12	0.3	NFRC	0.23	NFRC	Bug Screen
Window W1	Window	New Right Wall	Right	270			1	12	0.3	NFRC	0.23	NFRC	Bug Screen

OPAQUE DOORS

01	02	03	04
Name	Side of Building	Area (ft²)	U-factor
Front Door D1	New Front Wall	20	0.2

OPAQUE SURFACE CONSTRUCTIONS

01	02	03	04	05	06	07	08
Construction Name	Surface Type	Construction Type	Framing	Total Cavity R-value	Interior / Exterior Continuous R-value	U-factor	Assembly Layers
R-21 w/R-5 Wall	Exterior Walls	Wood Framed Wall	2x6 @ 16 in. O. C.	R-21	None / 5	0.048	Inside Finish: Gypsum Board Cavity / Frame: R-21 / 2x6 Sheathing / Insulation: R-5 Sheathing Exterior Finish: 3 Coat Stucco
Attic RoofNew ADU	Attic Roofs	Wood Framed Ceiling	2x4 @ 24 in. O. C.	R-19	None / 0	0.059	Roofing: Light Roof (Asphalt Shingle) Roof Deck: Wood Siding/sheathing/decking Cavity / Frame: R-13.0 / 2x4 Around Roof Joists: R-6.0 Insul.
R-19 Floor Crawlspace	Floors Over Crawlspace	Wood Framed Floor	2x10 @ 16 in. O. C.	R-19	None / None	0.046	Floor Surface: Carpeted Floor Deck: Wood Siding/sheathing/decking Cavity / Frame: R-19 / 2x10

Registration Number: 423-P01011153A-000-000-0000000-0000

Registration Date/Time: 06/27/2023 16:18

HERS Provider: CHEERS

NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.

CA Building Energy Efficiency Standards - 2022 Residential Compliance

Report Version: 2022.0.000

Report Generated: 2023-06-27 15:57:17

Schema Version: rev 20220901

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

CF1R-PRF-01E

Project Name: 2306-22-0336 Chula-Vista ADU -- 999 L-Shape -- Standard 2BR RF

Calculation Date/Time: 2023-06-27T15:56:29-07:00

Input File Name: 2306-22-0336 Chula-Vista ADU -- 999 L-Shape -- Standard 2BR RF.rbd22x

Calculation Description: Title 24 Analysis

ENERGY USE SUMMARY

Energy Use	Standard Design Source Energy (EDR1) (kBtu/ft² - yr)	Standard Design TDV Energy (EDR2) (kTDU/ft² - yr)	Proposed Design Source Energy (EDR1) (kBtu/ft² - yr)	Proposed Design TDV Energy (EDR2) (kTDU/ft² - yr)	Compliance Margin (EDR1)	Compliance Margin (EDR2)
Space Heating	0.85	3.79	1.06	7.68	-0.21	-3.89
Space Cooling	1.71	34.59	1.31	29.12	0.4	5.47
IAQ Ventilation	0.4	4.23	0.4	4.23	0	0
Water Heating	2.11	21.46	1.38	15.39	0.73	6.07
Self Utilization/Flexibility Credit				0		0
North Facing Efficiency Compliance Total	5.07	64.07	4.15	56.42	0.92	7.65
Space Heating	0.85	3.79	1.29	9.37	-0.44	-5.58
Space Cooling	1.71	34.59	1.44	32.43	0.27	2.16
IAQ Ventilation	0.4	4.23	0.4	4.23	0	0
Water Heating	2.11	21.46	1.39	15.43	0.72	6.03
Self Utilization/Flexibility Credit				0		0
East Facing Efficiency Compliance Total	5.07	64.07	4.52	61.46	0.55	2.61

Registration Number: 423-P01011153A-000-000-0000000-0000

Registration Date/Time: 06/27/2023 16:18

HERS Provider: CHEERS

NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.

CA Building Energy Efficiency Standards - 2022 Residential Compliance

Report Version: 2022.0.000

Report Generated: 2023-06-27 15:57:17

Schema Version: rev 20220901

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

CF1R-PRF-01E

Project Name: 2306-22-0336 Chula-Vista ADU -- 999 L-Shape -- Standard 2BR RF

Calculation Date/Time: 2023-06-27T15:56:29-07:00

Input File Name: 2306-22-0336 Chula-Vista ADU -- 999 L-Shape -- Standard 2BR RF.rbd22x

Calculation Description: Title 24 Analysis

REQUIRED PV SYSTEMS

01	02	03	04	05	06	07	08	09	10	11	12
DC System Size (kWdc)	Exception	Module Type	Array Type	Power Electronics	CFI	Asimuth (deg)	Tilt Input	Array Angle (deg)	Tilt: [x in 12]	Inverter Eff. (%)	Annual Solar Access (%)
2.21	NA	Standard (14-17%)	Fixed	none	true	150-270	n/a	n/a	<=7:12	96	98

REQUIRED SPECIAL FEATURES

The following are features that must be installed as condition for meeting the modeled energy performance for this computer analysis.

- Insulation below roof deck
- Northwest Energy Efficiency Alliance (NEEA) rated heat pump water heater; specific brand/model, or equivalent, must be installed

HERS FEATURE SUMMARY

The following is a summary of the features that must be field-verified by a certified HERS Rater as a condition for meeting the modeled energy performance for this computer analysis. Additional detail is provided in the building tables below. Registered CF2Rs and CF3Rs are required to be completed in the HERS Registry

- Quality insulation installation (QII)
- Indoor air quality ventilation
- Kitchen range hood
- Verified heat pump rated heating capacity

BUILDING - FEATURES INFORMATION

01	02	03	04	05	06	07
Project Name	Conditioned Floor Area (ft²)	Number of Dwelling Units	Number of Bedrooms	Number of Zones	Number of Ventilation Cooling Systems	Number of Water Heating Systems
2306-22-0336 Chula-Vista ADU -- 999 L-Shape -- Standard 2BR RF	999	1	2	1	0	1

ZONE INFORMATION

01	02	03	04	05	06	07
Zone Name	Zone Type	HVAC System Name	Zone Floor Area (ft²)	Avg. Ceiling Height	Water Heating System 1	Status
New ADU	Conditioned	New HVAC1	999	8	DHW Sys 1	New

Registration Number: 423-P01011153A-000-000-0000000-0000

Registration Date/Time: 06/27/2023 16:18

HERS Provider: CHEERS

NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.

CA Building Energy Efficiency Standards - 2022 Residential Compliance

Report Version: 2022.0.000

Report Generated: 2023-06-27 15:57:17

Schema Version: rev 20220901

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

CF1R-PRF-01E

Project Name: 2306-22-0336 Chula-Vista ADU -- 999 L-Shape -- Standard 2BR RF

Calculation Date/Time: 2023-06-27T15:56:29-07:00

Input File Name: 2306-22-0336 Chula-Vista ADU -- 999 L-Shape -- Standard 2BR RF.rbd22x

Calculation Description: Title 24 Analysis

OPAQUE SURFACE CONSTRUCTIONS

01	02	03	04	05	06	07	08
Construction Name	Surface Type	Construction Type	Framing	Total Cavity R-value	Interior / Exterior Continuous R-value	U-factor	Assembly Layers
R-38 w/R-19 B.R.D.	Ceilings (below attic)	Wood Framed Ceiling	2x4 @ 24 in. O. C.	R-38	None / None	0.025	Over Ceiling Joists: R-38.9 Insul. Cavity / Frame: R-5.1 / 2x4 Inside Finish: Gypsum Board

BUILDING ENVELOPE - HERS VERIFICATION

01	02	03	04	05
Quality Insulation Installation (QII)	High R-value Spray Foam Insulation	Building Envelope Air Leakage	CFM50	CFM50
Required	Not Required	N/A	n/a	n/a

WATER HEATING SYSTEMS

01	02	03	04	05	06	07	08	09
Name	System Type	Distribution Type	Water Heater Name	Number of Units	Solar Heating System	Compact Distribution	HERS Verification	Water Heater Name (#)
DHW Sys 1	Domestic Hot Water (DHW)	Standard	DHW Heater 1	1	n/a	None	n/a	DHW Heater 1 (1)

WATER HEATERS - NEEA HEAT PUMP

01	02	03	04	05	06	07	08
Name	# of Units	Tank Vol. (gal)	NEEA Heat Pump Brand	NEEA Heat Pump Model	Tank Location	Duct Inlet Air Source	Duct Outlet Air Source
DHW Heater 1	1	50	AQSmith	AQSmithHPTU50	Outside	New ADU	New ADU


















Registration Number: 423-P01011153A-000-000-0000000-0000

Registration Date/Time: 06/27/2023 16:18

HERS Provider: CHEERS

NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.</

BMP SITE LEGEND

 (E) CONCRETE, IMPERVIOUS SURFACE  (E) PAVERS, IMPERVIOUS SURFACE  (E) LANDSCAPE, PERVIOUS SURFACE  IMPERVIOUS AREA  EXISTING DWELLING, IMPERVIOUS SURFACE  PROPERTY LINE  DRAINAGE  APPROXIMATE DIRECTION OF LOT DRAINAGE  (N) DOWNSPOUT  APPROXIMATE DRAINAGE FROM STRUCTURES  (E) 8'-0" PERIMETER FENCING  CONTOUR LINE	<p>SOURCE CONTROL BMPs Chapter 4 and Appendix E BMP Design Manual</p> <p>4.2.1 PREVENTION OF ILLICIT DISCHARGES INTO THE MS4</p> <p>4.2.2 STORM DRAIN STENCILING OR SIGNAGE</p> <p>4.2.3 PROTECT OUTDOOR MATERIALS STORAGE AREAS FROM RAINFALL, RUN-ON, RUNOFF, AND WIND DISPERSAL</p> <p>4.2.4 PROTECT MATERIALS STORED IN OUTDOOR WORK AREAS FROM RAINFALL, RUN-ON, RUNOFF, AND WIND DISPERSAL</p> <p>4.2.5 PROTECT TRASH STORAGE AREAS FROM RAINFALL, RUN-ON, RUNOFF, AND WIND DISPERSAL</p> <p>4.2.6 ADDITIONAL BMPs BASED ON POTENTIAL SOURCES OF RUNOFF POLLUTANTS (MUST ANSWER FOR EACH SOURCE LISTED BELOW)</p> <p>SC-A ONSITE STORM DRAIN INLETS</p> <p>SC-D1 NEED FOR FUTURE INDOOR & STRUCTURAL PEST CONTROL</p> <p>SC-D2 LANDSCAPE / OUTDOOR PESTICIDE USE</p> <p>SC-E POOLS, SPAS, PONDS, DECORATIVE FOUNTAINS, AND OTHER WATER FEATURES</p> <p>SC-G REFUSE AREAS</p> <p>SC-N FIRE SPRINKLER TEST WATER</p> <p>SC-O MISCELLANEOUS DRAIN OR WASH WATER</p> <p>SC-P PLAZAS, SIDEWALKS, AND PARKING LOTS</p>
<p>SITE DESIGN BMPs Chapter 4 and Appendix E BMP Design Manual</p> <p>4.3.1 MAINTAIN NATURAL DRAINAGE PATHWAYS AND HYDROLOGIC FEATURES</p> <p>4.3.2 CONSERVE NATURAL AREAS, SOILS, AND VEGETATION</p> <p>4.3.3 MINIMIZE IMPERVIOUS AREA</p> <p>4.3.4 MINIMIZE SOIL COMPACTION</p> <p>4.3.5 IMPERVIOUS AREA DISPERSION</p> <p>4.3.6 RUNOFF COLLECTION</p> <p>4.3.7 LANDSCAPING WITH NATIVE OR DROUGHT TOLERANT SPECIES</p> <p>4.3.8 HARVESTING AND USING PRECIPITATION</p>	<p>CONSTRUCTION BMP STANDARDS Chapter 4 and Appendix K BMP Design Manual</p> <p>WM-1 MATERIAL DELIVERY & STORAGE AREA</p> <p>WM-4 SPILL PREVENTION AND CONTROL</p> <p>WM-5 SOLID WASTE MANAGEMENT</p> <p>WM-8 CONCRETE WASTE MANAGEMENT</p> <p>WM-9 SANITARY WASTE MANAGEMENT</p> <p>SC-5 FIBER ROLLS BARRIER</p> <p>SC-7 STREET SWEEPING AND VACUUMING</p> <p>SC-8 PROVIDE SPLASH BLOCKS FOR STORMWATER DISPERSAL AT RAINWATER LEADERS</p>  MS  SWM  CWM  SS  FR FR

CONSTRUCTION BMP GENERAL NOTES

PRIOR TO ANY SOIL DISTURBANCE, TEMPORARY SEDIMENT CONTROLS SHALL BE INSTALLED BY THE CONTRACTOR OR QUALIFIED PERSON(S) AS INDICATED BELOW:

1. ALL REQUIREMENTS OF THE CITY STORM WATER STANDARDS MUST BE INCORPORATED INTO THE DESIGN AND CONSTRUCTION OF THE PROPOSED GRADING/IMPROVEMENTS CONSISTENT WITH THE APPROVED STORM WATER POLLUTION PREVENTION PLAN (SWPPP) AND THE SAN DIEGO MUNICIPAL CODE (MPC) FOR CONSTRUCTION LER, BMPs AND, IF APPLICABLE, THE STORM WATER QUALITY MANAGEMENT PLAN (SWQMP) FOR POST-CONSTRUCTION BMPs.
2. THE CONTRACTOR SHALL INSTALL AND MAINTAIN ALL STORM DRAIN INLET PROTECTION. INLET PROTECTION IN THE PUBLIC RIGHT-OF-WAY MUST BE TEMPORARILY REMOVED PRIOR TO A RAIN EVENT TO ENSURE NO FLOODING OCCURS AND RE-INSTALL AFTER RAIN IS OVER.
3. ALL CONSTRUCTION BMPs SHALL BE INSTALLED AND PROPERLY MAINTAINED THROUGHOUT THE DURATION OF CONSTRUCTION.
4. THE CONTRACTOR SHALL ONLY GRADE, INCLUDING CLEARING AND GRUBBING, AREAS FOR WHICH THE CONTRACTOR OR QUALIFIED CONTACT PERSON CAN PROVIDE EROSION AND SEDIMENT CONTROL MEASURES.
5. THE CONTRACTOR OR QUALIFIED CONTACT PERSON FOR EROSION AND SEDIMENT CONTROL MEASURES ARE AWARE OF ALL STORM WATER BMPs AND IMPLEMENT SUCH MEASURES. FAILURE TO COMPLY WITH THE APPROVED SWPPP/WPCP WILL RESULT IN THE ISSUANCE OF CORRECTION NOTICES, CITATIONS, CIVIL PENALTIES, AND/OR TOP WORK NOTICES.
6. THE CONTRACTOR OR QUALIFIED CONTACT PERSON SHALL BE RESPONSIBLE FOR CLEANUP OF ALL SILT, DEBRIS, AND MUD ON AFFECTED AND ADJACENT STREETS(S) AND WITHIN STORM DRAIN SYSTEM DUE TO CONSTRUCTION VEHICLES/EQUIPMENT AND CONSTRUCTION ACTIVITY AT THE END OF EACH WORK DAY.
7. THE CONTRACTOR SHALL PROTECT NEW AND EXISTING STORM WATER CONVEYANCE SYSTEMS FROM SEDIMENTATION, CONCRETE RINSE, OR OTHER CONSTRUCTION-RELATED DEBRIS AND DISCHARGES WITH THE APPROPRIATE BMPs THAT ARE ACCEPTABLE TO THE CITY RESIDENT ENGINEER AND AS INDICATED IN THE SWPPP/WPCP.
8. THE CONTRACTOR OR QUALIFIED CONTACT PERSON SHALL CLEAR DEBRIS, SILT, AND MUD FROM ALL DITCHES AND SWALES PRIOR TO AND WITHIN 3 BUSINESS DAYS AFTER EACH RAIN EVENT OR PRIOR TO THE NEXT RAIN EVENT, WHICHEVER IS SOONER.
9. IF A NON-STORM WATER DISCHARGE LEAVES THE SITE, THE CONTRACTOR SHALL IMMEDIATELY STOP THE ACTIVITY AND REPAIR THE DAMAGES. THE CONTRACTOR SHALL NOTIFY THE CITY RESIDENT ENGINEER OF THE DISCHARGE. PRIOR TO THE REPAIR OF THE DAMAGE, THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE NECESSARY PRECAUTIONS TO PREVENT PAVEMENT WATER DISCHARGE SHALL BE REMOVED FROM THE STORM DRAIN CONVEYANCE SYSTEM AND PROPERLY DISPOSED OF BY THE CONTRACTOR.
10. EQUIPMENT AND WORKERS FOR EMERGENCY WORK SHALL BE MADE AVAILABLE AT ALL TIMES. ALL NECESSARY MATERIALS SHALL BE STOCKPILED ONSITE AT CONVENIENT LOCATIONS TO FACILITATE RAPID DEPLOYMENT OF CONSTRUCTION BMPs IF NECESSARY IS IMMINENT.
11. THE CONTRACTOR SHALL RESTORE AND MAINTAIN ALL EROSION AND SEDIMENT CONTROL BMPs TO WORKING ORDER YEAR ROUND.
12. THE CONTRACTOR SHALL INSTALL ADDITIONAL EROSION AND SEDIMENT CONTROL MEASURES DUE TO UNFORESEEN CIRCUMSTANCES TO PREVENT NON-STORM WATER AND SEDIMENT-LOADED DISCHARGES.
13. THE CONTRACTOR OR QUALIFIED CONTACT PERSON SHALL BE RESPONSIBLE FOR ANY PUBLIC NECESSARY PRECAUTIONS TO PREVENT PUBLIC TRESPASS ONTO AREAS WHERE IMPOUNDED WATERS CREATE A HAZARDOUS CONDITION.
14. ALL EROSION AND SEDIMENT CONTROL MEASURES PROVIDED PER THE APPROVED SWPPP/WPCP SHALL BE INSTALLED AND MAINTAINED. ALL EROSION AND SEDIMENT CONTROLS FOR INTERIM CONDITIONS SHALL BE PROPERLY DOCUMENTED AND REPORTED TO THE CALLED TO THE SATISFACTION OF THE CITY RESIDENT ENGINEER.
15. AS NECESSARY, THE CITY RESIDENT ENGINEER SHALL SCHEDULE MEETINGS FOR THE PROJECT TEAM (GENERAL CONTRACTOR, QUALIFIED CONTACT PERSON, EROSION CONTROL SUBCONTRACTOR IF ANY, ENGINEER OF WORK, OWNER/DEVELOPER, AND THE CITY RESIDENT ENGINEER) TO EVALUATE THE ADEQUACY OF THE EROSION AND SEDIMENT CONTROL MEASURES AND OTHER BMPs RELATIVE TO ANTICIPATED CONSTRUCTION ACTIVITIES.
16. THE CONTRACTOR OR QUALIFIED CONTACT PERSON SHALL VISUALLY INSPECT AND MAINTAIN ALL BMPs DAILY AND AS NEEDED. VISUAL INSPECTIONS AND MAINTENANCE OF ALL BMPs SHALL BE CONDUCTED BEFORE, DURING, AND AFTER EVERY RAIN EVENT AND EVERY 24 HOURS DURING ANY PROLONGED RAIN EVENT. THE CONTRACTOR SHALL MAINTAIN AND REPAIR ALL BMPs AS SOON AS POSSIBLE AS SAFETY ALLOWS.
17. CONSTRUCTION ENTRANCE AND EXIT AREA. TEMPORARY CONSTRUCTION ENTRANCE AND EXITS SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE SAN DIEGO MUNICIPAL CODE CHAPTER 17C-01 TO PREVENT TRACKING OF SEDIMENT AND OTHER POTENTIAL POLLUTANTS ONTO PAVED SURFACES AND TRAVELED WAYS. WIDTH SHALL BE 10' OR THE MINIMUM NECESSARY TO ACCOMMODATE VEHICLES AND EQUIPMENT WITHOUT BYPASSING THE ENTRANCE. (a) NON-STORM WATER DISCHARGES SHALL BE EFFECTIVELY MANAGED PER THE SAN DIEGO MUNICIPAL CODE CHAPTER 4, ARTICLE 3, DIVISION 3.
18. STORM WATER MANAGEMENT AND DISCHARGE CONTROL. (a) DRAINAGE PATTERN. (1) DRAINAGE PATTERN. (a) STORM WATER WILL DRAIN AWAY FROM BUILDING AND SHOW DRAINAGE PATTERN. THE GRADE SHALL FALL A MINIMUM OF 6" WITHIN THE FIRST 10 FEET, SECTION R401.3
A. EXCEPTION: WHERE LOT LINES, WALLS, SLOPES OR OTHER PHYSICAL BARRIERS PROHIBIT 6 INCHES OF FALL WITHIN 10 FEET DRAINS OR SWALES SHALL BE CONSTRUCTED TO ENSURE DRAINAGE AWAY FROM THE STRUCTURE. IMPERVIOUS SURFACES WITHIN 10 FEET OF THE BUILDING FOUNDATION SHALL BE SLOPED NOT LESS THAN 2 PERCENT AWAY FROM THE BUILDING.
19. ALL NEW ROOF DOWNSPOUTS SHALL BE DISCONNECTED AND DIRECTED TO PERVIOUS AREAS.



SNAPADU
DESIGN HOUSE

YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 999 L-SHAPE

CITY OF CHULA VISTA
276 FOURTH AVENUE,
CHULA VISTA, CA 91910

DESIGNER:

LUIS CALDERON
SnapADU

SIGNATURE

[illegible]

BMP SITE PLAN

C100

22040

ENERGY EFFICIENCY HERS VERIFICATION

PER CF1R FORM (TITLE 24)

BUILDING-LEVEL VERIFICATIONS:		
• QUALITY INSULATION INSTALLATION (QII)	■ YES	□ NO
• INDOOR AIR QUALITY VENTILATION	■ YES	□ NO
• KITCHEN RANGE HOOD	■ YES	□ NO
COOLING SYSTEM VERIFICATIONS:		
• MINIMUM AIR FLOW	■ YES	□ NO
• VERIFIED SEER	■ YES	□ NO
• VERIFIED SEER	■ YES	□ NO
• VERIFIED REFRIGERANT CHARGE	■ YES	□ NO
• FAN EFFICACY WATTS/CFM	■ YES	□ NO
HEATING SYSTEM VERIFICATIONS:		
• VERIFIED HSPF	■ YES	□ NO
• VERIFIED HEAT PUMP RATED HEATING CAPACITY	■ YES	□ NO
HVAC DISTRIBUTION SYSTEM VERIFICATIONS:		
• DUCT LEAKAGE TESTING	■ YES	□ NO
DOMESTIC HOT WATER SYSTEM VERIFICATIONS:		
• -- NONE --	□ YES	■ NO

REQUIRED SPECIAL FEATURES

PER CF1R FORM (TITLE 24)

- INSULATION BELOW ROOF DECK
- NORTHWEST ENERGY EFFICIENCY ALLIANCE (NEEA) RATED HEAT PUMP WATER HEATER; SPECIFIC BRAND / MODEL, OR EQUIVALENT, MUST BE INSTALLED

LOT COVERAGE

LOT AREA:	
EXISTING BUILDING & STRUCTURE LOT AREA:	
PRIMARY DWELLING UNIT (PDU):	
GARAGE:	
OTHER STRUCTURES:	
TOTAL COVERED LOT AREA:	
EXISTING LOT COVERAGE (%):	
PROPOSED BUILDING AREA ADDITION:	
ACCESSORY DWELLING UNIT (ADU):	
² ADU AREA DEDUCTION:	
TOTAL AREA:	
PROPOSED LOT COVERAGE ADDITION:	
^{1,2} NEW LOT COVERAGE:	
(EXISTING + PROPOSED LOT COVERAGE ADDITION)	
¹ MAXIMUM LOT COVERAGE ALLOWED:	
EXISTING BUILDING & STRUCTURE FLOOR AREA:	
PRIMARY DWELLING UNIT (PDU):	
GARAGE:	
OTHER STRUCTURES:	
TOTAL BUILDING AREA:	
EXISTING FLOOR AREA RATIO:	
PROPOSED BUILDING AREA ADDITION:	
ACCESSORY DWELLING UNIT (ADU):	
² ADU DEDUCTION AREA:	
TOTAL AREA:	
PROPOSED FLOOR AREA ADDITION:	
¹ NEW FLOOR AREA RATIO:	
(EXISTING + PROPOSED FLOOR AREA RATIO)	
¹ MAXIMUM FLOOR AREA RATIO ALLOWED:	
¹ REFER TO CITY OF CHULA VISTA MUNICIPAL CODE, TITLE 19.	
² ADU FLOOR AREA AND LOT COVERAGE DEDUCTION OF UP TO 800 SF PER CVMC 19.58.022.	

LID HANDBOOK NOTES

LOW IMPACT DEVELOPMENT (LID) HANDBOOK APPLICABLE SECTIONS AND MEASURES TO THE PROPOSED WORK:

2.2. SITE PLANNING;

2.2.4. MINIMIZE SOIL COMPACTION;

2.2.5. DRAIN RUNOFF FROM IMPERVIOUS SURFACES TO PERVIOUS AREAS.

ADDITIONAL NOTES

1. AN ELECTRONICALLY SIGNED AND REGISTERED INSTALLATION CERTIFICATE(S) (CF2R) POSTED BY THE INSTALLING CONTRACTOR SHALL BE SUBMITTED TO THE FIELD INSPECTOR DURING CONSTRUCTION AT THE BUILDING SITE. A REGISTERED CF2R WILL HAVE A UNIQUE 21-DIGIT REGISTRATION NUMBER FOLLOWED BY FOUR ZEROS LOCATED AT THE BOTTOM OF EACH PAGE. THE FIRST 12 DIGITS OF THE NUMBER WILL MATCH THE REGISTRATION NUMBER OF THE ASSOCIATED CF1R. CERTIFICATE OF OCCUPANCY WILL NOT BE ISSUED UNTIL FORMS CF2R IS REVIEWED AND APPROVED.
2. AN ELECTRONICALLY SIGNED AND REGISTERED CERTIFICATE(S) OF FIELD VERIFICATION AND DIAGNOSTIC TESTING (CF3R) SHALL BE POSTED AT THE BUILDING SITE BY A CERTIFIED HERS RATER. A REGISTERED CF3R WILL HAVE A UNIQUE 25-DIGIT REGISTRATION NUMBER LOCATED AT THE BOTTOM OF EACH PAGE. THE FIRST 20 DIGITS OF THE NUMBER WILL MATCH THE REGISTRATION NUMBER OF THE ASSOCIATED CF2R. CERTIFICATE OF OCCUPANCY WILL NOT BE ISSUED UNTIL CF3R IS REVIEWED AND APPROVED.

EARTHWORK QUANTITIES

CUT QUANTITY:	__ _CYD
FILL QUANTITY:	__ _CYD
IMPORT / EXPORT:	__ _CYD
MAX CUT DEPTH:	__ _CYD
MAX FILL DEPTH:	__ _CYD


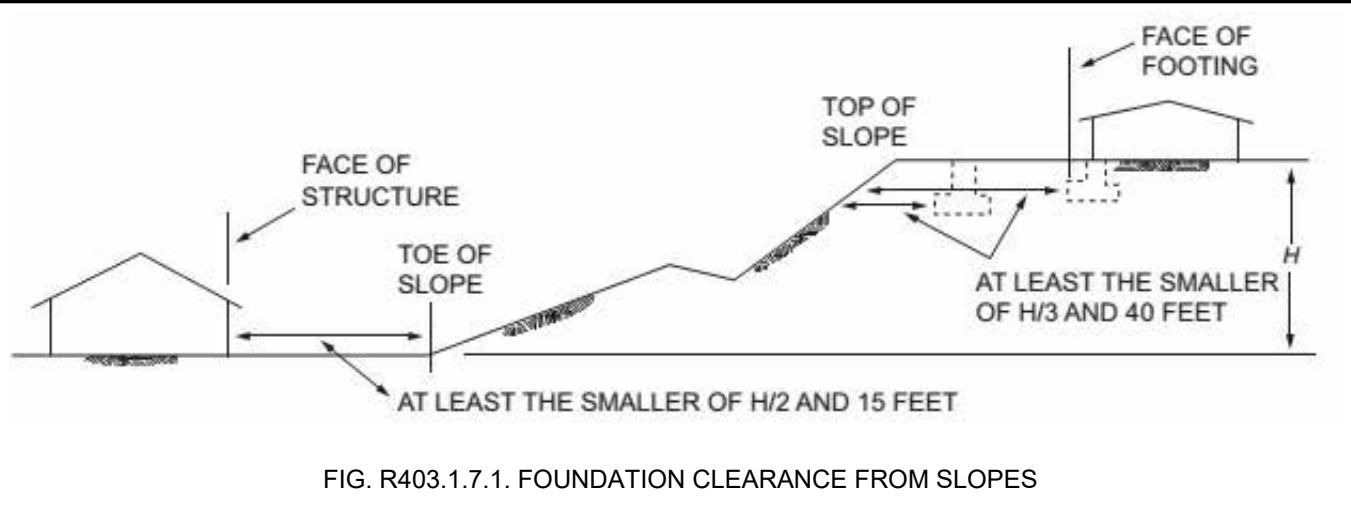


FIG. R403.1.7.1. FOUNDATION CLEARANCE FROM SLOPES

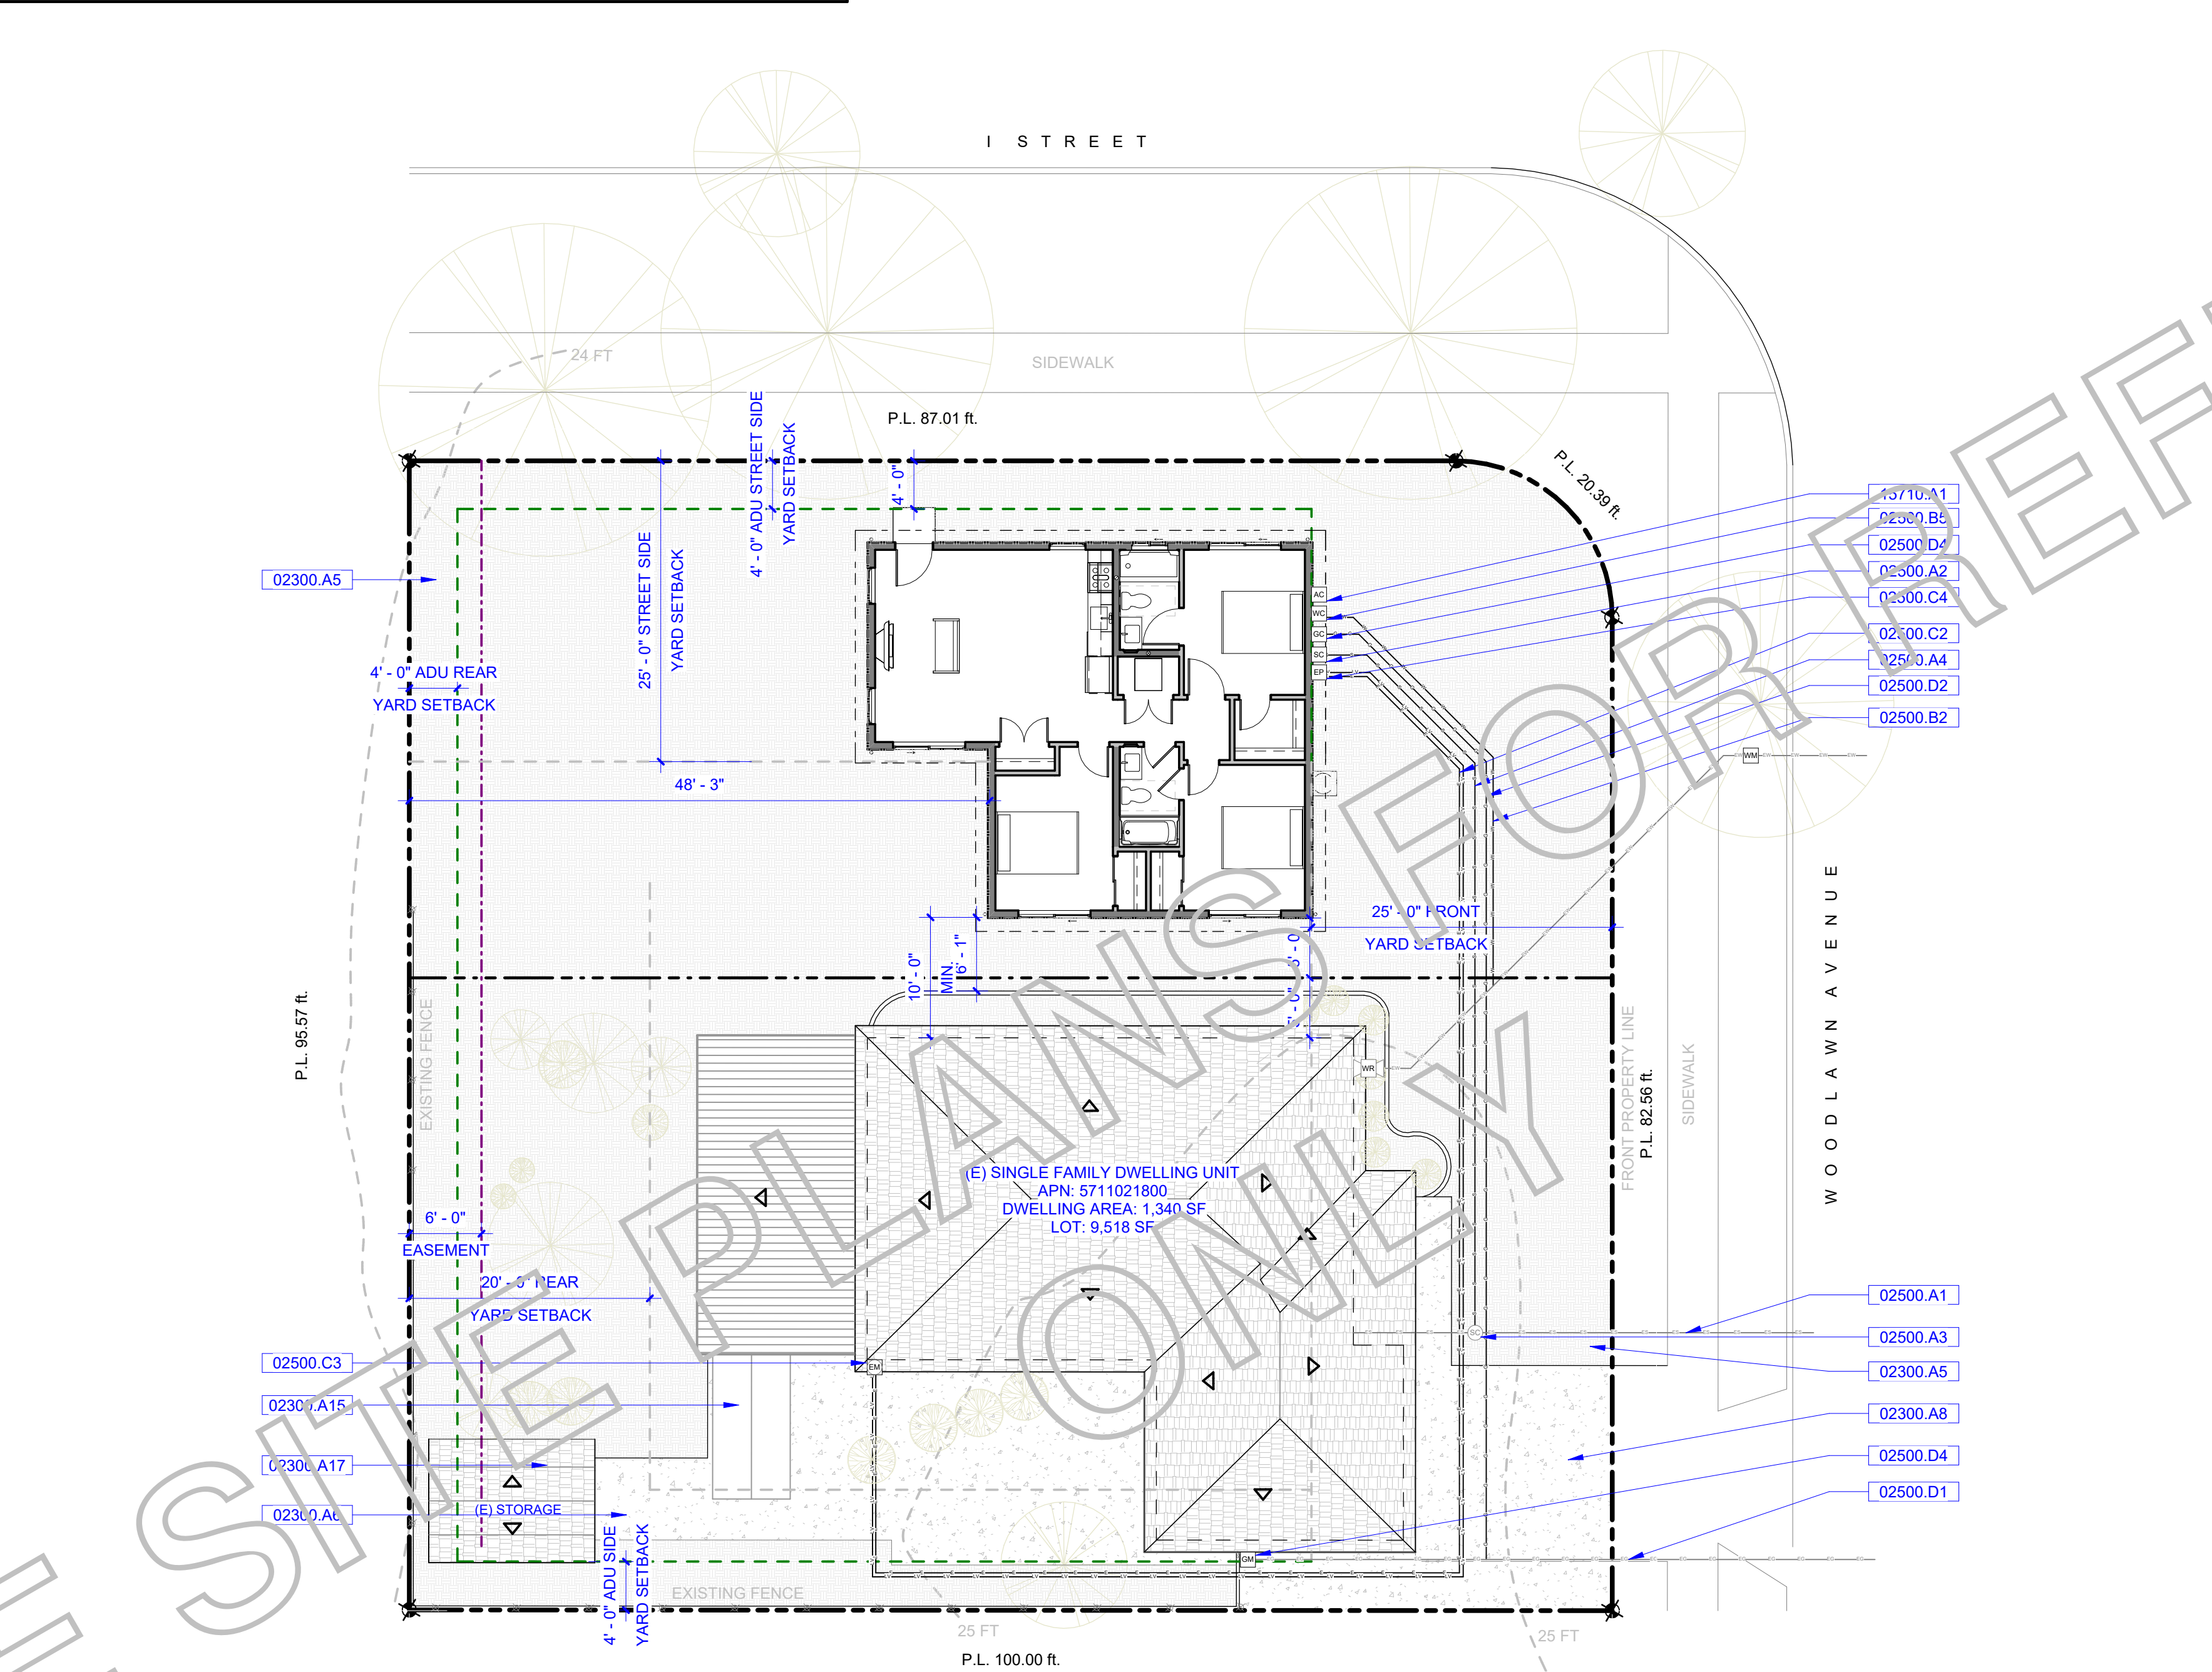


1 PROPOSED SITE PLAN

SCALE: 1" = 10'-0"

0' 2' 4' 6' 8' 10' 20'

1" = 10'-0"



KEYNOTES:

KEYNOTE	DESCRIPTION
02300.A5	(E) LAWN
02300.A6	(E) PATHWALK (CONCRETE)
02300.A8	(E) DRIVEWAY (CONCRETE)
02300.A15	(E) EXISTING TENT
02300.A17	(E) EXISTING STORAGE
02500.A1	(E) SEWAGE LINE
02500.A2	(N) SEWER POINT OF CONNECTION
02500.A3	(E) SANITARY CLEANOUT
02500.A4	(N) SEWAGE LINE, SIZING PER CPC TABLE 703.2
02500.B2	(N) WATER LINE, SIZING PER CPC TABLE 610.4
02500.B5	(N) WATER POINT OF CONNECTION WITH SHUT-OFF VALVE
02500.C2	(N) ELECTRICAL LINE
02500.C3	(E) ELECTRIC METER & PANEL; SEE REQUIREMENTS PER ELECTRICAL SERVICE SELECTION ON SHEET G102
02500.C4	(N) 150AMP ELECTRICAL SUB-PANEL WITH LOCAL DISCONNECT, WIRE SIZES / QUANTITY FEEDING SUB-PANEL FROM MAIN ELECTRICAL PANEL (3#1 & (1)#6G CU IN 1-1/2" CONDUIT.
02500.D1	(E) NATURAL GAS LINE
02500.D2	(N) NATURAL GAS LINE, SIZING PER TABLE C 1215.0
02500.D4	(N) GAS CONNECTION
15710.A1	A/C CONDENSER GOODMAN, 36,000 BTU/H, HER T24 REPORT

PROPOSED SITE PLAN LEGEND

(E) STRUCTURES	---	PROPERTY LINE
(E) NATIVE LANDSCAPING	---	IMAGINARY PROPERTY LINE
(E) ASPHALT	---	SETBACK LINE
(E) PAVERS	---	EASEMENT LINE
	---	STREET CENTERLINE
	---	(E) WATER LINE
	---	(E) ELECTRICAL LINE
	---	(E) NATURAL GAS LINE
	---	(E) SEWAGE LINE
	---	(N) WATER LINE
	---	(N) ELECTRICAL LINE
	---	(N) LOW VOLTAGE CONDUIT
	---	(N) NATURAL GAS LINE
	---	(N) SEWAGE LINE
	---	COUNTOUR LINE
	---	(E) PERIMETER FENCING

	SIZE (INCH)	MATERIAL	BURIAL DEPTH (INCH)
WATER LINE:			
SEWAGE LINE:			
ELECTRICAL LINE:			
GAS LINE:			
GAS LINE LENGTH FROM (E) GAS METER (FT):			

LID HANDBOOK NOTES

LOW IMPACT DEVELOPMENT (LID) HANDBOOK APPLICABLE SECTIONS AND MEASURES TO THE PROPOSED WORK:

2.2. SITE PLANNING;

2.2.4. MINIMIZE SOIL COMPACTION;

2.2.5. DRAIN RUNOFF FROM IMPERVIOUS SURFACES TO PERVIOUS AREAS.

GENERAL NOTES

1. THIS PROJECT PROPOSES NO WORK WITHIN THE PUBLIC RIGHT-OF-WAY.
2. ALL DRAINAGE FROM IMPERVIOUS AREAS & DOWNSPOUTS TO BE ROUTED TO LANDSCAPE AREAS & PLANTER BOXES.
3. FINISHED GRADING SHALL SLOPE AWAY FROM THE PERIMETER OF THE BUILDING TOWARD THE PAD SWALE THAT GOES AROUND THE BUILDING AT A SLOPE OF TWO PERCENT FOR A MINIMUM OF FIVE FEET. THIS REQUIREMENTS SHALL ALSO APPLY TO ALL FLATWORK AND LANDSCAPED AREAS ADJACENT TO THE STRUCTURE.
4. STABILIZATION OF ALL DISTURBED AREAS, BY MEANS OF COMPLETED LANDSCAPING, MULCHING, OR OTHER CITY APPROVED METHOD, IS REQUIRED PRIOR TO GRANT OF OCCUPANCY.
5. SEPARATE (DETACHED BUILDING WITH A SEPARATE FOUNDATION AND SLAB) ADU REQUIRES A SEPARATE GROUND ELECTRODE SYSTEM PER CEC 250.32.
6. ADU MAY HAVE A SEPARATE UTILITY SERVICE INSTALLED, OR SUB FED VIA EXISTING SERVICE WITH ADEQUATE CAPACITY. ADU'S REQUIRE ELECTRICAL LOAD CALCULATIONS PER CEC 220.83 TO JUSTIFY EXISTING ELECTRICAL SERVICE SIZE IS ADEQUATE.
7. LANDSCAPE IRRIGATION WATER USE SHALL HAVE WEATHER OR SOIL-BASED CONTROLLERS. CGC SECTION 4.304.1.
8. A MINIMUM OF 65% OF CONSTRUCTION WASTE IS TO BE RECYCLED. CGC SECTION 4.408.1.
9. THE CONTRACTOR SHALL SUBMIT A CONSTRUCTION WASTE MANAGEMENT PLAN, PER CGC SECTION 4.408.2.
10. OPERATION AND MAINTENANCE MANUAL. THE BUILDER IS TO PROVIDE AN OPERATION MANUAL (CONTAINING INFORMATION FOR MAINTAINING APPLIANCES, ETC.) FOR THE OWNER AT THE TIME OF FINAL INSPECTION. CGC SECTION 4.410.1.
11. POLLUTANT CONTROL. DURING CONSTRUCTION, ENDS OF DUCT OPENINGS ARE TO BE SEALED, AND MECHANICAL EQUIPMENT IS TO BE COVERED. CGC SECTION 4.504.1.
12. POLLUTANT CONTROL. VOC'S MUST COMPLY WITH THE LIMITATIONS LISTED IN SECTION 4.504.3 AND TABLES 4.504.1, 4.504.2, 4.504.3 AND 4.504.5 FOR: ADHESIVES, PAINTS AND COATINGS, CARPET AND COMPOSITION WOOD PRODUCTS. CGC SECTION 4.504.2.
13. INTERIOR MOISTURE CONTROL. CONCRETE SLABS WILL BE PROVIDED WITH A CAPILLARY BREAK. CGC SECTION 4.505.2.1.
14. INTERIOR MOISTURE CONTROL. THE MOISTURE CONTENT OF WOOD SHALL NOT EXCEED 19% BEFORE IT IS ENCLOSED IN CONSTRUCTION. THE MOISTURE CONTENT NEEDS TO BE CERTIFIED BY ONE OF 3 METHODS SPECIFIED. BUILDING MATERIALS WITH VISIBLE SIGNS OF WATER DAMAGE SHOULD NOT BE USED IN CONSTRUCTION. THE MOISTURE CONTENT MUST BE DETERMINED BY THE CONTRACTOR BY ONE OF THE METHODS LISTED IN CGC SECTION 4.505.3.
15. INDOOR AIR QUALITY. BATHROOM FANS SHALL BE ENERGY STAR RATED, VENTED DIRECTLY TO THE OUTSIDE AND CONTROLLED BY A HUMIDISTAT. CGC 4.506.1.
16. CONTRACTOR TO FIELD VERIFY UTILITY ROUTES AND REQUIREMENT OF SEWAGE PUMP. ROUTES MAY DIFFER BASED ON FIELD CONDITIONS AT START OF CONSTRUCTION.
17. A BOUNDARY SURVEY OR A BUILDING VERIFICATION SURVEY, TO DETERMINE EXACT LOCATION OF PROPERTY LINES, INCLUDING THE RELATION OF THOSE LINES TO THE ADU LOCATION IS REQUIRED AS PART OF THIS PLAN SET, WITHOUT CONDUCTING A BOUNDARY SURVEY IT IS NOT POSSIBLE TO PERFORM A BUILDING VERIFICATION SURVEY FROM A LICENSE PROFESSIONAL LAND SURVEYOR.
18. SEE ADDITIONAL SITE PLAN NOTES ON SHEET G101.



SNAPADU
DESIGN HOUSE

YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 999 L-SHAPE
CITY OF CHULA VISTA
276 FOURTH AVENUE,
CHULA VISTA, CA 91910

DESIGNER:
LUIS CALDERON
SnapADU

SIGNATURE

RELEASE	DATE	BY	APP.	RELEASED FOR...
	03/22/2024		LAG	

PROPOSED SITE
PLAN

A011

22040


3 BEDROOM DOOR SCHEDULE							
MARK	WIDTH	HEIGHT	R.O. WIDTH	R.O. HEIGHT	TYPE	COMMENTS	
D1	3'-0"	6'-8"	38"	82 1/2"	EXTERIOR DOOR		
D2	3'-0"	6'-8"	38"	82"	INTERIOR SINGLE PANEL DOOR		
D3	3'-0"	6'-8"	38"	82"	INTERIOR SINGLE PANEL DOOR		
D4	2'-6"	6'-8"	32"	82"	INTERIOR SINGLE PANEL DOOR		
D5	2'-6"	6'-8"	32"	82"	INTERIOR SINGLE PANEL DOOR		
D6	2'-6"	6'-8"	32"	82"	INTERIOR SINGLE PANEL DOOR		
D7	2'-6"	6'-8"	32"	82"	INTERIOR SINGLE PANEL DOOR		
D8	2'-6"	6'-8"	32"	82"	INTERIOR SINGLE PANEL DOOR		
D9	4'-0"	6'-8"	50 1/2"	82"	INTERIOR DOUBLE PANEL DOOR		
D10	4'-0"	6'-8"	50 1/2"	82"	INTERIOR DOUBLE PANEL DOOR	100 SQ.IN. MIN. AIR TRANSFER GRILLE ABOVE DOOR	
D11	4'-0"	6'-8"			INTERIOR BYPASS SLIDING DOOR		
D12	4'-0"	6'-8"			INTERIOR BYPASS SLIDING DOOR		

3 BEDROOM - WINDOW SCHEDULE

MARK	WIDTH	HEIGHT	R.O. WIDTH	R.O. HEIGHT	SILL HEIGHT	HEADER HEIGHT	TYPE	COMMENTS
W1	3'-0"	4'-0"	3'-0 1/2"	4'-0 1/2"	3'-0"	7'-0"	SINGLE HUNG	TEMPERED
W2	3'-0"	4'-0"	3'-0 1/2"	4'-0 1/2"	3'-0"	7'-0"	SINGLE HUNG	
W3	6'-0"	4'-0"	6'-0 1/2"	4'-0 1/2"	3'-0"	7'-0"	SLIDER	
W4	6'-0"	4'-0"	6'-0 1/2"	4'-0 1/2"	3'-0"	7'-0"	SLIDER	
W5	6'-0"	4'-0"	6'-0 1/2"	4'-0 1/2"	3'-0"	7'-0"	SLIDER	
W6	6'-0"	4'-0"	6'-0 1/2"	4'-0 1/2"	3'-0"	7'-0"	SLIDER	
W7	3'-0"	1'-0"	3'-0 1/2"	1'-0 1/2"	6'-9"	7'-9"	SLIDER	
W8	3'-0"	4'-0"	3'-0 1/2"	4'-0 1/2"	3'-0"	7'-0"	SINGLE HUNG	

DOOR & WINDOW NOTES

- FIELD VERIFY ALL DIMENSIONS PRIOR TO ORDERING.
- DOOR SWING DIRECTION PER PLAN.
- DIMENSIONS DO NOT INCLUDE DOOR FRAME, U.N.O.
- PROVIDE SUITABLE ISOLATOR BETWEEN DIS-SIMILAR METALS (I.E. ALUMINUM & STEEL).
- ALL GLAZING IN DOORS SHALL BE TEMPERED.
- ALL WINDOWS (U.N.O.) SHALL BE GLAZED PER TITLE 24 REQUIREMENTS.
- ALL MANUFACTURED WINDOWS SHALL HAVE A LABEL ATTACHED CERTIFIED BY THE NATIONAL FENESTRATION RATING COUNCIL (NFR) AND SHOWING COMPLIANCE WITH THE TITLE 24 ENERGY REPORT.
- ALL WINDOWS SHOULD HAVE A MAX U-FACTOR OF .30, A MAXIMUM SHGC OF .23.
- PROVIDE TEMPERED GLASS ("TEMP") AT WINDOWS WITHIN A 24-INCH ARCH OF A DOOR JAMB, AND AT GLAZING UNITS ABOVE THE SHOWER OR BATHTUB, IN SAUNAS OR STEAM ROOMS WHERE THE SILL IS WITHIN 60 INCHES MEASURED VERTICALLY FROM THE WET STANDING SURFACE.
- TEMPERED GLASS AT THE FOLLOWING LOCATIONS REQUIRING SAFETY GLAZING:
 - GLAZING IN SWINGING, SLIDING, AND BI-FOLD DOORS (CRC R308.4.1).
 - GLAZING WITHIN 60 INCHES - VERTICALLY AND HORIZONTALLY - OF SHOWERS, BATHTUBS, HOT TUBS, SWIMMING POOLS, AND SAUNAS (CRC R308.4.5).
- PER CBC SECTION 708A.2, EXTERIOR WINDOWS, EXTERIOR GLAZED SHALL COMPLY WITH THE FOLLOWING:
 - MULTI-PANE GLAZING WITH A MINIMUM OF ONE TEMPERED PANE MEETING THE REQUIREMENTS OF SECTION 2406 SAFETY GLAZING, AND WHERE ANY GLAZING FRAMES MADE OF VINYL MATERIALS SHALL HAVE WELDED CORNERS, METAL REINFORCEMENT IN INTERLOCK AREA, AND BE CERTIFIED TO AAMA/WDMA/CSA 101/I.5.2/A440.
- PER CBC SECTION 708A.3, EXTERIOR DOORS SHALL BE CONSTRUCTED WITH A NON-COMBUSTIBLE CLADDING MATERIAL OR BE CONSTRUCTED WITH A SOLID CORE, STILES/RAILS NO LESS THAN 1-3/8" THICK, AND PANELS NO LESS THAN 1-1/4" THICK, EXCEPT FOR THE XTERIOR PERIMETER OF THE PANEL THAT SHALL BE PERMITTED TO TAPER TO THE TONGUE NO LESS THAT 3/8" THICK.
- PER CBC SECTION 708A.2, GLAZED DOORS TO BE CONSTRUCTED WITH MULTIPANE GLAZING WITH A MINIMUM OF ONE TEMPERED PANE CONFORMING TO SECTION 2406.
- SKYLIGHTS SHALL BE TESTED BY AN APPROVED INDEPENDENT LABORATORY, AND BEAR A LABEL IDENTIFYING MANUFACTURER, PERFORMANCE GRADE RATING AND APPROVED INSPECTION AGENCY TO INDICATE COMPLIANCE WITH THE REQUIREMENTS OF AAMA/WDMA/CSA 101/I.5.2/A440.

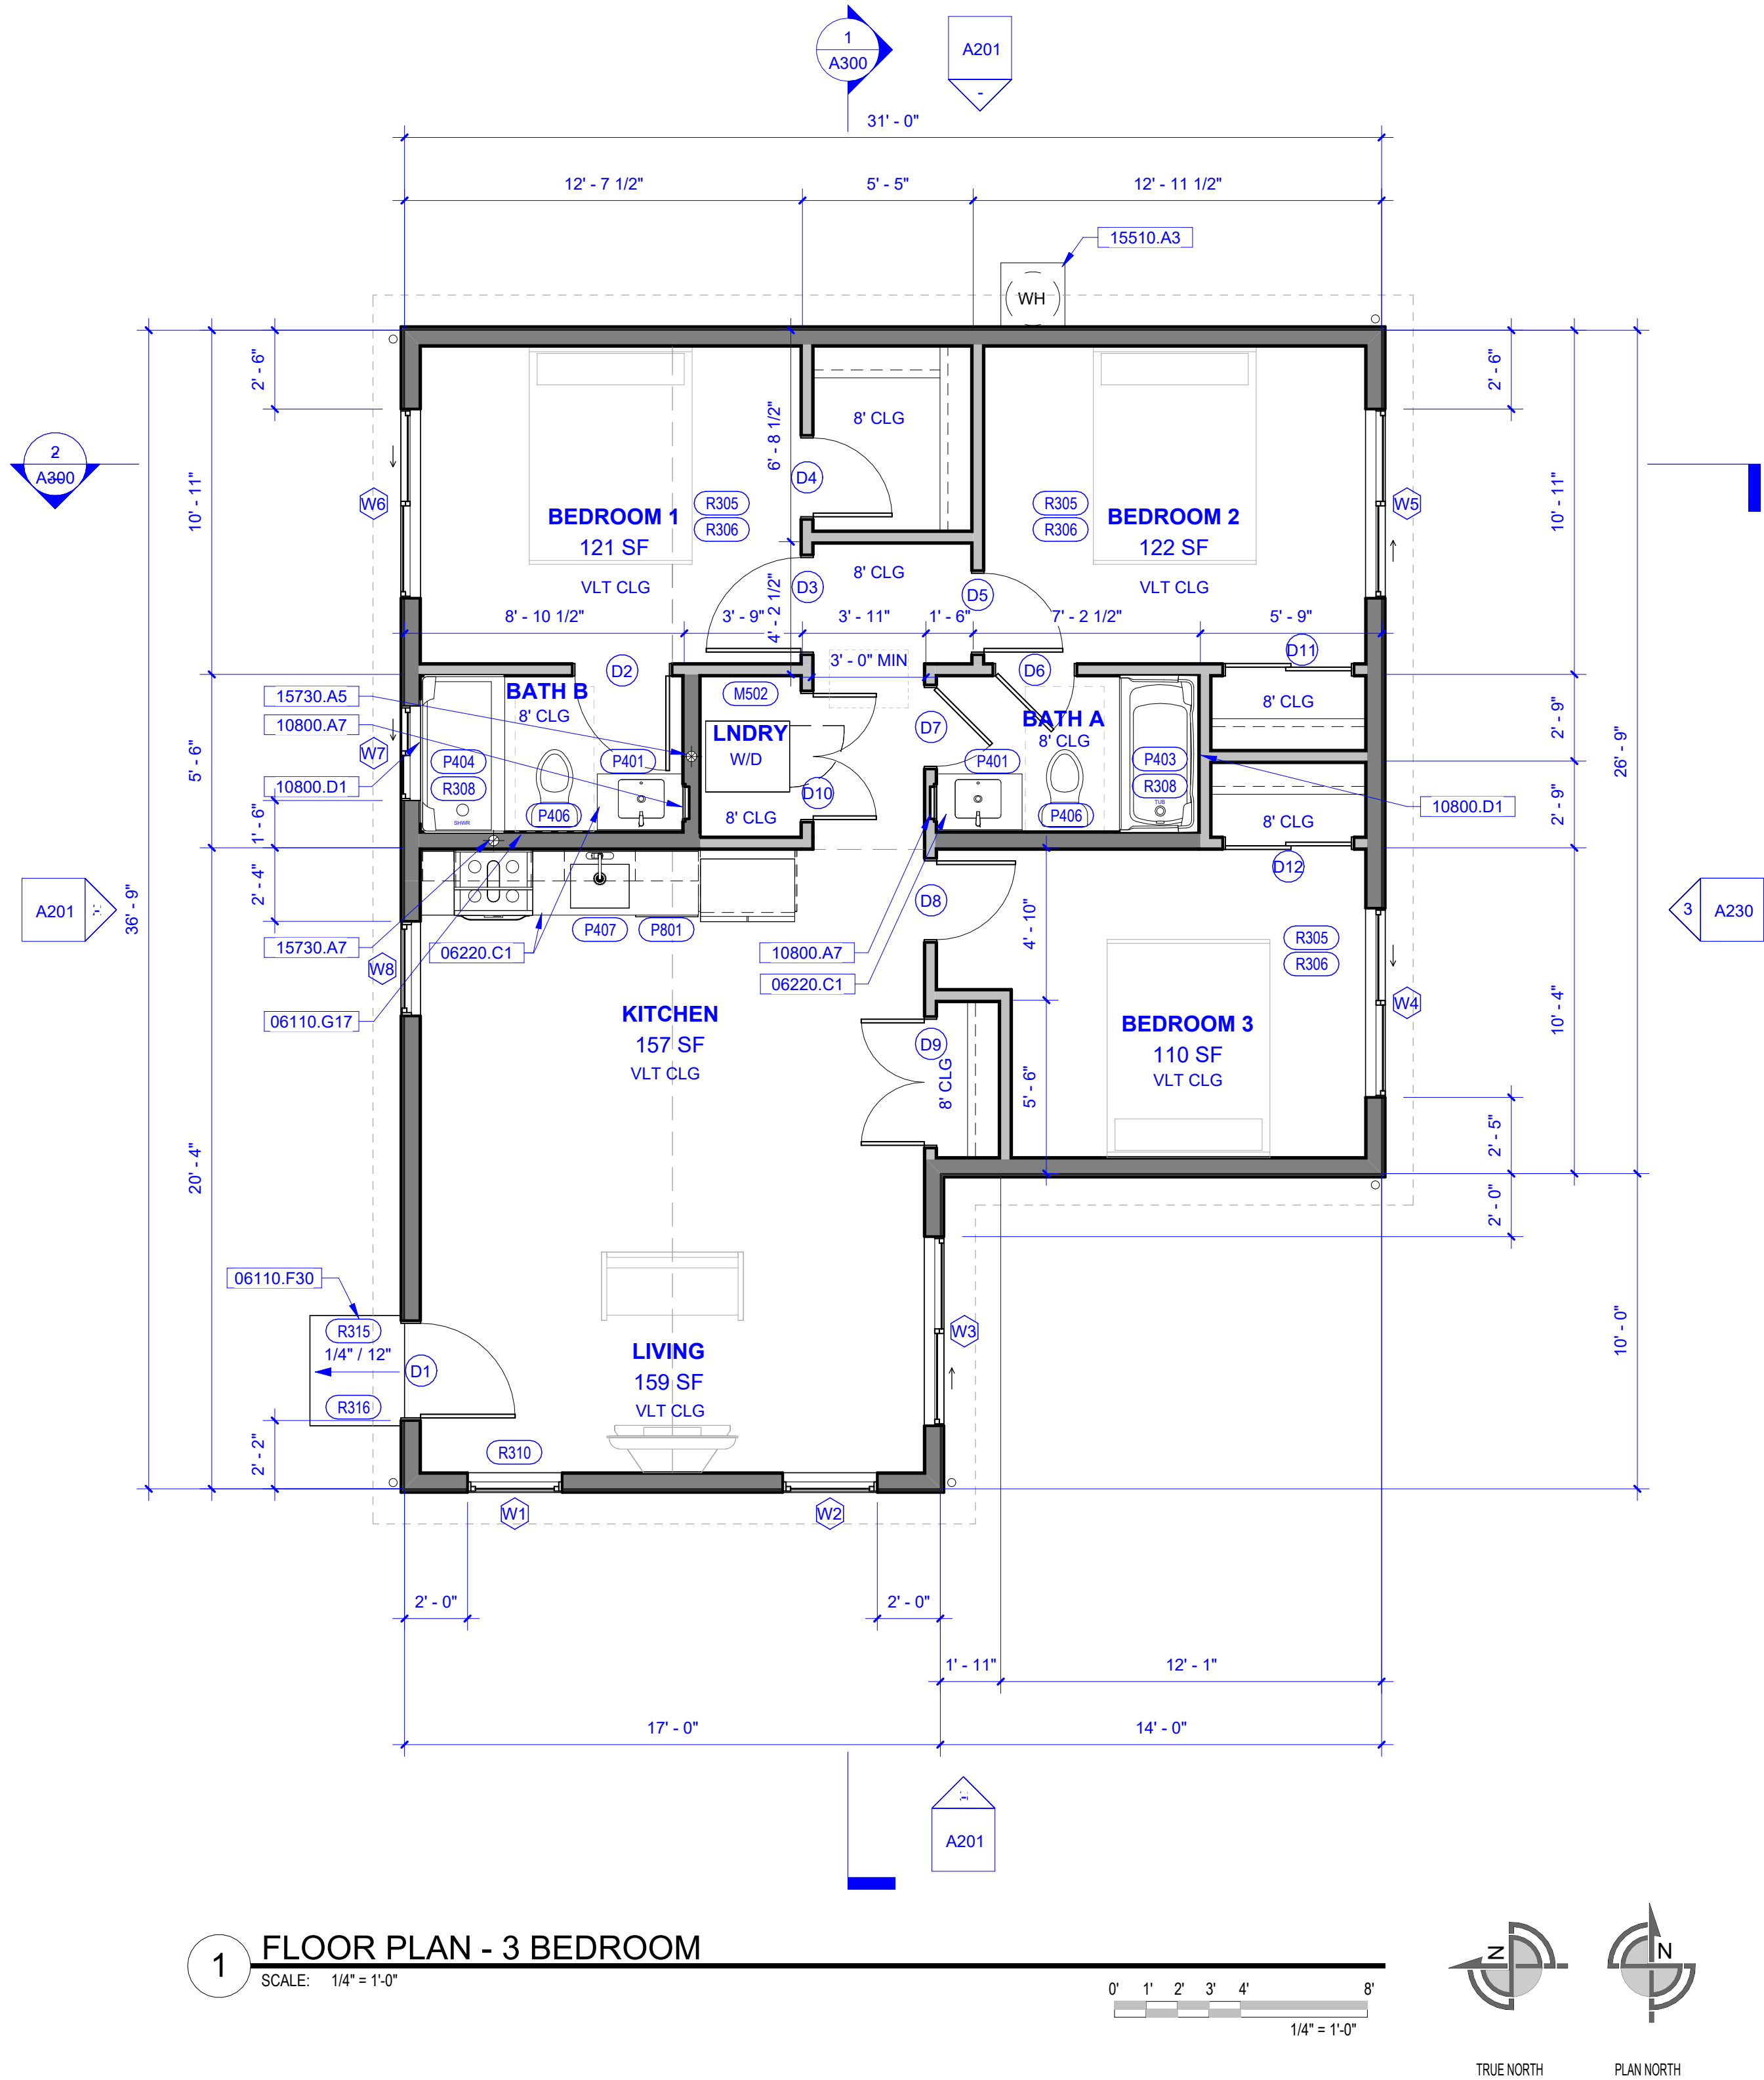

1 FLOOR PLAN - 3 BEDROOM
SCALE: 1/4" = 1'-0"

KEYNOTES:

KEYNOTE	DESCRIPTION
06110.F30	WOOD STOOP EXTERIOR DOOR LANDING
06110.G17	2X8 MIN. SOLID REINFORCEMENT LOCATED BETWEEN 32" AND 39 1/4" AFF. SEE SHEETS G101 AND A501 FOR MORE INFORMATION ABOUT AGING-IN-PLACE DESIGN
06220.C1	MILLWORK SHOWN FOR REFERENCE ONLY, SEE SHOP DRAWINGS
10800.A7	PROVIDE 14 1/4" x 25 1/4" R.O. FRAMING FOR MEDICINE CABINET. NO ELECTRICAL WIRING WITHIN FRAMING FOR MEDICINE CABINET PERMITTED
10800.D1	PROVIDE FRAMING FOR 16"x12" NICHE. BOTTOM OF NICHE TO BE 60" ABOVE SLAB AND CENTERED ALONG WALL
15510.A3	APPLICANT/OWNER TO PROVIDE CUT SHEET FOR WATER HEATER TO MEET MINIMUM REQUIREMENTS OF TITLE 24 CALCULATIONS
15730.A5	4" DRYER VENT, SEE SHEET G200 CODE EXCERPTS CHAPTER 5: EXHAUST SYSTEMS FOR MORE INFORMATION
15730.A7	HOOD EXHAUST FAN ABOVE ELECTRIC RANGE 130 CFM OR 55% CE MIN. (GAS RANGE 280 CFM OR 85% CE MIN.); 2022 BEES TABLE 150.0-G

FLOOR PLAN LEGEND:

- 2X6 WOOD STUDS @ 16" O.C.
- 2X4 WOOD STUDS @ 16" O.C.
- 34" TALL PONY WALL 2X4 WOOD STUDS @ 16" O.C.
- OVERHEAD LINES
- VAULTED CEILING
- 8' CLG 8' FLAT CEILING
- VLT CLG VAULTED CEILING

YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 999 L-SHAPE

CITY OF CHULA VISTA
276 FOURTH AVENUE,
CHULA VISTA, CA 91910

DESIGNER:

LUIS CALDERON
SnapADU

SIGNATURE

RELEASE	DATE	BY	APP.	RELEASED FOR...
A	03/22/2024		LAG	

FLOOR PLAN - 3
BEDROOM

A100

22040

MARK	WIDTH	HEIGHT	R.O. WIDTH	R.O. HEIGHT	TYPE	COMMENTS
D1	3' - 0"	6' - 8"	38"	82 1/2"	EXTERIOR DOOR	
D2	3' - 0"	6' - 8"	38"	82"	INTERIOR SINGLE PANEL DOOR	
D3	3' - 0"	6' - 8"	38"	82"	INTERIOR SINGLE PANEL DOOR	
D4	2' - 6"	6' - 8"	32"	82"	INTERIOR SINGLE PANEL DOOR	
D5	2' - 6"	6' - 8"	32"	82"	INTERIOR SINGLE PANEL DOOR	
D6	2' - 6"	6' - 8"	32"	82"	INTERIOR SINGLE PANEL DOOR	
D7	2' - 6"	6' - 8"	32"	82"	INTERIOR SINGLE PANEL DOOR	
D10	4' - 0"	6' - 8"	50 1/2"	82"	INTERIOR DOUBLE PANEL DOOR	100 SQ. IN. MIN. AIR TRANSFER GRILLE ABOVE DOOR
D14	2' - 6"	6' - 8"	32"	82"	INTERIOR SINGLE PANEL DOOR	

MARK	WIDTH	HEIGHT	R.O. WIDTH	R.O. HEIGHT	SILL HEIGHT	HEADER HEIGHT	TYPE	COMMENTS
W1	3'-0"	4'-0"	3'-0 1/2"	4'-0 1/2"	3'-0"	7'-0"	SINGLE HUNG	TEMPERED
W2	3'-0"	4'-0"	3'-0 1/2"	4'-0 1/2"	3'-0"	7'-0"	SINGLE HUNG	
W3	6'-0"	4'-0"	6'-0 1/2"	4'-0 1/2"	3'-0"	7'-0"	SLIDER	
W4	6'-0"	4'-0"	6'-0 1/2"	4'-0 1/2"	3'-0"	7'-0"	SLIDER	
W5	6'-0"	4'-0"	6'-0 1/2"	4'-0 1/2"	3'-0"	7'-0"	SLIDER	
W6	6'-0"	4'-0"	6'-0 1/2"	4'-0 1/2"	3'-0"	7'-0"	SLIDER	
W7	3'-0"	1'-0"	3'-0 1/2"	1'-0 1/2"	6'-9"	7'-9"	SLIDER	
W8	3'-0"	4'-0"	3'-0 1/2"	4'-0 1/2"	3'-0"	7'-0"	SINGLE HUNG	

TRUE NORTH

PLAN NORTH

KEYNOTE	DESCRIPTION
06110.F30	WOOD STOOP EXTERIOR DOOR LANDING
06110.G17	2X8 MIN. SOLID REINFORCEMENT LOCATED BETWEEN 32" AND 39 1/4" AFF. SEE SHEETS G101 AND A501 FOR MORE INFORMATION ABOUT AGING-IN-PLACE DESIGN
06220.C1	MILLWORK SHOWN FOR REFERENCE ONLY. SEE SHOP DRAWINGS
10800.A1	PROVIDE 14 1/4" x 25 1/4" R.O. FRAMING FOR MEDICINE CABINET. NO ELECTRICAL WIRING WITHIN FRAMING FOR MEDICINE CABINET PERMITTED
10800.D1	PROVIDE FRAMING FOR 16"x12" NICHE. BOTTOM OF NICHE TO BE 60" ABOVE SLAB AND CENTERED ALONG WALL
15510.A3	APPLICANT/OWNER TO PROVIDE CUT SHEET FOR WATER HEATER TO MEET MINIMUM REQUIREMENTS OF TITLE 24 CALCULATIONS.
15730.A5	4" DRYER VENT. SEE SHEET G200 CODE EXCERPTS CHAPTER 5; EXHAUST SYSTEMS FOR MORE INFORMATION
15730.A7	HOOD EXHAUST FAN ABOVE ELECTRIC RANGE 130 CFM OR 55% CE MIN. (GAS RANGE 280 CFM OR 85% CE MIN.); 2022 BEES TABLE 10.0-G

22040








FLOOR PLAN OPTIONS - WINDOW SCHEDULE


1. FIELD VERIFY ALL DIMENSIONS PRIOR TO ORDERING.
2. DOOR SWING DIRECTION PER PLAN.
3. DIMENSIONS DO NOT INCLUDE DOOR FRAME, U.N.O.
4. PROVIDE SUITABLE ISOLATOR BETWEEN DIS-SIMILAR METALS (I.E. ALUMINUM & STEEL).
5. ALL GLAZING IN DOORS SHALL BE TEMPERED.
6. ALL WINDOWS (U.N.O.) SHALL BE GLAZED PER TITLE 24 REQUIREMENTS.
7. ALL MANUFACTURED WINDOWS SHALL HAVE A LABEL ATTACHED CERTIFIED BY THE NATIONAL FENESTRATION RATING COUNCIL (NFCRC) AND SHOWING COMPLIANCE WITH THE TITLE 24 ENERGY CODE.
8. ALL WINDOWS SHOULD HAVE A MAX U-FACTOR OF .30, A MAXIMUM SHGC OF .23.
9. PROVIDE TEMPERED GLASS ("TEMP") AT WINDOWS WITHIN A 24-INCH ARCH OF A DOOR JAMB, AND AT GLAZING UNITS ABOVE THE SHOWER OR BATHTUB, IN SAUNAS OR STEAM ROOMS WHERE THE SILL IS WITHIN 60 INCHES MEASURED VERTICALLY FROM THE WET STANDING SURFACE.
10. TEMPERED GLASS AT THE FOLLOWING AREAS REQUIRING SAFETY GLAZING:
 - A. GLAZING IN SWINGING, SLIDING, AND BI-FOLD DOORS (CRC R308 4.1).
 - B. GLAZING WITHIN 60 INCHES - VERTICALLY AND HORIZONTALLY - OF SHOWERS, BATHTUBS, HOT TUBS, SWIMMING POOLS, AND SAUNAS (CRC R308 4.5).
11. PER CBC SECTION 708A.2, EXTERIOR WINDOWS, EXTERIOR GLAZED SHAL COMPLY WITH THE FOLLOWING:
 - A. GLAZING IN DOORS WITH A MINIMUM OF ONE TEMPERED PANE MEETING THE REQUIREMENTS OF SECTION 2406 SAFETY GLAZING, AND WHERE ANY GLAZING FRAMES MADE OF VINYL MATERIALS SHALL HAVE WELDED CORNERS, METAL REINFORCEMENT IN INTERLOCK AREA, AND BE CERTIFIED TO AAMA/WDMA/CSA 1011.5.2/A440.
12. PER CBC SECTION 708A.3, EXTERIOR DOORS SHALL BE CONSTRUCTED WITH A VISIBLE SURFACE GLAZING MATERIAL OR BE CONSTRUCTED WITH A SOLID CORE, STILL FRAMES NO THICKER THAN 1/4" THICK, AND PANELS NO LESS THAN 1-1/4" THICK, EXCEPT FOR THE EXTERIOR PERIMETER OF THE PANEL THAT SHALL BE PERMITTED TO TAPER TO THE TONGUE NO LESS THAN 3/8" THICK.
13. PER CBC SECTION 708A.2, GLAZED DOORS TO BE CONSTRUCTED WITH MULTIPANE GLAZING WITH A MINIMUM OF ONE TEMPERED PANE CONFORMING TO SECTION 2406.
14. SKID TEST SHALL BE TESTED BY AN APPROVED INDEPENDENT LABORATORY, AND BEAR A LABEL IDENTIFYING MANUFACTURER, PERFORMANCE GRADE RATING AND APPROVED INSPECTION AGENCY TO INDICATE COMPLIANCE WITH THE REQUIREMENTS OF AAMA/WDMA/CSA 1011.5.2/A440.



KEYNOTE	DESCRIPTION
06110.D11	34" TALL 2X4 PONY WALL
06110.F30	WOOD STOOP EXTERIOR DOOR LANDING
06110.G17	2X8 MIN. SOLID REINFORCEMENT LOCATED BETWEEN 32" AND 39 1/4" AFF. SEE SHEETS G101 AND A501 FOR MORE INFORMATION ABOUT AGING-IN-PLACE DESIGN
06220.C1	MILLWORK SHOWN FOR REFERENCE ONLY. SEE SHOP DRAWINGS
07110.B3	DOWNSPOUT
07800.A7	PROVIDE 14 1/4" x 25 1/4" R.O. FRAMING FOR MEDICINE CABINET. NO ELECTRICAL WIRING WITHIN FRAMING FOR MEDICINE CABINET PERMITTED
08000.D1	PROVIDE FRAMING FOR 16"x12" NICHE. BOTTOM OF NICHE TO BE 60" ABOVE SLAB AND CENTERED ALONG WALL
5730.A5	4" DRYER VENT. SEE SHEET G200 CODE EXCERPTS CHAPTER 5: EXHAUST SYSTEMS FOR MORE INFORMATION
5730.A7	HOOD EXHAUST FAN ABOVE ELECTRIC RANGE 130 CFM OR 55% CE MIN. (GAS RANGE 280 CFM OR 85% CE MIN.); 2022 BEES TABLE 100-0-G

FLOOR PLAN LEGEND:

	2X6 WOOD STUDS @ 16" O.C.
	2X4 WOOD STUDS @ 16" O.C.
	34" TALL PONY WALL 2X4 WOOD STUDS @ 16" O.C.
	OVERHEAD LINES
	VAULTED CEILING
	8" FLAT CEILING
	VAULTED CEILING

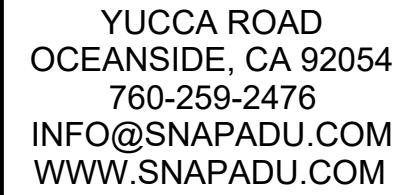

ADU: 999 L-SHAPE
CITY OF CHULA VISTA
276 FOURTH AVENUE,
CHULA VISTA, CA 92011

DESIGNER:
LUIS CALDERON
SnapADU



SIGNATURE

[illegible]



FLOOR PLAN - OPTIONS

A102

22040

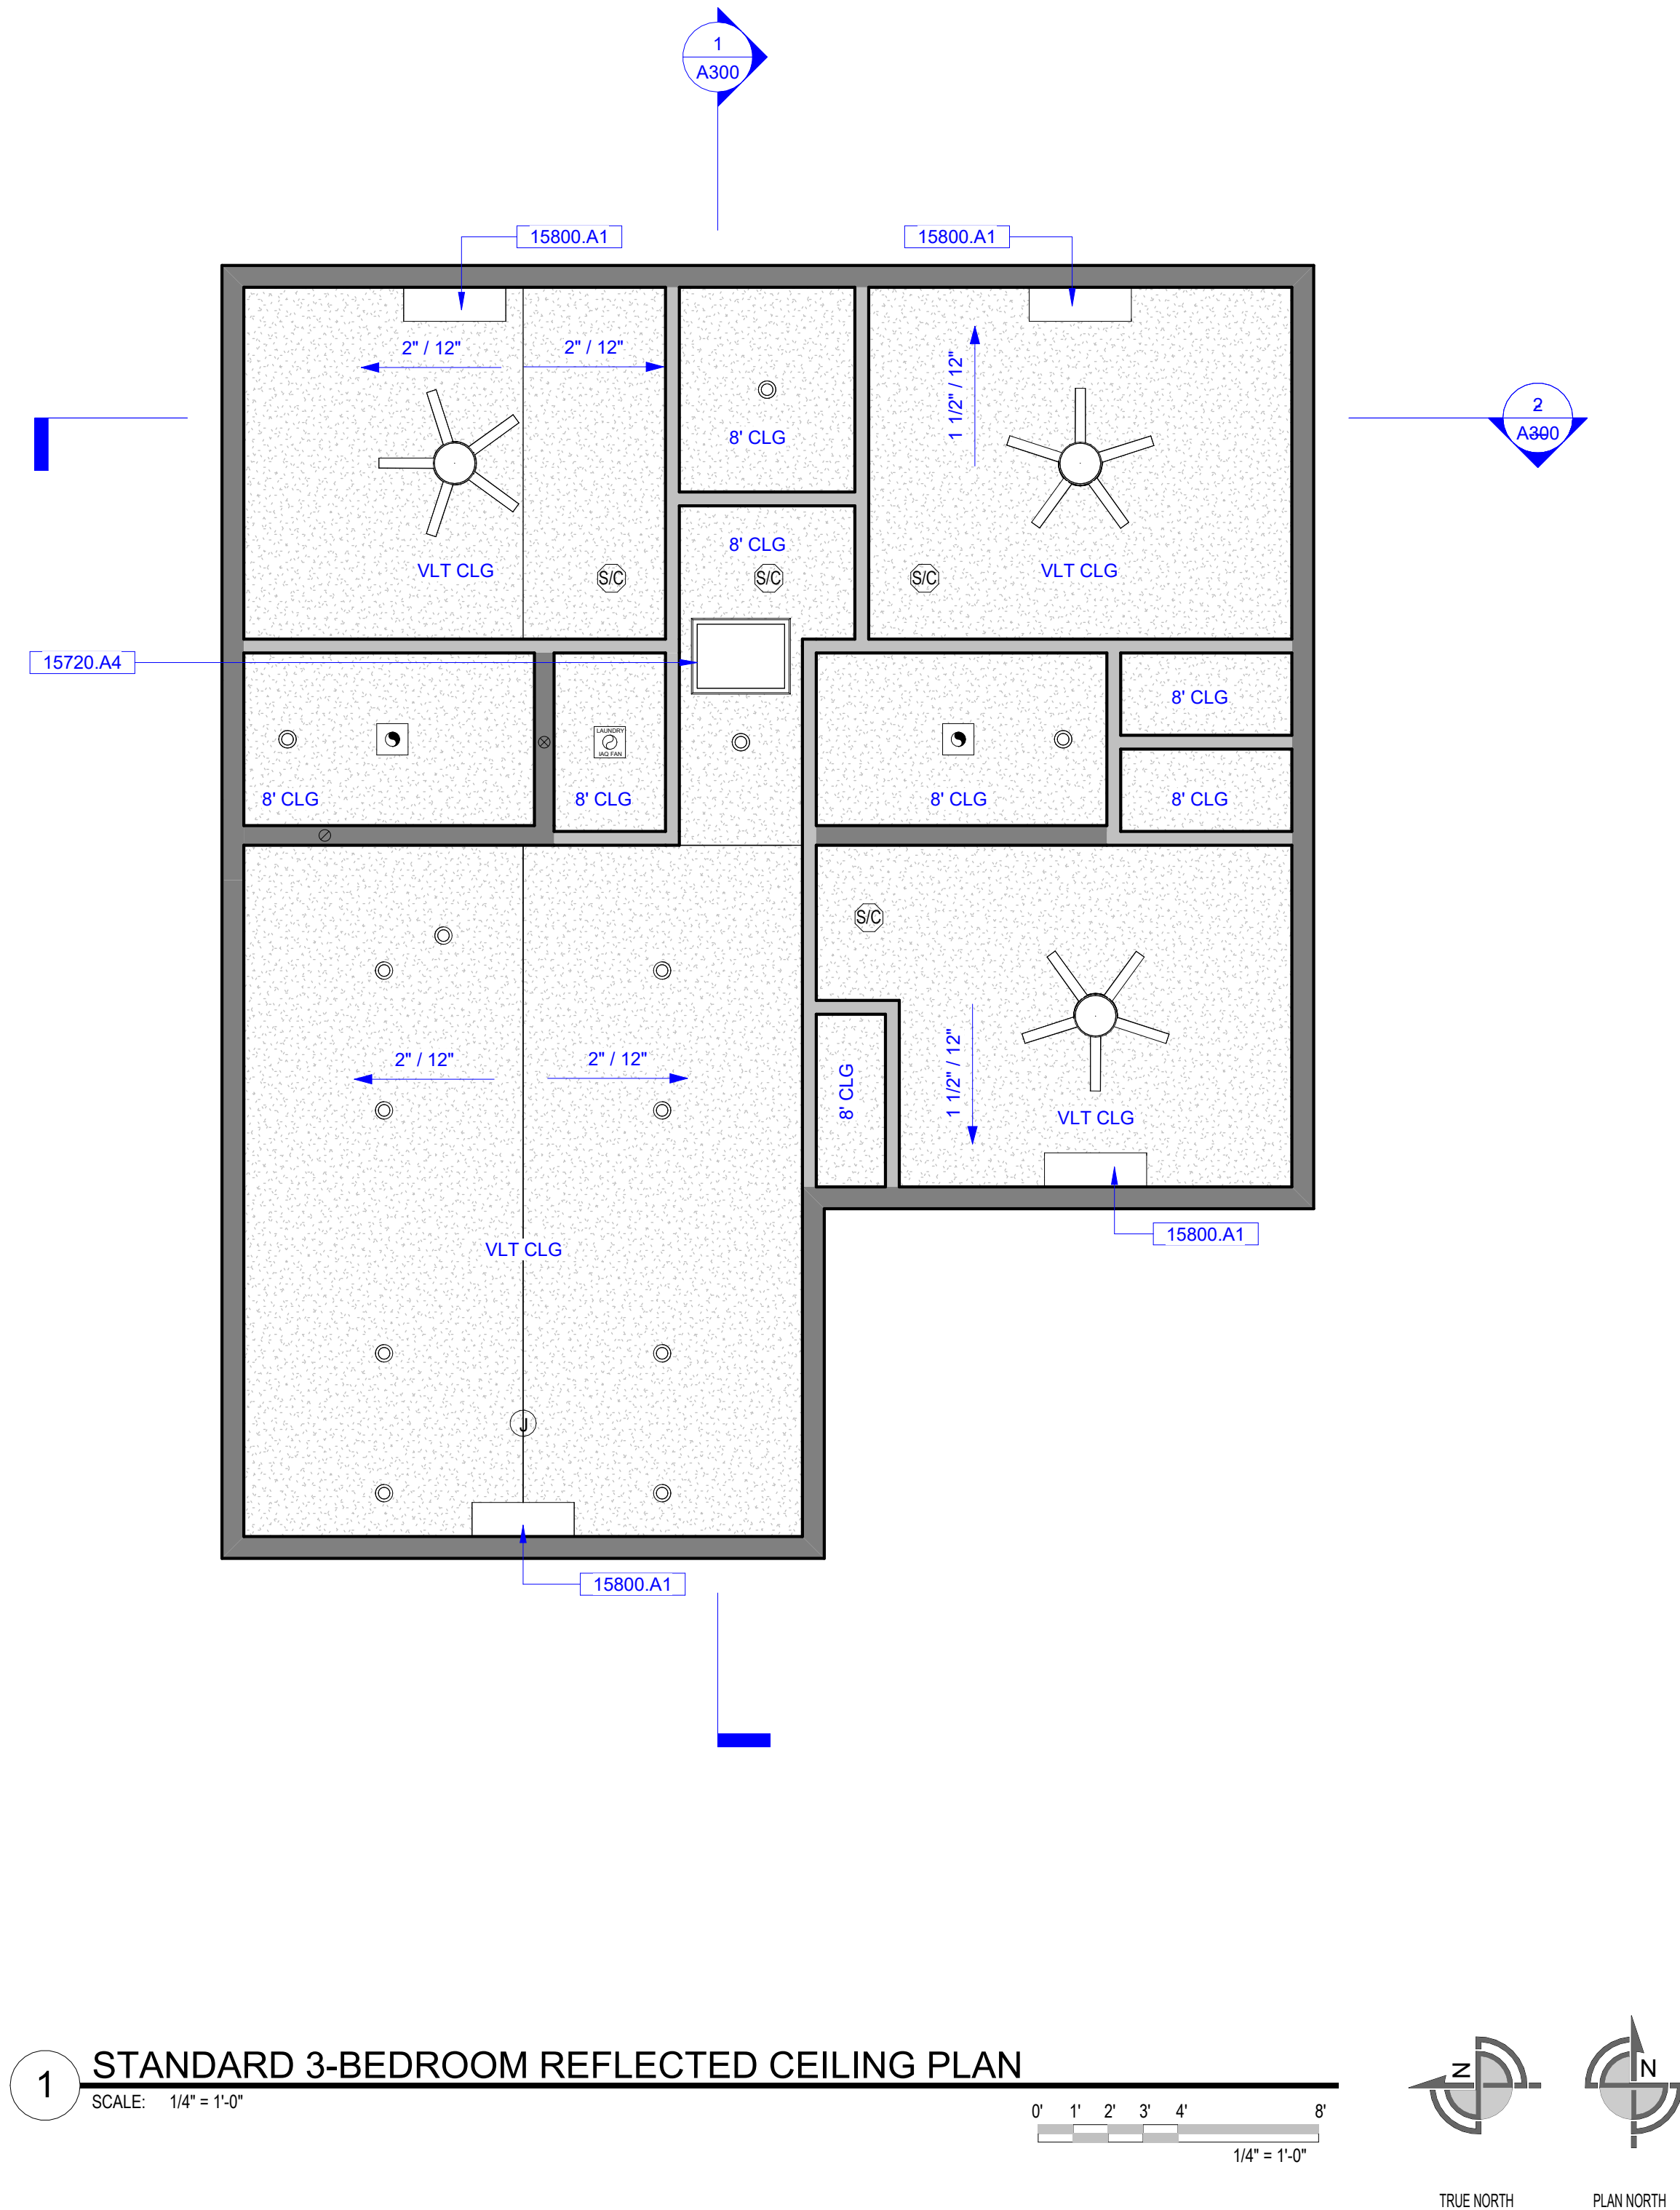

1 STANDARD 3-BEDROOM REFLECTED CEILING PLAN
SCALE: 1/4" = 1'-0"

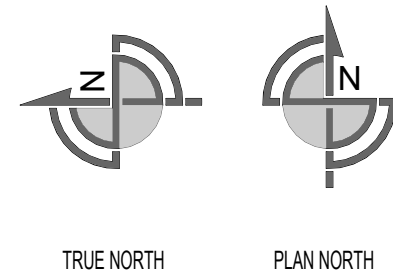

KEYNOTES:

KEYNOTE	DESCRIPTION
15720.A4	22"X30" ATTIC ACCESS
15800.A1	MINI SPLIT SYSTEM; APPLICANT/OWNER TO PROVIDE CUT SHEET TO MEET MINIMUM REQUIREMENTS OF TITLE 24 CALCULATIONS

REFLECTED CEILING PLAN LEGEND

	DRYWALL CEILING
	JUNCTION BOX
	SMOKE / CARBON MONOXIDE DETECTOR HARDWIRED W/ BATTERY BACKUP
	PHOTOELECTRIC SMOKE / CARBON MONOXIDE DETECTOR HARDWIRED W/ BATTERY BACKUP
	RECESSED LIGHT
	MICROWAVE-HOOD EXHAUST FAN COMBO 130 CFM MIN (IF GAS RANGE 280 CFM MIN. TO BE PROVIDED)
	EXHAUST VENT FAN - INTERMITTENT 50 CFM MIN / CONTINUOUS 20 CFM MIN
	EXHAUST VENT FAN SHALL BE USED TO MEET THE REQUIREMENTS FOR INDOOR AIR QUALITY (IAQ) PER T24 REPORT
	LAUNDRY EXHAUST VENT FAN SHALL BE USED TO MEET THE REQUIREMENTS FOR INDOOR AIR QUALITY (IAQ) PER T24 REPORT
	CEILING FAN WITH LIGHT
	DIRECTION OF CEILING SLOPE
	8' FLAT CEILING
	VAULTED CEILING

REFLECTED CEILING NOTES:

1. SMOKE ALARMS LOCATED BETWEEN 10 TO 20 FT FROM COOKING APPLIANCE SHALL BE IONIZED SMOKE ALARMS WITH ALARM SILENCING SWITCH, OR PHOTOELECTRIC SMOKE ALARM IN ACCORDANCE CRC R314.3.3 (4) EXCEPTION



SNAPADU
DESIGN HOUSE

YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 999 L-SHAPE

CITY OF CHULA VISTA
276 FOURTH AVENUE,
CHULA VISTA, CA 91910

DESIGNER:

LUIS CALDERON
SnapADU


SIGNATURE

RELEASE	DATE	BY	APP.	LAG	RELEASED FOR...
A	03/22/2024				

REFLECTED
CEILING PLAN - 3
BEDROOM

A110


22040

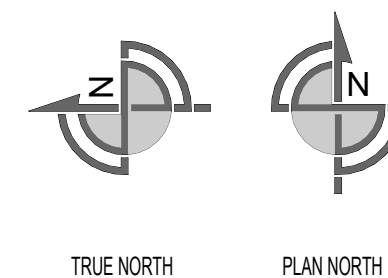



KEYNOTES:


KEYNOTE	DESCRIPTION
15720.A4	22"X30" ATTIC ACCESS
15800.A1	MINI SPLIT SYSTEM; APPLICANT/OWNER TO PROVIDE CUT SHEET TO MEET MINIMUM REQUIREMENTS OF TITLE 24 CALCULATIONS


REFLECTED CEILING PLAN LEGEND


 DRYWALL CEILING


 JUNCTION BOX


 SMOKE / CARBON MONOXIDE DETECTOR HARDWIRED W/ BATTERY BACKUP


 PHOTOELECTRIC SMOKE / CARBON MONOXIDE DETECTOR HARDWIRED W/ BATTERY BACKUP


 RECESSED LIGHT


 MICROWAVE-HOOD EXHAUST FAN COMBO 130 CFM MIN (IF GAS RANGE 280 CFM MIN. TO BE PROVIDED)

 EXHAUST VENT FAN - INTERMITTENT 50 CFM MIN / CONTINUOUS 20 CFM MIN

 EXHAUST VENT FAN SHALL BE USED TO MEET THE REQUIREMENTS FOR INDOOR AIR QUALITY (IAQ) PER T24 REPORT

 LAUNDRY EXHAUST VENT FAN SHALL BE USED TO MEET THE REQUIREMENTS FOR INDOOR AIR QUALITY (IAQ) PER T24 REPORT

 CEILING FAN WITH LIGHT

 SLOPE
 DIRECTION OF CEILING SLOPE

8' CLG 8' FLAT CEILING

VLT CLG VAULTED CEILING


REFLECTED CEILING NOTES:

1. SMOKE ALARMS LOCATED BETWEEN 10 TO 20 FT FROM COOKING APPLIANCE SHALL BE IONIZED SMOKE ALARMS WITH ALARM SILENCING SWITCH, OR PHOTOELECTRIC SMOKE ALARM IN ACCORDANCE CRC R314.3.3 (4) EXCEPTION





ADU: 999 L-SHAPE
CITY OF CHULA VISTA
276 FOURTH AVENUE,
CHULA VISTA, CA 91910

DESIGNER:
LUIS CALDERON
SnapADU


SIGNATURE

[illegible]

REFLECTED CEILING PLAN - 2 BEDROOM
A111
22040

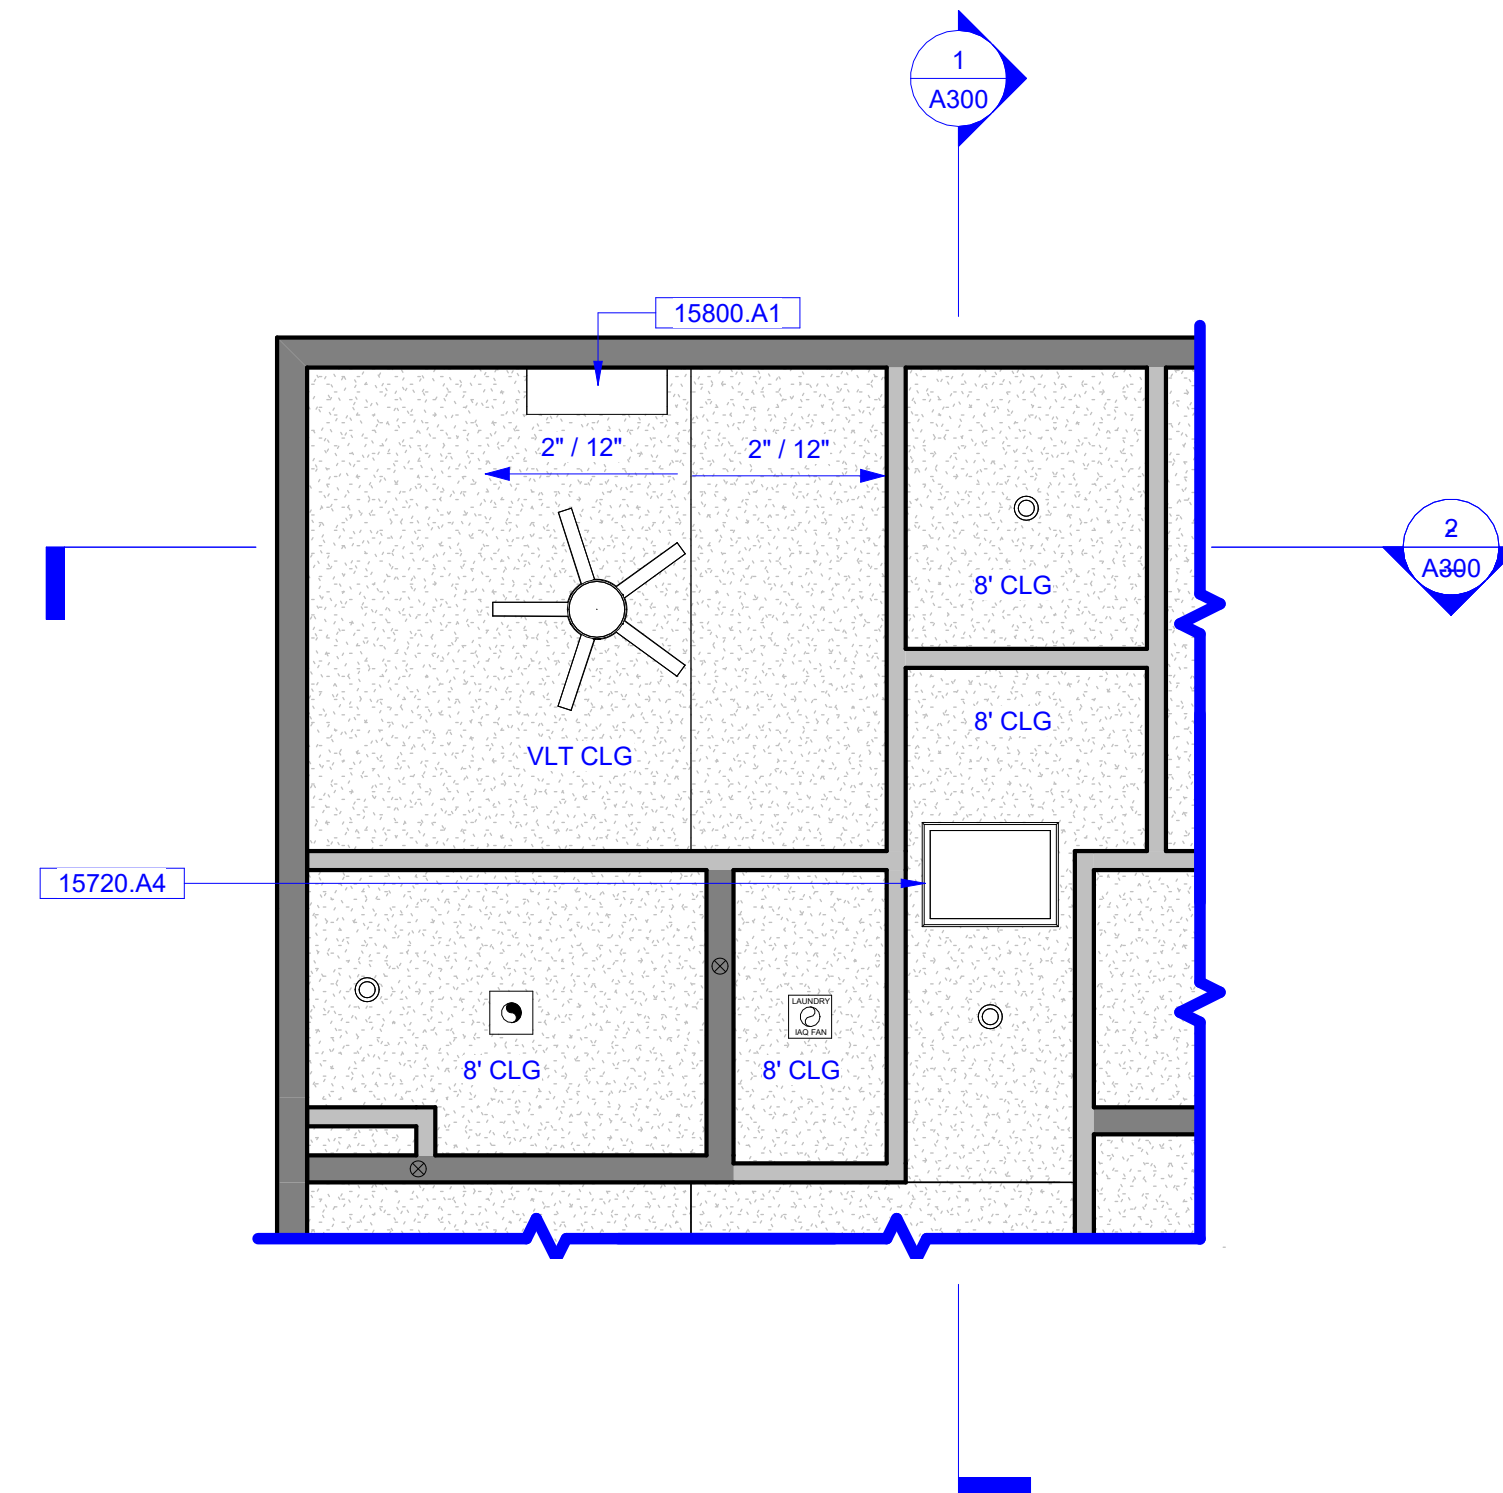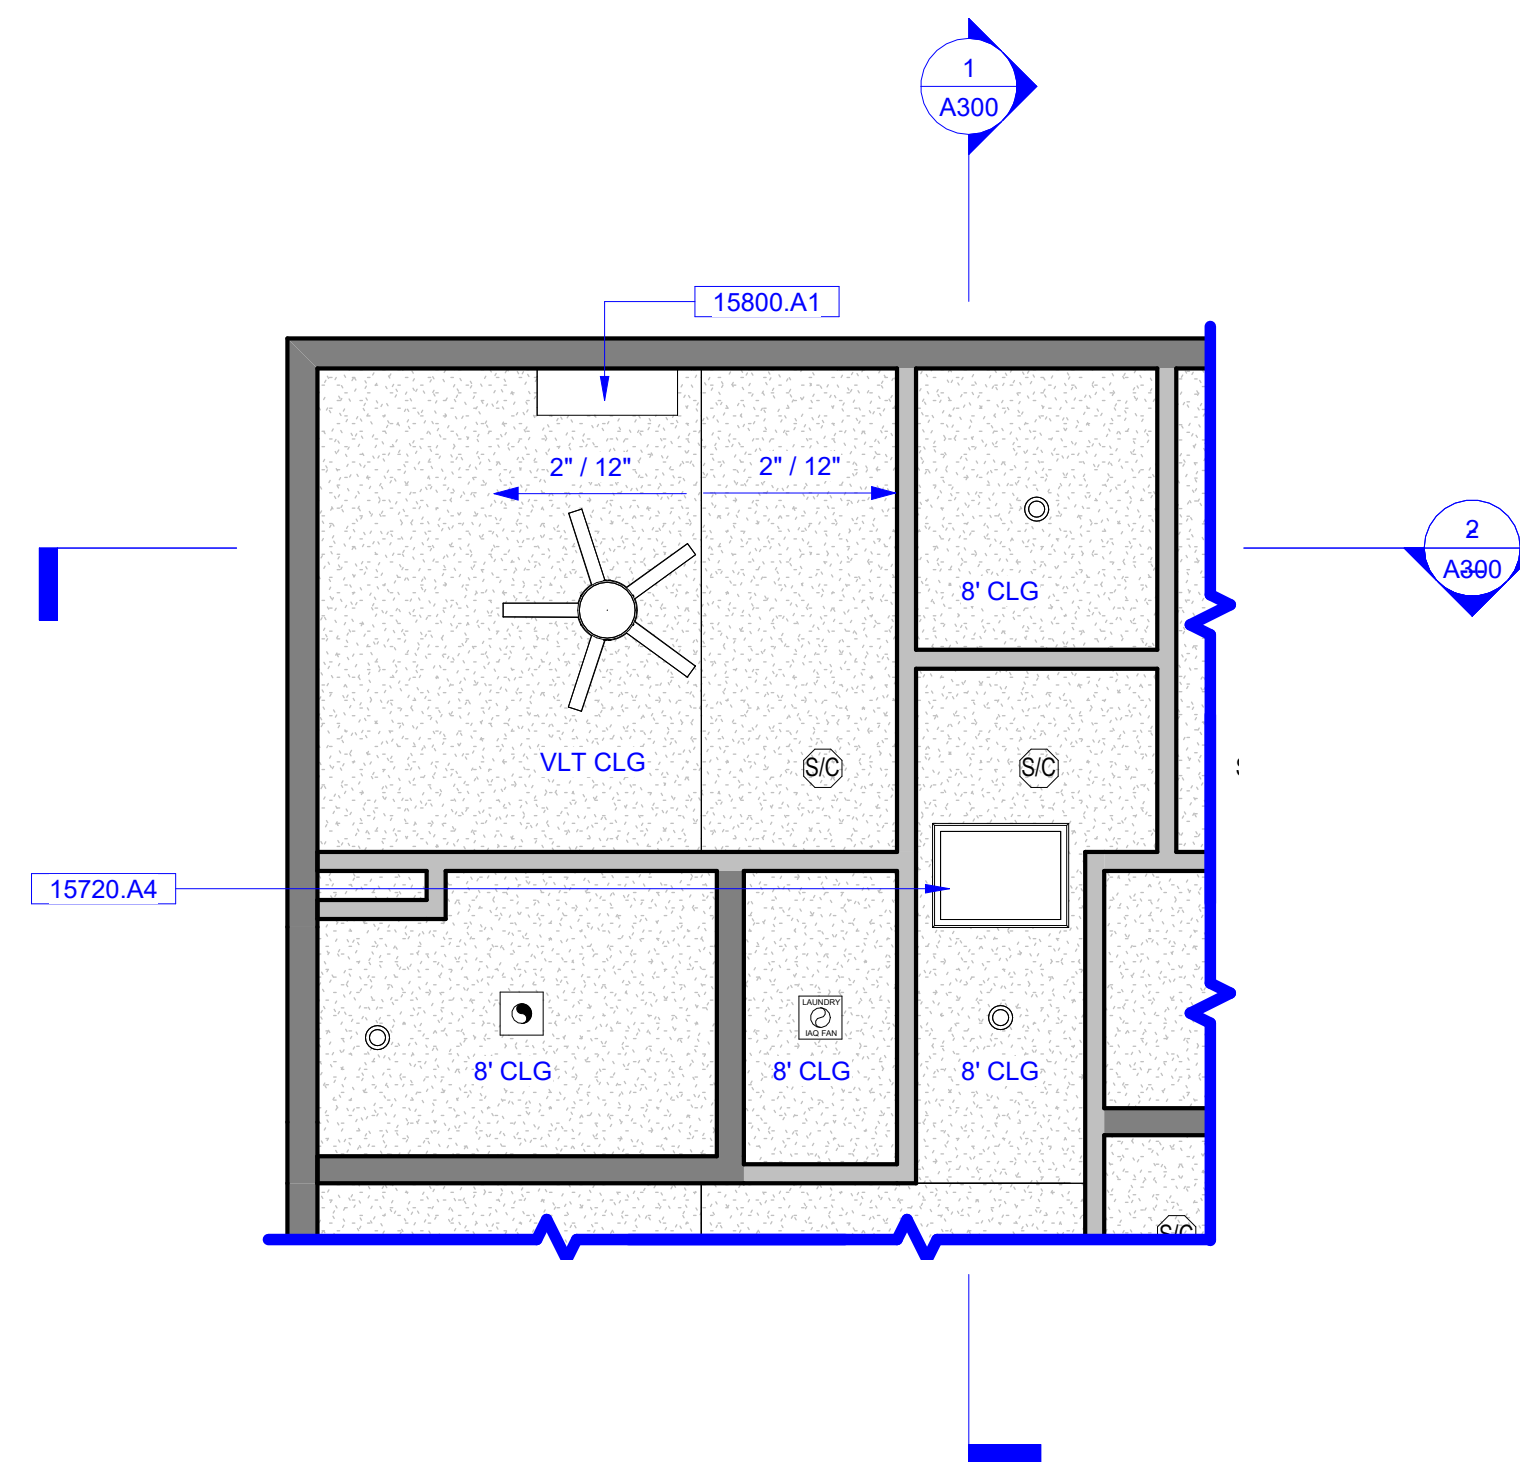

KEYNOTES:	
KEYNOTE	DESCRIPTION
15720.A4	22"x30" ATTIC ACCESS
15800.A1	MINI SPLIT SYSTEM; APPLICANT/OWNER TO PROVIDE CUT SHEET TO MEET MINIMUM REQUIREMENTS OF TITLE 24 CALCULATIONS

REFLECTED CEILING PLAN LEGEND

The diagram shows a rectangular area representing a ceiling. At the top left is a textured square labeled "DRYWALL CEILING". Below it are several circular icons: a junction box (J), a smoke/carbon monoxide detector (S/C) with "BATTERY BACKUP", another smoke/carbon monoxide detector (S/C) with "PE" and "BATTERY BACKUP", a recessed light (a circle with a dot), a microwave-hood exhaust fan (a circle with a dot and a line), an exhaust vent fan (a circle with a dot and a line), and another exhaust vent fan (a circle with a dot and a line). Below these are labels: "JUNCTION BOX", "SMOKE / CARBON MONOXIDE DETECTOR HARDWIRED W/ BATTERY BACKUP", "PHOTOELECTRIC SMOKE / CARBON MONOXIDE DETECTOR HARDWIRED W/ BATTERY BACKUP", "RECESSED LIGHT", "MICROWAVE-HOOD EXHAUST FAN COMBO 130 CFM MIN (IF GAS RANGE 280 CFM MIN. TO BE PROVIDED)", "EXHAUST VENT FAN - INTERMITTENT 50 CFM MIN / CONTINUOUS 20 CFM MIN", "EXHAUST VENT FAN SHALL BE USED TO MEET THE REQUIREMENTS FOR INDOOR AIR QUALITY (IAQ) PER T24 REPORT", and "LAUNDRY EXHAUST VENT FAN SHALL BE USED TO MEET THE REQUIREMENTS FOR INDOOR AIR QUALITY (IAQ) PER T24 REPORT". At the bottom left is a circular ceiling fan with five blades, labeled "CEILING FAN WITH LIGHT". Below the fan is a blue arrow pointing left, labeled "SLOPE", and the text "DIRECTION OF CEILING SLOPE". At the bottom are two labels: "8' CLG" and "8' FLAT CEILING". At the very bottom are two labels: "VLT CLG" and "VAULTED CEILING".

DRYWALL CEILING

JUNCTION BOX

SMOKE / CARBON MONOXIDE DETECTOR HARDWIRED W/ BATTERY BACKUP

PHOTOELECTRIC SMOKE / CARBON MONOXIDE DETECTOR HARDWIRED W/ BATTERY BACKUP

RECESSED LIGHT

MICROWAVE-HOOD EXHAUST FAN COMBO 130 CFM MIN (IF GAS RANGE 280 CFM MIN. TO BE PROVIDED)

EXHAUST VENT FAN - INTERMITTENT 50 CFM MIN / CONTINUOUS 20 CFM MIN

EXHAUST VENT FAN SHALL BE USED TO MEET THE REQUIREMENTS FOR INDOOR AIR QUALITY (IAQ) PER T24 REPORT

LAUNDRY EXHAUST VENT FAN SHALL BE USED TO MEET THE REQUIREMENTS FOR INDOOR AIR QUALITY (IAQ) PER T24 REPORT

CEILING FAN WITH LIGHT

SLOPE

DIRECTION OF CEILING SLOPE

8' CLG

8' FLAT CEILING

VLT CLG

VAULTED CEILING



SNAPADU
DESIGN HOUSE

YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 999 L-SHAPE

DESIGNER:
LUIS CALDERON
napADU

SIGNATURE

[illegible]

REFLECTED
CEILING PLAN -
OPTIONS

A112

22040



PLAN NORTH

KEYNOTE	DESCRIPTION
07710.B3	DOWNSPOUT
07710.C1	OHAGIN STANDARD LOW PROFILE ATTIC VENTS, 0.68 SF NFVA
13600.C1	SOLAR ZONE FOR PV SYSTEM (SEE G102 CHECKLIST FOR SIZING PER T24 CALCULATIONS). SOLAR ZONE LOCATION MIGHT VARY PER SITE CONDITIONS
15710.D2	RANGE HOOD ROOF EXHAUST VENT
15710.D3	BATH EXHAUST FAN ROOF VENT

Diagram illustrating the roof layout components and their placement:

- ROOFING PER CHECKLIST SELECTION ON SHEET G102**: Indicated by a dashed line.
- WALL LINE BELOW**: Indicated by a dashed line.
- SLOPE**: Indicated by a blue arrow pointing left.
- DIRECTION OF DRAINAGE**: Indicated by a blue arrow pointing left.
- ROOF VENT**: Indicated by a square symbol with horizontal lines.
- EXHAUST ROOF JACK VENT**: Indicated by a square symbol with a horizontal line.
- SOLAR PV PANEL**: Indicated by a rectangular symbol.

1. ROOF MATERIAL PER CHECKLIST SELECTION ON SHEET G102.
 - a. ROOF TYPE 1 - 242 HIGHLANDER NEX AR ASPHALT SHINGLE, MANUFACTURED BY MALAREK ROOFING PRODUCTS; ICC APPROVAL: 1/15/19, UL RATING 2218; OR EQUAL APPROVED.
 - i. SEE DETAILS: 1/A500, 4/A500, 1/A510, 4/A510, 1/A520, 4/A520, 1/A530, 4/A530.
 - b. ROOF TYPE 2 - LOW PROFILE/ BEL AIR CONCRETE ROOF TILE BY EAGLE ROOFING; IAPMO ER-1900; OR EQUAL APPROVED.
 - i. SEE DETAILS 2/A500, 5/A500, 2/A510, 5/A510, 2/A520, 5/A520, 2/A530, 5/A530.
 - c. ROOF TYPE 3 - HIPS PROFILE/ CAPISTRANO CONCRETE S-TILE ROOF BY EAGLE ROOFING; IAPMO ER-1900; OR EQUAL APPROVED.
 - i. SEE DETAILS 3/A500, 6/A500, 3/A510, 6/A510, 3/A520, 6/A520, 3/A530, 6/A530.
2. OTHER ROOF TYPE MODEL:
 - a. MAKE:
 - i. MODEL:
 - c. ICC ESR NUMBER:
3. ROOF UNDERLAYMENT SHALL BE DOUBLE NEX POLYMER MODIFIED FIBERGLASS UNDERLAYMENT OF 1/8" THICK GL ESQ L OR LESS TO 4.12 PER P905.1.1(2); ICC APPROVAL- ESR-1561; OR EQUAL APPROVED.
4. ROOF GUTTERS SHALL BE PROVIDED WITH THE MEANS TO PREVENT THE ACCUMULATION OF LEAVES AND DEBRIS IN THE GUTTER. (CBC 92.1.705A.4)
5. ALL VENTS (ROOF, FOUNDATION, COMBUSTION-AIR, ETC) SHALL RESIST THE INTRUSION OF LEAVES AND DEBRIS. (CBC 92.1.705A.1)
6. VENTILATION OPENINGS FOR ENCLOSED ATTICS, EAVE SOFF SPACES, ENCLOSED RAFTER SPACES FORMED WHERE CEILINGS ARE APPLIED DIRECTLY TO THE UNDERSIDE OF ROOF RAFTERS, UNDERFLOOR VENTILATION OPENINGS, AND VENT OPENINGS IN EXTERIOR WALLS AND EXTERIOR DOORS SHALL BE LISTED TO ASTM E-28786 AND COMPLY WITH ALL OF THE FOLLOWING: (CBC 92.1.705A.2, CBC 92.1.705A.3)
7. THERE SHALL BE NO FLAMING IGNITION OF THE COTTON MATERIAL DURING THE EMBER ENTRUSION TEST.
8. THERE SHALL BE NO FLAMING IGNITION DURING THE INTEGRITY TEST PORTION OF THE FLAME INTRUSION TEST.
9. THE MAXIMUM TEMPERATURE OF THE UNEXPOSED SIDE OF THE VENT SHALL NOT EXCEED 662 DEGREES FAHRENHEIT (350 DEGREES CELSIUS)
6. EXHAUST DUCT TERMINATION IS AS FOLLOWS PER CMC 502.2:
 - a. 3 FEET FROM A PROPERTY LINE.
 - b. 10 FEET FROM A FORCED AIR INLET, AND
 - c. 3 FEET FROM OPENINGS INTO THE BUILDING.
7. EXHAUST DUCT SHALL NOT DISCHARGE ONTO A PUBLIC WAY. CMC 502.2
8. UNLESS OTHERWISE PERMITTED OR REQUIRED BY THE DRYER MANUFACTURER'S INSTALLATION INSTRUCTIONS AND APPROVED BY THE CITY, DOMESTIC DRYER MOISTURE EXHAUST DUCTS SHALL NOT EXCEED A TOTAL COMBINED HORIZONTAL AND VERTICAL LENGTH OF FIVE FEET INCLUDING TWO 90-DEGREE ELBOWS. TWO FEET SHALL BE DEDUCTED FOR EACH 90 DEGREE ELBOW IN EXCESS OF TWO. CMC 504.4.2.

CLASS-1 VAPOR BARREIR PROVIDED ON WINTER-WARM-SIDE: NO
TOTAL ROOF VENT AREA REQUIRED: ROOF AREA / 150 SF

CALCULATIONS:		
<u>DESCRIPTION</u>	<u>AREA</u>	<u>REQ. ROOF VENT</u>
ATTIC AREA	999 SF	6.66 SF

TOTAL NET FREE VENTILATION AREA (NFVA) PROVIDE:

O'HAGIN CONC.TILE LOW PROF.VENT NFVA = 98.75 SQ.IN.=0.68 SF./V.
 6.66 SF. / 0.68 SF./VENT = 9.80 10 VENTS WILL BE PROVIDED AS FOLLOWS:


4 EXHAUST VENTS WITHIN 3 FT. BELOW THE RIDGE HIGHEST POINT
& 6 INTAKE VENTS AT THE BOTTOM THIRD OF THE ATTIC SPACE

TOTAL VENT AREA = 10 VENTS X 0.68 SF./VENT = 6.80 SF.
TOTAL PROVIDE = 6.80 SF > 6.66 SF REQ. ROOF VENT.



ADU: 999 L-SHAPE
CITY OF CHULA VISTA
276 FOURTH AVENUE,
CHULA VISTA, CA 91910

DESIGNER:
LUIS CALDERON
SnapADU


SIGNATURE

[illegible]

ROOF PLAN

A120

22040



SNAPADU
DESIGN HOUSE

YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 999 L-SHAPE

CITY OF CHULA VISTA
276 FOURTH AVENUE,
CHULA VISTA, CA 91910

DESIGNER:

LUIS CALDERON
SnapADU


SIGNATURE

[illegible]

ROOF PLAN - OPTIONS


A121

22040


KEYNOTES:

KEYNOTE	DESCRIPTION
07710.B3	DOWNSPOUT
07710.C1	O'HAGIN STANDARD LOW PROFILE ATTIC VENTS, 0.68 SF NFVA
08620.A3	2X4 SKYLIGHT (APPLICANT/OWNER TO PROVIDE CUT SHEET FOR SKYLIGHT TO MEET REQUIREMENTS OF FIRE ZONING AND TITLE 24 CALCULATIONS)

ROOF PLAN LEGEND




ROOFING PER CHECKLIST SELECTION ON SHEET G102



WALL LINE BELOW




DIRECTION OF DRAINAGE




ROOF VENT



EXHAUST ROOF JACK VENT



SOLAR PV PANEL

ROOF SKYLIGHT:

MANUFACTURER: _____

MODEL: _____

ICC ESR:

ROOF NOTES:

- ROOF MATERIAL PER CHECKLIST SELECTION ON SHEET G102.
- A. ROOF TYPE 1 - 242 HIGHLANDER NER ASPHALT SHINGLE, MANUFACTURED BY MALARKE ROOFING PRODUCTS; ICC APPROVAL: ESR-3150, UL RATING 22R; OR EQUAL APPROVED.
- a. SEE DETAILS: 1/A500, 4/A500, 1/A510, 4/A510, 1/A520, 4/A520, 1/A530, 4/A530.
- B. ROOF TYPE 2 - LOW PROFILE "BEL AIR" CONCRETE ROOF TILE BY EAGLE ROOFING; IAPMO ER-1900; OR EQUAL APPROVED.
- a. SEE DETAILS 2/A500, 5/A500, 2/A510, 5/A510, 2/A520, 5/A520, 2/A530, 5/A530.
- C. ROOF TYPE 3 - HIGH PROFILE "CAPISTRANO" CONCRETE S-TILE ROOF BY EAGLE ROOFING; IAPMO ER-1900; OR EQUAL APPROVED.
- a. SEE DETAILS 3/A500, 6/A500, 3/A510, 6/A510, 3/A520, 6/A520, 3/A530, 6/A530.
- D. OTHER ROOF TYPE MODEL:
- a. MAKE:
- b. MODEL:
- c. ICC ESR NUMBER:
- D. ROOF UNDERLAYMENT SHALL BE DOUBLE LEX POLYMER MODIFIED FIBERGLASS UNDERLAYMENT ON ROOF SLOPES EQUAL OR LESS TO 4:12 PER P905.1(1/2); ICC APPROVAL: ESR-1561; OR EQUAL APPROVED.
- E. ROOF GUTTERS SHALL BE PROVIDED WITH THE MEANS TO PREVENT THE ACCUMULATION OF LEAVES AND DEBRIS IN THE GUTTER. (CBC 92.1.7054.4)
- F. ALL VENTS (ROOF, FOUNDATION, COMBUSTION-AIR, ETC.) SHALL RESIST THE INTRUSION OF FLAMES AND EMBERS. (CBC 92.1.706A.1)
- G. VENTILATION OPENINGS OR EXHAUST ATTICS, EAVE SOFFIT SPACES, ENCLOSED RAFTER SPACES FORMED WHERE CEILINGS ARE APPLIED DIRECTLY TO THE UNDERSIDE OF ROOF RAFTERS, UNDERFLOOR VENTILATION OPENINGS, AND VENT OPENINGS IN EXTERIOR WALLS AND EXTERIOR DOORS SHALL BE LISTED TO ASTM E 2886 AND COMPLY WITH ALL OF THE FOLLOWING: (CBC 92.1.706A.2, CBC 92.1.706A.3)
- a. THERE SHALL BE NO FLAMING OR IGNITION OF THE COTTON MATERIAL DURING THE EMBER ENTRUSION TEST.
- b. THERE SHALL BE NO FLAMING OR IGNITION DURING THE INTEGRITY TEST PORTION OF THE FLAME INTRUSION TEST.
- c. THE TEMPERATURE OF THE UNEXPOSED SIDE OF THE VENT SHALL NOT EXCEED 662 DEGREES FAHRENHEIT (350 DEGREES CELSIUS)
- G. EXHAUST DUCT TERMINATION IS AS FOLLOWS PER CMG 502.2:
- A. 3 FEET FROM A PROPERTY LINE.
- B. 10 FEET FROM A FORCED AIR INLET, AND
- C. 3 FEET FROM OPENINGS INTO THE BUILDING.
- H. EXHAUST DUCT SHALL NOT DISCHARGE OUTTO A PUBLIC WAY. CMG 502.2
- I. UNLESS OTHERWISE PERMITTED OR REQUIRED BY THE DRYER MANUFACTURER'S INSTALLATION INSTRUCTIONS AND APPROVED BY THE CITY, DOMESTIC DRYER MOISTURE EXHAUST DUCTS SHALL NOT EXCEED A TOTAL COMBINED HORIZONTAL AND VERTICAL LENGTH OF THIRTEEN FEET, INCLUDING TWO 90-DEGREE ELBOWS. TWO FEET SHALL BE DEDUCTED FOR EACH 90 DEGREE ELBOW IN EXCESS OF TWO. CMG 504.2

ROOF VENT CALCULATION

CLASS-1 VAPOR BARREIR PROVIDED ON WINTER-WARM-SIDE: NO
TOTAL ROOF VENT AREA REQUIRED: ROOF AREA / 150 SF

CALCULATIONS:


<u>DESCRIPTION</u>	<u>AREA</u>	<u>REQ. ROOF VENT</u>
ATTIC AREA	999 SF	6.66 SF

TOTAL NET FREE VENTILATION AREA (NFVA) PROVIDE:

O'HAGIN CONC.TILE LOW PROF. VENT NFVA = 98.75 SQ.IN.=0.68 SF./V
6.66 SF. / 0.68 SF./VENT = 9.80 10 VENTS WILL BE PROVIDED AS FOLLOWS:

4 EXHAUST VENTS WITHIN 3 FT. BELOW THE RIDGE HIGHEST POINT
& 6 INTAKE VENTS AT THE BOTTOM THIRD OF THE ATTIC SPACE


TOTAL VENT AREA = 10 VENTS X 0.68 SF./VENT = 6.80 SF
TOTAL PROVIDE = 6.80 SF > 6.66 SF REQ. ROOF VENT.

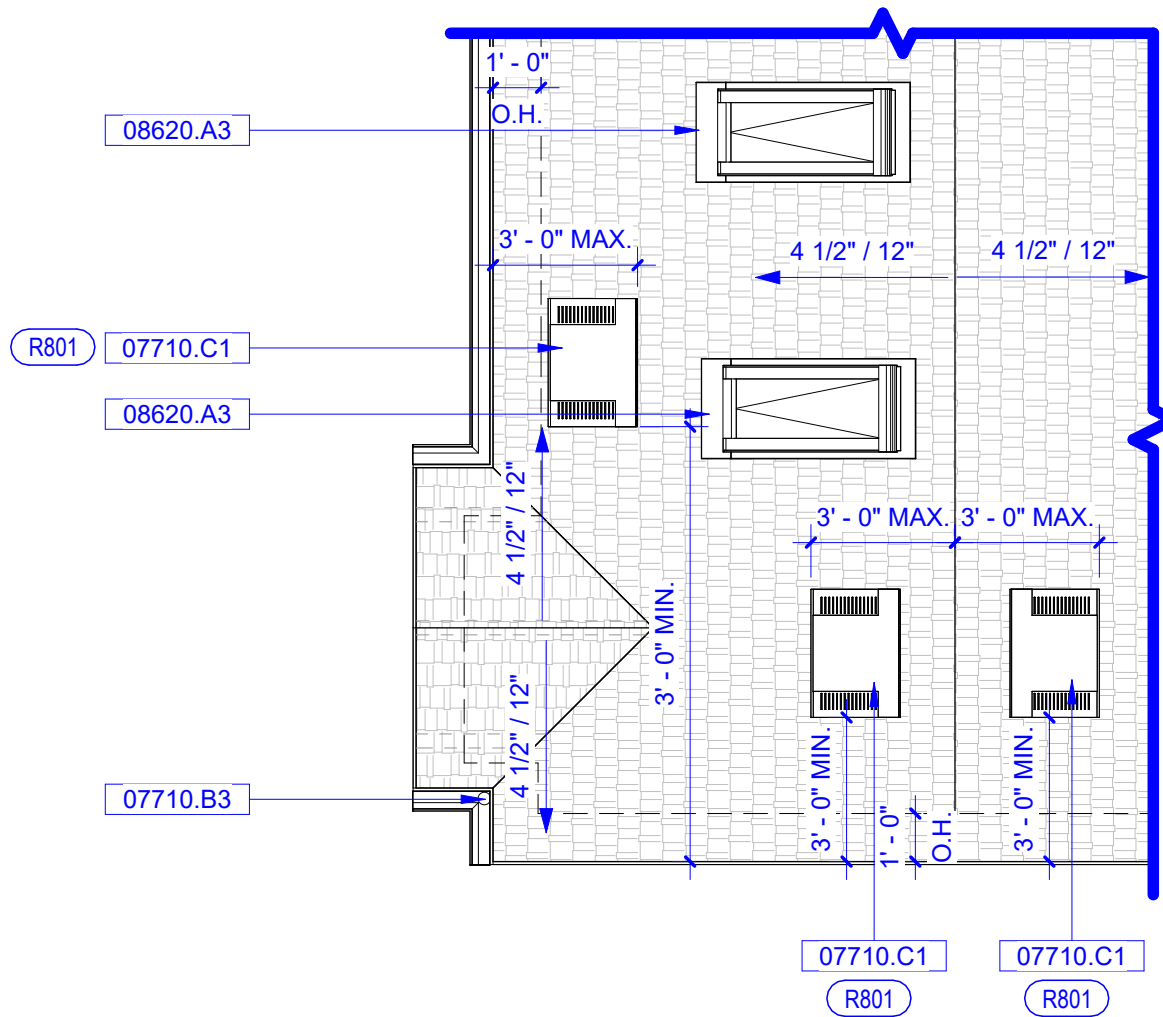


1 SKYLIGHTS OPTION ROOF PLAN
SCALE: 1/4" = 1'-0"

SCALE: 1/4" = 1'-0"


Autodesk Docs://22040_City of Chula Vista/22040_City of Chula Vista_999 L-Shape_V2_CD_RVT22.rvt 3/24/2024 11:35:05 AM

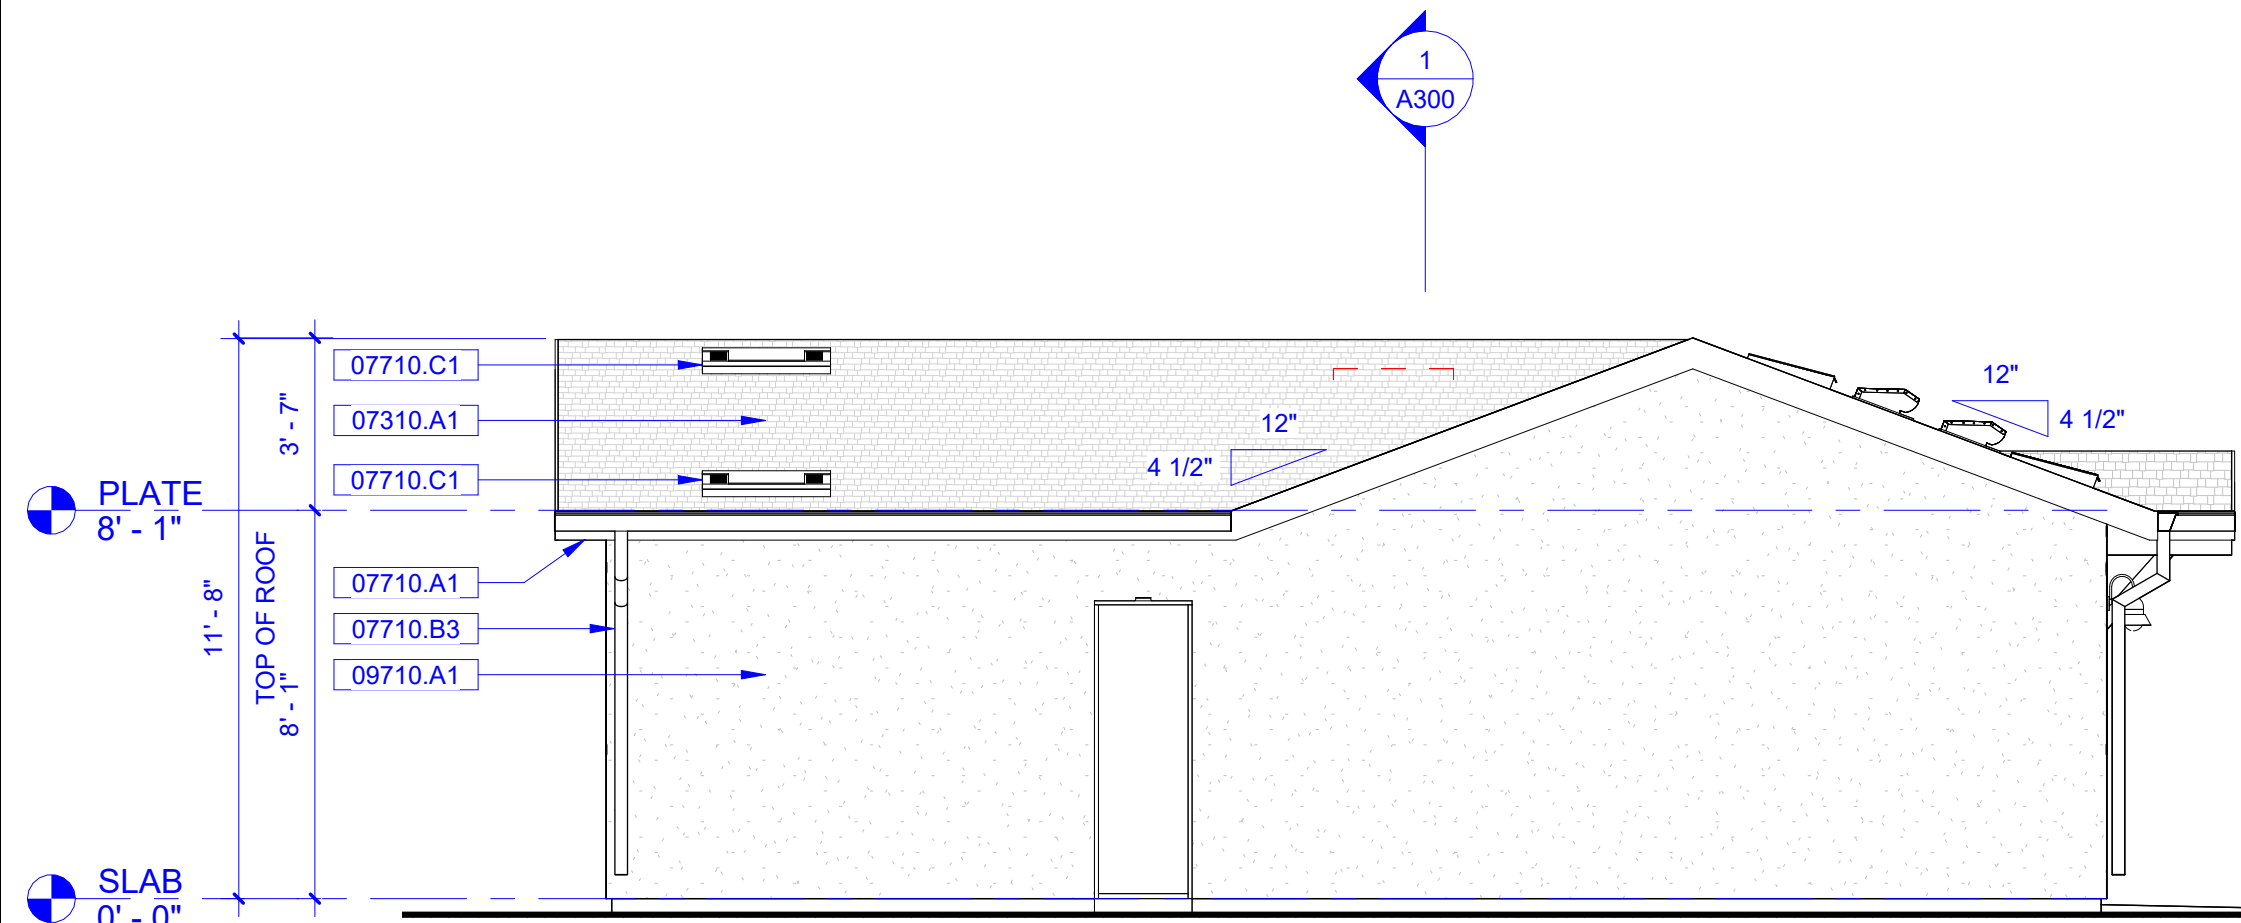


1 NORTH ELEVATION - STUCCO
SCALE: 1/4" = 1'-0"

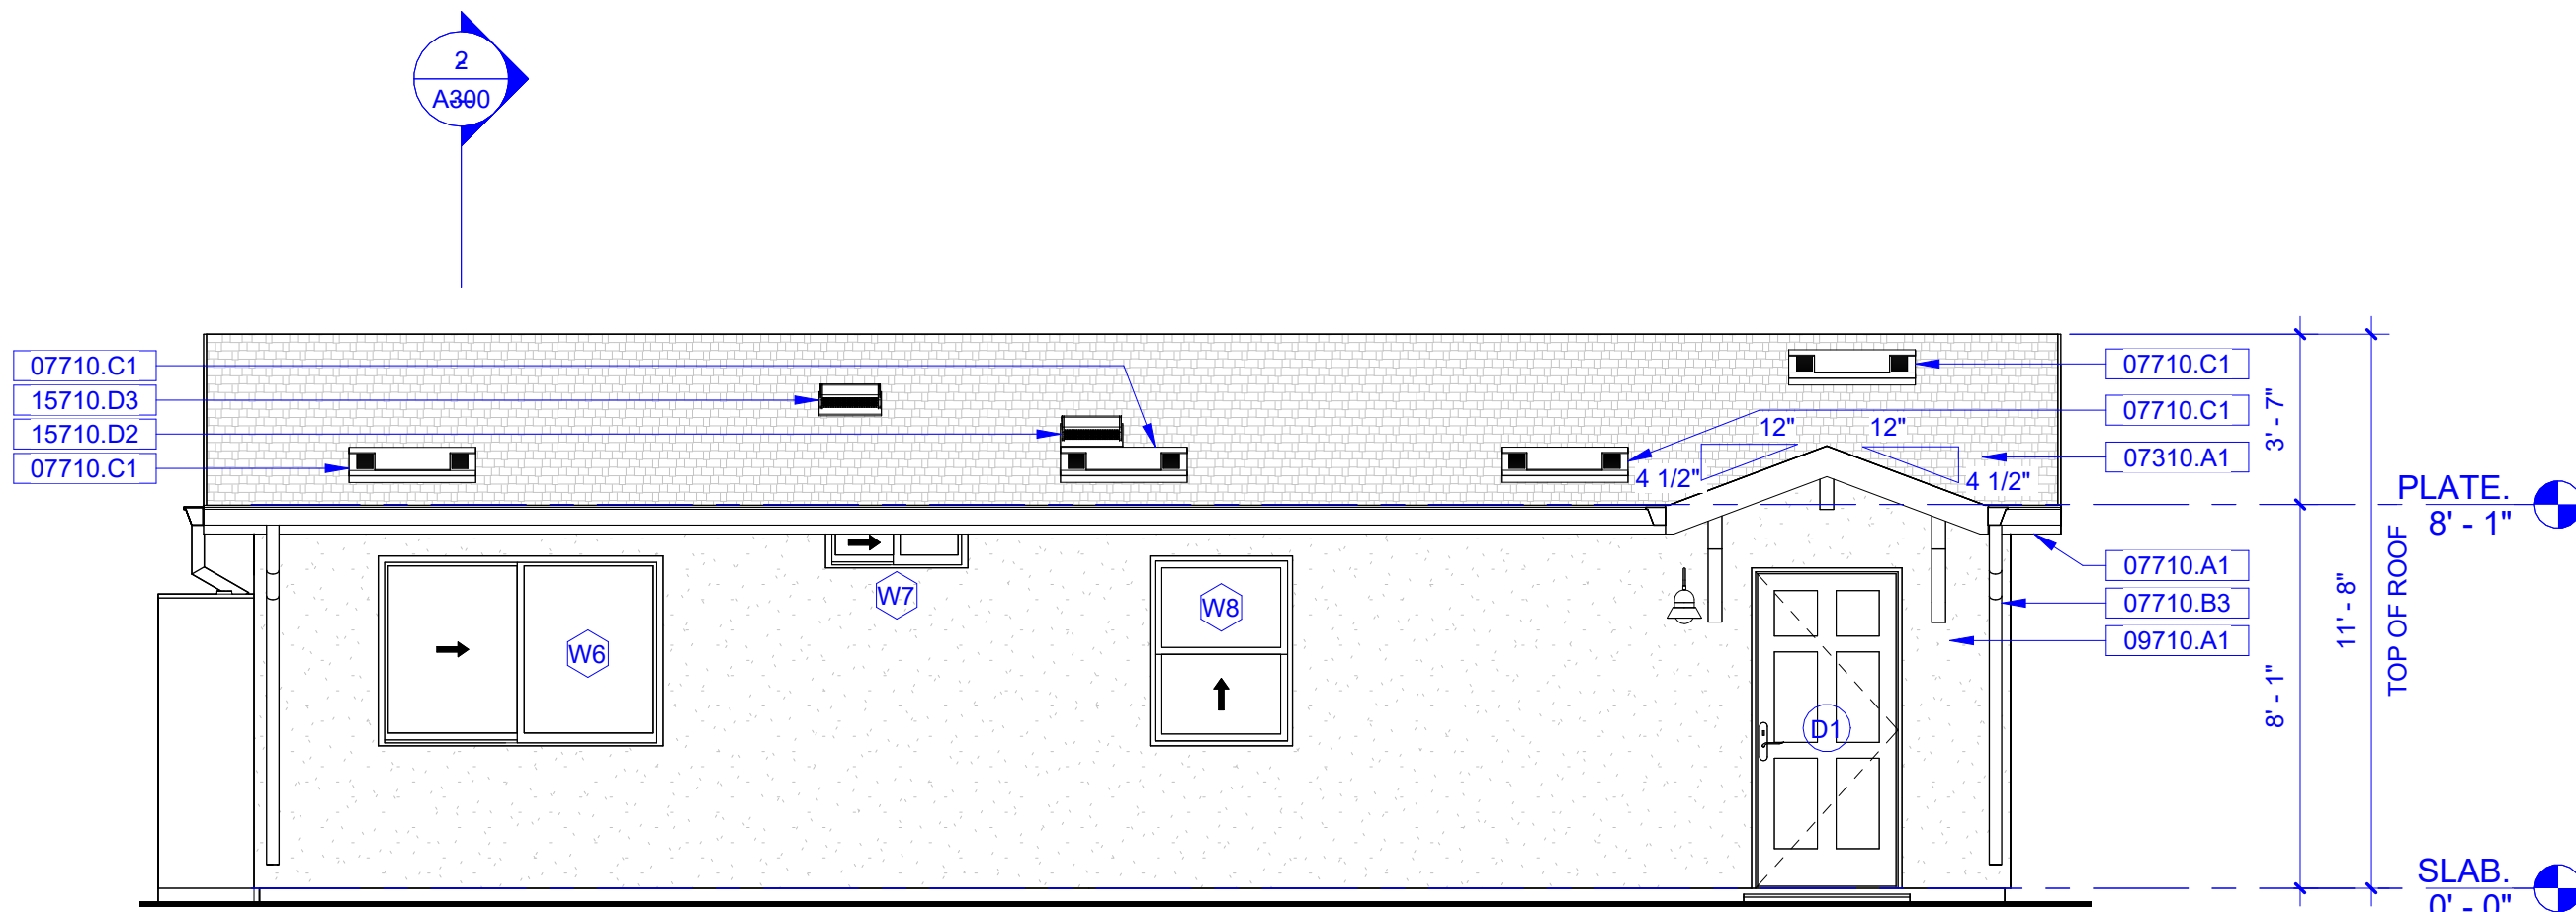

2 WEST ELEVATION - STUCCO
SCALE: 1/4" = 1'-0"

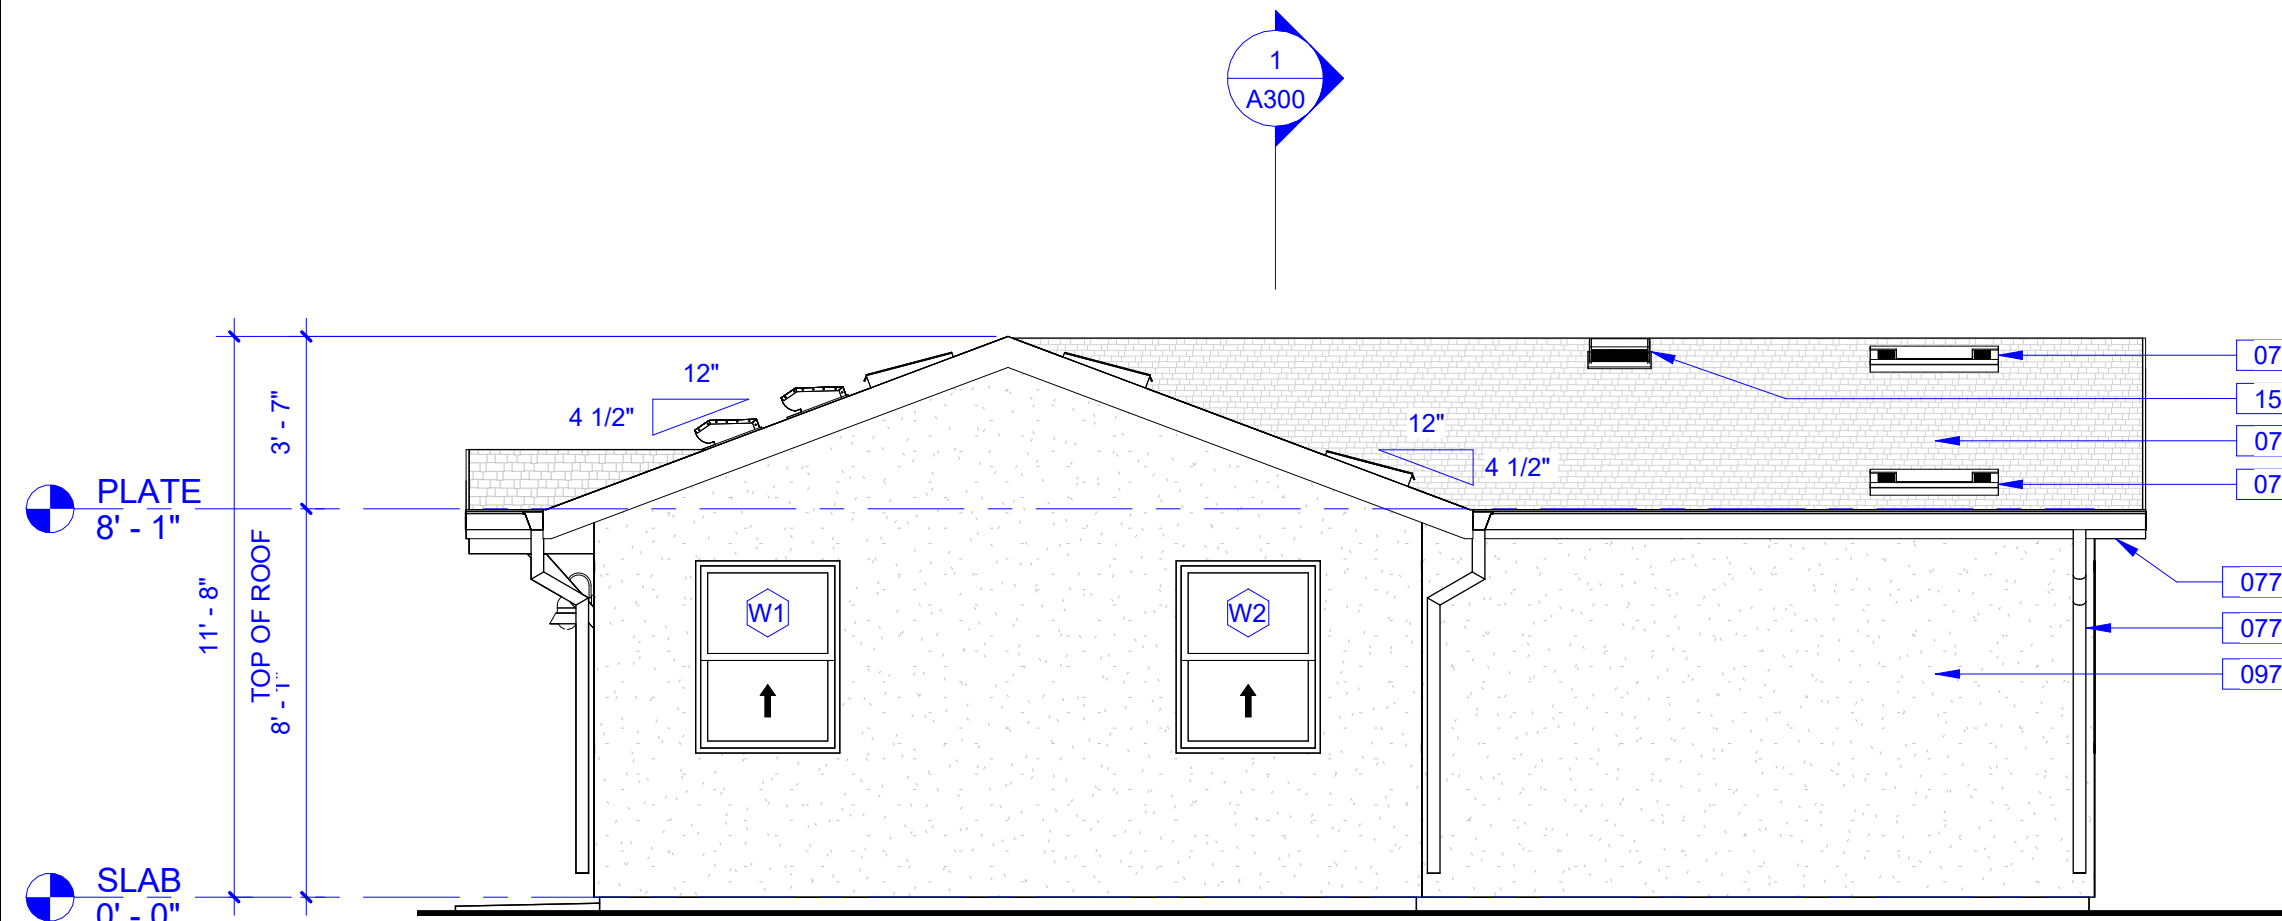

3 SOUTH ELEVATION - STUCCO
SCALE: 1/4" = 1'-0"

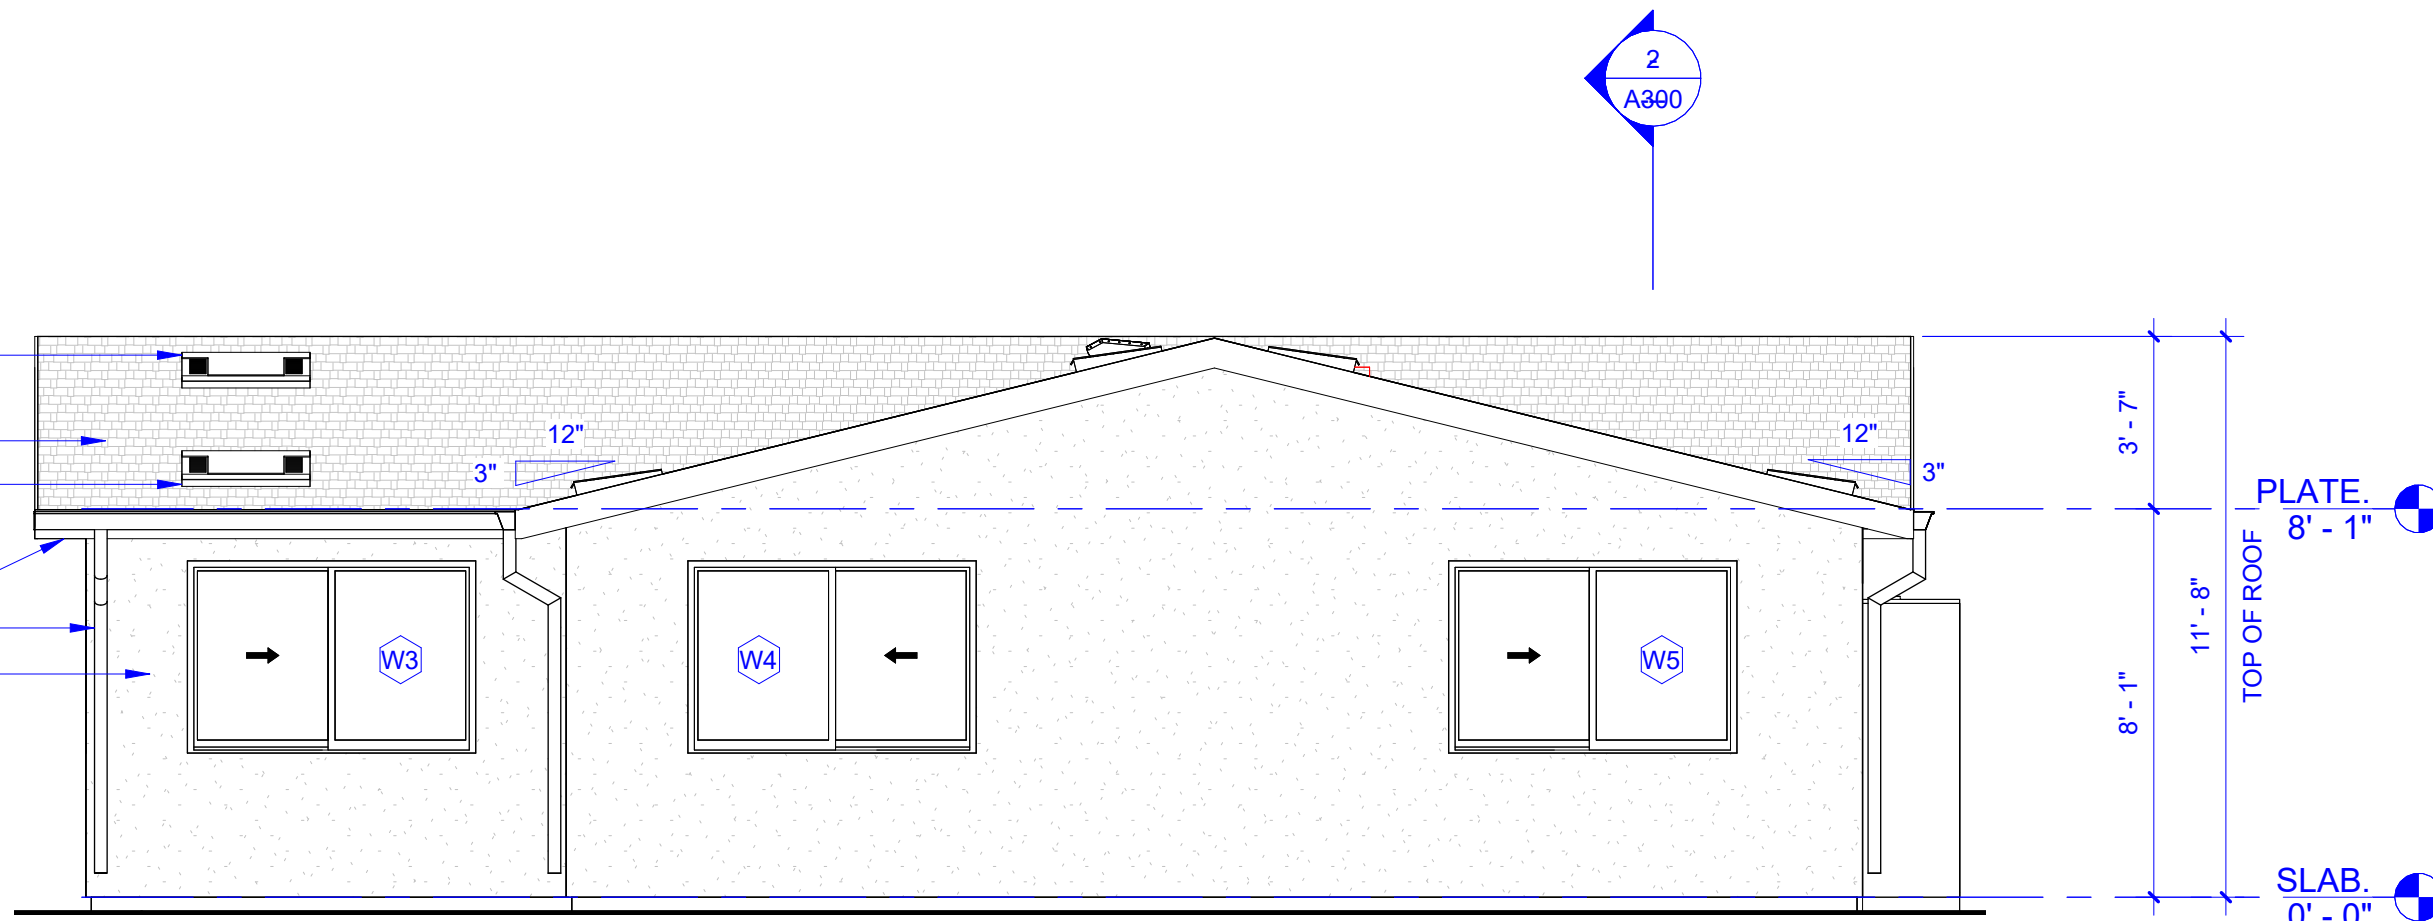

4 EAST ELEVATION - STUCCO
SCALE: 1/4" = 1'-0"

KEYNOTES:	
KEYNOTE	DESCRIPTION
07310.A1	ROOFING MATERIAL PER CHECKLIST ON SHEET G102
07710.A1	GUTTER
07710.B3	DOWNSPOUT
07710.C1	O'HAGIN STANDARD LOW PROFILE ATTIC VENTS, 0.68 SF NFVA
09710.A1	STUCCO FINISH, COLOR TBD
15710.D1	DRYER EXHAUST ROOF EXHAUST VENT
15710.D2	RANGE HOOD ROOF EXHAUST VENT
15710.D3	BATH EXHAUST FAN ROOF VENT

- GENERAL NOTES**
- THE EXTERIOR ROOFING, TRIM, WALLS, WINDOWS, AND COLOR PALETTE OF THE ADU SHALL INCORPORATE THE SAME FEATURES AS THE MAIN DWELLING UNIT.
 - THE TYPE, LOCATION, AND SIZE OF THE BUILDING ADDRESS IDENTIFICATION MUST BE CLEARLY VISIBLE AND LEGIBLE FROM THE ADJACENT PUBLIC WAY OR STREET. ADDRESS LETTERS/NUMBERS SHALL BE MINIMUM 4 INCHES HIGH, WITH A MINIMUM STROKE WIDTH OF 1/2 INCH, AND SHALL CONTRAST WITH THEIR BACKGROUND. CRC R319.1.




SNAPADU
DESIGN HOUSE

YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 999 L-SHAPE
CITY OF CHULA VISTA
276 FOURTH AVENUE,
CHULA VISTA, CA 91910

DESIGNER:
LUIS CALDERON
SnapADU


SIGNATURE


RELEASE	DATE	BY	APP.	RELEASED FOR...
A	03/22/2024	LAG		

ELEVATIONS A -
STUCCO


A201

22040


Autodesk Docs://22040_City of Chula Vista/22040_City of Chula Vista_999 L-Shape_V2_CD_RVT22.rvt 3/24/2024 11:35:11 AM

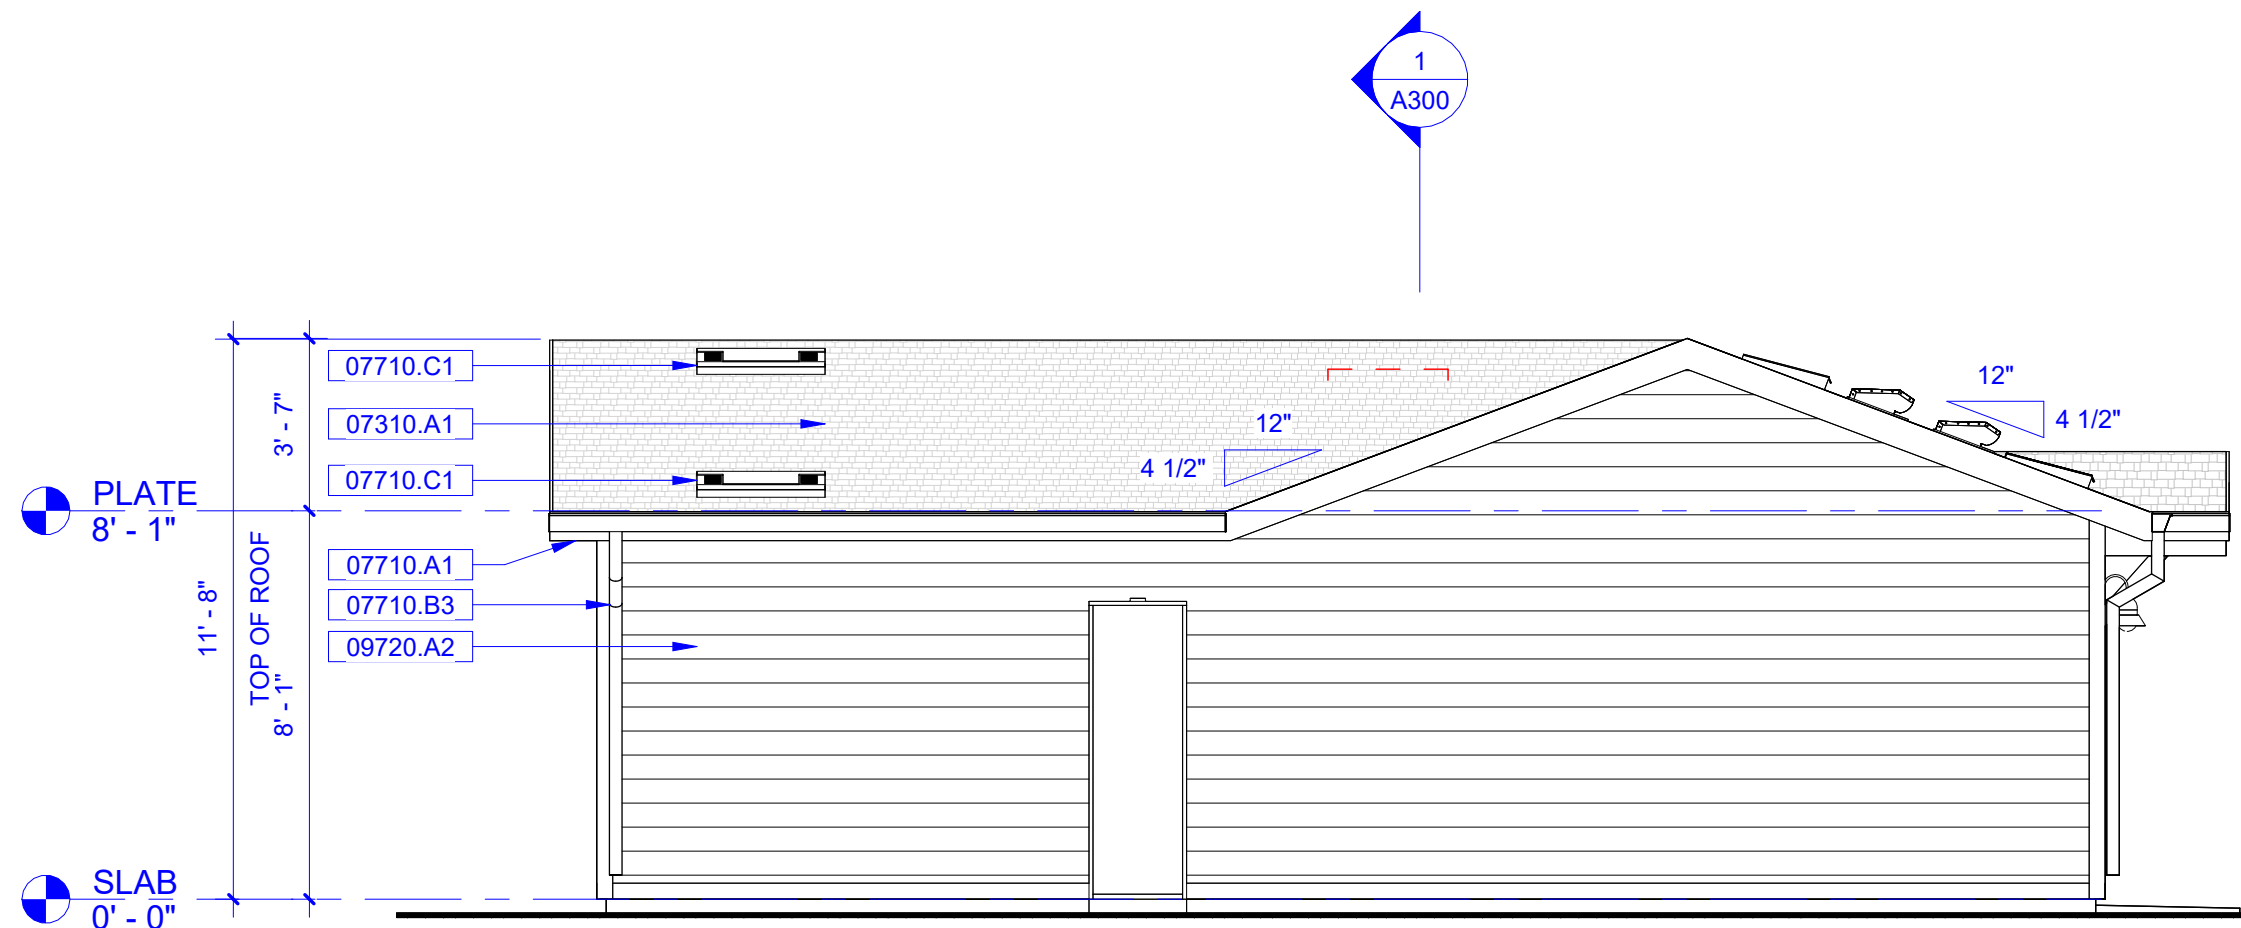


1 NORTH ELEVATION - LAP SIDING
SCALE: 1/4" = 1'-0"

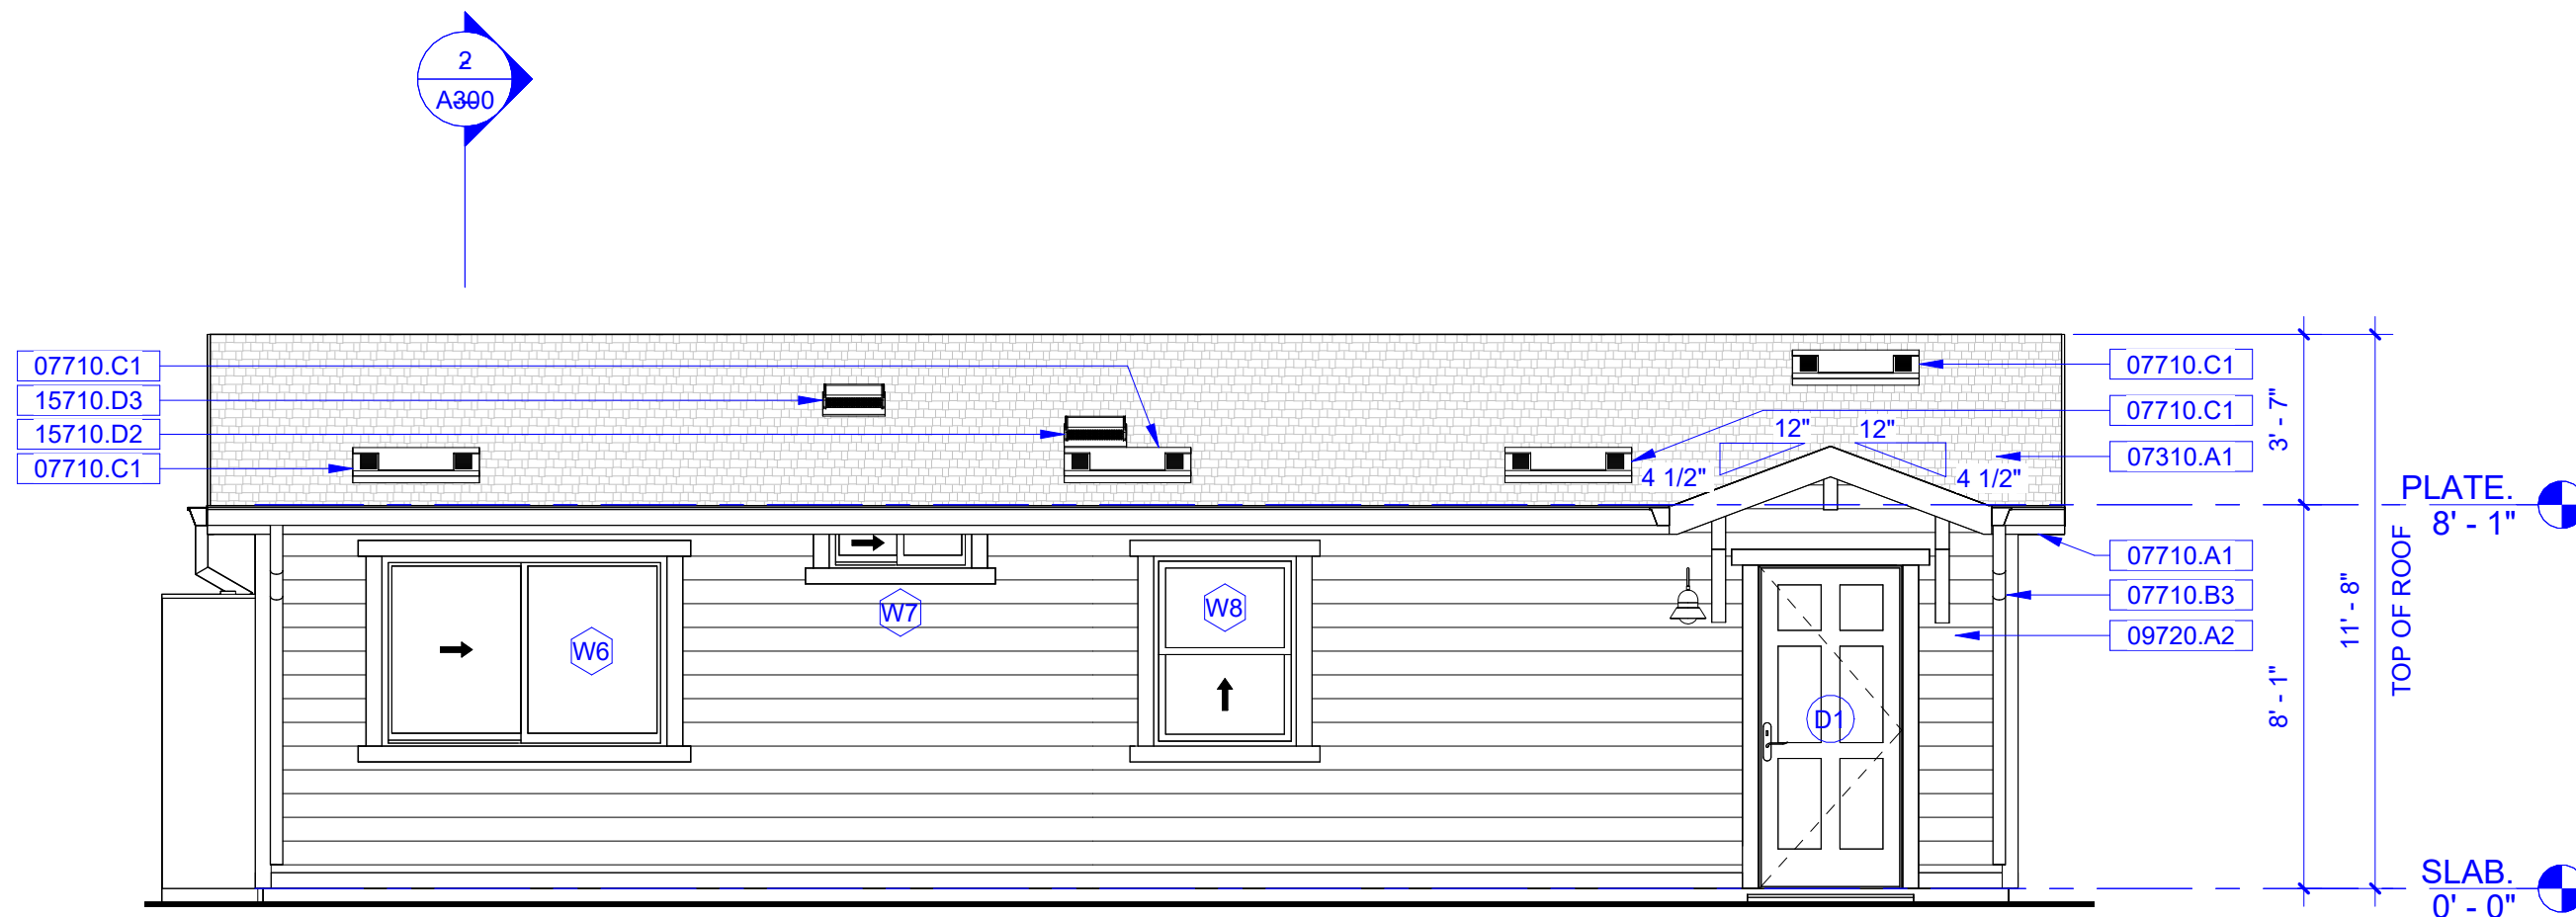

2 WEST ELEVATION - LAP SIDING
SCALE: 1/4" = 1'-0"

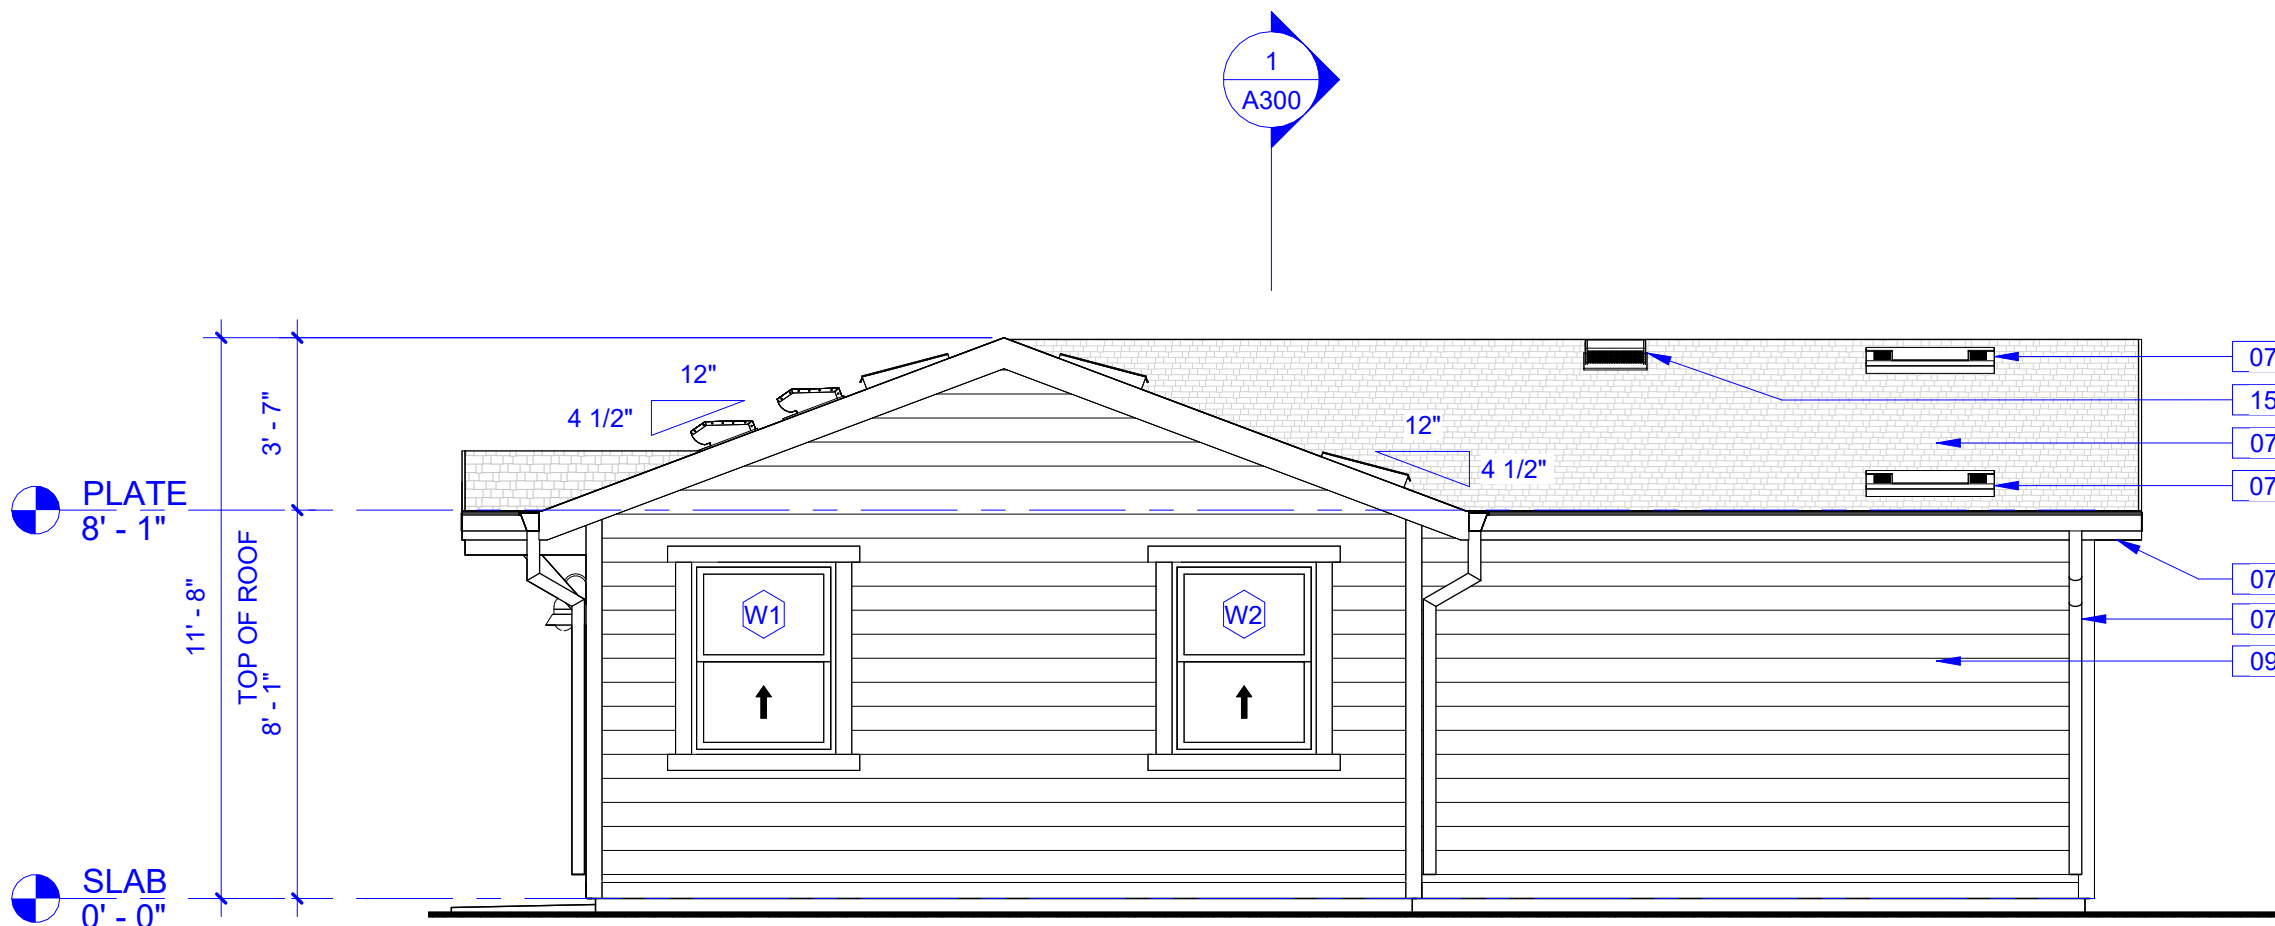

3 SOUTH ELEVATION - LAP SIDING
SCALE: 1/4" = 1'-0"

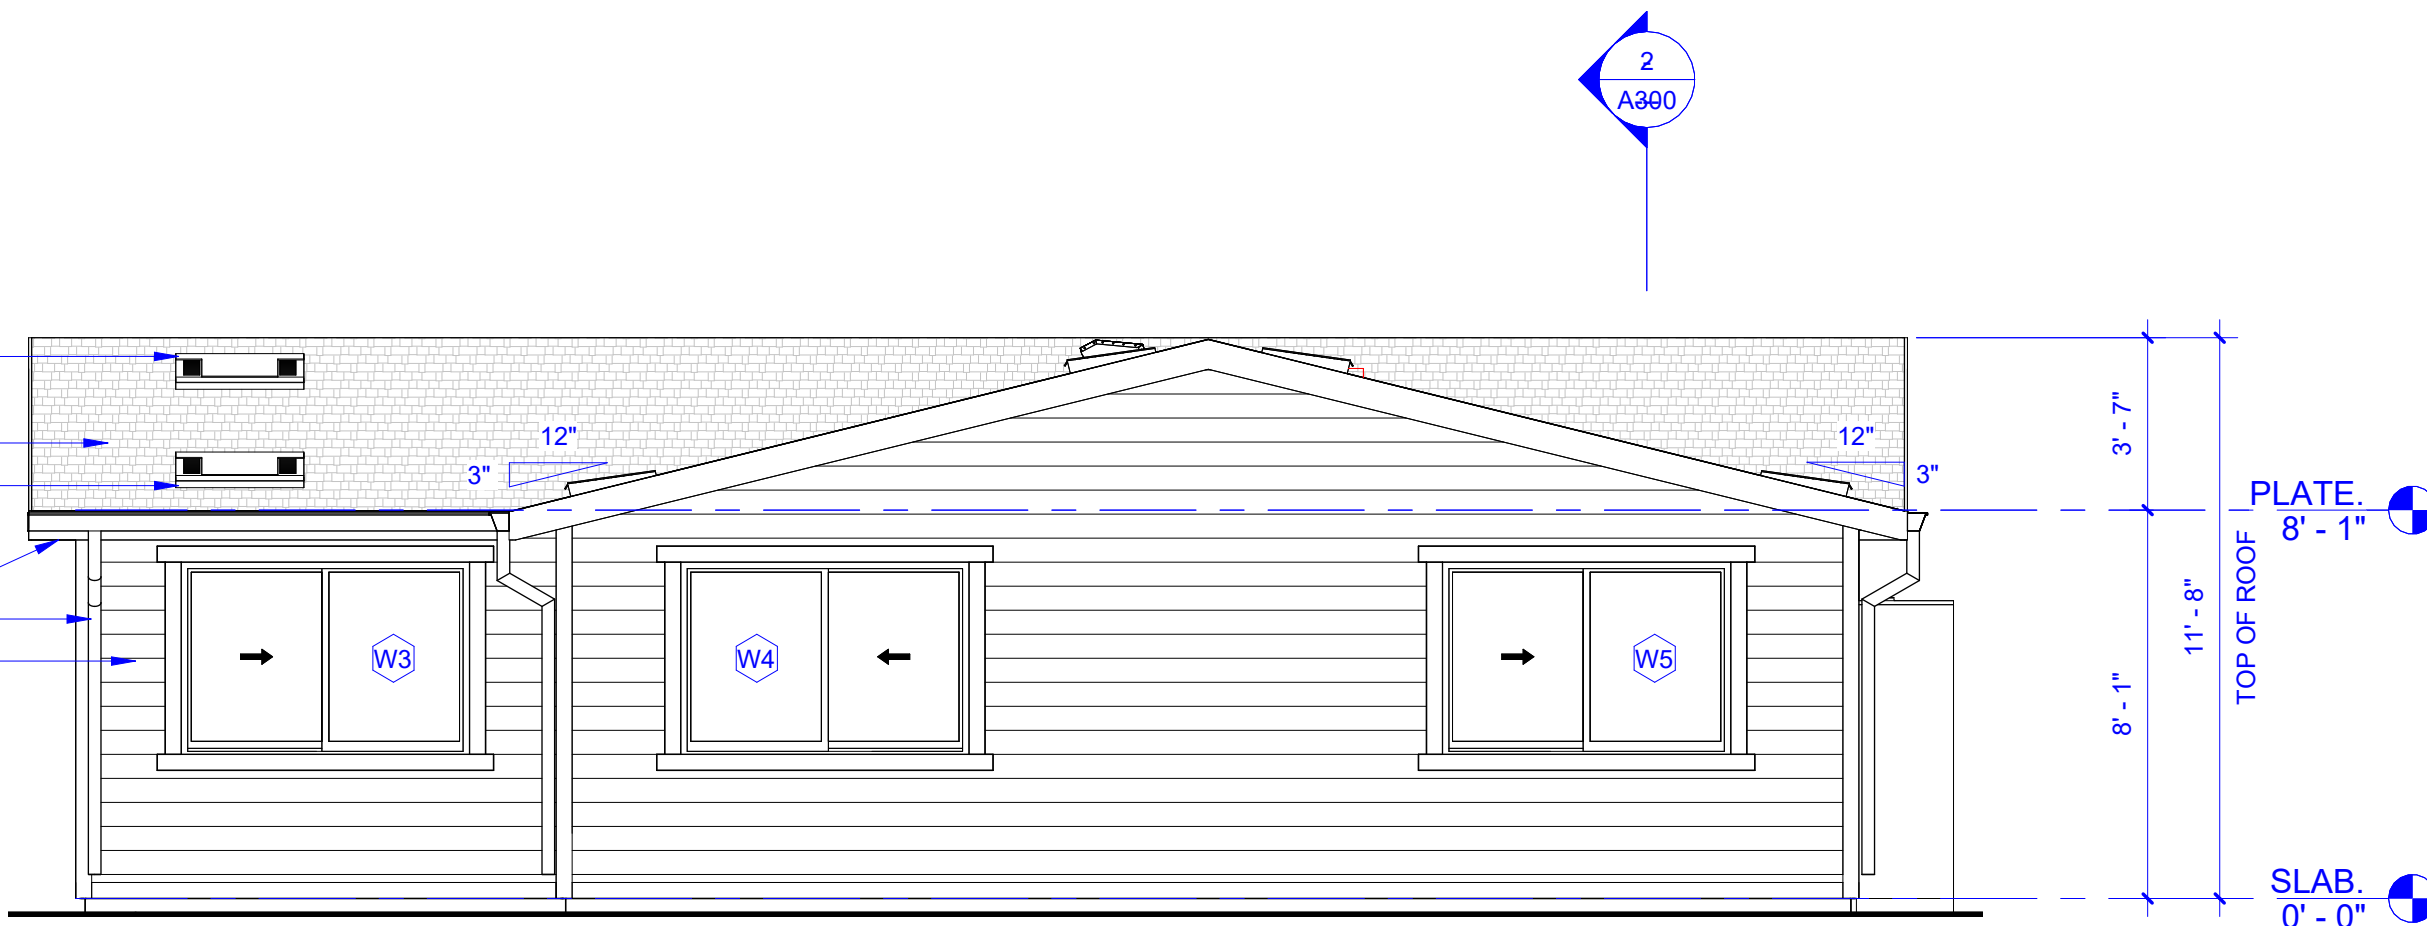

4 EAST ELEVATION - LAP SIDING
SCALE: 1/4" = 1'-0"

KEYNOTES:

KEYNOTE	DESCRIPTION
07310.A1	ROOFING MATERIAL PER CHECKLIST ON SHEET G102
07710.A1	GUTTER
07710.B3	DOWNSPOUT
07710.C1	O'HAGIN STANDARD LOW PROFILE ATTIC VENTS, 0.68 SF NFVA
09720.A2	FIBER CEMENT WALL LAP SIDING 'HARDIEPLANK' ESR-2290 OR SIMILAR, COLOR TBD TO MATCH MAIN RESIDENCE
15710.D1	DRYER EXHAUST ROOF EXHAUST VENT
15710.D2	RANGE HOOD ROOF EXHAUST VENT
15710.D3	BATH EXHAUST FAN ROOF VENT



SNAPADU
DESIGN HOUSE

YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 999 L-SHAPE
CITY OF CHULA VISTA
276 FOURTH AVENUE,
CHULA VISTA, CA 91910

DESIGNER:

LUIS CALDERON
SnapADU

Luis Calderon
SIGNATURE

RELEASE DATE BY APP. RELEASED FOR...
A 03/22/2024 LAG

GENERAL NOTES


- THE EXTERIOR ROOFING, TRIM, WALLS, WINDOWS, AND COLOR PALETTE OF THE ADU SHALL INCORPORATE THE SAME FEATURES AS THE MAIN DWELLING UNIT.
- THE TYPE, LOCATION, AND SIZE OF THE BUILDING ADDRESS IDENTIFICATION MUST BE CLEARLY VISIBLE AND LEGIBLE FROM THE ADJACENT PUBLIC WAY OR STREET. ADDRESS LETTERS/NUMBERS SHALL BE MINIMUM 4 INCHES HIGH, WITH A MINIMUM STROKE WIDTH OF 1/2 INCH, AND SHALL CONTRAST WITH THEIR BACKGROUND. CRC R319.1.

ELEVATIONS B -
LAP SIDING


A211

22040


Autodesk Docs://22040_City of Chula Vista/22040_City of Chula Vista_999 L-Shape_V2_CD_RVT22.rvt 3/24/2024 11:35:13 AM

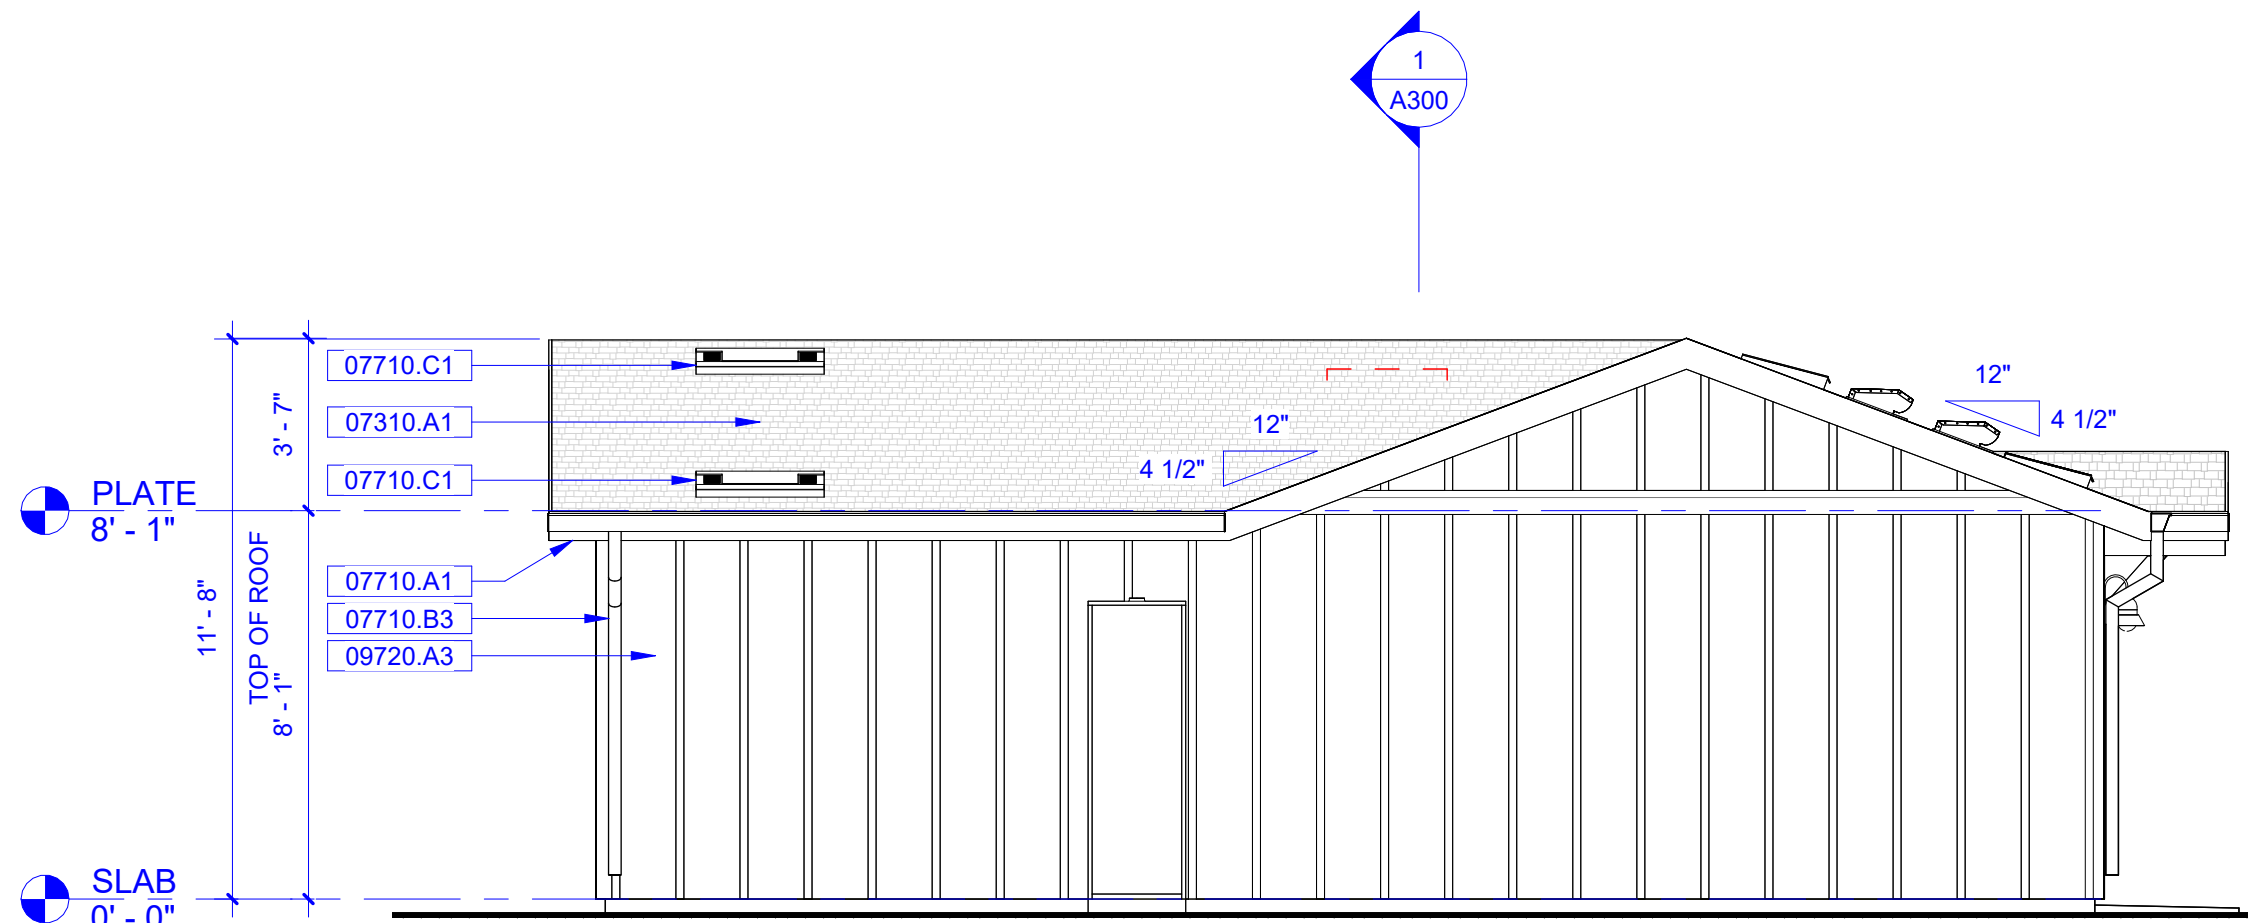


1 NORTH ELEVATION - B&B SIDING
SCALE: 1/4" = 1'-0"

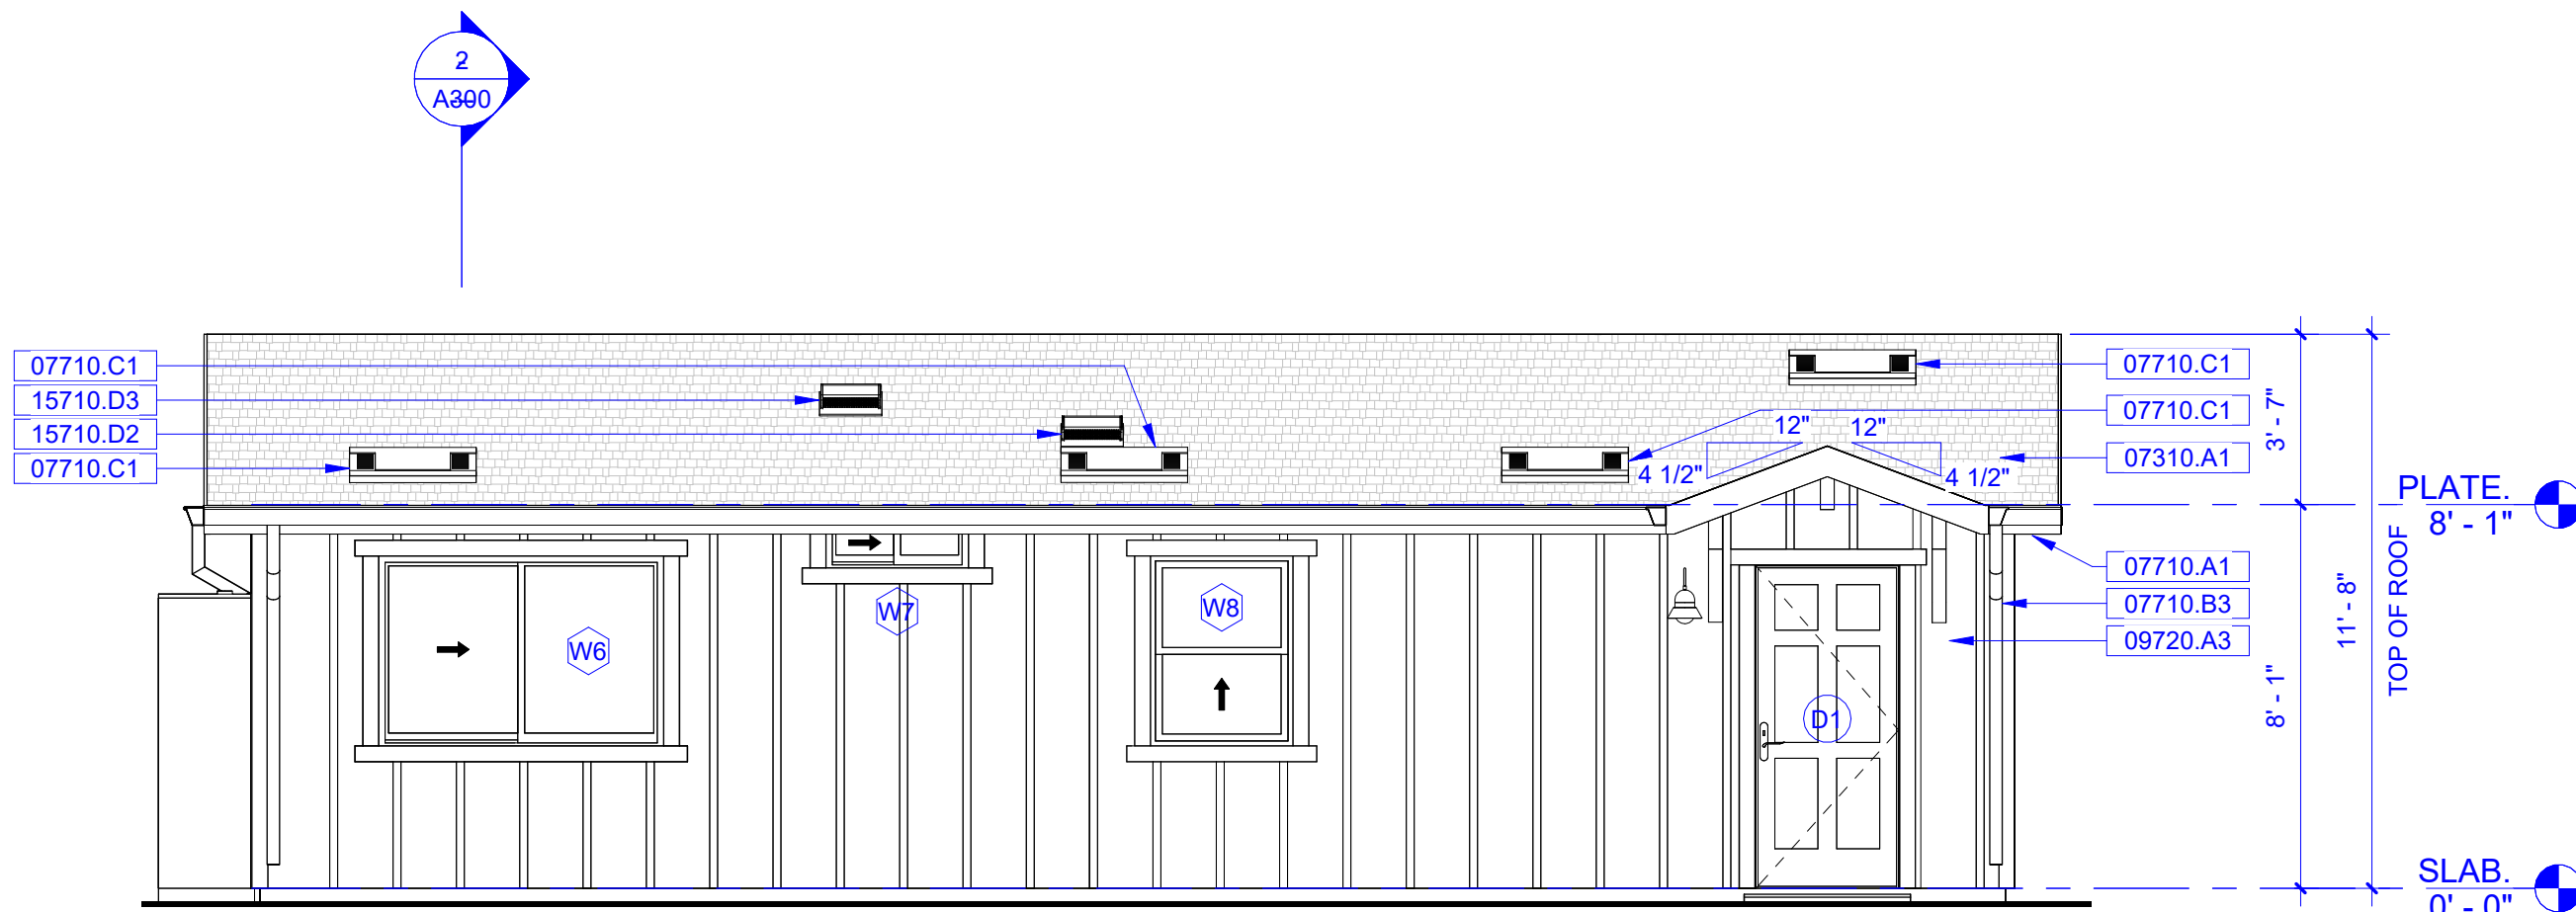

2 WEST ELEVATION - B&B SIDING
SCALE: 1/4" = 1'-0"

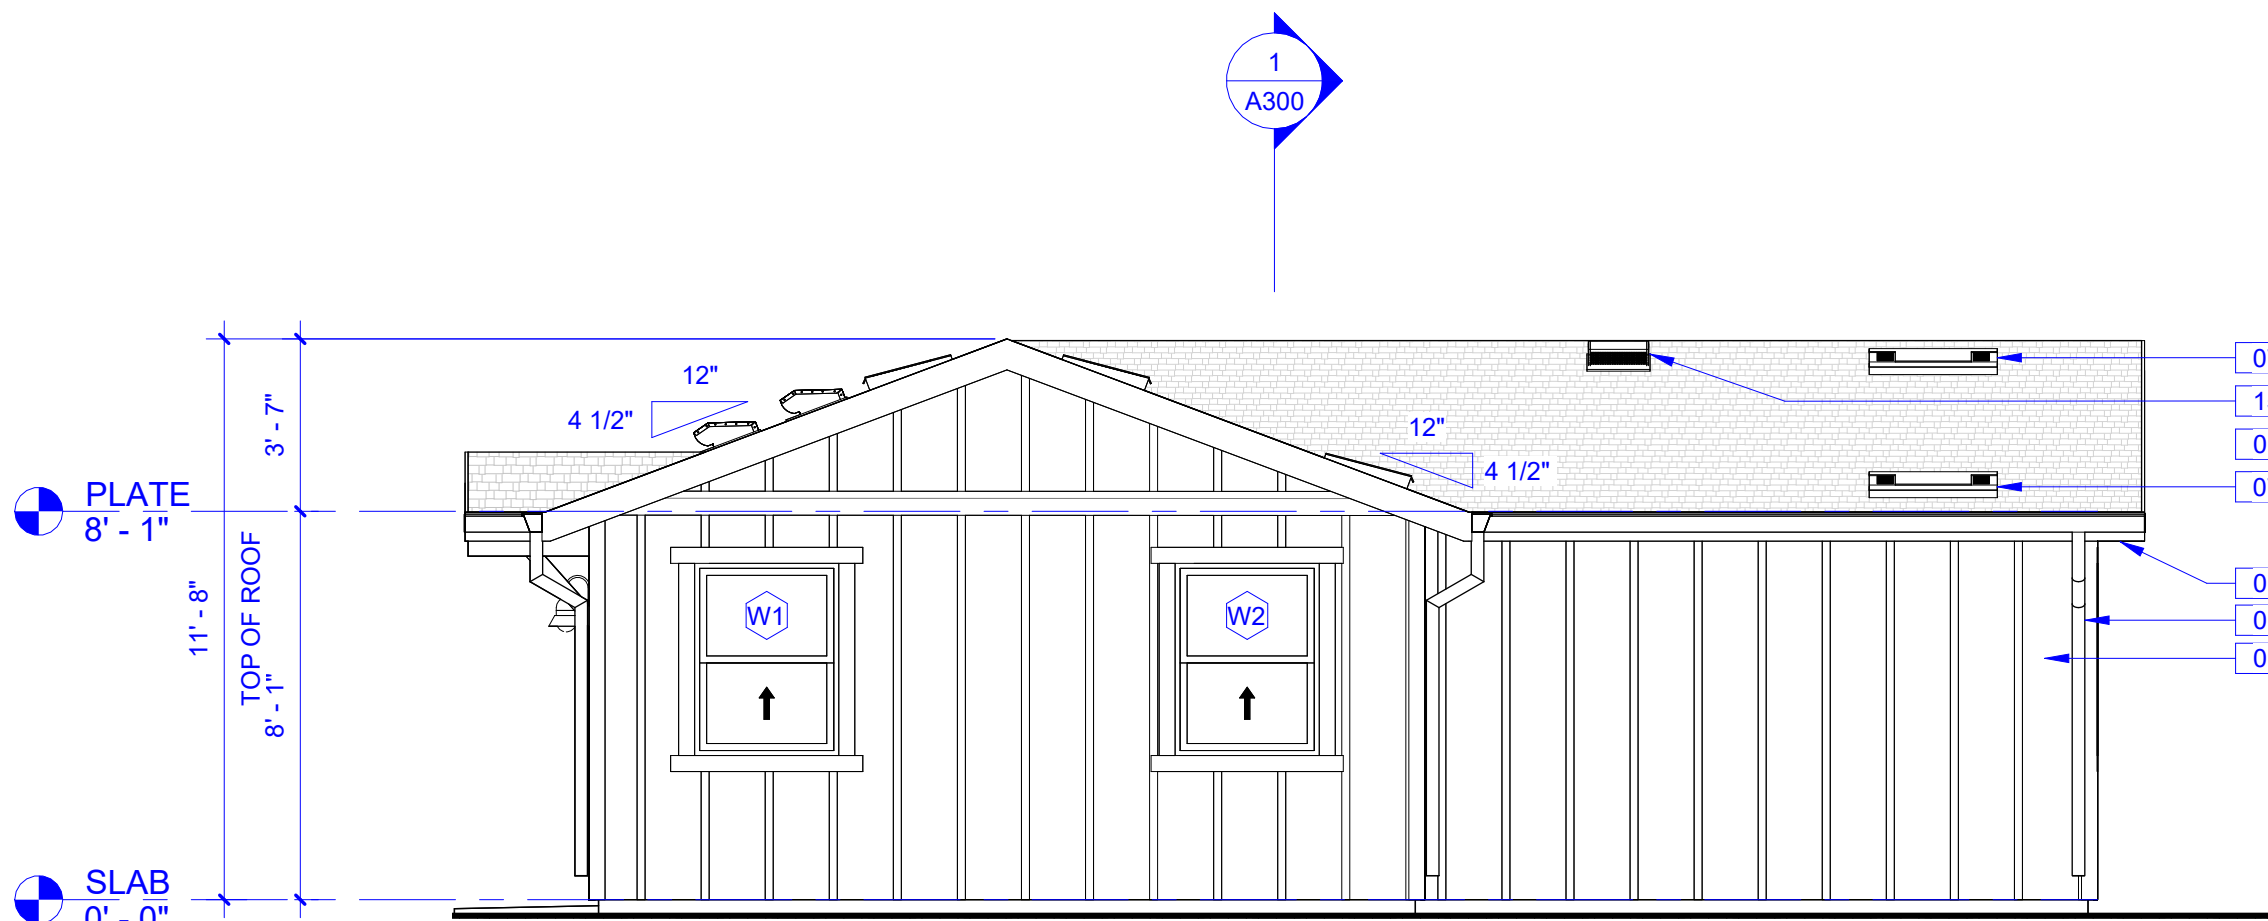

3 SOUTH ELEVATION - B&B SIDING
SCALE: 1/4" = 1'-0"

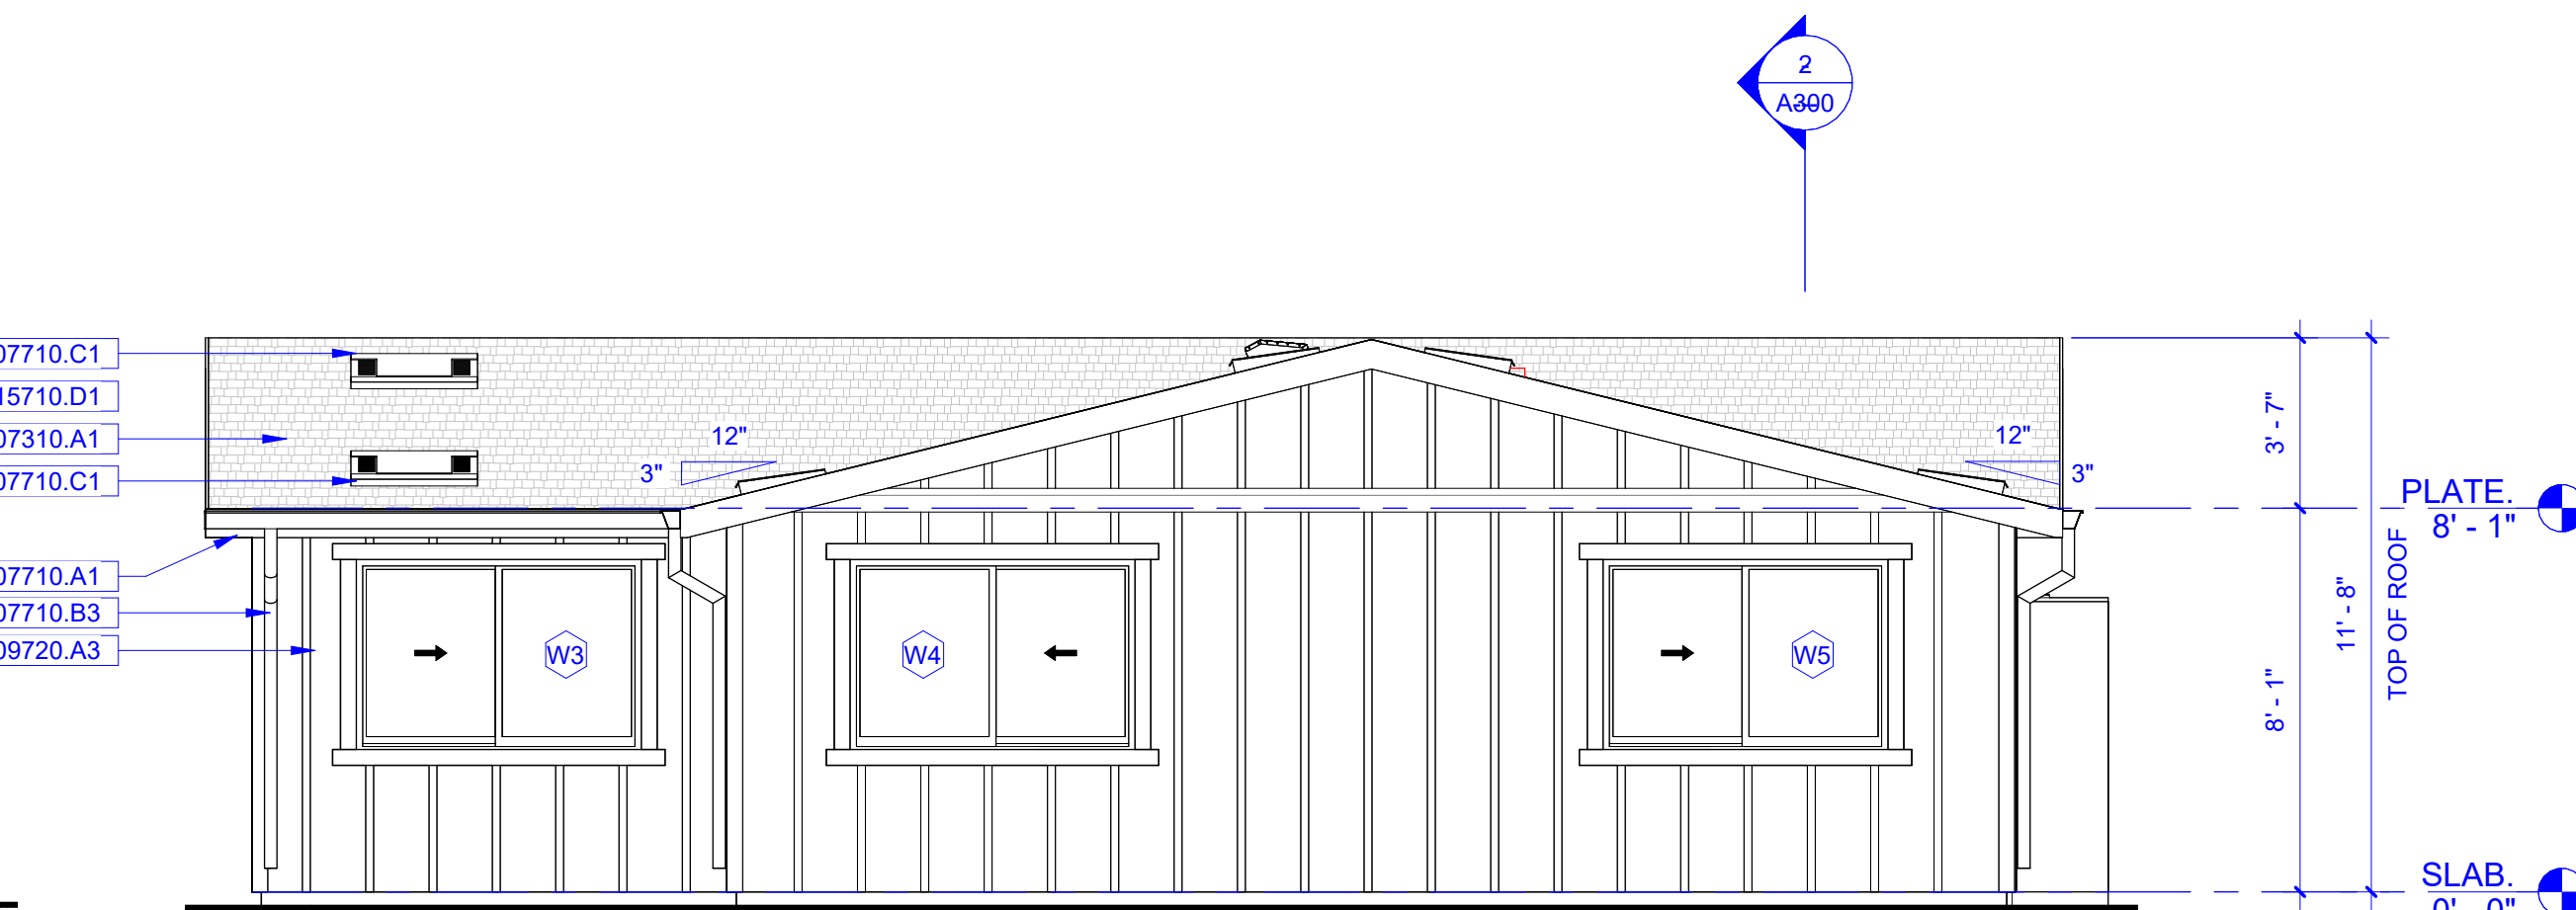

4 EAST ELEVATION - B&B SIDING
SCALE: 1/4" = 1'-0"

KEYNOTES:

KEYNOTE	DESCRIPTION
07310.A1	ROOFING MATERIAL PER CHECKLIST ON SHEET G102
07710.A1	GUTTER
07710.B3	DOWNSPOUT
07710.C1	O'HAGIN STANDARD LOW PROFILE ATTIC VENTS, 0.68 SF NFVA
09720.A3	FIBER CEMENT WALL VERTICAL B&B SIDING 'HARDIEPANEL' ESR-1844 OR SIMILAR, COLOR TBD TO MATCH MAIN RESIDENCE
15710.D1	DRYER EXHAUST ROOF EXHAUST VENT
15710.D2	RANGE HOOD ROOF EXHAUST VENT
15710.D3	BATH EXHAUST FAN ROOF VENT



SNAPADU
DESIGN HOUSE

YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 999 L-SHAPE
CITY OF CHULA VISTA
276 FOURTH AVENUE,
CHULA VISTA, CA 91910

DESIGNER:

LUIS CALDERON
SnapADU

Luis Calderon
SIGNATURE

RELEASE DATE BY APP. RELEASED FOR...


GENERAL NOTES

- THE EXTERIOR ROOFING, TRIM, WALLS, WINDOWS, AND COLOR PALETTE OF THE ADU SHALL INCORPORATE THE SAME FEATURES AS THE MAIN DWELLING UNIT.
- THE TYPE, LOCATION, AND SIZE OF THE BUILDING ADDRESS IDENTIFICATION MUST BE CLEARLY VISIBLE AND LEGIBLE FROM THE ADJACENT PUBLIC WAY OR STREET. ADDRESS LETTERS/NUMBERS SHALL BE MINIMUM 4 INCHES HIGH, WITH A MINIMUM STROKE WIDTH OF 1/2 INCH, AND SHALL CONTRAST WITH THEIR BACKGROUND. CRC R319.1.


ELEVATIONS C -
BOARD & BATTEN

A221


22040

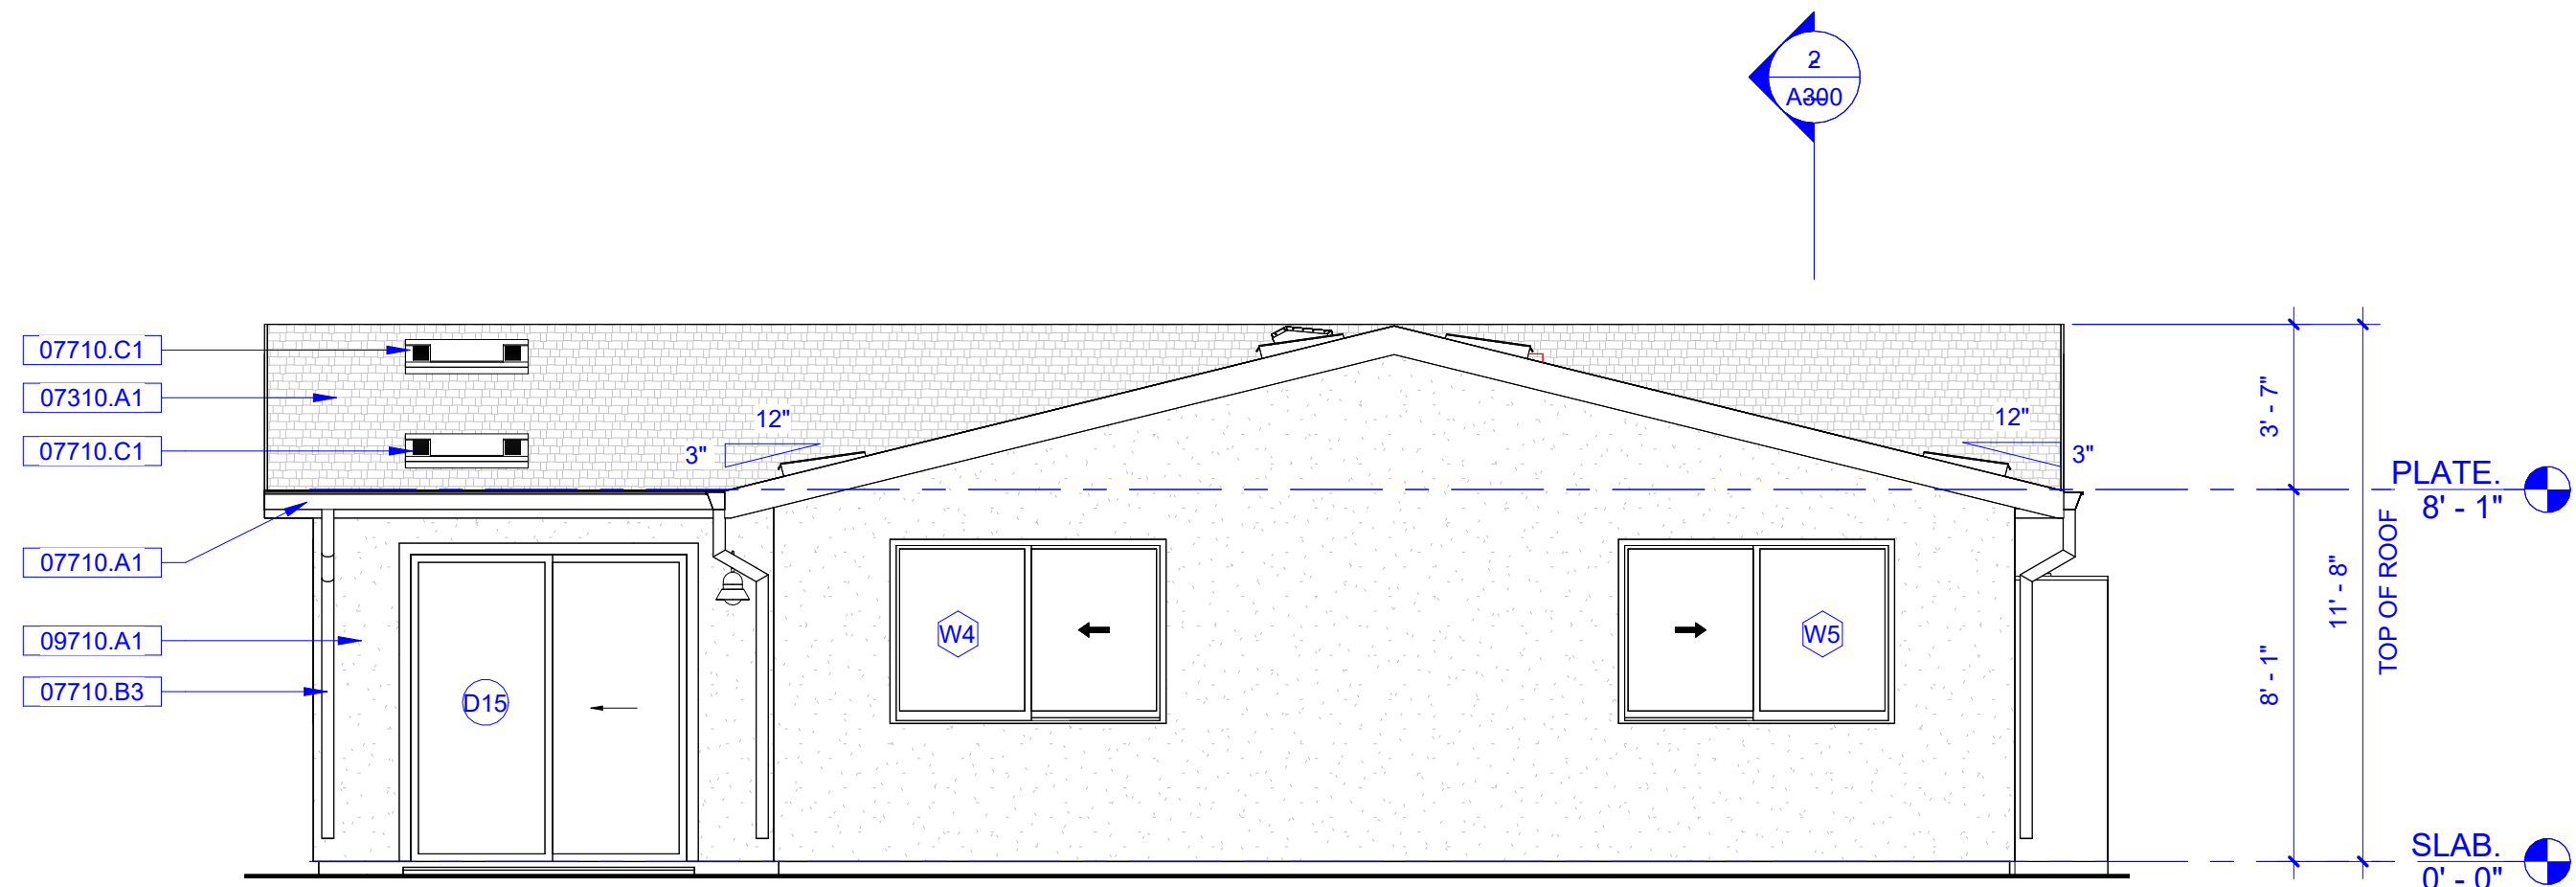

1 EAST ELEVATION - STUCCO - 6068 SGD
SCALE: 1/4" = 1'-0"

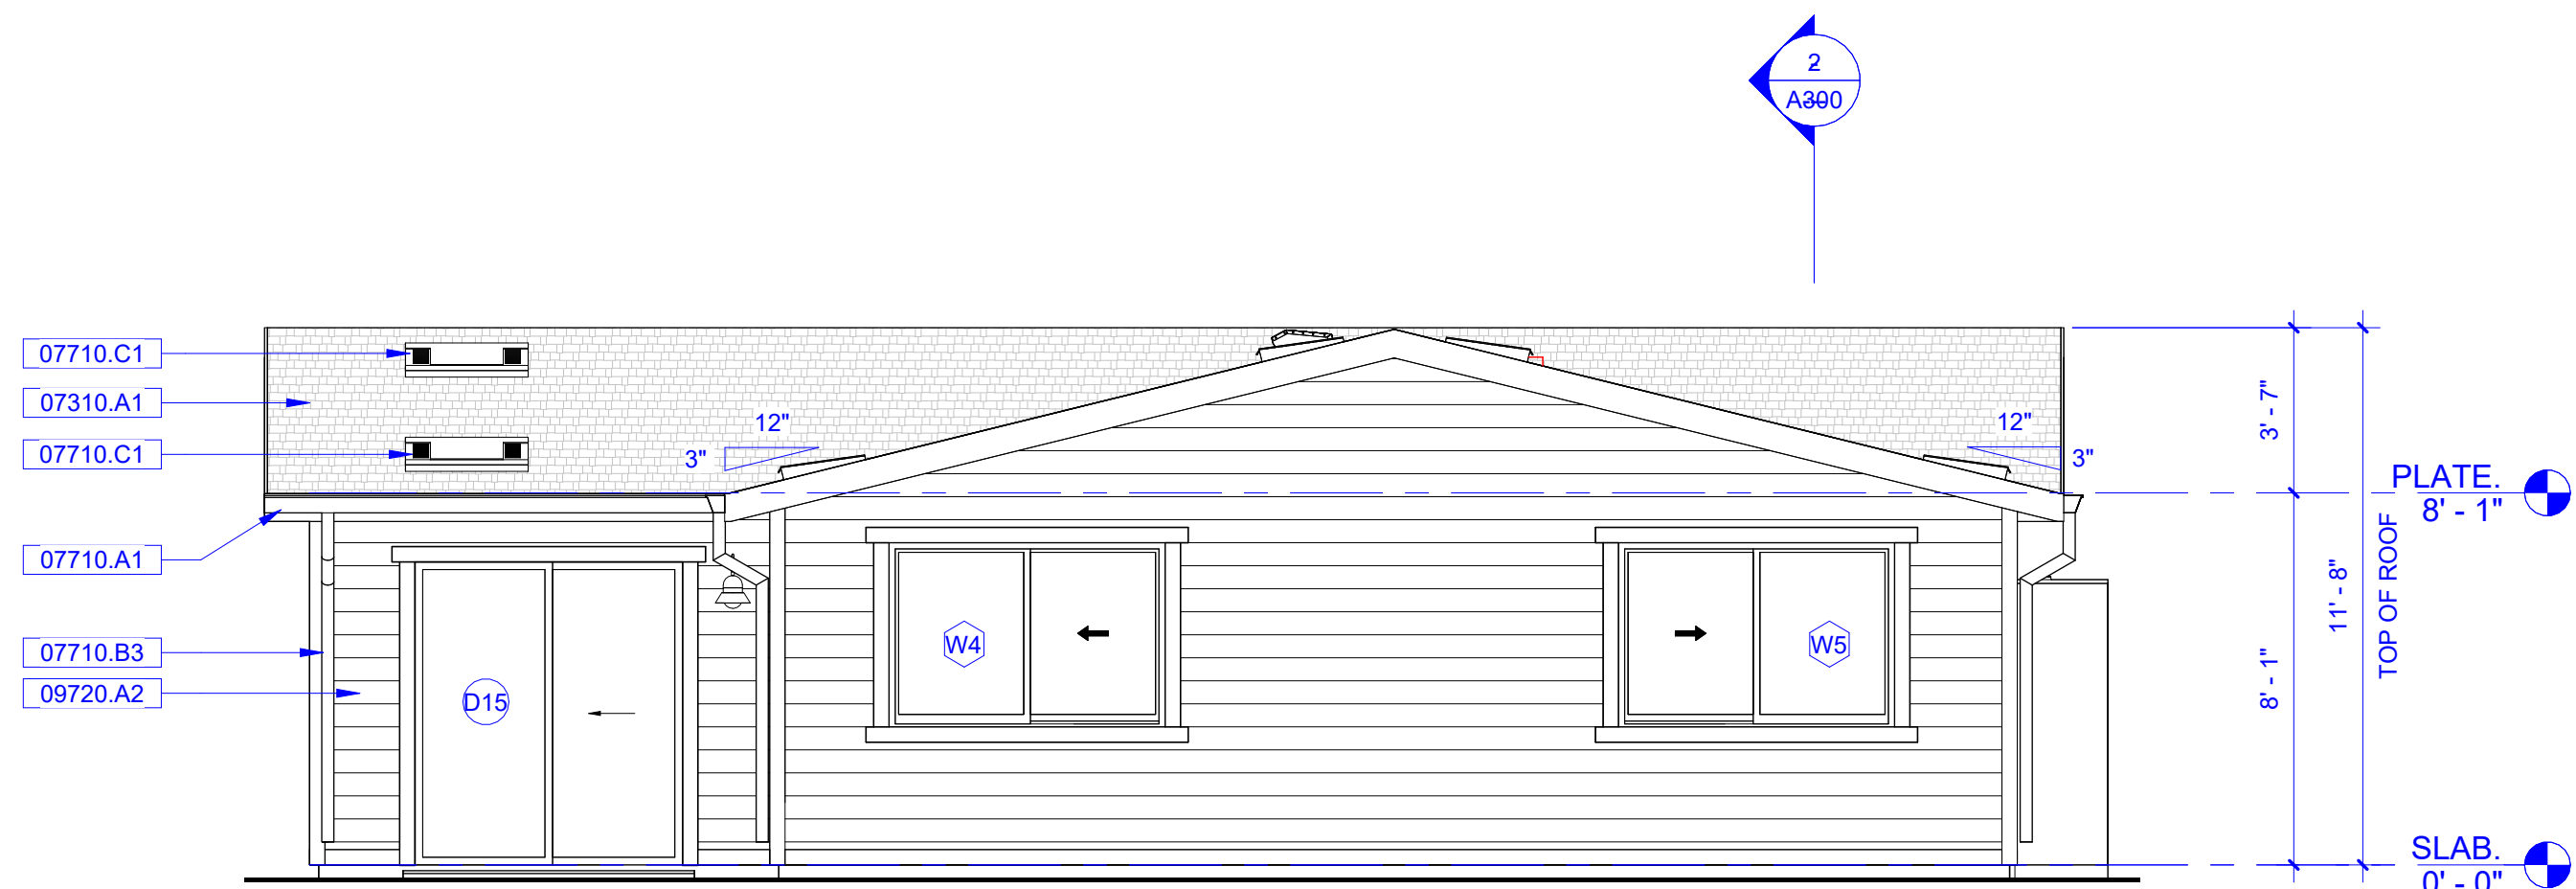

2 EAST ELEVATION - LAP SIDING - 6068 SGD
SCALE: 1/4" = 1'-0"

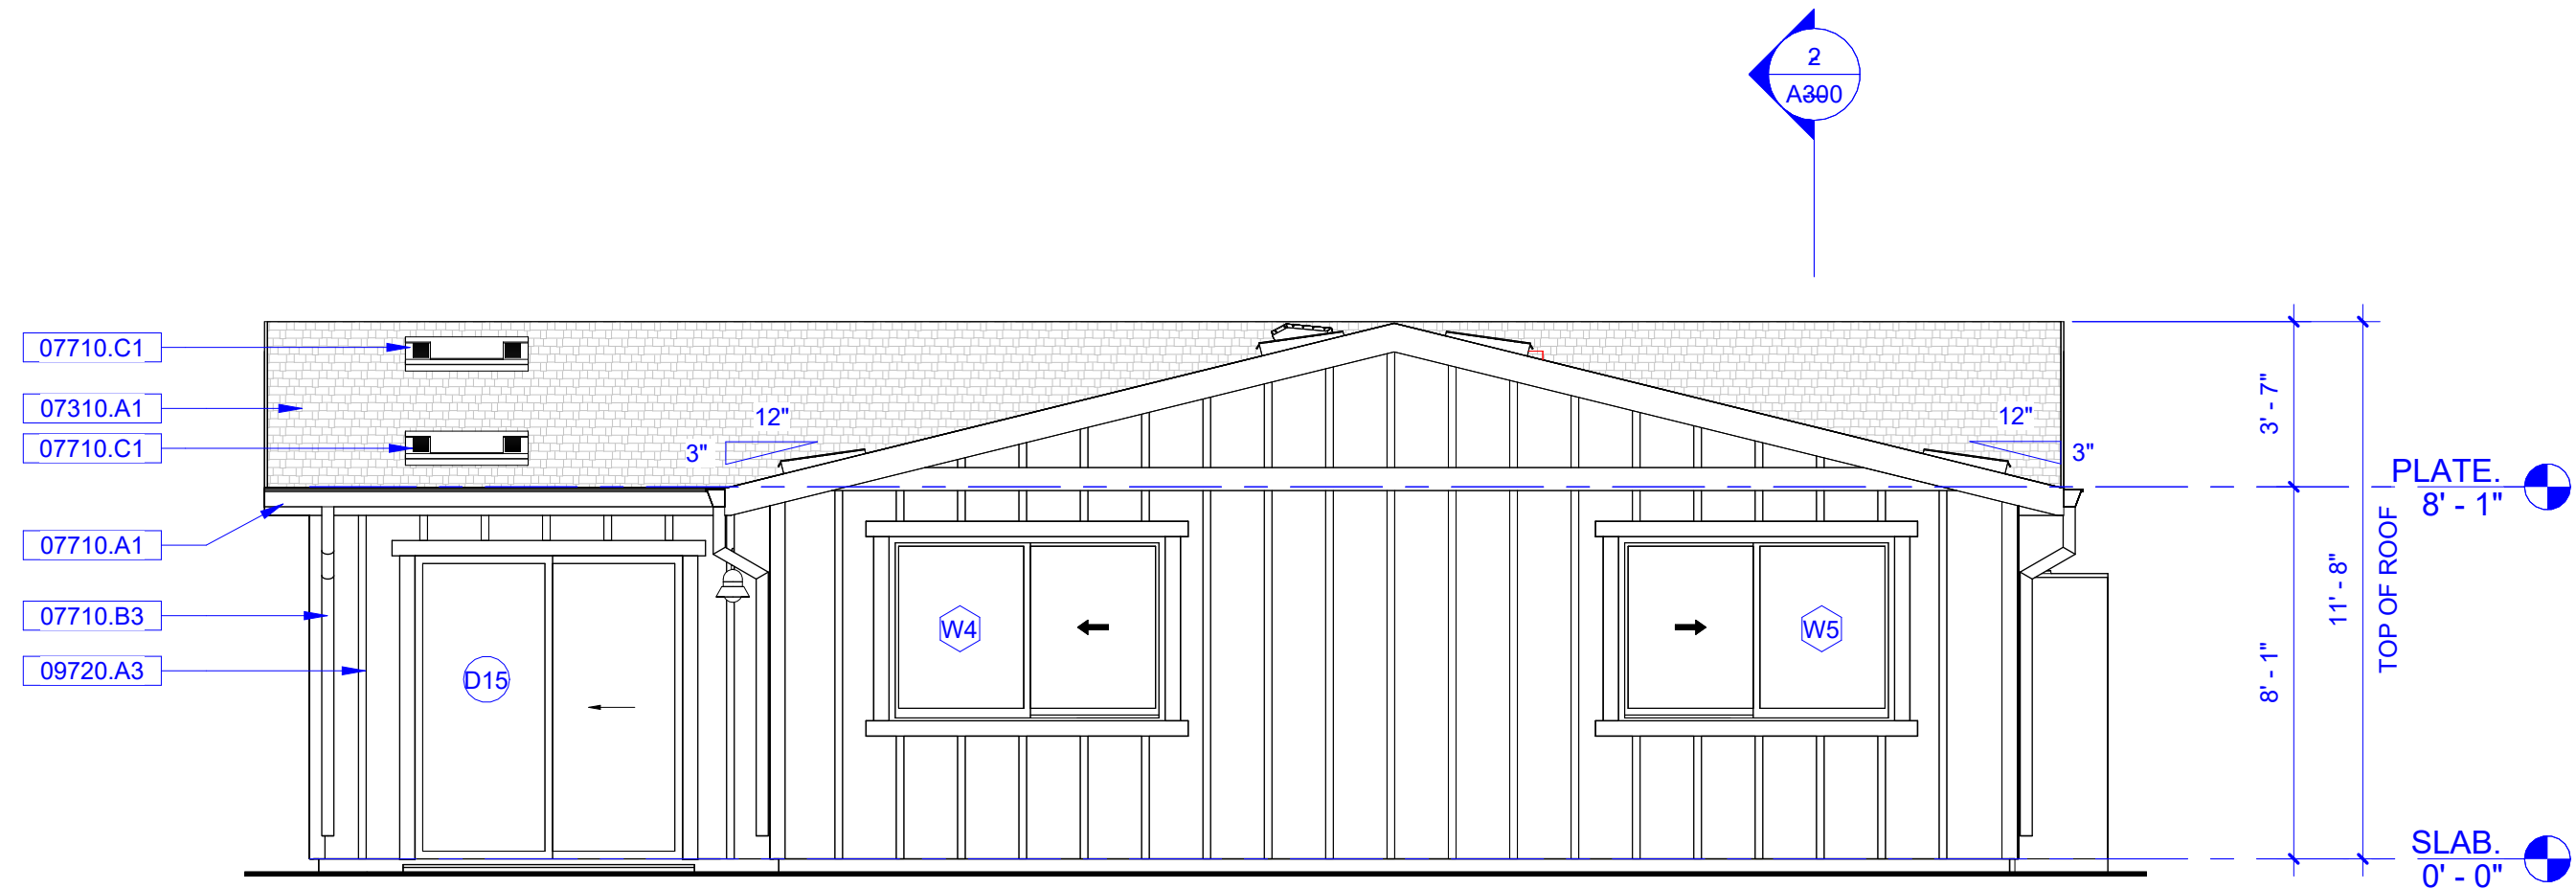

3 EAST ELEVATION - B&B SIDING - 6068 SGD
SCALE: 1/4" = 1'-0"

KEYNOTES:

KEYNOTE	DESCRIPTION
07310.A1	ROOFING MATERIAL PER CHECKLIST ON SHEET G102
07710.A1	GUTTER
07710.B3	DOWNSPOUT
07710.C1	O'HAGIN STANDARD LOW PROFILE ATTIC VENTS, 0.68 SF NFVA
09710.A1	STUCCO FINISH, COLOR TBD
09720.A2	FIBER CEMENT WALL LAP SIDING 'HARDIEPLANK' ESR-2290 OR SIMILAR, COLOR TBD TO MATCH MAIN RESIDENCE
09720.A3	FIBER CEMENT WALL VERTICAL B&B SIDING 'HARDIEPANEL' ESR-1844 OR SIMILAR, COLOR TBD TO MATCH MAIN RESIDENCE

GENERAL NOTES

- THE EXTERIOR ROOFING, TRIM, WALLS, WINDOWS, AND COLOR PALETTE OF THE ADU SHALL INCORPORATE THE SAME FEATURES AS THE MAIN DWELLING UNIT.
- THE TYPE, LOCATION, AND SIZE OF THE BUILDING ADDRESS IDENTIFICATION MUST BE CLEARLY VISIBLE AND LEGIBLE FROM THE ADJACENT PUBLIC WAY OR STREET. ADDRESS LETTERS/NUMBERS SHALL BE MINIMUM 4 INCHES HIGH, WITH A MINIMUM STROKE WIDTH OF 1/2 INCH, AND SHALL CONTRAST WITH THEIR BACKGROUND. CRC R319.1.



SNAPADU
DESIGN HOUSE

YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 999 L-SHAPE

CITY OF CHULA VISTA
276 FOURTH AVENUE,
CHULA VISTA, CA 91910

DESIGNER:

LUIS CALDERON
SnapADU


Luis Calderon
SIGNATURE

RELEASE DATE BY APP. RELEASED FOR...


ELEVATION -
OPTIONS

A230

22040

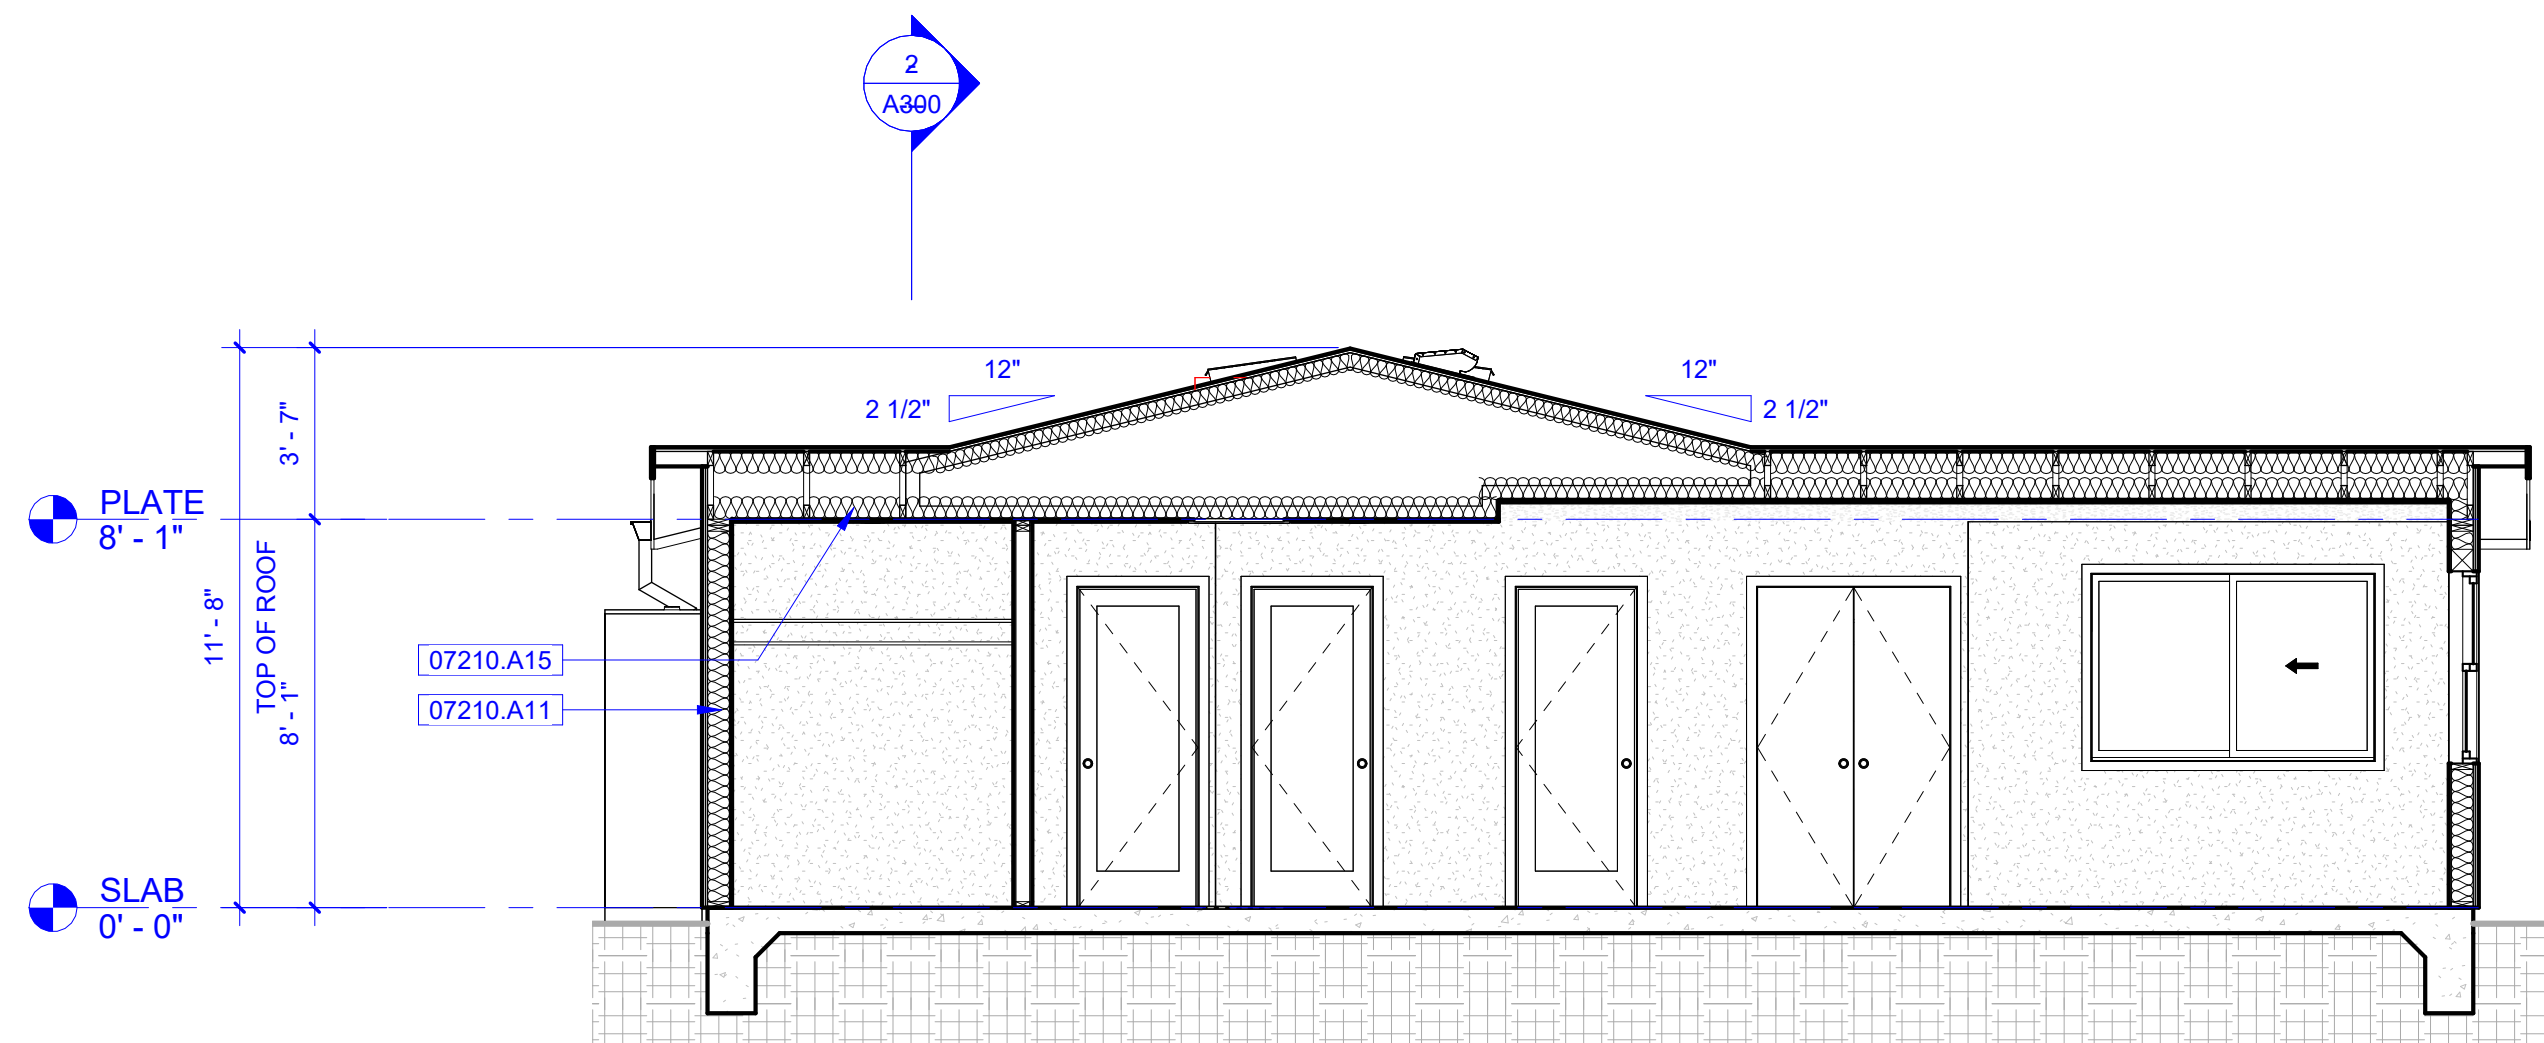

1 SECTION 1
1/4" = 1'-0"

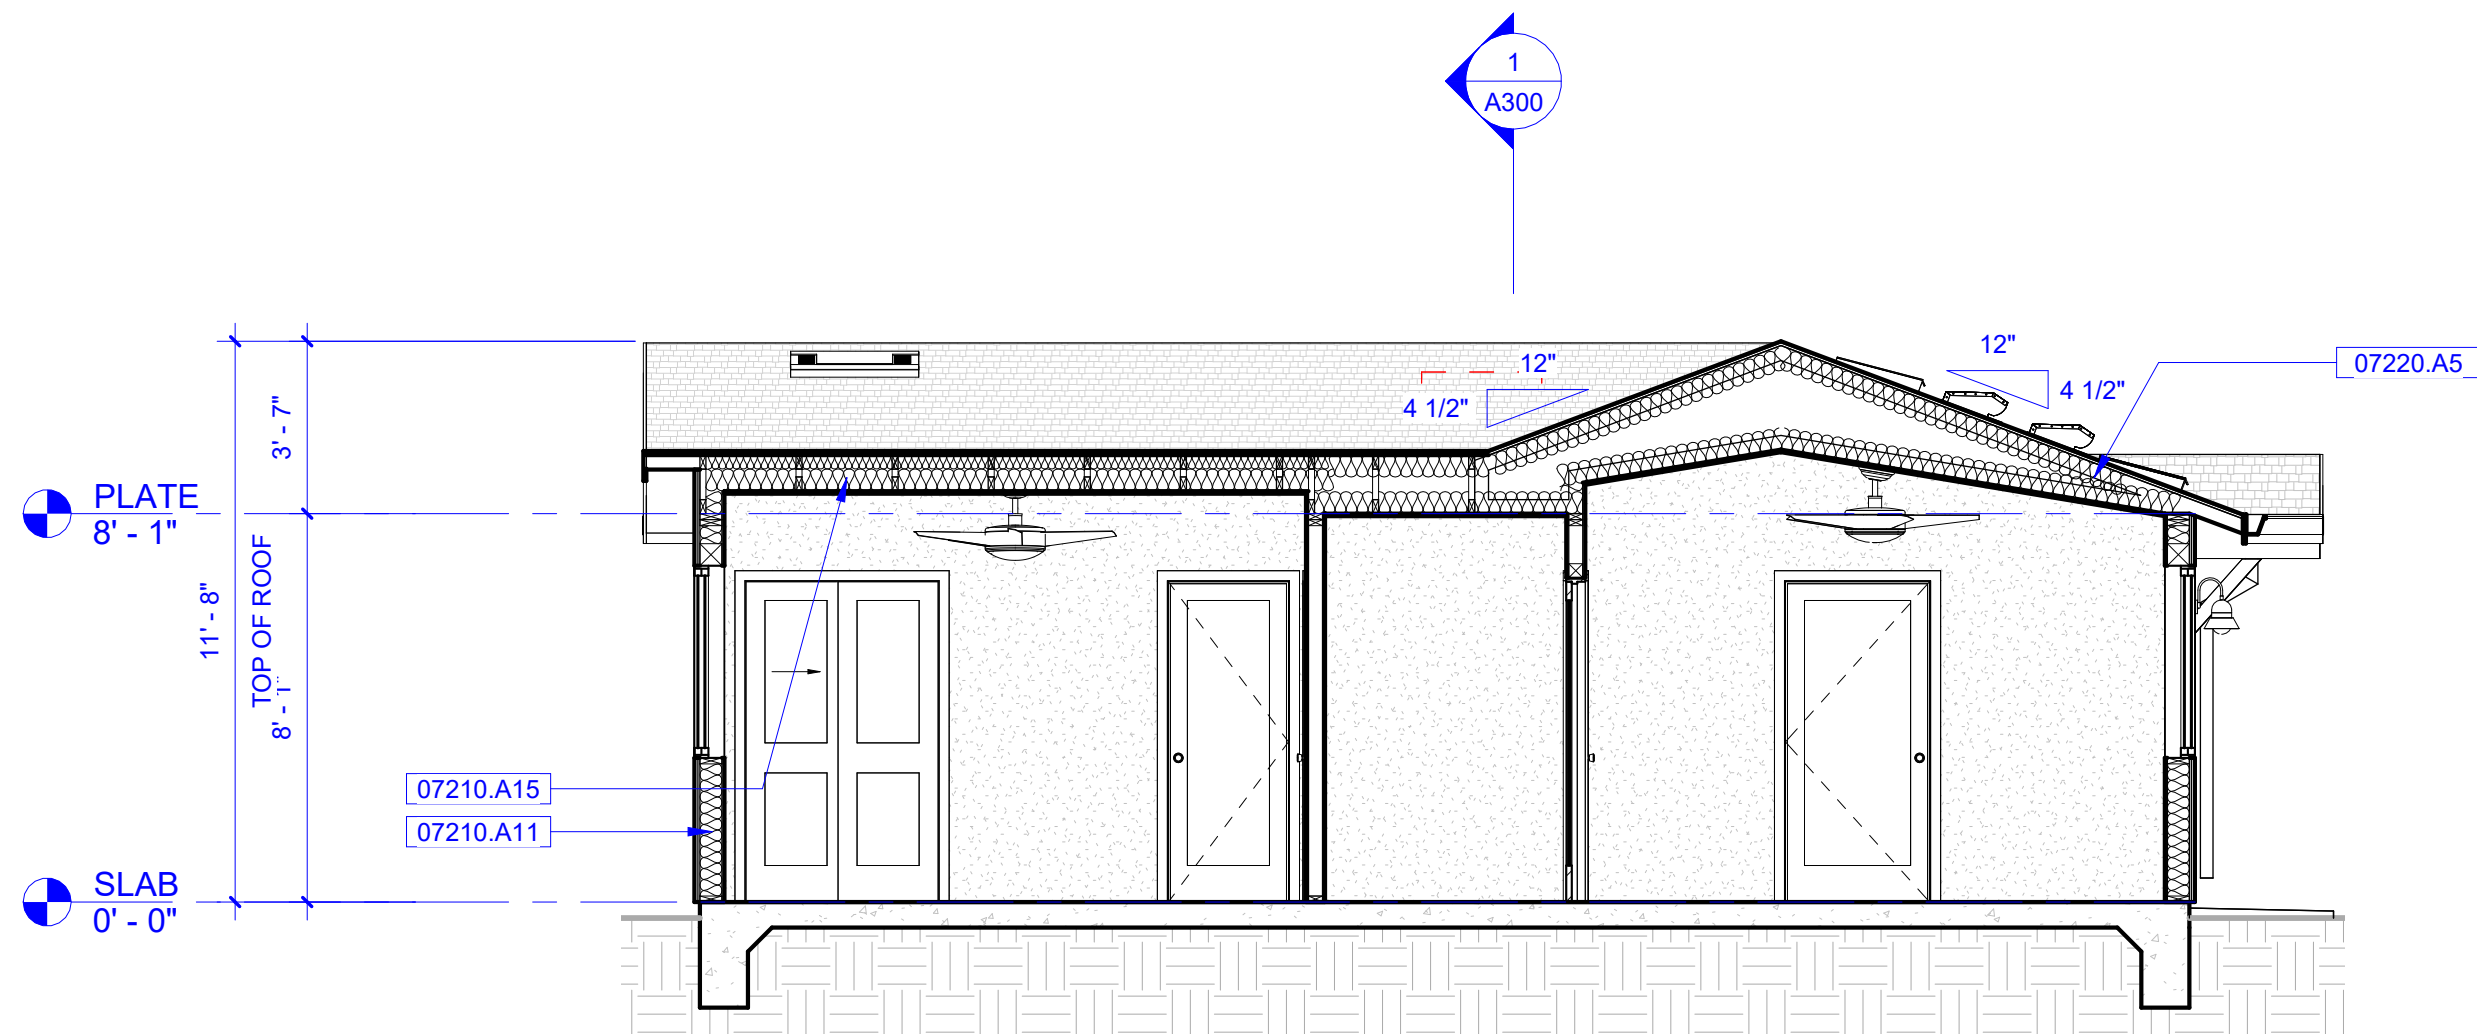

2 SECTION 2
1/4" = 1'-0"

KEYNOTES:

KEYNOTE	DESCRIPTION
07210.A11	WALL BATT INSULATION PER TITLE 24 CALCULATIONS
07210.A15	CEILING BATT INSULATION PER TITLE 24 CALCULATIONS
07220.A5	BATT INSULATION BELOW ROOF DECK PER TITLE 24 CALCULATIONS




SNAPADU
DESIGN HOUSE

YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 999 L-SHAPE

CITY OF CHULA VISTA
276 FOURTH AVENUE,
CHULA VISTA, CA 91910

DESIGNER:
LUIS CALDERON
SnapADU


SIGNATURE


RELEASE	DATE	BY	APP.	LAG	RELEASED FOR...
A	03/22/2024				

BUILDING
SECTIONS

A300


22040

Autodesk Docs://22040_City of Chula Vista/22040_City of Chula Vista_999 L-Shape_V2_CD_RVT22.rvt 3/24/2024 11:35:17 AM

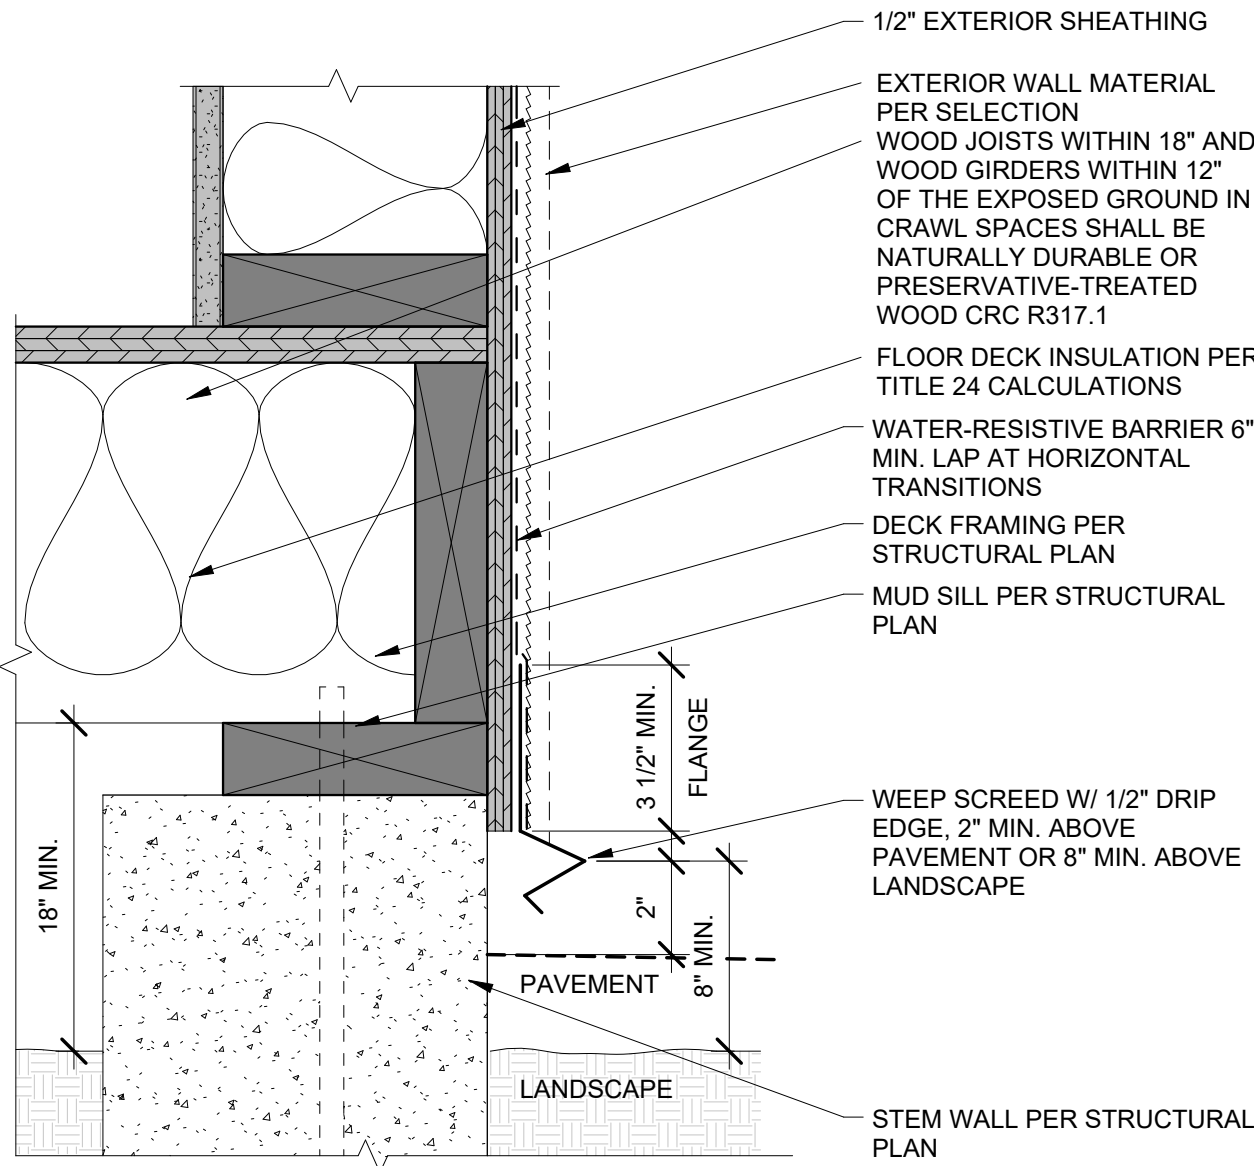


8 RAISED FLOOR FOUNDATION

SCALE: 3" = 1'-0"

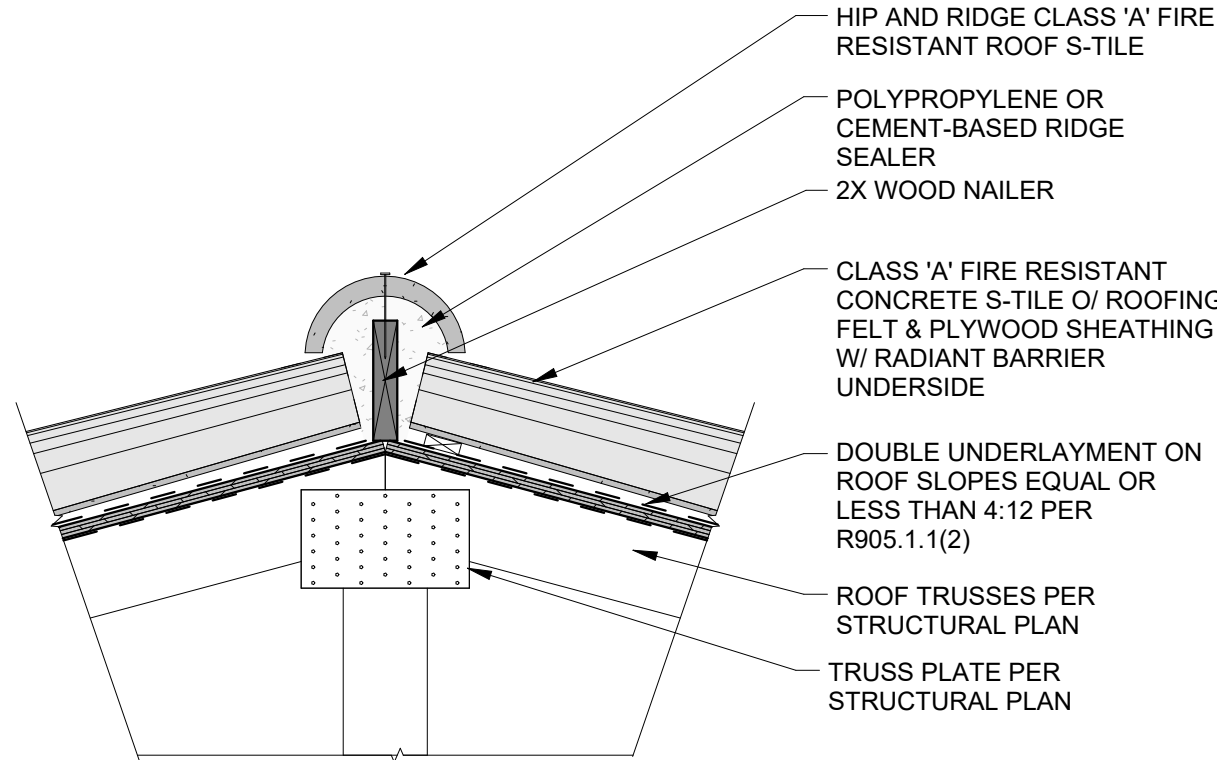


6 ROOF RIDGE W/ KING POST - S-TILE

SCALE: 1 1/2" = 1'-0"

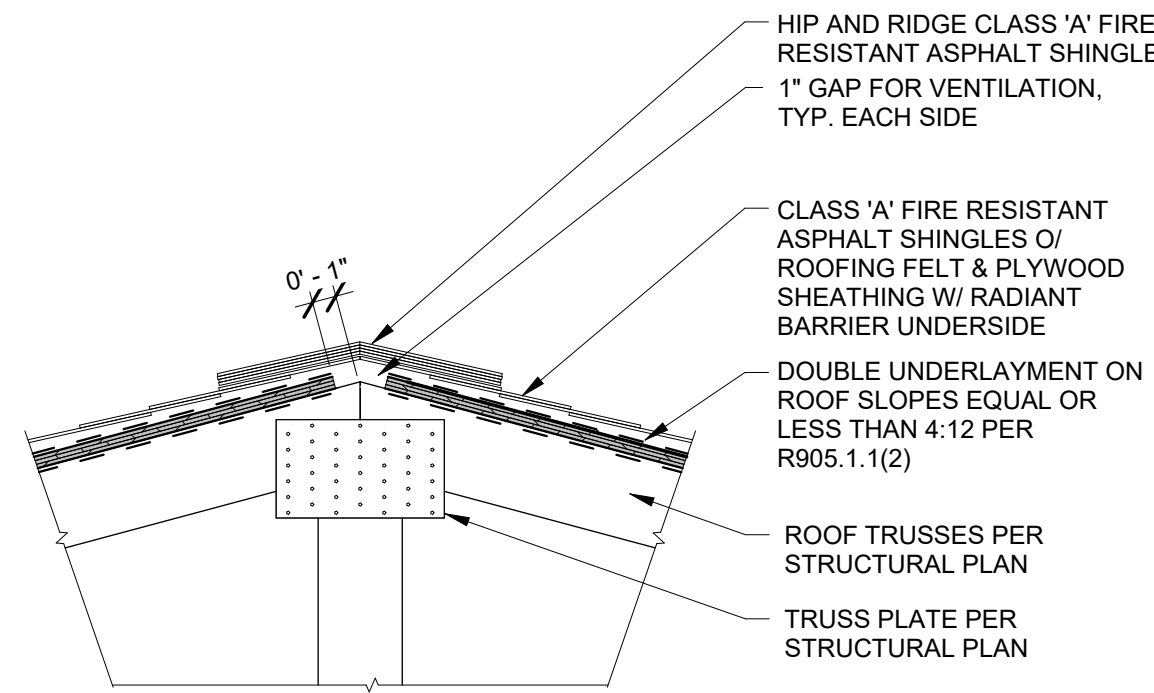


4 ROOF RIDGE W/ KING POST - SHINGLE

SCALE: 1 1/2" = 1'-0"

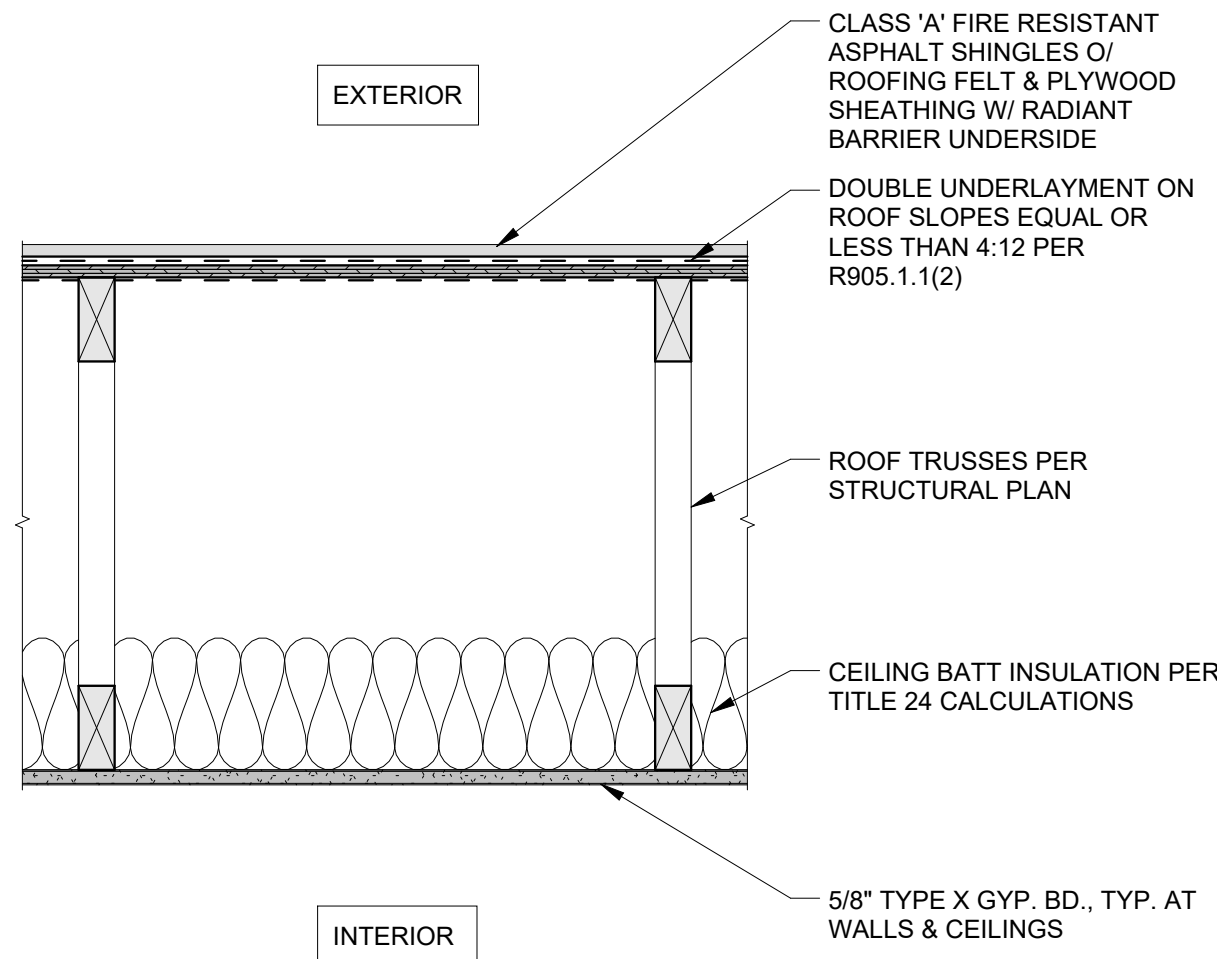


1 1- 1-HR CLASS 'A' ROOF DETAIL - SHINGLE

SCALE: 1 1/2" = 1'-0"

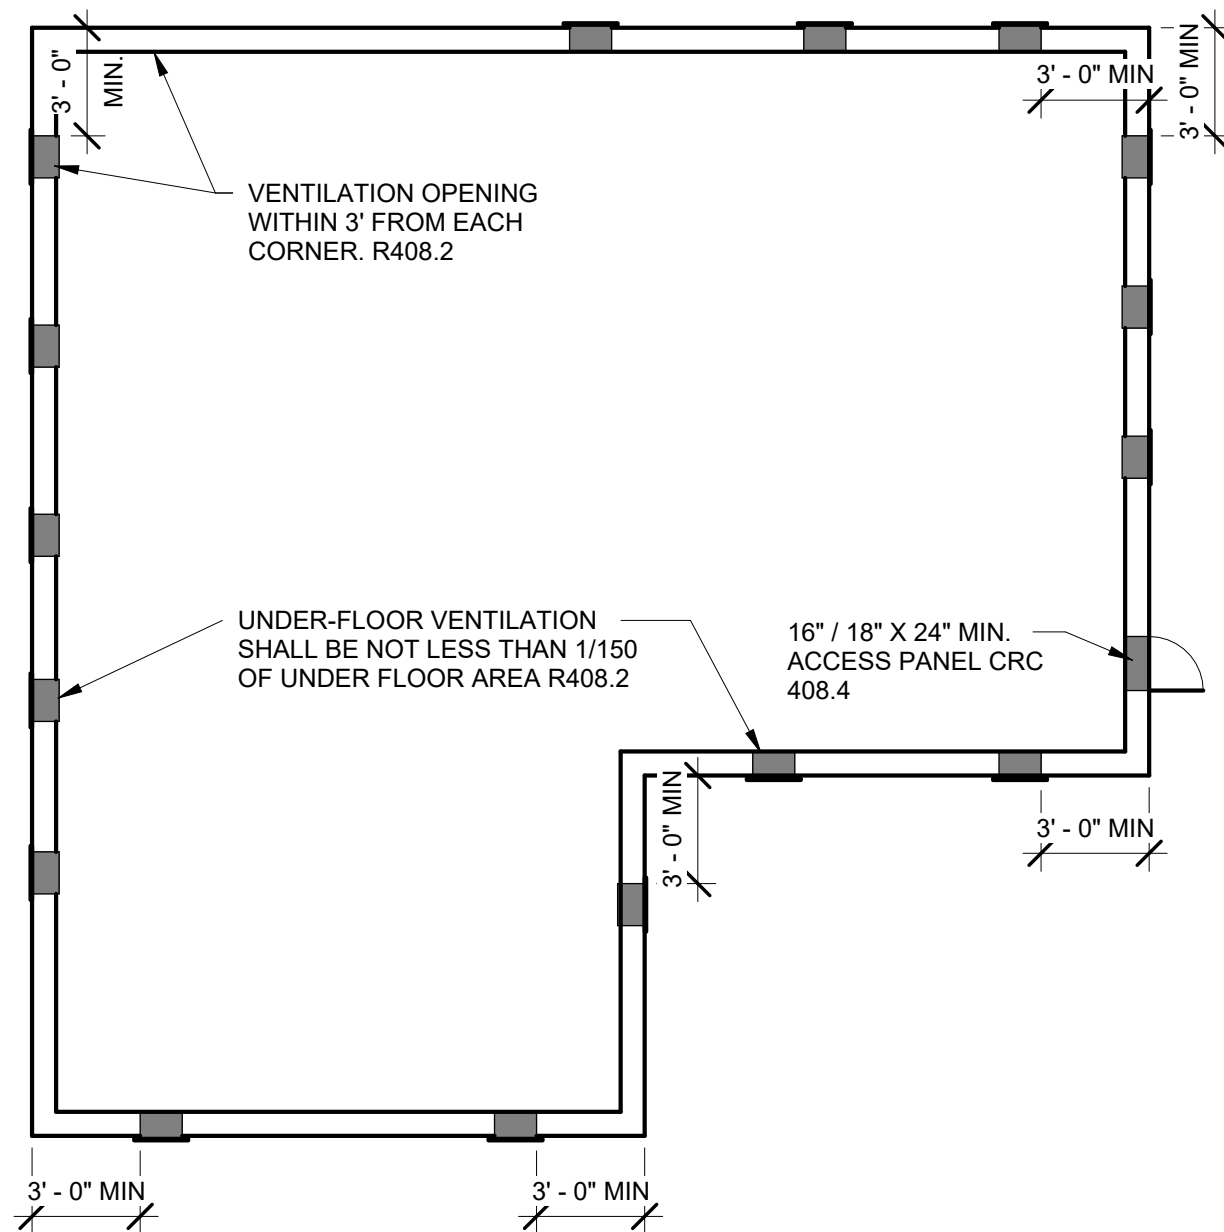


9 FOUNDATION VENTS CALCULATIONS

SCALE: 1" = 1'-0"

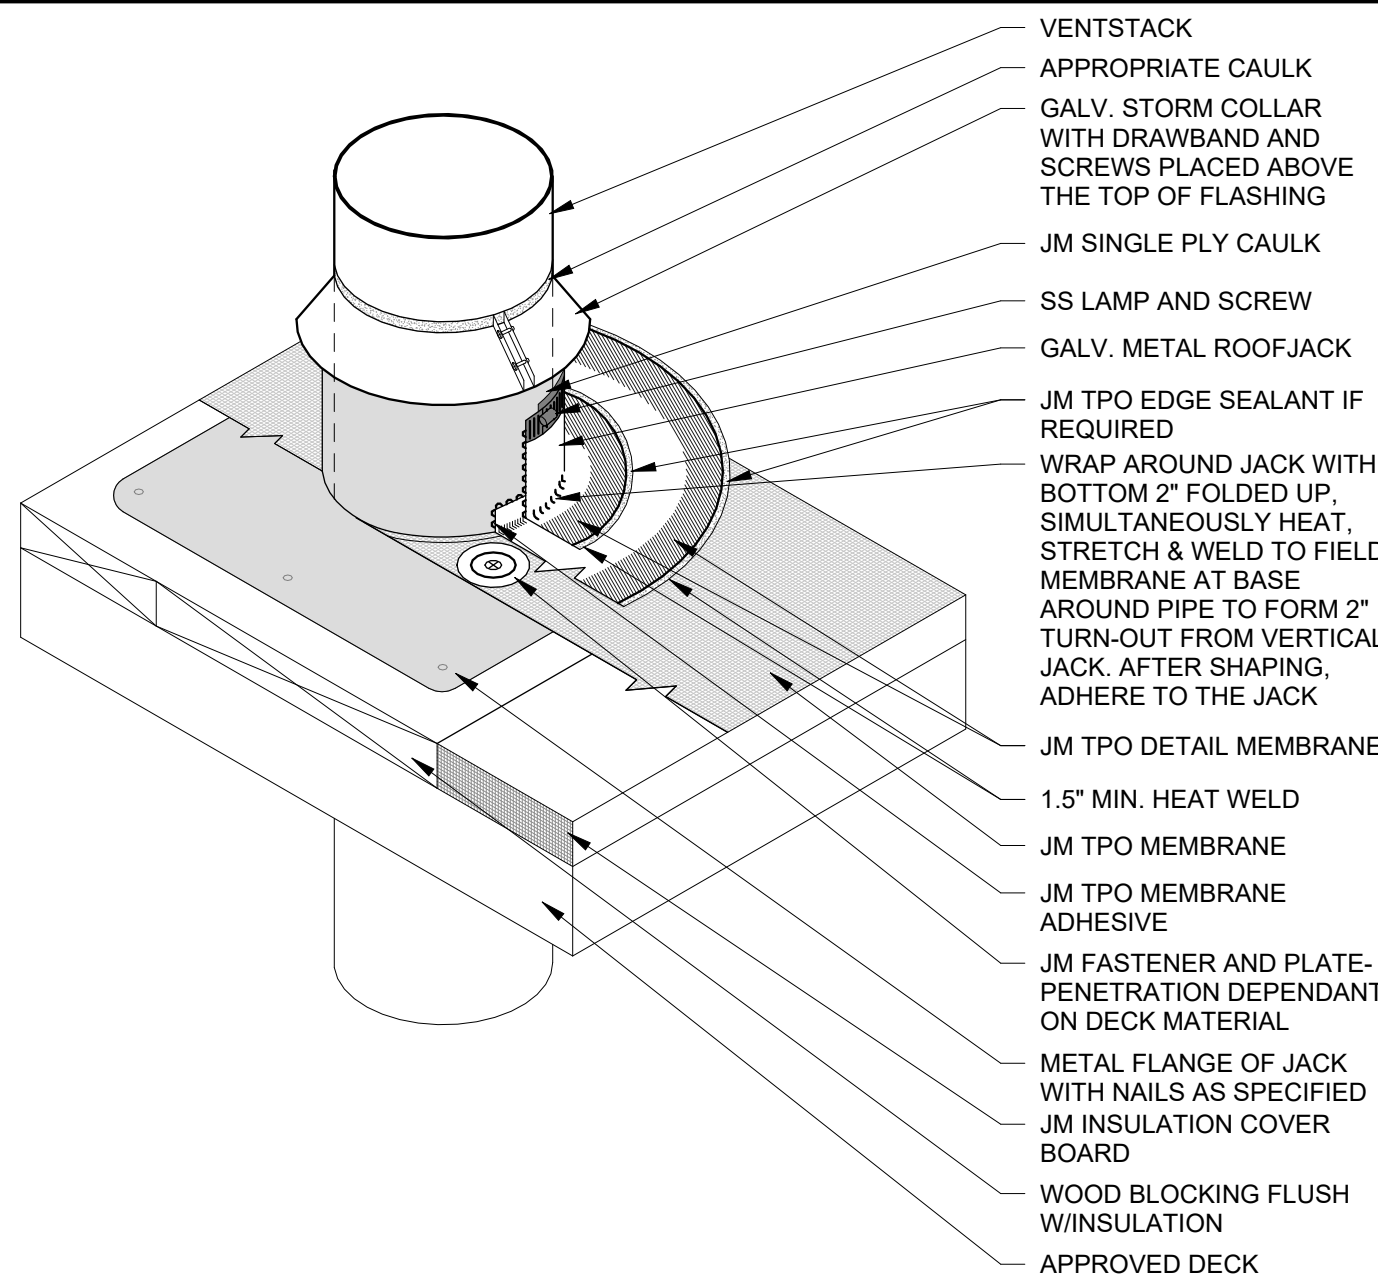


7 ROOF VENTILATION DETAIL

SCALE: N.T.S.

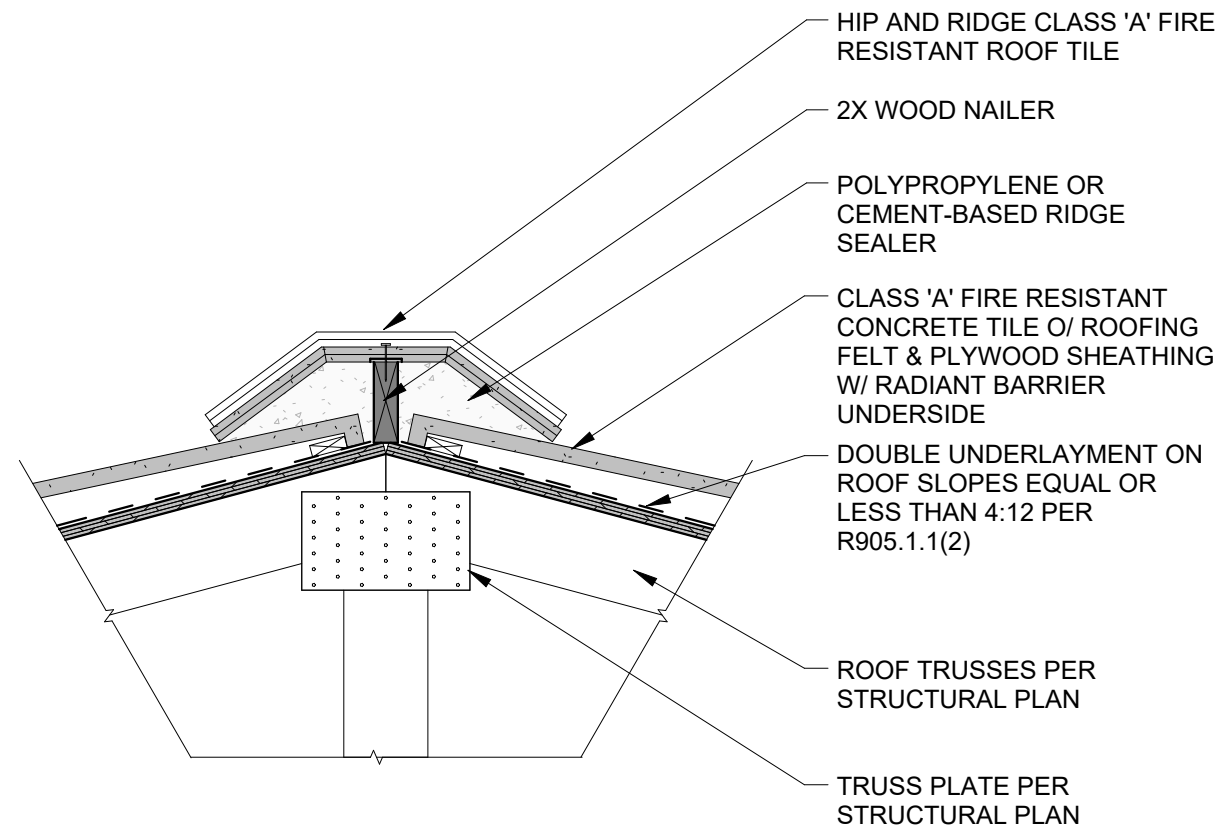


5 ROOF RIDGE W/ KING POST - CEMENT

SCALE: 1 1/2" = 1'-0"

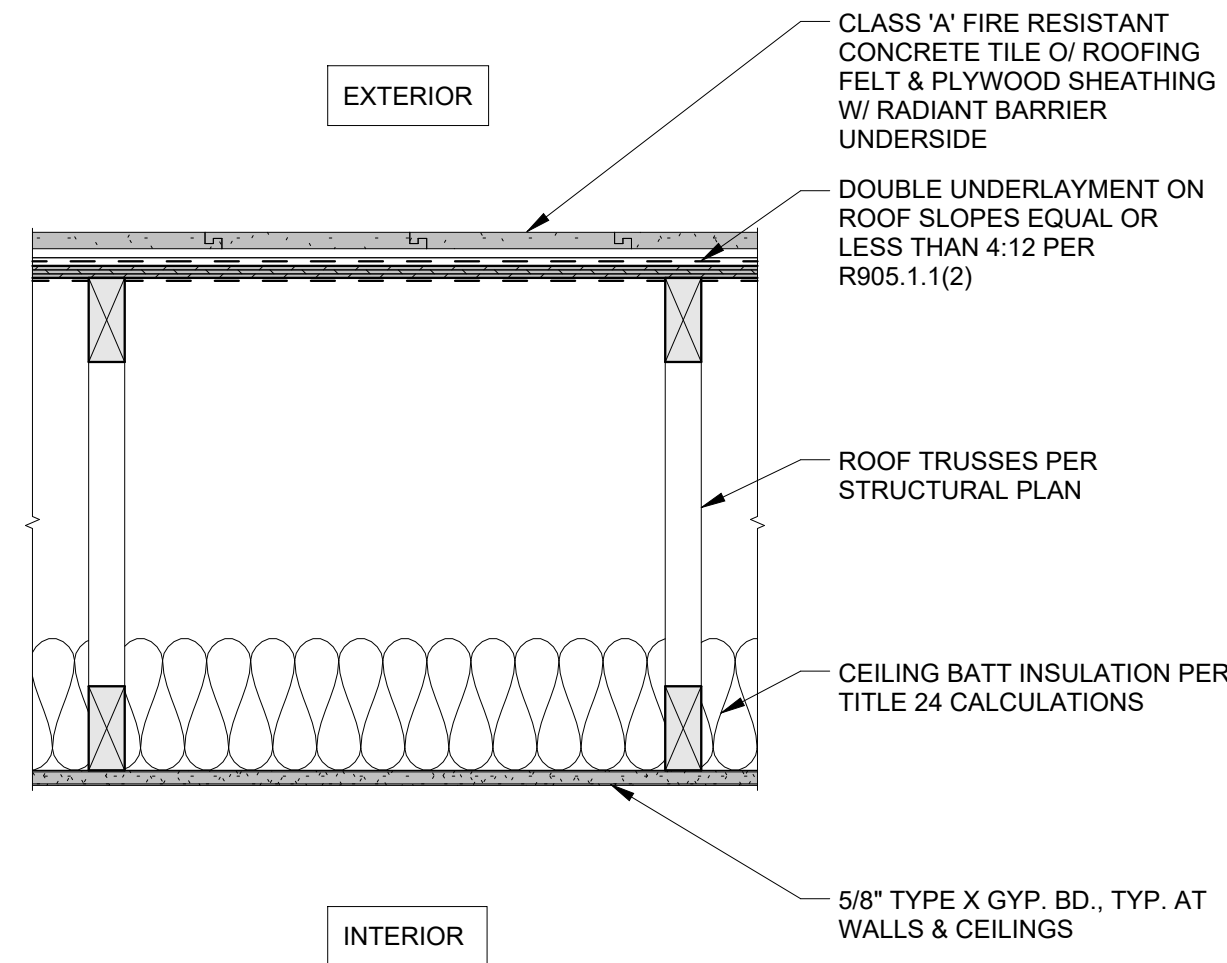

2 2- 1-HR CLASS 'A' ROOF DETAIL - CEMENT

SCALE: 1 1/2" = 1'-0"

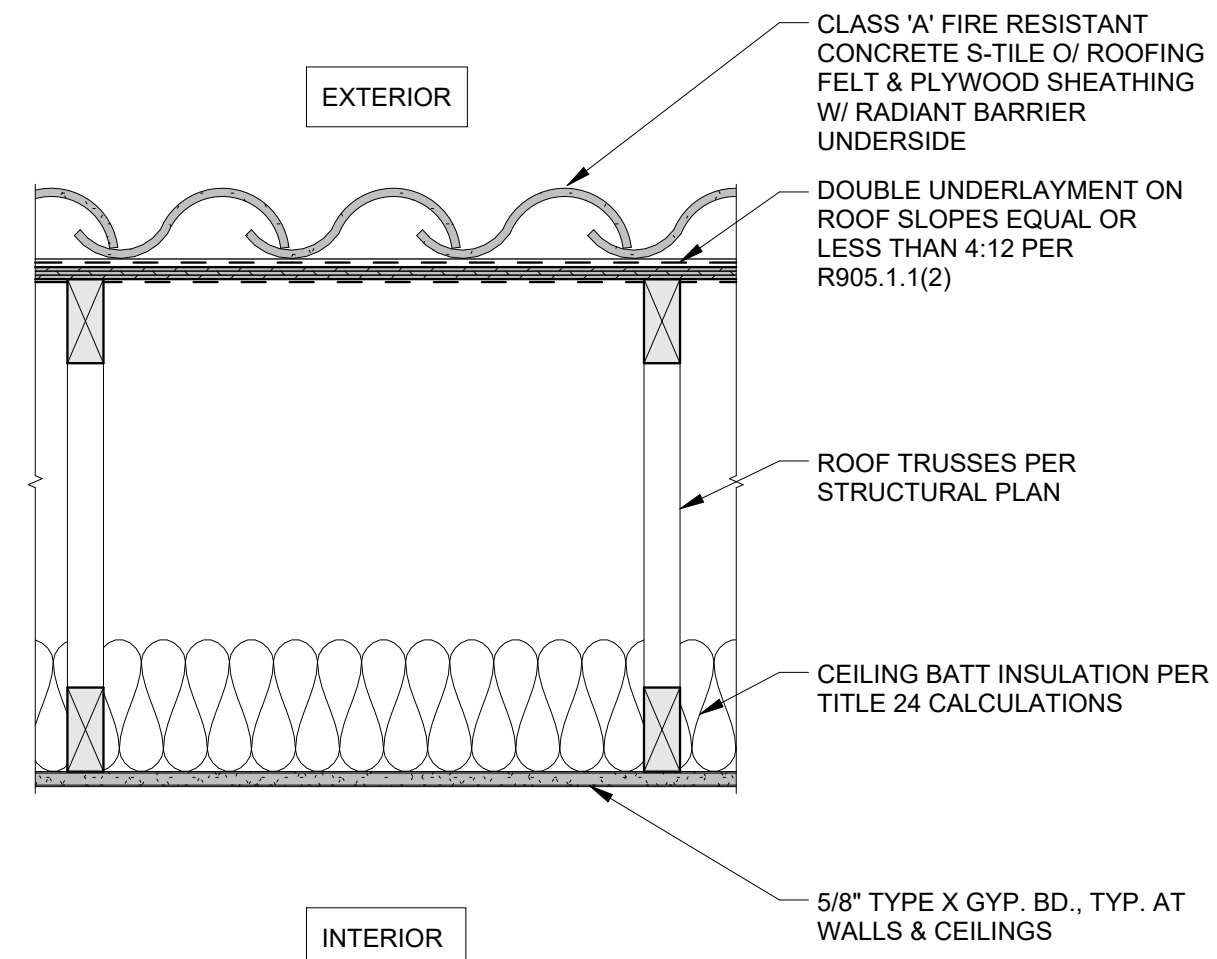

3 3- 1-HR CLASS 'A' ROOF DETAIL - S-TILE

SCALE: 1 1/2" = 1'-0"

FOUNDATION VENT CALCULATIONS:

NET FREE VENTED AREA CALC.	CRAWL SPACE AREA	REQUIRED NFVA	
CRAWL SPACE AREA / 150 SF	999 SF	6.66 SF	
CRAWL SPACE VENT NFVA	REQUIRED NFVA / CRAWLSPACE VENT NFVA	REQUIRED VENTS	NFVA TO BE PROVIDED
VULCAN FOUNDATION VENT MODEL VFS814S OR EQUAL (NFVA = 62 SQ.IN. = 0.43 SF)	15.49 SF	16	6.88 SF



SNAPADU
DESIGN/BUILD

YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 999 L-SHAPE
CITY OF CHULA VISTA
276 FOURTH AVENUE,
CHULA VISTA, CA 91910

DESIGNER:
LUIS CALDERON
SnapADU

Luis Calderon
SIGNATURE


RELEASE	DATE	BY	APP.	RELEASED FOR...
A	03/22/2024	LAG		

GENERIC ROOF &
MISC. DETAILS

A500


22040

Autodesk Docs//22040_City of Chula Vista//22040_City of Chula Vista_999 L-Shape_V2_CD_RVT22.rvt 3/24/2024 11:39:20 AM

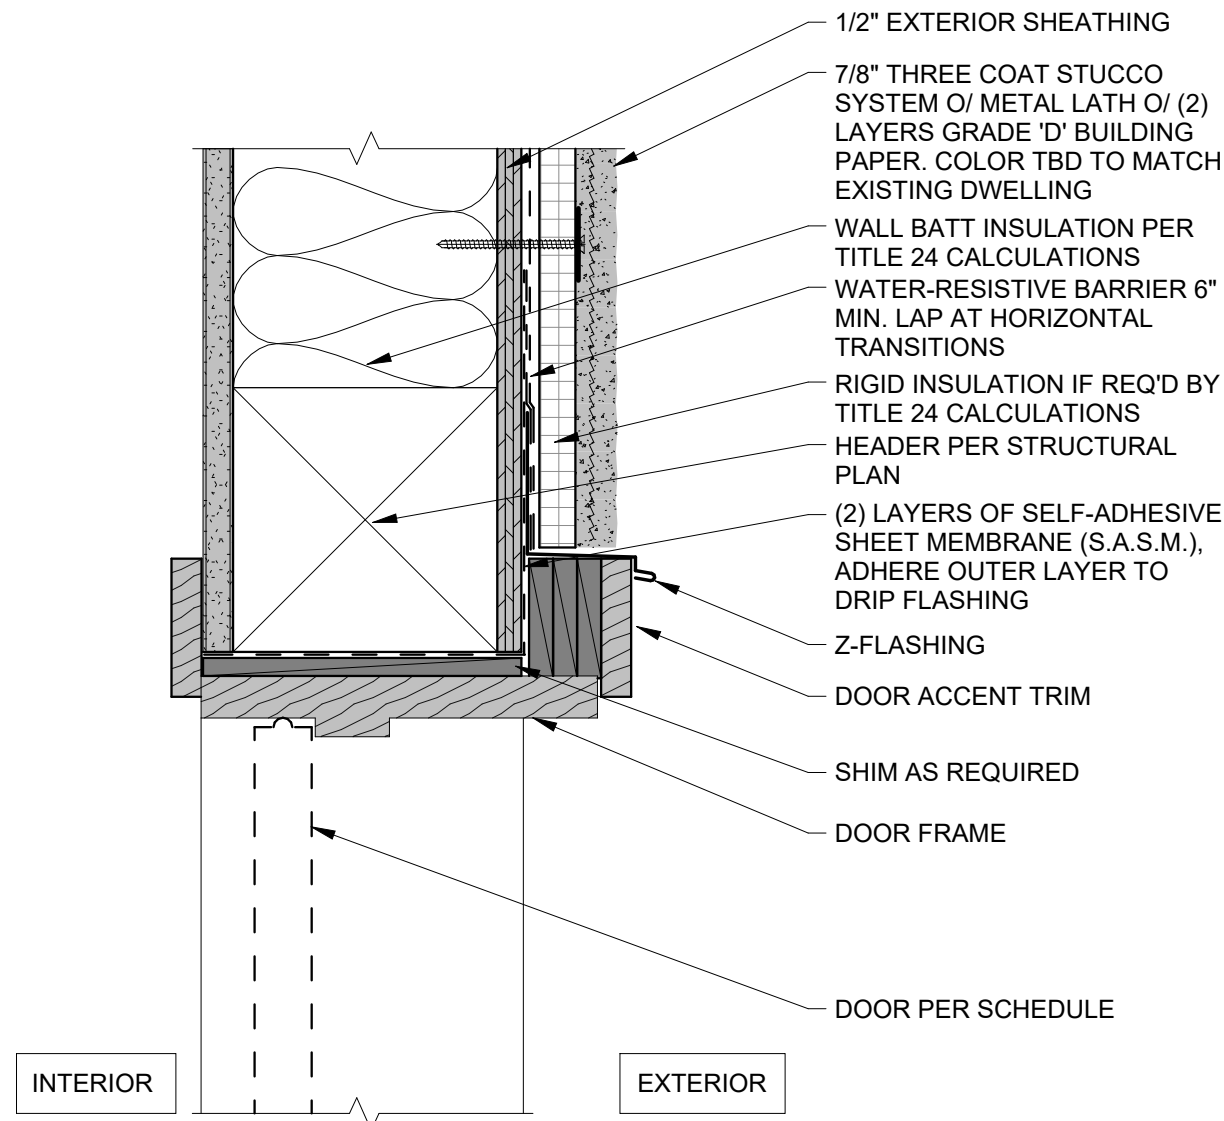


10 DOOR - EXTERIOR HEAD @ STUCCO
W/ CONT. INSULATION (JAMB SIM.)

SCALE: 3" = 1'-0"

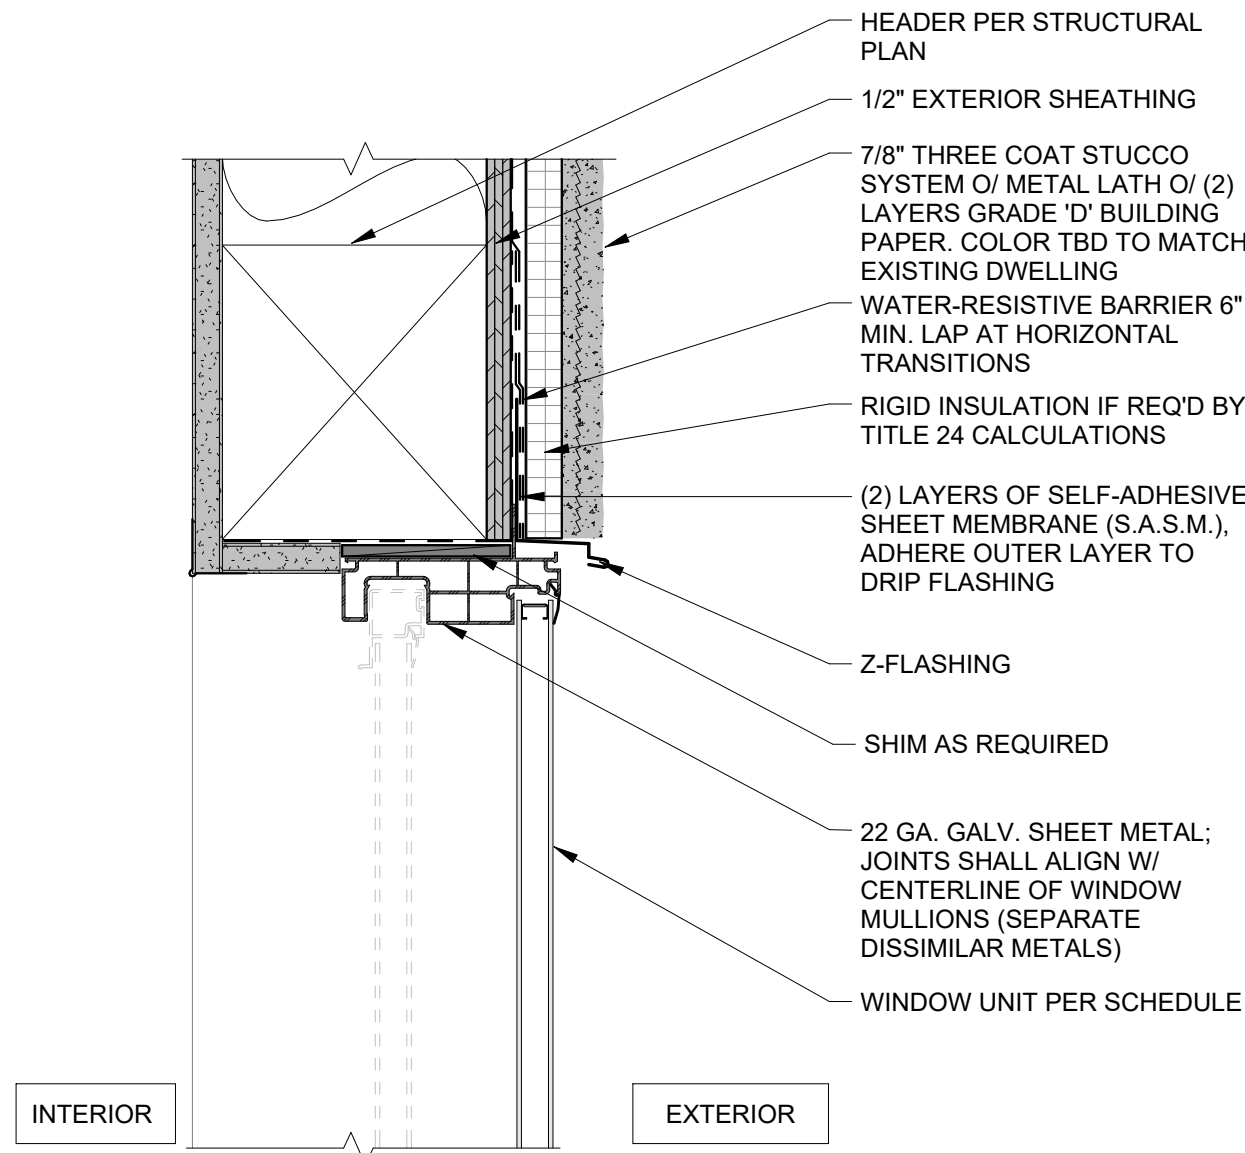


7 WINDOW - EXTERIOR HEAD @ STUCCO
W/ CONT. INSULATION (JAMB SIM.)

SCALE: 3" = 1'-0"

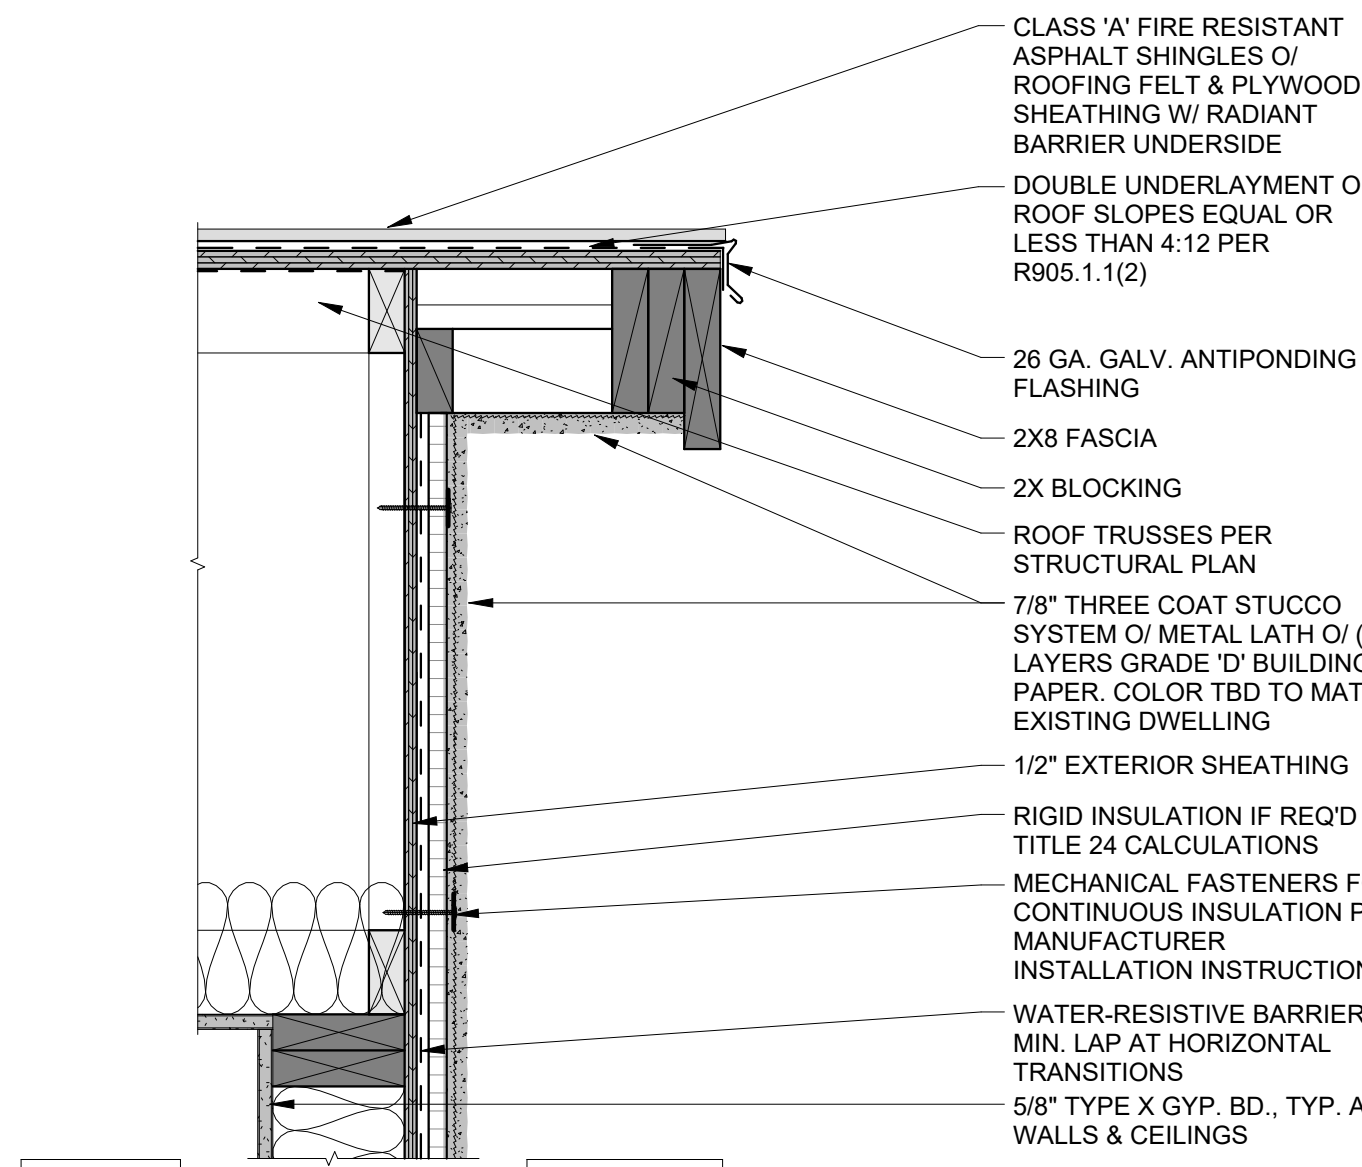


4 A1 - ROOF RAKE - SHINGLE PROTECTED
W/ CONT. INSULATION AND STUCCO

SCALE: 1 1/2" = 1'-0"

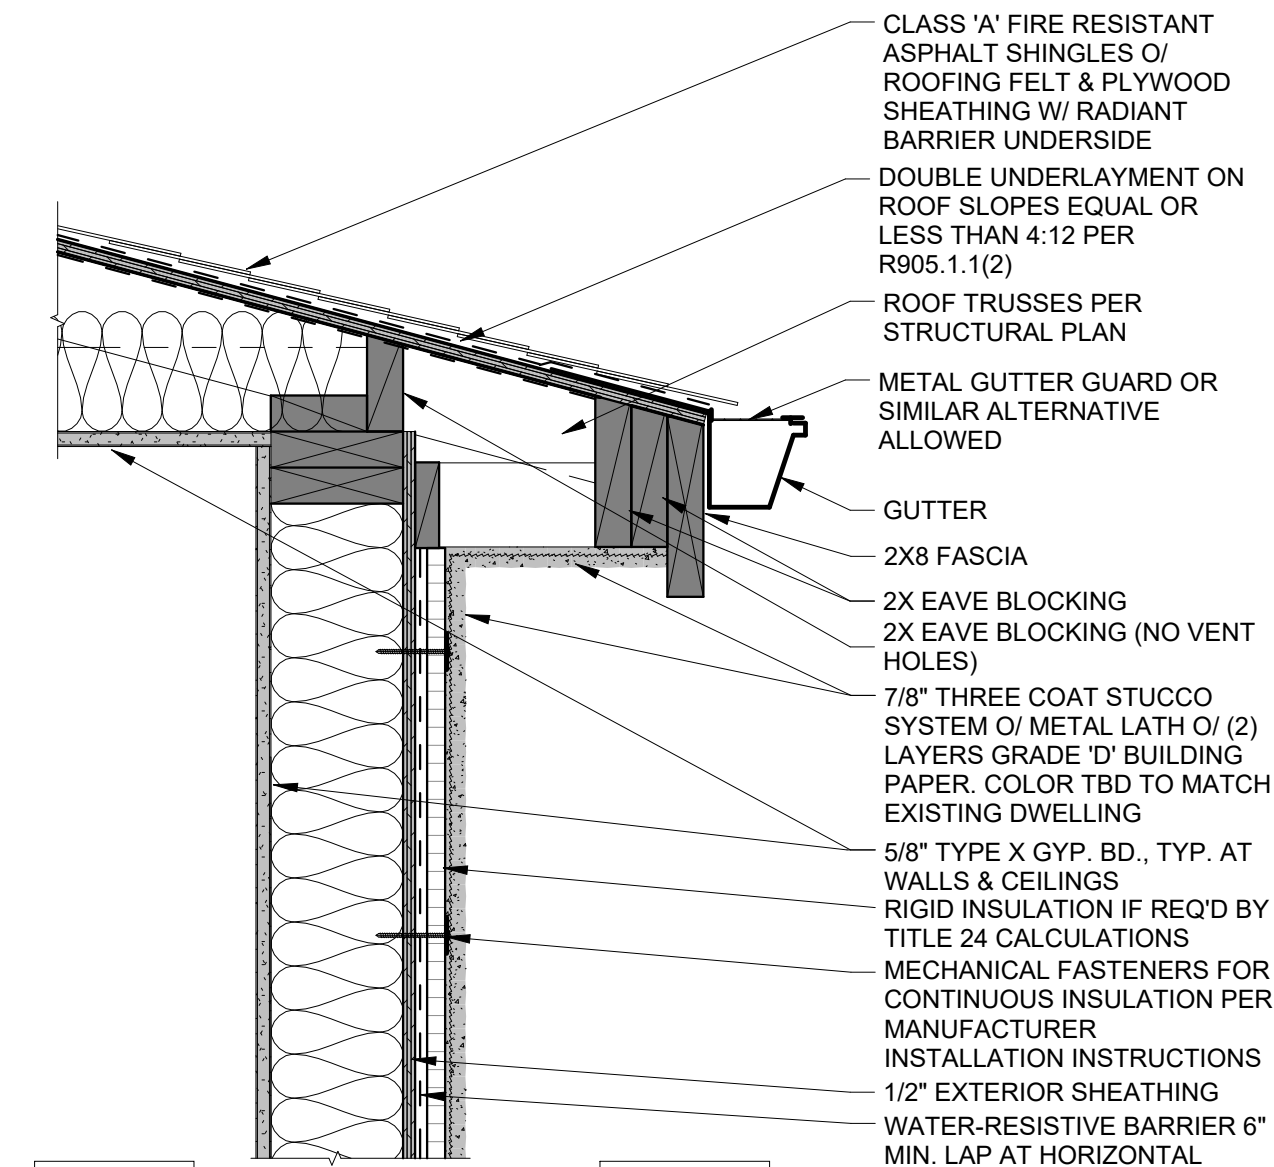


1 A1 - ROOF EAVE - SHINGLE PROTECTED
W/ CONT. INSULATION AND STUCCO

SCALE: 1 1/2" = 1'-0"

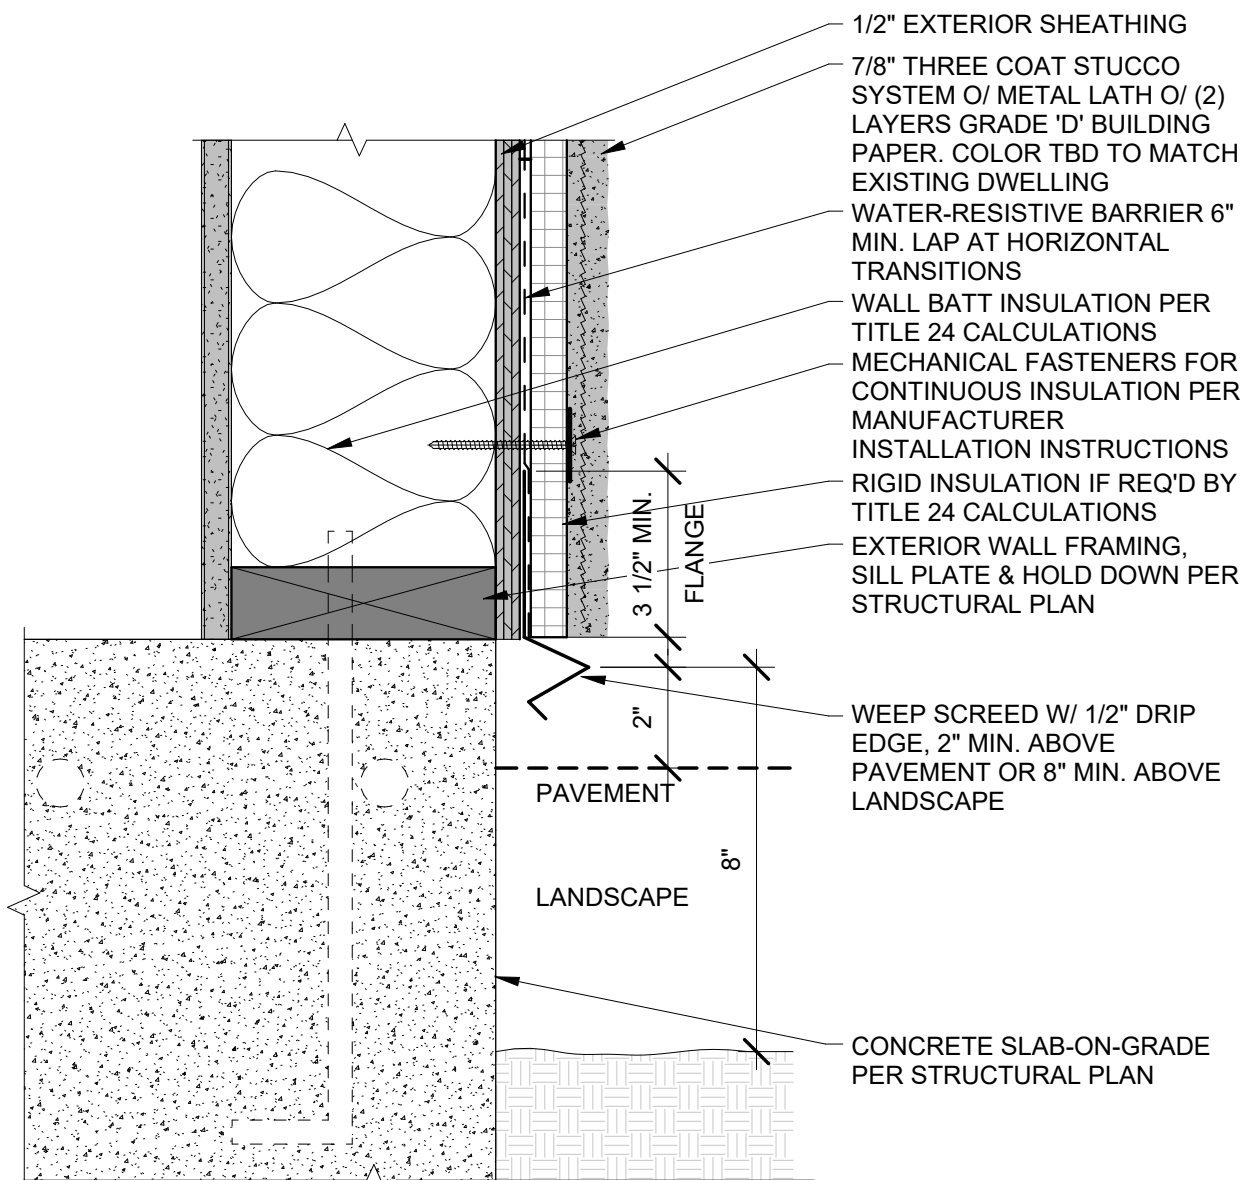


11 WALL - EXTERIOR STUCCO SCREED
W/ CONT. INSULATION

SCALE: 3" = 1'-0"

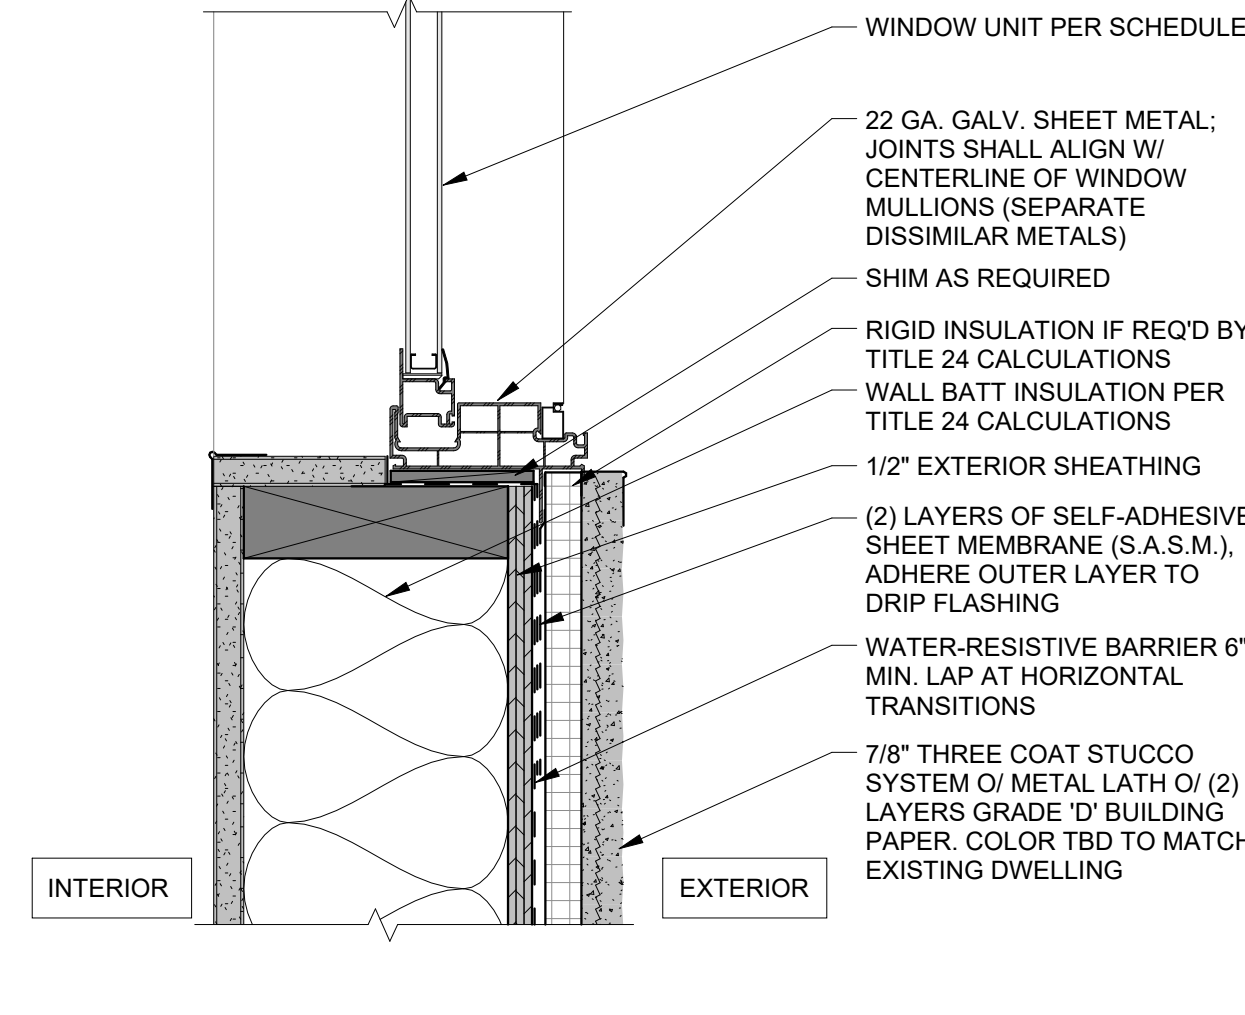


8 WINDOW - EXTERIOR SILL @ STUCCO
W/ CONT. INSULATION

SCALE: 3" = 1'-0"

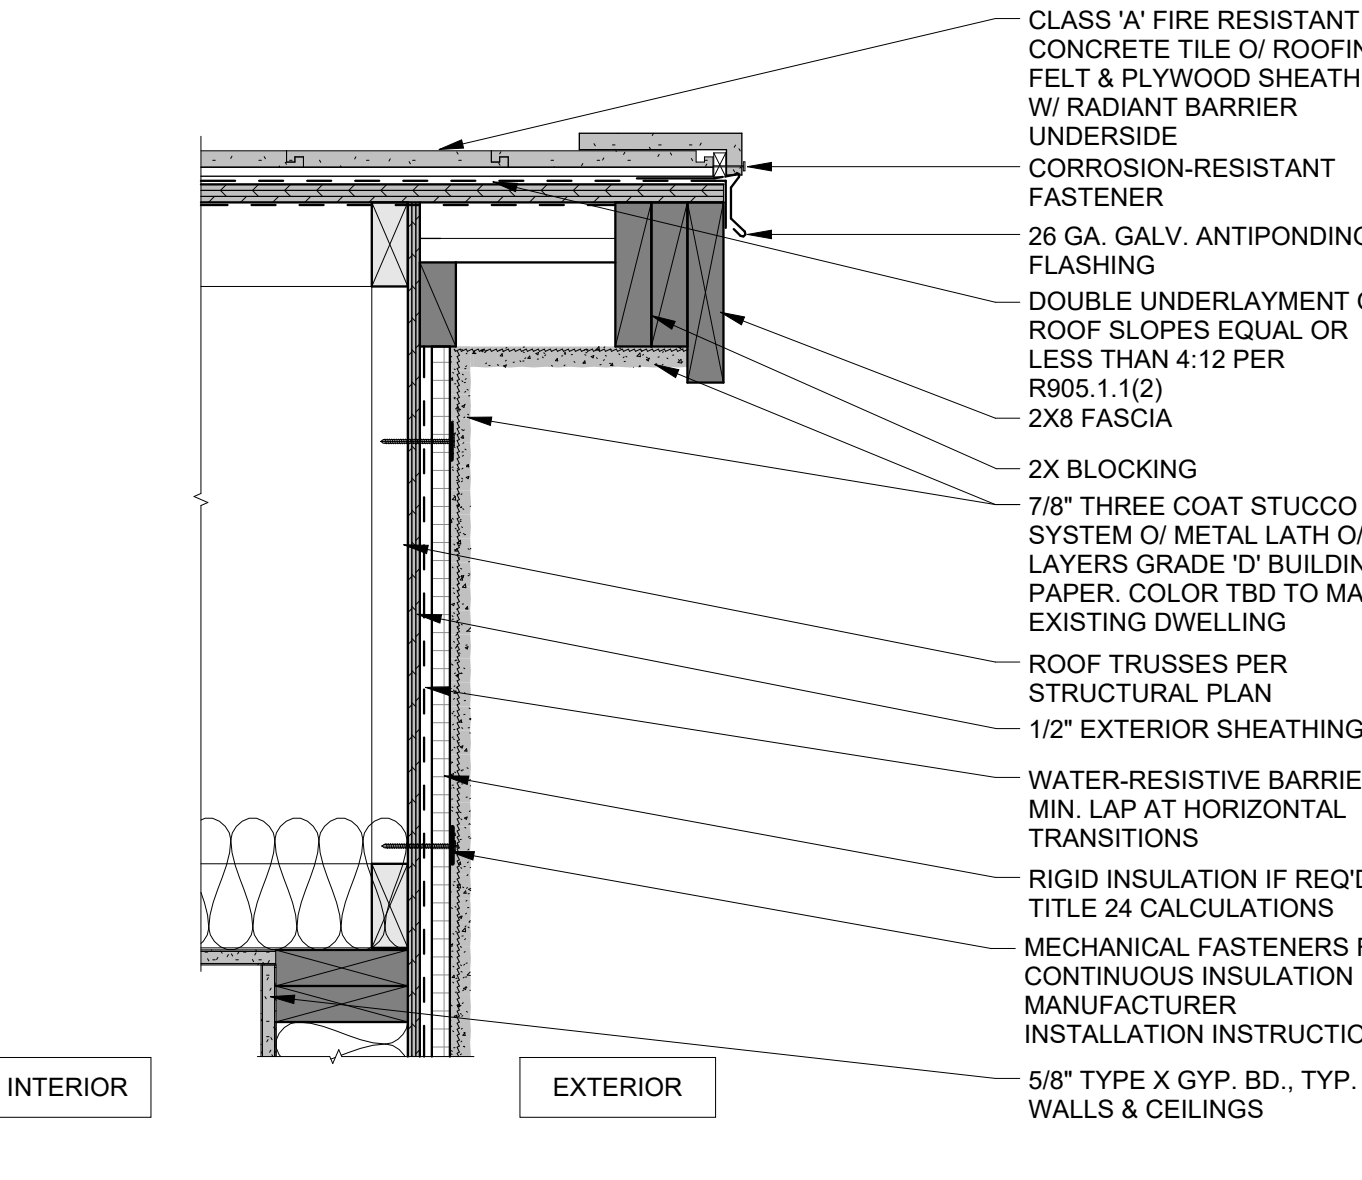


5 A2 - ROOF RAKE - CEMENT PROTECTED
W/ CONT. INSULATION AND STUCCO

SCALE: 1 1/2" = 1'-0"

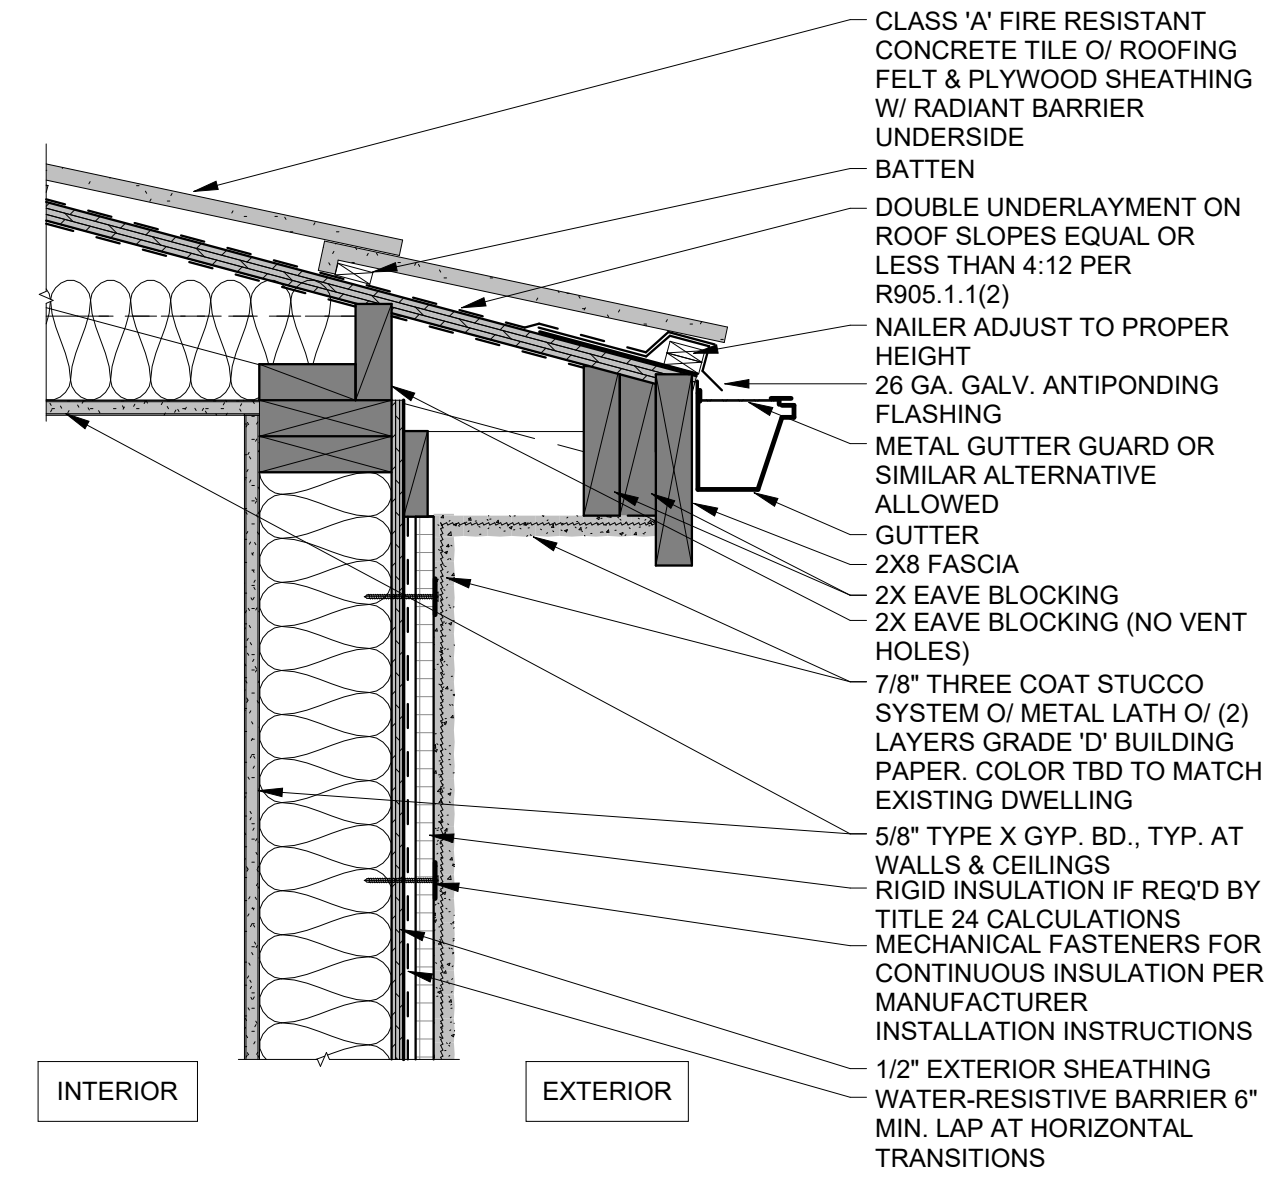


2 A2 - ROOF EAVE - CEMENT PROTECTED
W/ CONT. INSULATION AND STUCCO

SCALE: 1 1/2" = 1'-0"

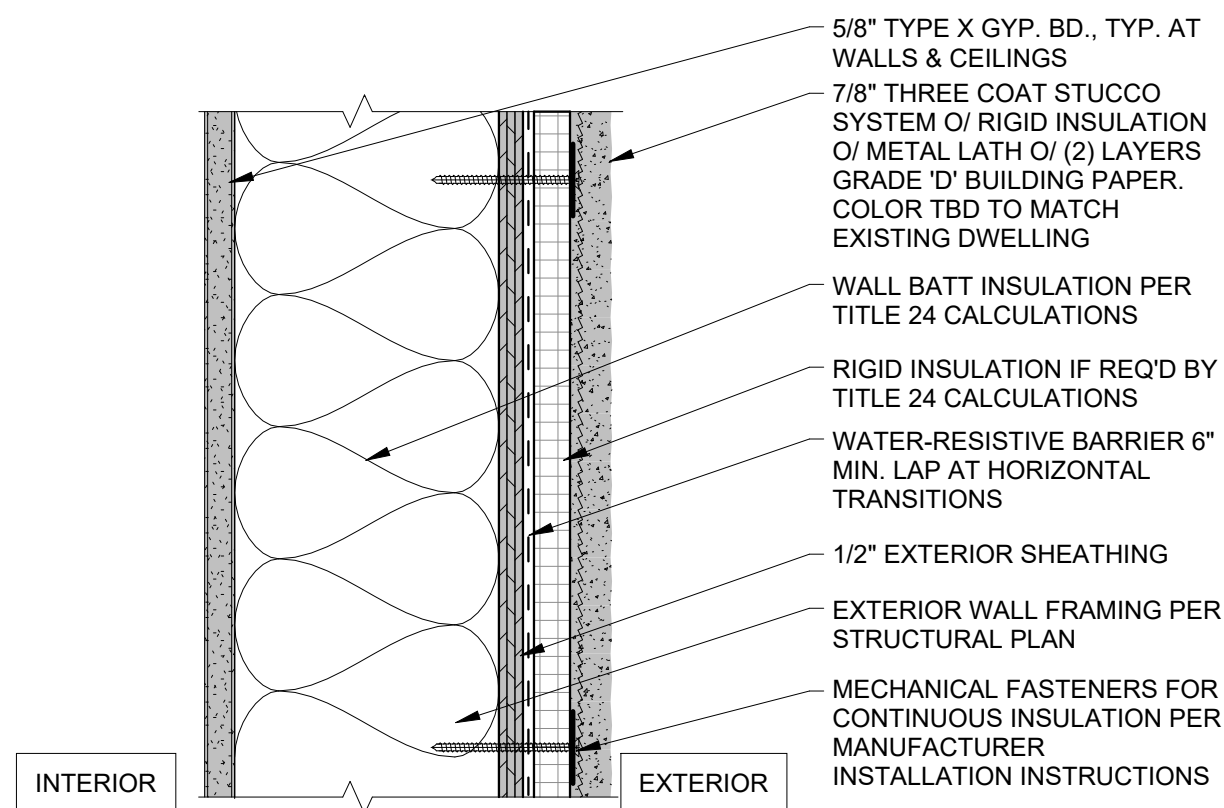


12 A - WALL - EXTERIOR 1-HOUR RATED - STUCCO
W/ CONT. INSULATION

SCALE: 3" = 1'-0"

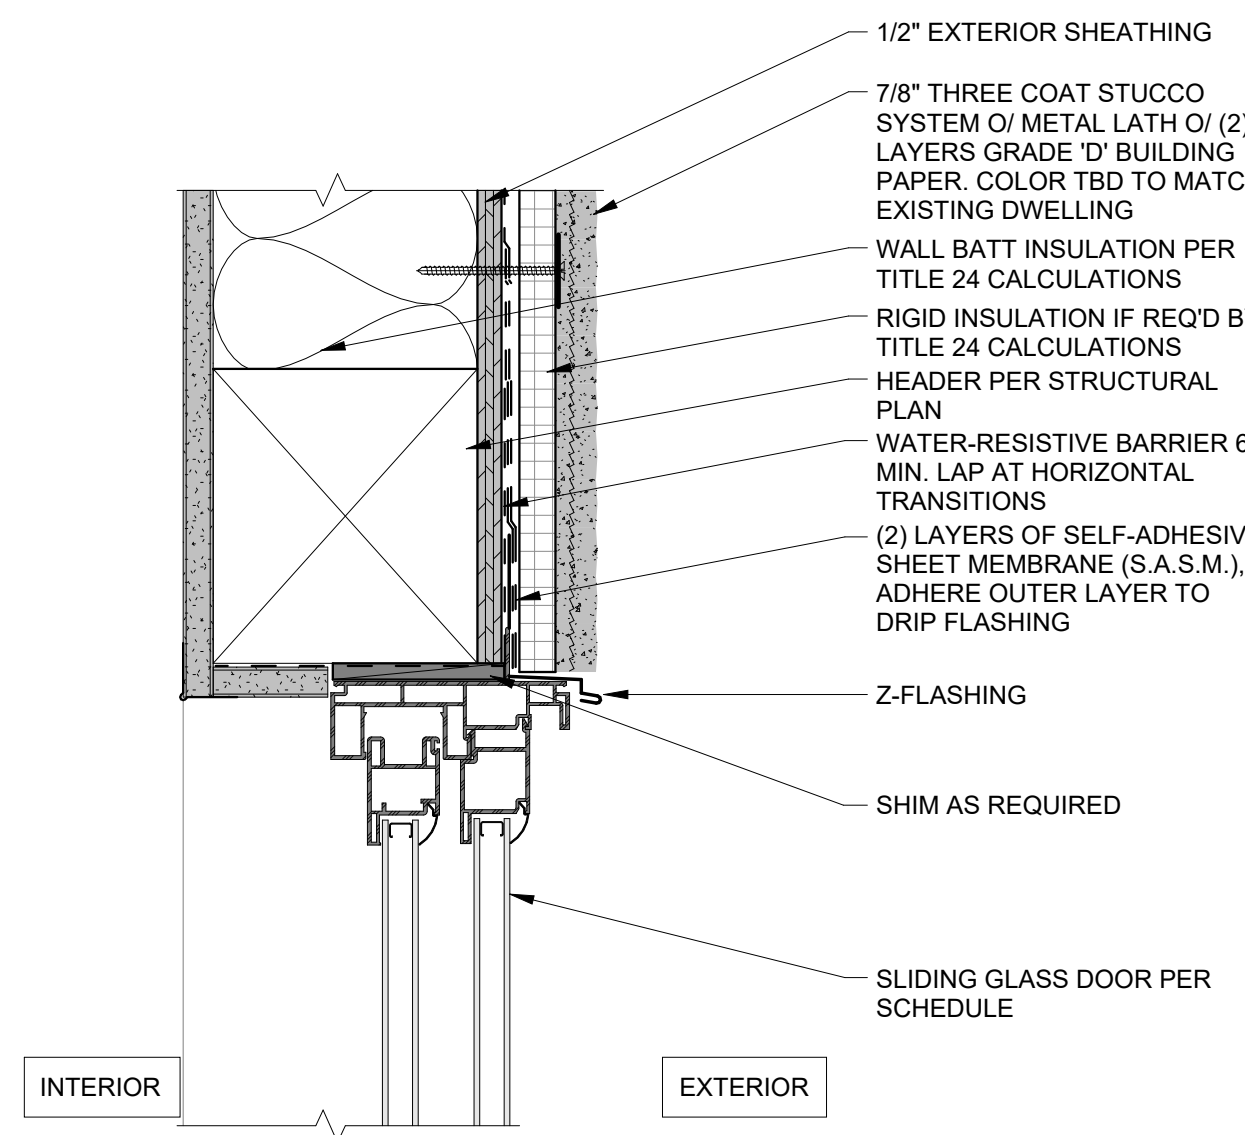


9 DOOR - SLIDING GLASS DOOR HEAD @ STUCCO
W/ CONT. INSULATION (JAMB SIM.)

SCALE: 3" = 1'-0"

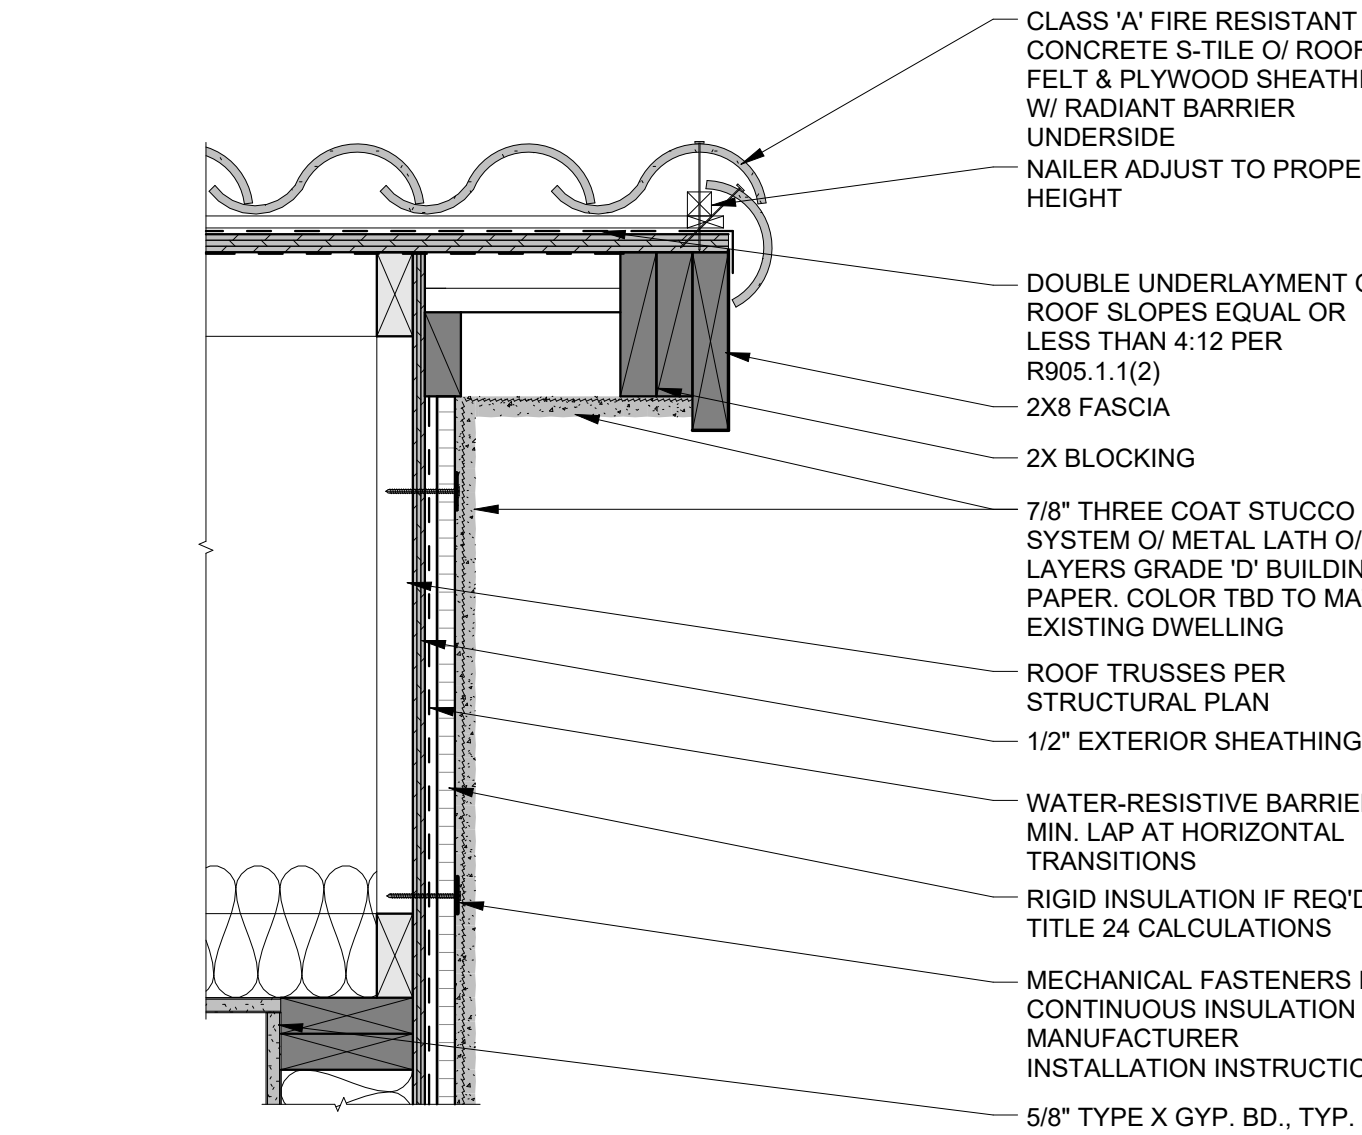

6 A3 - ROOF RAKE - S-TILE PROTECTED
W/ CONT. INSULATION AND STUCCO

SCALE: 1 1/2" = 1'-0"

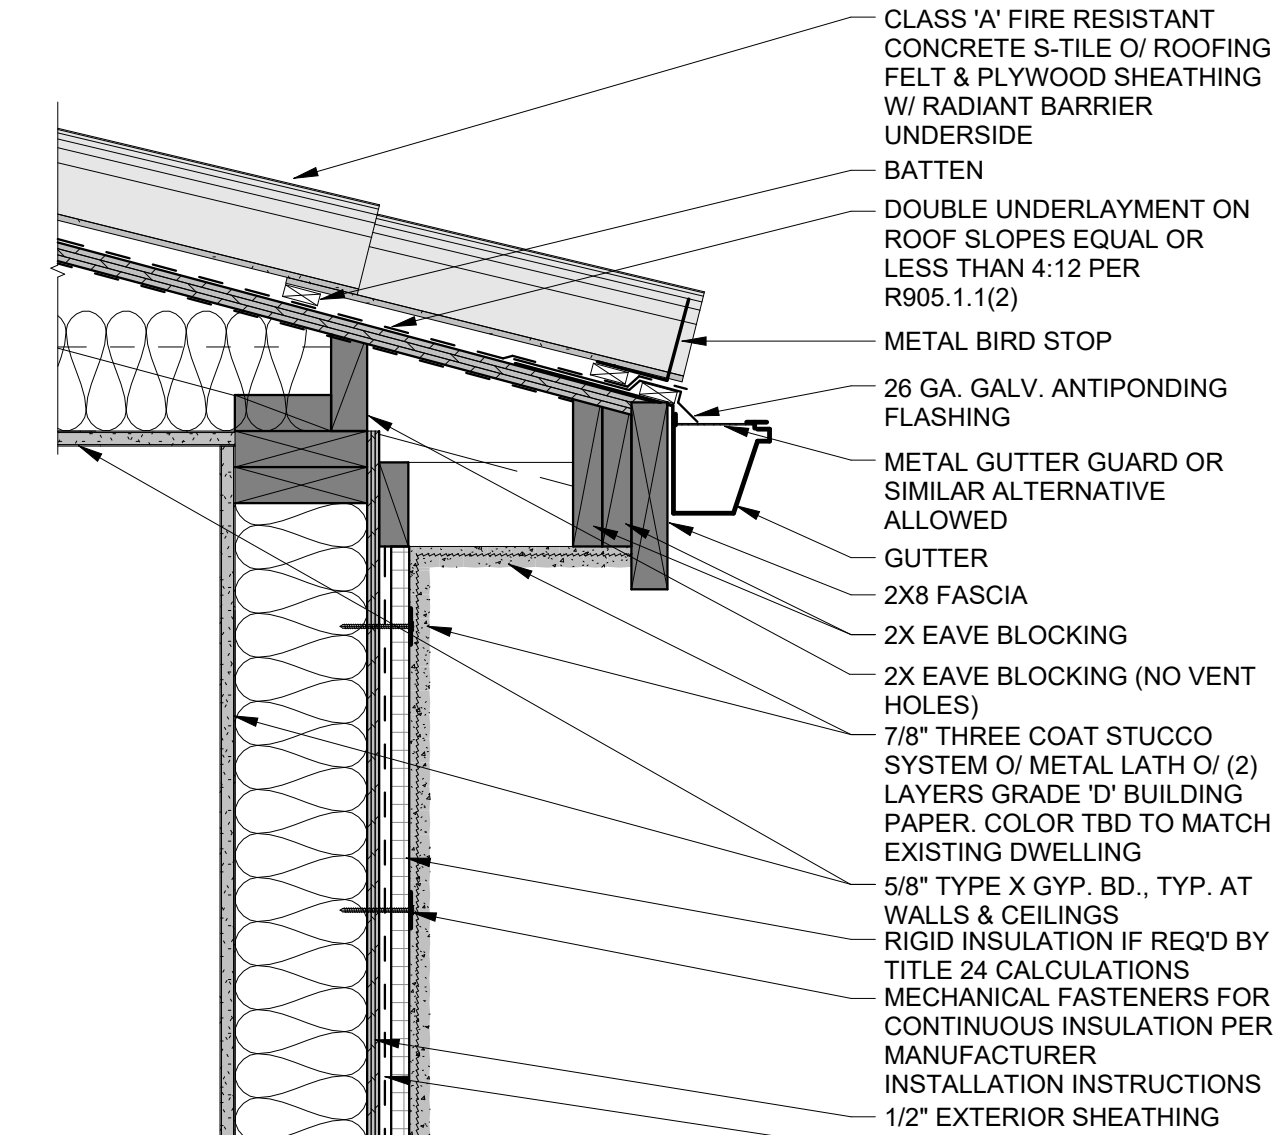

3 A3 - ROOF EAVE - S-TILE PROTECTED
W/ CONT. INSULATION AND STUCCO

SCALE: 1 1/2" = 1'-0"



SNAPADU
DESIGN/BUILD

YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 999 L-SHAPE

CITY OF CHULA VISTA
276 FOURTH AVENUE,
CHULA VISTA, CA 91910

DESIGNER:

LUIS CALDERON
SnapADU

Luis Calderon
SIGNATURE













RELEASE	DATE	BY	APP.	RELEASED FOR...
	03/22/2024		LAG	

STUCCO DETAILS

A510

22040

3/24/2024 11:39:22 AM
Autodesk Docs://22040_City of Chula Vista/22040_City of Chula Vista_999
L-Shape_V2_CD_RVT22.rvt

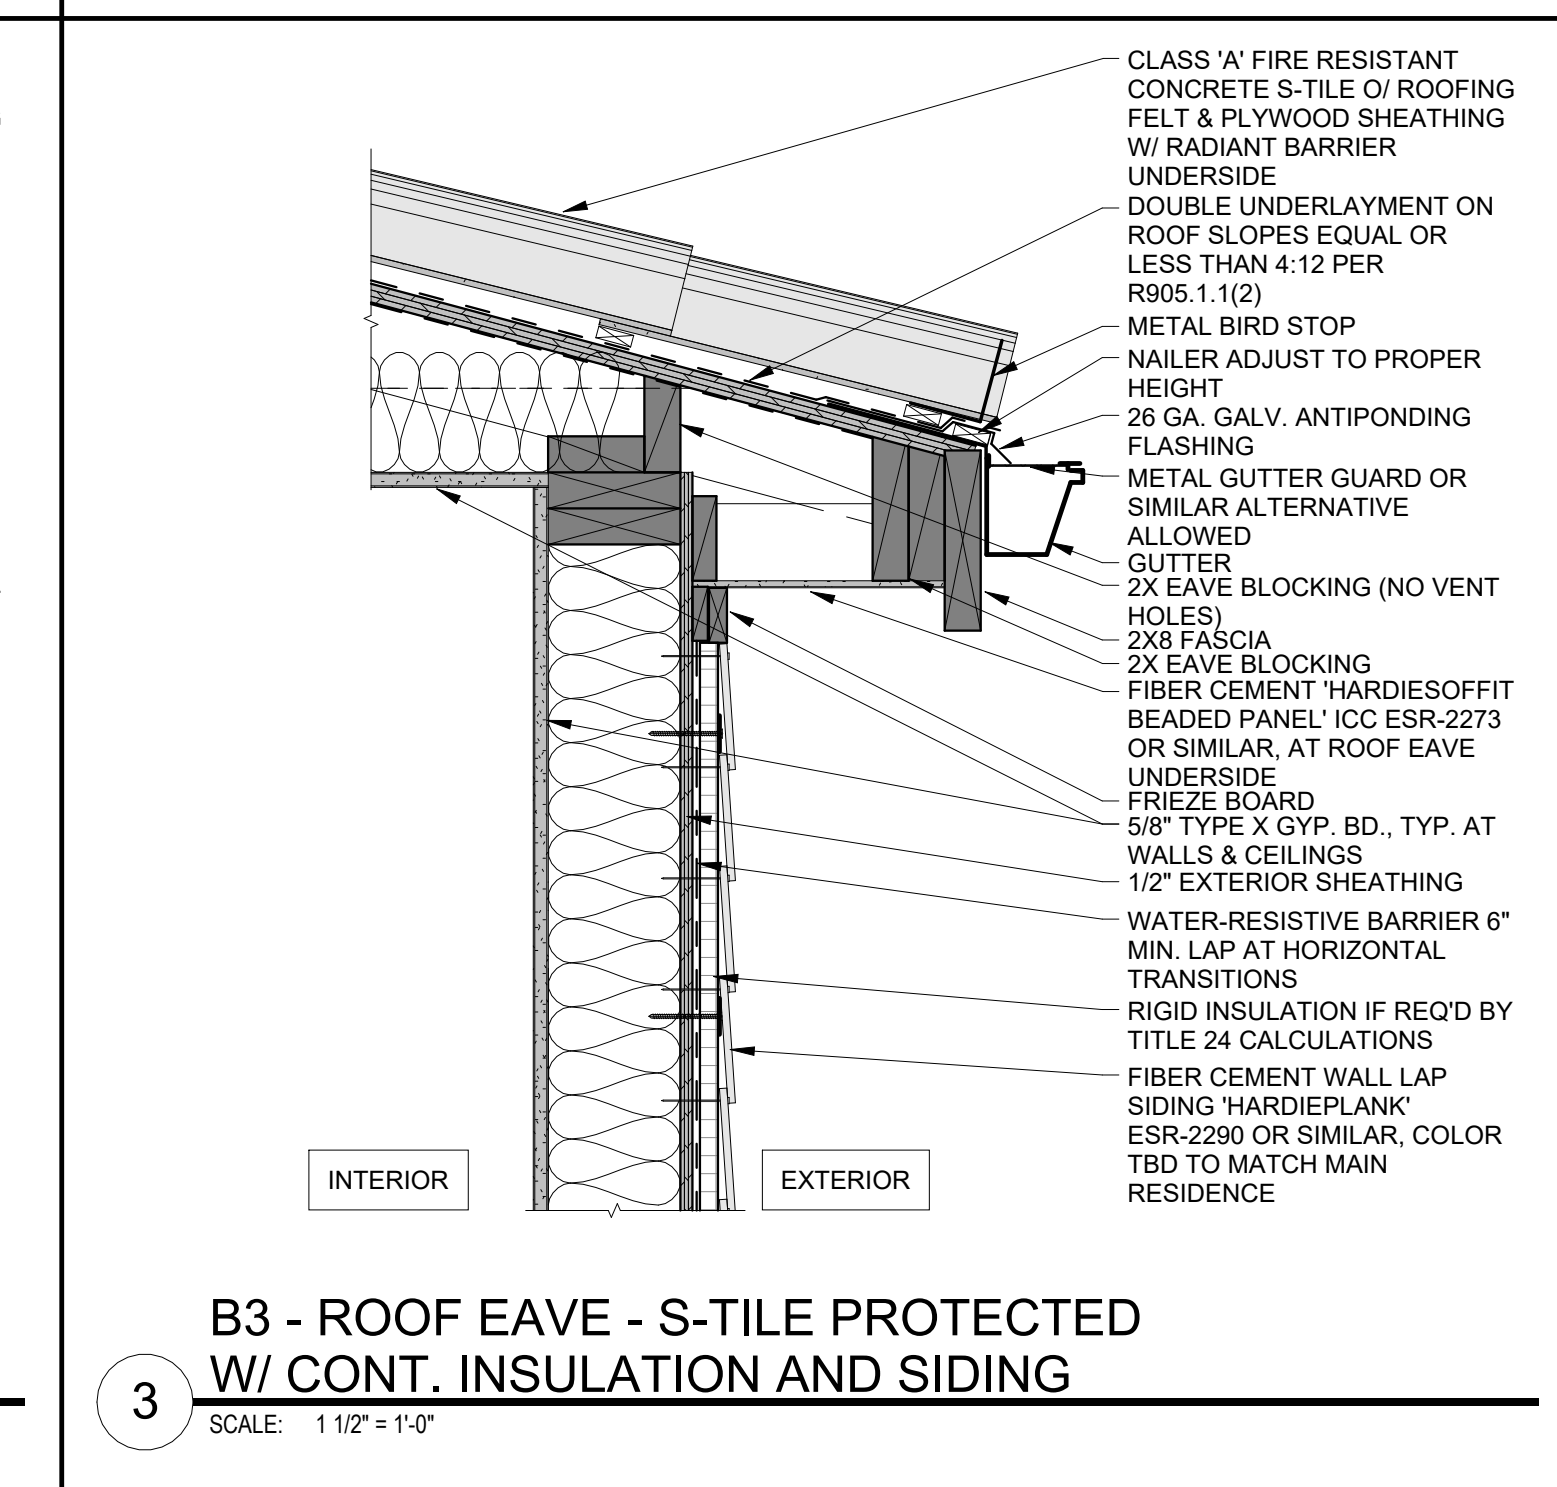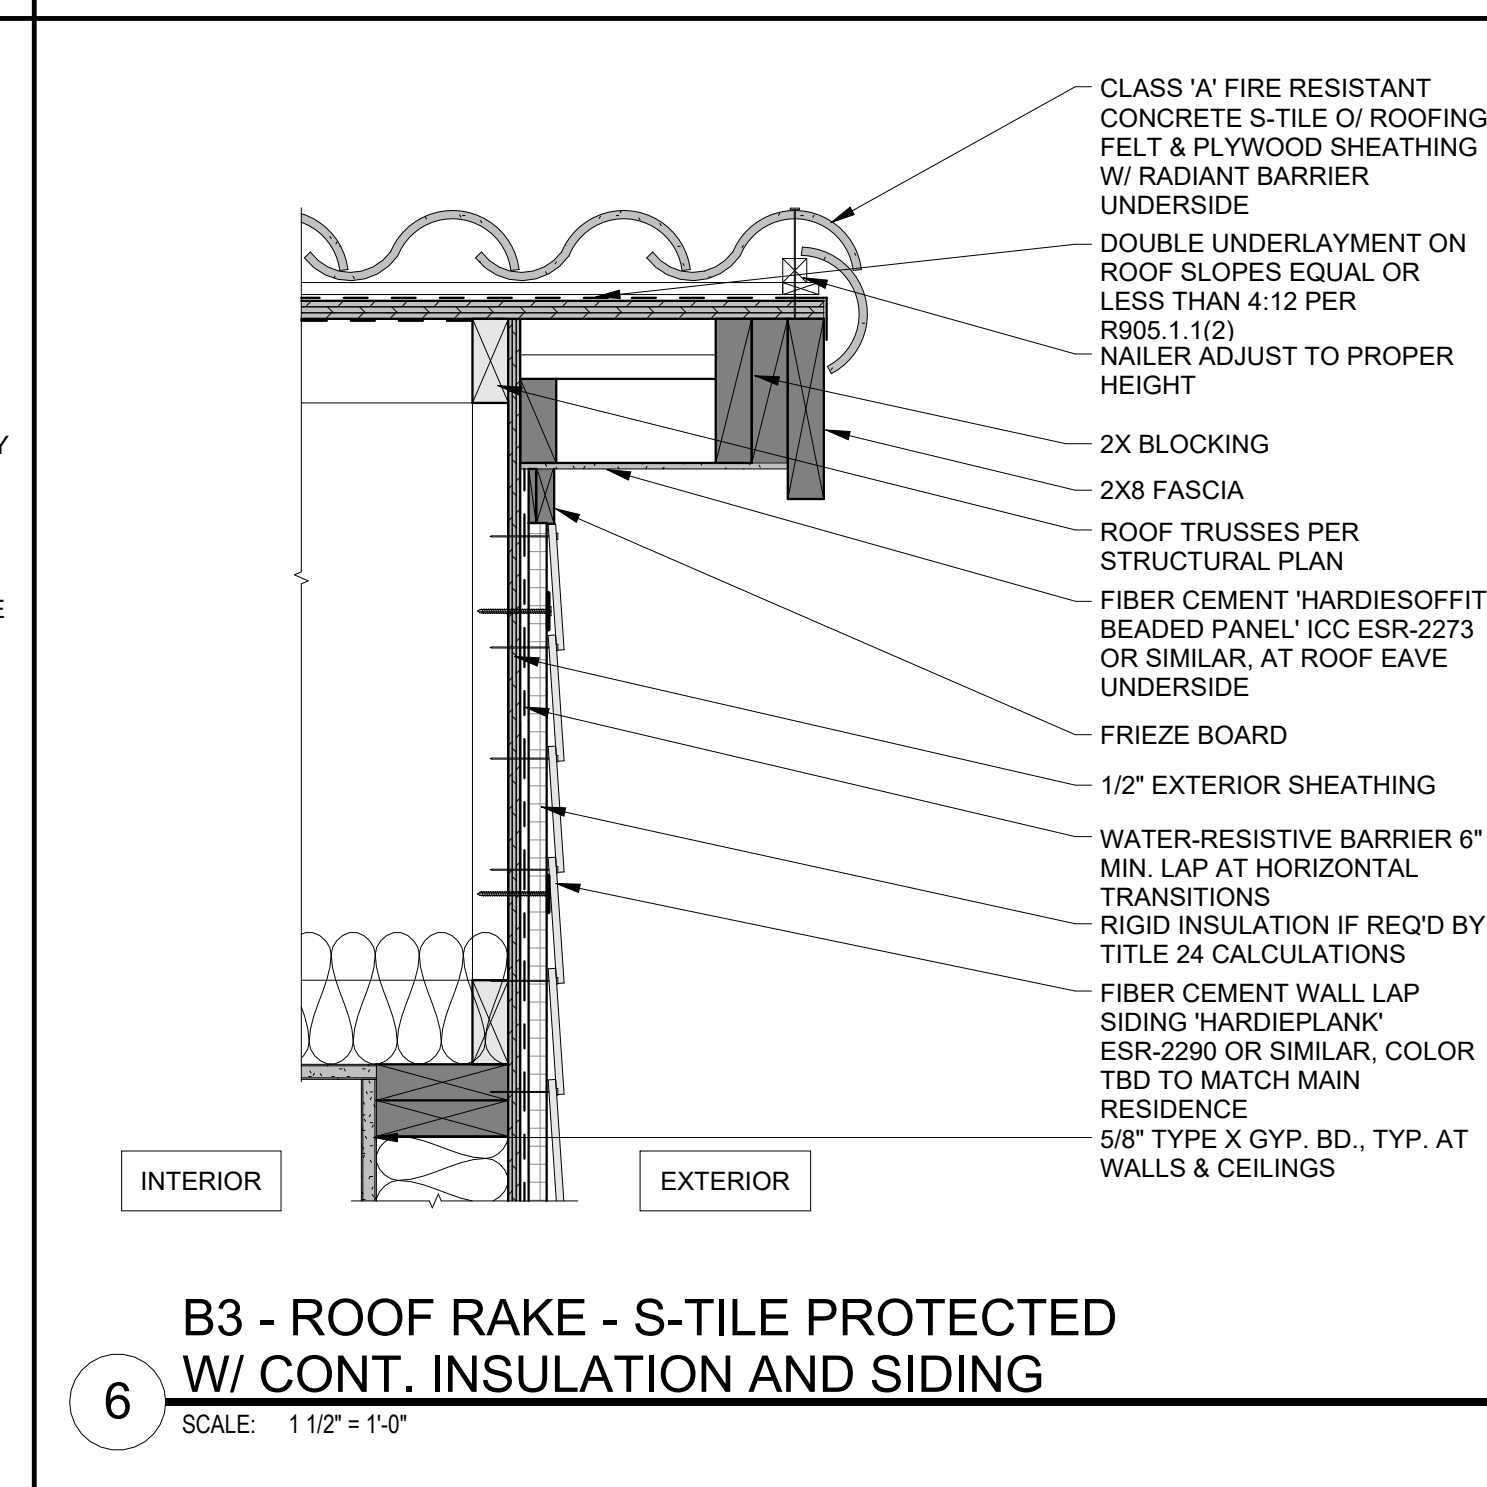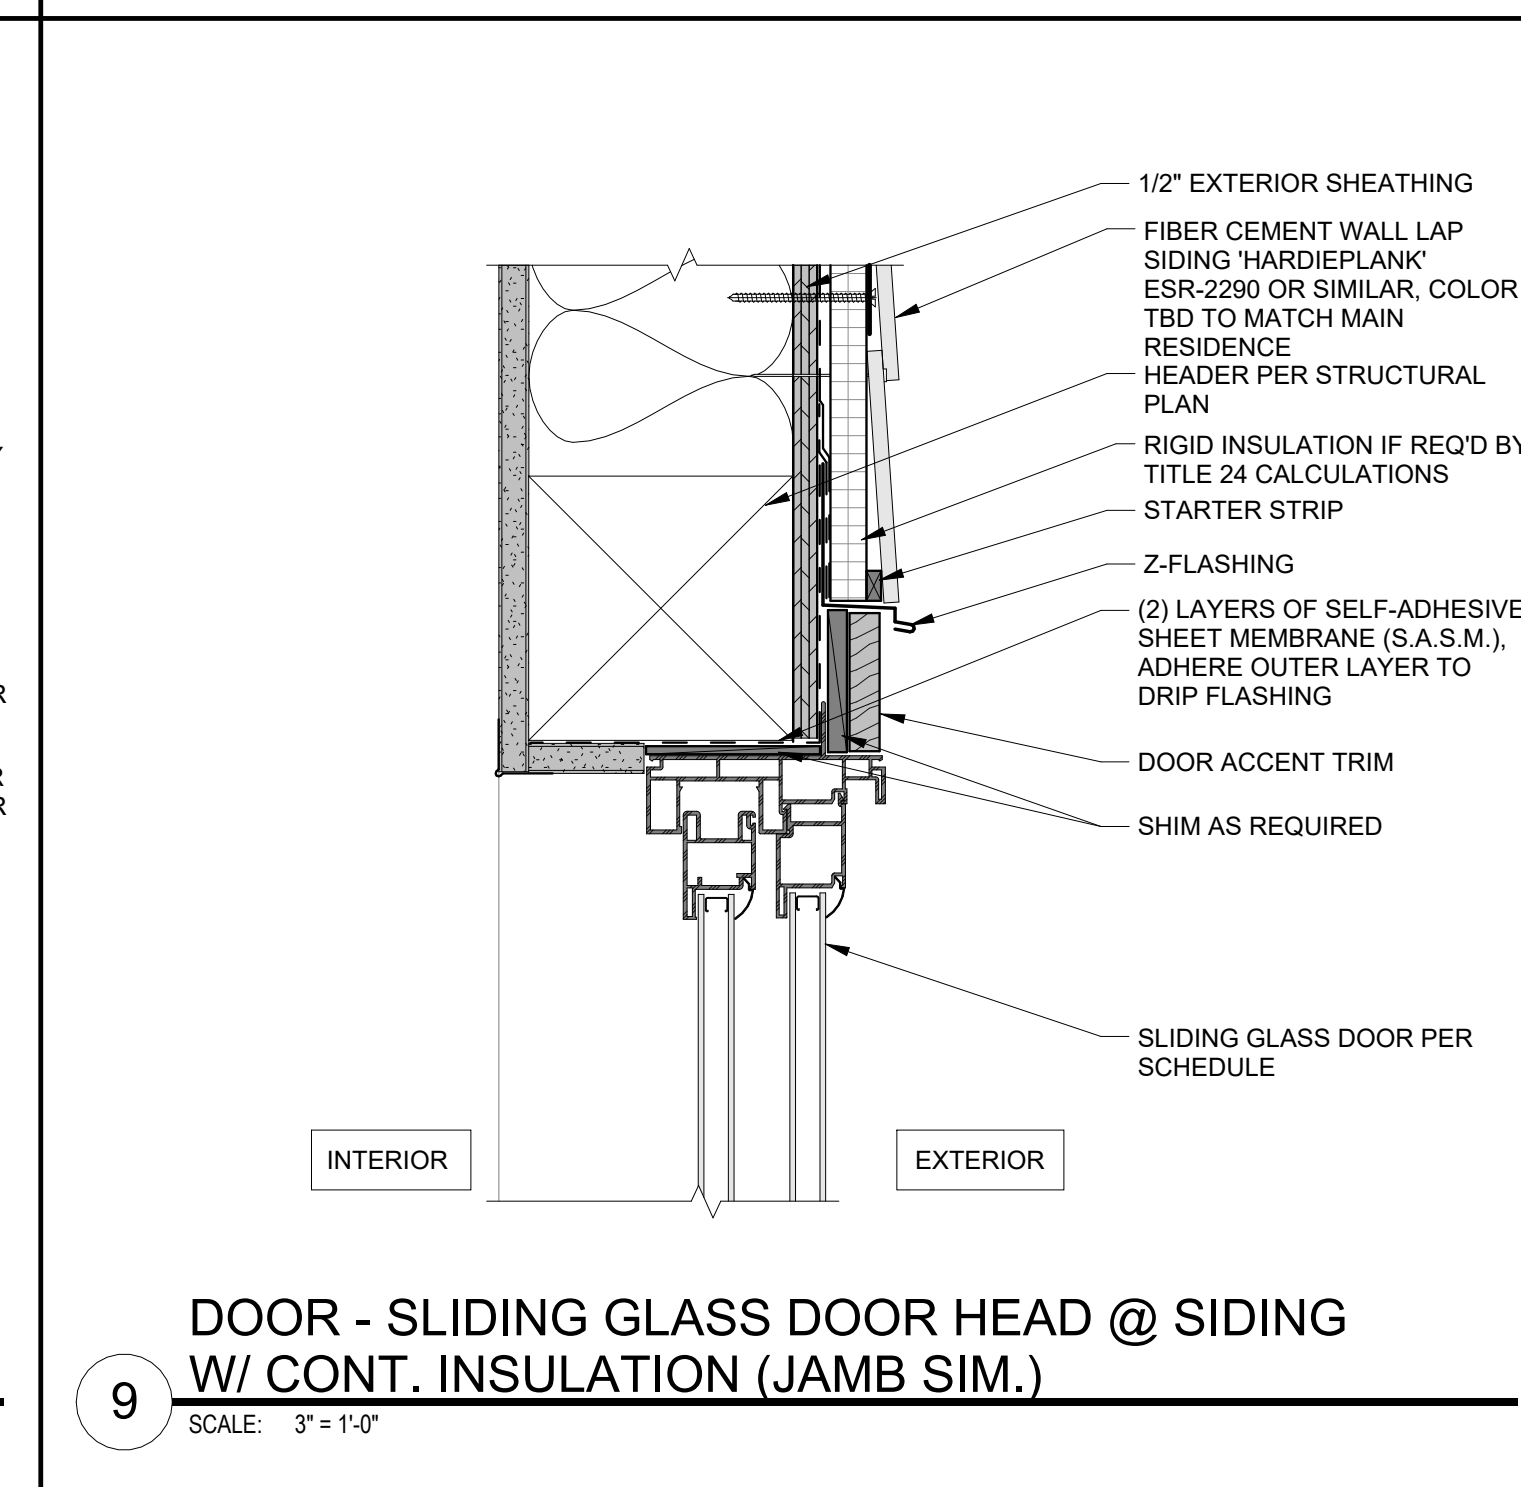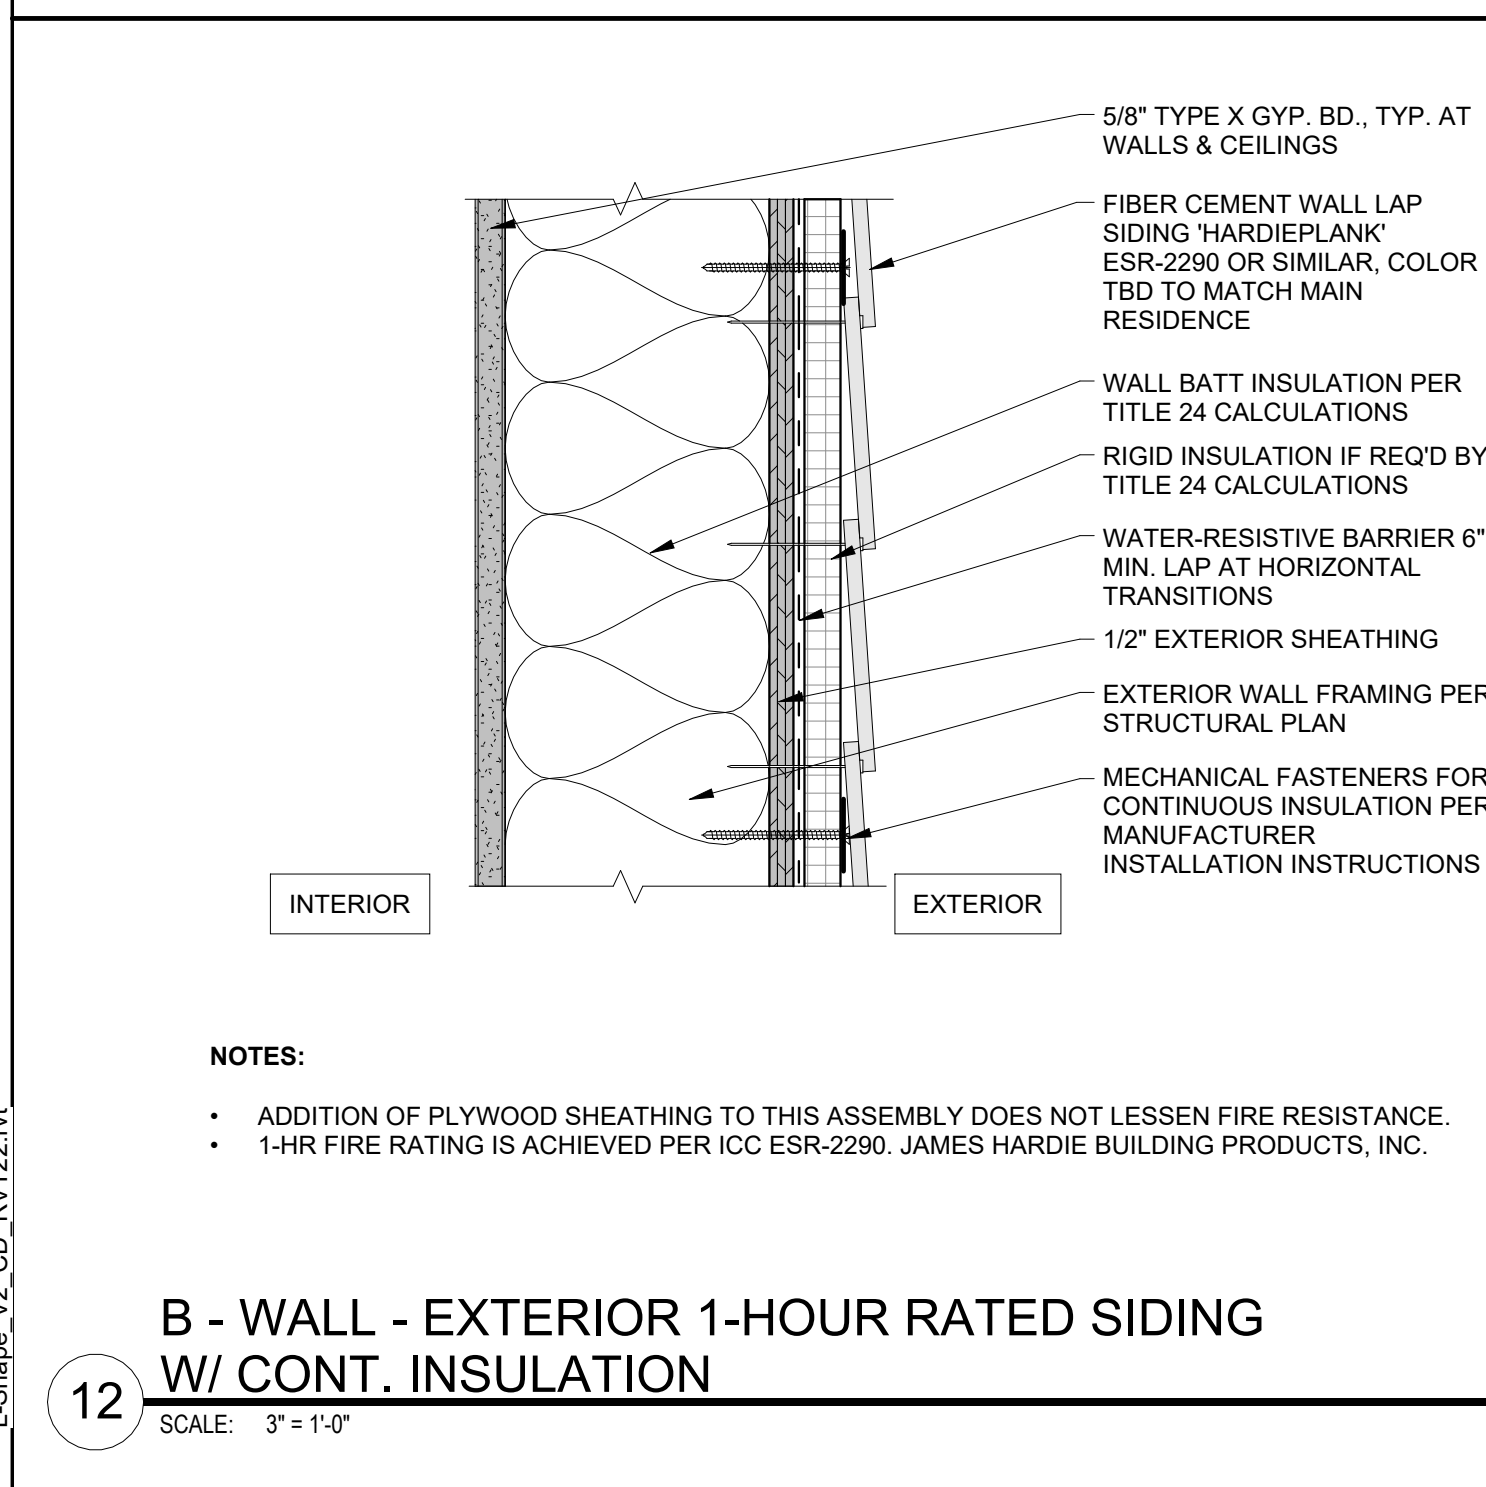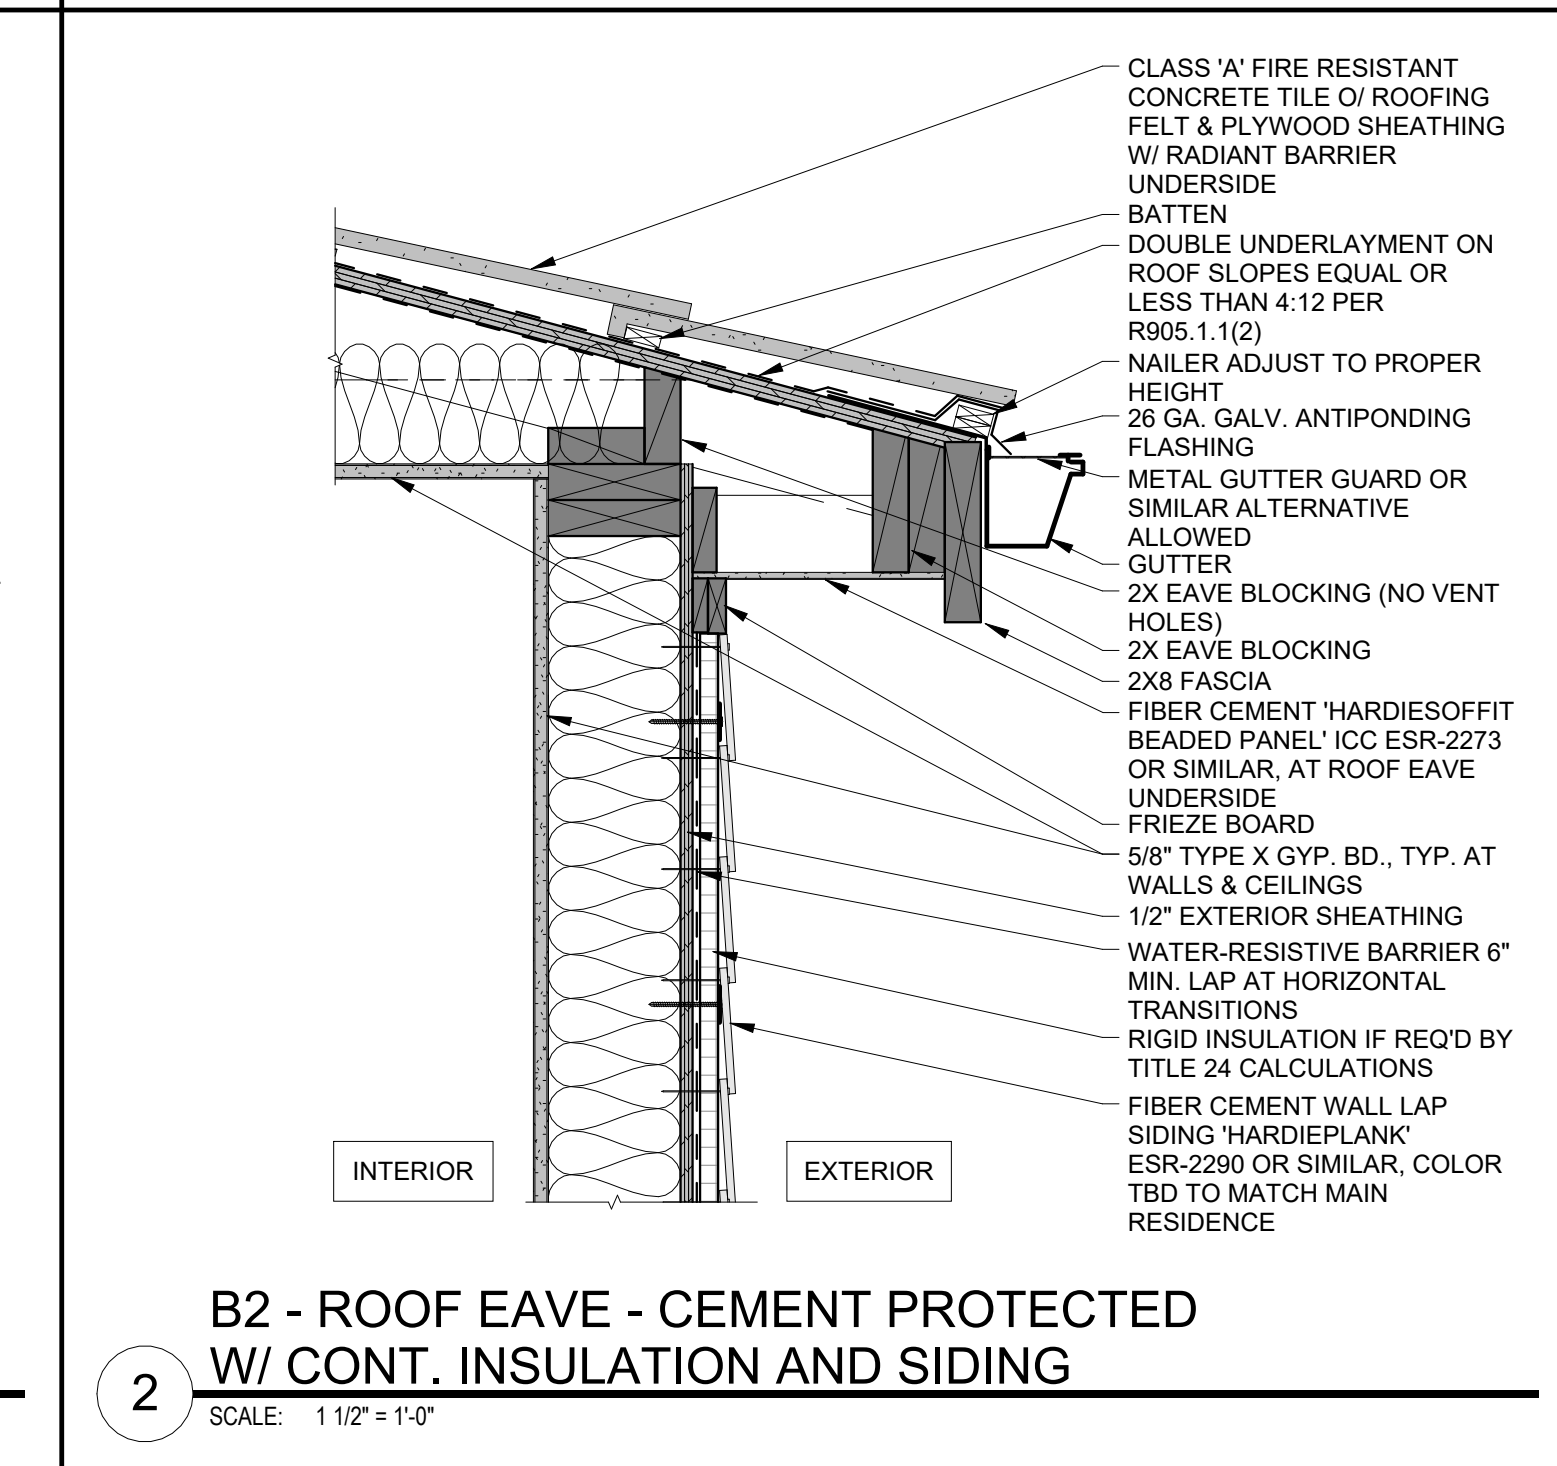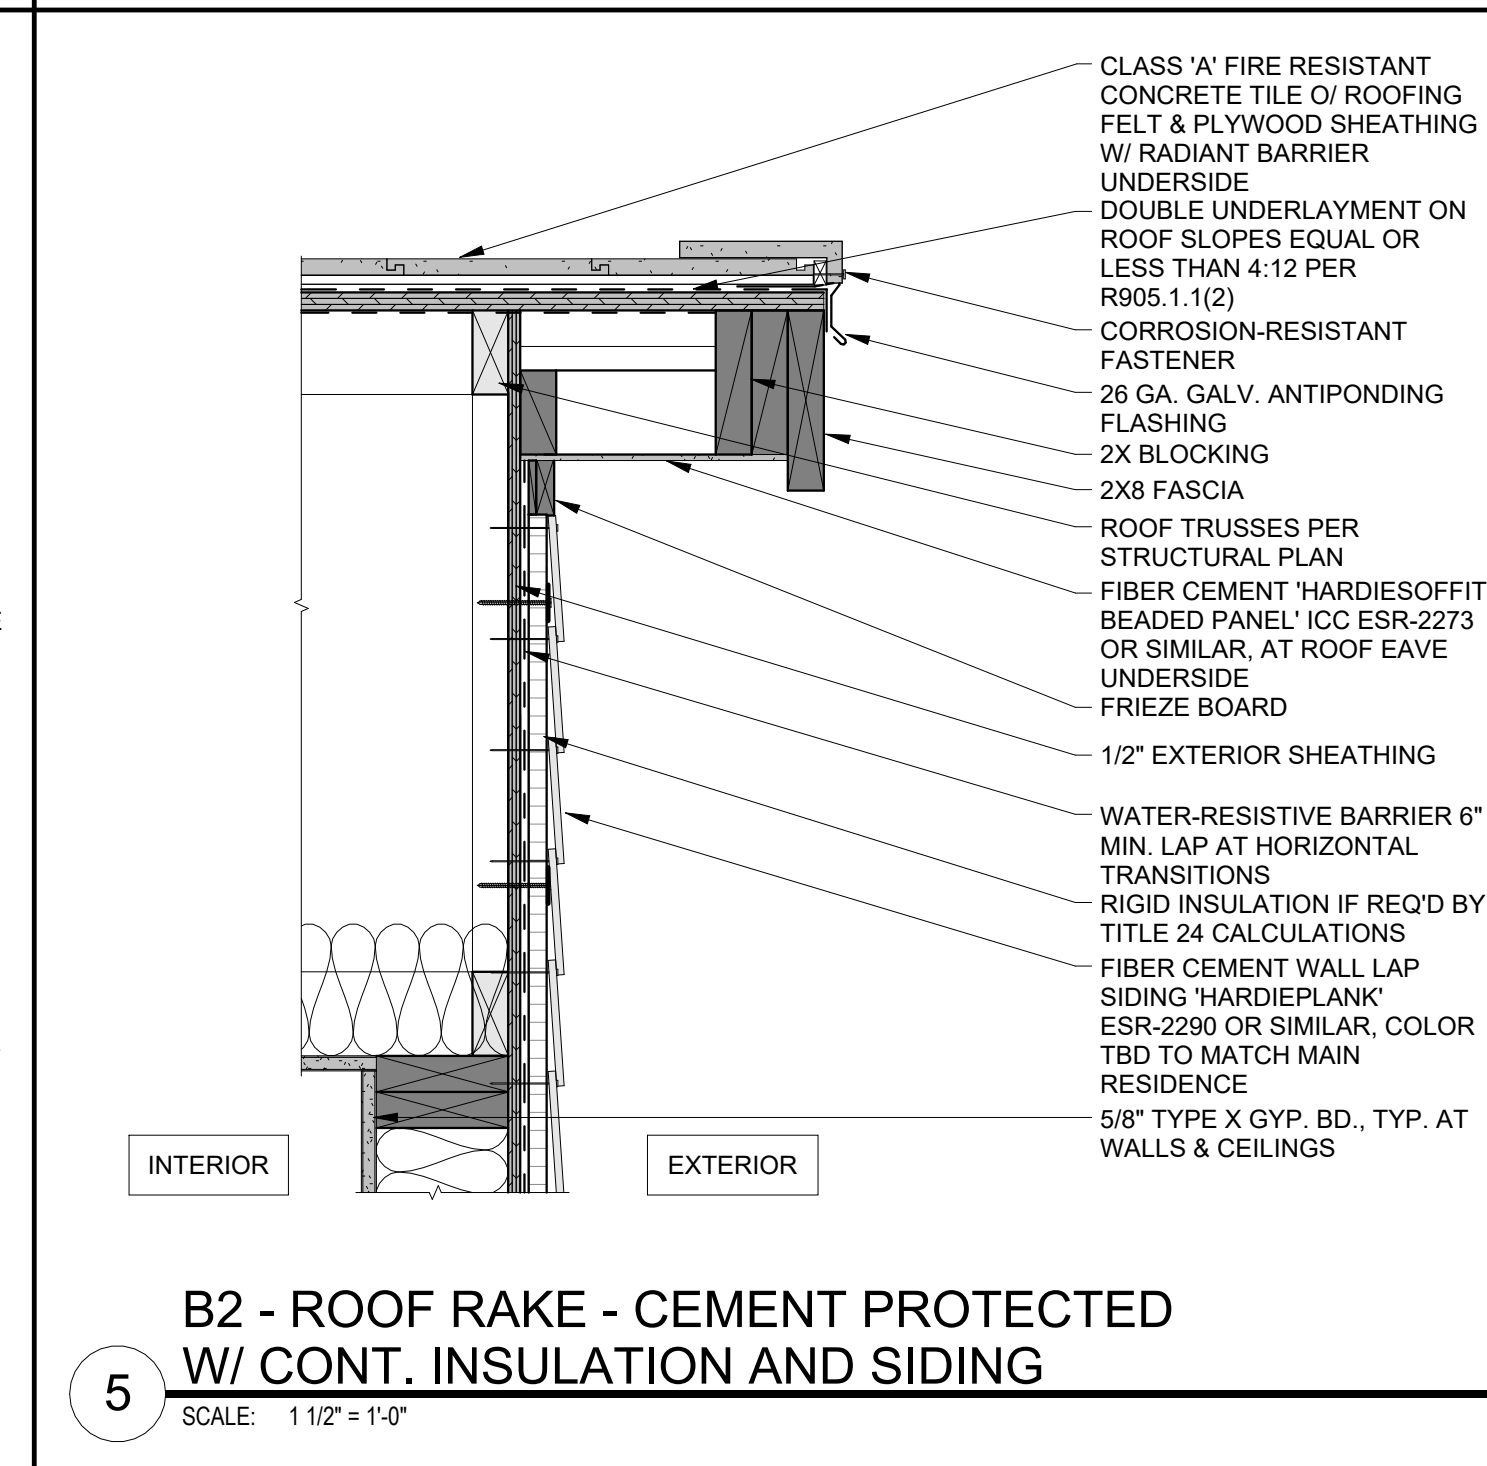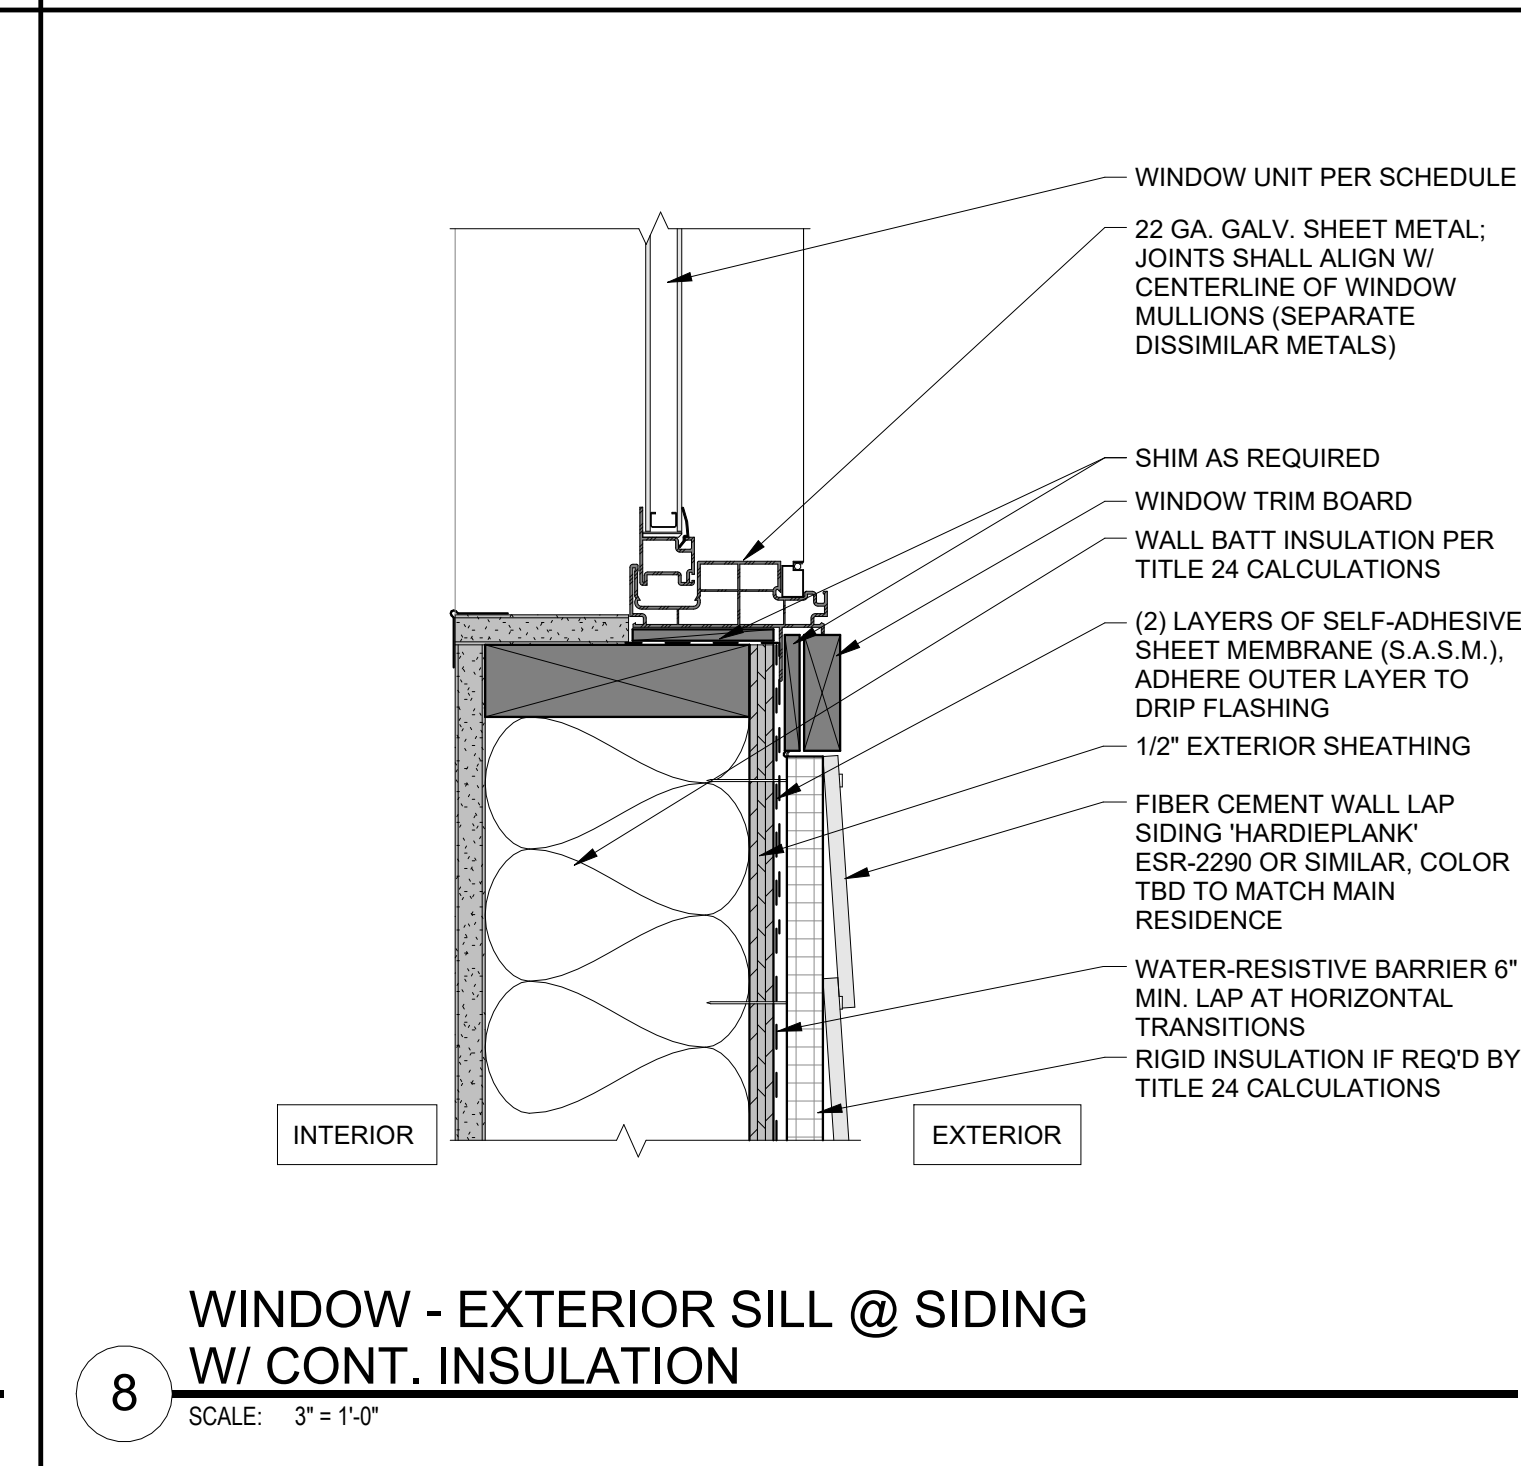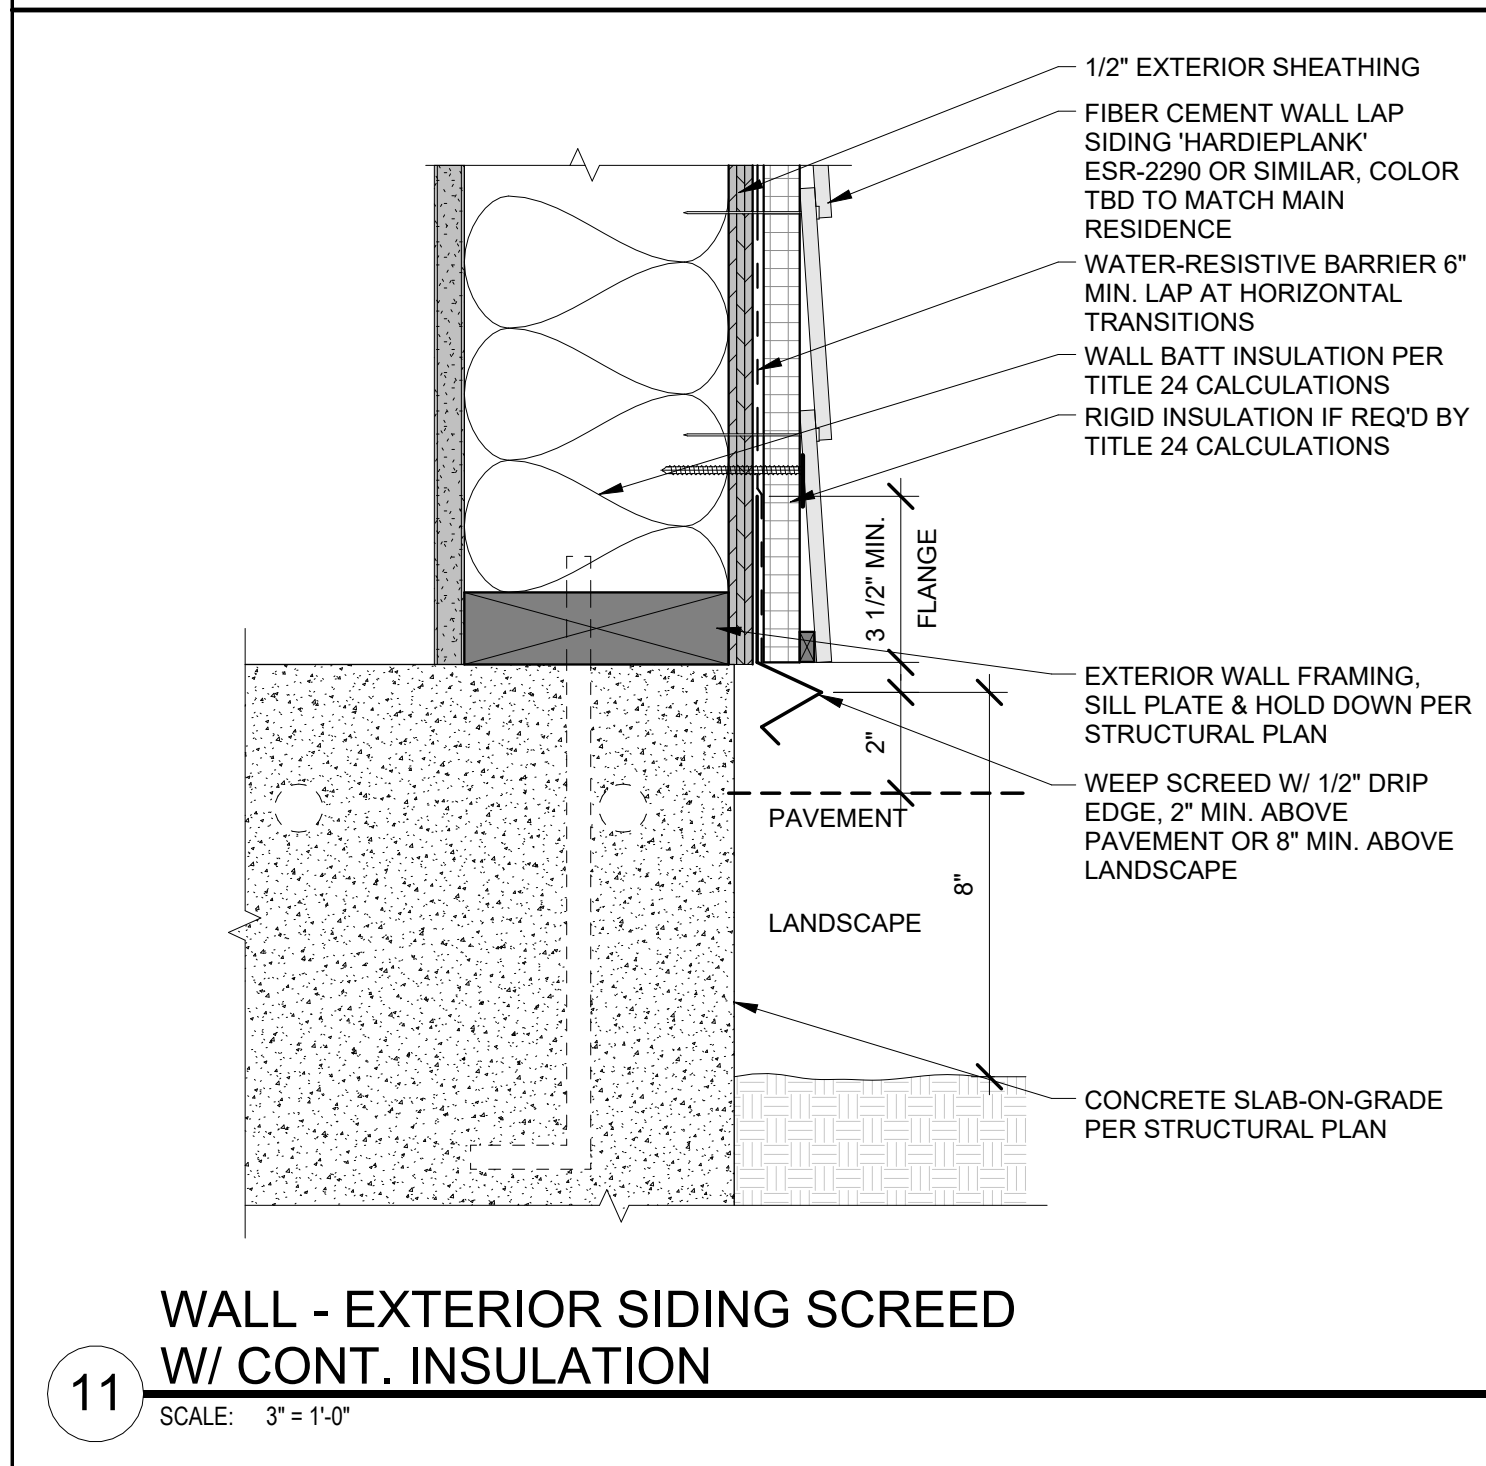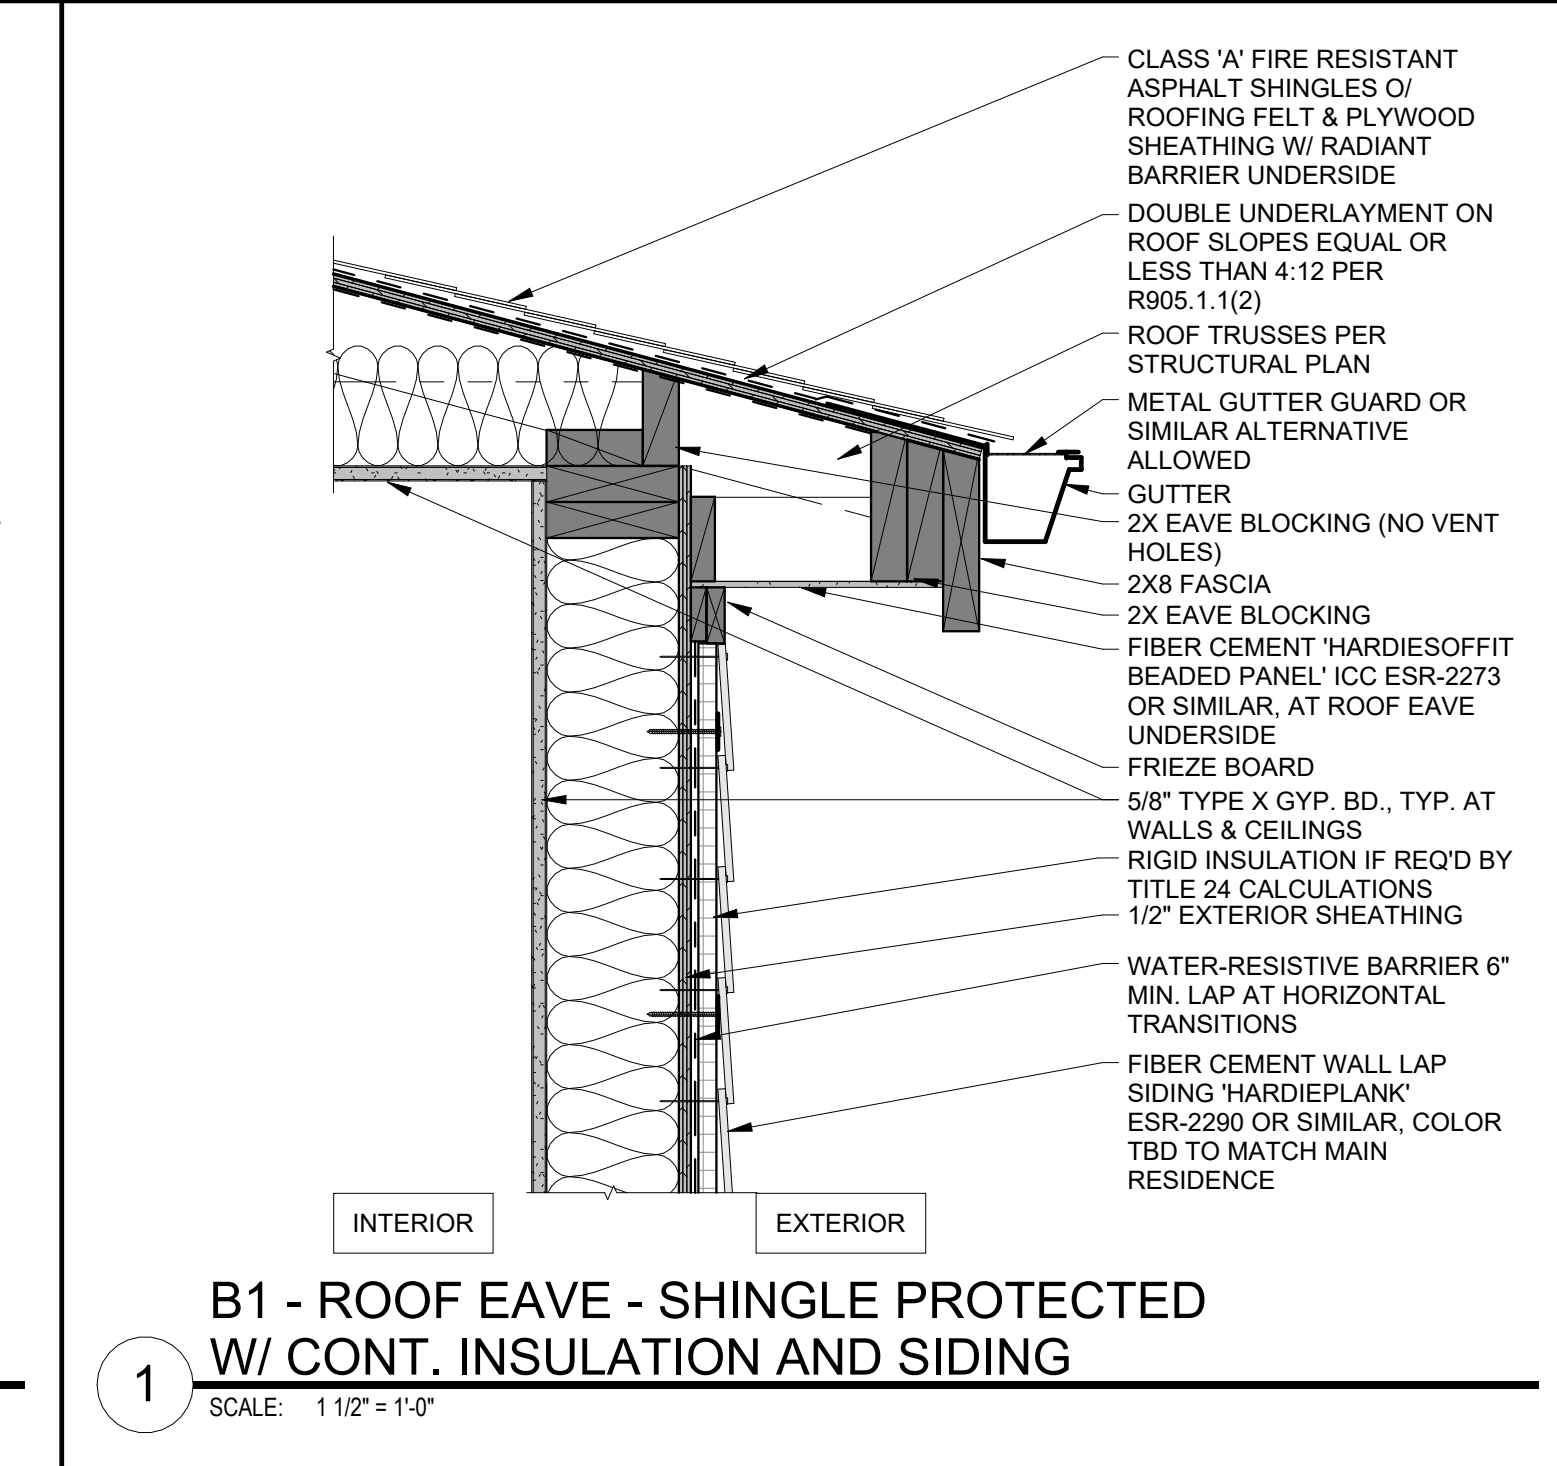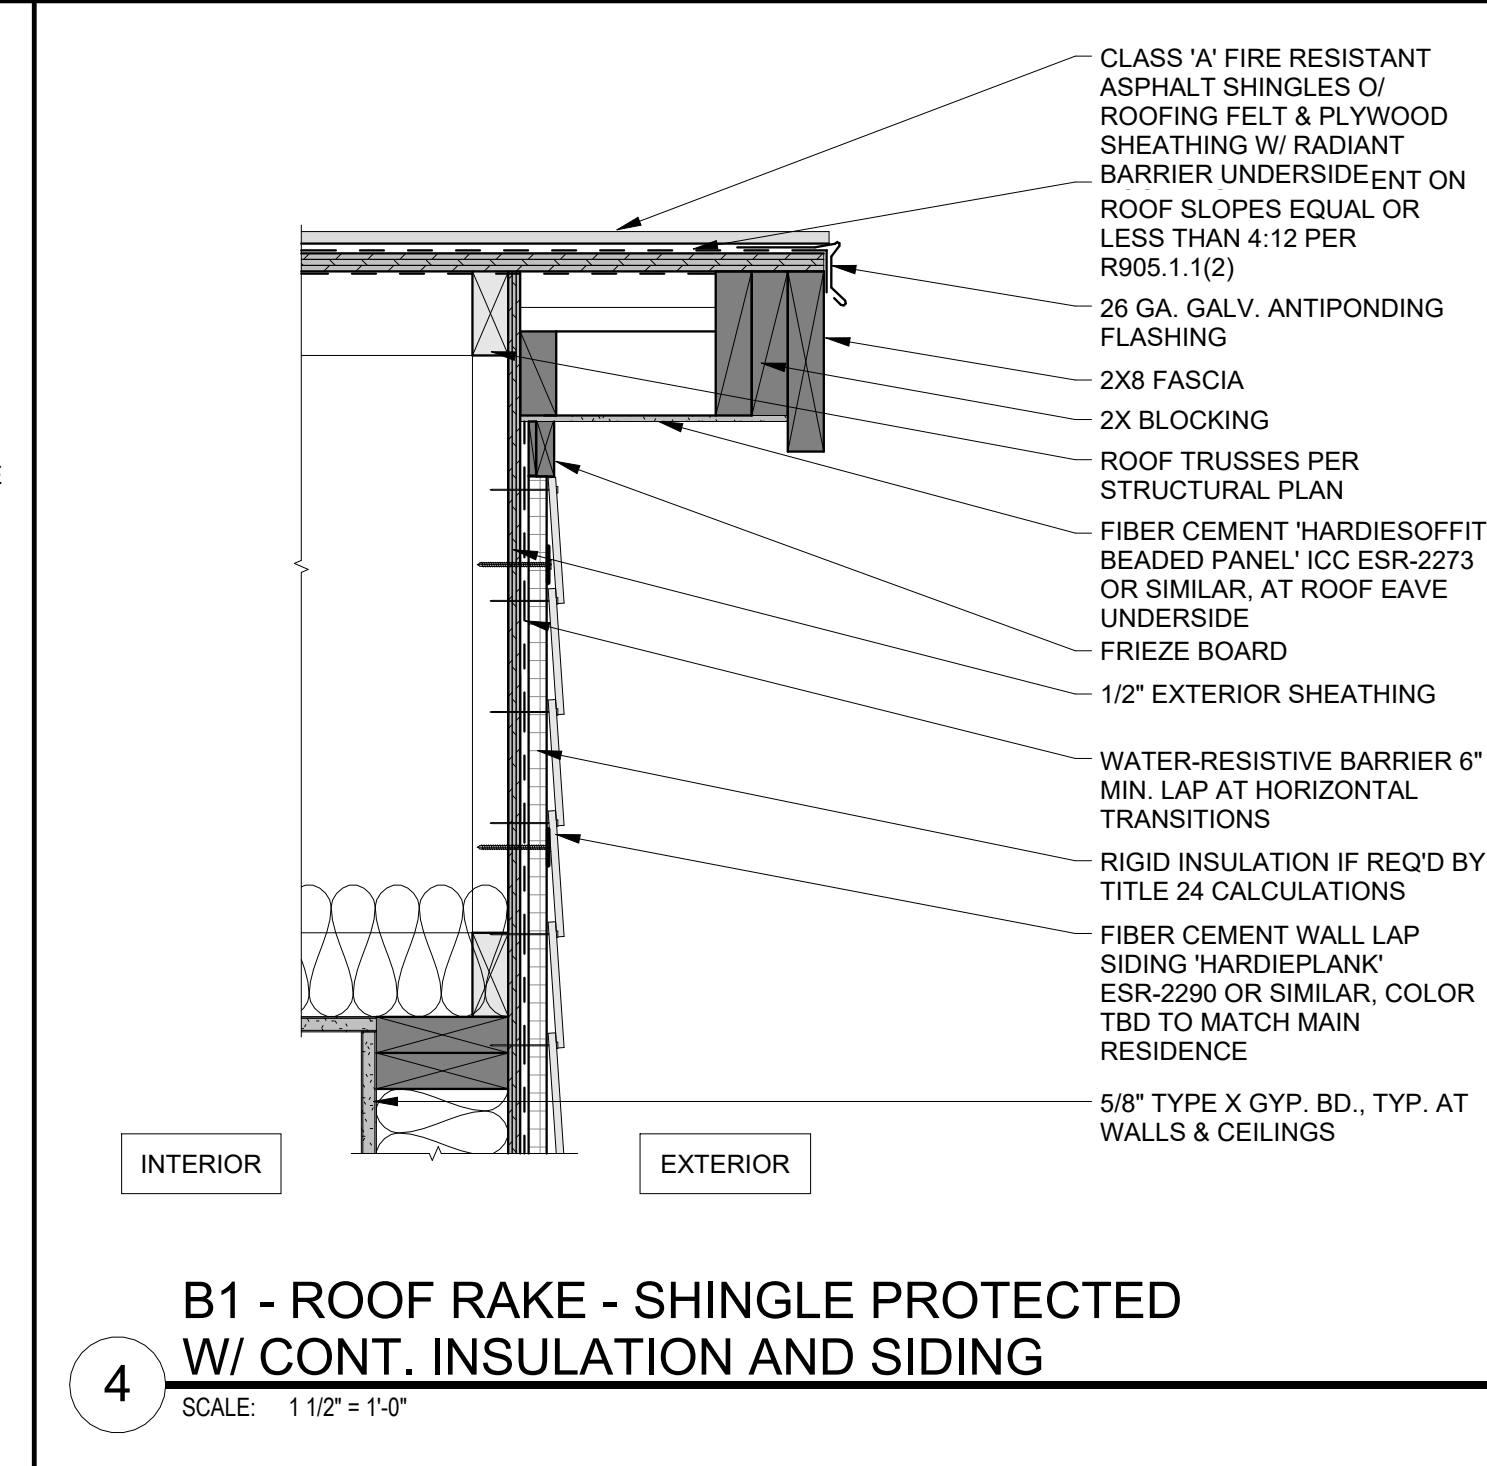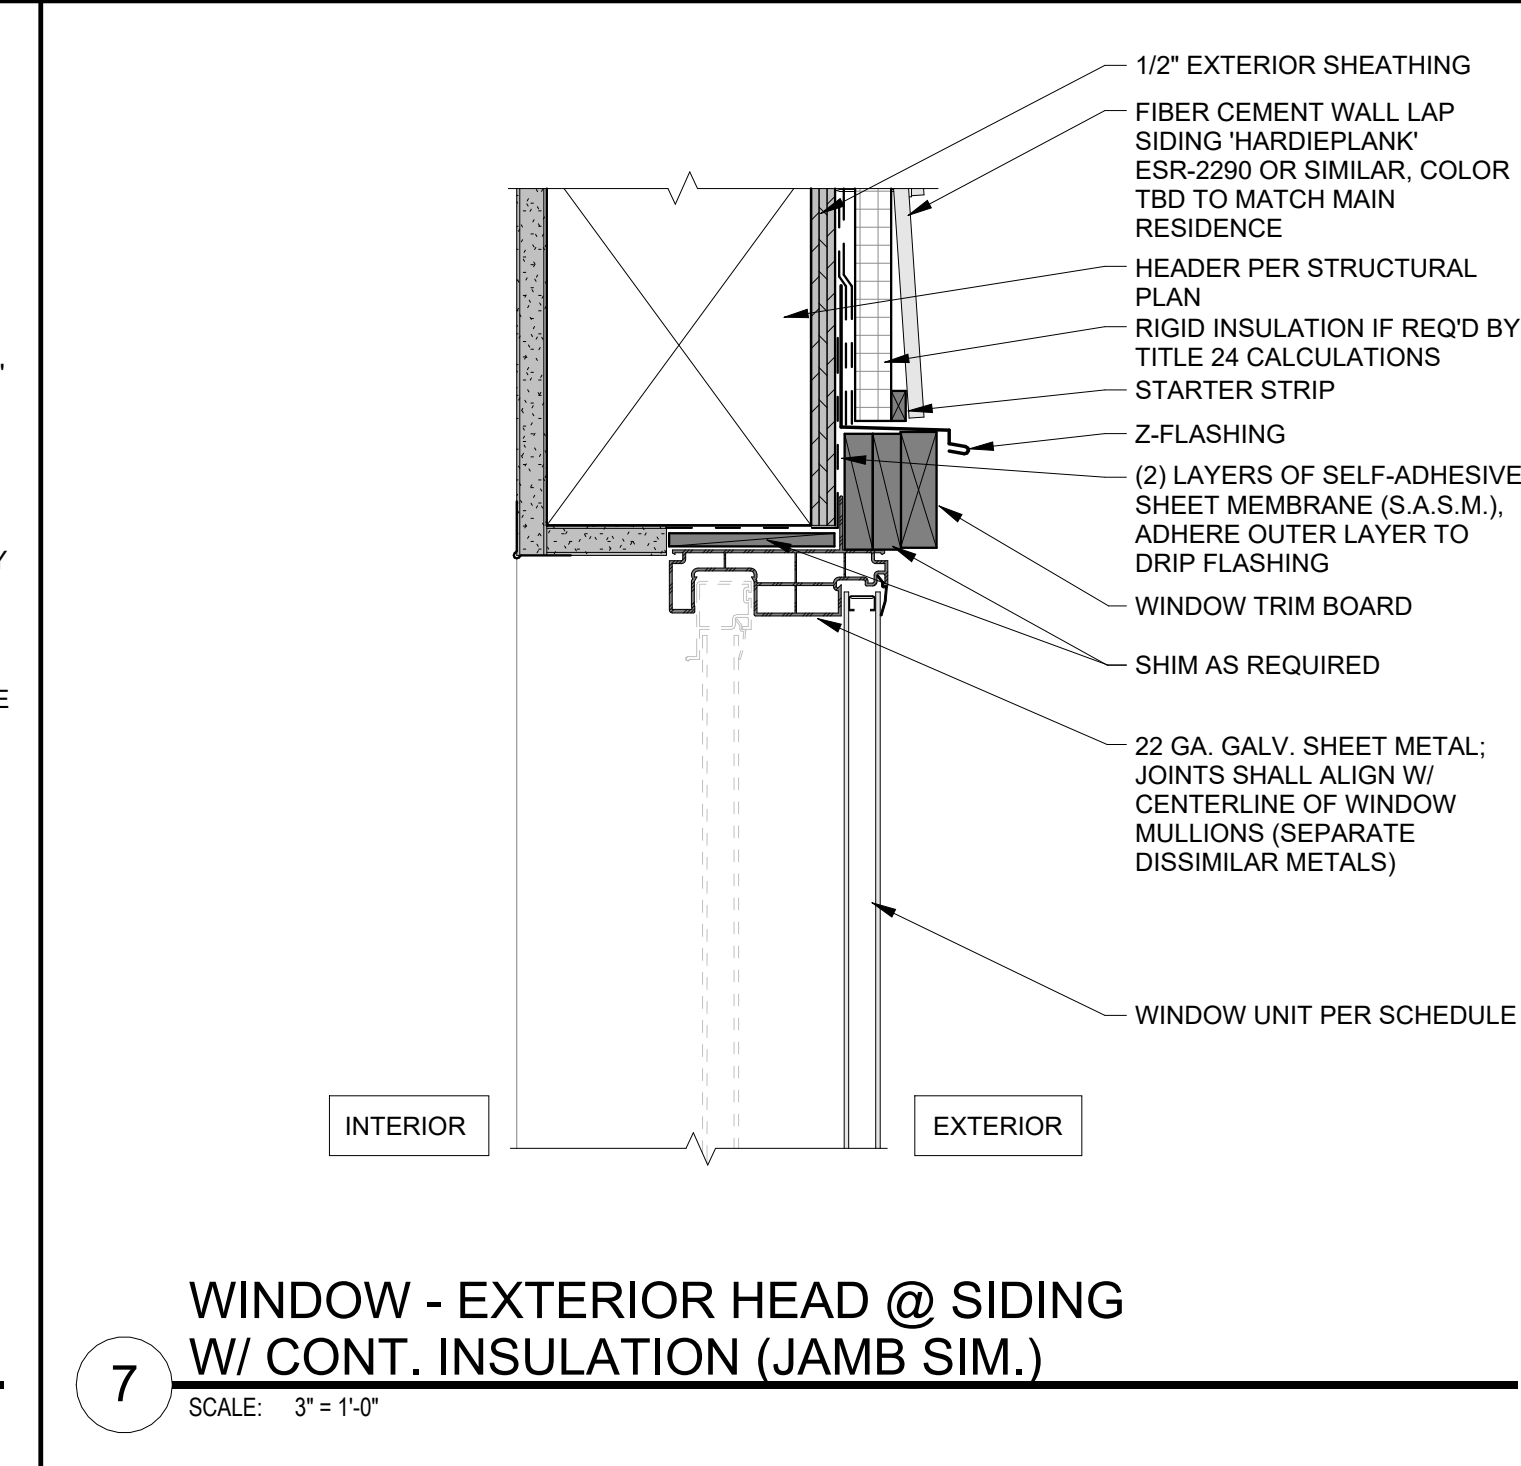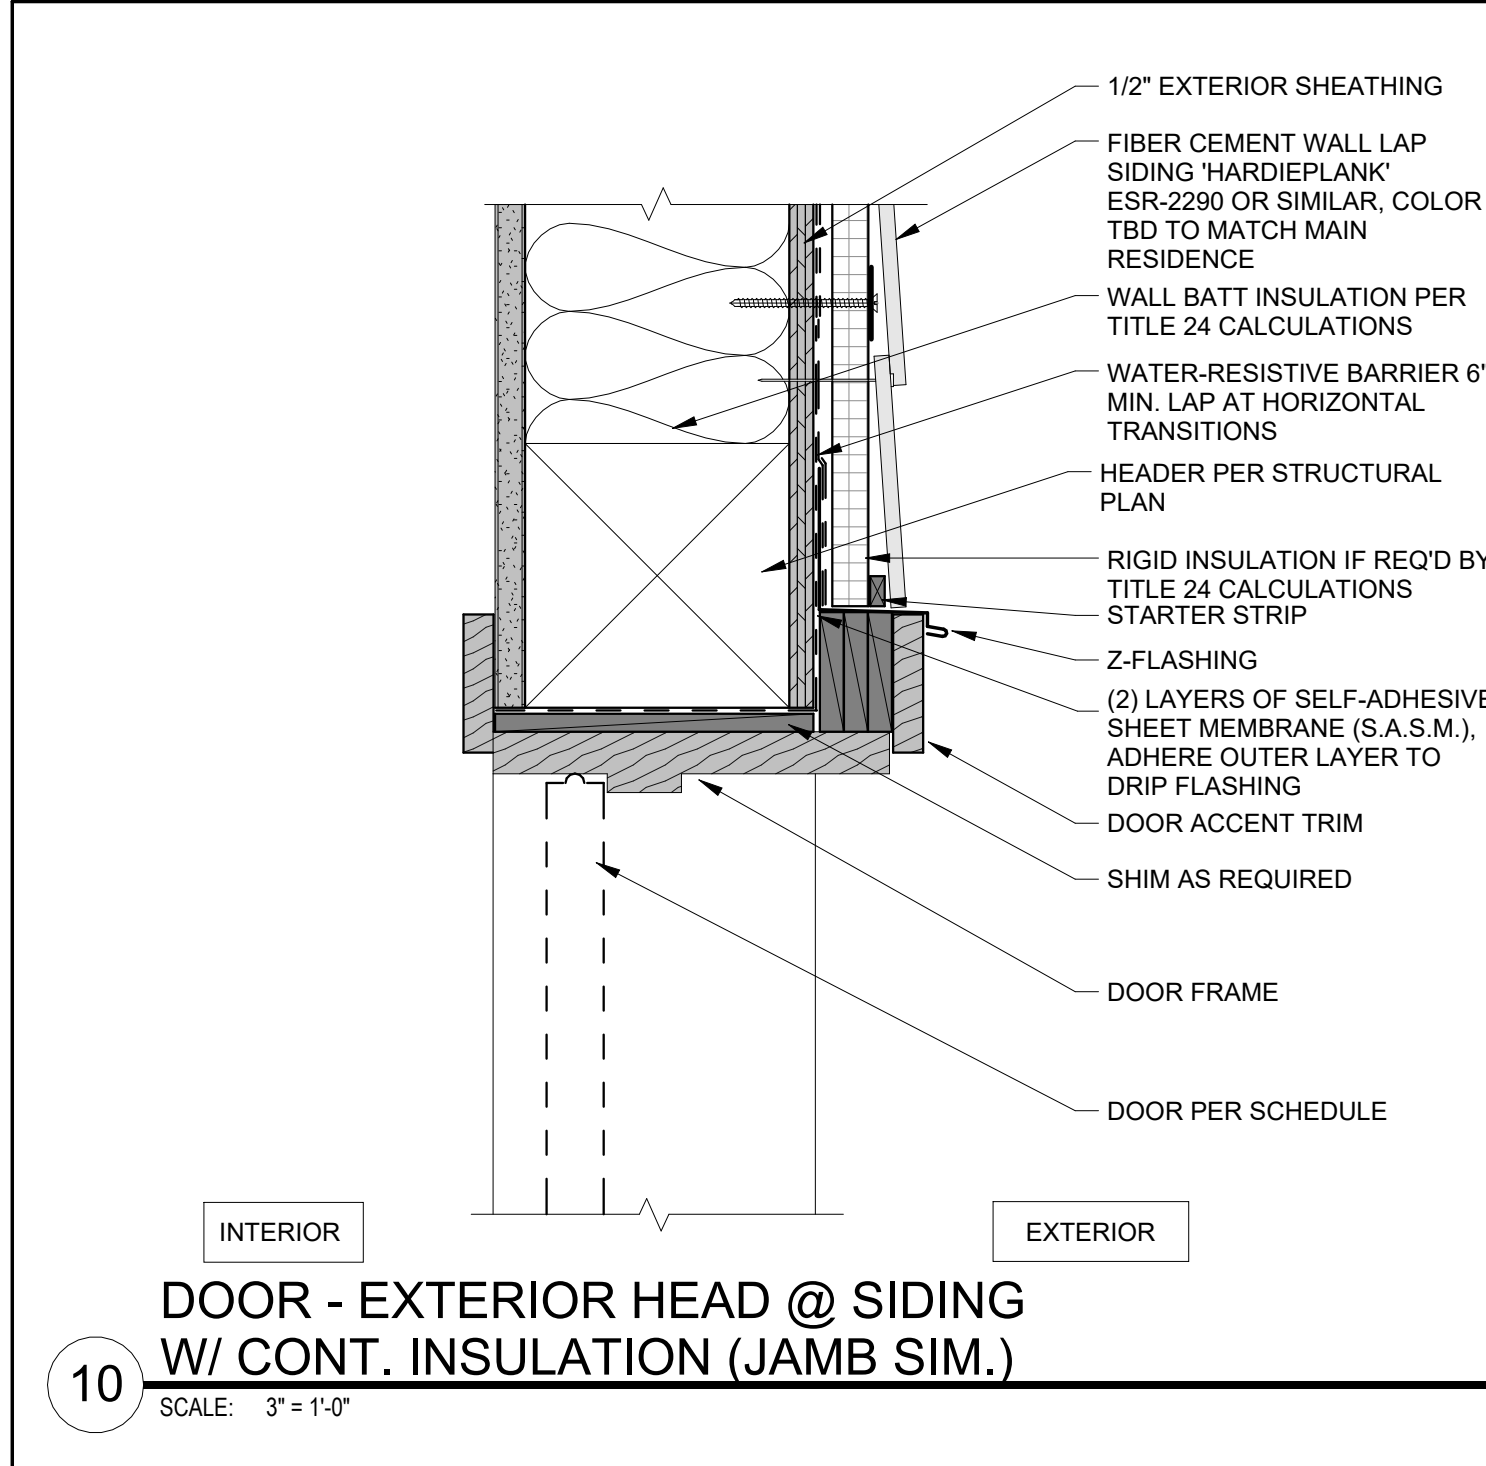

S

SNAPADU
DESIGN/BUILD

YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 999 L-SHAPE
CITY OF CHULA VISTA
276 FOURTH AVENUE,
CHULA VISTA, CA 91910

DESIGNER:
LUIS CALDERON
SnapADU


Luis Calderon
SIGNATURE

RELEASE	DATE	BY	APP.	RELEASED FOR...
	03/22/2024		LAG	

LAP SIDING
DETAILS

A520

22040


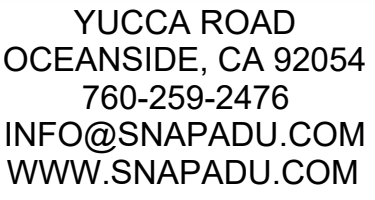


CITY OF CHULA VISTA
276 FOURTH AVENUE,


SIGNATURE


RELEASE	DATE	BY	ADD	RELEASED FOR
---------	------	----	-----	--------------

22040



C - WALL - EXTERIOR 1-HOUR RATED B&B
W/ CONT. INSULATION



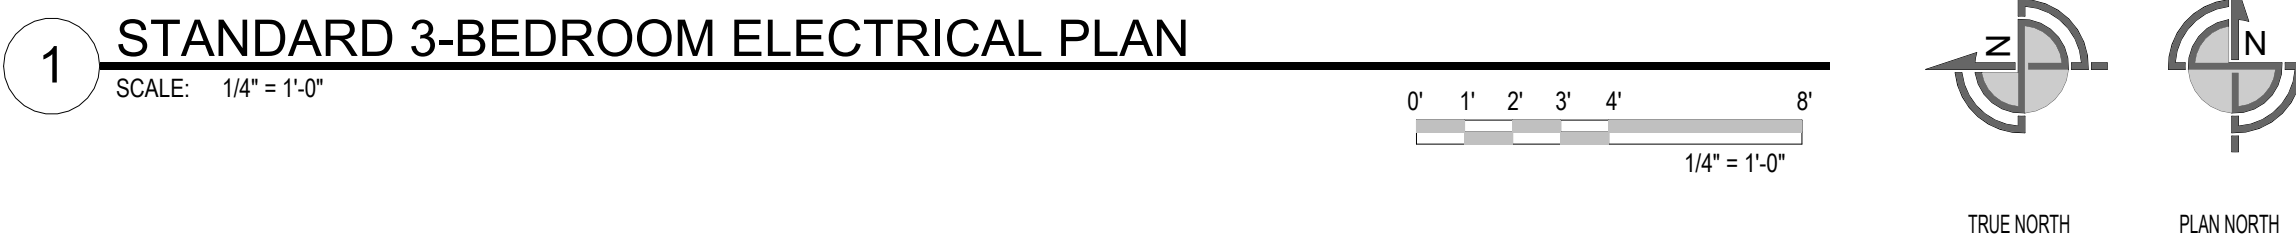

ASHRAE STANDARD 62.2 EQUATION 4.1(a)

THE WHOLE-BUILDING EXHAUST FAN SHALL PROVIDE A MINIMUM VENTILATION RATE ACCORDING TO EQUATION 4.1(A) LOW:

$$Q_{fan} = 0.03A_{floor} + 7.5 (N_{br} + 1)$$

WHERE:

Q_{fan} = FAN FLOW RATE (CFM)
 A_{floor} = CONDITIONED FLOOR AREA (S.F.)
 N_{br} = NUMBER OF BEDROOM, NOT LESS THAN ONE

CALCULATIONS:

$$\begin{aligned} Q_{fan} &= 0.03(999) + 7.5 (3 + 1) \\ Q_{fan} &= 29.97 + 30.0 \\ &= 59.97 \text{ CFM (50 CFM MIN.)} \end{aligned}$$

THE WHOLE-BUILDING EXHAUST FAN SHALL PROVIDE 59.97 CFM PER T-24 REPORT

WHOLE-HOUSE FAN NOT REQUIRED

EXHAUST FAN MODEL: S&P PCD110-PREMIUM CHOICE WITH DC MOTOR; 4" DUCT SONE RATING RANGE: 0.7 - 1.2;
DUCT SONE RATING RANGE: 0.3 - 1.1

SMOKE ALARMS SHALL BE INTERCONNECTED PER CRC R314.4.

SMOKE ALARMS SHALL BE HARD-WIRED WITH BATTERY BACKUP PER CRC R314.6 IN THE FOLLOWING LOCATIONS ON FLOOR PLANS OR UTILITY PLANS (CRC R314.3):

- A. OUTSIDE EACH SEPARATE SLEEPING AREA IN IMMEDIATE VICINITY OF BEDROOMS
- B. ON EACH STORY OF DWELLING
- C. IN ANY BEDROOM WITH A FUEL-BURNING APPLIANCE LOCATED WITHIN THAT BEDROOM OR ITS ATTACHED BATHROOM

CARBON MONOXIDE DETECTOR SHALL BE INTERCONNECTED PER CRC R315.1.7 AND HARD-WIRED WITH BATTERY BACKUP PER CRC R315.5 - IN THE FOLLOWING LOCATIONS ON FLOOR PLANS OR UTILITY PLANS IN DWELLING UNITS WITH AFFILIATED APPLIANCES, FIREPLACE, OR AN ATTACHED GARAGE COMMUNICATING WITH THE DWELLING UNIT (CRC R315)


- A. OUTSIDE EACH SEPARATE SLEEPING AREA IN IMMEDIATE VICINITY OF BEDROOMS
- B. ON EACH STORY OF DWELLING
- C. IN ANY BEDROOM WITH A FUEL-BURNING APPLIANCE LOCATED WITHIN THAT BEDROOM OR ITS ATTACHED BATHROOM.

COMBINATION SMOKE AND CARBON MONOXIDE ALARMS SHALL BE LISTED IN ACCORDANCE WITH UL-217 AND UL-2034. CRC R314.1.1 & R315.1.1.

SMOKE ALARMS SHALL BE LOCATED AT LEAST 3 FT FROM THE ENTRY DOOR TO ANY BATHROOM CONTAINING A BATHTUB/SHOWER. CRC R314.3.3.



ALL SMOKE ALARMS SHALL BE LOCATED AT LEAST 20 FT FROM A PERMANENTLY INSTALLED COOKING APPLIANCE. CRC R314.3.4.

A. SMOKE ALARMS ARE ALLOWED TO BE 10 FT FROM A PERMANENTLY INSTALLED COOKING APPLIANCE IF THE SMOKE ALARM IS AN IONIZATION SMOKE ALARM WITH ALARM SILENCING SWITCH, OR PHOTOELECTRIC SMOKE ALARM IN ACCORDANCE CRC R314.3.4.3 (4) EXCEPTION.

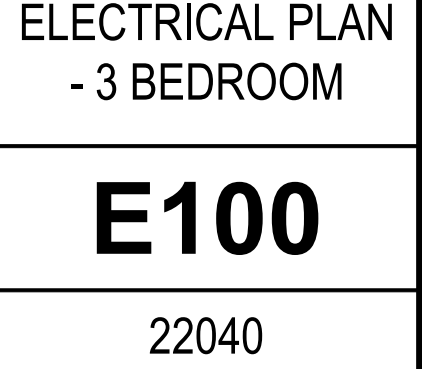

1 LIVING ROOM OPTION, 2-BEDROOM ELECTRICAL PLAN

SCALE: 1/4" = 1'-0"

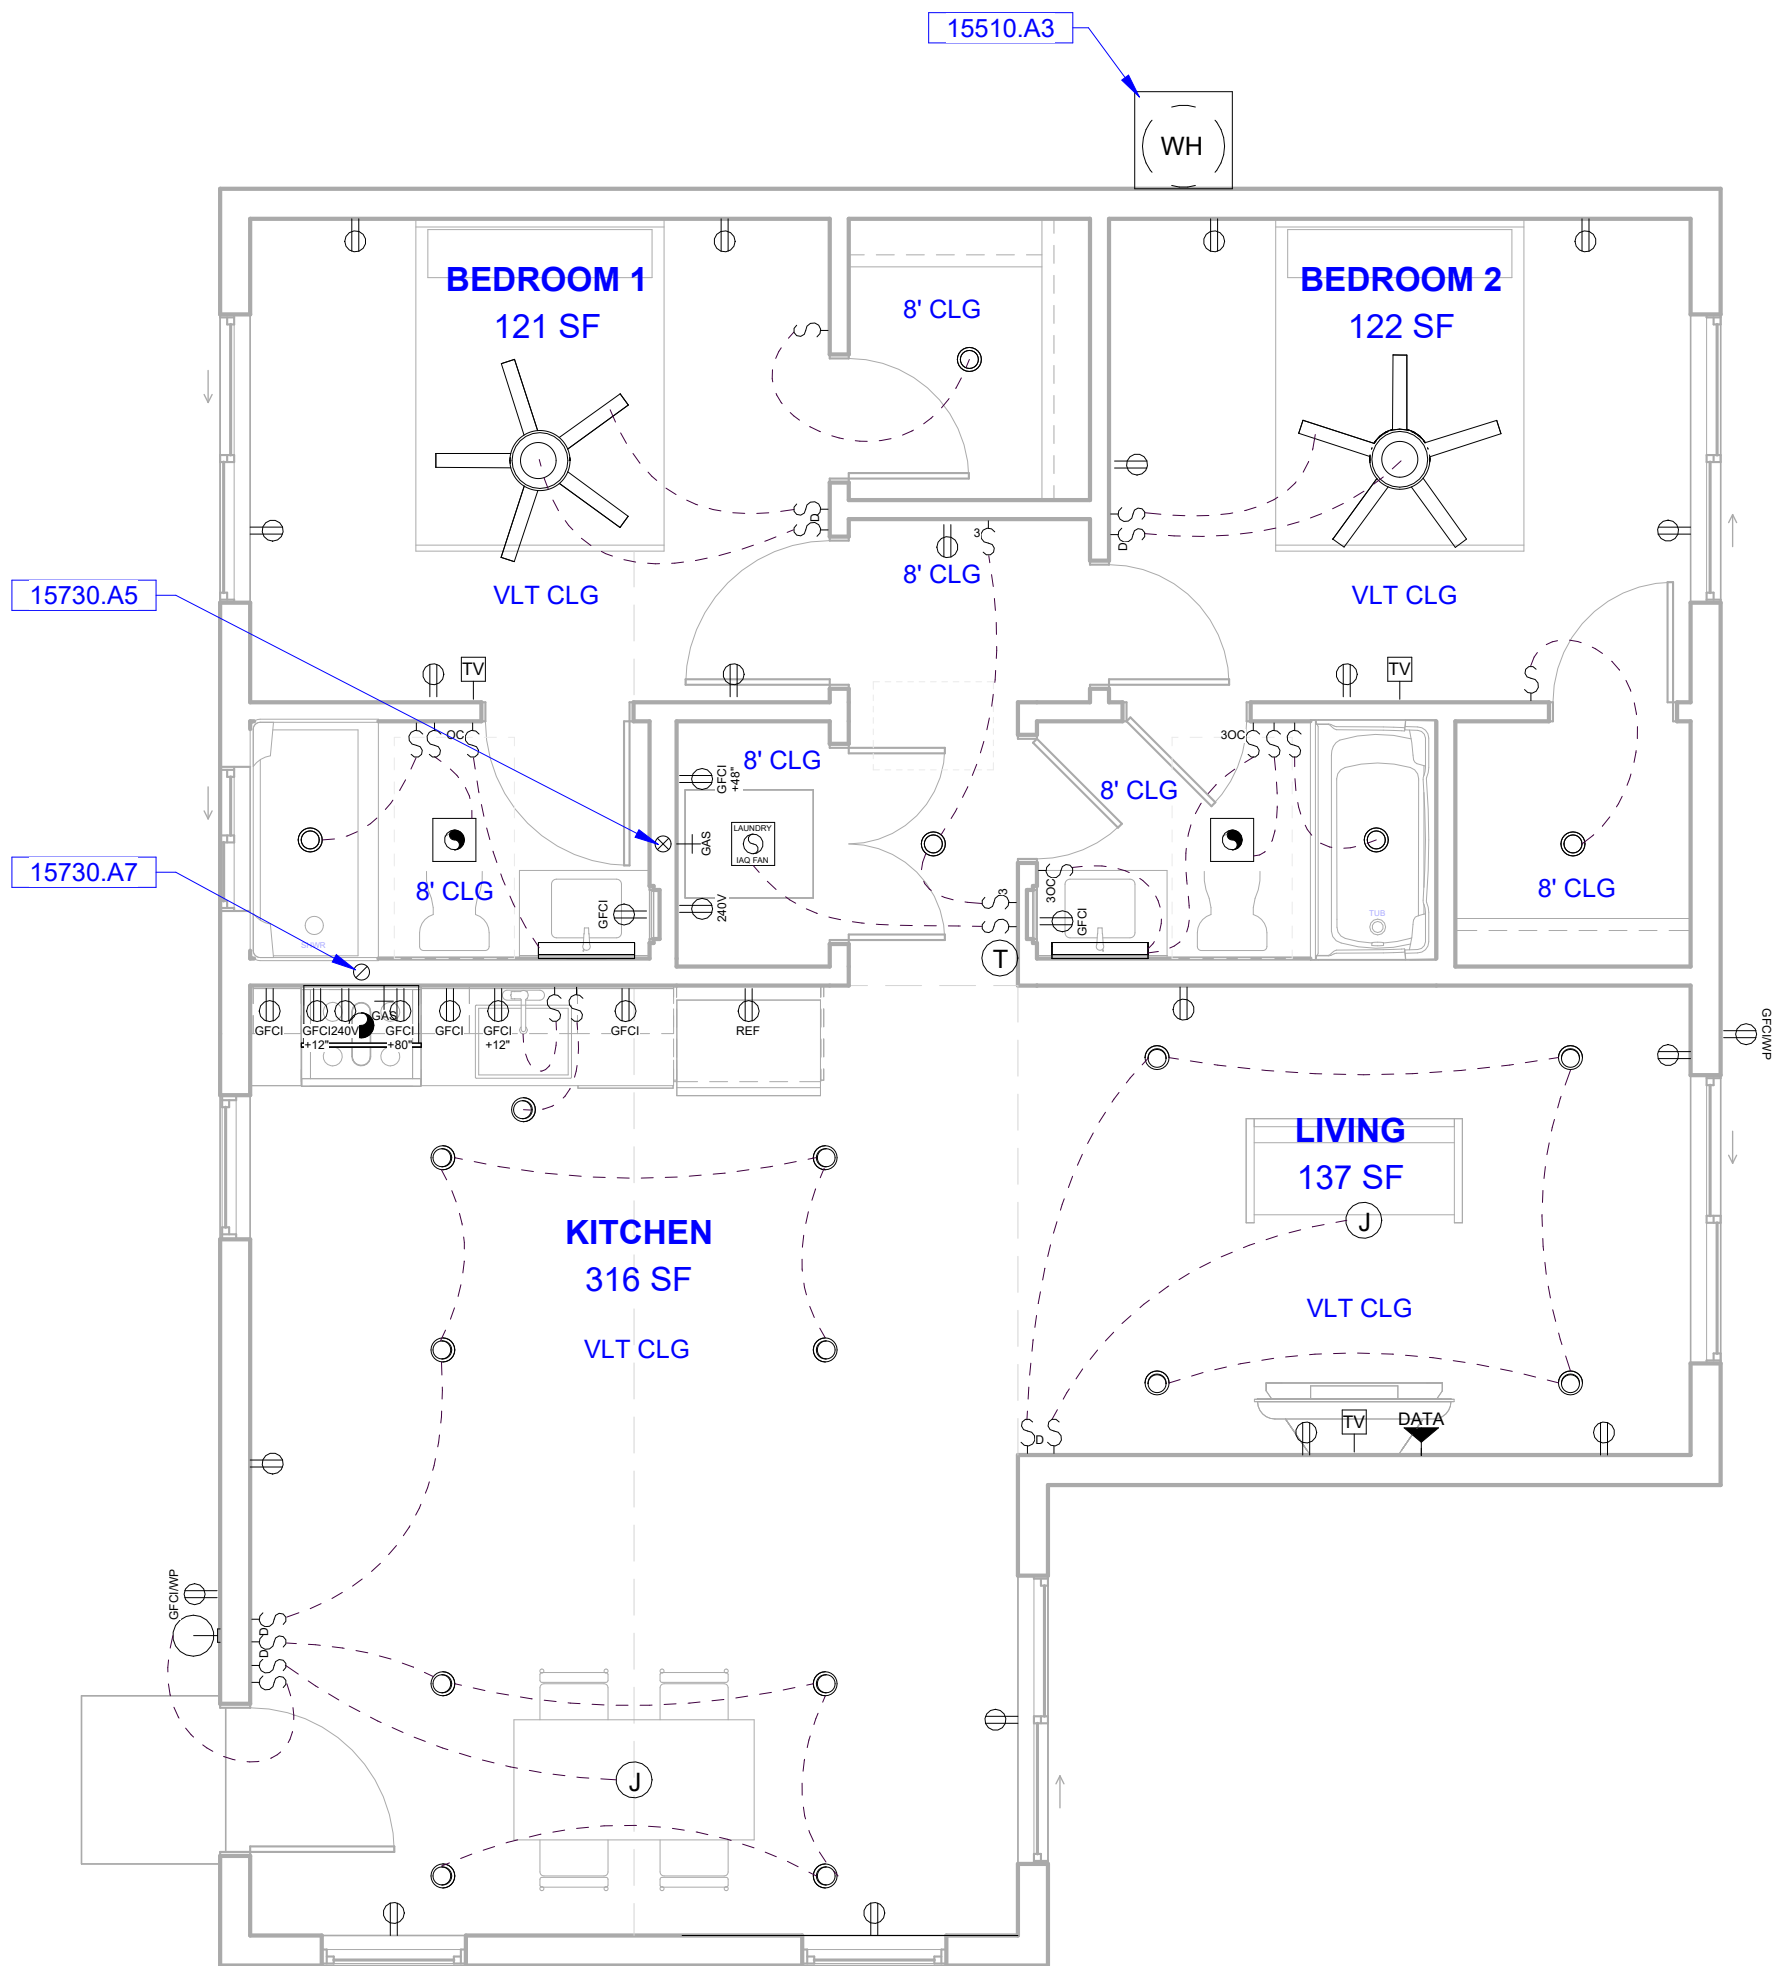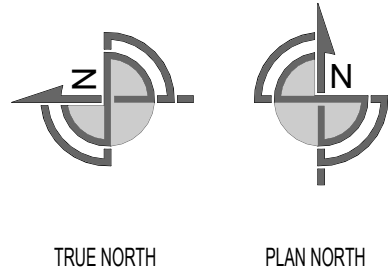

KEYNOTES

KEYNOTE	DESCRIPTION
15510.A3	APPLICANT/OWNER TO PROVIDE CUT SHEET FOR WATER HEATER TO MEET MINIMUM REQUIREMENTS OF TITLE 24 CALCULATIONS
15730.A5	4" DRYER VENT, SEE SHEET G200 CODE EXCERPTS CHAPTER 5: EXHAUST SYSTEMS FOR MORE INFORMATION
15730.A7	HOOD EXHAUST FAN ABOVE ELECTRIC RANGE 130 CFM OR 55% CE MIN. (GAS RANGE 280 CFM OR 85% CE MIN.); 2022 BEES TABLE 150.0-G

ELECTRICAL FLOOR PLAN LEGEND

	SINGLE POLE SWITCH
	THREE-WAY SWITCH
	OCCUPANCY SENSOR SWITCH
	DIMMER SWITCH
	DUPLEX RECEPTACLE OUTLET
	INDICATES OUTLET HEIGHT ABOVE FINISH FLOOR
	GROUND FAULT CIRCUIT INTERRUPTER DUPLEX OUTLET
	INDICATES 240V
	INDICATES WEATHER PROOF
	PHOTOELECTRIC SMOKE / CARBON MONOXIDE DETECTOR HARDWIRED W/ BATTERY BACKUP
	SMOKE / CARBON MONOXIDE DETECTOR HARDWIRED W/ BATTERY BACKUP
	JUNCTION BOX
	THERMOSTAT
	(1) OUTLET AND BRUSH PLATE BOX @ +12" AND @ +60"
	COAX CABLE
	EXHAUST VENT FAN - INTERMITTENT 50 CFM MIN / CONTINUOUS 20 CFM MIN
	EXHAUST VENT FAN SHALL BE USED TO MEET THE REQUIREMENTS FOR INDOOR AIR QUALITY (IAQ) PER T24 REPORT
	MICROWAVE-HOOD EXHAUST FAN COMBO 130 CFM MIN (IF GAS RANGE 280 CFM MIN. TO BE PROVIDED)
	GAS POINT OF CONNECTION W/ SHUT OFF VALVE
	WATER CONNECTION
	HOSE BIB
	RECESSED CAN LIGHT
	EXTERIOR WALL MOUNTED LIGHT
	VANITY SCONCE LIGHT
	ELECTRIC HEAT PUMP WATER HEATER IN OUTDOOR ENCLOSURE INSTALLED PER MANUFACTURER'S RECOMMENDATIONS
	POWER AND DISCONNECT FOR A/C CONDENSER
	A/C CONDENSER
	EVAPORATOR
	CEILING FAN WITH LIGHT

INDOOR AIR QUALITY NOTES:

- PROPOSED DWELLING UNIT FOLLOW THE **EXHAUST-ONLY APPROACH** TO COMPLY INDOOR AIR QUALITY (IAQ) REQUIREMENTS.
 - MANDATORY (CBES 150.0(O), ASHRAE STANDARD 62.2):
EXCEPTION: ADDITIONS 1000 S.F. OR LESS AND ALTERATIONS:
 - A MECHANICAL EXHAUST VENTILATION SYSTEM, SUPPLY VENTILATION SYSTEM, OR COMBINATION THEREOF SHALL BE INSTALLED FOR EACH DWELLING UNIT TO PROVIDE WHOLE-BUILDING VENTILATION WITH OUTDOOR AIR IN COMPLIANCE WITH ASHRAE STANDARD 62.2 AS ADOPTED BY THE CALIFORNIA ENERGY COMMISSION.
 - HERS VERIFICATION REQUIRED TO CONFIRM WHOLE-BUILDING VENTILATION AIRFLOW.
 - AN INTERMITTENTLY OR CONTINUOUSLY OPERATING LOCAL MECHANICAL EXHAUST VENTILATION SYSTEM SHALL BE INSTALLED IN EACH BATHROOM WITH A BATHTUB, SHOWER, OR SIMILAR MOISTURE SOURCE AND IN EACH KITCHEN IN COMPLIANCE WITH ASHRAE STANDARD 62.2 AS ADOPTED BY THE CALIFORNIA ENERGY COMMISSION. INTERMITTENT LOCAL EXHAUST VENTILATION AIRFLOW RATES SHALL BE 20 CFM IN BATHROOMS AND 5 AIR CHANGES PER HOUR IN KITCHENS BASED ON KITCHEN VOLUME.

INDOOR AIR QUALITY NOTES:

ASHRAE STANDARD 62.2 EQUATION 4.1(a)	
THE WHOLE-BUILDING EXHAUST FAN SHALL PROVIDE A MINIMUM VENTILATION RATE ACCORDING TO EQUATION 4.1(A) BELOW:	
WHERE:	
$Q_{fan} = 0.03A_{floor} + 7.5 (Nbr + 1)$	
WHERE:	
Q_{fan} = FAN FLOW RATE (CFM)	
A_{floor} = CONDITIONED FLOOR AREA (S.F.)	
Nbr = NUMBER OF BEDROOM, NOT LESS THAN ONE	
CALCUALTIONS:	
$Q_{fan} = 0.03(999) + 7.5 (3 + 1)$	
$Q_{fan} = 29.97 + 30.0$	
$= 59.97 \text{ CFM (50 CFM MIN.)}$	
IAQ FAN SHALL PROVIDE 59.97 CFM PER T-24 REPORT	
LISTED WHOLE-HOUSE FAN NOT REQUIRED	
EXHAUST FAN MODEL: S&P PCD110 PREMIUM CHOICE WITH DC MOTOR; 4" DUCT SONE RATING RANGE: 0.7 - 1.2; 6" DUCT SONE RATING RANGE: 0.3 - 1.1	

ELECTRICAL NOTES:

POWER NOTES

- ALL ELECTRICAL WORK SHALL BE DESIGN PER 2022 CALIFORNIA ELECTRICAL CODE, 2022 NATIONAL ELECTRICAL CODE, AND 2022 BUILDING ENERGY EFFICIENCY STANDARDS.
- ALL ELECTRICAL EQUIPMENT SHALL BE LABELED, LISTED, OR CERTIFIED BY A NATIONALLY RECOGNIZED TESTING LABORATORY ACCREDITED BY THE UNITED STATES OCCUPATIONAL SAFETY HEALTH ADMINISTRATION.
- THE MAXIMUM COMBINED VOLTAGE DROP ON BOTH INSTALLED FEEDER CONDUCTORS AND BRANCH CIRCUIT CONDUCTORS TO THE FARTHEST CONNECTED LOAD OR OUTLET SHALL NOT EXCEED 5 PERCENT.
- ALL THE CONDUCTOR'S SPECIFIED IN THE PANEL SCHEDULES ARE GROUNDED SEPARATELY.
- PURCHASE RTU WITH FACTORY INSTALLED DISCONNECT. COORDINATE PROPER RATING OF DISCONNECT WITH MANUFACTURER.
- INSTALL WEATHERPROOF (WP), GFI PROTECTED, WEATHER RESISTANT RECEPTACLE OUTLETS ON THE ROOFTOP AND WITHIN 25 FT OF HEATING/AIR CONDITIONING AND IDENTIFIED AND LISTED AS "EXTRA DUTY" PER ARTICLE 406.9 (B)(1) & 406.4(D)(6).
- ALL WORK PERFORMED SHALL COMPLY WITH ALL STATE AND LOCAL ALL ELECTRICAL CODES.
- ALL BRANCH CIRCUIT BREAKERS SHALL BE 10,000 AIC RATING, UNLESS NOTED OTHERWISE.
- ALL THE HVAC UNITS ARE EQUIPPED WITH FACTORY INSTALLED DISCONNECT SWITCH UNLESS NOTIFIED OTHERWISE. COORDINATE WITH MANUFACTURE BEFORE INSTALLATION AND IN THE ABSENCE OF DISCONNECT SWITCH PROVIDE REQUIRED DISCONNECT AS PER NEC 430.104 AND 430.110.
- THE BATHROOM CIRCUITING SHALL BE EITHER A 20-AMP CIRCUIT DEDICATED TO EACH BATHROOM, OR AT LEAST ONE 20 AMP CIRCUIT SUPPLYING ONLY BATHROOM RECEPTACLE OUTLETS PER CEC 210.11(C)(3).
- ALL ELECTRICAL DEVICES INSTALLED IN DWELLINGS SHALL BE PROVIDED WITH ARC-FAULT PROTECTION OUTLETS (NOT JUST RECEPTACLES) LOCATED IN ROOMS DESCRIBED IN NEC 210.12(A); KITCHENS, LAUNDRY AREAS, FAMILY, LIVING, BEDROOMS, DINING, HALLS, ETC. CEC ARTICLE 210 & 406.
- ALL 120-VOLT, SINGLE-PHASE, 15- AND 20-AMPERE BRANCH CIRCUITS SUPPLYING OUTLETS OR DEVICES INSTALLED IN DWELLING UNIT KITCHENS, FAMILY ROOMS, SUNROOMS, DINING ROOMS, LIVING ROOMS, PARLORS, LIBRARIES, DENS, BEDROOMS, AND SUNROOMS, RECREATION ROOMS, CLOSETS, HALLWAYS, LAUNDRY AREAS, OR SIMILAR ROOMS OR AREA SHALL BE PROTECTED BY ANY OF THE MEANS DESCRIBED IN 210.12(A)(1) THROUGH (6).
- INSTALL A MINIMUM OF 2 SMALL APPLIANCE BRANCH CIRCUITS WITHIN THE KITCHEN AND DINING AREAS PER CEC 210.11(C)(1) & 210.52(B).
- ALL OUTLETS IN KITCHEN AND BATHROOMS SHALL BE GFCI PER CEC 210.8.
- ALL RECEPTACLES INSTALLED IN THE DWELLING SHOULD BE TAMPER RESISTANT PER ARTICLE 210.52 & 550.13.
- PER CEC 210.11(C)(3), BATHROOM CIRCUITING SHALL BE EITHER:
 - A 20 AMP CIRCUIT DEDICATED TO EACH BATHROOM, OR
 - AT LEAST ONE 20 AMP CIRCUIT SUPPLYING ONLY BATHROOM RECEPTACLE OUTLETS.
- ELECTRIC POWERED APPLIANCES SHALL BE PROVIDED WITH A 30A CIRCUIT. CEC 220.54.
- ELECTRICAL RECEPTACLE OUTLETS, SWITCHES AND CONTROLS (INCLUDING CONTROLS FOR HEATING, VENTILATION AND AIR CONDITIONING) INTENDED TO BE USED BY OCCUPANTS SHALL BE LOCATED NO MORE THAN 48 INCHES MEASURED FROM THE TOP OF THE OUTLET BOX AND NOT LESS THAN 15 INCHES MEASURED FROM THE BOTTOM OF THE OUTLET BOX ABOVE THE FINISH FLOOR. R327.1.2.
- DOORBELL BUTTONS OR CONTROLS, WHEN INSTALLED, SHALL NOT EXCEED 48 INCHES (1219.2 MM) ABOVE EXTERIOR FLOOR OR LANDING, MEASURED FROM THE TOP OF THE DOORBELL BUTTON ASSEMBLY. WHERE DOORBELL BUTTONS INTEGRATED WITH OTHER FEATURES ARE REQUIRED TO BE INSTALLED ABOVE 48 INCHES (1219.2 MM) MEASURED FROM THE EXTERIOR FLOOR OR LANDING, A STANDARD DOORBELL BUTTON OR CONTROL SHALL ALSO BE PROVIDED AT A HEIGHT NOT EXCEEDING 48 INCHES (1219.2 MM) ABOVE EXTERIOR FLOOR OR LANDING, MEASURED FROM THE TOP OF THE DOORBELL BUTTON OR CONTROL. R327.1.4.
- SURGE PROTECTION REQUIREMENTS:
 - ALL SERVICES SUPPLYING DWELLING UNITS SHALL BE PROVIDED WITH A SURGE-PROTECTIVE DEVICE (SPD).
 - LOCATION - THE SPD SHALL BE AN INTEGRAL PART OF THE SERVICE EQUIP-MENT OR SHALL BE LOCATED IMMEDIATELY ADJACENT THERETO.
 - EXCEPTION: THE SPD SHALL NOT BE REQUIRED TO BE IN THE SERVICE EQUIPMENT AS REQUIRED IN.
 - IF LOCATED AT EACH NEXT LEVEL DISTRIBUTION EQUIPMENT DOWN-STREAM TOWARD THE LOAD.
 - TYPE - THE SPD SHALL BE A TYPE 1 OR TYPE 2 SPD.

LIGHTING NOTES

- PROVIDE LIGHTING CONTROL WITH CONTINUOUS DIMMING IN ALL AREAS. PROVIDE REQUIRED DRIVERS AND DIMMER SWITCHES FOR CONTINUOUS DIMMING USING 0-10 VOLT DIMMING.
- LIGHTING SHALL PROVIDE NOT LESS THAN 215 LUX (20 FOOTCANDLES) AS MEASURED 30" ABOVE FLOOR.
- IF APPLICABLE, SPECIFY THAT THE EXHAUST FANS TO BE ON A SEPARATE SWITCH FROM LIGHTS PER CENC 150.0(K)2B.
- ALL INSTALLED LUMINAIRES SHALL BE HIGH-EFFICACY IN ACCORDANCE WITH ES TABLE 150.0-A.
 - LUMINAIRES MUST HAVE A LABEL CERTIFIED FOR AIRTIGHT CONSTRUCTION.
 - LIGHT SOURCES THAT ARE NOT MARKED "JA8-2019-E" SHALL NOT BE INSTALLED IN ENCLOSED LUMINAIRES. ES 150.0(K)
- BATHROOMS, GARAGE, LAUNDRY ROOMS, AND UTILITY ROOM LIGHTING TO HAVE ONE LUMINAIRE CONTROLLED BY A VACANCY OR OCCUPANCY SENSOR PROVIDING AUTOMATIC-OFF FUNCTIONALITY PER CENC SECTION 150.0(K)2I. IF AN OCCUPANT SENSOR IS INSTALLED, IT SHALL BE INITIALLY CONFIGURED TO MANUAL-ON OPERATION USING THE MANUAL CONTROL REQUIRED UNDER SECTION 150.0(K)2C.
- ALL OTHER LUMINAIRES THAT CONTAIN LIGHT SOURCES THAT MEET REFERENCE JOINT APPENDIX JA8 REQUIREMENTS ARE TO BE CONTROLLED BY A VACANCY/OCCUPANCY SENSOR OR DIMMER PER CENC SECTION 150.0(K)2J. NOTE THAT CLOSETS WITH AN AREA LESS THAN 70 FT2 AND HALLWAY LIGHTING ARE EXEMPT FROM THIS REQUIREMENT.
- RECESSED CAN LIGHT FIXTURES SHALL BE IC LISTED, AIR-TIGHT LABELED, AND NOT BE EQUIPPED WITH A STANDARDS MEDIUM BASE SCREW SHELL LAMP HOLDER. ES 150.0(K)
- SFD OUTDOOR LIGHTING FIXTURES THAT ARE ATTACHED TO A BUILDING ARE REQUIRED TO BE HIGH EFFICACY, BE MANUALLY ON/OFF SWITCH CONTROLLED, AND HAVE BOTH MOTION SENSOR AND PHOTOCELL CONTROL. SEE ES 150.0(K) 3 FOR ADDITIONAL CONTROL OPTIONS.

MECHANICAL NOTES:

EXHAUST FAN NOTES

- KITCHENS REQUIRE EXHAUST FANS WITH A MINIMUM 130 CFM (280 CFM IF GAS RANGE) DUCTED TO THE EXTERIOR. DETAIL COMPLIANCE BY INCLUDING A COMPLYING EXHAUST FAN OR A DUCTED RANGE HOOD TO THE EXTERIOR.
- BATHROOMS REQUIRE EXHAUST FANS (MINIMUM 50 CFM) TO BE DUCTED TO THE EXTERIOR. A BATHROOM IS DEFINED "AS A ROOM WITH A BATHTUB, SHOWER, OR SPA OR SOME SIMILAR SOURCE OF MOISTURE."
- RESIDENTIAL BATHROOM EXHAUST FANS SHALL BE ENERGY STAR RATED AND SHALL BE CONTROL BY A HUMIDISTAT CAPABLE OF AN ADJUSTMENT BETWEEN 50 AND 80% HUMIDITY. CALGREEN 4.506.1. EXCEPTION: CONTROL BY A HUMIDISTAT IS NOT REQUIRED IF THE BATHROOM EXHAUST FAN IS ALSO THE DWELLING WHOLE HOUSE VENTILATION.

SMOKE & CARBON MONOXIDE NOTES:

SMOKE & CARBON MONOXIDE ALARM NOTES

- SMOKE ALARMS SHALL BE INTERCONNECTED PER CRC R314.4.
- SMOKE ALARMS SHALL BE HARD-WIRED WITH BATTERY BACK-UP PER CRC R314.6 IN THE FOLLOWING LOCATIONS ON FLOOR PLANS OR UTILITY PLANS (CRC R314.3):
 - OUTSIDE EACH SEPARATE SLEEPING AREA IN IMMEDIATE VICINITY OF BEDROOMS
 - ON EACH STORY OF DWELLING
 - IN ANY BEDROOM WITH A FUEL-BURNING APPLIANCE LOCATED WITHIN THAT BEDROOM OR ITS ATTACHED BATHROOM
- CARBON MONOXIDE DETECTOR SHALL BE INTERCONNECTED PER CRC R315.1.7 AND HARD-WIRED WITH BATTERY BACK-UP PER CRC R315.5 - IN THE FOLLOWING LOCATIONS ON FLOOR PLANS OR UTILITY PLANS IN DWELLING UNITS WITH FUEL-BURNING APPLIANCES, FIREPLACE, OR AN ATTACHED GARAGE COMMUNICATING WITH THE DWELLING UNIT (CRC R315):
 - OUTSIDE EACH SEPARATE SLEEPING AREA IN IMMEDIATE VICINITY OF BEDROOMS
 - ON EACH STORY OF DWELLING
 - IN ANY BEDROOM WITH A FUEL-BURNING APPLIANCE LOCATED WITHIN THAT BEDROOM OR ITS ATTACHED BATHROOM.
- COMBINATION SMOKE AND CARBON MONOXIDE ALARMS SHALL BE LISTED IN ACCORDANCE WITH UL-217 AND UL-2034, CRC R314.1.1 & R315.1.1.
- SMOKE ALARMS SHALL BE LOCATED AT LEAST 3 FT FROM THE ENTRY DOOR TO ANY BATHROOM CONTAINING A BATHTUB/SHOWER. CRC R314.3.3.
- ALL SMOKE ALARMS SHALL BE LOCATED AT LEAST 20 FT FROM A PERMANENTLY INSTALLED COOKING APPLIANCE. CRC R314.3.3.
 - SMOKE ALARMS ARE ALLOWED TO BE 10 FT FROM A PERMANENTLY INSTALLED COOKING APPLIANCE IF THE SMOKE ALARM IS AN IONIZATION SMOKE ALARM WITH ALARM SILENCING SWITCH, OR PHOTOELECTRIC SMOKE ALARM IN ACCORDANCE CRC R314.3.3. (4) EXCEPTION.



ADU: 999 L-SHAPE
CITY OF CHULA VISTA
276 FOURTH AVENUE,
CHULA VISTA, CA 91910

DESIGNER:
LUIS CALDERON
SnapADU


SIGNATURE

RELEASE	DATE	BY	APP.	RELEASED FOR...
	03/22/2024	A	LAG	


ELECTRICAL PLAN
- 2 BEDROOM

E101


22040

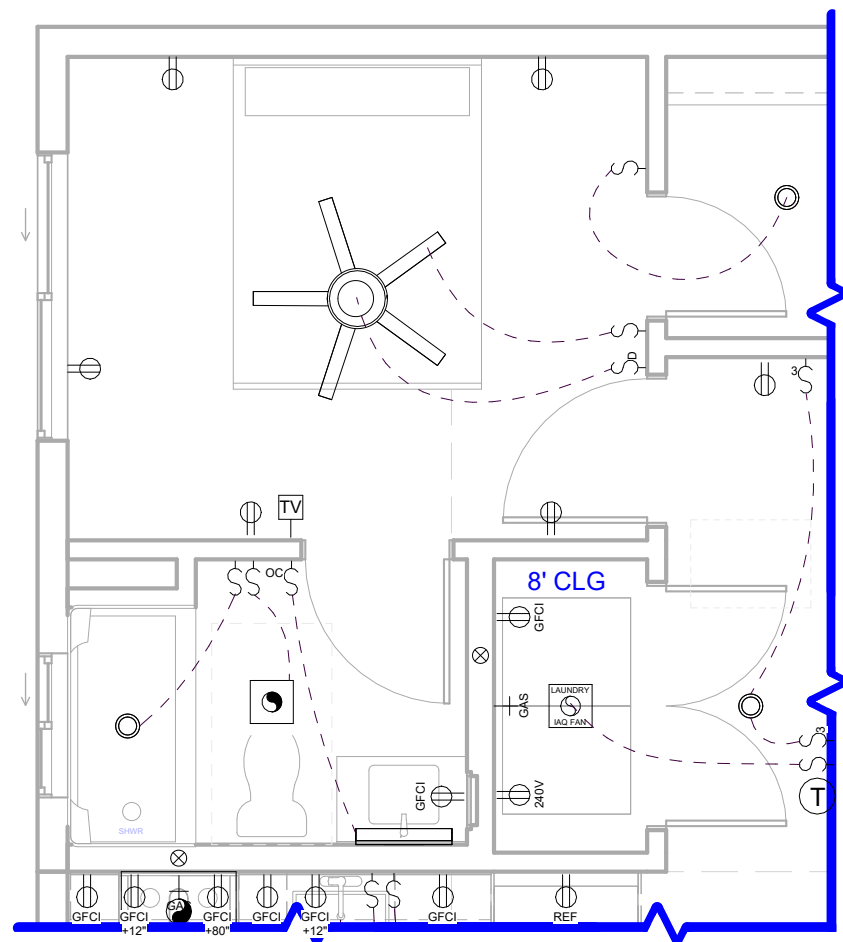


4 SIDE BY SIDE LAUNDRY OPTION ELECTRICAL PLAN
SCALE: 1/4" = 1'-0"

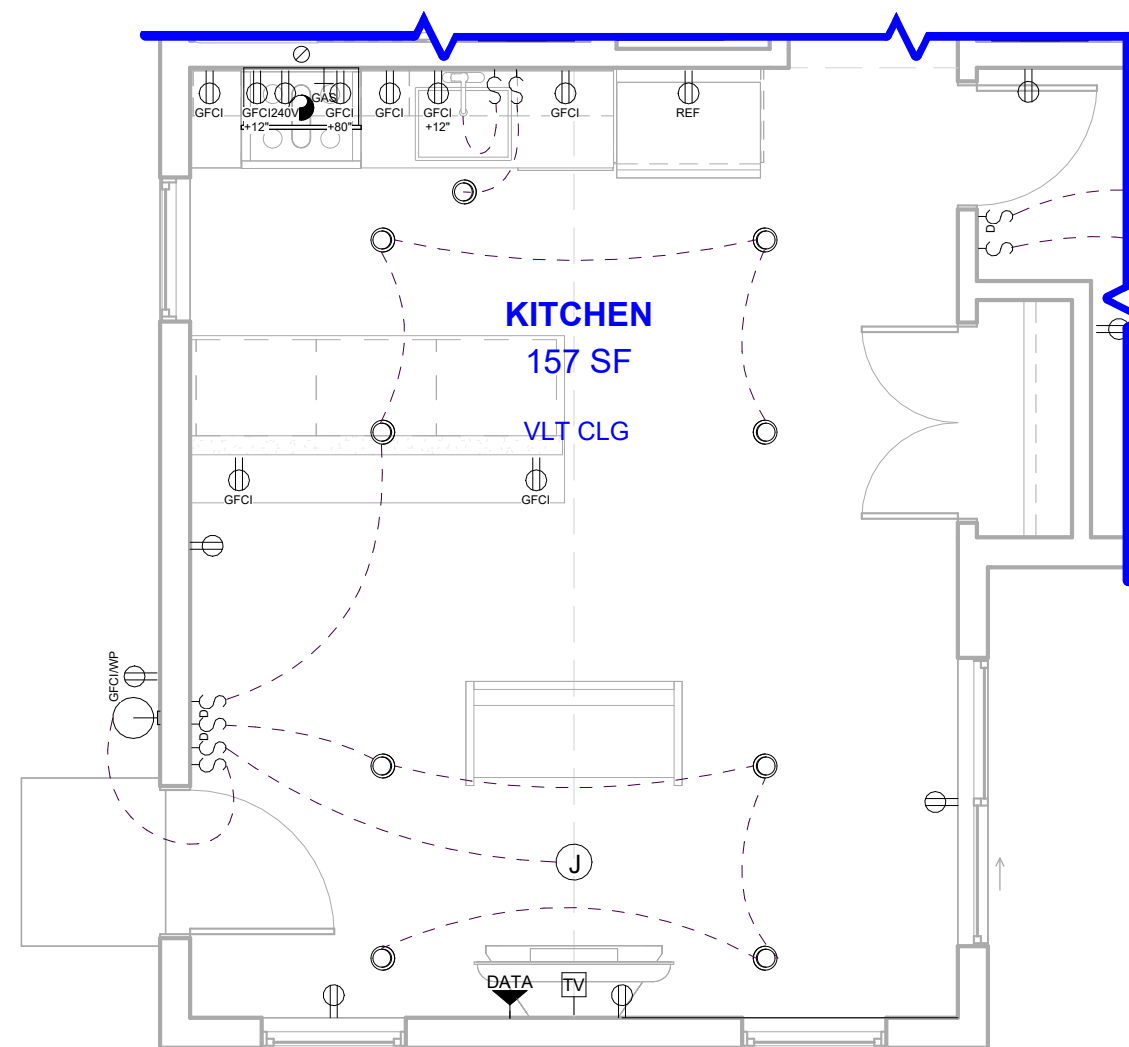


1 8' PENINSULA OPTION ELECTRICAL PLAN
SCALE: 1/4" = 1'-0"

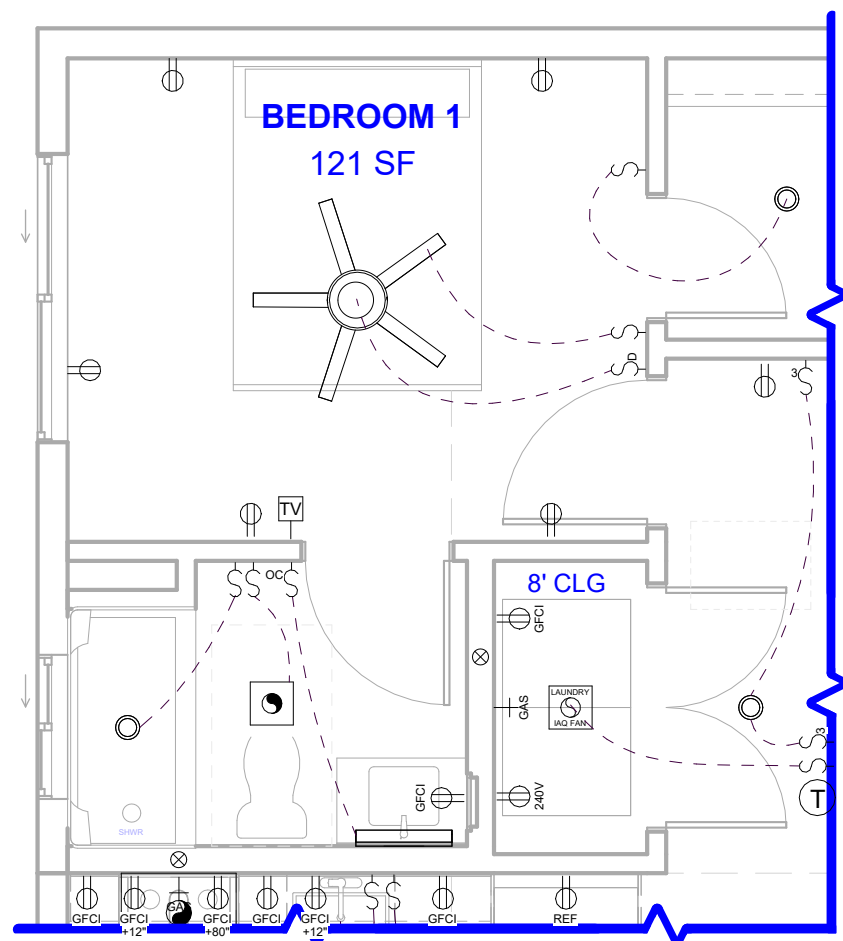

ACCESSIBLE BEDROOM & BATH OPTION
ELECTRICAL PLAN

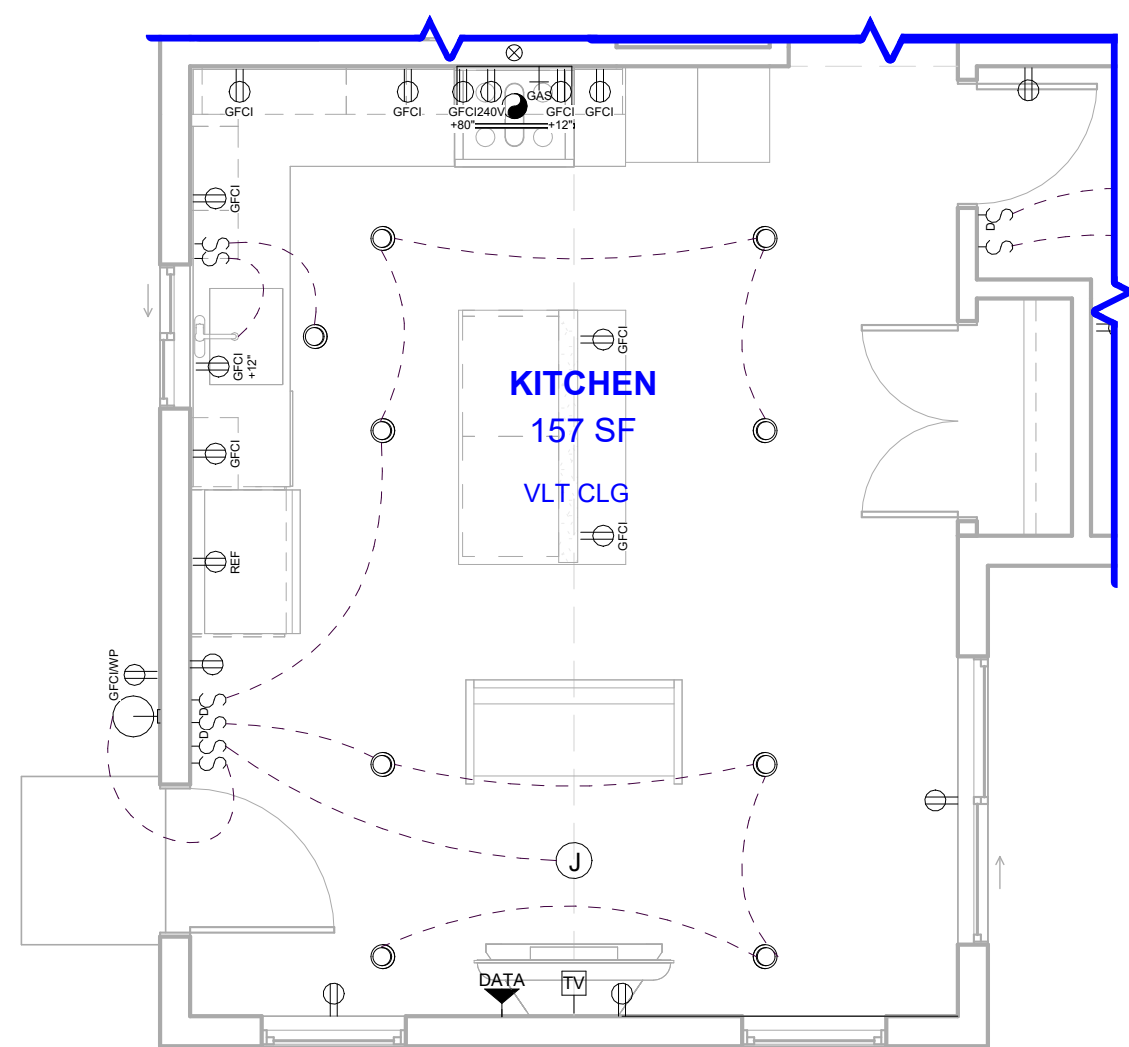

2 L-KITCHEN WITH 5' ISLAND OPTION ELECTRICAL PLAN

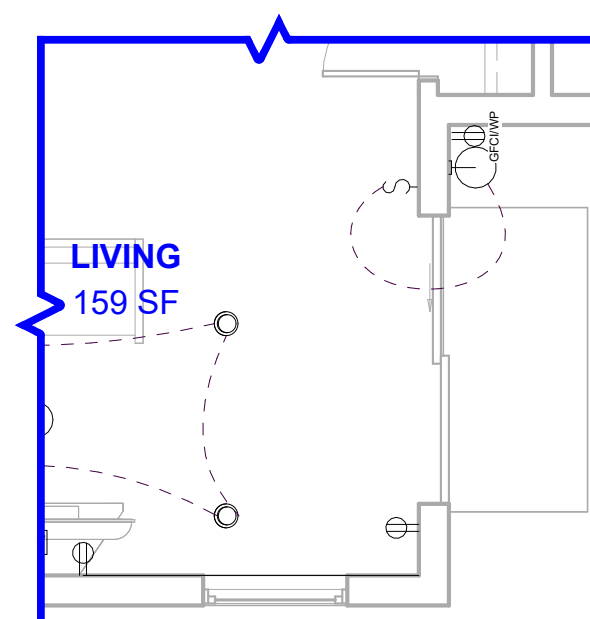




























6'-0" x 6'-8" SLIDING GLASS DOOR OPTION
ELECTRICAL PLAN

KEYNOTES

KEYNOTE	DESCRIPTION

ELECTRICAL FLOOR PLAN LEGEND

	SINGLE POLE SWITCH
	THREE-WAY SWITCH
	OCCUPANCY SENSOR SWITCH
	DIMMER SWITCH
	DUPLEX RECEPTACLE OUTLET
	INDICATES OUTLET HEIGHT ABOVE FINISH FLOOR
	GROUND FAULT CIRCUIT INTERRUPTER DUPLEX OUTLET
	INDICATES 240V
	INDICATES WEATHER PROOF
	PHOTOELECTRIC SMOKE / CARBON MONOXIDE DETECTOR HARDWIRED W/ BATTERY BACKUP
	SMOKE / CARBON MONOXIDE DETECTOR HARDWIRED W/ BATTERY BACKUP
	JUNCTION BOX
	THERMOSTAT
	(1) OUTLET AND BRUSH PLATE BOX @ +12" AND @ +60"
	COAX CABLE
	EXHAUST VENT FAN - INTERMITTENT 50 CFM MIN / CONTINUOUS 20 CFM MIN
	EXHAUST VENT FAN SHALL BE USED TO MEET THE REQUIREMENTS FOR INDOOR AIR QUALITY (IAQ) PER T24 REPORT
	MICROWAVE-HOOD EXHAUST FAN COMBO 130 CFM MIN (IF GAS RANGE 280 CFM MIN. TO BE PROVIDED)
	GAS POINT OF CONNECTION W/ SHUT OFF VALVE
	WATER CONNECTION
	HOSE BIB
	RECESSED CAN LIGHT
	EXTERIOR WALL MOUNTED LIGHT
	VANITY SCONCE LIGHT
	ELECTRIC HEAT PUMP WATER HEATER IN OUTDOOR ENCLOSURE INSTALLED PER MANUFACTURER'S RECOMMENDATIONS
	POWER AND DISCONNECT FOR A/C CONDENSER
	A/C CONDENSER
	EVAPORATOR
	CEILING FAN WITH LIGHT

INDOOR AIR QUALITY NOTES:

1. PROPOSED DWELLING UNIT FOLLOW THE **EXHAUST-ONLY APPROACH** TO COMPLY INDOOR AIR QUALITY (IAQ) REQUIREMENTS
- A. MANDATORY (CBEES 150.0 (O), ASHRAE STANDARD 62.2):
- EXCEPTION: ADDITIONS 1000 S.F. OR LESS AND ALTERATIONS:
- MECHANICAL EXHAUST VENTILATION SYSTEM, SUPPLY VENTILATION SYSTEM, OR COMBINATION THEREOF SHALL BE INSTALLED FOR EACH DWELLING UNIT TO PROVIDE WHOLE-BUILDING VENTILATION WITH OUTDOOR AIR IN COMPLIANCE WITH ASHRAE STANDARD 62.2 AS ADOPTED BY THE CALIFORNIA ENERGY COMMISSION.
 - HERMETICALLY SEALED BUILDING ENVELOPE TO MAINTAIN BUILDING VENTILATION AIRFLOW.
 - AN INTERMITTENTLY OR CONTINUOUSLY OPERATING LOCAL MECHANICAL EXHAUST VENTILATION SYSTEM SHALL BE INSTALLED IN EACH BATHROOM WITH A BATHTUB, SHOWER, OR SIMILAR MOISTURE SOURCE AND IN EACH KITCHEN IN COMPLIANCE WITH ASHRAE STANDARD 62.2 AS ADOPTED BY THE CALIFORNIA ENERGY COMMISSION. INTERMITTENT LOCAL MECHANICAL EXHAUST VENTILATION AIR FLOW RATES SHALL BE 100 CFM IN BATHROOMS AND 5 AIR CHANGES PER HOUR IN KITCHENS BASED ON KITCHEN VOLUME.

INDOOR AIR QUALITY NOTES:

ASHRAE STANDARD 62.2 EQUATION 4.1(a)	
THE WHOLE-BUILDING EXHAUST FAN SHALL PROVIDE A MINIMUM VENTILATION RATE ACCORDING TO EQUATION 4.1(a) BELOW:	
$Q_{fan} = 0.03A_{floor} + 7.5 (Nbr + 1)$	
WHERE:	Q_{fan} = FAN FLOW RATE (CFM) A_{floor} = CONDITIONED FLOOR AREA (S.F.) Nbr = NUMBER OF BEDROOM, NOT LESS THAN ONE
CALCULATIONS:	$Q_{fan} = 0.03(999) + 7.5 (3 + 1)$ $Q_{fan} = 29.97 + 30.0$ $= 59.97 \text{ CFM (50 CFM MIN.)}$
IAQ FAN SHALL PROVIDE 59.97 CFM PER T-24 REPORT	
LISTED WHOLE-HOUSE FAN NOT REQUIRED	
EXHAUST FAN MODEL: S&P PCD110-PREMIUM CHOICE WITH DC MOTOR; 4" DUCT SONE RATING RANGE: 0.7 - 1.2; 6" DUCT SONE RATING RANGE: 0.3 - 1.1	

ELECTRICAL NOTES:

POWER NOTES

1. ALL ELECTRICAL WORK SHALL BE DESIGN PER 2022 CALIFORNIA ELECTRICAL CODE, 2022 NATIONAL ELECTRICAL CODE, AND 2022 BUILDING ENERGY EFFICIENCY STANDARDS.
2. ALL ELECTRICAL EQUIPMENT SHALL BE LABELED, LISTED, OR CERTIFIED BY A NATIONALLY RECOGNIZED TESTING LABORATORY ACCREDITED BY THE UNITED STATES OCCUPATIONAL SAFETY HEALTH ADMINISTRATION.
3. THE MAXIMUM COMBINED VOLTAGE DROP ON BOTH INSTALLED FEEDER CONDUCTORS AND BRANCH CIRCUIT CONDUCTORS TO THE FARTHEST CONNECTED LOAD OR OUTLET SHALL NOT EXCEED 5 PERCENT.
4. ALL THE CONDUCTOR'S SPECIFIED IN THE PANEL SCHEDULES ARE GROUNDED SEPARATELY.
5. PURCHASE RTU WITH FACTORY INSTALLED DISCONNECT. COORDINATE PROPER RATING OF DISCONNECT WITH MANUFACTURER.
6. INSTALL WEATHERPROOF (WP), GFI PROTECTED, WEATHER RESISTANT RECEPTACLE OUTLETS ON THE ROOFTOP AND WITHIN 25 FT OF HEATING/AIR CONDITIONING AND IDENTIFIED AND LISTED AS "EXTRA DUTY" PER ARTICLE 406.9 (B)(1) & 406.4(D)(6)
7. ALL WORK PERFORMED SHALL COMPLY WITH ALL STATE AND LOCAL ALL ELECTRICAL CODES.
8. ALL BRANCH CIRCUIT BREAKERS SHALL BE 10,000 AIC RATING, UNLESS NOTED OTHERWISE.
9. ALL THE HVAC UNITS SHALL BE INSTALLED DISCONNECT SWITCH UNLESS NOTIFIED OTHERWISE. COORDINATE WITH MANUFACTURE BEFORE INSTALLATION AND IN THE ABSENCE OF DISCONNECT SWITCH PROVIDE REQUIRED DISCONNECT AS PER NEC 400.104 AND 430.410.
10. THE BATHROOM CIRCUITING SHALL BE EITHER A 20-AMP CIRCUIT DEDICATED TO EACH BATHROOM, OR AT LEAST ONE 20-AMP CIRCUIT SUPPLYING ONLY BATHROOM RECEPTACLE OUTLETS PER NEC 210.11(C)(3).
11. ALL ELECTRICAL DEVICES IN DWELING UNITS SHALL BE PROVIDED WITH ARC-Fault PROTECTION OUTLETS (NOT JUST RECEPTACLES) LOCATED IN ROOMS DESCRIBED IN NEC 210.12(A); KITCHENS, LAUNDRY AREAS, FAMILY, LIVING, BEDROOMS, DINING, HALLS, ETC. CEC ARTICLE 210 & 406.
12. ALL 120-VOLT, SINGLE-PHASE, 15- AND 20-AMPERE BRANCH CIRCUITS SUPPLYING OUTLETS OR DEVICES INSTALLED IN DWELLING UNIT KITCHENS, FAMILY ROOMS, SUNROOMS, DINING ROOMS, LIVING ROOMS, PORCHES, TERRACES, PATIOS, RECREATION ROOMS, CLOSETS, HALLWAYS, LAUNDRY AREAS, OR SIMILAR ROOMS OR AREA SHALL BE PROTECTED BY ANY OF THE MEANS DESCRIBED IN 210.12(A)(1) THROUGH (6).
13. INSTALL A MINIMUM OF 2 SMALL APPLIANCE BRANCH CIRCUITS WITHIN THE KITCHEN AND DINING AREAS PER NEC 210.11(C)(1) & 210.52(B).
14. ALL OUTLETS IN KITCHEN AND BATHROOMS SHALL BE GFCI PER CEC 210.8.
15. ALL RECEPTLES INSTALLED IN THE DWELLING SHOULD BE TAMPER RESISTANT PER ARTICLE 210.52 & 550.13.
16. PER CEC 210.11(C)(3), BATHROOM CIRCUITING SHALL BE EITHER:
 - A. A 20 AMP CIRCUIT DEDICATED TO EACH BATHROOM, OR
 - B. AT LEAST ONE 20 AMP CIRCUIT SUPPLYING ONLY BATHROOM RECEPTACLE OUTLETS.
17. ELECTRICAL POWERED APPLIANCES SHALL BE PROVIDED WITH A 30A CIRCUIT, CEC 220.54.
18. ELECTRICAL RECEPTACLE OUTLETS, SWITCHES AND CONTROLS (INCLUDING CONTROLS FOR HEATING, VENTILATION AND AIR CONDITIONING) INTENDED TO BE USED BY OCCUPANTS SHALL BE LOCATED NO MORE THAN 48 INCHES MEASURED FROM THE TOP OF THE OUTLET BOX AND NOT LESS THAN 15 INCHES MEASURED FROM THE BOTTOM OF THE OUTLET BOX ABOVE THE FINISH FLOOR. R327.1.2.
19. DOORBELL BUTTONS OR CONTROLS SHALL NOT EXCEED 48 INCHES (1219.2 MM) ABOVE EXTERIOR FLOOR OR LANDING, MEASURED FROM THE TOP OF THE DOORBELL BUTTON ASSEMBLY, WHERE DOORBELL BUTTONS INTEGRATED WITH OTHER FEATURES ARE REQUIRED TO BE INSTALLED ABOVE 48 INCHES (1219.2 MM) MEASURED FROM THE EXTERIOR FLOOR OR LANDING, A STANDARD DOORBELL BUTTON OR CONTROL SHALL ALSO BE PROVIDED AT A HEIGHT NOT EXCEEDING 48 INCHES (1219.2 MM) ABOVE EXTERIOR FLOOR OR LANDING, MEASURED FROM THE TOP OF THE DOORBELL BUTTON OR CONTROL. R327.1.4.
20. SURGE PROTECTION REQUIREMENTS:
 - A. ALL SERVICES SUPPLYING DWELLING UNITS SHALL BE PROVIDED WITH A SURGE-PROTECTIVE DEVICE (SPD).
 - B. LOCATION - THE SPD SHALL NOT BE AN INTEGRAL PART OF THE SERVICE EQUIP-MENT OR SHALL BE LOCATED IMMEDIATELY ADJACENT THERETO.
 - C. LOCATION: THE SPD SHALL NOT BE REQUIRED TO BE IN THE SERVICE EQUIPMENT AS REQUIRED IN D.
 - D. IF LOCATED AT EACH NEXT LEVEL, DISTRIBUTION EQUIPMENT DOWN-STREAM TOWARD THE LOAD.
 - E. TYPE - THE SPD SHALL BE A TYPE 1 OR TYPE 2 SPD.

LIGHTING NOTES

1. PROVIDE LIGHTING CONTROL WITH CONTINUOUS DIMMING IN ALL AREAS. PROVIDE REQUIRED DRIVERS AND DIMMER SWITCHES FOR CONTINUOUS DIMMING USING 0-10 VOLT DIMMING.
2. LIGHTING SHALL PROVIDE NOT LESS THAN 215 LUX (20 FOOT-CANDLES) AS MEASURED 30" ABOVE FLOOR.
3. IF APPLICABLE, SPECIFY THAT THE EXHAUST FANS TO BE ON A SEPARATE SWITCH FROM LIGHTS PER CENC 150.0(K)2E.
4. ALL INSTALLED LUMINAIRES SHALL BE HIGH-EFFICACY IN ACCORDANCE WITH ES TABLE 150.0-A.
5. A. LUMINAIRES MUST HAVE A LABEL CERTIFIED FOR AIRTIGHT CONSTRUCTION.
B. LIGHT SOURCES THAT ARE NOT MARKED "JAS-B19-D1-E" SHALL NOT BE INSTALLED IN ENCLOSED LUMINAIRES. ES 150.0(K)
6. BATHROOMS, GARAGE, LAUNDRY ROOMS, AND UTILITY ROOM LIGHTING TO HAVE ONE LUMINAIRE CONTROLLED BY A VACANCY OR OCCUPANCY SENSOR PROVIDING AUTOMATIC OFF FUNCTIONALITY PER CENC SECTION 150.0(K)2C. IF AN OCCUPANCY SENSOR IS INSTALLED, IT SHALL BE INITIALLY CONFIGURED TO MANUAL-ON OPERATION USING THE MANUAL CONTROL REQUIRED UNDER SECTION 150.0(K)2C.
7. ALL OTHER LUMINAIRES THAT CONTAIN LIGHT SOURCES THAT MEET REFERENCE JOINT APPENDIX JAB REQUIREMENTS ARE TO BE CONTROLLED BY A VACANCY/OCCUPANCY SENSOR OR DIMMER PER CENC SECTION 150.0(K)2I AND TO BE CLOSETED WITH AN AREA LESS THAN 70 FT² AND HALLWAY LIGHTING ARE EXEMPT FROM THIS REQUIREMENT.
8. RECESSED CAN LIGHT FIXTURES SHALL BE IC LISTED, AIR-TIGHT LABELED, AND NOT BE EQUIPPED WITH A STANDARDS MEDIUM BASE SCREW SHELL LAMP HOLDER. ES 150.0(K)
9. SFD OUTDOOR LIGHTING FIXTURES THAT ARE ATTACHED TO A BUILDING ARE REQUIRED TO BE HIGH EFFICACY. SFD HALLWAY LIGHTING FIXTURES THAT ARE ATTACHED TO A BUILDING ARE REQUIRED TO HAVE BOTH MOTION SENSOR AND PHOTOCELL CONTROL. SEE ES 150.0(K)3 FOR ADDITIONAL CONTROL OPTIONS.

MECHANICAL NOTES:

EXHAUST FAN NOTES

1. KITCHENS REQUIRE EXHAUST FANS WITH A MINIMUM 130 CFM (280 CFM IF GAS RANGE) DUCTED TO THE EXTERIOR. DETAIL COMPLIANCE BY INCLUDING A COMPLYING EXHAUST FAN OR A DUCTED RANGE HOOD TO THE EXTERIOR.
2. BATHROOMS REQUIRE EXHAUST FANS (MINIMUM 50 CFM) TO BE DUCTED TO THE EXTERIOR. A BATHROOM IS DEFINED "AS A ROOM WITH A BATHTUB, SHOWER, OR SPA OR SOME SIMILAR SOURCE OF MOISTURE".
3. RESIDENTIAL BATHROOM EXHAUST FANS SHALL BE ENERGY STAR RATED AND SHALL BE CONTROL BY A HUMIDISTAT CAPABLE OF AN ADJUSTMENT BETWEEN 50 AND 80% HUMIDITY. CALGREEN 4.506.1. EXCEPTION: CONTROL BY A HUMIDISTAT IS NOT REQUIRED IF THE BATHROOM EXHAUST FAN IS ALSO THE DWELLING WHOLE HOUSE VENTILATION.

SMOKE & CARBON MONOXIDE NOTES:

SMOKE & CARBON MONOXIDE ALARM NOTES

1. SMOKE ALARMS SHALL BE INTERCONNECTED PER CRC R314.4.
2. SMOKE ALARMS SHALL BE HARD-WIRED WITH BATTERY BACK-UP PER CRC R314.6 IN THE FOLLOWING LOCATIONS ON FLOOR PLANS OR UTILITY PLANS (CRC R314.3):
 - A. OUTSIDE EACH SEPARATE SLEEPING AREA IN IMMEDIATE VICINITY OF BEDROOMS
 - B. ON EACH STORY OF DWELLING
 - C. IN ANY BEDROOM WITH A FUEL-BURNING APPLIANCE LOCATED WITHIN THAT BEDROOM OR ITS ATTACHED BATHROOM
3. CARBON MONOXIDE DETECTOR SHALL BE INTERCONNECTED PER CRC R315.1.7 AND HARD-WIRED WITH BATTERY BACK-UP PER CRC R315.5. IN THE FOLLOWING LOCATIONS ON FLOOR PLANS OR UTILITY PLANS IN DWELLING UNITS WITH FUEL-BURNING APPLIANCES, FIREPLACE, OR AN ATTACHED GARAGE:
 - A. OUTSIDE EACH SEPARATE SLEEPING AREA IN IMMEDIATE VICINITY OF BEDROOMS
 - B. ON EACH STORY OF DWELLING
 - C. IN ANY BEDROOM WITH A FUEL-BURNING APPLIANCE LOCATED WITHIN THAT BEDROOM OR ITS ATTACHED BATHROOM
4. COMBINATION SMOKE AND CARBON MONOXIDE ALARMS SHALL BE LISTED IN ACCORDANCE WITH UL-217 AND UL-2034, CRC R314.1.1 & R315.1.1.
5. SMOKE ALARMS SHALL BE LOCATED AT LEAST 3 FT FROM THE ENTRY DOOR TO ANY BATHROOM CONTAINING A BATHTUB/SHOWER, CRC R314.3.3.
6. ALL SMOKE ALARMS SHALL BE LOCATED AT LEAST 20 FT FROM A PERMANENTLY INSTALLED COOKING APPLIANCE, CRC R314.3.3.
 - A. SMOKE ALARMS SHALL BE ALLOWED TO BE 10 FT FROM A PERMANENTLY INSTALLED COOKING APPLIANCE IF THE SMOKE ALARM IS AN IONIZATION SMOKE ALARM WITH ALARM SILENCING SWITCH, OR PHOTOELECTRIC SMOKE ALARM IN ACCORDANCE CRC R314.3.3.4 (EXCEPTION).



ADU: 999 L-SHAPE
CITY OF CHULA VISTA
276 FOURTH AVENUE,

DESIGNER:
LUIS CALDERON
SnapADU


SIGNATURE

[illegible]


ELECTRICAL PLAN - OPTIONS

E102


22040

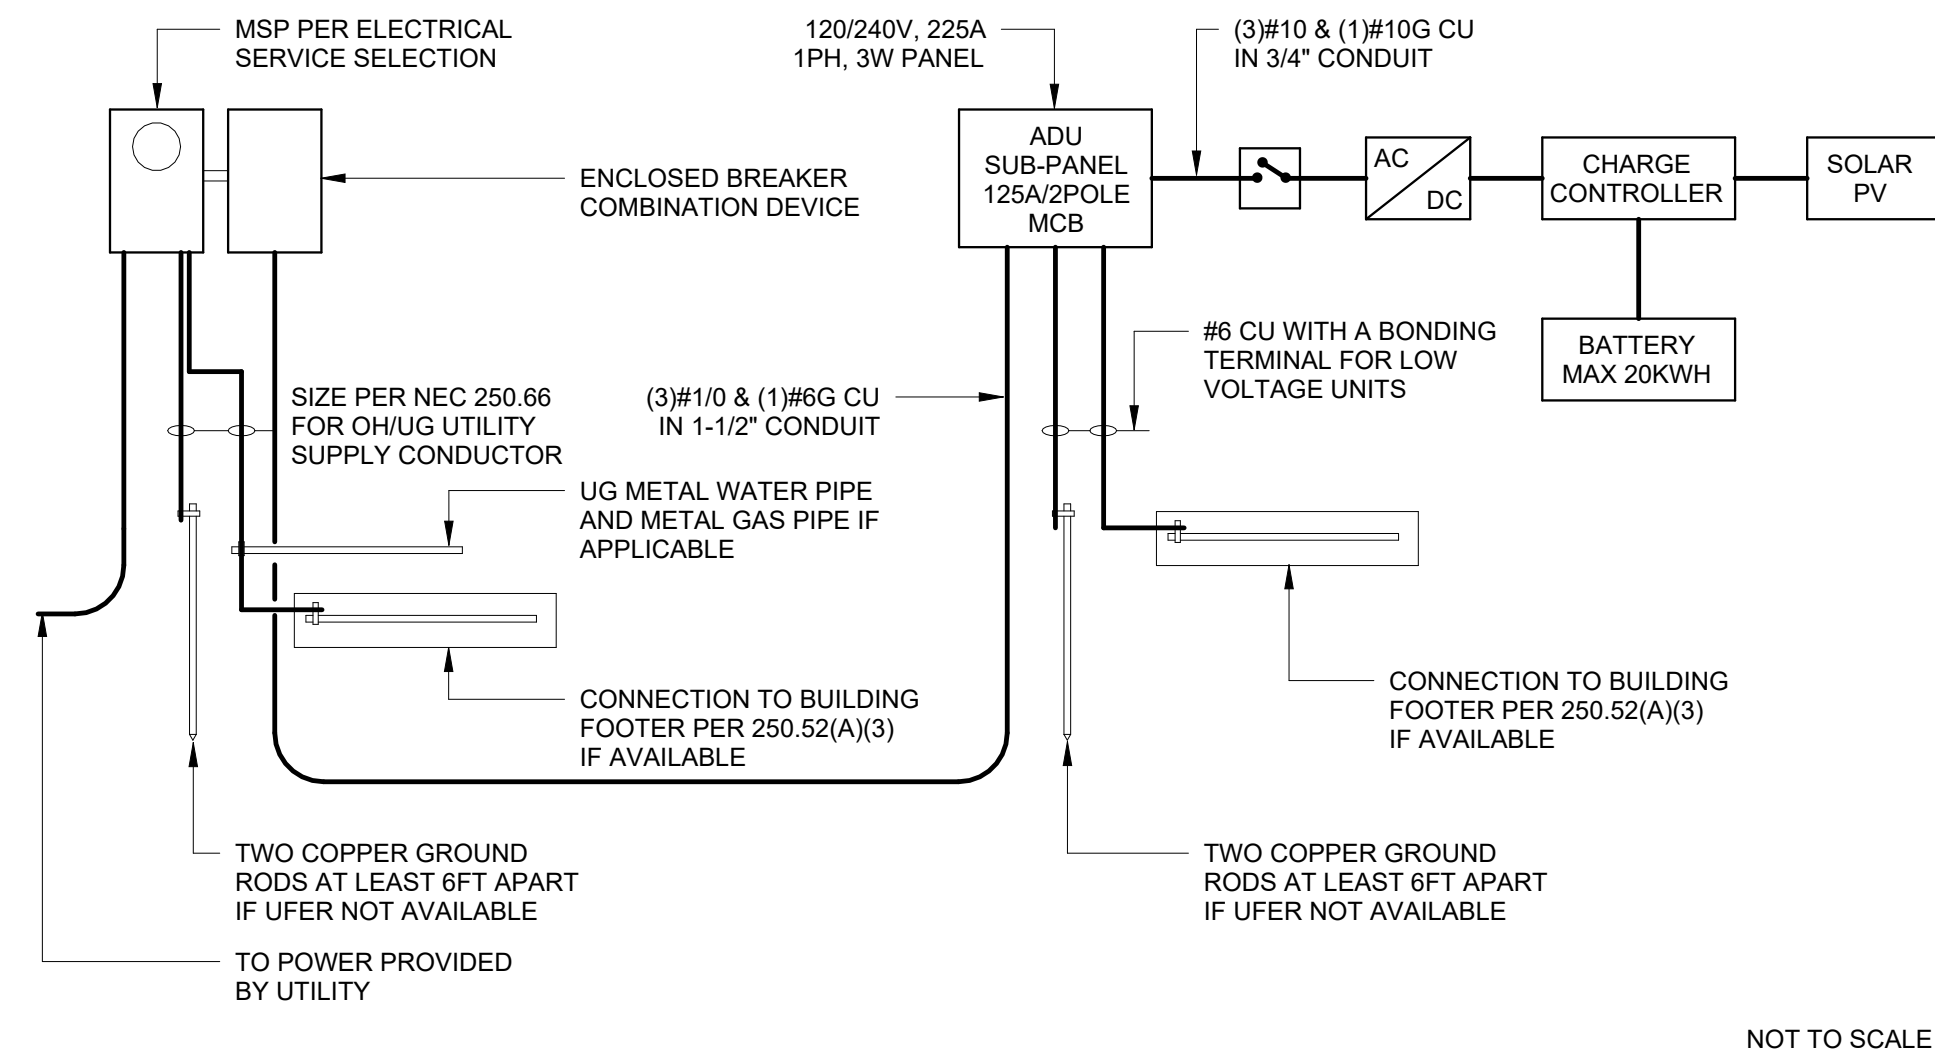


NOT TO SCALE

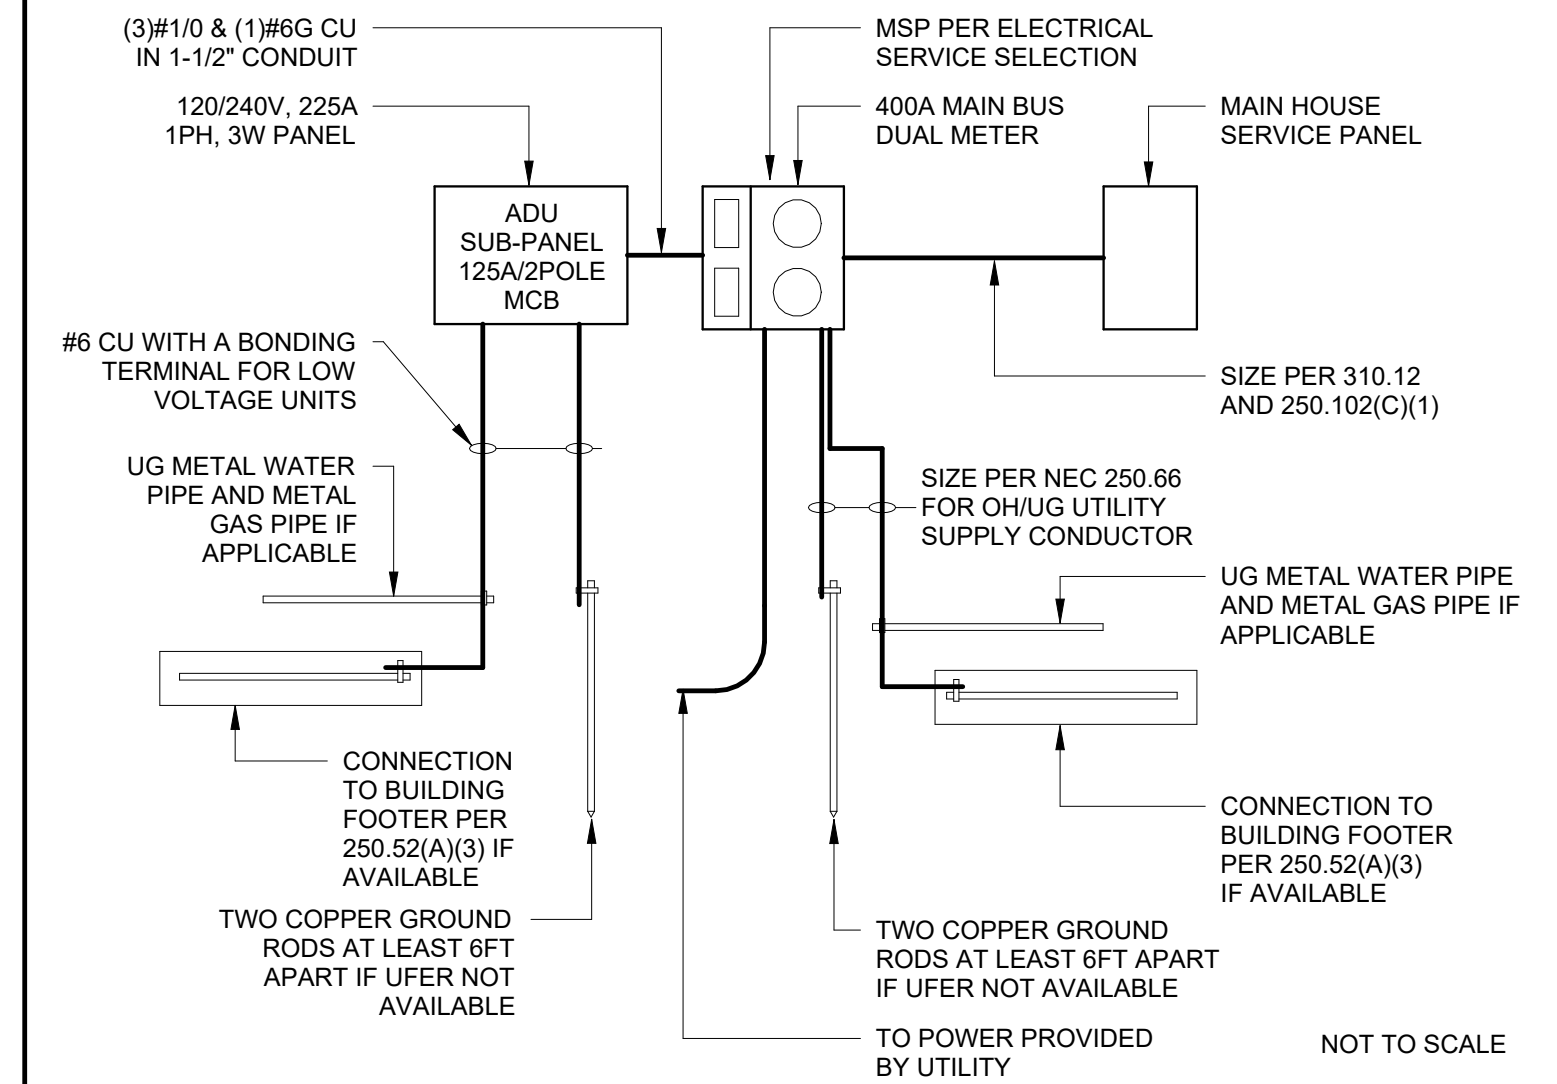

NOT TO SCALE

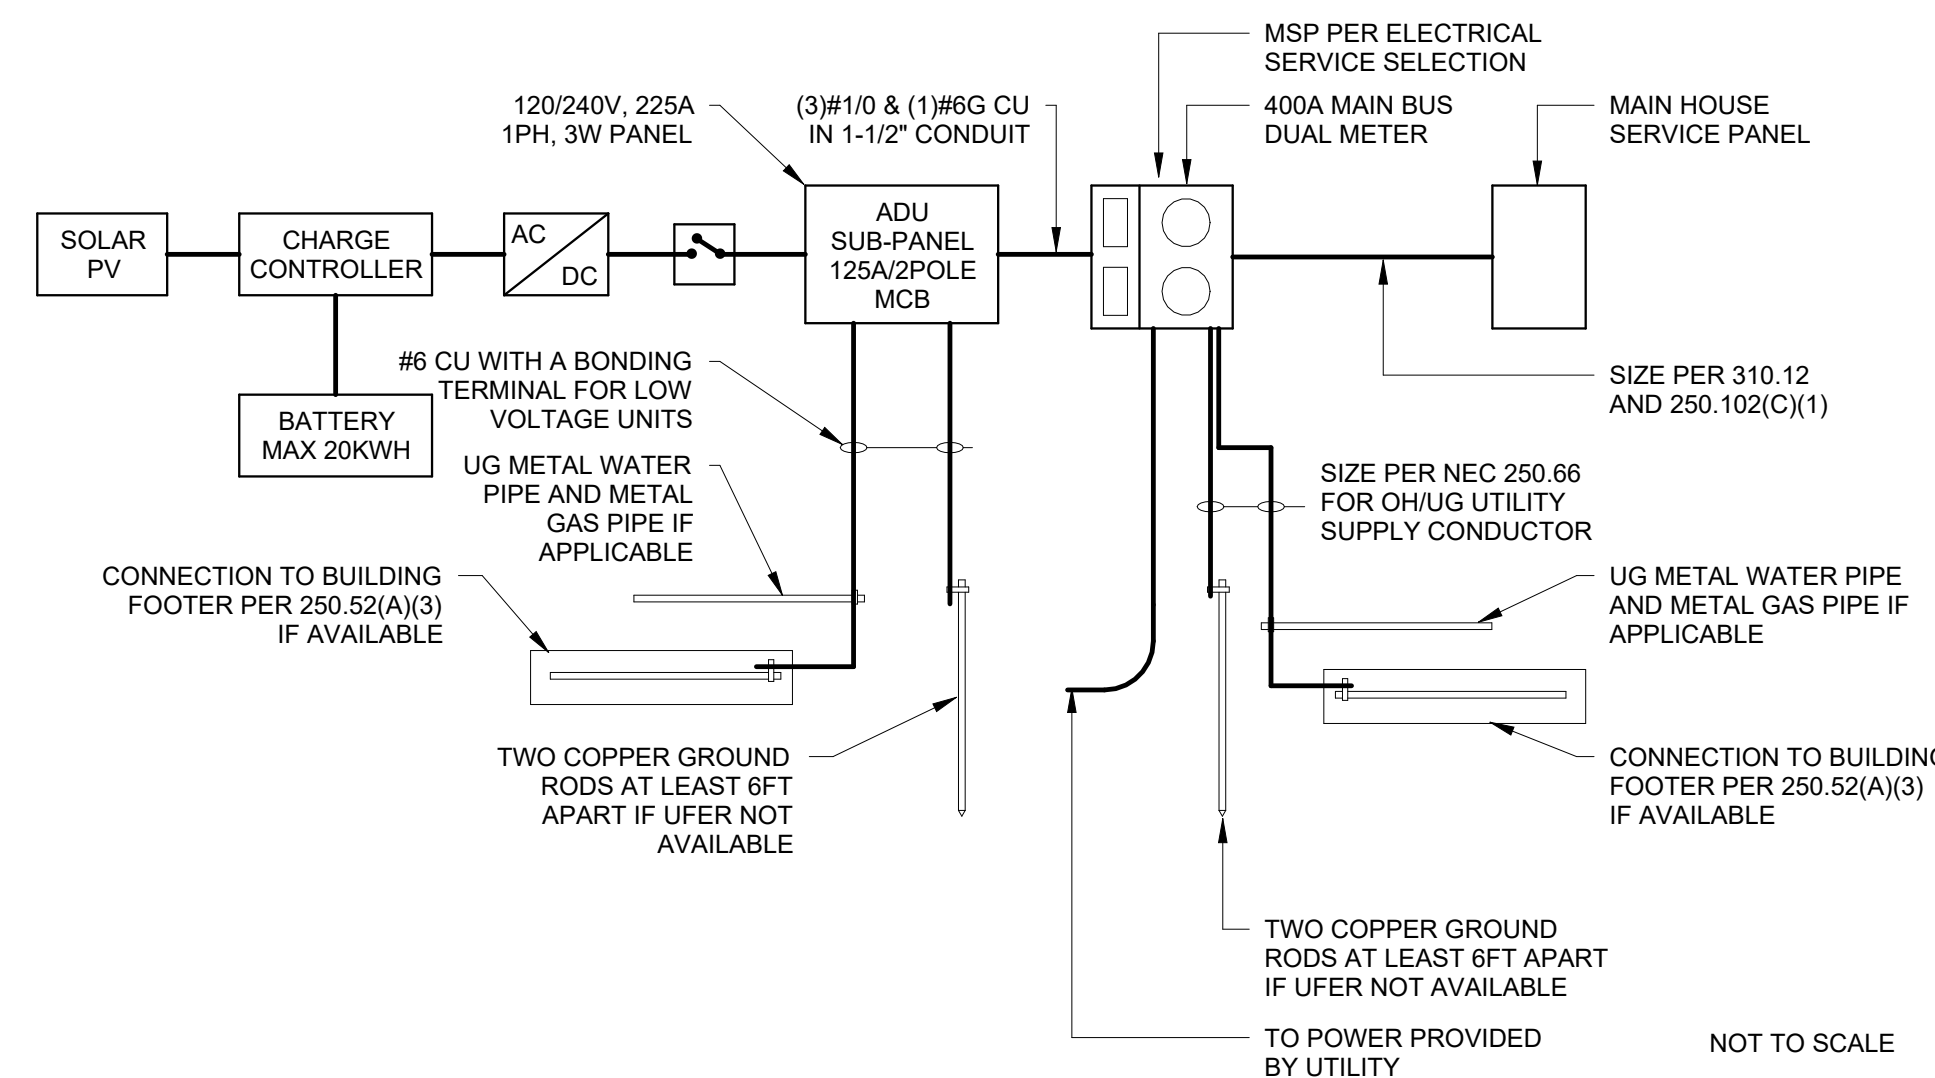

NOT TO SCALE

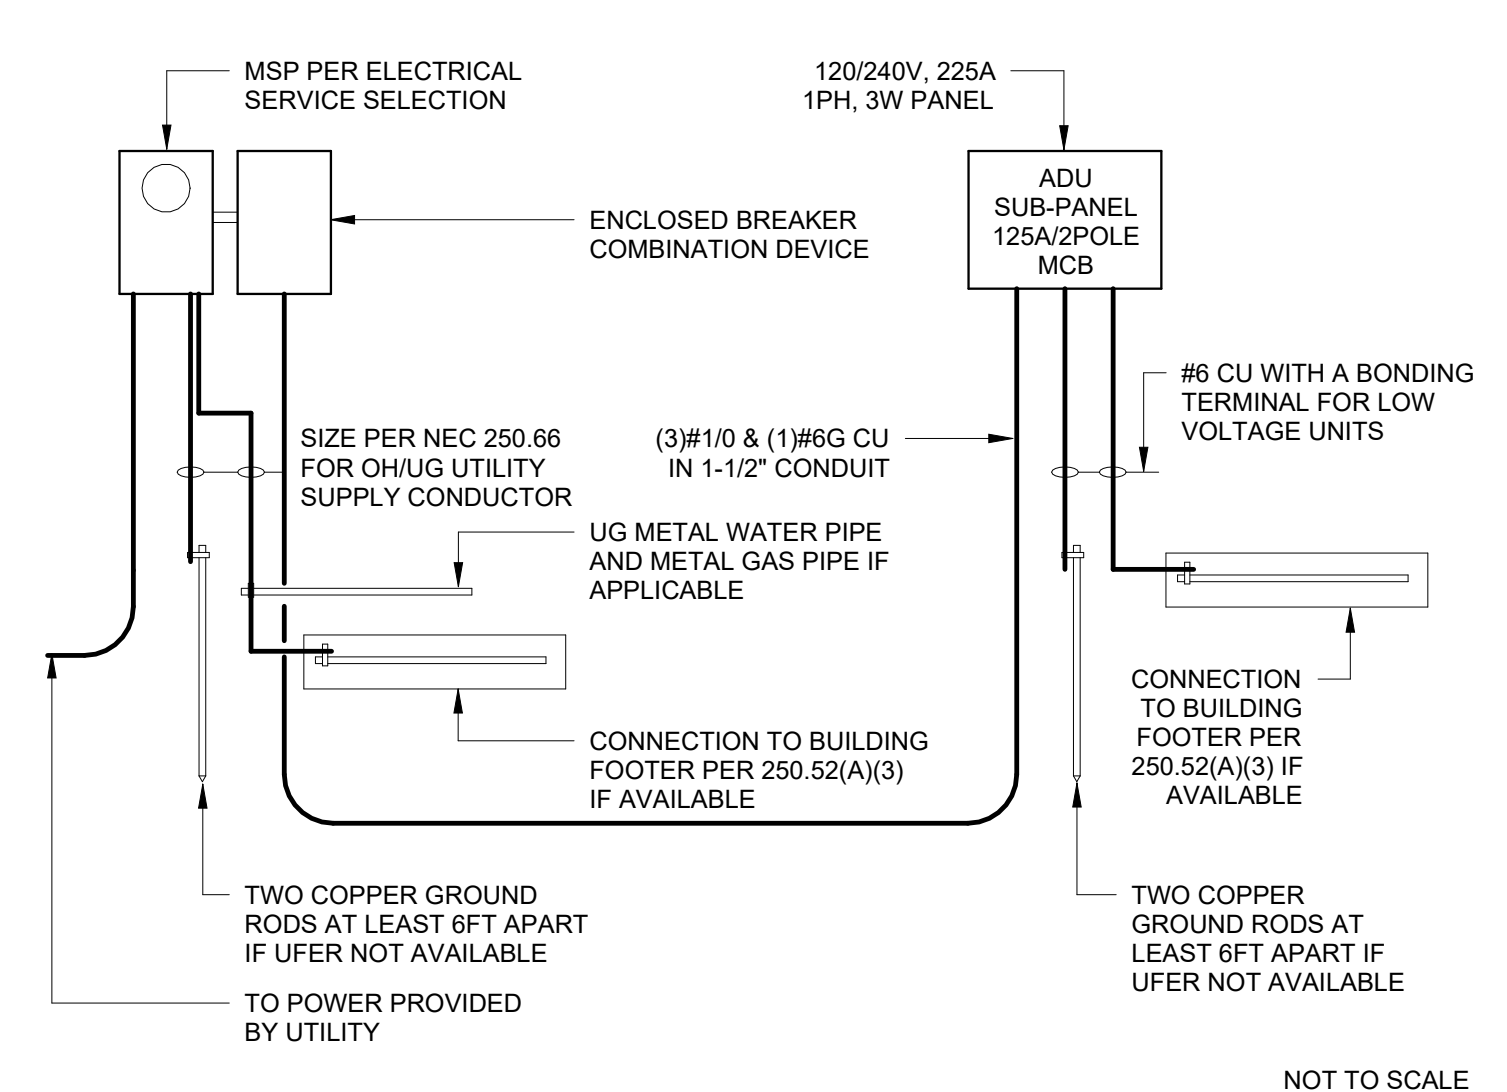

NOT TO SCALE

ESS PANEL SCHEDULE

ESS PANEL - 20/40 CKT 225A BUS 60A MLO 120/240V 1PH 3W OUTDOOR					
CKT #	C/B	LOAD	CKT #	C/B	LOAD
1			2		
3			4		
5			6		
7			8		
9			10		
11			12		
13			14		
15			16		
17			18		
19			20		

ELECTRICAL PANEL SCHEDULE

SUBPANEL - 30/60 CKT 225A BUS 100A MLO 120/240V 1PH 3W OUTDOOR					
CKT #	C/B	LOAD	CKT #	C/B	LOAD
1			2		
3			4		
5			6		
7			8		
9			10		
11			12		
13			14		
15			16		
17			18		
19			20		
21			22		
23			24		
25			26		
27			28		
29			30		



YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 999 L-SHAPE
CITY OF CHULA VISTA

276 FOURTH AVENUE,
CHULA VISTA, CA 91910

DESIGNER:
LUIS CALDERON
napADU


SIGNATURE

[illegible]


ELECTRIC PANEL SCHEDULE

E103


2040

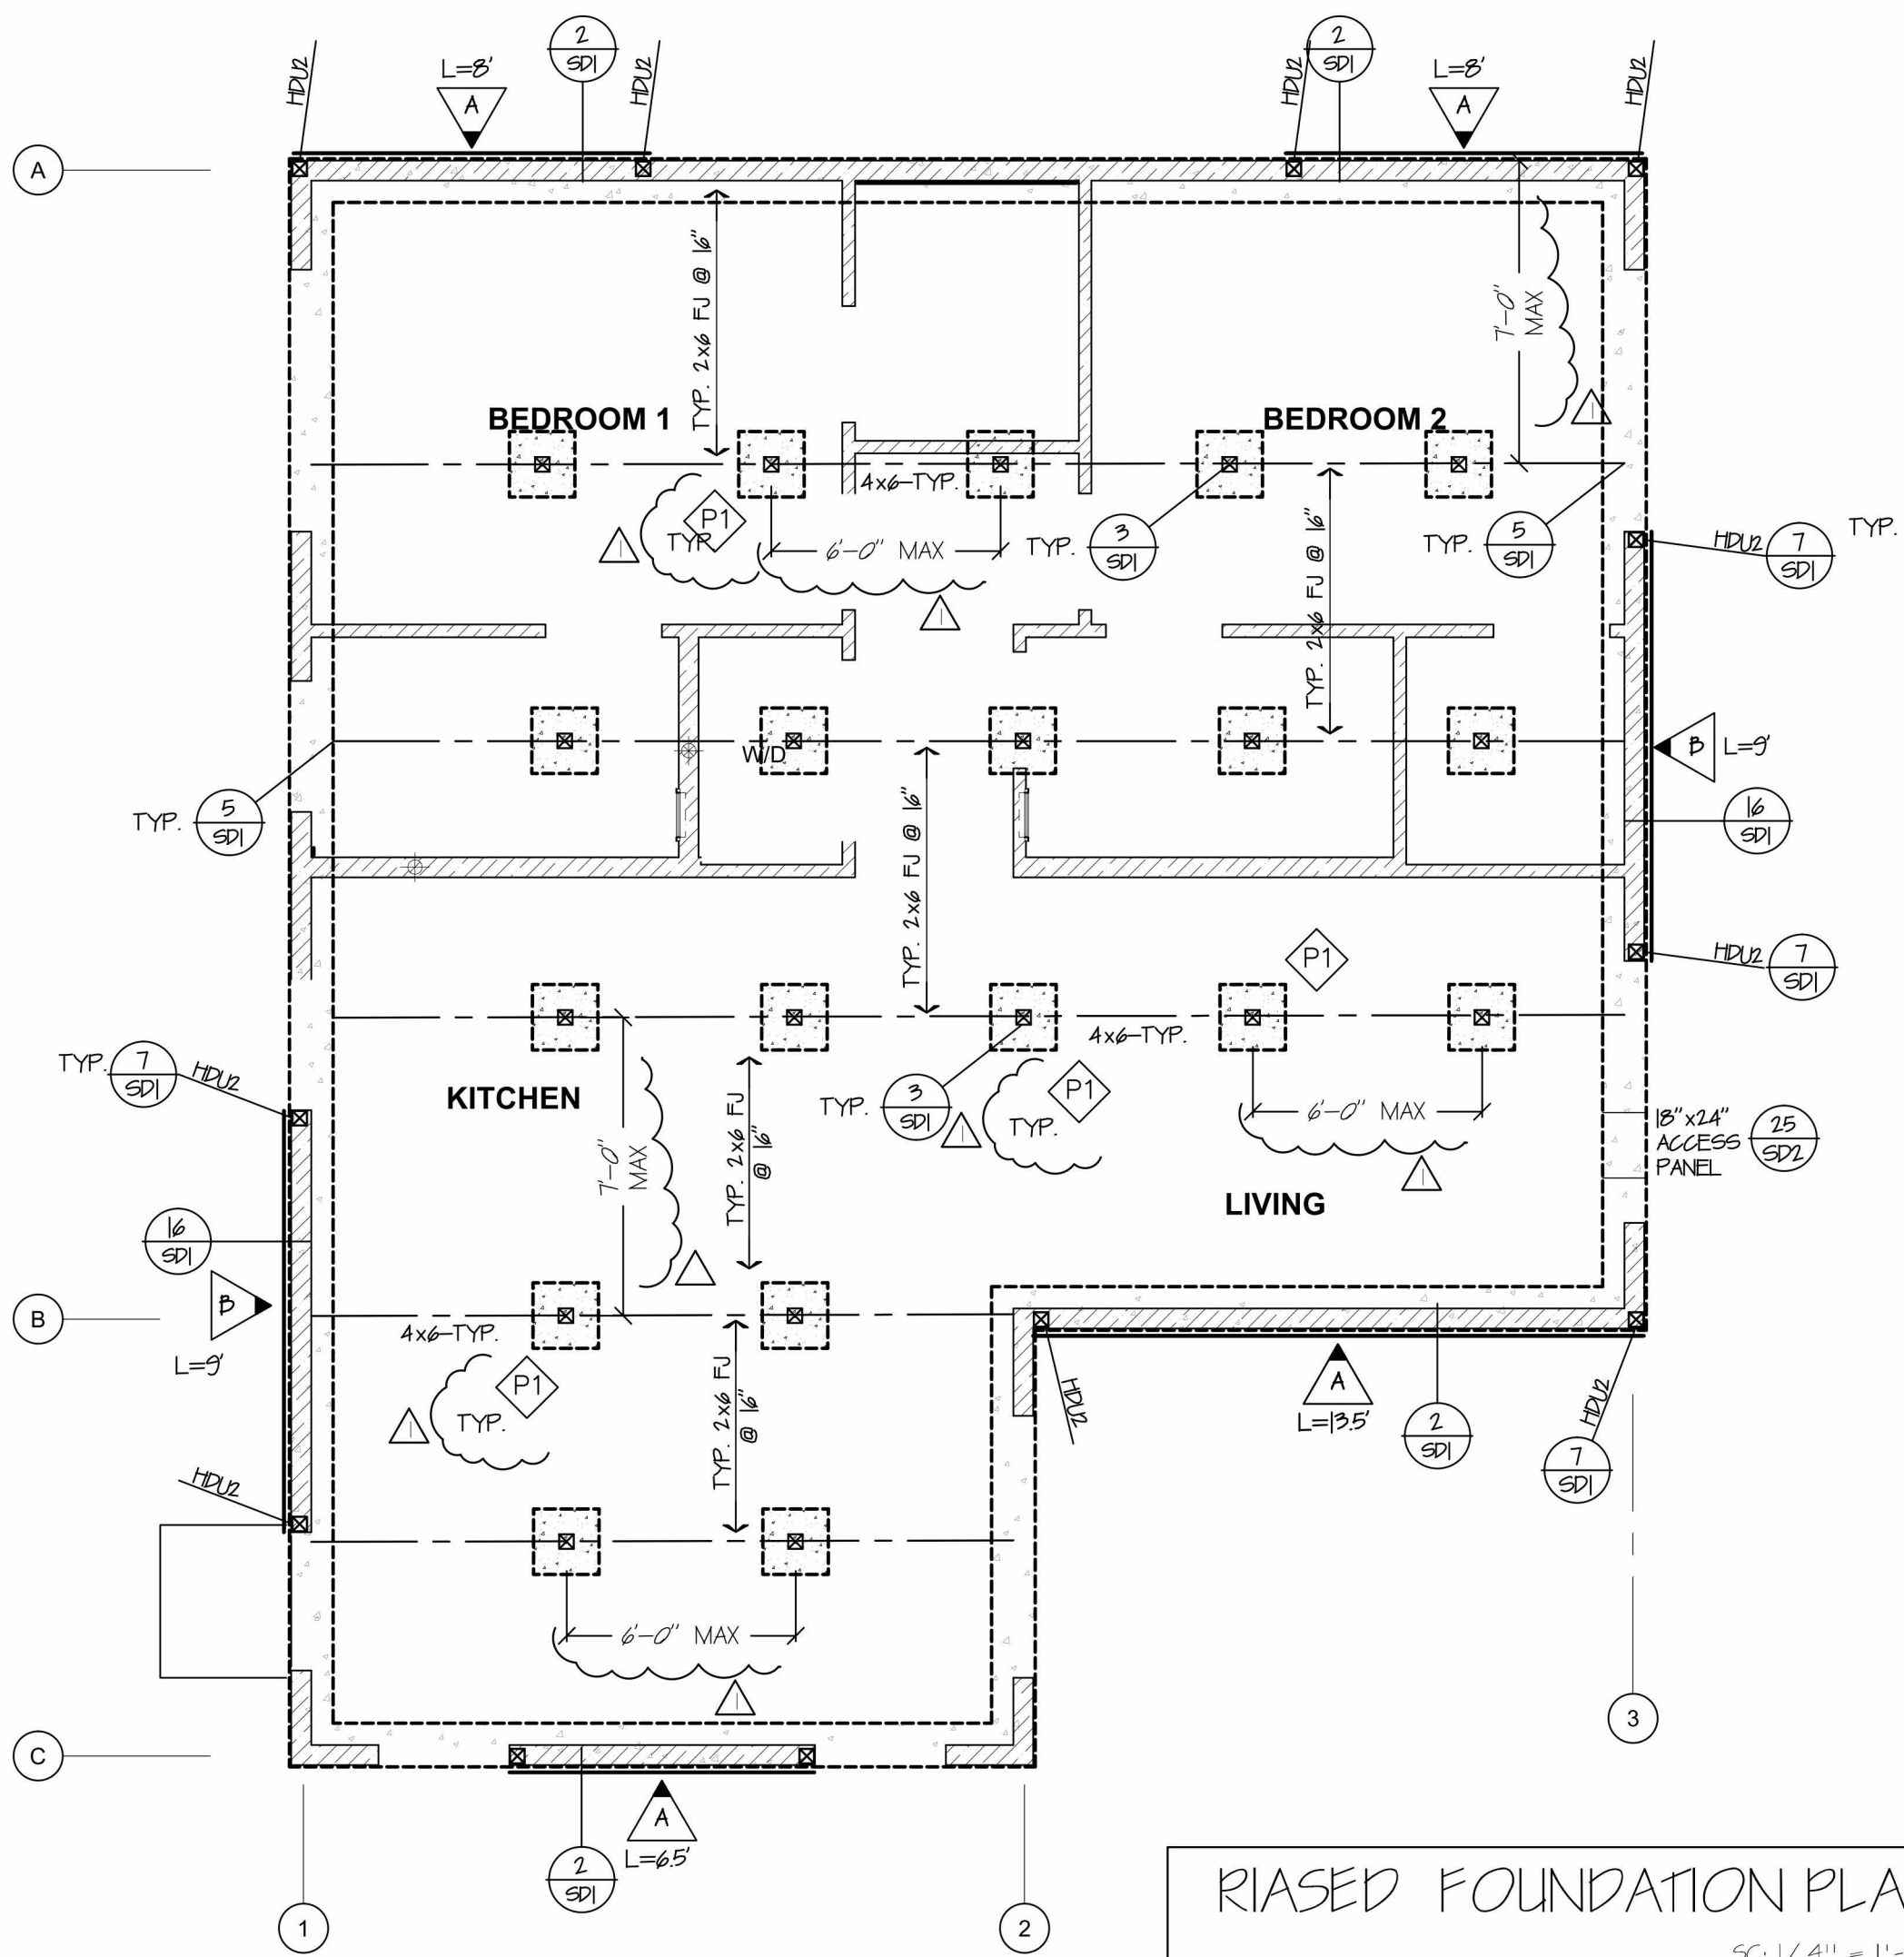

RIASED FOUNDATION PLAN
SC: 1/4" = 1'-0"

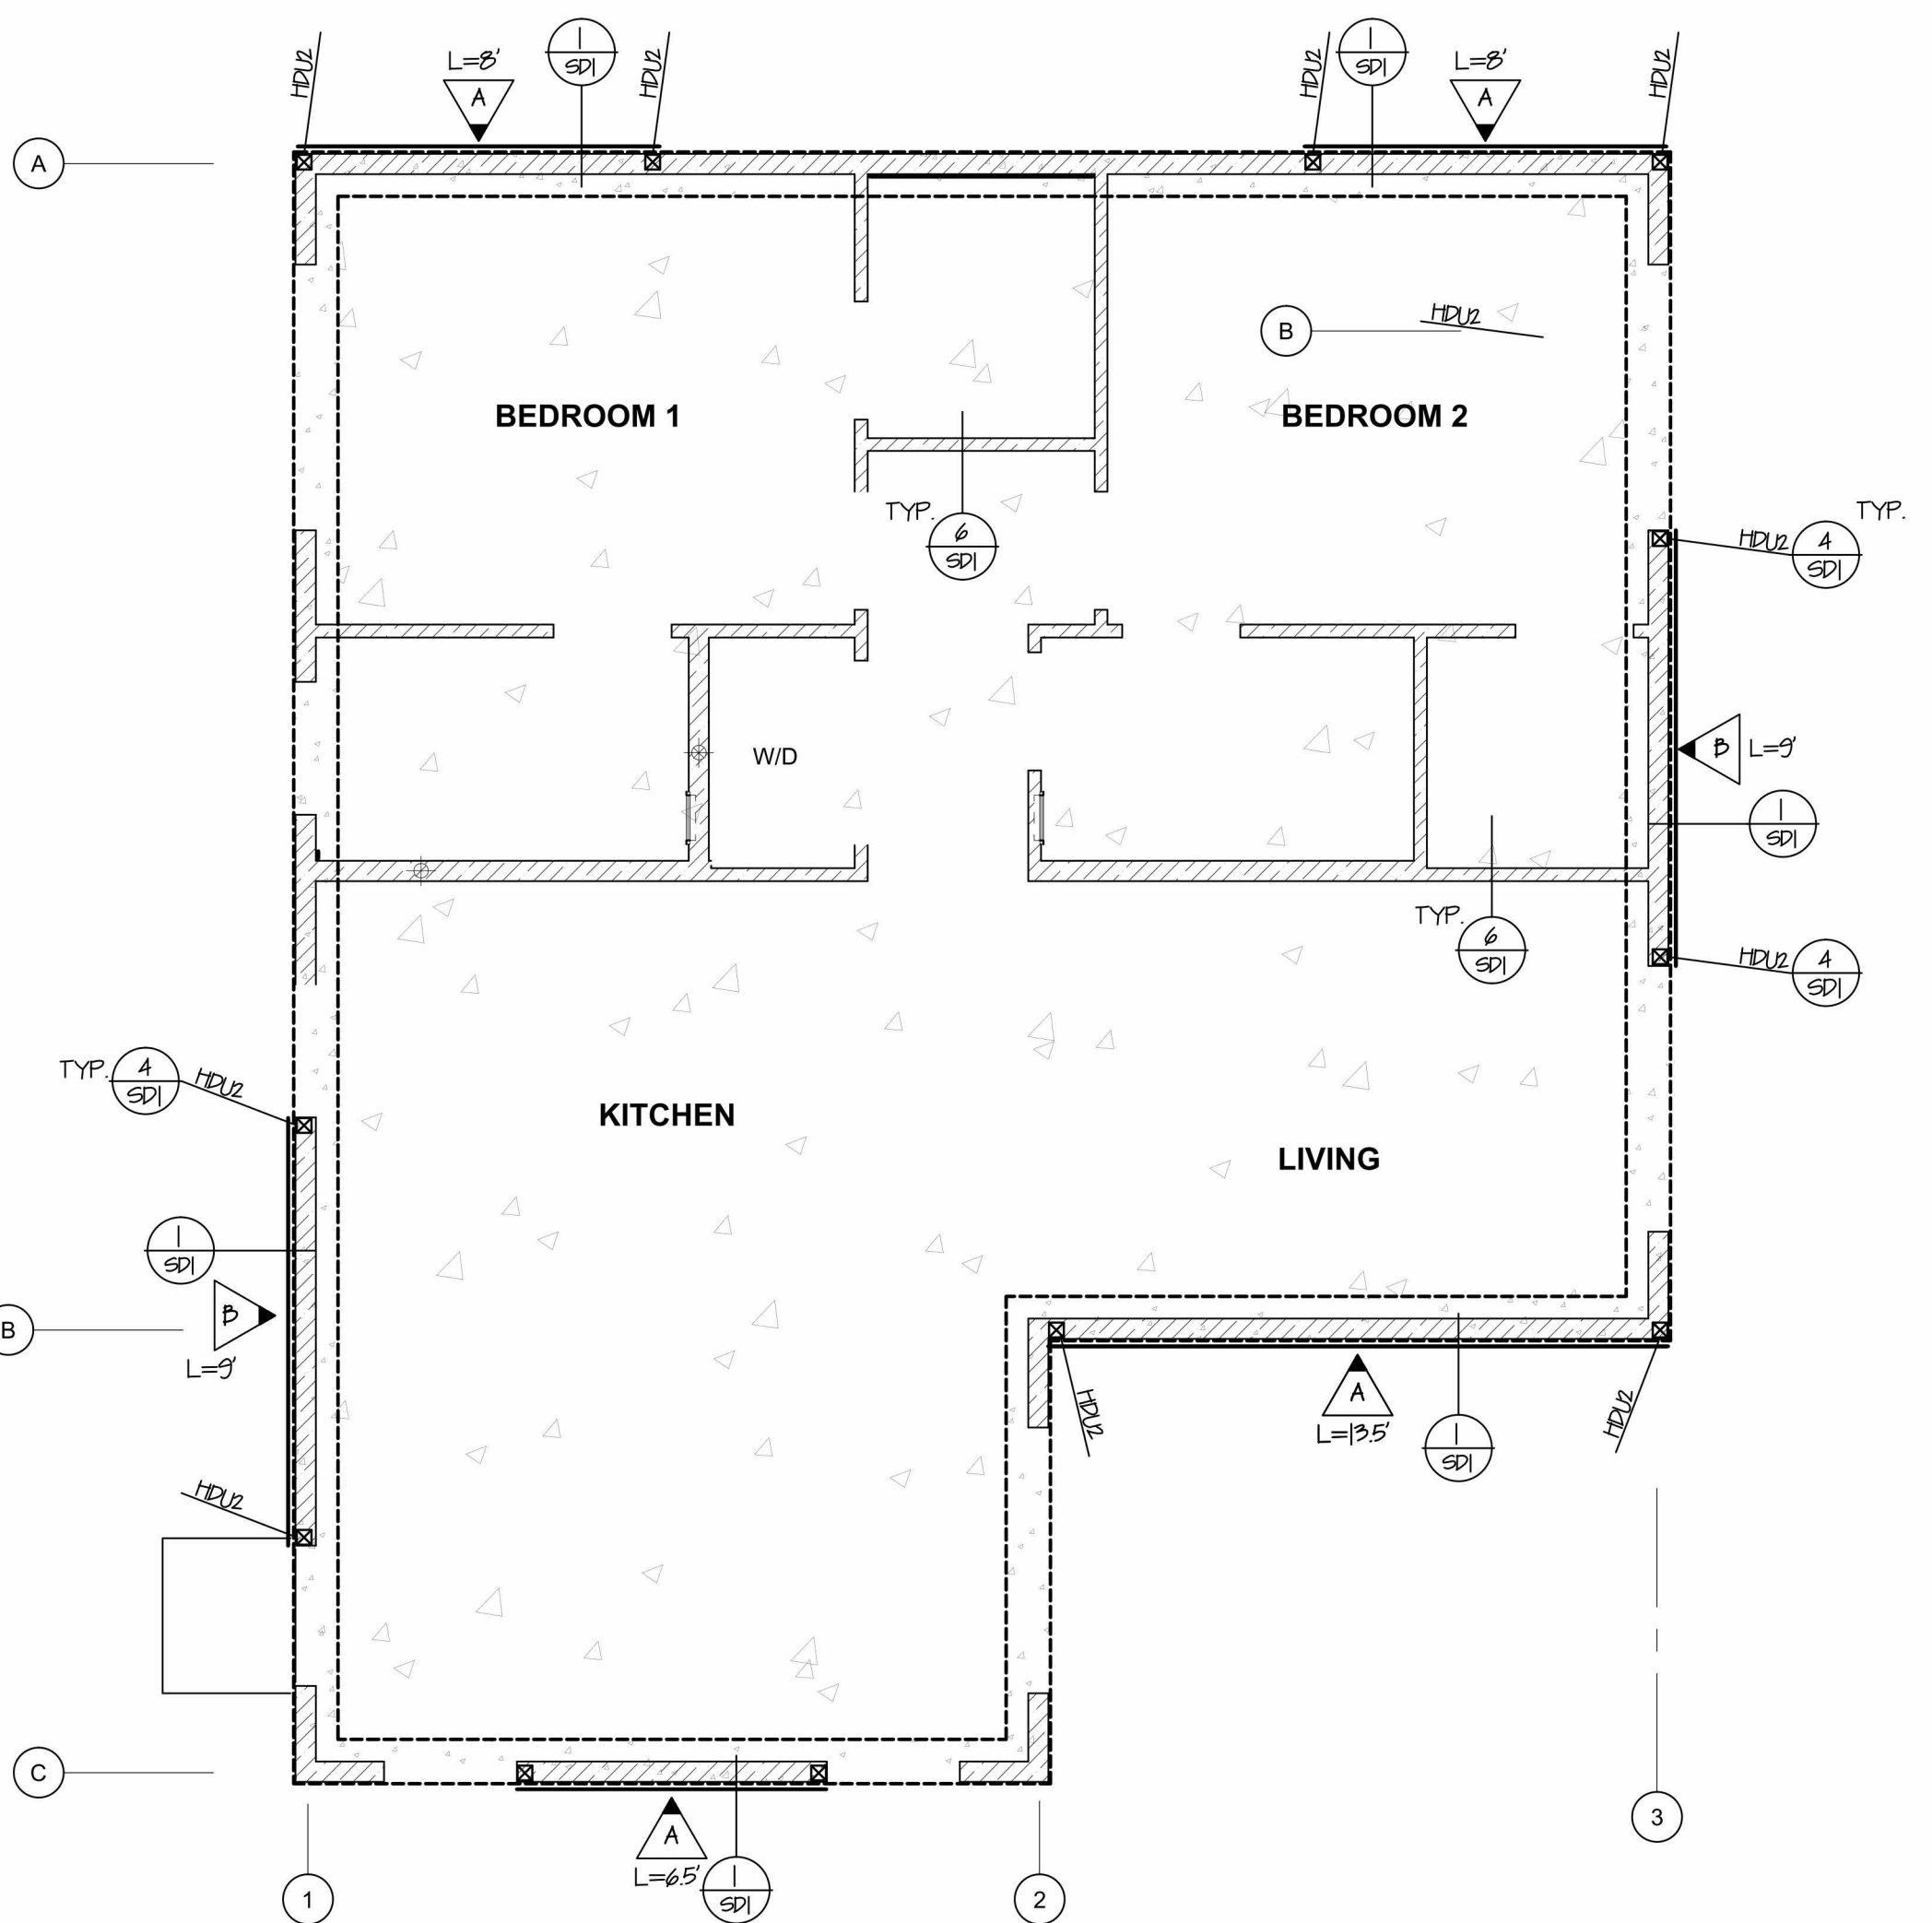

SLAB FOUNDATION PLAN
SC: 1/4" = 1'-0"

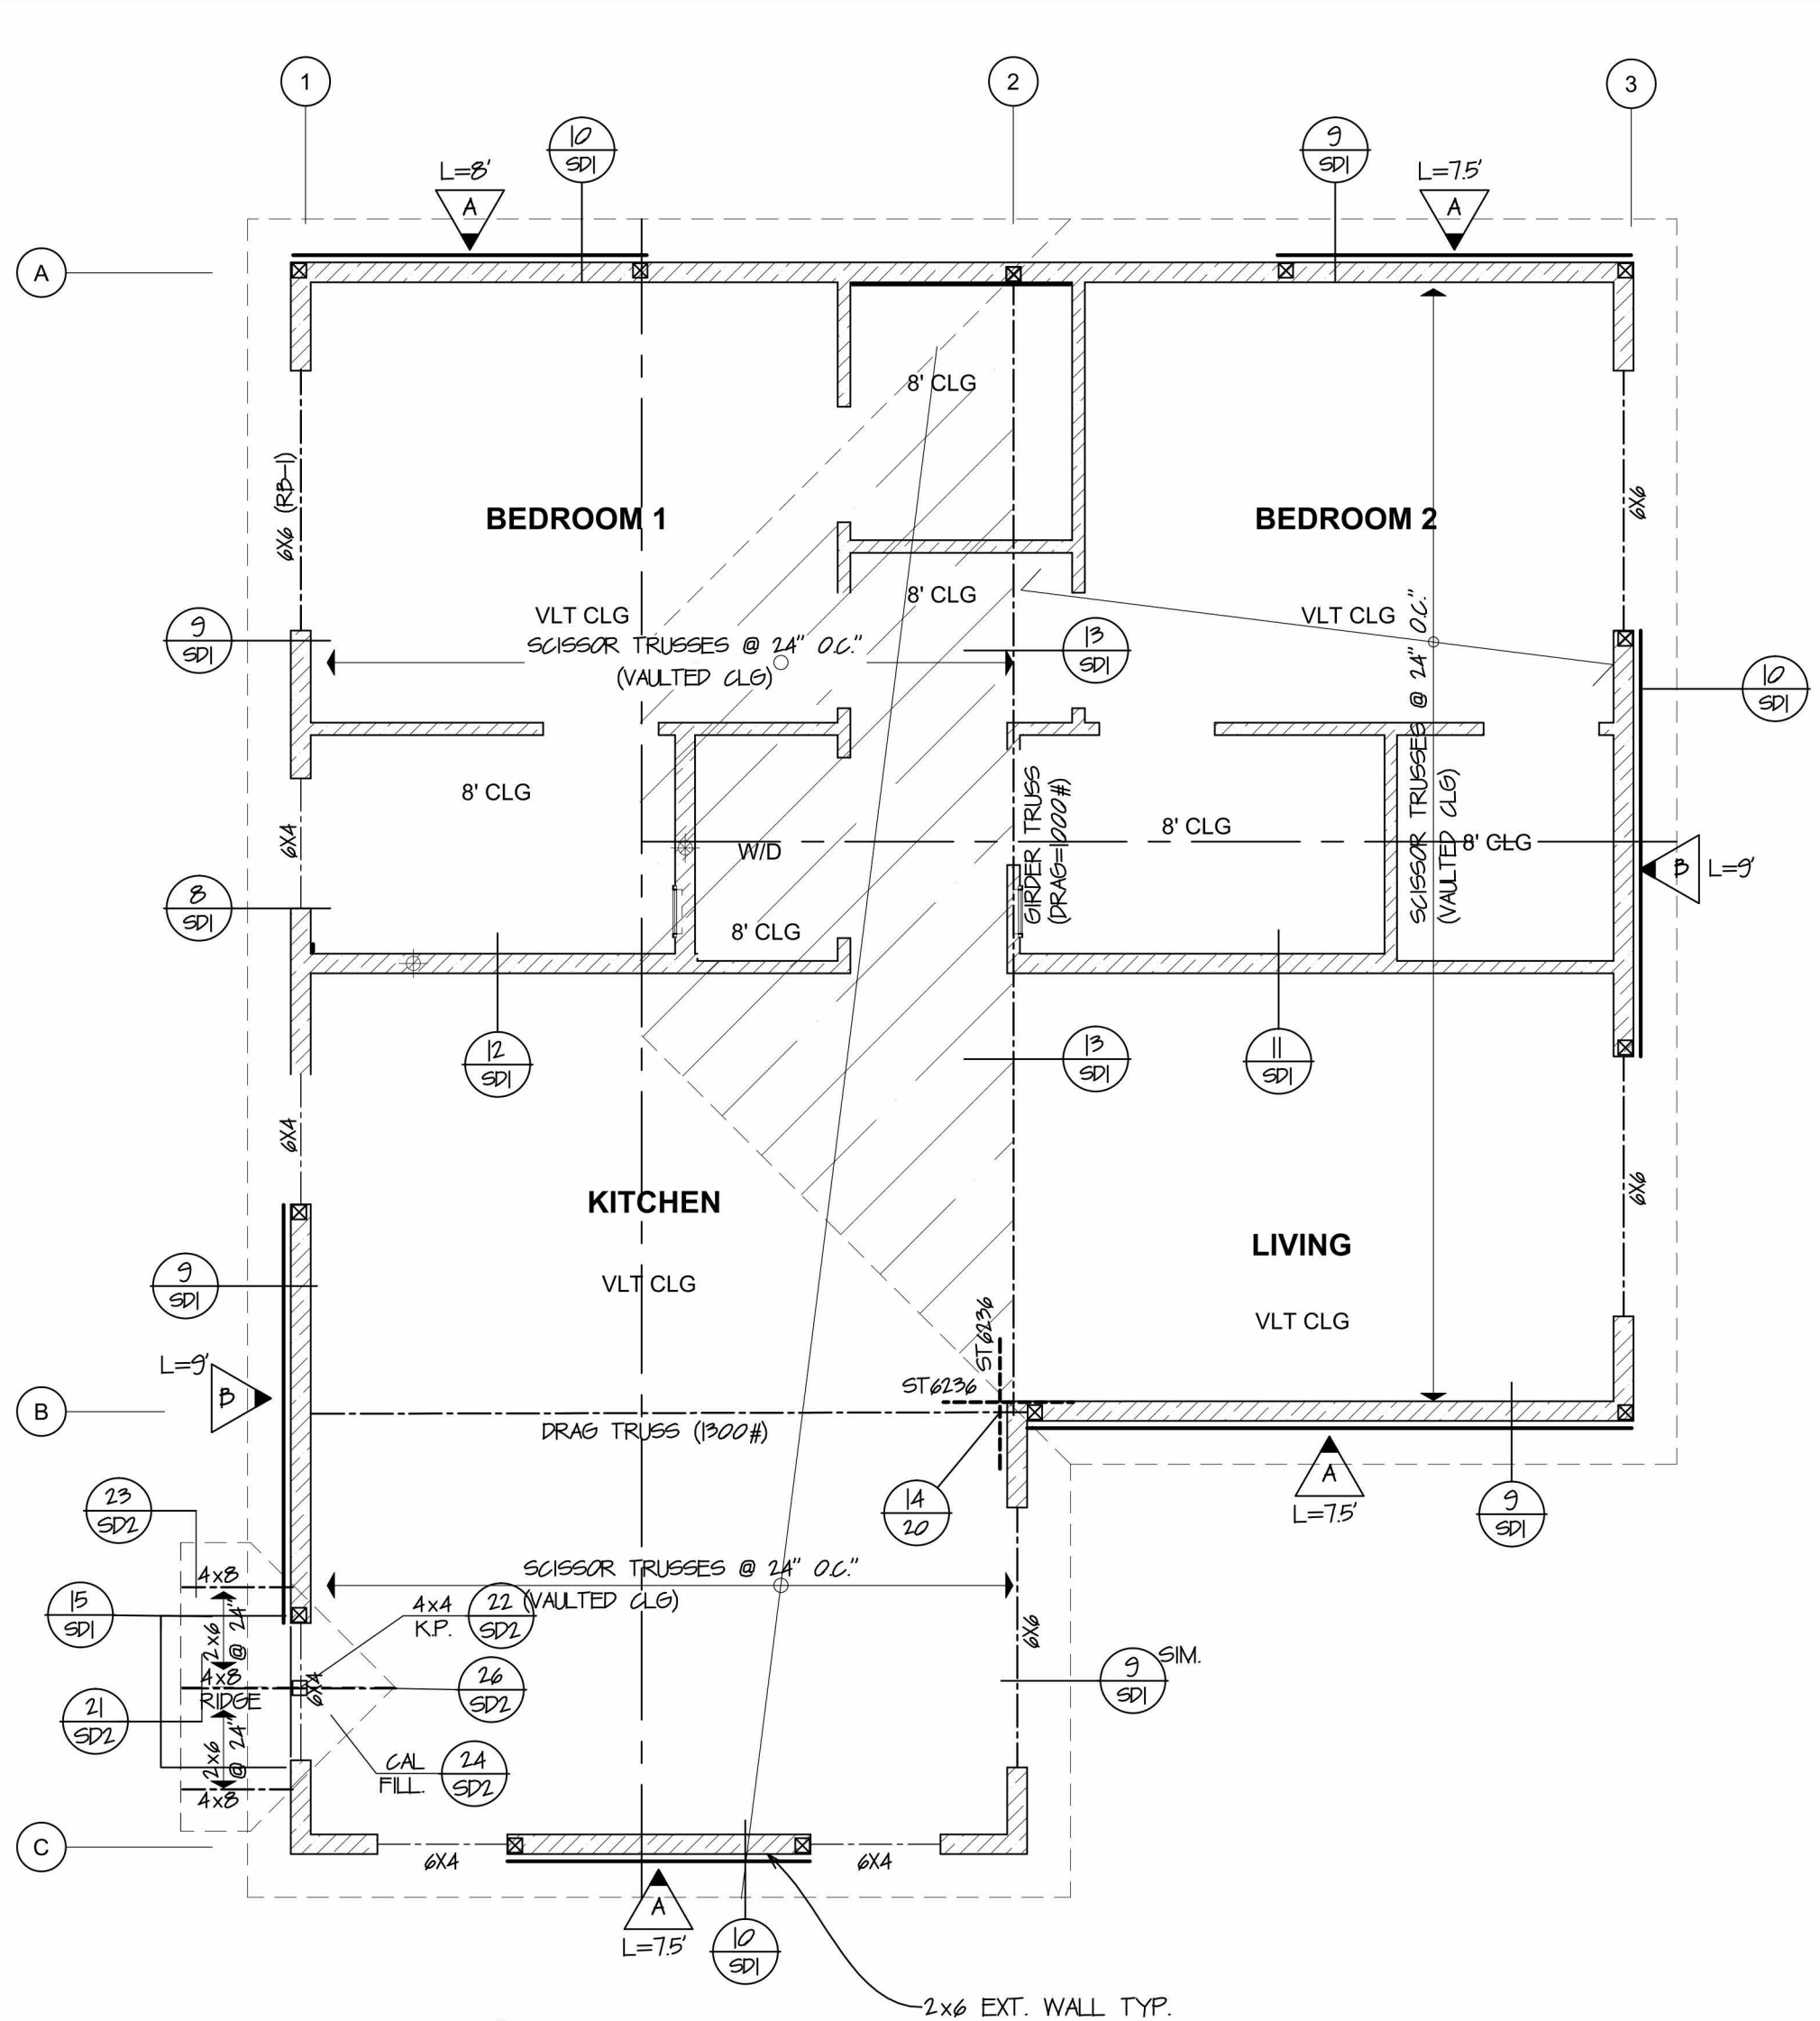

WALLS AND ROOF FRAMING PLAN
SC: 1/4" = 1'-0"

THE STRUCTURE(S) WILL BE LOCATED ENTIRELY ON UNDISTURBED NATIVE SOIL.

AS A CALIFORNIA LICENSED ENGINEER/ARCHITECT, I HAVE CLASSIFIED THE NON-EXPANSIVE NATURAL GROUND MATERIALS AS TYPE V PER TABLE RA0441 OF THE 2022 CALIFORNIA RESIDENTIAL CODE AND ASSIGNED A LOAD BEARING PRESSURE OF 1500 PSF FOR DESIGN OF FOUNDATIONS RELATED TO THIS PROJECT.

THE UNDERSIGNED ACKNOWLEDGES BY THEIR SIGNATURE BELOW THAT THE PRESUMPTIVE LOAD BEARING VALUE OF 1500 PSF IS ALLOWED FOR FOUNDATION DESIGN WHERE THE FOUNDATIONS ARE EMBEDDED IN NON-EXPANSIVE NATURAL GROUND. THE UNDERSIGNED UNDERSTANDS THAT IF THE BUILDING INSPECTOR SUSPECTS FILL, EXPANSIVE SOILS, OR ANY GEOLOGIC INSTABILITY BASED UPON OBSERVATION OF THE FOUNDATION EXCAVATION, A SOILS OR GEOLOGICAL REPORT, AND RESUBMITTAL OF THE PLANS TO PLAN CHECK TO VERIFY THAT THE REPORT RECOMMENDATIONS HAVE BEEN INCORPORATED, MAY BE REQUIRED.

SIGNATURE: _____ OWNER/LICENSED ENGINEER OR ARCHITECT

SOILS

FRAMING NOTES

ROOF DIAPHRAGM

15/32" APA RATED SHEATHING (MIN), EXPOSURE 1, 24/0 MAX. SPAN RATINGS, w/ 8d COMMON NAILS @ 6" o.c. AT BOUNDARY & PANEL EDGE NAILING (EN), AND 12" o.c. AT INTERMEDIATE FRAMING MEMBERS.

FLOOR DIAPHRAGM

23/32" APA STURD-I-FLOOR, EXPOSURE 1, TONGUE AND GROOVE, w/ 10d COMMON NAILS @ 4" o.c. AT BOUNDARY & PANEL EDGE NAILING (EN), AND 12" o.c. AT INTERMEDIATE FRAMING MEMBERS.

FRAMING

1) ALL (2) 2x ROOF & FLOOR FRAMING TO HAVE MIN. 16d AT 12" O.C. T&D, STAGGERED.

2) ALL (2) 2x FRAMING TO HAVE MIN. 1/2" DIAMETER BOLTS AT 18" O.C. T&D, STAGGERED.

3) 2x SOLID BLOCKING REQUIRED AT POINTS OF SUPPORT FOR ALL HORIZONTAL FRAMING MEMBERS. IN ADDITION, ALL 2x10 AND LARGER MEMBERS SHALL HAVE SOLID FULL DEPTH BLOCKING OR BRIDGING AT MAX. 8'-0" o.c.

4) ALL WOOD POSTS AT UPPER FLOORS TO CONTINUE TO BEAM OR FOUNDATION.

5) UNLESS DETAILED OTHERWISE, ALL RIDGE / HIP / VALLEY CONNECTIONS TO HAVE A SIMPSON A95 CONNECTOR AT EACH CORNER WITH A 2x KICKER TO BEARING WALL.

6) AT ROOF-TO-WALL FRAMING, PROVIDE A95 FRAMING ANCHORS PER SHEARWALL SCHEDULE OR AT MAX. 48" O.C. FROM PLATES TO RAFTERS AND RAFTER BLOCKING AROUND PERIMETER OF BUILDING AND AT DRAG LINES AS INDICATED ON PLANS (SEE PLANS WHERE OTHER REQUIREMENTS MAY OCCUR).

7) PROVIDE DOUBLE JOISTS UNDER ALL PARALLEL WALLS, UNO.

8) WHEN SHEAR WALLS ARE SUPPORTED BY WOOD JOISTS THAT ARE PERPENDICULAR TO THE SHEAR WALL, ATTACH SOLID 4x BLOCKING UNDER SHEAR WALLS BETWEEN JOISTS. PROVIDE 2x SOLID BLOCKING UNDER NON-SHEAR WALLS PERPENDICULAR TO FLOOR JOISTS. SEE PLANS AND DETAILS WHERE OTHER REQUIREMENTS MAY OCCUR.

9) ATTACH MIN. 2x SOLID BLOCKING AND EDGE NAIL THE PERIMETER OF ALL OPENINGS OVER 10" IN WIDTH OR LENGTH IN ALL SHEAR PANELS AND DIAPHRAGMS. SEE DETAILS WHERE OTHER REQUIREMENTS MAY OCCUR.

10) ALL CONNECTORS AND METAL HARDWARE IN CONTACT WITH PRESSURE TREATED TIMBER SHALL HAVE CORROSION-RESISTANT COATINGS OR PROTECTION, SUCH AS "ZMAX", HOT DIPPED GALVANIZED, OR BE STAINLESS STEEL.

STUD SIZE	MAX. HEIGHT
2x4 @ 16" o.c.	10 FT
2x6 @ 16" o.c.	12 FT
2x6 @ 8" o.c.	14 FT
2x8 @ 16" o.c.	16 FT

LEGEND	
	Rf TRUSSES @ 24" o.c. UNO.
	2x6 F.J. @ 16" o.c. UNO.
	4x PM WIDTH POST UNO.
	POST ABOVE
	PLYWOOD SHEARWALL PER PLAN
	ST6236 SIMPSON STRAP, UNO.
	DRAG LINE PER PLAN SEE SHEARWALL NOTES ON SHEET S11

FOUNDATION NOTES

1) CONCRETE SHALL HAVE A MINIMUM ULTIMATE COMPRESSIVE STRENGTH OF 2500 PSI AT 28 DAYS FOR FURRED-IN-PLACE CONTINUOUS AND SPREAD FOOTINGS, AND 3000 PSI (SPECIAL INSP. REQ'D) AT 28 DAYS FOR GRADE BEAMS.

2) PORTLAND CEMENT SHALL BE TYPE II PER ASTM C 150. AGGREGATES SHALL BE PER ASTM C 39 WITH MAXIMUM SIZE OF 1 1/2" FOR FOOTINGS AND 1" FOR ALL OTHER WORK.

3) REINFORCING STEEL SHALL BE ASTM A615, GRADE 60, CLEAN AND RUST FREE. LAPS AT SPLICES AND FOUR LINES TO BE 40 BAR DIAMETERS (2'-0" MINIMUM) UNLESS NOTED OTHERWISE ON PLANS.

4) ALL NEW SILL PLATE ANCHOR BOLTS TO BE INSTALLED IN FRESH CONCRETE SHALL BE 5/8" DIAMETER A307 "L" BOLTS SPACED PER PLAN AND SHEARWALL SCHEDULE WITH MINIMUM 7" EMBEDMENT. MAXIMUM ANCHOR BOLT SPACING SHALL BE 4'-0" o.c. ANCHOR BOLTS AT ENDS OF WALL PANELS SHALL BE LOCATED WITHIN 12" AND GREATER THAN 7" BOLT DIAMETERS FROM THE END OF SILL PLATE. THERE SHALL BE A MINIMUM OF TWO ANCHOR BOLTS PER WALL PANEL. (ANCHOR BOLTS TO EXISTING FOOTINGS PER NOTE #8 BELOW). PLATE WASHERS A MINIMUM 3"x3"x0.2125" THICK SHALL BE USED ON EACH BOLT. ALL CONNECTORS AND METAL HARDWARE IN CONTACT WITH PRESSURE TREATED TIMBER SHALL HAVE CORROSION-RESISTANT COATINGS OR PROTECTION, SUCH AS "ZMAX", HOT DIPPED GALVANIZED, OR BE STAINLESS STEEL.

5) IF NO SOILS REPORT IS PROVIDED, ASSUMED ALLOWABLE SOIL BEARING PRESSURE (ASPP) SHALL BE 1500 PSF (PER SOL SITE CLASS D) & EMBED FOOTINGS A MINIMUM OF 12" INTO COMPETENT SOIL.

6) REINFORCING SHALL BE CONTINUOUS AROUND CORNERS AND THROUGH INTERSECTIONS.

7) CONSTRUCTION JOINTS SHALL BE PREPARED BY WIRE BRUSHING, CLEANING AND BRUSHING IN A PASTE OF NEAT CEMENT MORTAR IMMEDIATELY PRIOR TO POURING. LOCATION OF CONSTRUCTION JOINT SHALL BE APPROVED BY THE PROJECT STRUCTURAL ENGINEER.

8) ALL CONNECTORS AND METAL HARDWARE IN CONTACT WITH PRESSURE TREATED TIMBER SHALL HAVE CORROSION-RESISTANT COATINGS OR PROTECTION, SUCH AS "ZMAX", HOT DIPPED GALVANIZED, OR BE STAINLESS STEEL.

9) PRIOR TO POURING INTERIOR CONCRETE FLOOR SLABS, ALL SOIL BELOW FLOOR SHALL BE COMPACTED TO REQUIRED 90% DENSITY AND MOISTENED TO A DEPTH NOT LESS THAN 18" OR PER SOILS REPORT.

10) DEEPEN NEW FOOTINGS AS NECESSARY TO OBTAIN REQUIRED EMBEDMENT FOR ALL NEW HOLD DOWN BOLTS. ALL HOLD DOWN BOLTS TO HAVE A MINIMUM OF 3" OF CONCRETE COVER TO SOIL @ BOTTOM. ALL HOLD DOWN BOLTS MUST BE TIED IN PLACE PRIOR TO FOUNDATION INSPECTION.

11) ALL HOLD DOWNS MUST BE TIED IN PLACE PRIOR TO FOUNDATION INSPECTION.

12) MINIMUM HORIZONTAL DISTANCE FROM BOTTOM LEADING EDGE OF FOOTING TO DAYLIGHT SHALL BE 7'-0"

FOUNDATION LEGEND

	(N) 12" WIDE x 24" DEEP FOOTING W/ 2-#4 T. & D.
	(N) CONG. PAD PER PLAN

	4x PM WIDTH POST UNO.
	POST ABOVE
	SHEARWALL PER PLAN

CONCRETE SLAB

USE 4" THK. CONG. SLAB W/ #3 @ 16" O.C. EW. @ MID-HEIGHT, 0/ 2" SAND, 0/ 10 ML VAPOR BARRIER (ASTM E36 & E1145), 0/ 2" SAND BASE.

CONCRETE PAD SCHEDULE

PAD	SIZE
P1	18" SQ.x14" THK. CONG. PAD W/ 2-#4 EW.

REVISIONS

BY

DATE

DESCRIPTION

PCSD

Full Construction Set Plans

Engineering

PH 760.207.1885

pcsd@pcsd.com

PROJECT:

New Detached ADU

CHULA VISTA, CA

DRAWING:

Accessory Dwelling Unit

Standard L-2-Bedroom 999 S.F. Plan

JOB #:

23-269

FILE:

CV-ADU.dwg

DRAWN:

PC

ENGINEER:

PC

DATE:

6-26-23

SCALE:

1/4" = 1'-0"

REGISTERED PROFESSIONAL ENGINEER

NO. 1057182

EXP. 12-31-23







CIVIL

STATE OF CALIFORNIA

SHEET

51

SHEET - OF -

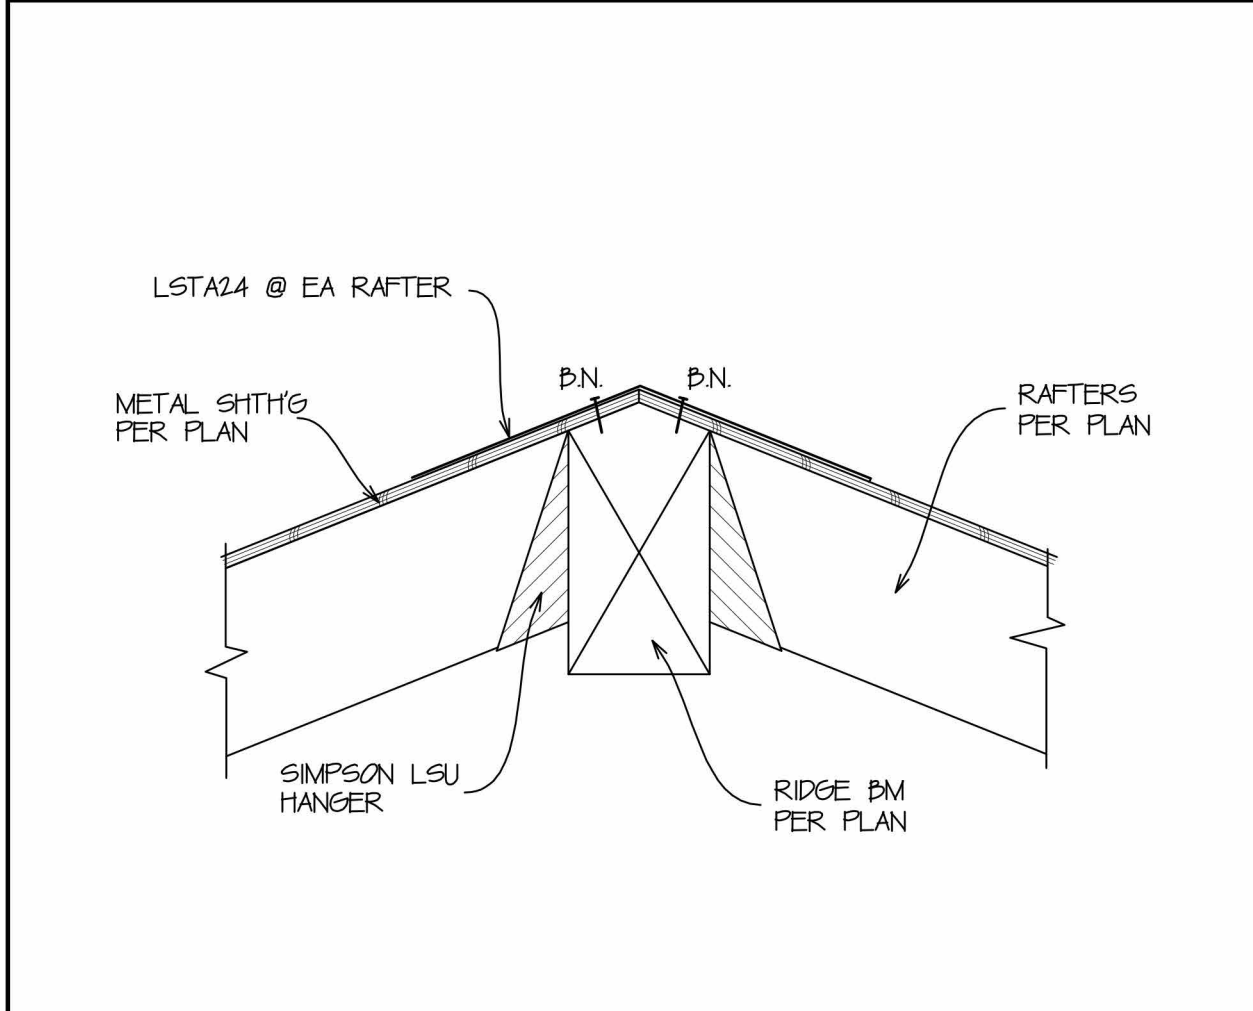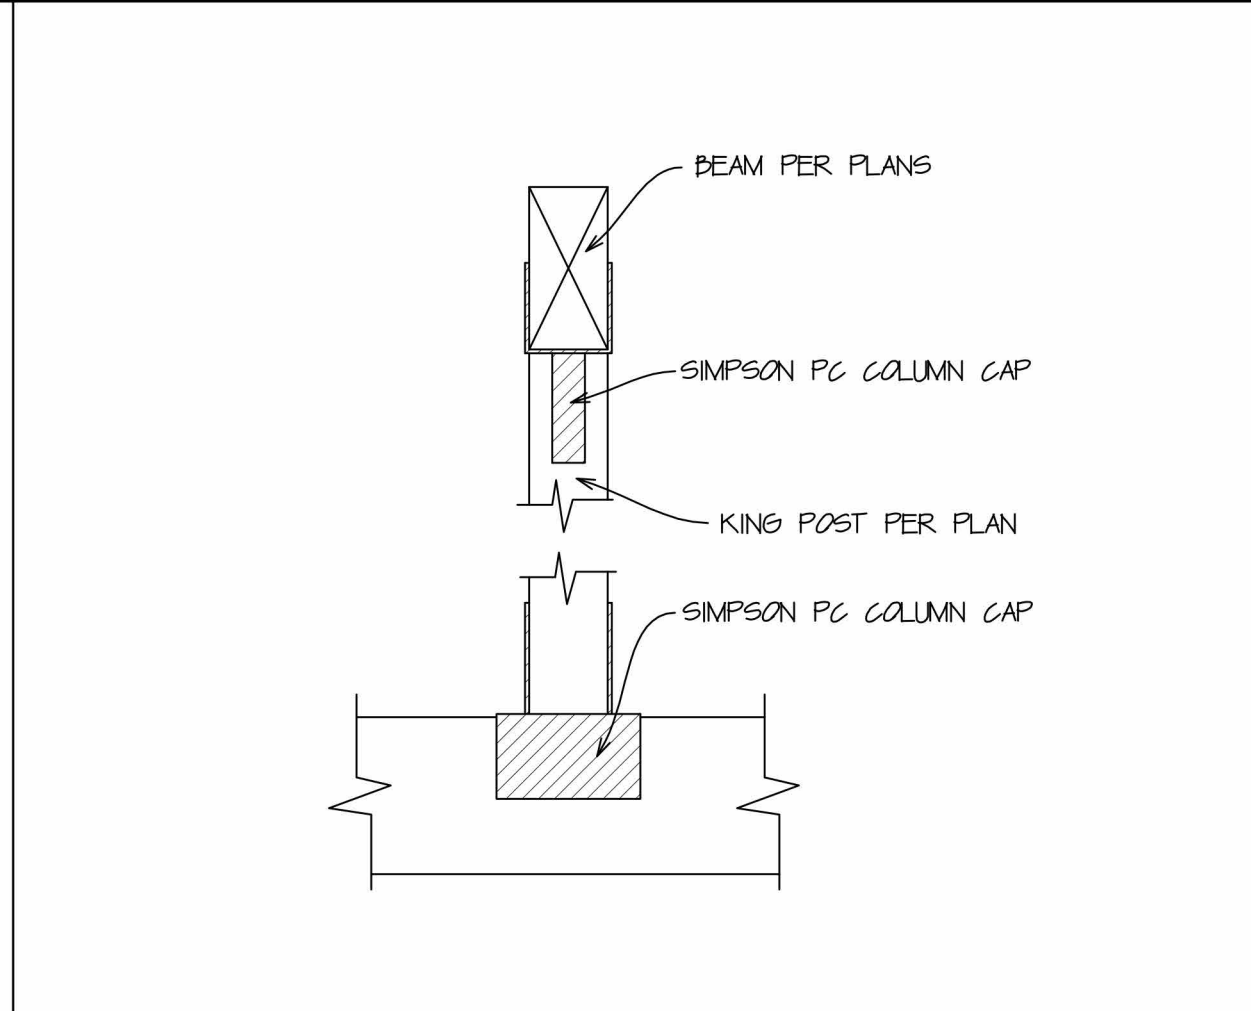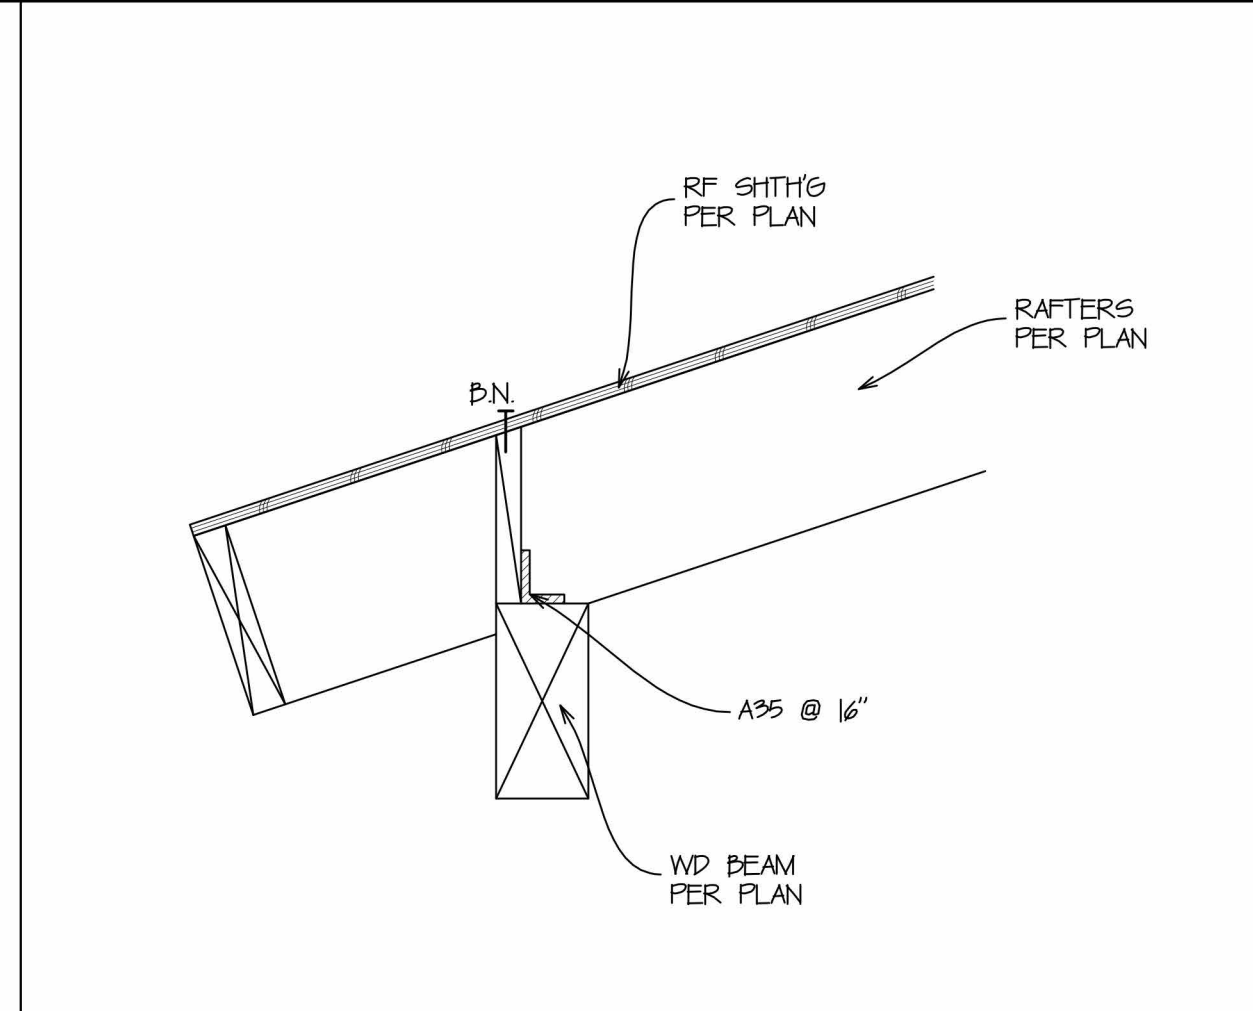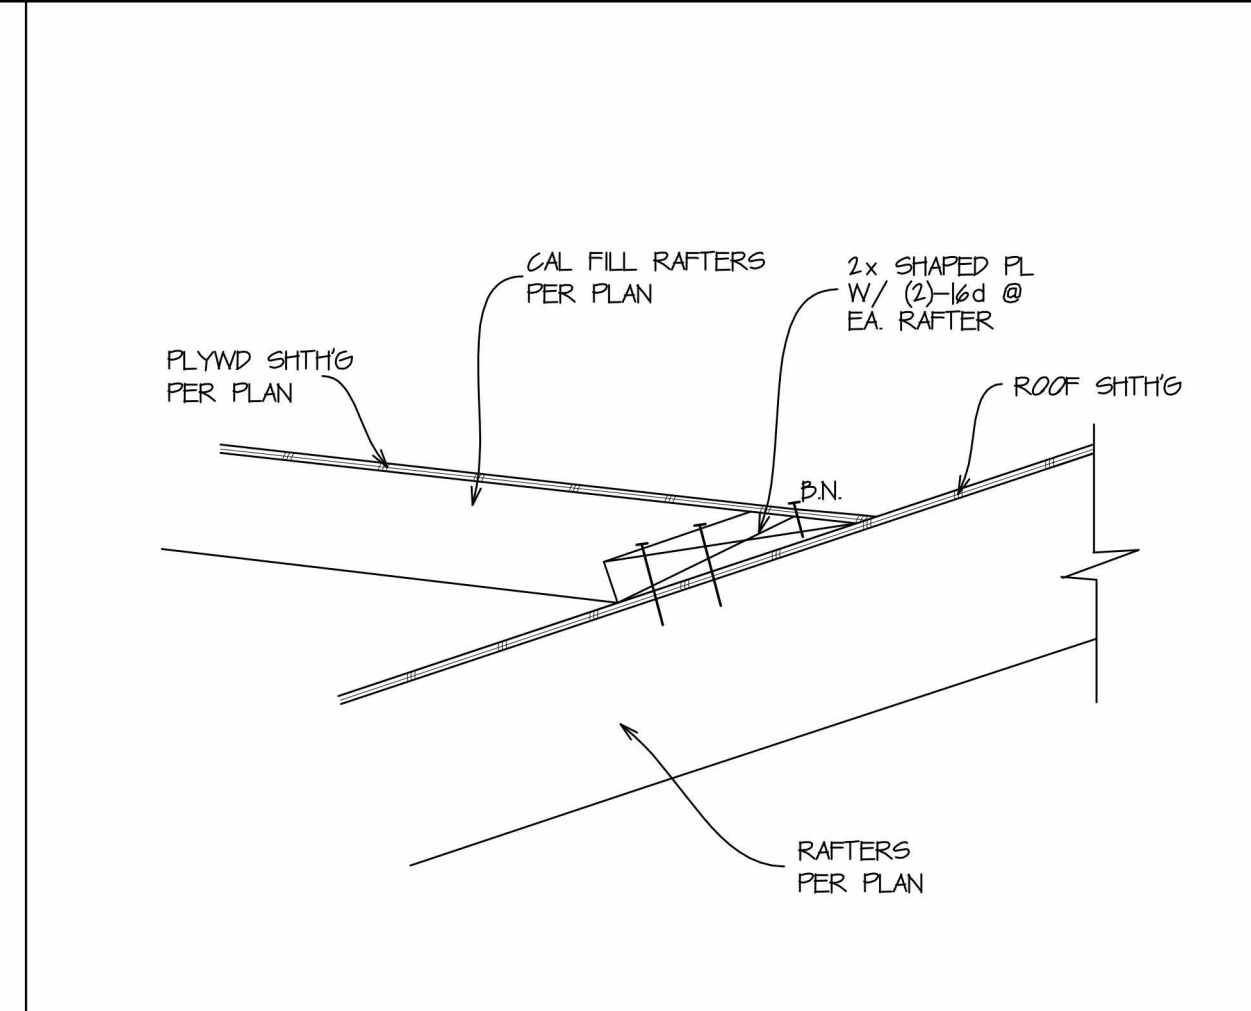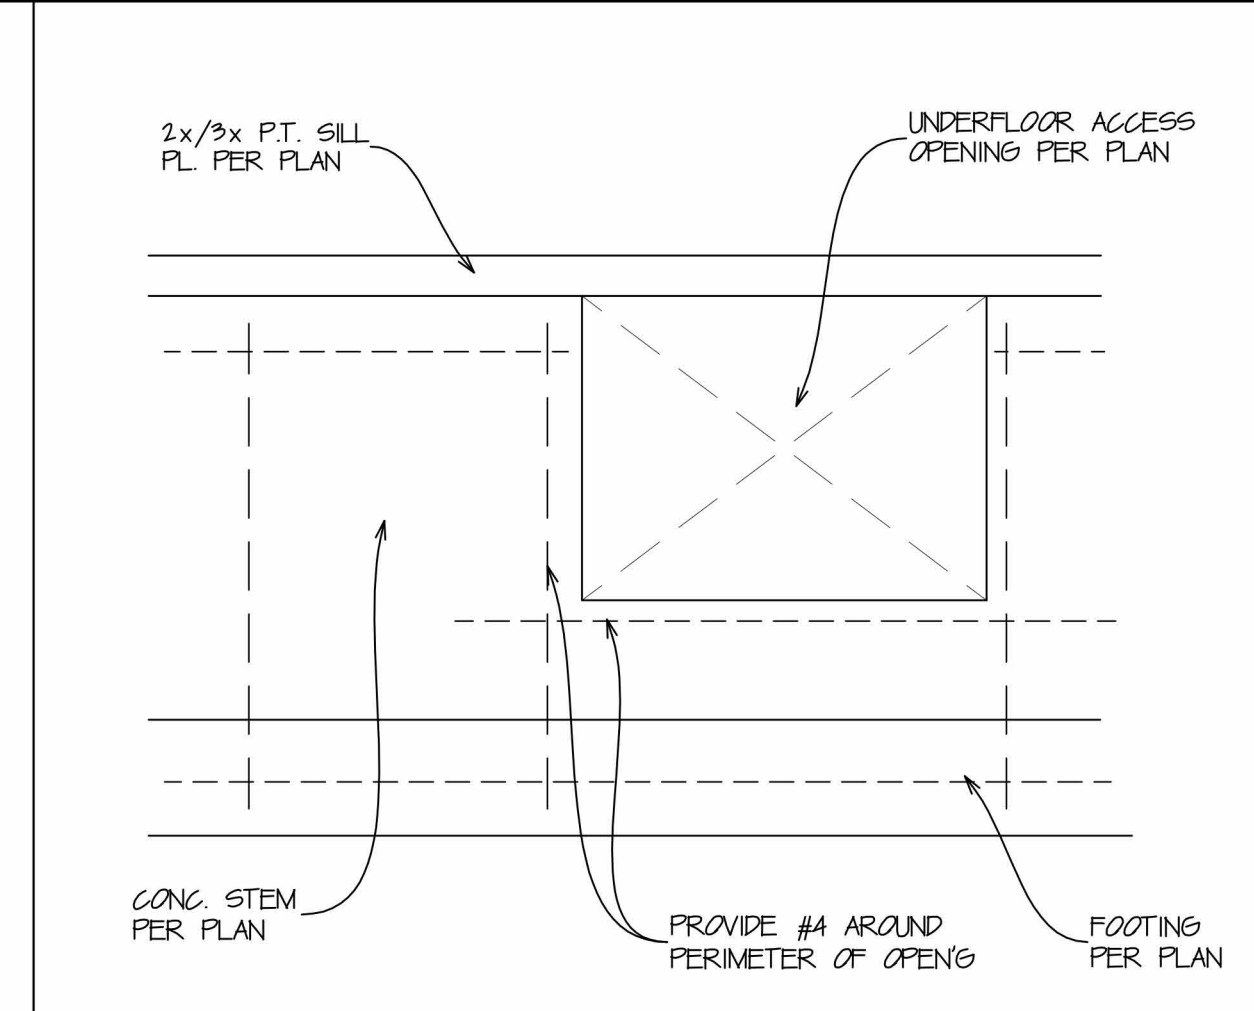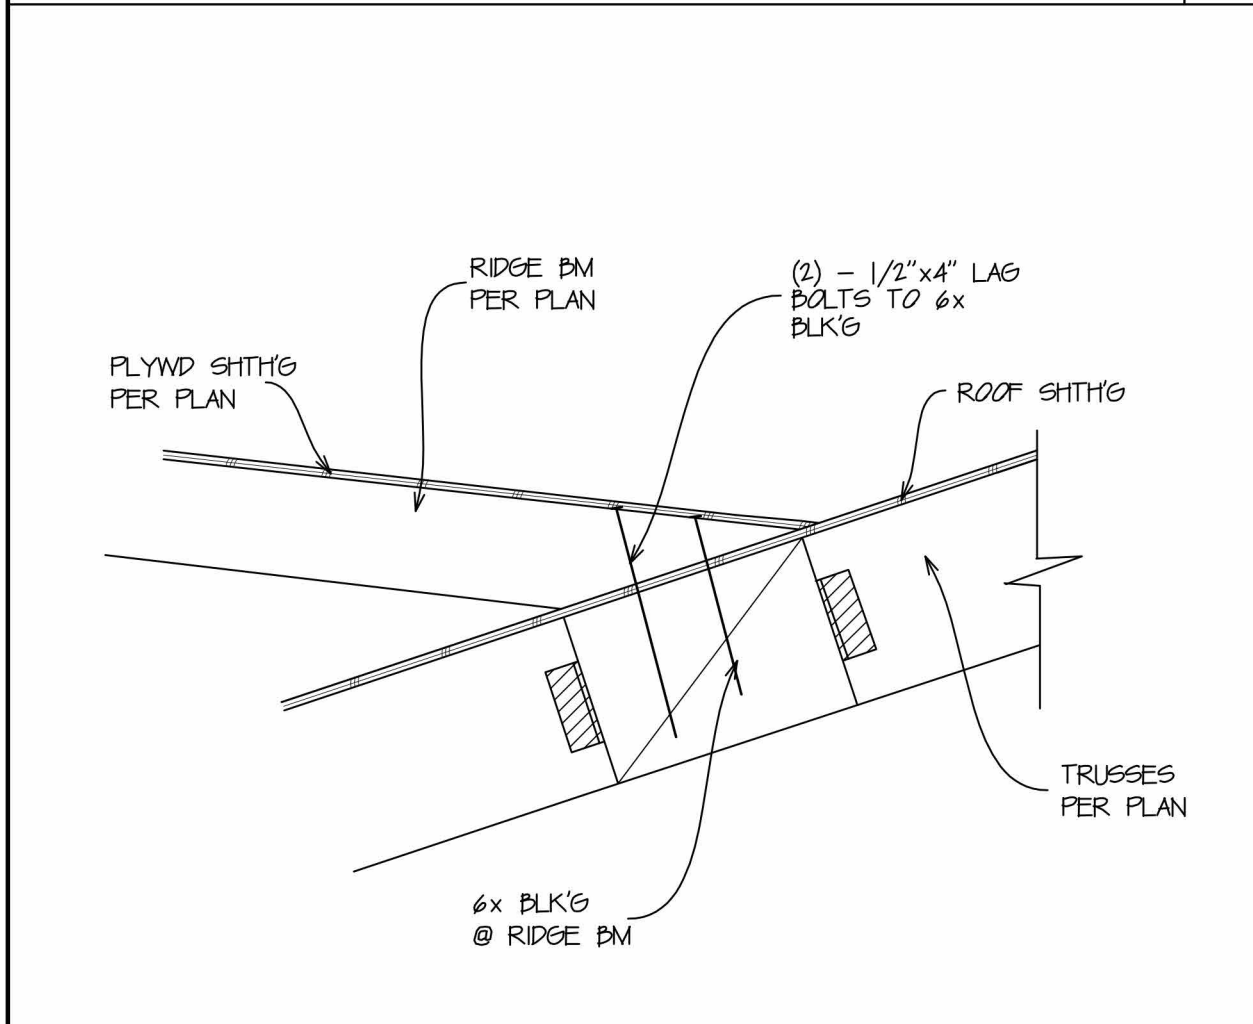									
DETAIL	21	DETAIL	22	DETAIL	23	DETAIL	24	DETAIL	25
									
DETAIL	26	DETAIL	27	DETAIL	28	DETAIL	29	DETAIL	30
DETAIL	31	DETAIL	32	DETAIL	33	DETAIL	34	DETAIL	35
DETAIL	36	DETAIL	37	DETAIL	38	DETAIL	39	DETAIL	40

REVISIONS

1-16-23

PCD

PROJECT

New Detached ADU

CHULA VISTA, CA

DRAWING

Details

Standard Rect-2 Bedroom 999 sf Plan

JOB #:

23-169

FILE:

CV-ADU.dwg

DRAWN:

PC

ENGINEER:

PC

DATE:

6-16-23

SCALE:

1/4" = 1'-0"

STAMP

REGISTERED PROFESSIONAL ENGINEER

PAUL S. CHEN

057182

EXP. 12-31-25

CIVIL

STATE OF CALIFORNIA

SHEET

SD2

SHEET - OF -

GENERAL

1) ALL DESIGN, CONSTRUCTION, AND WORKMANSHIP SHALL CONFORM TO:
2022 EDITION OF THE CALIFORNIA BUILDING CODE (CBC), AMERICAN SOCIETY OF CIVIL ENGINEERS (ASCE)
7-16, 2022 CALIFORNIA MECHANICAL CODE (CMC), 2022 CALIFORNIA PLUMBING CODE, AND ALL LOCAL ORDINANCES AND REQUIREMENTS.

2) THE APPROVED CONTRACT STRUCTURAL DRAWINGS AND SPECIFICATIONS REPRESENT THE FINISHED STRUCTURE. THEY DO NOT INDICATE THE METHOD OF CONSTRUCTION.

3) IT SHALL BE THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO PROVIDE ALL MEASURES NECESSARY TO PROTECT THE STRUCTURE DURING CONSTRUCTION. SUCH MEASURES SHALL INCLUDE, BUT ARE NOT LIMITED TO, BRACING AND SHORING FOR LOADS DUE TO CONSTRUCTION EQUIPMENT, ETC., THE METHODS, TECHNIQUES, SEQUENCES, PROCEDURES, SUPERVISION, AND INSTALLATION OF ALL TEMPORARY BRACING AND SHORING SHOULD ENSURE THE SAFETY OF THE WORK. BRACING AND SHORING IS TO BE INSTALLED PER THE LATEST OSHA STANDARDS. ALL BRACING AND/OR SHORING SHALL STAY IN PLACE UNTIL ALL WORK HAS BEEN SUITABLY COMPLETED.

4) THE GENERAL CONTRACTOR SHALL VERIFY ALL DIMENSIONS PRIOR TO STARTING CONSTRUCTION. THE ENGINEER SHALL BE NOTIFIED OF ANY DISCREPANCIES OR INCONSISTENCIES.

5) DIMENSIONS SHALL TAKE PRECEDENCE OVER SCALES ON DRAWINGS. NOTES AND DETAILS ON DRAWINGS SHALL TAKE PRECEDENCE OVER GENERAL NOTES AND TYPICAL DETAILS.

6) IT SHALL BE THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO ENSURE THAT ALL APPLICABLE SAFETY LAWS ARE STRICTLY ENFORCED AND TO MAINTAIN A SAFE CONSTRUCTION PROJECT.

7) IT SHALL BE THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO PROVIDE SUPERVISION OF THE CONSTRUCTION WORK TO ENSURE THAT IT IS BUILT IN CONFORMANCE WITH THE APPROVED PLANS AND SPECIFICATIONS. THE ENGINEER WILL PROVIDE ONLY OBSERVATION OF THE WORK DURING CONSTRUCTION.

8) THE APPROVED SET OF CONSTRUCTION DOCUMENTS, INCLUDING ALL APPROVED REVISIONS, SHALL BE PRESENT AT THE JOB SITE AT ALL TIMES.

9) CONSTRUCTION MATERIALS SHALL BE SPREAD OUT IF PLACED ON FRAMED FLOORS OR ROOFS. LOADS SHALL NOT EXCEED THE DESIGN LOADING FOR THE SUPPORTING MEMBERS.

10) NO CHANGES IN THE PLANS WILL BE MADE AND NO EXTRA WORK PERFORMED UNLESS SO APPROVED BY THE OWNER, CIVIL/STRUCTURAL ENGINEER, SOILS ENGINEER/GEOLGISTS, COUNTY/CITY INSPECTOR AND BUILDING OFFICIALS.

11) A CLAIM FOR EXTRAS WILL BE CONSIDERED IF A CONDITION ARISES WHICH WAS CHANGED BY DESIGN BY OTHERS, UNFORESEEN OR HAS NOT BEEN SHOWN ON THE PLANS. SUCH CLAIMS FOR EXTRAS WILL NOT BE ALLOWED UNLESS THE CONTRACTOR HAS NOTIFIED THE OWNER AND SUPERVISING ENGINEER IN WRITING, INCLUDING AN AGREED-TO REIMBURSEMENT SCHEDULE, PRIOR TO PERFORMING THE EXTRA WORK.

INTENT OF THE DOCUMENTS

IT IS THE INTENT OF THE DRAWINGS AND THE SPECIFICATIONS TO REQUIRE THE COMPLETION OF THE WORK IN A THOROUGH AND WORKMANLIKE MANNER IN EVERY RESPECT.

DESCRIPTION OF WORK

THE CONTRACTOR SHALL FURNISH PERMITS, LICENSES, FEES, MATERIAL, LABOR, TOOLS, PLANT, SUPPLIES, EQUIPMENT, TRANSPORTATION, SUPERINTENDENCE, TEMPORARY CONSTRUCTION OF EVERY NATURE, INSURANCE, TAXES, CONTRIBUTIONS, AND ALL OTHER SERVICES AND FACILITIES, UNLESS SPECIFICALLY EXCEPTED NECESSARY TO COMPLETE THIS PROJECT.

LIABILITY AND COMPENSATION INSURANCE

THE CONTRACTOR SHALL MAINTAIN AT ALL TIMES, FULL AND UNLIMITED WORKMANS COMPENSATION INSURANCE IN ACCORDANCE WITH THE LABOR CODE OF THE STATE OF CALIFORNIA AND SHALL CARRY PUBLIC CONTINGENT LIABILITY OF INSURANCE, IN AMOUNTS SATISFACTORY TO AND IN COMPANIES SELECTED WITH THE CONSENT OF THE OWNER.

PERMITS

THE CONTRACTOR SHALL OBTAIN THE BUILDING PERMIT, AND ALL OTHER CERTIFICATIONS, INSPECTION REPORTS, RELEASES, JURISDICTIONAL SETTLEMENTS, NOTICES, RECEIPTS FOR FEE PAYMENTS, JUDGMENTS, AND SIMILAR DOCUMENTS, CORRESPONDENCE AND RECORDS IN COLLECTION.

SUBCONTRACTOR'S STATUS

EVERY ITEM MENTIONED IN THE SPECIFICATIONS IS INTENDED TO REPRESENT THE QUALITY OF MATERIALS THAT WILL BE DEMANDED. SHOULD THE SUBCONTRACTOR WISH TO SUGGEST ANY SUBSTITUTES THAT HE CONSIDERS EQUAL IN VALUE AND EFFICIENCY WITH THE ONE SPECIFIED, HE SHALL STATE WHAT THE ITEM SUGGESTED IS, AND THE DIFFERENCE IN COST, IF ANY.

IF SUBSTITUTES OF MATERIALS (EQUIVALLY 6000) ARE OFFERED AT THE TIME BIDS ARE SUBMITTED, THEY WILL BE CONSIDERED. IN THE EVENT THE OWNER WISHES TO ACCEPT THE SUBSTITUTE, ARRANGEMENTS WILL BE MADE FOR THE CHANGE BEFORE ENTERING INTO A CONTRACT.

IF NO ITEMS ARE SUGGESTED AS A SUBSTITUTE AT THE TIME THE BIDS ARE SUBMITTED, THEN NO DEVIATION WILL BE ALLOWED FROM THE MATERIALS SPECIFIED WITHOUT FIRST SECURING THE APPROVAL OF THE OWNER.

WORKMAN SAFETY-EXCAVATIONS

ALL REGULATIONS OF THE STATE OR FEDERAL AGENCY SHOULD BE FOLLOWED BEFORE ALLOWING WORKMEN IN A TRENCH OR OTHER EXCAVATION.

IF EXCAVATIONS ARE TO BE MADE DURING THE RAINY SEASON PARTICULAR CARE SHOULD BE GIVEN TO INSURE THAT PERMS OR OTHER DEVICES PREVENT SURFACE WATER FROM FLOWING OVER THE TOP OF THE EXCAVATION OR PONDING AT THE TOP OF THE EXCAVATIONS.

NO TRENCHES OR EXCAVATIONS SHALL BE 5' OR MORE IN DEPTH INTO WHICH A PERSON IS REQUIRED TO DESCEND, OR OBTAIN NECESSARY PERMIT FROM THE STATE OF CALIFORNIA DIVISION OF INDUSTRIAL SAFETY PRIOR TO ISSUANCE OF A BUILDING OR GRADING PERMIT.

WRAP AND PROTECT ALL UTILITY LINES IN WAY OF CONSTRUCTION PER STANDARD CONSTRUCTION PRACTICES

TIMBER

1) ALL TIMBER DESIGN AND CONSTRUCTION SHALL BE PER 2022 CBC CHAPTER 23 AND 2020 NATIONAL DESIGN SPECIFICATION (NDS). ALL SAWN LUMBER SHALL BE GRADED BY EITHER NWFA OR WCLB.

2) UNJO, ALL WOOD SILL PLATES AND LEDGERS BEARING ON CONCRETE OR MASONRY SHALL BE PRESSURE TREATED DOUGLAS FIR-LARCH. ANCHOR BOLTS SHALL BE 5/8" DIAMETER SPACED A MAXIMUM 4'-0" O.C. AND WITHIN 12" AND GREATER THAN SEVEN BOLT DIAMETERS FROM EACH END OF A SILL, FROM A HOLE, OR FROM A NOTCH GREATER THAN 1/3 THE WIDTH OF THE SILL. SEE SHEARWALL SCHEDULE FOR OTHER REQUIREMENTS.

3) ALL WALL BRACING AND MATCHING OF STUDS SHALL CONFORM TO SECTION 2302B.33 OF THE 2022 CALIFORNIA BUILDING CODE.

4) UNLESS NOTED OTHERWISE ON FRAMING PLANS:

ROOF SHEATHING SHALL BE 15/32" APA-RATED SHEATHING, EXPOSURE I, MIN. SPAN RATING 24/0, NAILED WITH 8d COMMON @ 6" O.C. EDGES & BOUNDARIES AND 12" O.C. AT INTERMEDIATE FRAMING MEMBERS.

FLOOR SHEATHING SHALL BE 23/32" APA-RATED STURD-I-FLOOR, T&G, EXPOSURE I, MIN. SPAN RATING 20" O.C., NAILED WITH 1d COMMON @ 6" O.C. AT EDGES & BOUNDARIES AND 12" O.C. AT INTERMEDIATE FRAMING MEMBERS.

SHEARWALL SHEATHING SHALL BE APA "STRUCTURAL I" RATED, EXPOSURE I, GROUP 1, NAILING PER SHEARWALL SCHEDULE.

ALL WOOD STRUCTURAL PANEL SHEATHING SHALL BE GRADE MARKED BY APA, T&G, OR PTL AND SHALL CONFORM TO PS-1-9, PS-2-18, OR FRP-1-20.

TRASH REMOVAL

THE CONTRACTOR SHALL PROMPTLY REMOVE FROM THE BUILDING, LOT, SIDEWALKS, AND STREETS - ALL RUBBISH AND DIRT, AS IT ACCUMULATES, DUE TO THE WORK DONE UNDER THIS CONTRACT.

ALL COMBUSTIBLE DEBRIS SHALL BE REMOVED FROM THE BUILDING ON A DAILY BASIS.

FOUNDATION

1) CONCRETE SHALL HAVE A MINIMUM ULTIMATE COMPRESSIVE STRENGTH OF 3500 PSI AT 28 DAYS FOR POURED-IN-PLACE CONTINUOUS AND SPREAD FOOTINGS, AND 3000 PSI (SPECIAL INSP. REQ'D) AT 28 DAYS FOR GRADE BEAMS.

2) PORTLAND CEMENT SHALL BE TYPE II PER ASTM C 150. AGGREGATES SHALL BE PER ASTM C39 WITH MAXIMUM SIZE OF 1 1/2" FOR FOOTINGS AND 1" FOR ALL OTHER WORK.

3) REINFORCING STEEL SHALL BE ASTM A66, GRADE 60, CLEAN AND RUST FREE. LAPS AT SPLICES AND FOUR LINES TO BE 40 BAR DIAMETERS (3'-0" MINIMUM) UNLESS NOTED OTHERWISE ON PLANS.

4) UNJO, SLABS ON GRADE SHALL BE 4" THICK WITH #2 BARS @ 16" O.C. EACH WAY WITH 2 INCH COVER AT BOTTOM. 4" CLEAN SAND SHALL BE PLACED BELOW THE SLAB WITH A 10 MIL PLASTIC VAPOR BARRIER PER ASTM E26 & ASTM E146 PLACED AT MID-HEIGHT. BARS SHALL BE LAPPED 20". SEE SOILS REPORT (IF AVAILABLE) FOR OTHER REQUIREMENTS.

5) ALL NEW SILL PLATE ANCHOR BOLTS TO BE INSTALLED IN FRESH CONCRETE SHALL BE 5/8" DIAMETER ABOUT 1" LONG SPACED PER PLAN AND SHEARWALL SCHEDULE WITH MINIMUM 7' EMBEDMENT. MAXIMUM ANCHOR BOLT SPACING SHALL BE 4'-0" O.C. ANCHOR BOLTS AT ENDS OF WALL PANELS SHALL BE LOCATED WITHIN 12" AND GREATER THAN 7 BOLT DIAMETERS FROM THE END OF SILL PLATE. THERE SHALL BE A MINIMUM OF TWO ANCHOR BOLTS PER WALL PANEL. ANCHOR BOLTS TO EXISTING FOOTINGS PER NOTE #8 (BELOW). PLATE WASHERS A MINIMUM 9/32X2 1/2" THICK SHALL BE USED ON EACH BOLT. ALL CONNECTORS AND METAL HARDWARE IN CONTACT WITH PRESSURE TREATED TIMBER SHALL HAVE CORROSION RESISTANT COATINGS OR PROTECTION, SUCH AS "ZMAX", HOT DIPPED GALVANIZED, OR BE STAINLESS STEEL.

6) IF NO SOILS REPORT IS PROVIDED, ASSUMED ALLOWABLE SOIL BEARING PRESSURE (ASBP) SHALL BE 100 PSF (PER SOIL SITE CLASS D) AND EMBED FOOTINGS A MINIMUM OF 24" INTO COMPETENT SOIL.

7) REINFORCEMENT CLEARANCES FOR FOOTINGS AND GRADE BEAMS, (UNJO):

A) FURRED AGAINST EARTH - 3"

B) FORMED SURFACE - 2"

8) REMOVAL OF FORMS:

A) SUPPORTING VERTICAL SURFACES - 2 DAYS MINIMUM

B) SUPPORTING BEAMS & GIRDERS - 15 DAYS MINIMUM

9) REINFORCING SHALL BE CONTINUOUS AROUND CORNERS AND THROUGH INTERSECTIONS.

10) ALL NEW SILL PLATE ANCHOR BOLTS TO BE INSTALLED INTO EXISTING FOOTINGS SHALL BE SIMPSON TITAN HD ANCHOR (CC-ES-ESEB-105/LARR# 125662)

14) CONSTRUCTION JOINTS SHALL BE PREPARED BY WIRE BRUSHING, CLEANING AND BRUSHING IN A PASTE OF NEAT CEMENT MORTAR IMMEDIATELY PRIOR TO POURING. LOCATION OF CONSTRUCTION JOINT SHALL BE APPROVED BY THE PROJECT STRUCTURAL ENGINEER.

15) ALL CONNECTORS AND METAL HARDWARE IN CONTACT WITH PRESSURE TREATED TIMBER SHALL HAVE CORROSION RESISTANT COATINGS OR PROTECTION, SUCH AS "ZMAX", HOT DIPPED GALVANIZED, OR BE STAINLESS STEEL.

16) PRIOR TO POURING INTERIOR CONCRETE FLOOR SLABS, ALL SOL BELOW FLOOR SHALL BE COMPACTED TO REQUIRED 90% RELATIVE DENSITY AND MOISTENED TO A DEPTH NOT LESS THAN 18".

17) DEEPEN NEW FOOTINGS AS NECESSARY TO OBTAIN REQUIRED EMBEDMENT FOR ALL NEW HOLD DOWN BOLTS. ALL HOLD DOWN BOLTS TO HAVE A MINIMUM OF 3" OF CONCRETE COVER TO SOIL & BOTTOM.

FRAMING

ROOF DIAPHRAGM

15/32" APA RATED SHEATHING (MIN), EXPOSURE I, 24/0 MAX SPAN RATING, w/ 8d COMMON NAILS @ 6" O.C. AT BOUNDARY & PANEL EDGE NAILING (EN), AND 12" O.C. AT INTERMEDIATE FRAMING MEMBERS

FLOOR DIAPHRAGM

23/32" APA STURD-I-FLOOR, EXPOSURE I, TONGUE AND GROOVE, w/ 1d COMMON NAILS @ 6" O.C. AT BOUNDARY & PANEL EDGE NAILING (EN), AND 12" O.C. AT INTERMEDIATE FRAMING MEMBERS

FRAMING

BUILT-UP WOOD FRAMING MEMBERS MAY NOT BE SUBSTITUTED FOR 4x AND WIDER BEAMS UNLESS NOTED BY ENGINEER.

ALL (1) 2x ROOF & FLOOR FRAMING TO HAVE MIN. 16d AT 12" O.C. T&G, STAGGERED

ALL (2) 2x FRAMING TO HAVE MIN. 1 1/2" DIAMETER BOLTS AT 18" O.C. T&G, STAGGERED

2x solid BLOCKING REQUIRED AT POINTS OF SUPPORT FOR ALL HORIZONTAL FRAMING MEMBERS.

IN ADDITION, ALL 2x10 AND LARGER MEMBERS SHALL HAVE SOLID FULL DEPTH BLOCKING OR BRACING AT MAX. 8'-0" O.C. ON PLANS AND SECURELY WIRED.

ALL WOOD POSTS AT UPPER FLOORS TO CONTINUE TO BEAM OR FOUNDATION.

UNLESS DETAILED OTHERWISE, ALL RIDGE / HIP / VALLEY CONNECTIONS TO HAVE A SIMPSON A95 CONNECTOR AT EACH CORNER WITH A 2x KICKER TO BEARING WALL.

AT ROOF-TO-WALL FRAMING, PROVIDE A95 FRAMING ANCHORS PER SHEARWALL SCHEDULE OR AT MAX. 48" O.C. FROM PLATES TO RAFTERS AND RAFTER BLOCKING AROUND PERIMETER OF BUILDING AND AT DRAG LINES AS INDICATED ON PLANS (SEE PLANS WHERE OTHER REQUIREMENTS MAY OCCUR).

ALL CORRECTORS AND METAL HARDWARE IN CONTACT WITH PRESSURE TREATED TIMBER SHALL HAVE CORROSION RESISTANT COATINGS OR PROTECTION, SUCH AS "ZMAX", HOT DIPPED GALVANIZED, OR BE STAINLESS STEEL.

REINFORCING STEEL

ALL PRIMARY REINFORCEMENT SHALL CONFORM TO ASTM A - 66, GRADE 60 KSI, STEEL.

ALL TIES AND STIRRUPS SHALL CONFORM TO ASTM A-66, GRADE 40 KSI, STEEL.

SPLICES OF REINFORCING SHALL BE LAPPED A MINIMUM OF 40 BAR DIAMETERS UNLESS SPECIFIED ON PLANS AND SECURELY WIRED TOGETHER, USING A MINIMUM OF 6 GA. WIRE. SPLICES OF ADJACENT REINFORCING BARS SHALL BE STAGGERED WHEREVER POSSIBLE.

TIMBER

5) HORIZONTAL WOOD STRUCTURAL PANELS SHALL BE LAP WITH THE LONG DIMENSION AND FACE GRAIN PERPENDICULAR TO THE RAFTERS OR JOISTS, AND THE SHEETS SHALL BE STAGGERED AS SHOWN IN 2022 CBC TABLE 2306.1.2 (CASES I AND 9). EACH SHEET SHALL CONTAIN A MINIMUM OF 8 SQUARE FEET AND EXTEND TO 3 SUPPORTS. 1/8" SPACING BETWEEN PANEL ENDS AND EDGES IS REQUIRED. ALL WOOD STRUCTURAL PANEL DIAPHRAGMS SHALL BE REVIEWED BY CONTRACTOR FOR COMPLIANCE WITH NAILING AND PANEL REQUIREMENTS BEFORE FINISH IS APPLIED.

6) UNJO, ALL 2x ROOF RAFTER AND FLOOR JOIST FRAMING MEMBERS SHALL BE MINIMUM GRADE DOUGLAS FIR-LARCH NO. 2 OR BETTER. ALL BEAMS, HEADERS, AND POSTS SHALL BE MINIMUM DOUGLAS FIR-LARCH NO. 1 OR BETTER. ALL VERTICAL WALL FRAMING MEMBERS SHALL BE DOUGLAS FIR -LARCH NO. 2 OR BETTER.

7) ALL PS1 AND LVL ENGINEERED FRAMING MEMBERS SHOWN ON PLANS TO BE 23E PARALLAM (E=2200 ksi) AND 10E MICROLAM BEAMS (E=2000 ksi), RESPECTIVELY, AS DESCRIBED IN CC-ES-ESEB-105 & CC-ES-ESEB-107. ALL WOOD I-JOIST MEMBERS SHOWN ON PLANS TO BE AS DESCRIBED IN ESEB-105.

8) MOISTURE CONTENT OF SAWN LUMBER AT TIME OF INSTALLATION SHALL NOT EXCEED 19%.

9) ALL BOLT HEADS AND NUTS BEARING ON WOOD SHALL HAVE WASHERS. HOLES IN WOOD FOR BOLTS SHALL BE DRILLED MAX. 1/16" LARGER THAN NOMINAL BOLT SIZE.

10) NOTCHING OR DRILLING HOLES IN BEAMS OR JOISTS SHALL BE ONLY AS DETAILED PER ENGINEER

11) ALL SAWN LUMBER (2x, 4x, 6x) RAFTERS, FLOOR JOISTS, AND BEAMS SHALL HAVE SOLID WOOD BLOCKING AT ALL POINTS OF SUPPORT. MEMBERS WITH NOMINAL DEPTH 12" OR GREATER SHALL HAVE 2x FULL DEPTH SOLID BLOCKING OR CROSS BRACING SPACED AT 8'-0" FOR MAXIMUM.

12) UNJO, ALL FRAMING CONNECTION HARDWARE SHALL BE AS MANUFACTURED BY THE SIMPSON STRONG-TIE COMPANY AND SHALL BE REFERENCED AS SHOWN IN THEIR LATEST CATALOGS. ALL CONNECTOR WALLS AND BOLTS SHALL BE AS DESIGNATED PER MANUFACTURER. ALTERNATE MANUFACTURER CONNECTOR HARDWARE MAY BE USED PROVIDED ENGINEER'S WRITTEN APPROVAL IS OBTAINED BY CONTRACTOR AND CC APPROVAL IS PROVIDED.

13) TOP PLATES SHALL LAP LOWER PLATES AT CORNERS, AND BREAKS AT PLATE SHALL BE LAPPED A MINIMUM OF 4'-0", WITH 20-6d NAILS ON EACH SIDE.

14) ALL BEAMS SHALL BE SUPPORTED BY POSTS OR GIRDERS. FOR 4x8 AND SMALLER BEAMS A MINIMUM (2)-2X4 DF. #2 POST SHALL BE USED. UNJO. FOR 4x10 AND LARGER BEAMS A MINIMUM 4x4 DF. #1 POST SHALL BE USED. UNJO. ALL POSTS SHALL PROVIDE FULL BEARING WIDTH FOR THE BEAM, UNJO.

15) ALL POSTS SHALL BE CONTINUED BETWEEN FLOORS WITH SOLID FULL WIDTH BLOCKING AND A POST OF EQUAL OR GREATER SIZE BELOW, UNTIL A BEAM OR FOUNDATION IS ENCOUNTERED. ALL POSTS INSIDE WALLS MAY BEAR ON THE SOLE OR SILL PLATE, UNJO. ISOLATED POSTS SHALL BE SEATED IN POST OR COLUMN DEAKS PER PLAN.

16) ALL WALLS HIGHER THAN 12'-0" SHALL BE 2x8 OR 3x8 STUDS @ 16" O.C., UNLESS SPECIFICALLY DESIGNED OTHERWISE BY ENGINEER. ALL WALLS CONTAINING MECHANICAL PIPING 2" IN DIAMETER OR LARGER SHALL BE FRAMED WITH 2x8 STUDS @ 16" O.C.

17) CUTTING, NOTCHING, OR BORING HOLES IN STUDS SHALL COMPLY WITH 2022 CBC SECTION 2302B.10 & 2302B.11.

18) FRAMING AND NAILING NOT SPECIFICALLY DETAILED ON THE PLANS ARE TO CONFORM TO 2022 CBC TABLE 2306.1.2. COMMON NAILS ARE REQUIRED FOR ALL SHEARWALL, FLOOR AND ROOF DIAPHRAGMS. USE DOUBLE JOISTS UNDER PARALLEL PARTITIONS. UNJO. DOUBLED HORIZONTAL MEMBERS SHALL BE STITCH-WALLED TOGETHER WITH TWO ROWS OF 16d NAILS @ 12" O.C. STAGGERED, UNLESS OTHERWISE DETAILED. TRIPLED HORIZONTAL MEMBERS SHALL HAVE MIN. 1/2" DIAMETER BOLTS AT 18" O.C. T&G, STAGGERED.

19) ANCHOR BOLTS TO SILL AND SOLE PLATES SHALL HAVE NUTS DRIVEN FLUSH WITH SQUARE PLATE WASHERS IN ACCORDANCE WITH THE FOLLOWING SCHEDULE:

BOLT DIAMETER	PLATE SIZE
5/8"	02129" x 3" x 3"
3/4"	5/16" x 3" x 3"
1"	5/8" x 3" x 3"
1 1/8"	3/8" x 3 1/2" x 3 1/2"

THE ABOVE SCHEDULE ALSO APPLIES TO LAG SCREWS DRIVEN INTO SOLE PLATES FOR RAISED FLOOR AND UPPER STORY CONDITIONS.

20) LAG SCREWS SHALL BE INSTALLED IN PRE-DRILLED HOLES. THE CLEARANCE HOLE FOR THE SHANK PORTION SHALL HAVE THE SAME DIAMETER AND DEPTH AS THE SHANK. THE LEAD HOLE FOR THE THREADED PORTION SHALL HAVE A DIAMETER EQUAL TO 40%-100% OF THE SHANK DIAMETER FOR ALL DUAL-FIR LARCH MEMBERS). LAG SCREWS ARE TO BE INSTALLED WITH THE TURN OF A WRENCH. DRIVING, AS WITH A HAMMER, IS NOT PERMITTED.

21) MINIMUM NAILING SHALL BE PER TABLE 2304A.1.2 OF THE 2022 CBC.

22) ALL CONNECTORS AND METAL HARDWARE IN CONTACT WITH PRESSURE TREATED TIMBER SHALL HAVE CORROSION RESISTANT COATINGS OR PROTECTION, SUCH AS "ZMAX", HOT DIPPED GALVANIZED, OR BE STAINLESS STEEL.

STRUCTURAL STEEL

1) ALL STRUCTURAL STEEL SHALL CONFORM TO SECTION 2201.1 - 2022 CBC.

W-WIDE FLANGE SHAPES: ASTM A992, Fy = 50-65 KSI

PLATE, ANGLES, CHANNELS: ASTM A36, Fy = 36 KSI

HOLLOW TUBE SHAPES: ASTM A500, GRADE B, Fy = 46 KSI

ROUND PIPE SHAPES: ASTM A53, GRADE B, Fy = 36 KSI

2) ALL STRUCTURAL STEEL SHALL BE FABRICATED IN A SHOP APPROVED BY THE LOCAL MUNICIPAL BUILDING DEPARTMENT.

3) STRUCTURAL SHOP DRAWINGS SHALL BE SUBMITTED TO THE STRUCTURAL ENGINEER FOR REVIEW PRIOR TO FABRICATION.

4) ALL STRUCTURAL STEEL SHALL BE IDENTIFIED PER 2022 CBC. DESIGN OF STEEL MEMBERS SHALL BE PER ASD PROVISIONS IN THE 2022 CBC SECTION 2201.1 & 2202.1.

5) STRUCTURAL STEEL SHALL HAVE A SHOP CONT OF RED-OXIDE PRIMER.

6) AFTER ERECTION, ALL FIELD CONNECTIONS, BOLTS, WELDS, AND ALL ABRADED PLACES ON THE SHOP PAINT SHALL BE TOUCHED UP WITH THE SAME TYPE OF PAINT AS THE SHOP COAT.

7) FIELD AND SHOP WELDING SHALL BE DONE BY A FULLY CERTIFIED WELDER USING LOW-HYDROGEN E70-T4 ELECTRODE RODS, UNLESS NOTED OTHERWISE. CONTINUOUS INSPECTION BY A REGISTERED INSPECTOR IS REQUIRED FOR FIELD WELDING. ALL WELDING SHALL BE PER AWS, LATEST EDITION, AND AWS SPECIFICATIONS.

8) BOLTS SHALL BE OF A307 QUALITY WITH WASHERS, UNLESS OTHERWISE SPECIFIED ON PLANS. ANY HIGH STRENGTH A305 OR A307 BOLTS SHALL HAVE SPECIAL INSPECTION, UNLESS NOTED OTHERWISE.

9) STEEL ERECTOR SHALL PROVIDE ALL ERECTION DRAGGING REQUIRED TO MAINTAIN STRUCTURE PLUMB AND PROPERLY BRACED DURING CONSTRUCTION.

10) ALL STRUCTURAL STEEL SHALL BE DESIGNED BASED UPON THE ALLOWABLE STRESS DESIGN METHOD PER AISI 360.

CONCRETE

1) ALL PHASES OF WORK PERTAINING TO CONCRETE CONSTRUCTION SHALL CONFORM TO 2022 CBC CHAPTER 19 (BASED ON ACI-308, LATEST ADOPTED EDITION) FOR REINFORCED CONCRETE.

2) MINIMUM ULTIMATE COMPRESSIVE CONCRETE STRENGTHS (F'c) SHALL BE:
SLAB ON GRADE: 2500 PSI @ 28 DAYS
STRUCTURAL DECK: 3000 PSI @ 28 DAYS
COLUMNS: 3000 PSI @ 28 DAYS
FOOTINGS: 3000 PSI @ 28 DAYS
CONCRETE/GRADE BEAMS: 3000 PSI @ 28 DAYS
CAISSONS: 3000 PSI @ 28 DAYS

3) CONTINUOUS INSPECTION BY AN APPROVED DEPUTY INSPECTOR IS REQUIRED FOR CAISSONS, GRADE BEAMS, STRUCTURAL SLABS, AND OTHER CONCRETE MEMBERS WHERE DESIGN COMPRESSIVE STRENGTH VALUE EXCEEDS 2500 PSI.

4) CEMENT SHALL BE TYPE II, LOW ALKALI, CONFORMING TO ASTM C-60.

5) ALL PRIMARY REINFORCEMENT SHALL BE PER ASTM A-66, GRADE 60 KSI STEEL. ALL TIES AND STIRRUPS SHALL CONFORM TO ASTM A-66, GRADE 40 KSI STEEL.

6) UNLESS NOTED OTHERWISE, SPLICES OF REINFORCING SHALL BE LAPPED A MINIMUM OF 40 BAR DIAMETERS AND SECURELY WIRED TOGETHER, USING A MINIMUM OF 6 GA WIRE. SPLICES OF ADJACENT REINFORCING BARS SHALL BE STAGGERED WHEREVER POSSIBLE. WHERE SPECIFICALLY CALLED OUT, WELDING OF REINFORCING BARS SHALL BE PERFORMED BY A CERTIFIED WELDER USING E50 SERIES ELECTRODES PER AWS, LATEST EDITION.

7) INTERIOR CONCRETE SLABS ON GRADE SHALL HAVE A STEEL TROWEL FINISH. DRIVEWAYS, WALKS, AND GARAGE SLABS SHALL HAVE A BROOM FINISH AND SHALL BE FITTED TO SLED WATER.

8) PRIOR TO POURING INTERIOR CONCRETE FLOOR SLABS, ALL SOL BELOW FLOOR SHALL BE COMPACTED TO REQUIRED DENSITY AND MOISTENED TO A DEPTH NOT LESS THAN 18" PER SOILS REPORT.

9) CLEAR COVERAGE OF CONCRETE OVER REINFORCING BARS, ANCHOR BOLTS, AND ALL OTHER CONCRETE INSERTS, UNLESS OTHERWISE SPECIFIED, SHALL BE AS FOLLOWS:
FOURED AGAINST EARTH: 3" CLEAR
FORMED CONCRETE: 2" CLEAR

10) FORMS FOR CONCRETE SHALL BE LAP OUT AND CONSTRUCTED TO PROVIDE THE SPECIFIED CAMBERS SHOWN. IF THE DRAWINGS, DECK CAMBERING SHOWN ON PLANS IS INTENDED TO PROVIDE A LEVEL DECK. ANY SLOPING FOR DRAINAGE SHALL BE ADDED OR SUBTRACTED FROM CAMBERING AS APPROPRIATE. THE DECK THICKNESS SHALL NOT BE REDUCED IN ORDER TO ACHIEVE DECK SLOPES.

11) DRYPACK UNDER BASEPLATES, SILL PLATES, AND WHERE OTHERWISE NOTED ON DRAWINGS SHALL CONSIST OF APPROVED NON-SHRINK HIGH STRENGTH GROUT. WHEN SPACE BETWEEN TWO SURFACES REQUIRES DRYPACK, IT SHALL BE PACKED BY TAMPING OR RAMMING WITH A BAR OR ROD UNTIL THE VOIDS ARE COMPLETELY FILLED.

12) PLACEMENT OF CONCRETE SHALL CONFORM TO ACI LATEST STANDARD AND PROJECT SPECIFICATIONS. WIRE BRUSH OR SANDBLAST ALL CONCRETE SURFACES AGAINST WHICH CONCRETE IS TO BE PLACED.

13) IF COLUMNS AND WALLS ARE PLACED WITH FLOORS, MINIMUM TIME OF TWO HOURS MUST ELAPSE BETWEEN END OF COLUMN OR WALL POUR AND BEGINNING OF FLOOR POUR.

14) PROVIDE SLEEVES FOR PLUMBING AND ELECTRICAL OPENINGS IN CONCRETE BEFORE PLACING. DO NOT CUT ANY REINFORCING WHICH MAY CONFLICT. COPIING IN CONCRETE IS NOT PERMITTED, EXCEPT AS SHOWN. NOTIFY THE PROJECT STRUCTURAL ENGINEER IN ADVANCE OF CONDITIONS NOT SHOWN ON THE STRUCTURAL DRAWINGS.

15) COVER TO BEAM REINFORCEMENT TO BE 2" MINIMUM FORMED CONCRETE & 3" MINIMUM AGAINST EARTH, UNLESS NOTED OTHERWISE.

16) ARCHITECTURAL DRAWINGS TO BE REFERRED TO FOR DECK SLOPES, DRAINAGE, PLUMBING, FRAMING AND ELECTRICAL HARDWARE & ALL DIMENSIONS.

17) REINFORCEMENT CALLED OUT IN DETAILS SHALL BE IN ADDITION TO THAT SHOWN ON PLANS (UNJO). REINFORCING METHODS SHOWN IN DETAILS SHALL BE USED AS APPLICABLE.

18) WHEN A MONOLITHIC PAIR IS NOT POSSIBLE, CONSTRUCTION JOINTS SHALL BE APPROVED BY THE PROJECT STRUCTURAL ENGINEER.

19) SHORING SHALL NOT BE REMOVED UNTIL CONCRETE HAS ACHIEVED MINIMUM 28 DAY COMPRESSIVE STRENGTH. FIFTEEN DAYS AFTER CONCRETE POUR IS COMPLETED THE PROJECT STRUCTURAL ENGINEER MAY RETEST, BASED ON COMPRESSION TESTS, IF SHORING MAY BE REMOVED.

20) ALL DECK SURFACES EXPOSED TO WEATHER SHALL BE WATERPROOFED. SEE ARCHITECTURAL DOCUMENTS FOR SPECIFICATIONS.

21) CONCRETE SHALL BE THOROUGHLY CONSOLIDATED IN A MANNER THAT WILL ELIMINATE THE REINFORCEMENT AND INSERTS, FILL THE FORMS, AND PROVIDE A SURFACE OF UNIFORM TEXTURE FREE OF ROCK POCKETS AND EXCESSIVE VOIDS. CONCRETE SHALL BE CONSOLIDATED BY MEANS OF HIGH FREQUENCY INTERNAL VIBRATORS WITHOUT CAUSING WATER OR CEMENT PASTE TO FLUSH TO THE SURFACE. INTERNAL VIBRATOR TYPE, SIZE, AND NUMBER SHALL BE APPROVED BY THE ENGINEER.

22) CONCRETE MIXING COMPANY SHALL PROVIDE TEST RECORDS AND STANDARD DEVIATION PER SECTION 1905 OF 2022 CBC.

SHEAR WALL

1) ONLY COMMON NAILS OR GALVANIZED BOX NAILS SHALL BE PERMITTED FOR REQUIRED NAILING AT VERTICAL SHEAR PANELS AND HORIZONTAL DIAPHRAGMS (ROOF AND FLOOR).

2) ALL SHEARWALLS WITH AN ALLOWABLE SHEAR CAPACITY GREATER THAN 950 pif REQUIRE 3x MEMBERS AT THE FOUNDATION SILL PLATE AND AT ADJACENT PANEL EDGES. A MINIMUM OF 1/2" EDGE DISTANCE FROM THE PANEL EDGE TO THE CENTER OF THE NAIL IS REQUIRED FOR THESE 3x MEMBERS.

3) ALL HOLD DOWN CONNECTORS SHALL BE TIGHTENED UPST PRIOR TO COVERING THE WALL FRAMING. BOLT HOLES FOR HOLD DOWN CONNECTION TO POST SHALL BE 1/16" (MAX) OVERSIZED. INSPECTOR TO VERIFY HOLD DOWN CONNECTIONS.

4) PROVIDE MINIMUM 4x4 POSTS FOR ALL HOLD DOWNS ENDS OF SHEARWALL.

5) APPROVED PLATE WASHERS SHALL BE PROVIDED FOR ALL WOOD STRUCTURAL PANEL SHEAR WALL ANCHOR BOLTS AND FOR ALL HOLD DOWN CONNECTOR BOLTS TO POSTS.

BOLT DIAMETER	PLATE SIZE
5/8"	02129" x 3" x 3"
3/4"	5/16" x 3" x 3"
1"	5/8" x 3" x 3"
1 1/8"	3/8" x 3 1/2" x 3 1/2"

DRAG LINE: DL

DRAG LINE: SIMPSON ST62# @ ALL